

Date: 03/07/2025**To:** Larry Semenza
Superior Walls of North Carolina3570 S. Main Street
Salisbury, North Carolina
28147
lsemenza@superiorwallsnc.com
919.691.4725**Re:** Superior Wall Foundation Review
Location: 164 Horse Path Lane
Holly Springs, NC 27540JDS Project No.: 24903499
Date of Review: 03/07/2025
Plan Revision: 6
Plan Date Modified: 03/07/2025


JDS Consulting, PLLC. has reviewed the aforementioned Superior Wall layout and the plans provided by the builder/architect.

Based on our review the wall locations and dimensions provided on the Superior Wall Layout are correct and shall provide adequate support for the structure above. Crushed stone footings below all wall panels to be a minimum of 24" wide unless noted otherwise. All review and calculations are based on a standard soil bearing capacity of 2000psf.

JDS Consulting, PLLC has reviewed and analyzed only the portions of the structure specifically referred to above. In no event are we to be deemed liable for any deficiencies in the remainder of the structure. Furthermore, we shall not be responsible for structural deficiencies in the superior wall system resulting from defects caused during manufacturing, delivery, placement, or on-site modifications.

If you have any questions or if I can be of further assistance to you on this project, please contact me at 984.204.3723.

Respectfully Submitted,
Nickolas Scudder
JDS Consulting

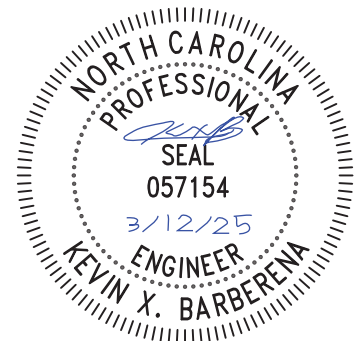

Reviewing Engineer

Attachments: Superior Wall Layouts

SHOP DRAWING GENERAL INFORMATION PAGE

CODES & STANDARDS

Building Code:	2012/2015/2018/2019 IRC, 2012 IBC, 2018 NCRC
ESR Report number:	ESR-1662 August 2018
3rd Party Inspection Agency:	PFS Corporation, Madison WI
Quality Assurance Manual:	Superior Walls of America 2005 Edition
Site Preparation Guide:	Superior Walls Builder Guideline Booklet Rev. June 2022
Fire Test Standards:	ASTM E119 ANSI/UL 1715

WALL MATERIALS

Concrete Compressive Strength:	Min. 5,000 PSI
water/cement Ratio:	<0.40
Reinforcing Steel:	No. 4 and larger - 60,000 PSI No. 3 and smaller - 40,000 PSI
Secondary Reinforcement:	Polypropylene Fiber
Embedded Wood Blocking	Preservatively Pressure Treated
EPS Foam Insulation:	Flame Spread: 20 Smoke Development: 240
XPS Foam Insulation:	Flame Spread: 5 Smoke Development: 165

SITE/WALL CONDITIONS

Frost Depth:	Min. 12 inches
assumed Soil Bearing Capacity:	2,000 PSF
Seismisc Category:	A, B, C
Basic Wind Speed:	155 maximum PSF
Wall Loading:	7,500 Pounds/LF (uniform) Maximum
Brickledge Loading:	2,900 Pounds/LF Maximum
Crushed Stone Footing Depth:	Min. 6 Inches thick or more (see table in Builder Guideline Booklet Table R403.4)
Crushed Stone Footing Width:	See Crushed Stone Footing Chart in Builder Guideline Booklet
Crushed Stone Size:	3/8 Inch and smaller (cleaned)
Backfill Material:	100 LB/CF Equivalent Fluid Pressure Max (see Builder Guideline booklet for more information)
Beam Pocket(s) & Point Load(s):	38,000 Pound Maximum - Data supplied by Customer/Builder (see plan for location and sizes)
Crushed Stone Footing Width:	24 inches U.N.O.

GENERAL NOTES

1. Jobsite shall be prepared by the builder in accordance with the Superior Walls of America builder Guideline Booklet - Site Preparation and Framing Attachment Requirements (Rev. January 2016).
2. Auxiliary drain pipe must be four (4) inch diameter perforated, covered with filter fabric and directed to a sump pit or daylight.
3. Builder shall establish the elevation benchmark (if necessary)
4. Builder shall insure proper site access for trucks and crane.

INSTALLATION NOTES

1. Installation shall be supervised by a Superior Walls certified installer. Certification is obtained through Superior Walls of America, Ltd.
2. Installation shall comply with Superior Walls of America's Installation Manual (Rev. July 2011).

DRAWING NOTES

1. All measurements for brick, stone, or support ledges are from Top Of Wall (TOW).
2. Drawings are not to scale.

DAMP PROOFING

Superior Walls are recognized by the ICC-ES as an alternative method of providing foundation wall damp proofing. No additional damp proofing is required. (See ESR-1662 & ICC-ES Legacy Report 21-72)

PLEASE NOTE

To comply with building code requirements, the framing/decking connections at the top of the Superior Walls and floor slab at the bottom of the Superior Wall MUST be completed PRIOR to backfilling.

CUSTOMER RELEASE

The attached drawing was created from information and dimensions provided by the customer/builder. Superior Walls of North Carolina, Inc. is not responsible for deviations from the Blue Print or information provided by the customer/builder.

I have reviewed the attached drawing & all of the dimensions and objects therein; I understand the Superior Walls will be custom manufactured per this drawing specifically for my project. By signing below I am certifying that I have reviewed the attached drawing and all of its listed dimensions and I accept FULL RESPONSIBILITY of any and all measurements and information provided by me/my associates/my company.

CUSTOMER MUST SIGN & DATE BELOW

Customer/Builder Signature & Date

PROJECT:

Job Number:	224-20212
Job Name:	224-20212
Job Address:	164 Horse Path Lane
Lot #:	----

BUILDER:

Company:	Black Sheep Construction
----------	--------------------------

Contact:
Phone/Email: ----

MUNICIPALITY:

Wake County
HOLLY SPRINGS, NC



3570 S. Main Street
Salisbury, NC 28147
Phone: 704-636-6200
Toll-Free: 877-896-9255
www.superiorwallsnc.com


DRAWING DATA:

Job Number:	224-20212
Sales Rep:	L.SEMENZA

Drawn By: JG

Date Created:	Nov. 04, 2024
Date Modified:	Mar. 07, 2025
Revision:	6

Pages: 5

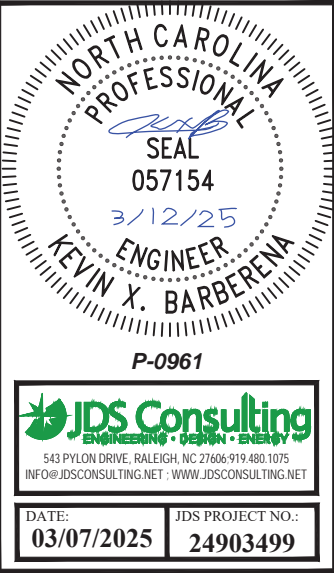

4' WALLS - TOTAL LENGTH: 48'-10"
6' WALLS - TOTAL LENGTH: 2'
10' WALLS - TOTAL LENGTH: 362'-9"

1/2" DIA. x 6" BOLTS FOR SILL PLATE

MINIMUM OF 2x8 SILL PLATE REQUIRED

#	DESCRIPTION									
2	L.F. OF 10' SOLID WALL (10 1/4" THICK)									
3	BRICK LEDGE TOTALING 37'-10"									
29	SLAB CONNECTOR									
49	L.F. OF SHOE BLOCK TOP (12" H x 5" D)									
ID	#	OBJECT	DESCRIPTION			WIDTH	HEIGHT	FROM TOP OF WALL	FROM BOT OF WALL	MAX HDR CAPACITY
A	1	DOOR	STYLE 1			47"	83"	33"	4"	5500 PLF
B	1	DOOR	STYLE 1			39"	83"	33"	4"	5500 PLF
ID	#	OBJECT	DESCRIPTION			# STUDS	HEIGHT			
C	5	EXTRA STUD				2	114"			
ID	#	OBJECT	LENGTH	WIDTH	THICKNESS	DESCRIPTION				
D	2	FOOTER PAD	36"	36"	6"					


BUILDER CHECK LIST:
-RO's/DIMS/WALL HEIGHT CORRECT?
-OBJECT OPENINGS CORRECT?
-WOOD BUTTS IND./REQ'D?
-SUPPORT/BRICK LEDGES CORRECT?
-EXTRA SUPPORT IND. FOR PT. LOAD?


SIGNATURE: _____
DATE: _____

PLEASE NOTE:
Adjustments made after sign-offs may incur an additional \$200 service charge

OWNER/BUILDER NOTIFICATION:
BY SIGNING THESE DRAWINGS YOU ARE ACKNOWLEDGING THAT THE WALLS WILL BE BUILT TO THE DIMENSIONS INDICATED ON THESE PLANS, AND THAT YOU ARE ASSUMING ANY AND ALL LIABILITY THAT MAY RESULT FROM THE WALLS BEING MANUFACTURED AS SHOWN


THESE DRAWINGS ARE APPROVED FOR FINAL PRODUCTION AS ILLUSTRATED AND NOT SUBJECT TO CHANGE.
CUSTOMER SIGNATURE: _____ DATE: _____





DATE:
03/07/2025

JDS PROJECT NO.:
24903499



3570 S. Main Street
Salisbury, NC 28147
Phone: 704-636-6200
Toll-Free: 877-896-9255

PROJECT:
164 Horse Path Lane

BUILDER:
Black Sheep Construction


STATUS: ISSUED FOR APPROVAL

SALESMAN: L.Semenza

FILENAME: 224-20212

SHEET TITLE: SUMMARY

SHEET NO. 2 of 5

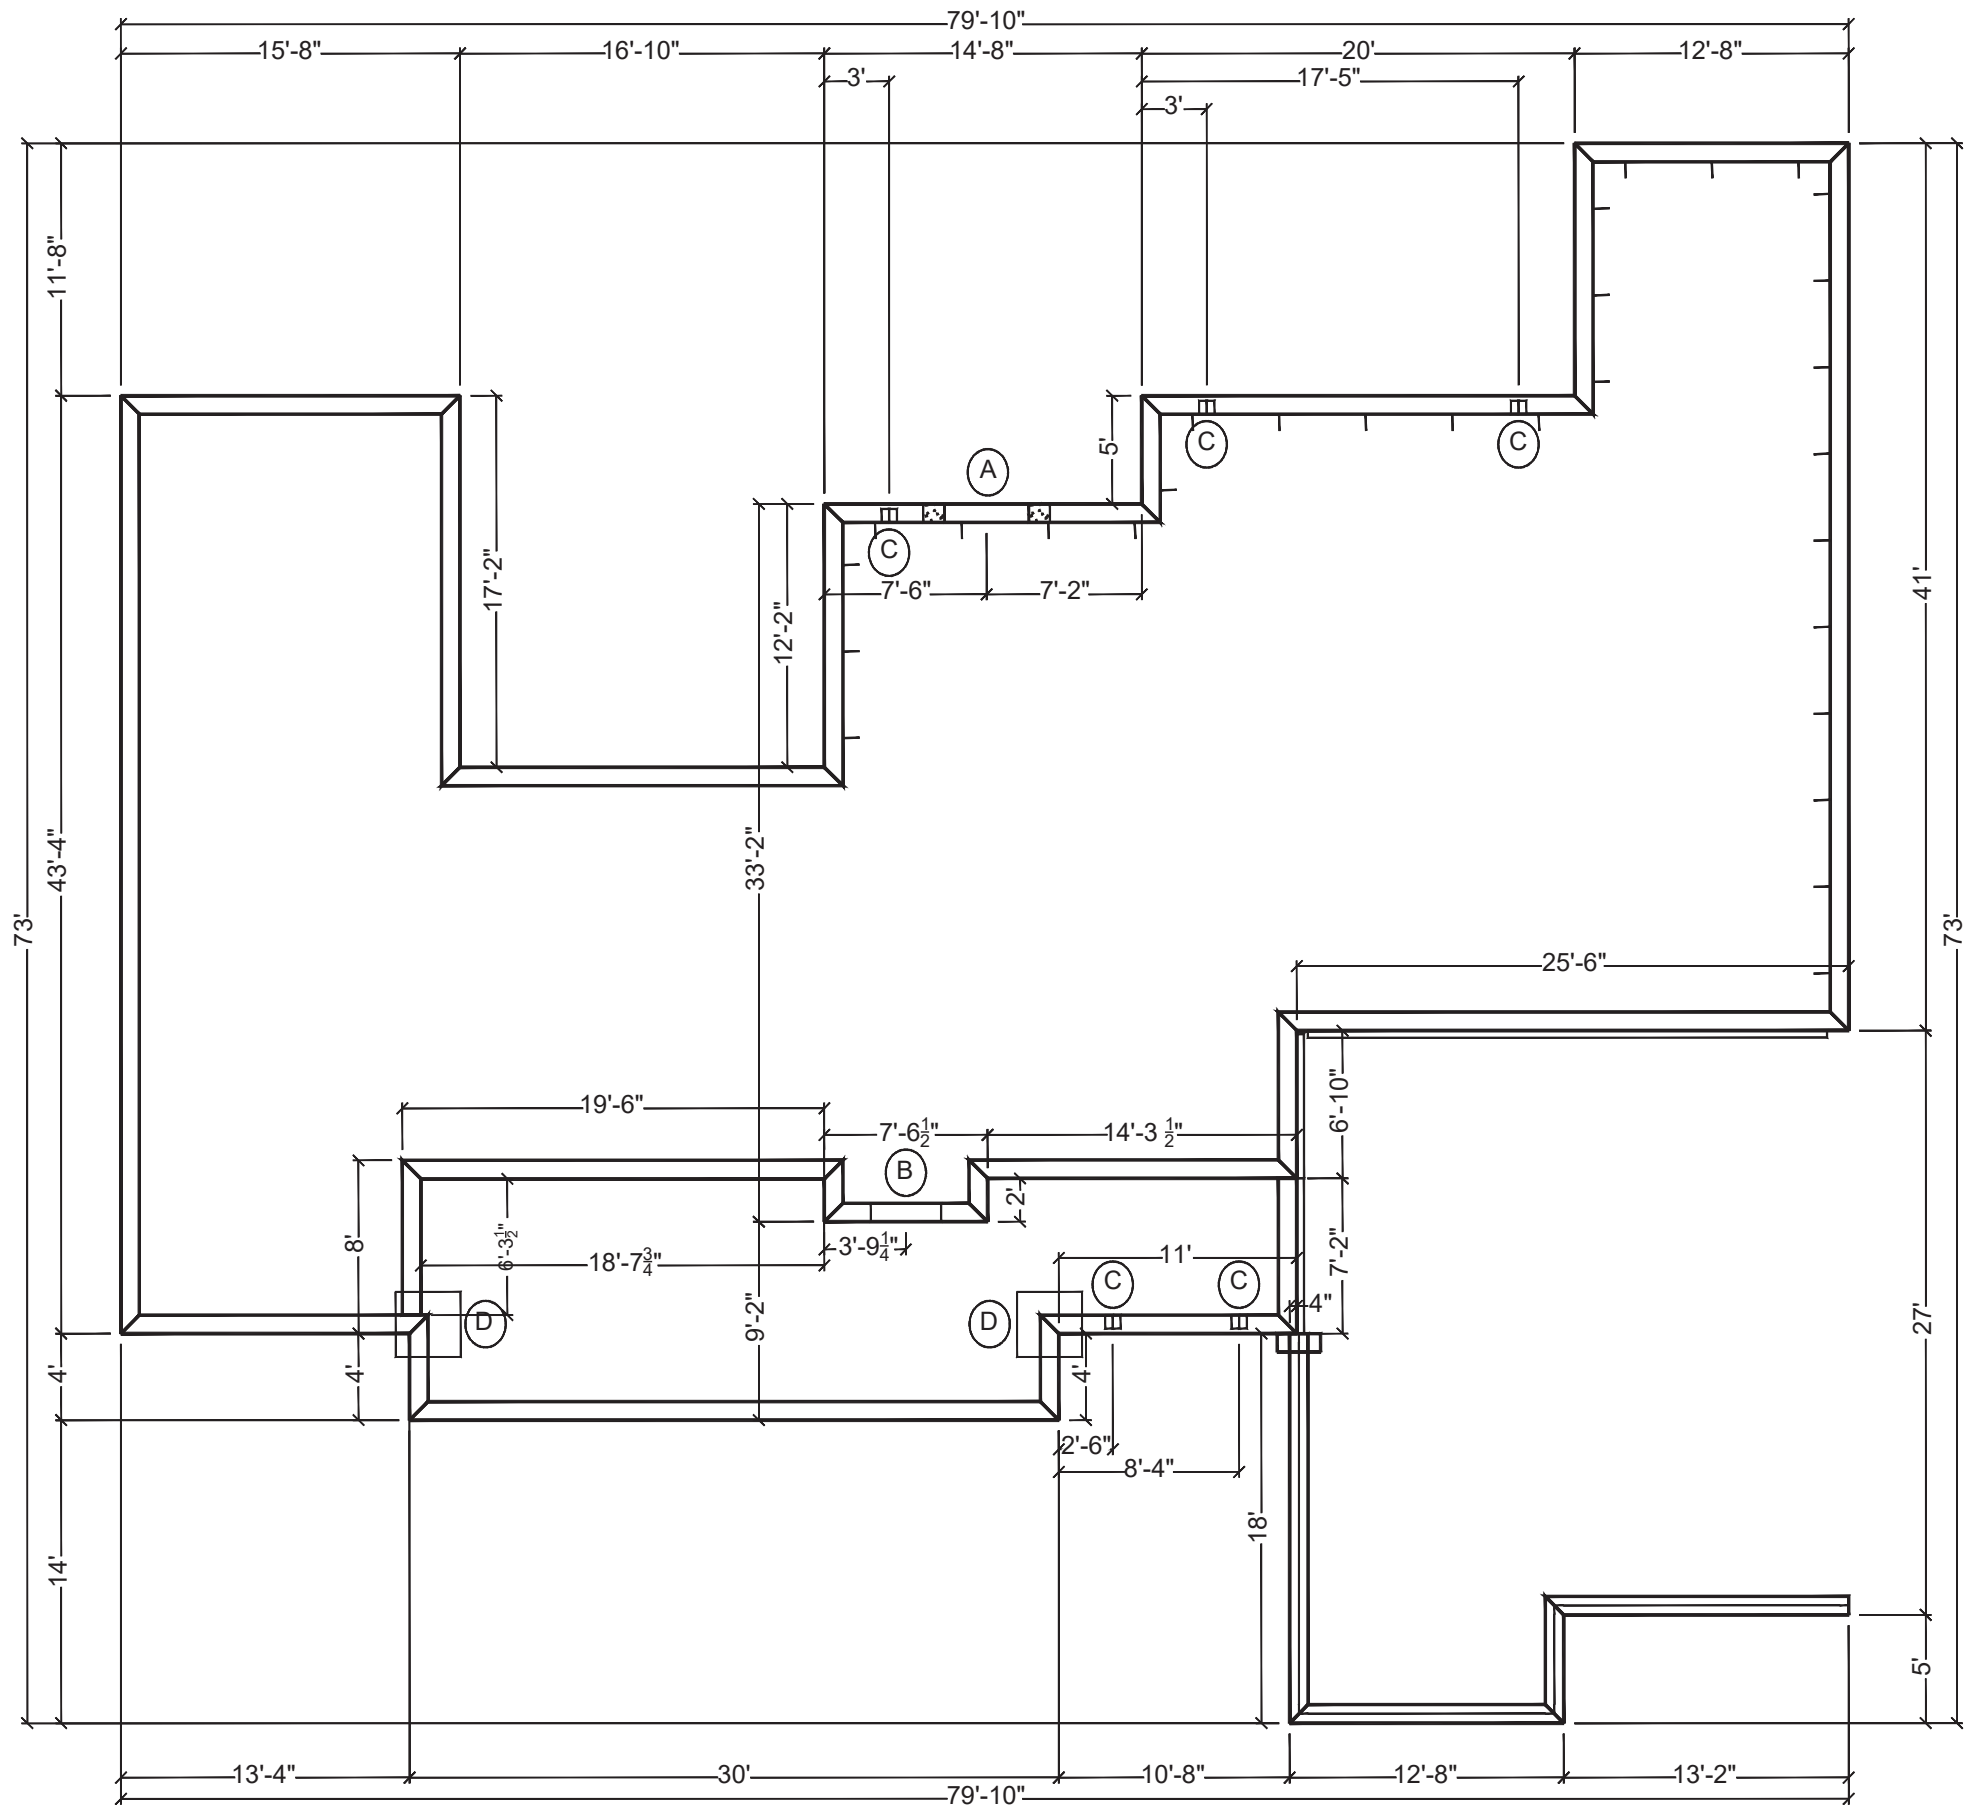

L.SEMENZA
BLACK SHEEP CONSTRUCTION
164 HORSE PATH LANE

10' Walls
4' Walls

MIN STONE DEPTH
FOR 2,000 PSF SOIL BEARING
1-STORY - 6"
2-STORY - 8"
3-STORY - 14"
24" MIN. WIDTH U.N.O.

Shear walls may be required,
refer to builder guideline
booklet for more information

Top of wall slab detail
per builder guideline
book must be adhered to

BRACING REQ'D AT
TOP AND BOTTOM OF
PORCH WALLS PRIOR
TO BACKFILL

Garage backfill procedures
in builder guideline booklet
must be adhered to



DATE: 03/07/2025 JDS PROJECT NO.: 24903499

Superior Walls
of North Carolina

3570 S. Main Street
Salisbury, NC 28147
Phone: 704-636-6200
Toll-Free: 877-896-9255

REV.	DATE	BY
1	11-04-24	JG
3	12-03-24	BS
4	12-09-24	BS
5	01-15-25	JG
6	03-07-25	BS

PROJECT: 164 Horse Path Lane
BUILDER: Black Sheep Construction

STATUS: ISSUED FOR APPROVAL

SALESMAN: L.Semenza

FILENAME: 224-20212

SHEET TITLE:
PLAN W/O DIMS

SHEET NO. 3 of 5

CUSTOMER SIGNATURE: _____ DATE: _____



P-0961



DATE:
03/07/2025

JDS PROJECT NO.:
24903499



3570 S. Main Street
Salisbury, NC 28147
Phone: 704-636-6200
Toll-Free: 877-896-9255

REV.	DATE	BY
1	11-04-24	JG
3	12-03-24	BS
4	12-09-24	BS
5	01-15-25	JG
6	03-07-25	BS

PROJECT:
164 Horse Path Lane
BUILDER:
Black Sheep Construction


STATUS: ISSUED FOR
APPROVAL

SALESMAN: L.Semenza

FILENAME: 224-20212

SHEET TITLE:
ISOMETRIC 1


SHEET NO. 4 of 5

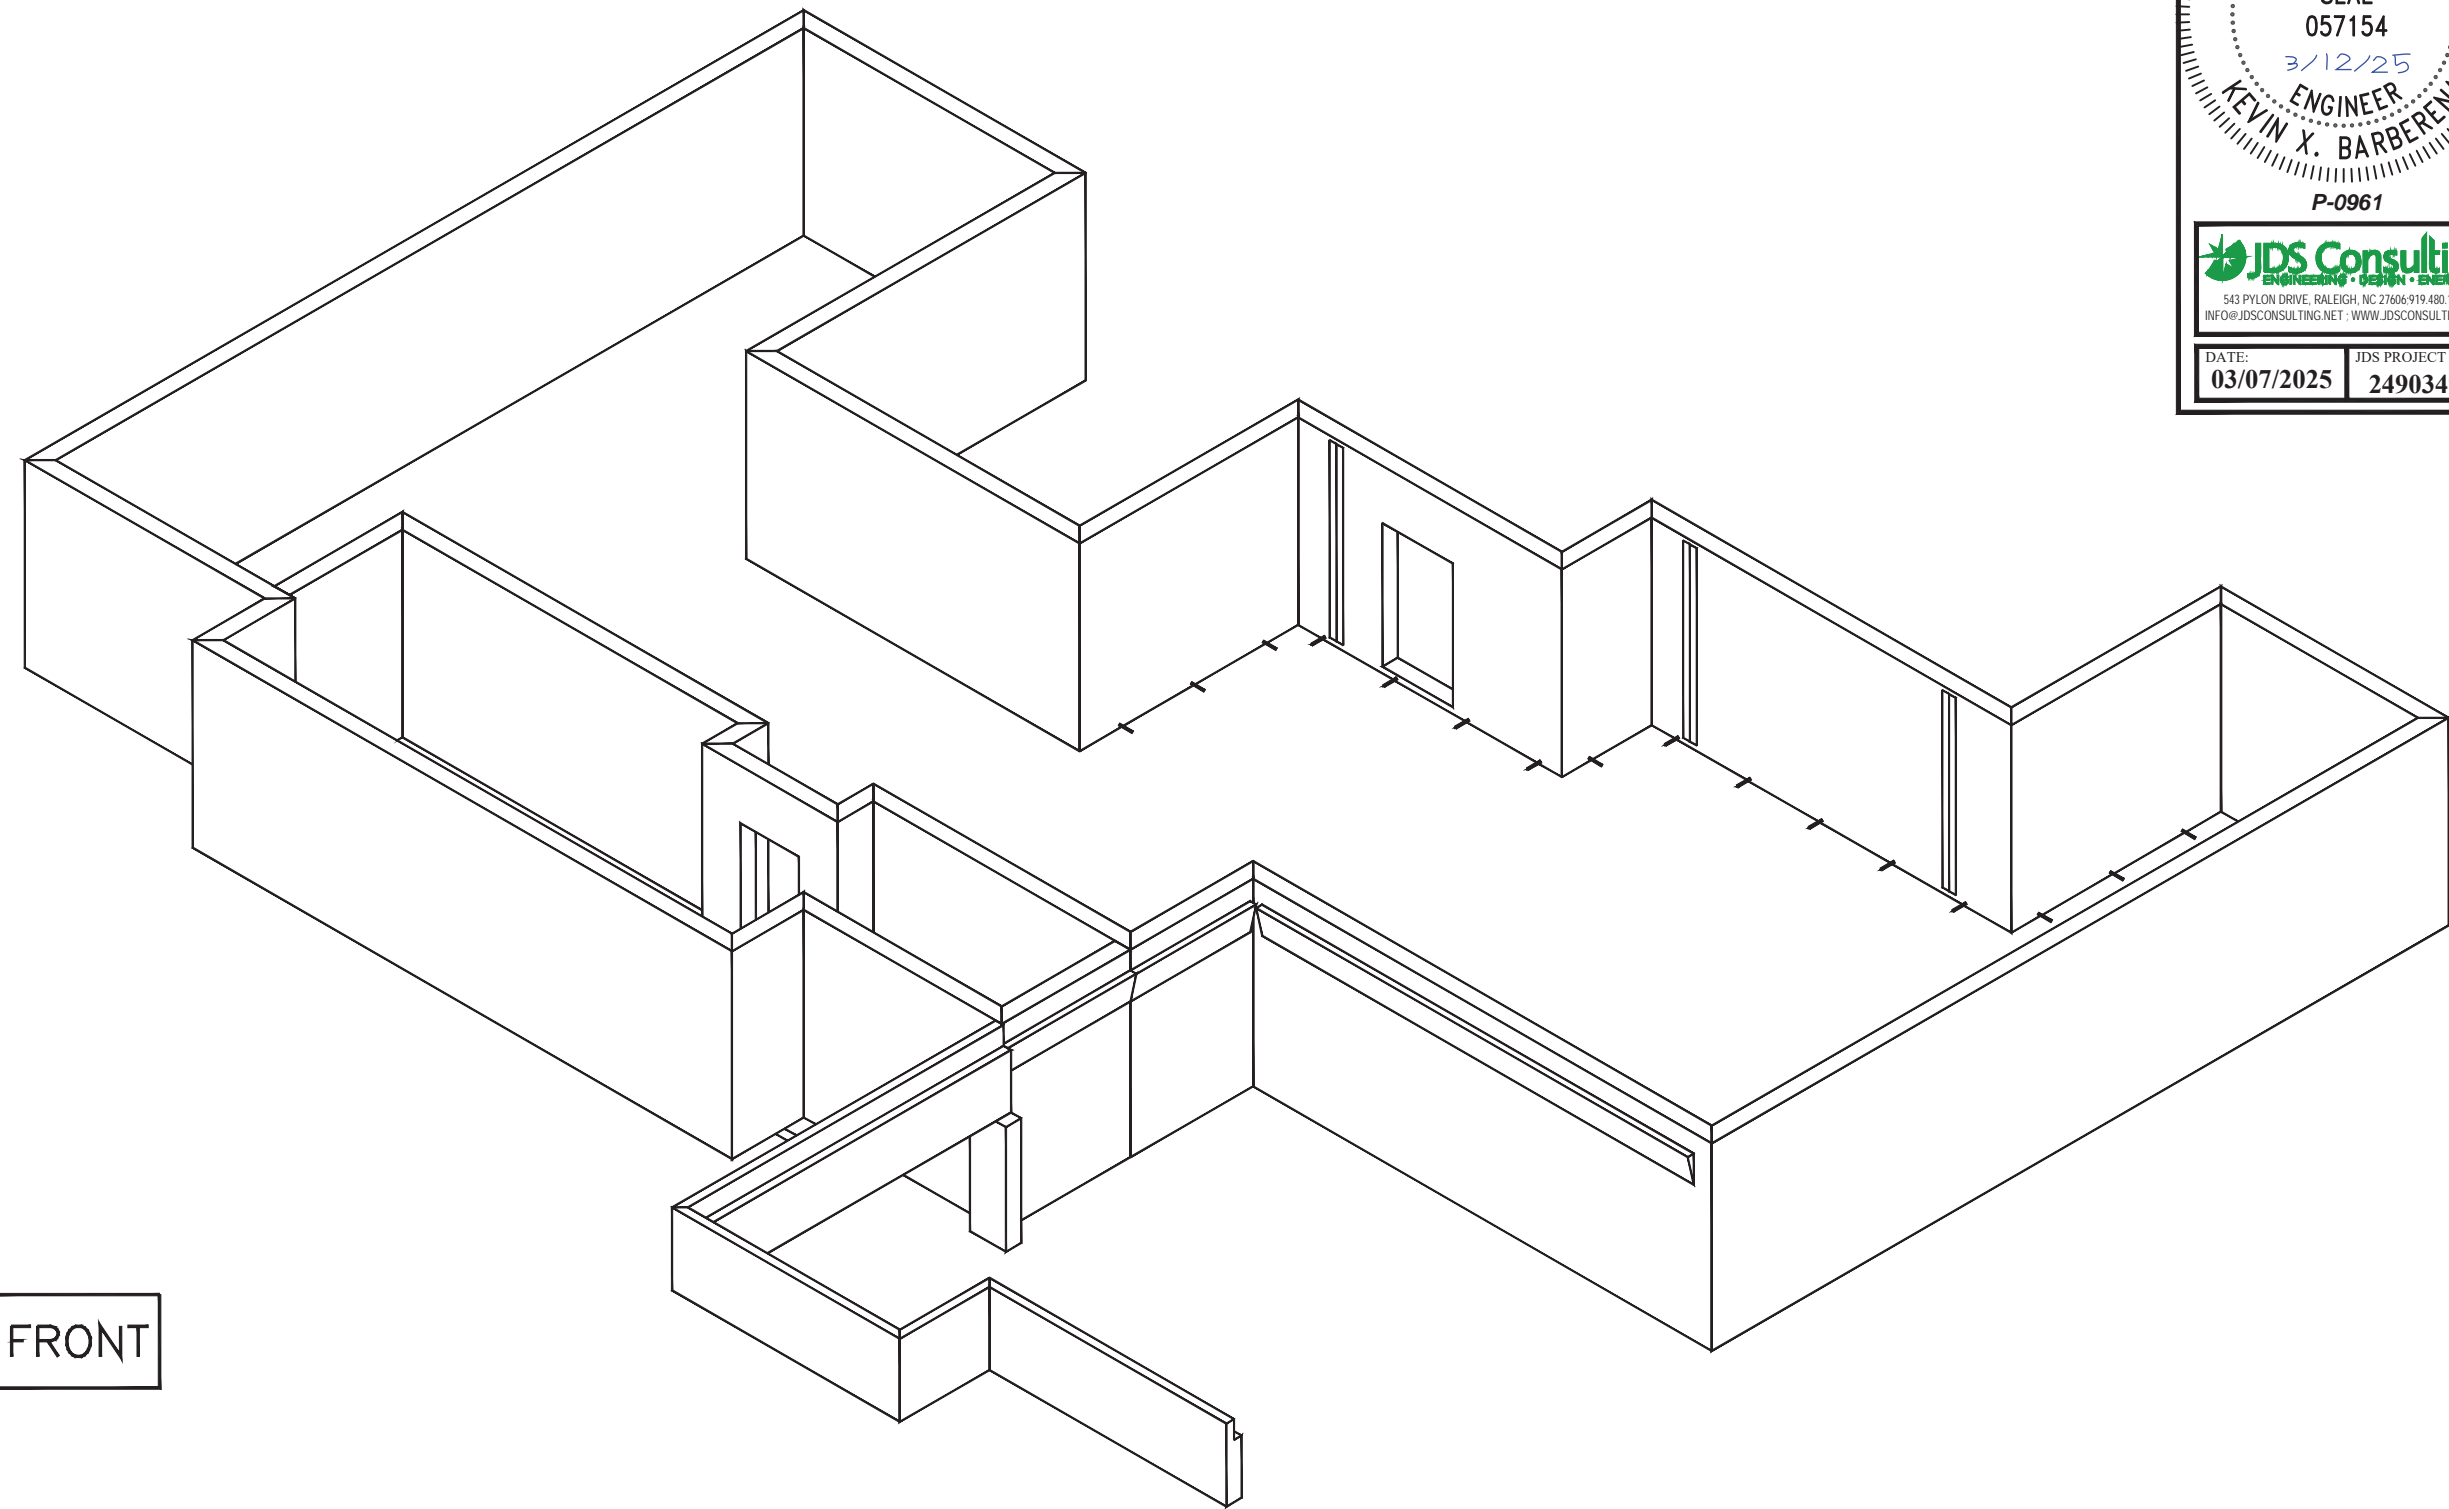

LEFT

FRONT

CUSTOMER SIGNATURE: _____ DATE: _____

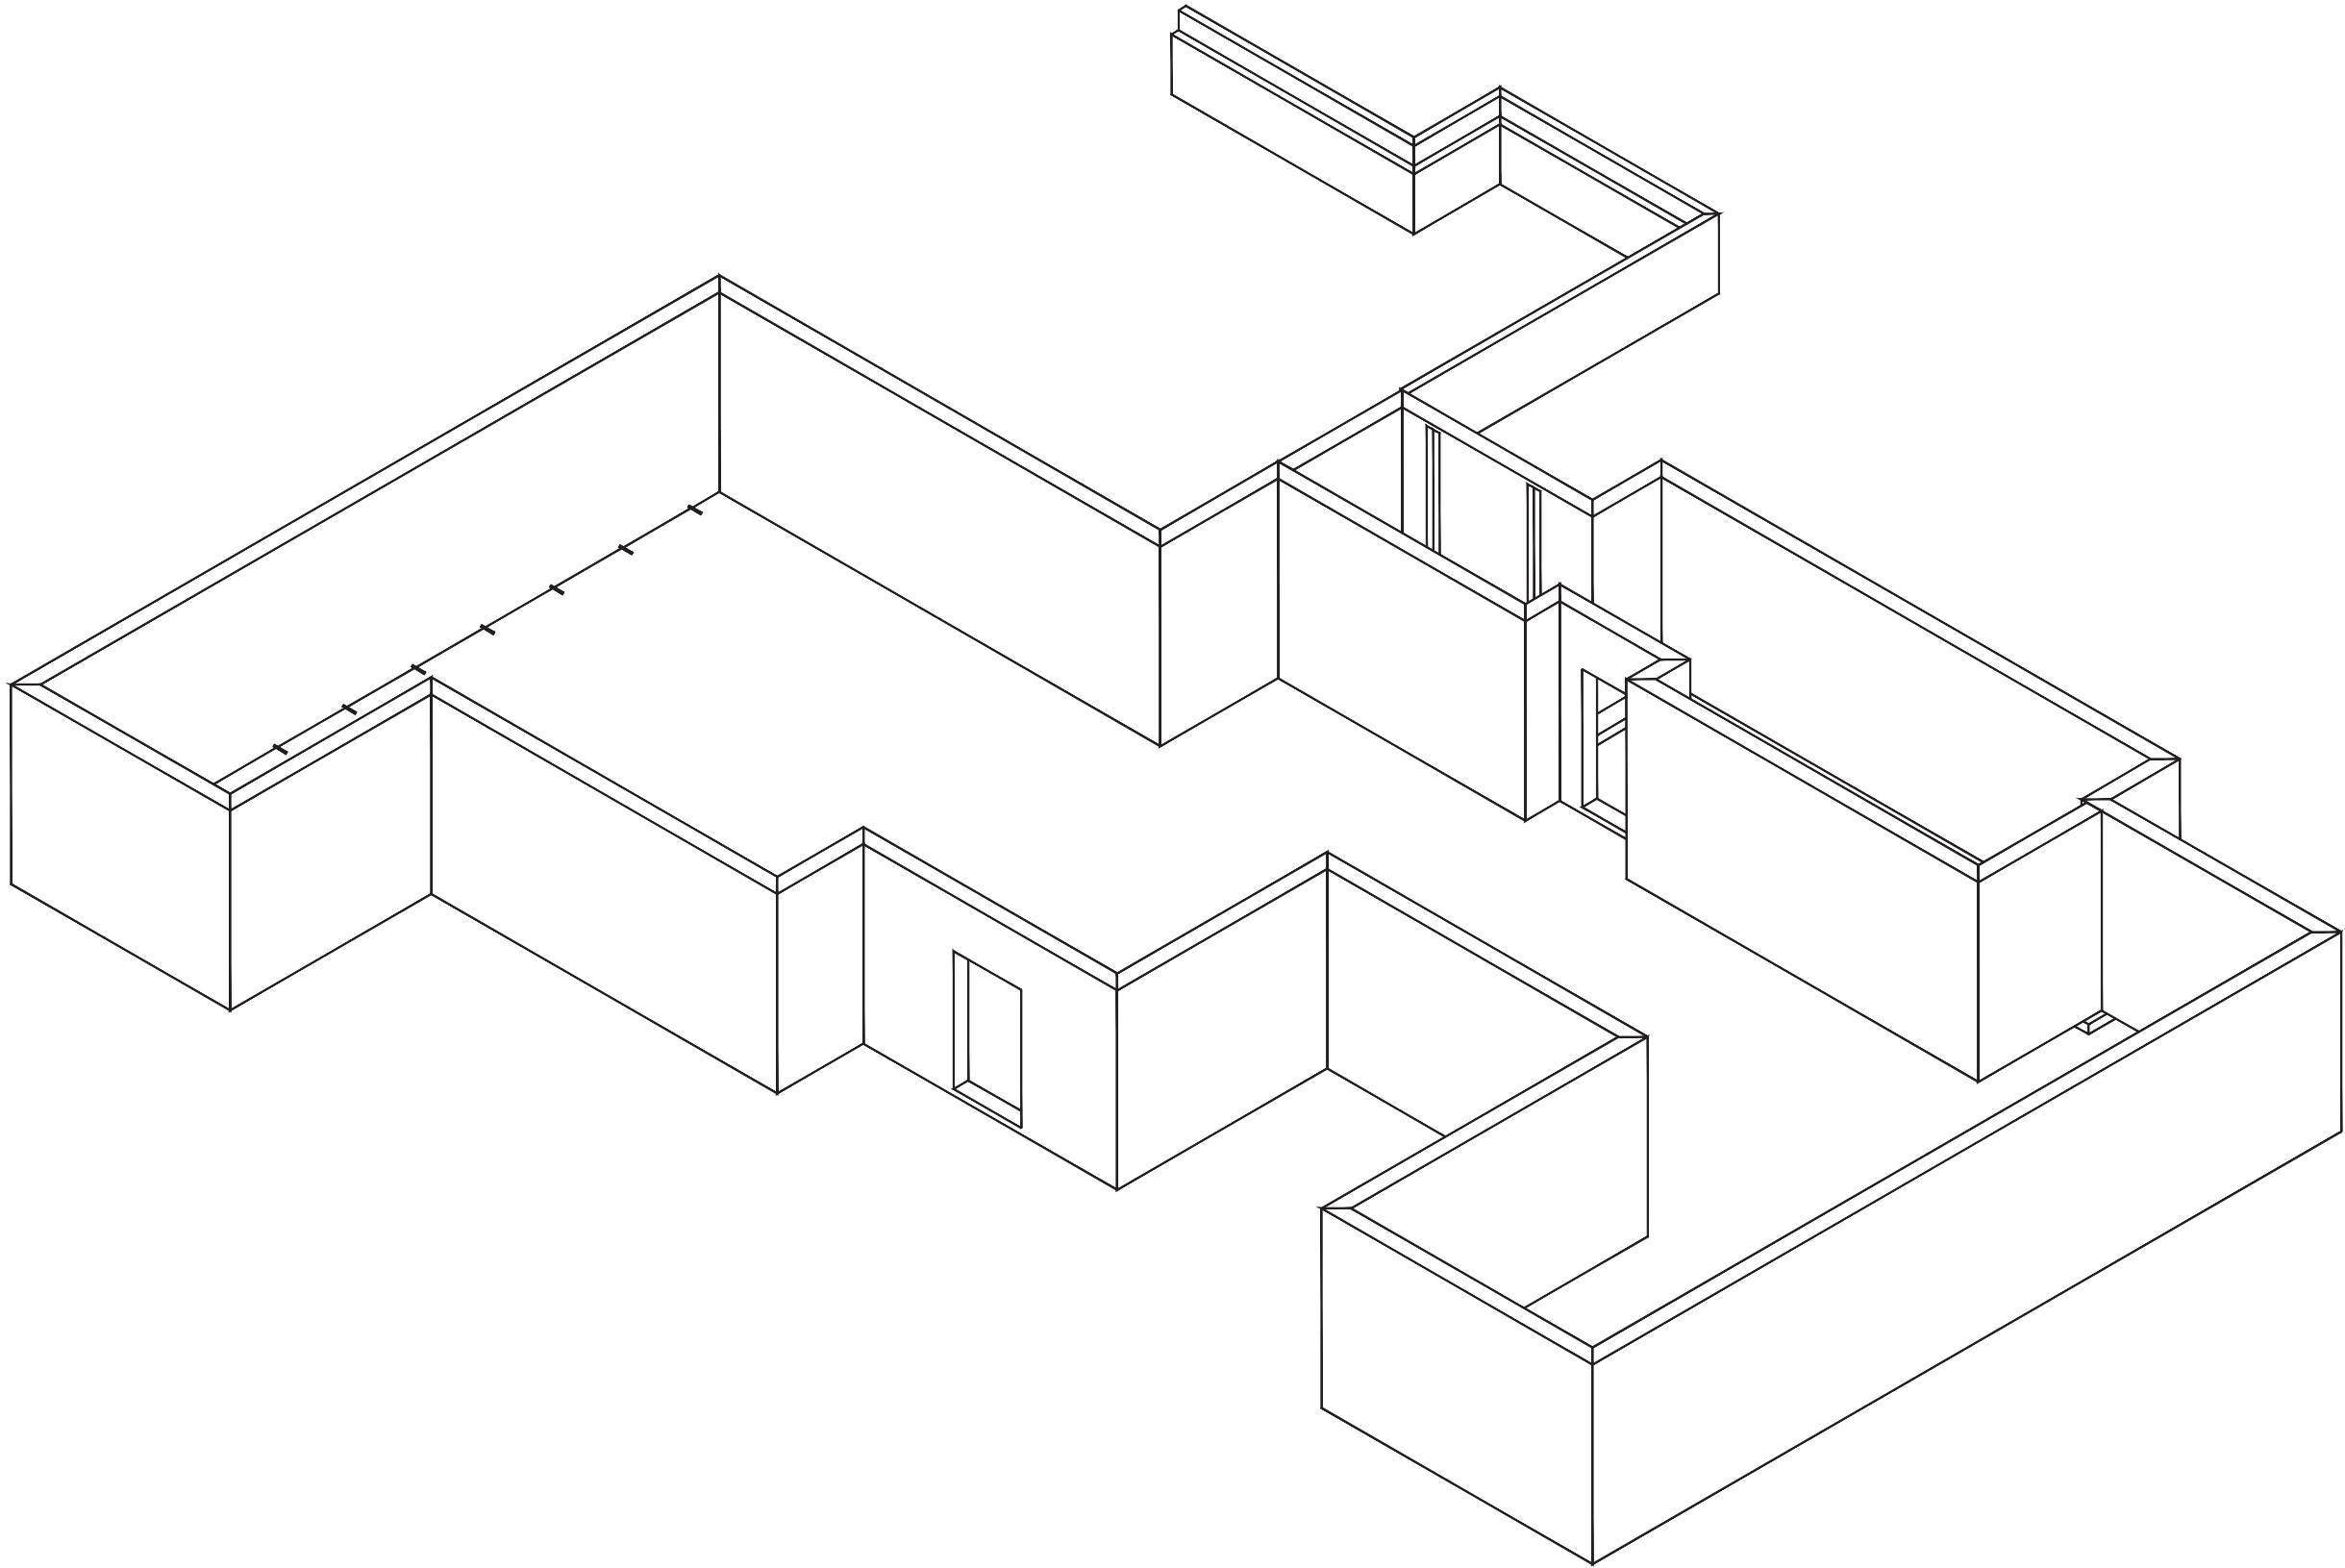



543 PYLON DRIVE, RALEIGH, NC 27606-919-480.1075
INFO@JDSCONSULTING.NET | WWW.JDSCONSULTING.NET

DATE:
03/07/2025

JDS PROJECT NO.:
24903499



Superior Walls
of North Carolina

3570 S. Main Street
Salisbury, NC 28147
Phone: 704-636-6200
Toll-Free: 877-896-9255

REV.	DATE	BY
1	11-04-24	JG
3	12-03-24	BS
4	12-09-24	BS
5	01-15-25	JG
6	03-07-25	BS

PROJECT:

164 Horse Path Lane

BUILDER:

Black Sheep Construction

STATUS:

ISSUED FOR APPROVAL

SALESMAN:

L.Semenza

FILENAME:

224-20212

SHEET TITLE:

ISOMETRIC 2

SHEET NO.

5 of 5

CUSTOMER SIGNATURE: _____

DATE: _____