

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 46064

JOB: 24-1487-F02

JOB NAME: LOT 0.0130 BLAKE POND

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

25 Truss Design(s)

Trusses:

F200, F201, F202, F203, F204, F205, F206, F207, F208, F209, F210, F212, F213, F214, F216, F217, F218, F219, F220, F221, F222, F223, F224, F225, F227



3/1/2024


Mark Morris

Warning !—Verify design parameters and read notes before use.

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for*

Job 24-1487-F02	Truss F200	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:34:59 2024 Page 1
ID: oDuWOOmHxMOj2fwcp2aKqzMG6w-saglsbJBRElxOvzuR3KUIINbxBM2wdsqHnobkqWzefW

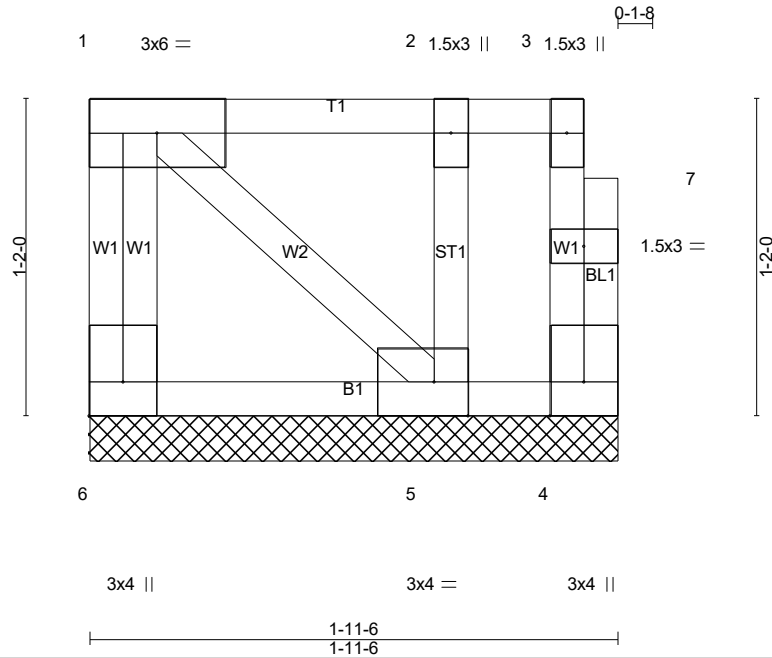

Scale = 1:8.5

Plate Offsets (X,Y)-- [5:0-1-8,Edge], [6:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Lumber DOL 1.00	WB 0.03	Horz(CT)	-0.00	4	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2021/TPI2014						Weight: 14 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)
 OTHERS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 1-11-6 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 6=54/1-11-6 (min. 0-1-8), 4=-9/1-11-6 (min. 0-1-8), 5=136/1-11-6 (min. 0-1-8)
 Max Uplift4=-9(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES- (7)**
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 9 lb uplift at joint 4.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Job	Truss	Truss Type	Qty	Ply	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC
24-1487-F02	F201	GABLE	1	1	Job Reference (optional) # 46064

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:00 2024 Page 1
 ID: oDuWOOmHlXMOj2fwcp2aKqzMG6w-KnE83xKpCYto03Y4?nrjqa76omO2MjzR?SKHMyzeFv

0₁-8

0₁-8

Scale = 1:24.4

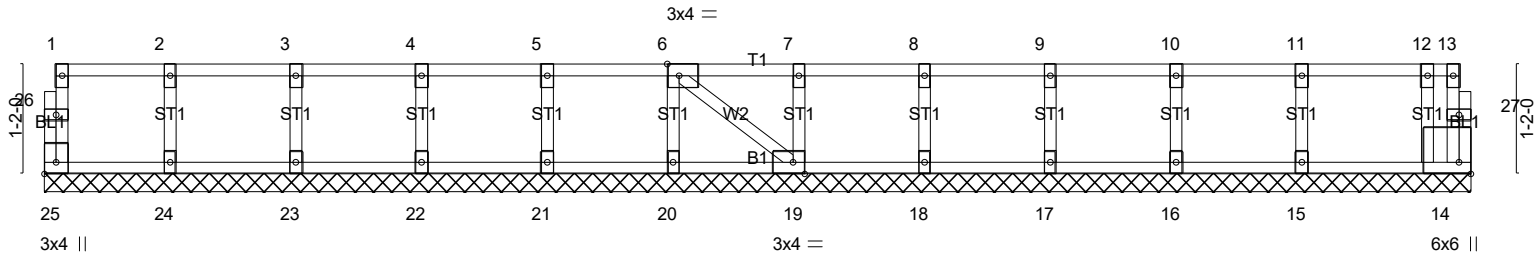

1-4-0	2-8-0	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-4-0	14-8-0	15-1-8
1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-5-8

Plate Offsets (X,Y)-- [6:0-1-8,Edge], [14:Edge,0-1-8], [19:0-1-8,Edge], [25:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 67 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 15-1-8.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 25, 14, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

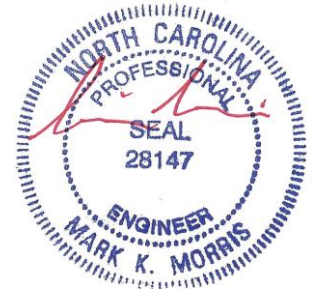

3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F202	Truss Type Floor	Qty 5	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:01 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-ozoWHHLRzr?fdD7GZUMyNogA89XT5eKaE64ruOzeFvu

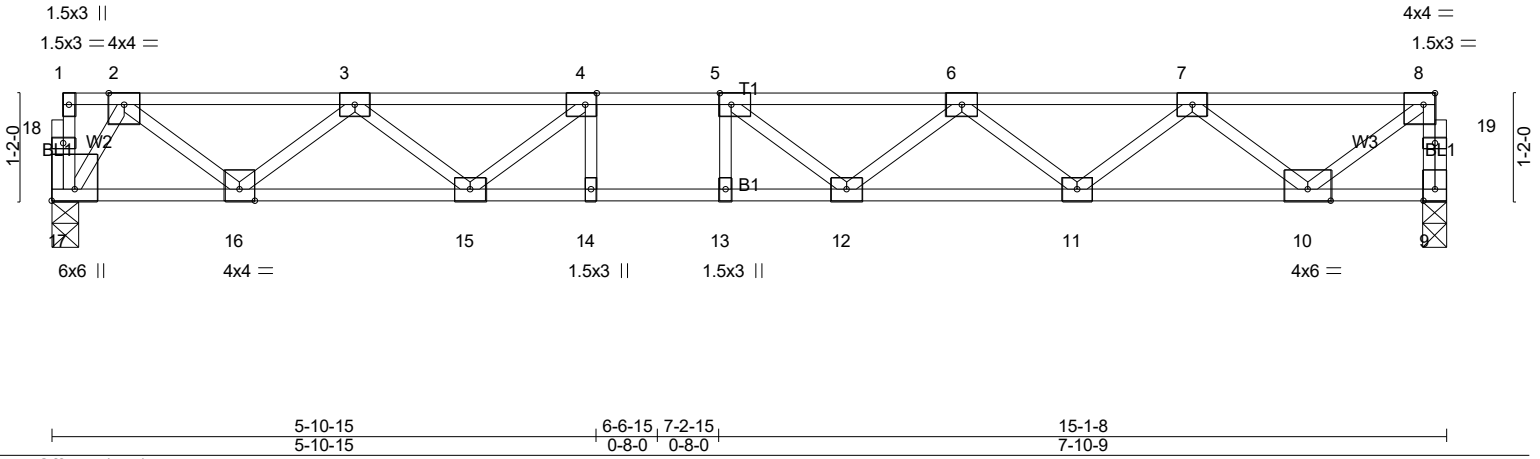


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [8:0-1-8,Edge], [17:Edge,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.47	Vert(LL)	-0.17	12-13	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.83	Vert(CT)	-0.23	12-13	>769		
BCLL 0.0	Lumber DOL 1.00	WB 0.54	Horz(CT)	0.04	9	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 77 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 9=812/0-3-0 (min. 0-1-8), 17=812/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 9-19=-807/0, 8-19=-806/0, 2-3=-1279/0, 3-4=-2399/0, 4-5=-2863/0, 5-6=-2814/0, 6-7=-2229/0, 7-8=-935/0
BOT CHORD 16-17=0/533, 15-16=0/1989, 14-15=0/2863, 13-14=0/2863, 12-13=0/2863, 11-12=0/2686, 10-11=0/1749
WEBS 4-15=-678/0, 3-15=0/542, 3-16=-924/0, 2-16=0/971, 2-17=-998/0, 5-12=-319/169, 6-12=0/293, 6-11=-594/0, 7-11=0/625, 7-10=-1060/0, 8-10=0/1130

NOTES- (4)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



3/1/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F203	Truss Type Floor	Qty 4	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:02 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-G9LuUcM3k98WFMiS7CtBw?DKiZsUq4SjTmPORrZeFvt



Scale: 1/2"=1'


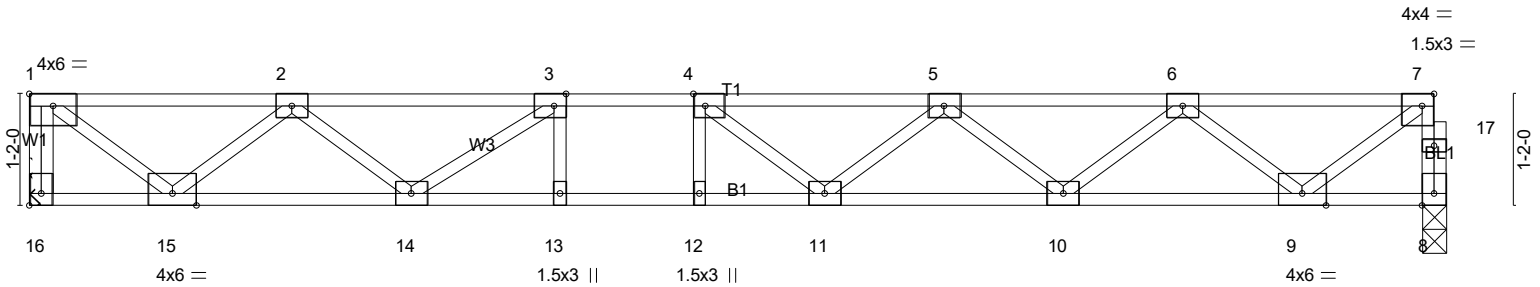


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [7:0-1-8,Edge], [16:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.48	Vert(LL)	-0.16	11-12	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.85	Vert(CT)	-0.22	11-12	>781		
BCLL 0.0	Lumber DOL 1.00	WB 0.55	Horz(CT)	0.04	8	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 75 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 16=802/Mechanical, 8=796/0-3-0 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-16=-798/0, 8-17=-791/0, 7-17=-790/0, 1-2=-914/0, 2-3=-2152/0, 3-4=-2733/0, 4-5=-2715/0, 5-6=-2170/0, 6-7=-914/0

BOT CHORD 14-15=0/1712, 13-14=0/2733, 12-13=0/2733, 11-12=0/2733, 10-11=0/2609, 9-10=0/1708

WEBS 1-15=0/1147, 2-15=-1038/0, 2-14=0/573, 3-14=-752/0, 4-11=-291/196, 5-11=-0/271, 5-10=-571/0, 6-10=0/601, 6-9=-1035/0, 7-9=0/1104

NOTES- (6)

- Unbalanced floor live loads have been considered for this design.
- All plates are 3x4 MT20 unless otherwise indicated.
- Refer to girder(s) for truss to truss connections.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC
24-1487-F02	F204	Floor	3	1	Job Reference (optional) # 46064

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:03 2024 Page 1
 ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-kMvGhyMhVTGNtWHfgvOQSDIW4zH4ZXlthPZxzHzeFvs



Scale = 1:35.6


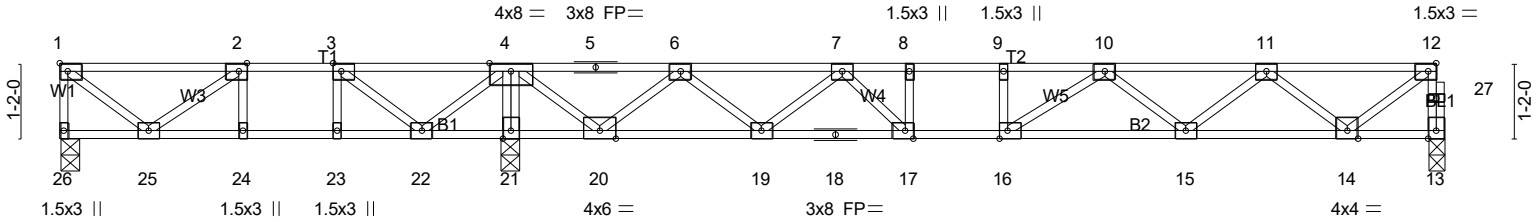


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [12:0-1-8,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.44	Vert(LL)	-0.13	15-16	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.57	Vert(CT)	-0.17	15-16	>990		
BCLL 0.0	Rep Stress Incr	YES	WB 0.57	Horz(CT)	0.03	13	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 108 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 26=219/0-3-8 (min. 0-1-8), 13=703/0-3-0 (min. 0-1-8), 21=1407/0-3-8 (min. 0-1-8)
 Max Uplift 26=-49(LC 4)
 Max Grav 26=327(LC 3), 13=716(LC 7), 21=1407(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-26=-328/39, 13-27=-709/0, 12-27=-708/0, 1-2=-259/97, 2-3=-475/335, 3-4=-74/700,
 6-7=-1449/0, 7-8=-2220/0, 8-9=-2220/0, 9-10=-2220/0, 10-11=-1878/0, 11-12=-805/0
 BOT CHORD 24-25=-335/475, 23-24=-335/475, 22-23=-335/475, 21-22=-1145/0, 20-21=-1145/0,
 19-20=0/949, 18-19=0/1942, 17-18=0/1942, 16-17=0/2220, 15-16=0/2187, 14-15=0/1515
 WEBS 3-23=0/263, 8-17=-290/0, 4-21=-1350/0, 1-25=-124/330, 2-25=-266/292, 3-22=-774/0,
 4-22=0/630, 4-20=0/1203, 6-20=-1115/0, 6-19=0/694, 7-19=-691/0, 7-17=0/579,
 12-14=0/973, 11-14=-924/0, 11-15=0/472, 10-15=-402/0, 10-16=-187/279

- NOTES-** (6)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 49 lb uplift at joint 26.
 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F205	Truss Type Floor	Qty 2	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:05 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-hk106eOy14W56qR1oKQuXerrknxJ1QhA9j2219zeFvq



Scale = 1:39.3

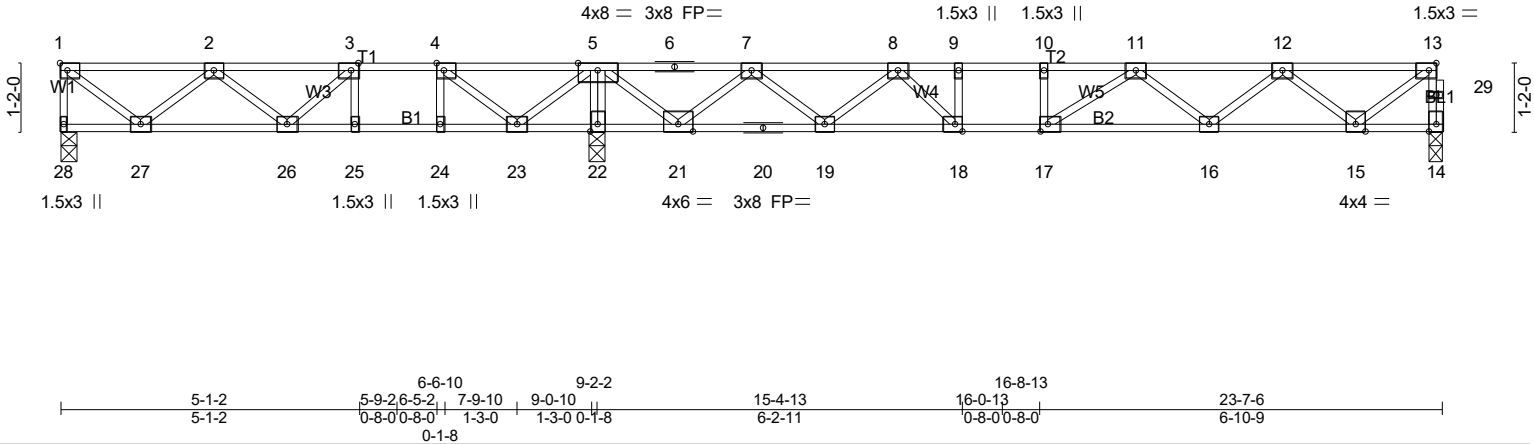


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [13:0-1-8,Edge], [17:0-1-8,Edge], [18:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.50	Vert(LL) -0.12	16-17	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.65	Vert(CT) -0.17	16-17	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.58	Horz(CT) 0.03	14	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					
							Weight: 119 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 28=361/0-3-8 (min. 0-1-8), 14=692/0-3-0 (min. 0-1-8), 22=1517/0-3-8 (min. 0-1-8)
 Max Grav 28=453(LC 3), 14=703(LC 7), 22=1517(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-28=-445/0, 14-29=-696/0, 13-29=-695/0, 1-2=-438/19, 2-3=-858/188, 3-4=-764/430,
 4-5=-157/805, 5-6=0/270, 6-7=0/270, 7-8=-1318/0, 8-9=-2127/0, 9-10=-2127/0,
 10-11=-2127/0, 11-12=-1830/0, 12-13=-787/0
 BOT CHORD 26-27=-51/841, 25-26=-430/764, 24-25=-430/764, 23-24=-430/764, 22-23=-1238/0,
 21-22=-1238/0, 20-21=0/804, 19-20=0/804, 18-19=0/1827, 17-18=0/2127, 16-17=0/2122,
 15-16=0/1482
 WEBS 3-25=-311/0, 4-24=0/325, 9-18=-299/0, 5-22=-1451/0, 1-27=-24/559, 2-27=-525/42,
 3-26=0/405, 4-23=-990/0, 5-23=0/801, 5-21=0/1217, 7-21=-1129/0, 7-19=0/704,
 8-19=-703/0, 8-18=0/598, 13-15=0/952, 12-15=-904/0, 12-16=0/453, 11-16=-380/0,
 11-17=-206/254

- NOTES-** (5)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F206	Truss Type Floor	Qty 9	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:06 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-9xbPK_PanOeyk_0EM1y74rN2AAHbmwrJONnbaczeFvp



Scale = 1:31.2


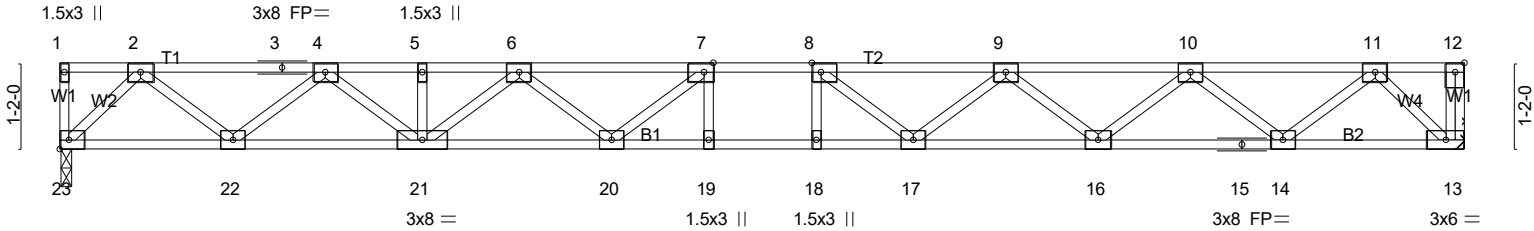


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.24 18-19	>929	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.64	Vert(CT)	-0.33 18-19	>675	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.39	Horz(CT)	0.06 13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 96 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 13=690/Mechanical, 23=690/0-2-0 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1304/0, 3-4=-1304/0, 4-5=-2374/0, 5-6=-2374/0, 6-7=-2940/0, 7-8=-3108/0, 8-9=-2931/0, 9-10=-2356/0, 10-11=-1330/0
BOT CHORD 22-23=0/668, 21-22=0/1918, 20-21=0/2760, 19-20=0/3108, 18-19=0/3108, 17-18=0/3108, 16-17=0/2748, 15-16=0/1945, 14-15=0/1945, 13-14=0/695
WEBS 7-20=-390/57, 6-20=0/321, 6-21=-494/0, 4-21=0/582, 4-22=-800/0, 2-22=0/827, 8-17=-397/50, 9-17=0/323, 9-16=-510/0, 10-16=0/536, 10-14=-800/0, 11-14=0/827, 11-13=-965/0, 2-23=-949/0

- NOTES-** (6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 23.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard




3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F207	Truss Type Floor	Qty 2	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:07 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-d79nXKPCYhmpL8bQvITMd3wDLabVHRSc1X962zeFv0



Scale = 1:31.1

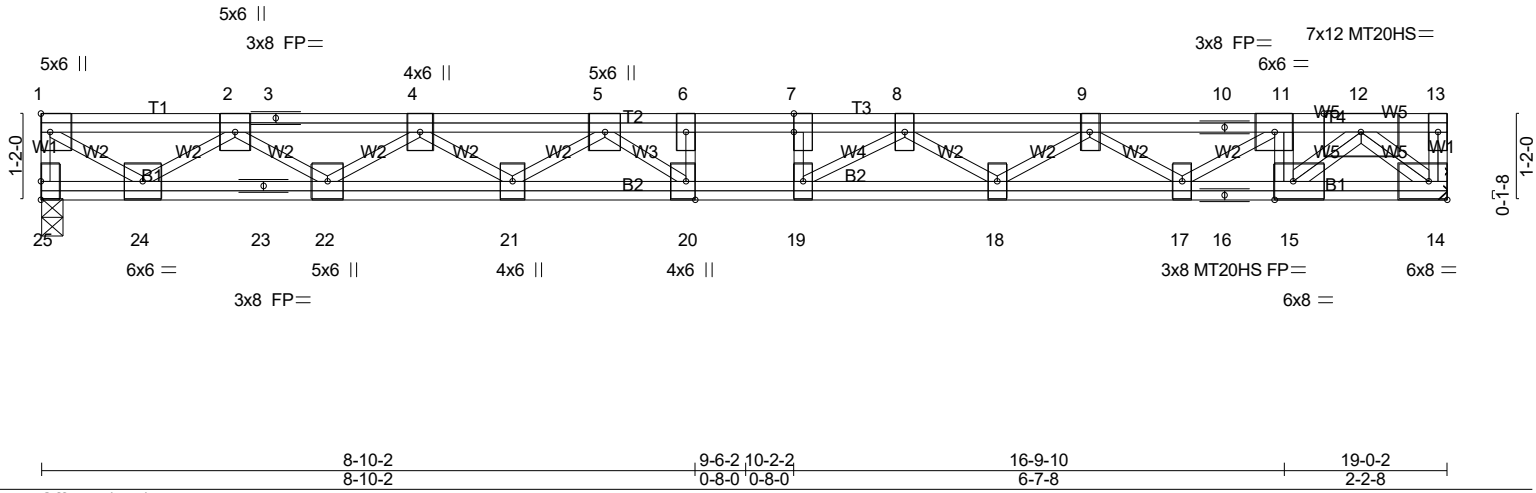


Plate Offsets (X,Y)-- [7:0-3-0,0-0-0], [15:0-3-0,Edge], [20:0-3-0,Edge]	
LOADING (psf)	SPACING- 1-4-0
TCLL 40.0	Plate Grip DOL 1.00
TCDL 10.0	Lumber DOL 1.00
BCLL 0.0	Rep Stress Incr NO
BCDL 5.0	Code IRC2021/TPI2014
CSI.	DEFL. in (loc) l/defl L/d
TC 0.36	Vert(LL) -0.10 20-21 >999 480
BC 0.78	Vert(CT) -0.36 18-19 >629 360
WB 0.82	Horz(CT) 0.05 14 n/a n/a
Matrix-SH	
PLATES	GRIP
MT20	244/190
MT20HS	187/143
Weight: 152 lb FT = 20%F, 11%E	

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 25=838/0-3-8 (min. 0-1-8), 14=2470/Mechanical
Max Grav 25=838(LC 1), 14=2718(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-25=-825/0, 1-2=-1074/0, 2-3=-2853/0, 3-4=-2853/0, 4-5=-4079/0, 5-6=-4986/0, 6-7=-4986/0, 7-8=-4986/0,
8-9=-5864/0, 9-10=-5843/0, 10-11=-5843/0, 11-12=-5414/0
BOT CHORD 23-24=0/2090, 22-23=0/2090, 21-22=0/3582, 20-21=0/4593, 19-20=0/4986, 18-19=0/5642, 17-18=0/5977, 16-17=0/5695,
15-16=0/5695, 14-15=0/2959
WEBS 11-15=-2440/0, 6-20=-420/0, 1-24=0/1310, 2-24=-1260/0, 2-22=0/946, 4-22=-905/0, 4-21=0/738, 5-21=-828/0,
5-20=0/1021, 8-18=0/275, 8-19=-782/0, 12-15=0/3437, 12-14=-3941/0

NOTES- (9)

- Unbalanced floor live loads have been considered for this design.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 3x6 MT20 unless otherwise indicated.
- Refer to girder(s) for truss to truss connections.
- Load case(s) 1, 2, 3, 4 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Standard loadcase(s) has been removed. Building designer must review loads shown to verify that they are correct for the intended use of the truss.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

LOAD CASE(S)

- 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-7=-67, 7-11=-13, 11-13=-103
Concentrated Loads (lb)
Vert: 11=-2202
- 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-6=-13, 6-11=-67, 11-13=-157
Concentrated Loads (lb)
Vert: 11=-2202



3/1/2024

Continued on Page 2 Design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC
24-1487-F02	F207	Floor	2	1	Job Reference (optional) # 46064

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:07 2024 Page 2
ID:oDuWOOmHxMOj2fwcp2aKqzMG6w-d79nXKPCYhmpL8bQvITMd3wDLabVHRSsc1X962zeFvo

LOAD CASE(S)

- 3) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 14-25=-7, 1-7=-67, 7-11=-13, 11-13=-103
 - Concentrated Loads (lb)
 - Vert: 11=-2202
- 4) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 14-25=-7, 1-6=-13, 6-11=-67, 11-13=-157
 - Concentrated Loads (lb)
 - Vert: 11=-2202




3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F208	Truss Type Floor	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:09 2024 Page 1
ID:oDuWOOMhLxMOj2fwp2aKqzMG6w-ZWHXy0RS4J0XbRkp1AVqiU?dTOSAzNCi4L0GAXzeFvM

Scale = 1:30.6

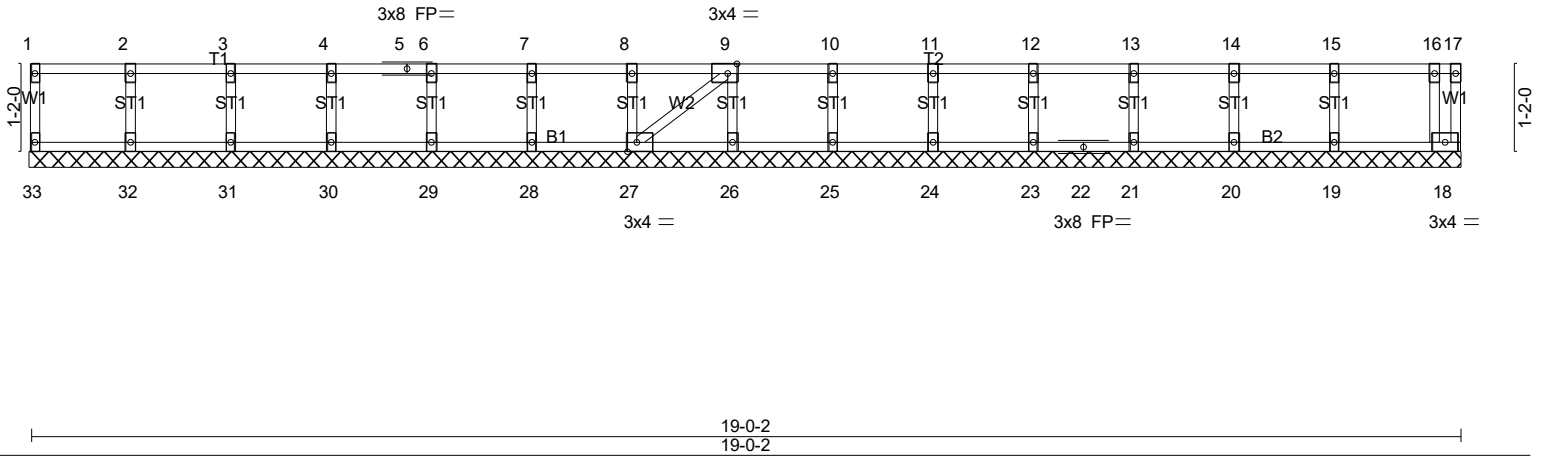

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP			
TCLL	40.0	Plate Grip DOL	2-0-0	TC	0.06	Vert(LL)	n/a	in (loc)	-	l/defl	n/a	L/d	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(CT)	n/a	-	n/a	999					
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	18	n/a	n/a					
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH											
													Weight: 81 lb	FT = 20%F, 11%E	


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS. All bearings 19-0-2.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 33, 18, 32, 31, 30, 29, 28, 27, 26, 25, 24, 23, 21, 20, 19

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

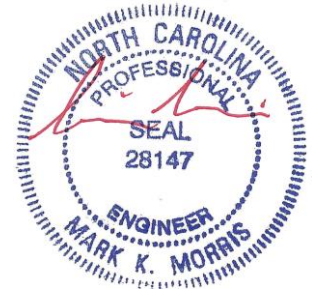


3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F209	Truss Type Floor	Qty 4	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:10 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-1iqv9LS4rc8NCbJ?bt03EhYiXobBigTvl?lpjNzeFvI



Scale = 1:31.2


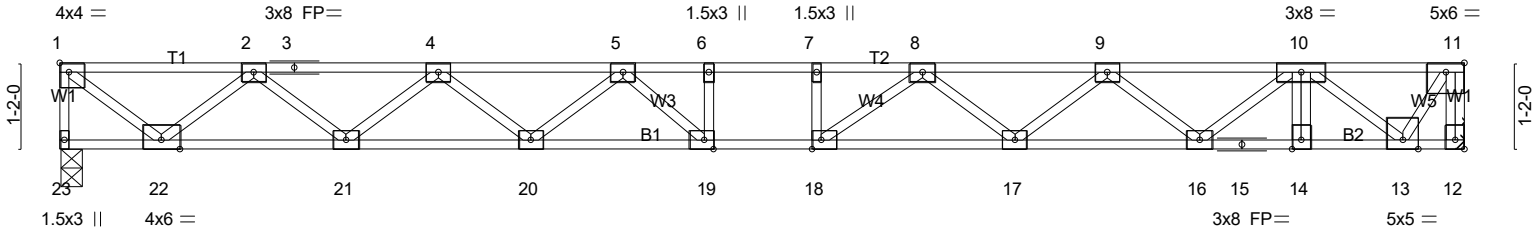


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [12:Edge,0-1-8], [18:0-1-8,Edge], [19:0-1-8,Edge]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.49	Vert(LL)	-0.24 18-19	>926	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.86	Vert(CT)	-0.43 17-18	>531	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.67	Horz(CT)	0.07 12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 98 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 23=757/0-3-8 (min. 0-1-8), 12=1224/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-23=-751/0, 11-12=-1224/0, 1-2=-858/0, 2-3=-2239/0, 3-4=-2239/0, 4-5=-3142/0, 5-6=-3694/0, 6-7=-3694/0, 7-8=-3694/0, 8-9=-3492/0, 9-10=-2817/0, 10-11=-794/0
BOT CHORD 21-22=0/1662, 20-21=0/2792, 19-20=0/3488, 18-19=0/3694, 17-18=0/3690, 16-17=0/3259, 15-16=0/2312, 14-15=0/2312, 13-14=0/2312
WEBS 1-22=0/1096, 2-22=-1046/0, 2-21=0/751, 4-21=-719/0, 4-20=0/456, 5-20=-450/0, 5-19=0/518, 10-16=0/634, 9-16=-576/0, 9-17=0/303, 8-17=-257/0, 8-18=-265/231, 10-13=-1904/0, 11-13=0/1413

NOTES- (7)

- Unbalanced floor live loads have been considered for this design.
- All plates are 3x4 MT20 unless otherwise indicated.
- Refer to girder(s) for truss to truss connections.
- Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-23=-7, 1-11=-67
Concentrated Loads (lb)
Vert: 10=-600
- Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-23=-7, 1-11=-67
Concentrated Loads (lb)
Vert: 10=-600
- 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-23=-7, 1-7=-67, 7-11=-13
Concentrated Loads (lb)
Vert: 10=-600



3/1/2024

Continued on Page 2 Design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC
24-1487-F02	F209	Floor	4	1	Job Reference (optional) # 46064

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:10 2024 Page 2
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-1iqv9LS4rc8NCbJ?bt03EhYiXobBigTvl?lpjNzeFvl

LOAD CASE(S) Standard

4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-23=-7, 1-6=-13, 6-11=-67

Concentrated Loads (lb)

Vert: 10=-600

5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-23=-7, 1-7=-67, 7-11=-13

Concentrated Loads (lb)

Vert: 10=-600

6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-23=-7, 1-6=-13, 6-11=-67

Concentrated Loads (lb)

Vert: 10=-600



3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F210	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:11 2024 Page 1
ID:oDuWOOmHxMOj2fwcp2aKqzMG6w-VuOINhTjcwGEqluB8bXInv4zuB8iRHh2XfVMFpzeFvk

Scale = 1:29.4

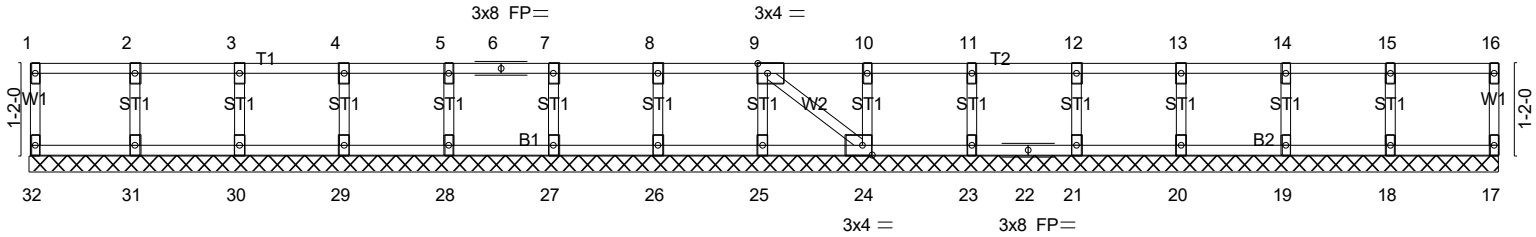


Plate Offsets (X,Y)-- [9:0-1-8,Edge], [24:0-1-8,Edge]		18-8-10 18-8-10	
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d
TCLL 40.0	Plate Grip DOL 1.00	TC 0.07	Vert(LL) n/a - n/a 999
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 24 n/a n/a
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH	
			PLATES GRIP
			MT20 244/190
			Weight: 78 lb FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 18-8-10.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 32, 17, 31, 30, 29, 28, 27, 26, 25, 24, 23, 21, 20, 19, 18

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (6)
1) All plates are 1.5x3 MT20 unless otherwise indicated.
2) Gable requires continuous bottom chord bearing.
3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
4) Gable studs spaced at 1-4-0 oc.
5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



3/1/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F212	Truss Type Floor Girder	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	----------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:11 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-VuOINhTjcwGEqluB8bXInv4wAB6TREy2XfVMFpzeFvk



Scale = 1:11.8

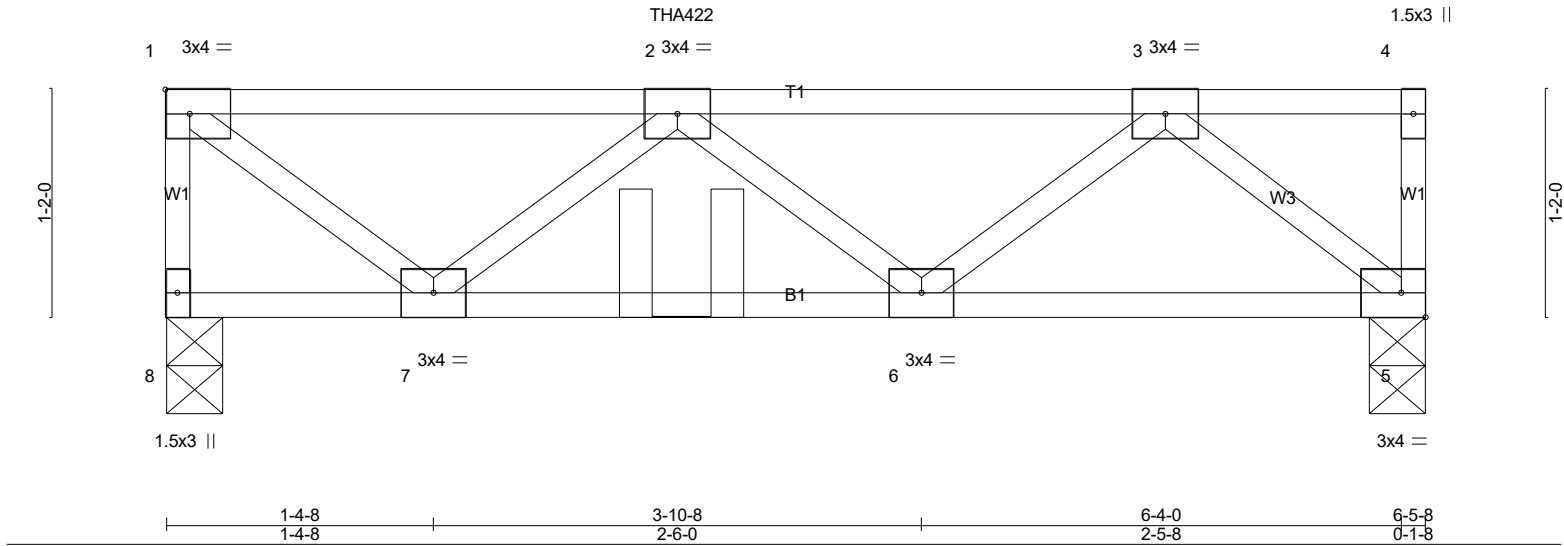

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.31	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.15	Vert(LL) -0.01 6 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.21	Vert(CT) -0.01 6-7 >999 360		
BCDL 5.0	Rep Stress Incr NO	Matrix-P	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2021/TPI2014			Weight: 33 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 8=380/0-3-8 (min. 0-1-8), 5=370/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-8=-375/0, 1-2=-345/0, 2-3=-538/0
 BOT CHORD 6-7=0/650, 5-6=0/393
 WEBS 1-7=0/440, 2-7=-398/0, 3-5=-508/0

- NOTES-** (5)
- 1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 2) Use Simpson Strong-Tie THA422 (Single Chord Girder) or equivalent at 2-7-12 from the left end to connect truss(es) F213 (1 ply 2x4 SP) to front face of top chord, skewed 0.0 deg. to the right, sloping 0.0 deg. down.
 - 3) Fill all nail holes where hanger is in contact with lumber.
 - 4) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 5-8=-10, 1-4=-100
 Concentrated Loads (lb)
 Vert: 2=-54(F)



3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F214	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:12 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-_5yga1TLNEO5SvTNil2XJ6d9mbUyAkzCmJEwnFzeFVj

Scale = 1:11.0

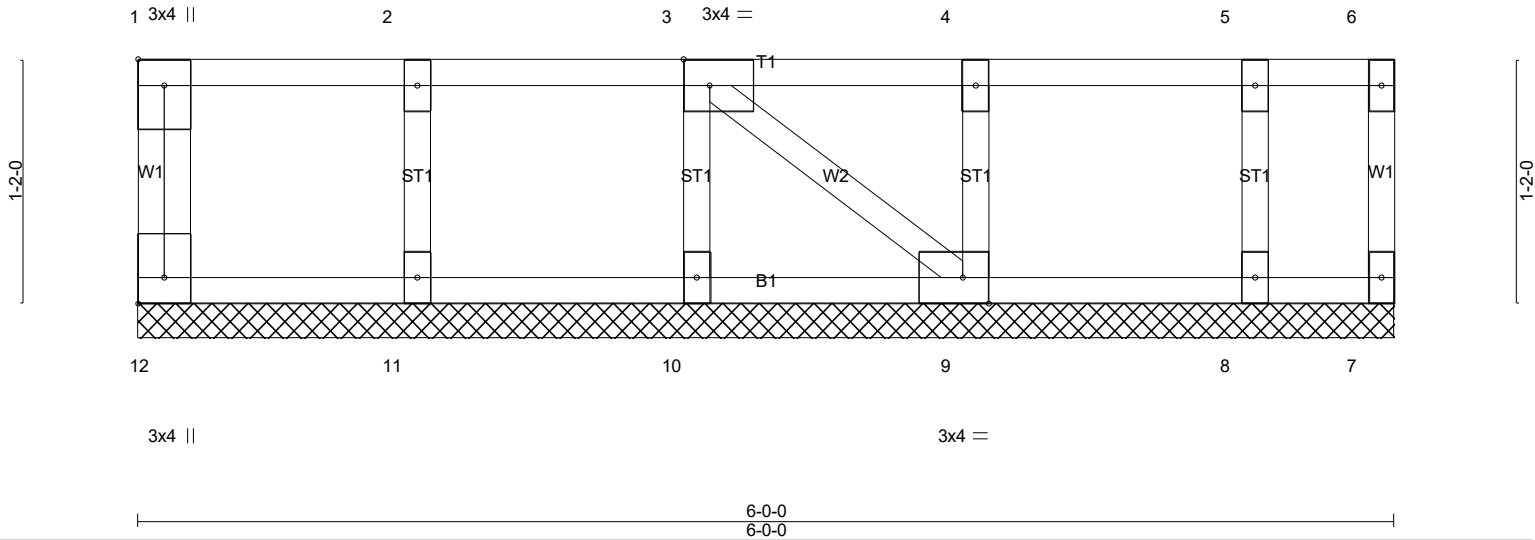


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [9:0-1-8,Edge], [12:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 30 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 6-0-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 12, 7, 11, 10, 9, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (6)
1) All plates are 1.5x3 MT20 unless otherwise indicated.
2) Gable requires continuous bottom chord bearing.
3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
4) Gable studs spaced at 1-4-0 oc.
5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



3/1/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F216	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:13 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-SHW2oNUz8XWYy332aG0amsKAKY?qBvBDL?z_TJizeFvi

0₁1₈

Scale = 1:24.5

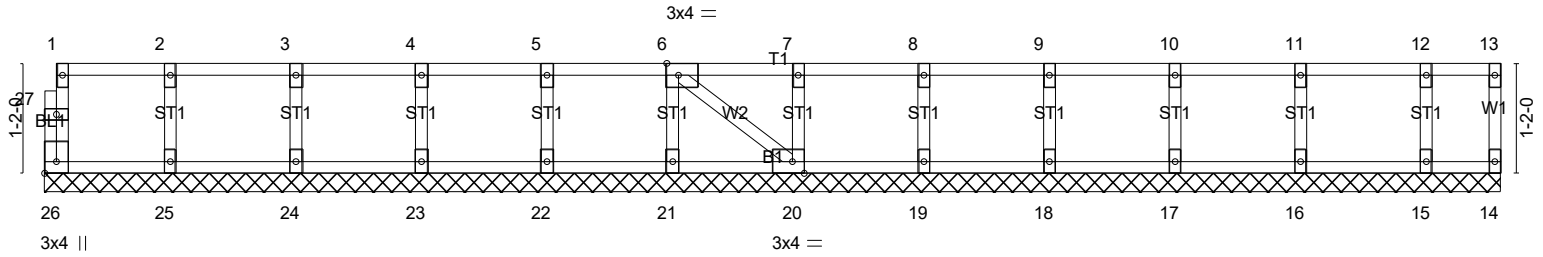

15-5-8
15-5-8

Plate Offsets (X,Y)-- [6:0-1-8,Edge], [20:0-1-8,Edge], [26:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 67 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-5-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F217	Truss Type Floor	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:14 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-wT4Q?jVbvrephCdmqj5?PXiQAP1GeXqUDdj1s8zeFvh


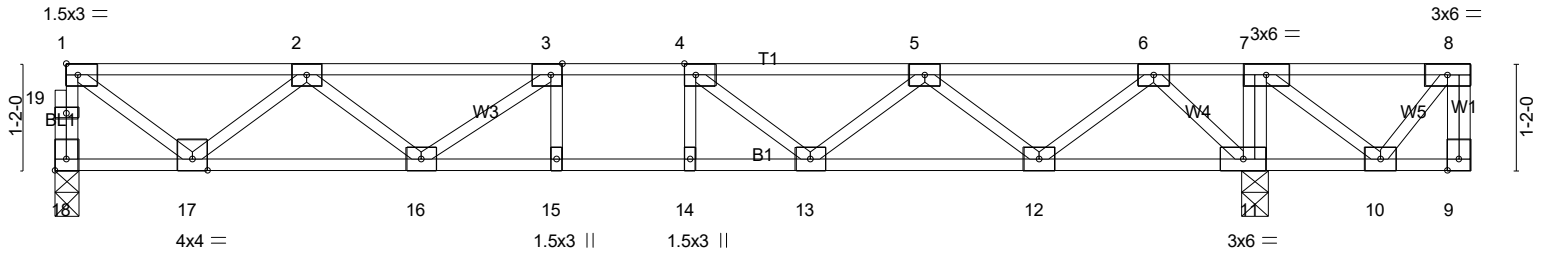


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [18:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.10	14	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.59	Vert(CT)	-0.13	14	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.46	Horz(CT)	0.03	11	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 81 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12,10-11.

REACTIONS. (lb/size) 18=687/0-3-0 (min. 0-1-8), 11=980/0-3-8 (min. 0-1-8)
Max Grav 18=702(LC 3), 11=980(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 18-19=-698/0, 1-19=-697/0, 1-2=-793/0, 2-3=-1805/0, 3-4=-2177/0, 4-5=-1999/0, 5-6=-1231/0
BOT CHORD 16-17=0/1480, 15-16=0/2177, 14-15=0/2177, 13-14=0/2177, 12-13=0/1783, 11-12=-52/655
WEBS 7-11=-303/0, 1-17=0/959, 2-17=-895/0, 2-16=0/424, 3-16=-533/0, 4-13=-425/7, 5-13=0/365, 5-12=-744/0, 6-12=0/777, 6-11=-975/0

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC
24-1487-F02	F218	Floor	1	1	Job Reference (optional) # 46064

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:15 2024 Page 1
 ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-OfeoD3WDg9mgJMCyNQcEXiFaWpNfN?QeSHTaOazeFvg

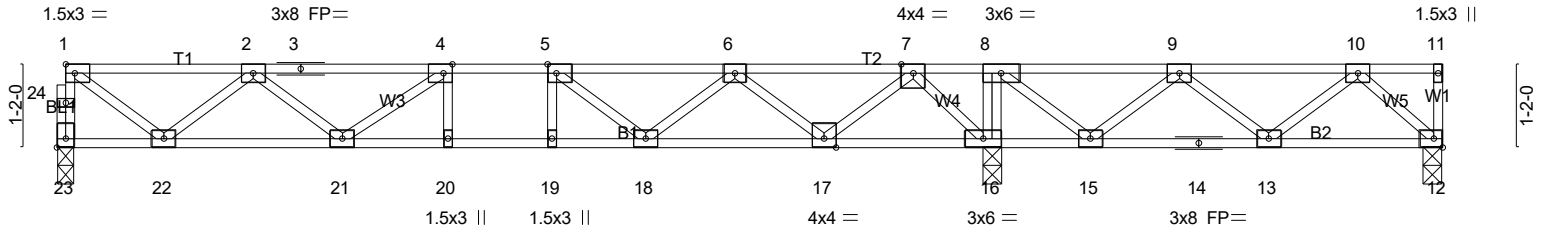

1-6-0	4-0-0	5-6-8	6-2-8	6-10-8	8-3-0	10-9-0	12-11-12	13-1-4	14-5-12	16-11-12	19-3-8	19-5-0
1-6-0	2-6-0	1-6-8	0-8-0	0-8-0	1-4-8	2-6-0	2-2-12	0-1-8	1-4-8	2-6-0	2-3-12	0-1-8
Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [23:Edge,0-1-8]												

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.41	Vert(LL)	-0.07	20	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.52	Vert(CT)	-0.10	20	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.02	16	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 99 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 23=595/0-3-0 (min. 0-1-8), 12=111/0-3-8 (min. 0-1-8), 16=1403/0-3-8 (min. 0-1-8)
 Max Uplift 12=-123(LC 3)
 Max Grav 23=603(LC 3), 12=264(LC 4), 16=1403(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 23-24=-597/0, 1-24=-596/0, 1-2=-664/0, 2-3=-1438/0, 3-4=-1438/0, 4-5=-1604/0, 5-6=-1234/0, 7-8=0/1341, 8-9=0/919, 9-10=-282/360
 BOT CHORD 21-22=0/1242, 20-21=0/1604, 19-20=0/1604, 18-19=0/1604, 17-18=0/887, 16-17=-573/0, 15-16=-1341/0, 14-15=-608/281, 13-14=-608/281
 WEBS 8-16=-631/0, 1-22=0/802, 2-22=-752/0, 2-21=0/256, 4-21=-278/0, 5-18=-514/0, 6-18=0/463, 6-17=-874/0, 7-17=0/913, 7-16=-1122/0, 8-15=0/724, 9-15=-665/0, 9-13=0/323, 10-13=-277/43, 10-12=-339/201

- NOTES-** (6)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 12.
 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard


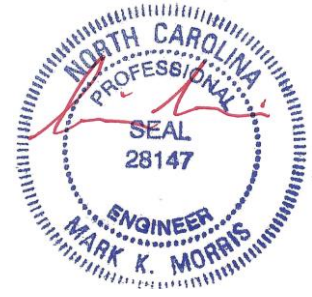


3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F219	Truss Type Floor	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:17 2024 Page 1
ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-K2lZelXTCm0OYgLLVrei0AKw2c39rvwxvbyhSTzeFve

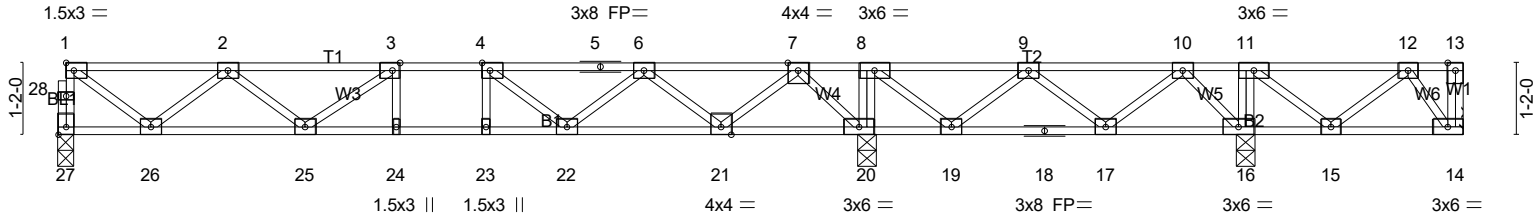

1-6-0	4-0-0	5-6-8	6-2-86-10-8	8-3-0	10-9-0	12-11-14	13-1-6	14-5-14	16-11-14	19-1-12	19-3-4	22-6-8	22-9-8
1-6-0	2-6-0	1-6-8	0-8-0 0-8-0	1-4-8	2-6-0	2-2-14	0-1-8	1-4-8	2-6-0	2-1-14	0-1-8	1-4-8	0-3-0

Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [27:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.41	Vert(LL)	-0.07 24-25	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.52	Vert(CT)	-0.10 24	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.02 20	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
									Weight: 119 lb FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 0-3-8 except (jt=length) 27=0-3-0, 14=Mechanical.
(lb) - Max Uplift All uplift 100 lb or less at joint(s) 14
Max Grav All reactions 250 lb or less at joint(s) 14 except 27=603(LC 5), 20=1392(LC 3), 16=553(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 27-28=-597/0, 1-28=-596/0, 1-2=-664/0, 2-3=-1437/0, 3-4=-1603/0, 4-5=-1232/0,
5-6=-1232/0, 7-8=0/1339, 8-9=0/905, 9-10=-154/305
BOT CHORD 25-26=0/1241, 24-25=0/1603, 23-24=0/1603, 22-23=0/1603, 21-22=0/885, 20-21=-559/0,
19-20=-1339/0, 18-19=-571/202, 17-18=-571/202
WEBS 8-20=-621/0, 11-16=-312/0, 1-26=0/801, 2-26=-752/0, 2-25=0/258, 3-25=-281/0,
4-22=-509/0, 6-22=0/461, 6-21=-873/0, 7-21=0/911, 7-20=-1129/0, 8-19=0/708,
9-19=-649/0, 9-17=-75/346, 10-17=-304/113, 10-16=-359/289, 12-14=-288/13

NOTES- (7)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14.
5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
6) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard





3/1/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F220	Truss Type Floor	Qty 2	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:18 2024 Page 1
ID: oDuWOOMhLxMOj2fwcp2aKqzMG6w-oEJxr5Y6z49FAqwX3Z9xZNI4Q0P6aM348FhE?vzeFvd

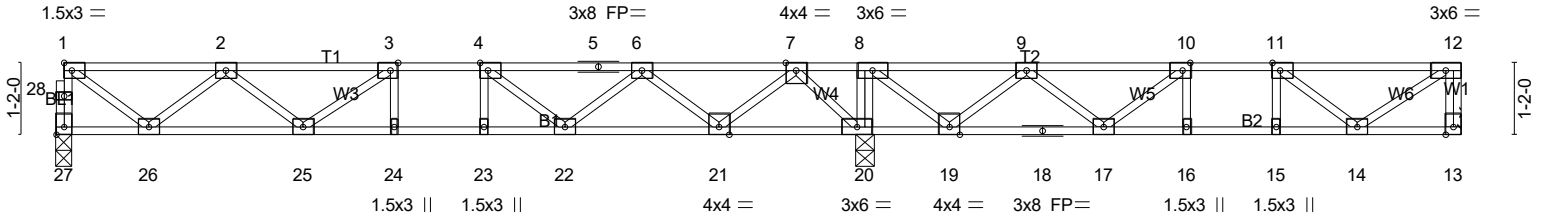

1-6-0	4-0-0	5-6-8	6-2-86-10-8	8-3-0	10-9-0	12-11-14	13-1-6	14-5-14	16-11-14	18-4-12	19-8-12	19-0-12	21-1-4	22-9-8
1-6-0	2-6-0	1-6-8	0-8-0/0-8-0	1-4-8	2-6-0	2-2-14	0-1-8	1-4-8	2-6-0	1-4-14	0-8-0/0-8-0	1-4-8	1-4-8	1-8-4

Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [27:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.43	Vert(LL)	-0.07	24	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.53	Vert(CT)	-0.10	24	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.44	Horz(CT)	0.02	20	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH							
	Code IRC2021/TPI2014								
								Weight: 116 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 27=593/0-3-0 (min. 0-1-8), 13=368/Mechanical, 20=1513/0-3-8 (min. 0-1-8)
Max Grav 27=623(LC 10), 13=441(LC 4), 20=1513(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 27-28=-618/0, 1-28=-617/0, 12-13=-433/0, 1-2=-690/0, 2-3=-1514/0, 3-4=-1722/0,
4-5=-1391/0, 5-6=-1391/0, 6-7=-435/269, 7-8=0/1473, 8-9=0/787, 9-10=-671/319,
10-11=-857/90, 11-12=-472/8
BOT CHORD 25-26=0/1291, 24-25=0/1722, 23-24=0/1722, 22-23=0/1722, 21-22=-62/1073, 20-21=-664/0,
19-20=-1473/0, 18-19=-512/462, 17-18=-512/462, 16-17=-90/857, 15-16=-90/857,
14-15=-90/857
WEBS 8-20=-738/0, 1-26=0/834, 2-26=-782/0, 2-25=0/290, 3-25=-266/38, 4-22=-559/0,
6-22=0/480, 6-21=-888/0, 7-21=0/927, 7-20=-1106/0, 8-19=0/901, 9-19=-825/0,
9-17=0/398, 10-17=-467/0, 11-14=-492/105, 12-14=-10/568

- NOTES-** (6)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Refer to girder(s) for truss to truss connections.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard





3/1/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F221	Truss Type Floor	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:20 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-ldRhGmaMUhPzP74wa_CPeoyQwq5a2FYncZAL3ozeFvB

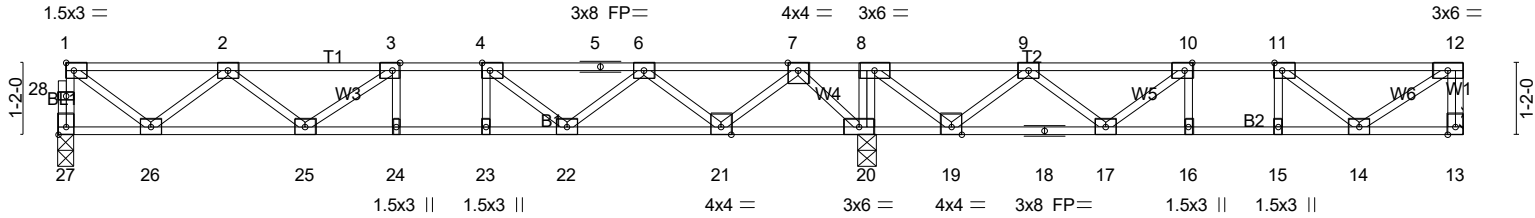

1-6-0	4-0-0	5-6-8	6-2-86-10-8	8-3-0	10-9-0	12-11-14	13-1-6	14-5-14	16-11-14	18-4-12	19-8-12	21-1-4	22-9-8
1-6-0	2-6-0	1-6-8	0-8-0/0-8-0	1-4-8	2-6-0	2-2-14	0-1-8	1-4-8	2-6-0	1-4-14	0-8-0/0-8-0	1-4-8	1-8-4

Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [27:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.43	Vert(LL)	-0.07	24	>999	480	MT20	244/190
TCDL 10.0	1.00	BC 0.53	Vert(CT)	-0.10	24	>999	360		
BCLL 0.0	1.00	WB 0.44	Horz(CT)	0.02	20	n/a	n/a		
BCDL 5.0	YES	Matrix-SH							
	Code IRC2021/TPI2014							Weight: 116 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 27=593/0-3-0 (min. 0-1-8), 13=368/Mechanical, 20=1513/0-3-8 (min. 0-1-8)
Max Grav 27=623(LC 10), 13=441(LC 4), 20=1513(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 27-28=-618/0, 1-28=-617/0, 12-13=-433/0, 1-2=-690/0, 2-3=-1514/0, 3-4=-1722/0, 4-5=-1391/0, 5-6=-1391/0, 6-7=-435/269, 7-8=0/1473, 8-9=0/787, 9-10=-671/319, 10-11=-857/90, 11-12=-472/8
BOT CHORD 25-26=0/1291, 24-25=0/1722, 23-24=0/1722, 22-23=0/1722, 21-22=-62/1073, 20-21=-664/0, 19-20=-1473/0, 18-19=-512/462, 17-18=-512/462, 16-17=-90/857, 15-16=-90/857, 14-15=-90/857
WEBS 8-20=-738/0, 1-26=0/834, 2-26=-782/0, 2-25=0/290, 3-25=-266/38, 4-22=-559/0, 6-22=0/480, 6-21=-888/0, 7-21=0/927, 7-20=-1106/0, 8-19=0/901, 9-19=-825/0, 9-17=0/398, 10-17=-467/0, 11-14=-492/105, 12-14=-10/568

- NOTES-** (6)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Refer to girder(s) for truss to truss connections.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F222	Truss Type Floor	Qty 2	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:21 2024 Page 1
ID: oDuWOOmHxMOj2fwcp2aKqzMG6w-Dp74T6a_F?Xq1Hf6khjeB0VZfDP_ngnWqDwucEzeFva


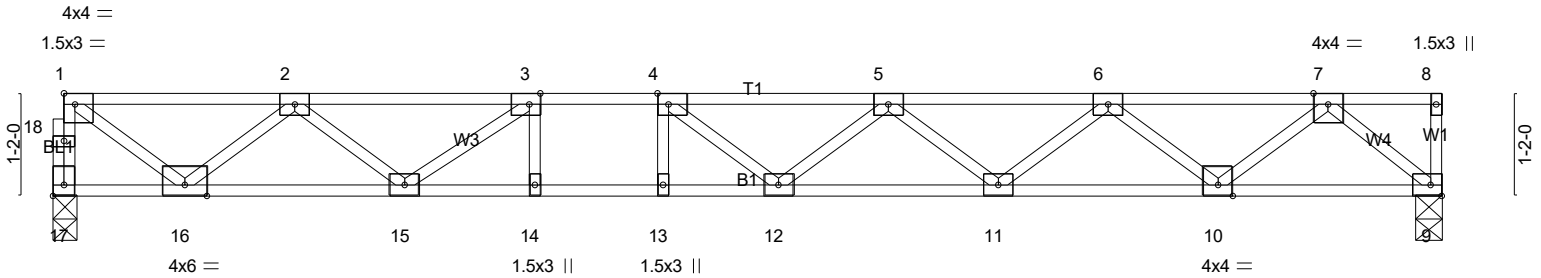


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [17:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.56	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.65	Vert(LL) -0.21 12-13 >911 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.57	Vert(CT) -0.28 12-13 >663 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.04 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 79 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP SS(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 17=852/0-3-2 (min. 0-1-8), 9=858/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 17-18=-851/0, 1-18=-849/0, 1-2=-989/0, 2-3=-2359/0, 3-4=-3048/0, 4-5=-3160/0, 5-6=-2763/0, 6-7=-1685/0
 BOT CHORD 15-16=0/1842, 14-15=0/3048, 13-14=0/3048, 12-13=0/3048, 11-12=0/3138, 10-11=0/2370, 9-10=0/964
 WEBS 3-14=-21/293, 4-13=-286/46, 1-16=0/1198, 2-16=-1111/0, 2-15=0/673, 3-15=-883/0, 4-12=-218/342, 5-11=-489/0, 6-11=0/511, 6-10=-892/0, 7-10=0/938, 7-9=-1263/0

- NOTES-** (5)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F223	Truss Type FLOOR	Qty 10	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	-----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:22 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-h0ZShSbc0lfgREllPEtjD2kPdkDW71g3tfS8gzefVz


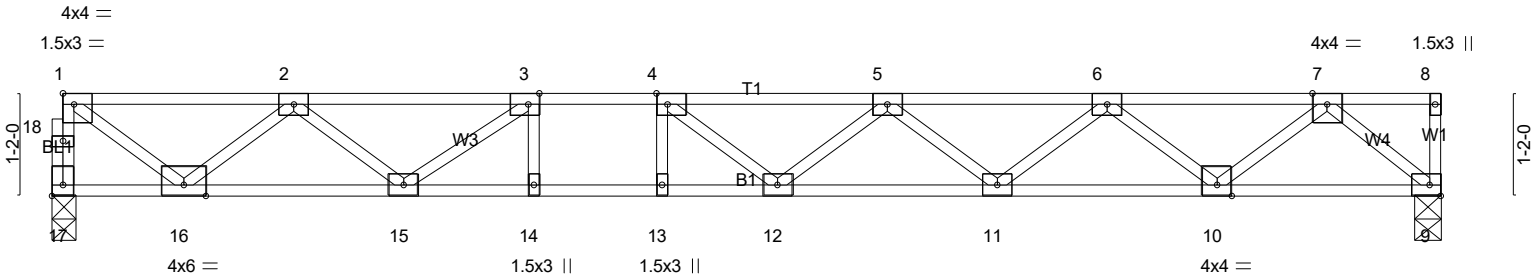



Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [17:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.56	Vert(LL)	-0.21	12-13	>911	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.65	Vert(CT)	-0.28	12-13	>663		
BCLL 0.0	Lumber DOL 1.00	WB 0.57	Horz(CT)	0.04	9	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 79 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP SS(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 17=852/0-3-2 (min. 0-1-8), 9=858/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 17-18=-851/0, 1-18=-849/0, 1-2=-989/0, 2-3=-2359/0, 3-4=-3048/0, 4-5=-3160/0, 5-6=-2763/0, 6-7=-1685/0
BOT CHORD 15-16=0/1842, 14-15=0/3048, 13-14=0/3048, 12-13=0/3048, 11-12=0/3138, 10-11=0/2370, 9-10=0/964
WEBS 3-14=-21/293, 4-13=-286/46, 1-16=0/1198, 2-16=-1111/0, 2-15=0/673, 3-15=-883/0, 4-12=-218/342, 5-11=-489/0, 6-11=0/511, 6-10=-892/0, 7-10=0/938, 7-9=-1263/0

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F224	Truss Type Floor	Qty 2	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:22 2024 Page 1
ID: oDuWOOMhLxMOj2fwcp2aKqzMG6w-h0ZShSbc0lfgeREllPEtjD2pvdnNWByg3tfS8gzefVz


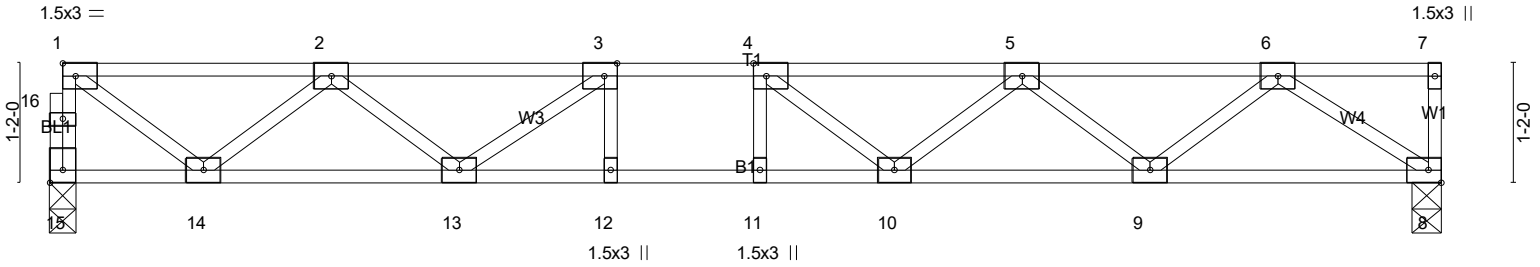



Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [15:Edge,0-1-8]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.21	Vert(LL)	-0.08	11	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.45	Vert(CT)	-0.10	11	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.32	Horz(CT)	0.02	8	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 68 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 15=487/0-3-2 (min. 0-1-8), 8=492/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 15-16=-485/0, 1-16=-484/0, 1-2=-554/0, 2-3=-1276/0, 3-4=-1565/0, 4-5=-1482/0, 5-6=-1022/0
BOT CHORD 13-14=0/1034, 12-13=0/1565, 11-12=0/1565, 10-11=0/1565, 9-10=0/1366, 8-9=0/657
WEBS 1-14=0/670, 2-14=-625/0, 2-13=0/315, 3-13=-401/0, 5-9=-447/0, 6-9=0/475, 6-8=-795/0

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F225	Truss Type FLOOR	Qty 8	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:23 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-9C7quocEncnXGbpVr6l6GRayB16VFaoPlXP?g7zeFvY

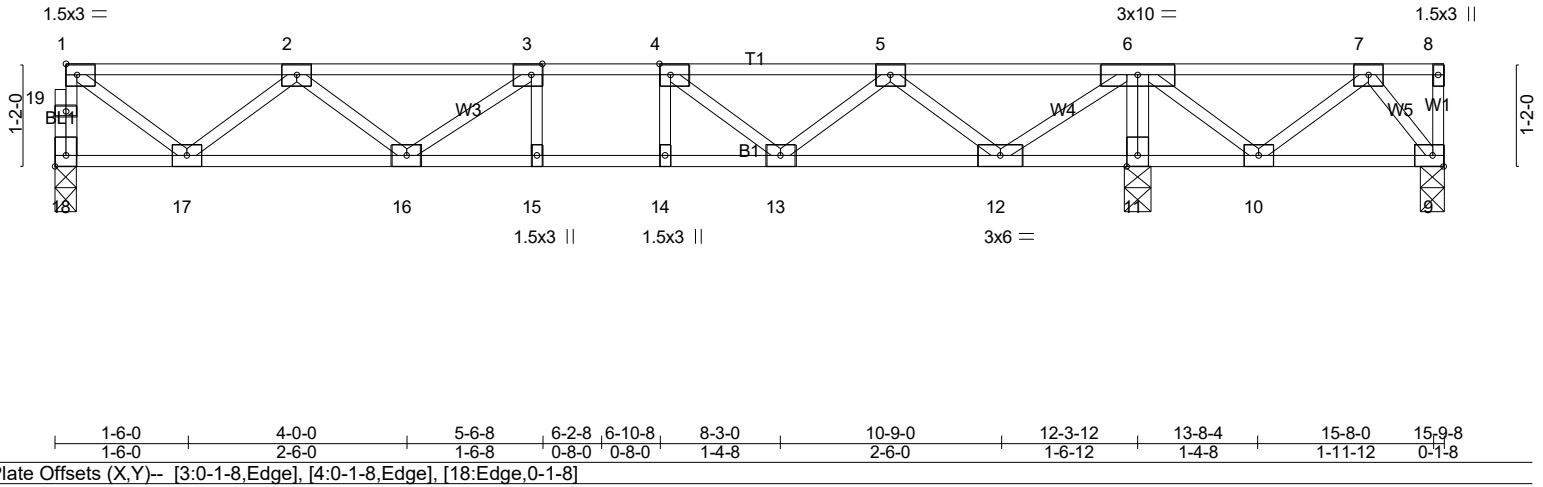

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.37	Vert(LL)	-0.07 15-16	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.52	Vert(CT)	-0.09 15-16	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.52	Horz(CT)	0.01 11	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 81 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 18=571/0-3-0 (min. 0-1-8), 11=1283/0-3-8 (min. 0-1-8), 9=-144/0-3-6 (min. 0-1-8)
Max Uplift9=-275(LC 3)
Max Grav 18=573(LC 3), 11=1283(LC 1), 9=92(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 18-19=-566/0, 1-19=-565/0, 1-2=-624/0, 2-3=-1325/0, 3-4=-1426/0, 4-5=-1001/0, 6-7=0/593
BOT CHORD 16-17=0/1168, 15-16=0/1426, 14-15=0/1426, 13-14=0/1426, 12-13=0/619, 11-12=-1007/0, 10-11=-1013/0
WEBS 6-11=-1255/0, 1-17=0/753, 2-17=-708/0, 4-13=-550/0, 5-13=0/506, 5-12=-927/0, 6-12=0/1100, 6-10=0/599,
7-10=-548/0, 7-9=-136/374

- NOTES-** (6)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=275.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

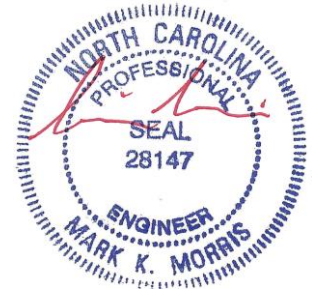

3/1/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1487-F02	Truss F227	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0130 BLAKE POND 95 GREAT SMOKY PLACE LILLINGTON, NC Job Reference (optional) # 46064
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 4 16:35:24 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-dOhC68dsYwvOulOhPpGLpe7CnRam_9yzWB8YCZzeFvX

0₁8

Scale = 1:25.0

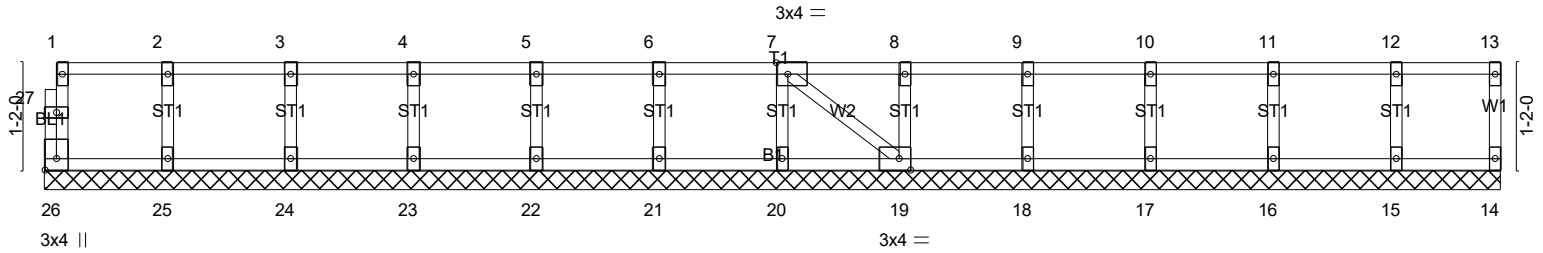

15-9-10
15-9-10

Plate Offsets (X,Y)-- [7:0-1-8,Edge], [19:0-1-8,Edge], [26:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	14	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 68 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-9-10.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)
1) All plates are 1.5x3 MT20 unless otherwise indicated.
2) Gable requires continuous bottom chord bearing.
3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
4) Gable studs spaced at 1-4-0 oc.
5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
6) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



3/1/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.