

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 54776

JOB: 24-7744-F01

JOB NAME: LOT 0.0011 CAMPBELL RIDGE

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2018 as well as IRC 2021.

19 Truss Design(s)

Trusses:

F1-01, F1-02, F1-03, F1-04, F1-05, F1-06, F1-07, F1-08, F1-10, F1-11, F1-12, F1-13, F1-13A, F1-14, F1-14A, F1-15, F1-16, F1-18, F1-19



12/5/2024

Mark Morris

Warning !—Verify design parameters and read notes before use.


This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSL/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI

Job 24-7744-F01	Truss F1-01	Truss Type GABLE	Qty 1	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:16 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-r92rC1?3EG1b_q8ac6L4BW9nSlsxVXji?Y4Xq8yBhW5

0₁-8

Scale = 1:21.9

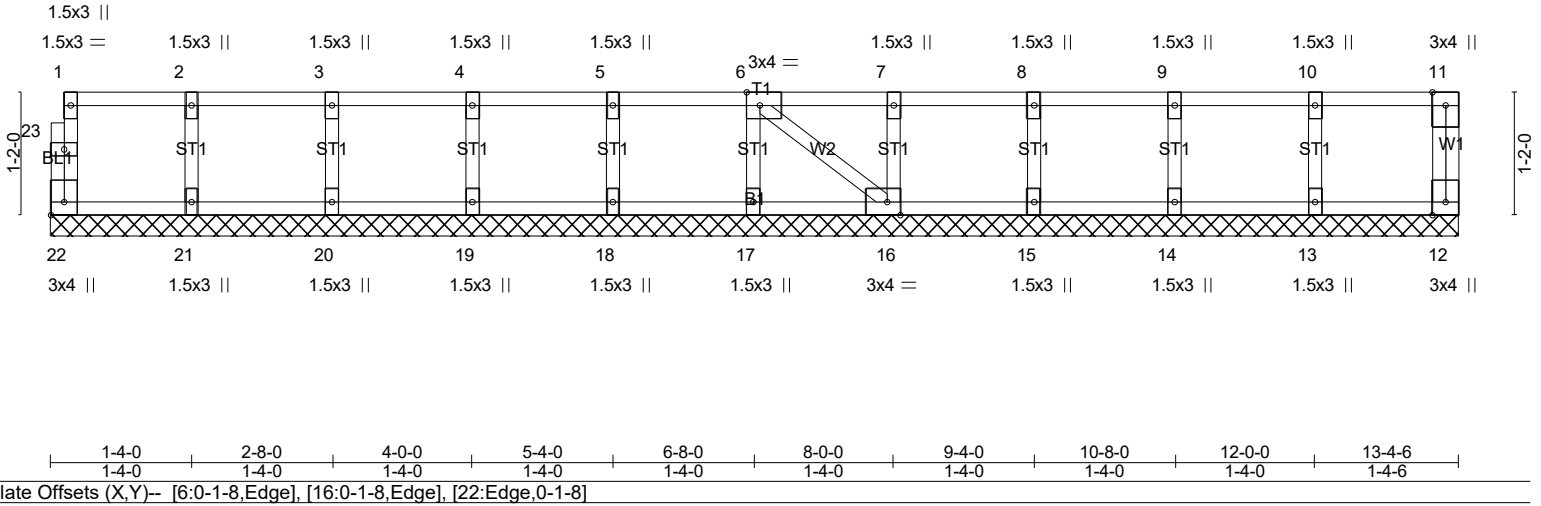

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.06	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(LL) n/a - n/a 999		
BCLL 0.0	Lumber DOL 1.00	WB 0.03	Vert(CT) n/a - n/a 999		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.00 12 n/a n/a		
	Code IRC2021/TPI2014			Weight: 59 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 13-4-6.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-02	Truss Type Floor	Qty 6	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:17 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-JLcDPN?i?a9Sc_jmAqsJkjiuFh3cEu4sDCp5MayBhW4

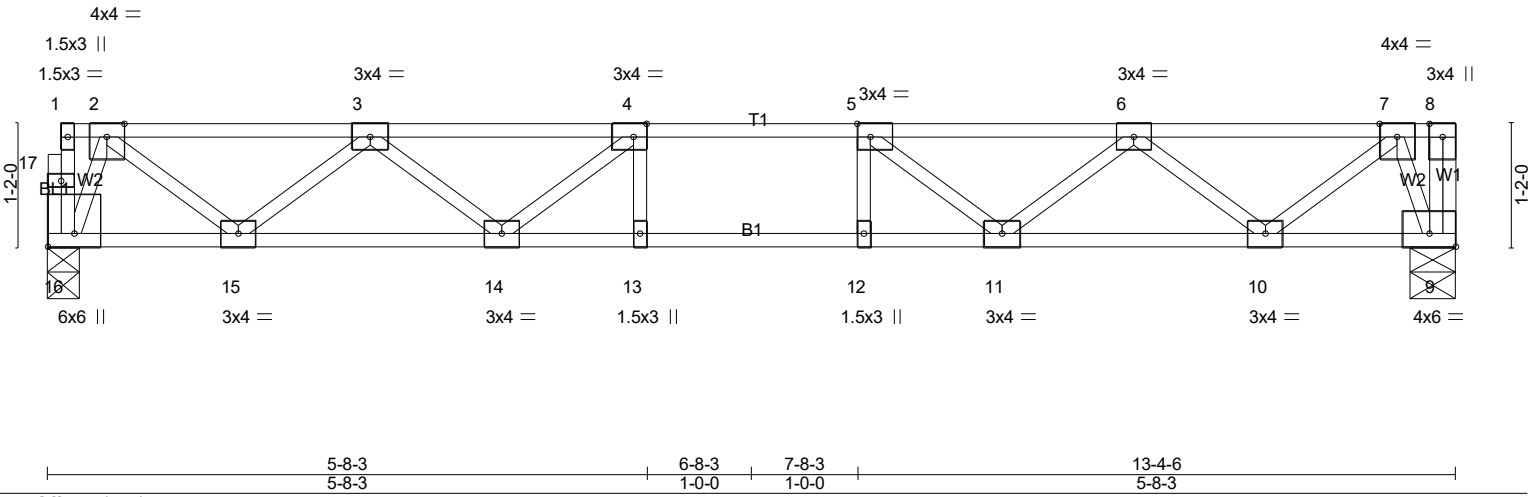



Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [9:Edge,0-1-8], [16:Edge,0-3-0]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.31	Vert(LL) -0.11 11-12 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.62	Vert(CT) -0.14 11-12 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.41	Horz(CT) 0.03 9 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 69 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 16=715/0-3-8 (min. 0-1-8), 9=721/0-5-4 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-987/0, 3-4=-1937/0, 4-5=-2244/0, 5-6=-1937/0, 6-7=-987/0

BOT CHORD 15-16=0/326, 14-15=0/1621, 13-14=0/2244, 12-13=0/2244, 11-12=0/2244, 10-11=0/1621, 9-10=0/326

WEBS 4-14=-524/0, 3-14=0/437, 3-15=-825/0, 2-15=0/861, 2-16=-864/0, 5-11=-524/0, 6-11=0/437, 6-10=-825/0, 7-10=0/861, 7-9=-851/0

NOTES- (4)

- Unbalanced floor live loads have been considered for this design.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION. Do not erect truss backwards.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-03	Truss Type GABLE	Qty 1	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:18 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-nXAbcj0KmtHJE8lzkXNYGxE7z5YKzRC?SsZeu1yBhW3

0-1-8

Scale = 1:15.1

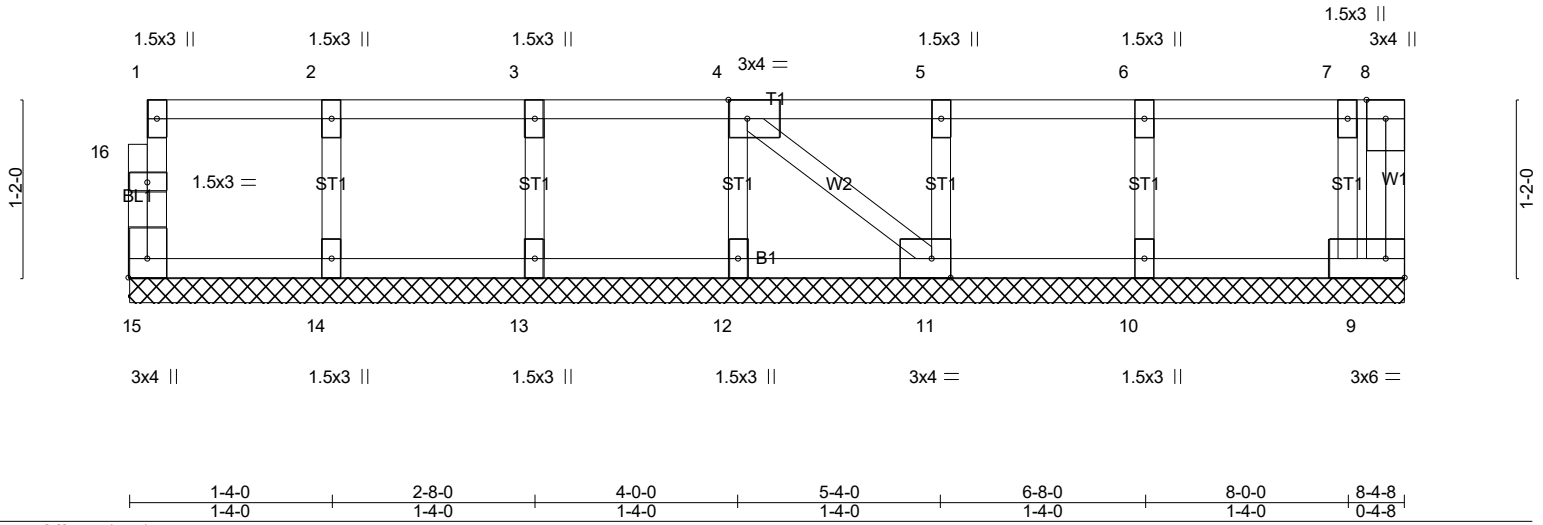


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [11:0-1-8,Edge], [15:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	9	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 40 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 8-4-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 15, 9, 14, 13, 12, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION. Do not erect truss backwards.

LOAD CASE(S) Standard




12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-04	Truss Type Floor	Qty 3	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:18 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-nXAbcj0KmtHJE8lzkXNYGxE5d5X6zPI?SsZeu1yBhW3

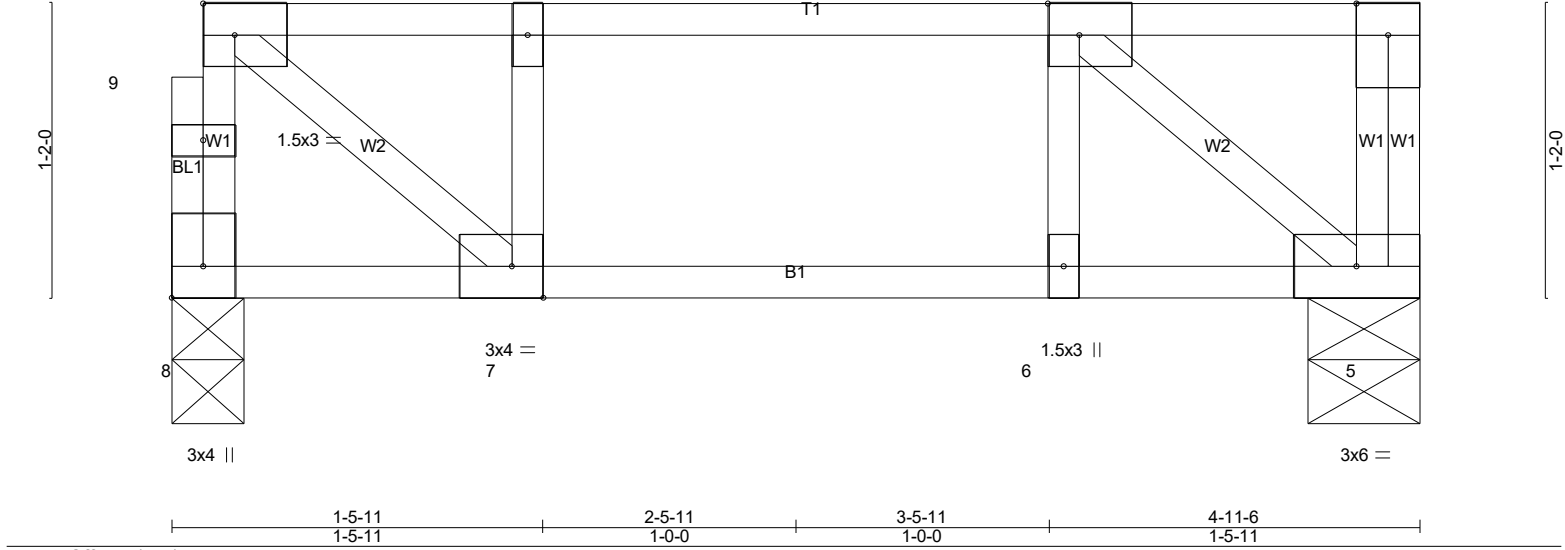

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.15	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.09	Vert(LL) -0.01 6 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.16	Vert(CT) -0.01 6 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2021/TPI2014			Weight: 27 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-11-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 8=252/0-3-8 (min. 0-1-8), 5=258/0-5-4 (min. 0-1-8)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-263/0, 2-3=-263/0
BOT CHORD 6-7=0/263, 5-6=0/263
WEBS 1-7=0/326, 3-5=-339/0

NOTES- (4)

- Unbalanced floor live loads have been considered for this design.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

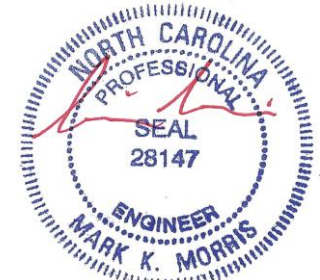

12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-06	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:20 2024 Page 1
ID:fcZ0KwZoZQmeXTMivGJ_CysCYm-jwHM1O2aIVX1TSSLryQOLMKSLvEsRLhivA2IzvyBhW1

Scale = 1:28.5

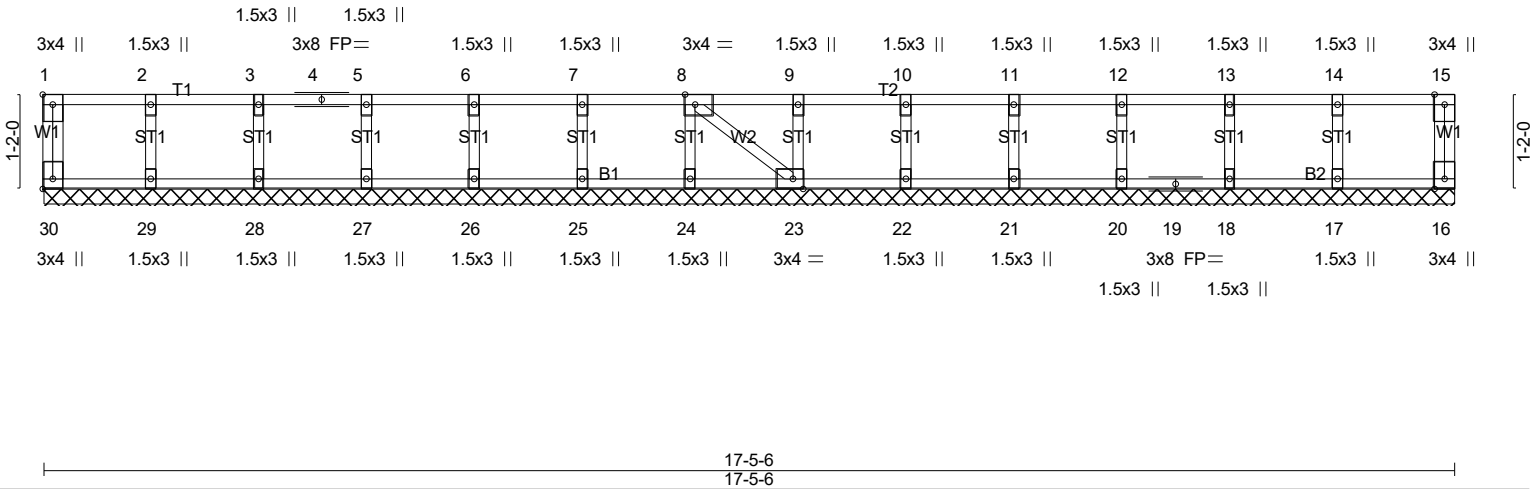


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [8:0-1-8,Edge], [23:0-1-8,Edge], [30:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	23	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 76 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 17-5-6.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 30, 16, 29, 28, 27, 26, 25, 24, 23, 22, 21, 20, 18, 17

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (5)
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard




12/5/2024



Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-07	Truss Type Floor	Qty 13	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	-----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:21 2024 Page 1
ID:fcZ0KwZoZQmeXTiMivGJ_CysCYm-B6rkFk3C3oft5c0YPfFuZsZ5JQtAgES8qnIVLyBhW0



Scale = 1:29.2

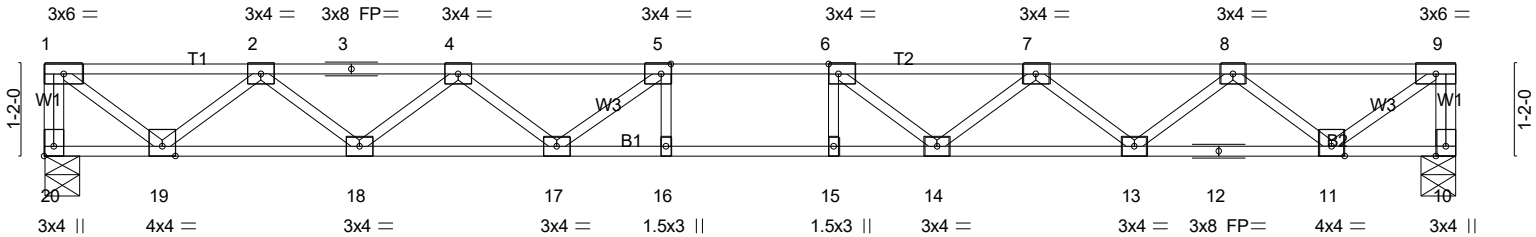

LOADING (psf) TCLL 40.0 TCDL 10.0 BCLL 0.0 BCDL 5.0	SPACING- Plate Grip DOL 1.00 Lumber DOL 1.00 Rep Stress Incr YES Code IRC2021/TPI2014	CSI. TC 0.32 BC 0.66 WB 0.46 Matrix-SH	DEFL. in (loc) l/defl L/d Vert(LL) -0.19 15-16 >999 480 Vert(CT) -0.26 15-16 >806 360 Horz(CT) -0.05 20 n/a n/a	PLATES GRIP MT20 244/190 Weight: 89 lb FT = 20%F, 11%E
--	--	---	---	---

LUMBER- TOP CHORD 2x4 SP No.1(flat) BOT CHORD 2x4 SP No.1(flat) WEBS 2x4 SP No.3(flat)	BRACING- TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
--	--

REACTIONS. (lb/size) 20=647/0-5-4 (min. 0-1-8), 10=647/0-5-4 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-20=-642/0, 9-10=-642/0, 1-2=-753/0, 2-3=-1861/0, 3-4=-1861/0, 4-5=-2496/0, 5-6=-2718/0, 6-7=-2510/0, 7-8=-1887/0, 8-9=-790/0
BOT CHORD 18-19=0/1422, 17-18=0/2280, 16-17=0/2718, 15-16=0/2718, 14-15=0/2718, 13-14=0/2296, 12-13=0/1456, 11-12=0/1456
WEBS 1-19=0/945, 2-19=-871/0, 2-18=0/572, 4-18=-544/0, 4-17=0/345, 5-17=-444/0, 6-14=-436/3, 7-14=0/345, 7-13=-533/0, 8-13=0/561, 8-11=-867/0, 9-11=0/973

NOTES- (3)
1) Unbalanced floor live loads have been considered for this design.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-08	Truss Type Floor	Qty 1	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:22 2024 Page 1
ID:fcZ0KwZoZQmeXTiMivGj_CysCYm-fJP6S43qq6nkjlbkzNSURnPm0ismvDAbNUxs1oyBhW?



Scale = 1:10.7

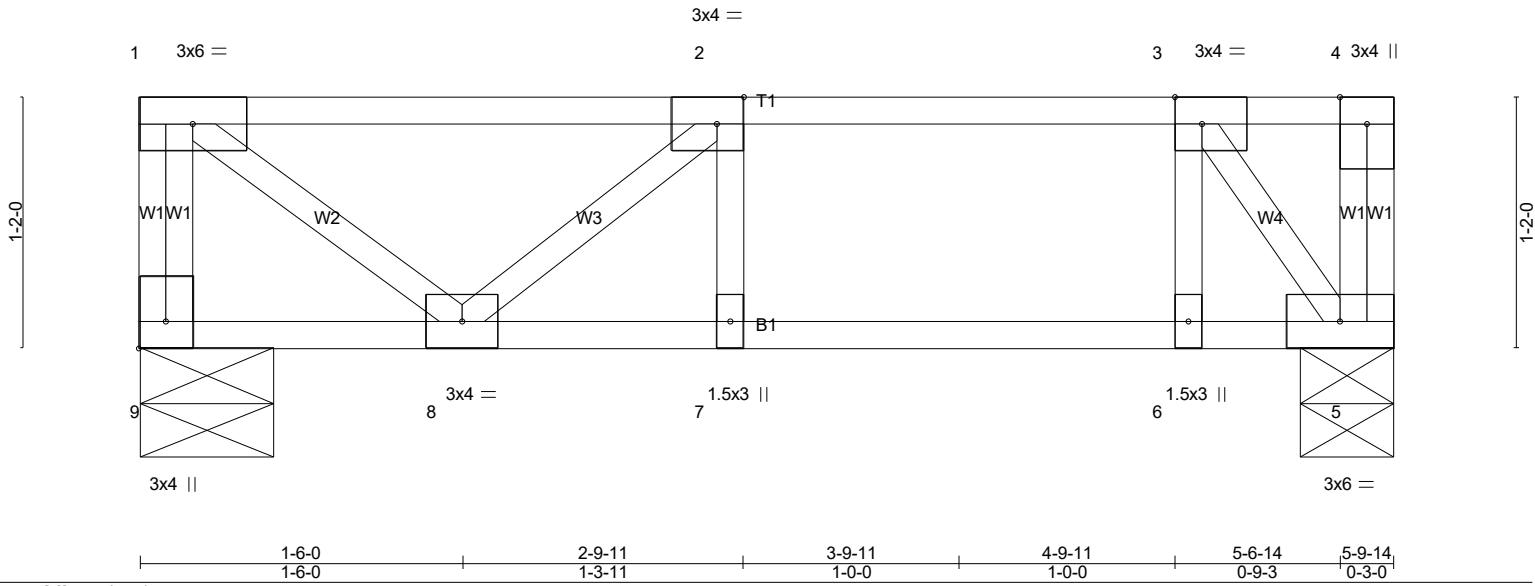


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [9:Edge,0-1-8]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.25	Vert(LL)	-0.03	7	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.30	Vert(CT)	-0.04	7	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.10	Horz(CT)	0.00	5	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 32 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-9-14 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 9=204/0-7-8 (min. 0-1-8), 5=204/0-5-4 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-5=-387/0

NOTES- (3)
1) Unbalanced floor live loads have been considered for this design.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-10	Truss Type GABLE	Qty 1	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:23 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-8VzUgQ4SbQvbKvAwW44zj_xzj6FUehRkc8GPaEyBhW_

0'-1'-8"

Scale = 1:13.0

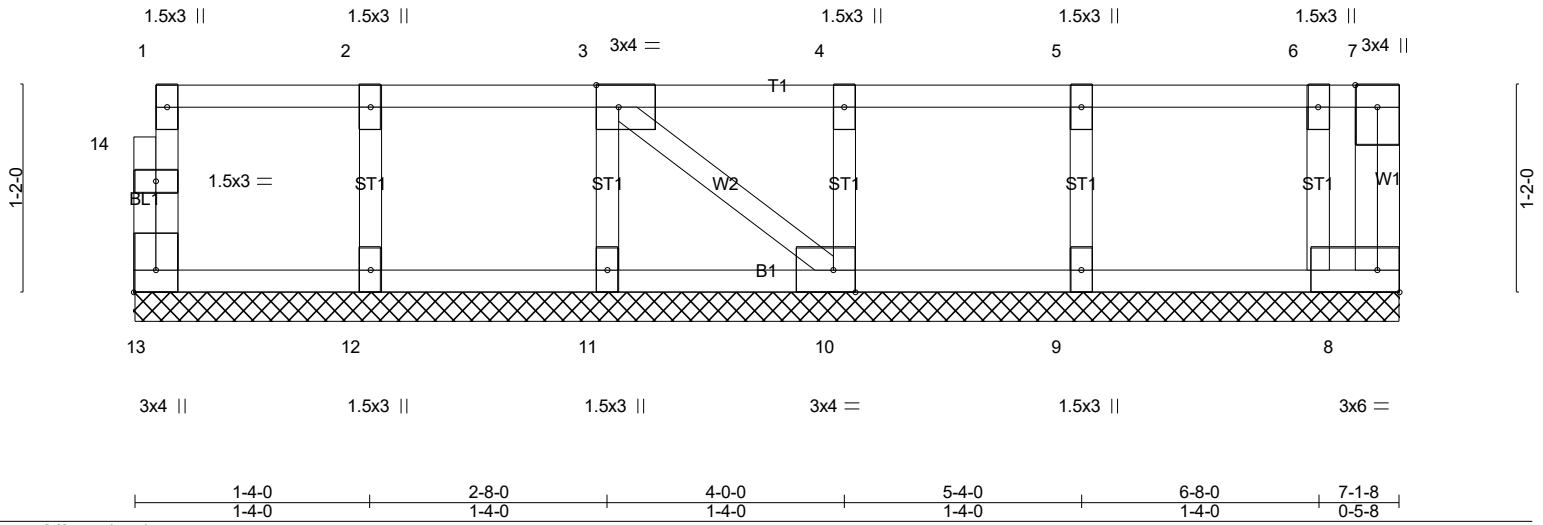


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [10:0-1-8,Edge], [13:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Lumber DOL 1.00	WB 0.03	Horz(CT)	0.00	8	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-P							
	Code IRC2021/TPI2014							Weight: 35 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 7-1-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 13, 8, 12, 11, 10, 9

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-12	Truss Type Floor	Qty 7	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:25 2024 Page 1
ID:fcZ0KwZoZQmeXTiMivGJ_CysCYm-4t5F466j619JaDKJeV?B2P1ENwlo6Wm13SiWd7yBhVy



Scale = 1:28.8

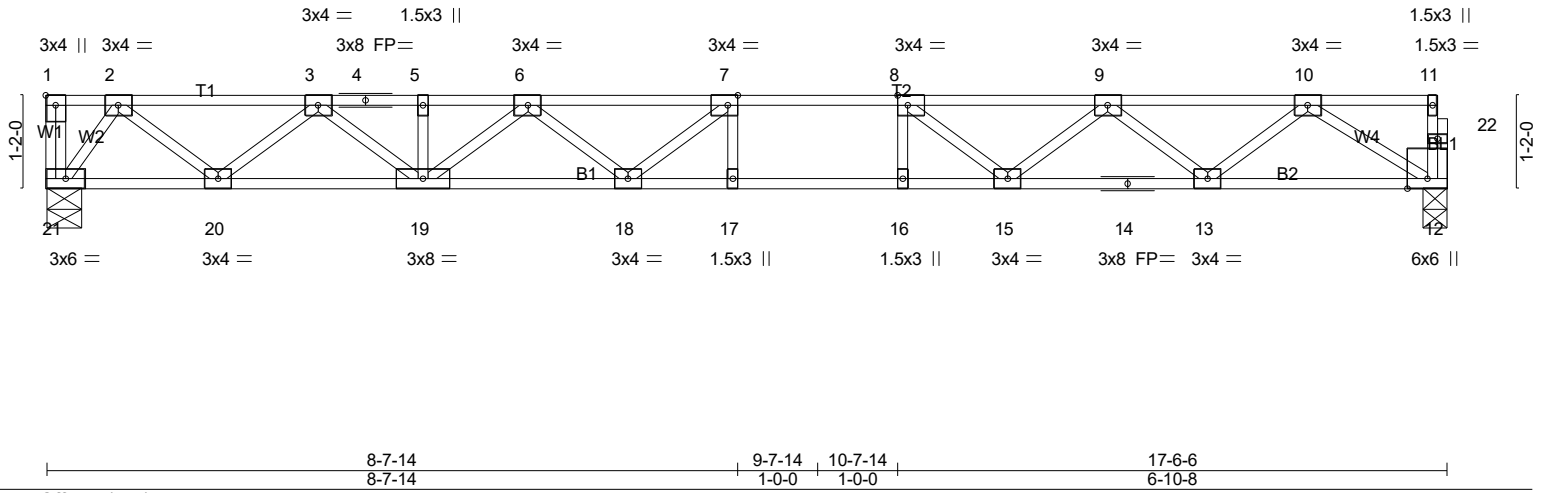


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.37	Vert(LL)	-0.20 17-18	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.79	Vert(CT)	-0.28 17-18	>745	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.36	Horz(CT)	0.04 12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 89 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 21=634/0-5-4 (min. 0-1-8), 12=629/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1067/0, 3-4=-2040/0, 4-5=-2040/0, 5-6=-2040/0, 6-7=-2516/0, 7-8=-2578/0, 8-9=-2226/0, 9-10=-1436/0
BOT CHORD 20-21=0/478, 19-20=0/1635, 18-19=0/2392, 17-18=0/2578, 16-17=0/2578, 15-16=0/2578, 14-15=0/1926, 13-14=0/1926,
12-13=0/916
WEBS 7-18=-306/127, 6-18=0/266, 6-19=-450/0, 3-19=0/517, 3-20=-739/0, 2-20=0/766, 8-15=-558/0, 9-15=0/421,
9-13=-639/0, 10-13=0/677, 10-12=-1085/0, 2-21=-797/0

NOTES- (4)
1) Unbalanced floor live loads have been considered for this design.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
3) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-13	Truss Type Floor	Qty 5	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:26 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGj_CysCYm-Y4fdIS6LlLHABNvVCDXQbdZP6K5?rz1BI6V39ZyBhVx



Scale = 1:28.5

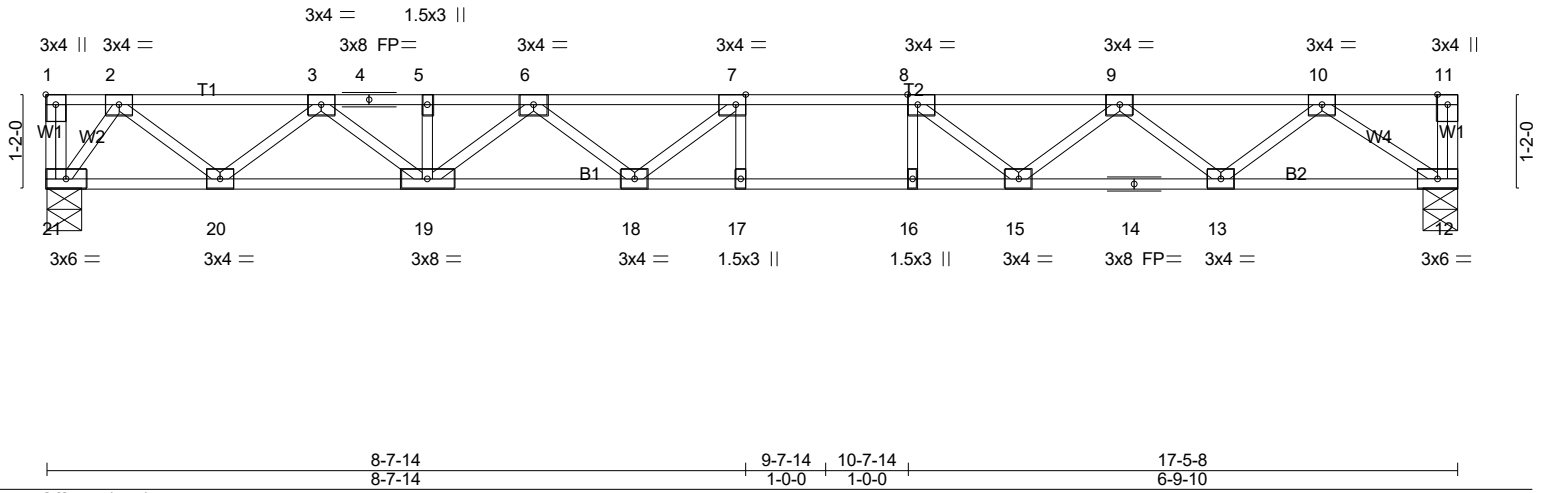


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.37	Vert(LL)	-0.20	17-18	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.79	Vert(CT)	-0.28	17-18	>748		
BCLL 0.0	Lumber DOL 1.00	WB 0.36	Horz(CT)	0.04	12	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 89 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 21=631/0-5-4 (min. 0-1-8), 12=631/0-5-4 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1062/0, 3-4=-2028/0, 4-5=-2028/0, 5-6=-2028/0, 6-7=-2498/0, 7-8=-2553/0, 8-9=-2196/0, 9-10=-1399/0
BOT CHORD 20-21=0/476, 19-20=0/1626, 18-19=0/2377, 17-18=0/2553, 16-17=0/2553, 15-16=0/2553, 14-15=0/1892, 13-14=0/1892,
12-13=0/876
WEBS 7-18=-299/131, 6-18=0/262, 6-19=-446/0, 3-19=0/513, 3-20=-735/0, 2-20=0/762, 8-15=-562/0, 9-15=0/424,
9-13=-642/0, 10-13=0/680, 10-12=-1055/0, 2-21=-794/0

NOTES- (3)
1) Unbalanced floor live loads have been considered for this design.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC
24-7744-F01	F1-13A	Floor	2	1	Job Reference (optional) # 54776

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:27 2024 Page 2
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-0GC?Vn7zeeP1pXUhlw2f8q6U9jScaJbKXmEci?yBhVw

LOAD CASE(S) Standard

4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 11-21=-7, 1-6=-13, 6-10=-67

Concentrated Loads (lb)

Vert: 2=-1000

5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 11-21=-7, 1-7=-67, 7-10=-13

Concentrated Loads (lb)

Vert: 2=-1000

6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 11-21=-7, 1-6=-13, 6-10=-67

Concentrated Loads (lb)

Vert: 2=-1000



12/5/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-14	Truss Type Floor	Qty 3	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:28 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-USmNj78bPyXuRg3JdZug2fiN7mmJpjTIQ_AESyBhVv

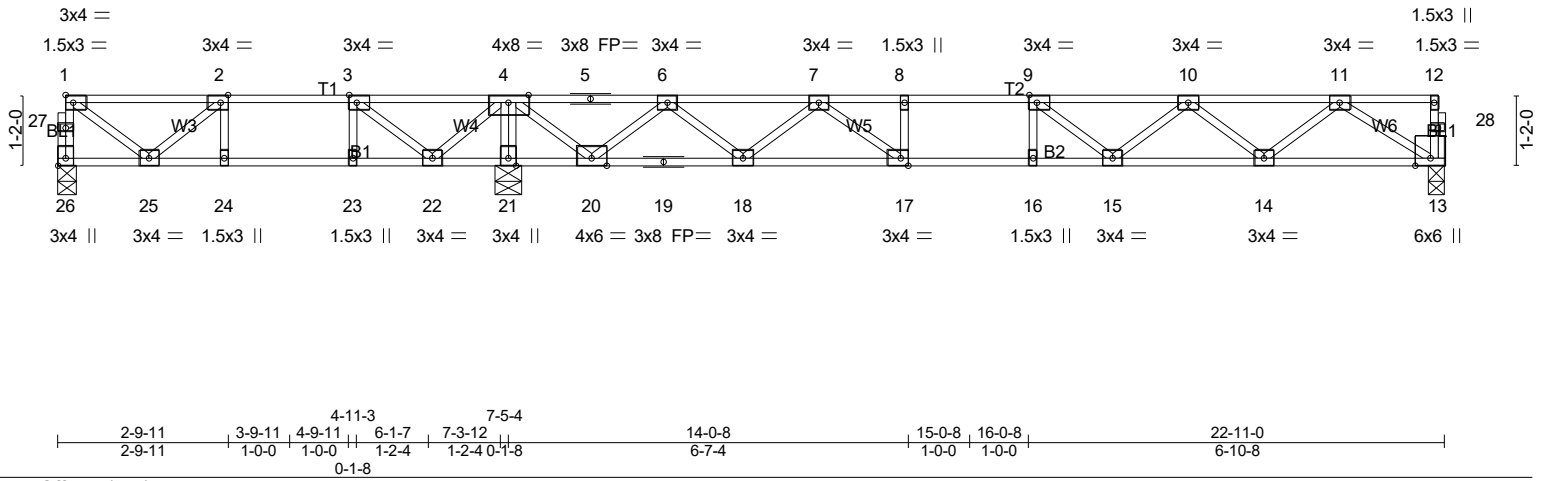


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [9:0-1-8,Edge], [17:0-1-8,Edge], [26:Edge,0-1-8]

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.51	Vert(LL) -0.17 15-16 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.84	Vert(CT) -0.23 15-16 >788 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.61	Horz(CT) 0.04 13 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 113 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 26=266/0-3-8 (min. 0-1-8), 21=1438/0-5-4 (min. 0-1-8), 13=776/0-3-8 (min. 0-1-8)
Max Uplift 26=-14(LC 4)
Max Grav 26=353(LC 3), 21=1438(LC 1), 13=789(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 26-27=-352/6, 1-27=-352/6, 1-2=-321/59, 2-3=-543/246, 3-4=-108/602, 4-5=-317/0,
5-6=-317/0, 6-7=-1767/0, 7-8=-2709/0, 8-9=-2709/0, 9-10=-2537/0, 10-11=-1730/0
BOT CHORD 24-25=-246/543, 23-24=-246/543, 22-23=-246/543, 21-22=-1013/0, 20-21=-1009/0,
19-20=0/1218, 18-19=0/1218, 17-18=0/2306, 16-17=0/2709, 15-16=0/2709, 14-15=0/2303,
13-14=0/1125
WEBS 8-17=-274/0, 4-21=-1382/0, 1-25=-75/383, 2-25=-289/243, 3-22=-796/0, 4-22=0/597,
4-20=0/1275, 6-20=-1184/0, 6-18=0/755, 7-18=-752/0, 7-17=0/705, 9-15=-388/47,
10-15=0/359, 10-14=-746/0, 11-14=0/787, 11-13=-1333/0

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 26.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-14A	Truss Type Floor	Qty 1	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	-----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:29 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-yfKmwT9DAGfl2qe4tL47DFBunX5i214d_4jijmuyBhVU

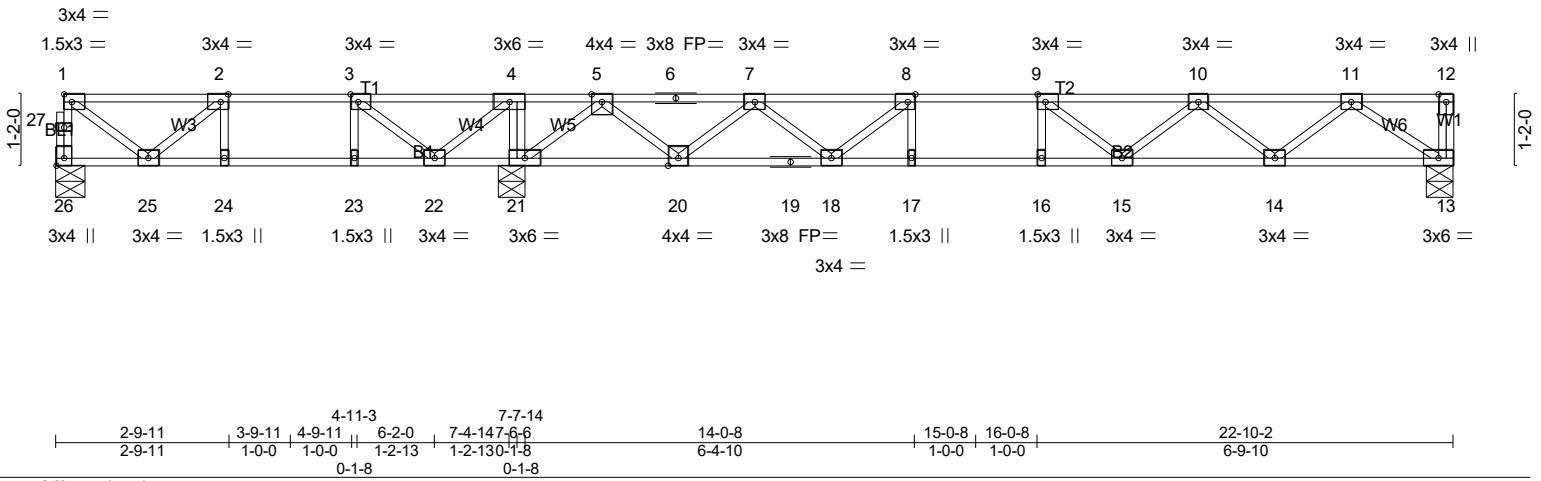


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [8:0-1-8,Edge], [9:0-1-8,Edge], [26:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.47	Vert(LL) -0.17 15-16 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.86	Vert(CT) -0.23 15-16 >809 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.47	Horz(CT) 0.04 13 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 114 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 26=268/0-5-8 (min. 0-1-8), 21=1441/0-5-4 (min. 0-1-8), 13=770/0-5-8 (min. 0-1-8)
Max Uplift 26=-14(LC 4)
Max Grav 26=355(LC 3), 21=1441(LC 1), 13=784(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 26-27=-355/6, 1-27=-354/6, 1-2=-325/59, 2-3=-553/242, 3-4=-123/608, 4-5=0/1063, 5-6=-1096/0, 6-7=-1096/0, 7-8=-2196/0, 8-9=-2637/0, 9-10=-2465/0, 10-11=-1666/0
BOT CHORD 24-25=-242/553, 23-24=-242/553, 22-23=-242/553, 21-22=-1063/0, 20-21=-21/369, 19-20=0/1795, 18-19=0/1795, 17-18=0/2637, 16-17=0/2637, 15-16=0/2637, 14-15=0/2234, 13-14=0/1066
WEBS 4-21=-573/0, 1-25=-75/387, 2-25=-298/239, 3-22=-803/0, 4-22=0/652, 8-18=-691/0, 7-18=0/565, 7-20=-950/0, 5-20=0/991, 5-21=-1395/0, 9-15=-383/51, 10-15=0/346, 10-14=-740/0, 11-14=0/781, 11-13=-1284/0

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 26.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard





12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-15	Truss Type Floor	Qty 6	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:30 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-Qru88p9rxZocg_CGR2bMITk5vxSlm3mDkTHIKyBhVt

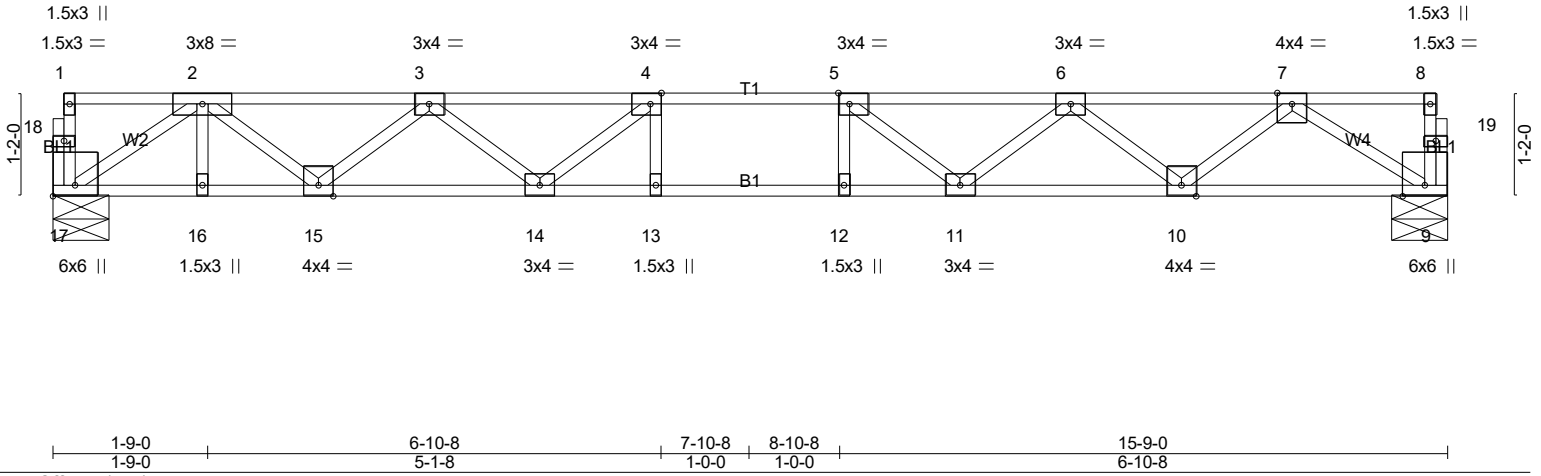

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.38	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.80	Vert(LL) -0.17 12-13 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.42	Vert(CT) -0.24 12-13 >771 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.05 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 79 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 17=846/0-7-8 (min. 0-1-8), 9=846/0-7-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1881/0, 3-4=-2834/0, 4-5=-3140/0, 5-6=-2832/0, 6-7=-1886/0
BOT CHORD 16-17=0/1183, 15-16=0/1183, 14-15=0/2519, 13-14=0/3140, 12-13=0/3140, 11-12=0/3140, 10-11=0/2519, 9-10=0/1217
WEBS 4-14=-590/0, 3-14=0/478, 3-15=-831/0, 2-15=0/891, 5-11=-591/0, 6-11=0/477, 6-10=-824/0, 7-10=0/871, 7-9=-1441/0, 2-17=-1418/0

NOTES- (3)
1) Unbalanced floor live loads have been considered for this design.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Job 24-7744-F01	Truss F1-16	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:31 2024 Page 1
ID:fcZ0KwZoZQmeXTiMivGJ_CysCYm-v1SWL9AUitwTI8nT_m6blgHLkL_RWJSwROcQrmyBhVs

0-1-8

0-1-8

Scale = 1:26.0

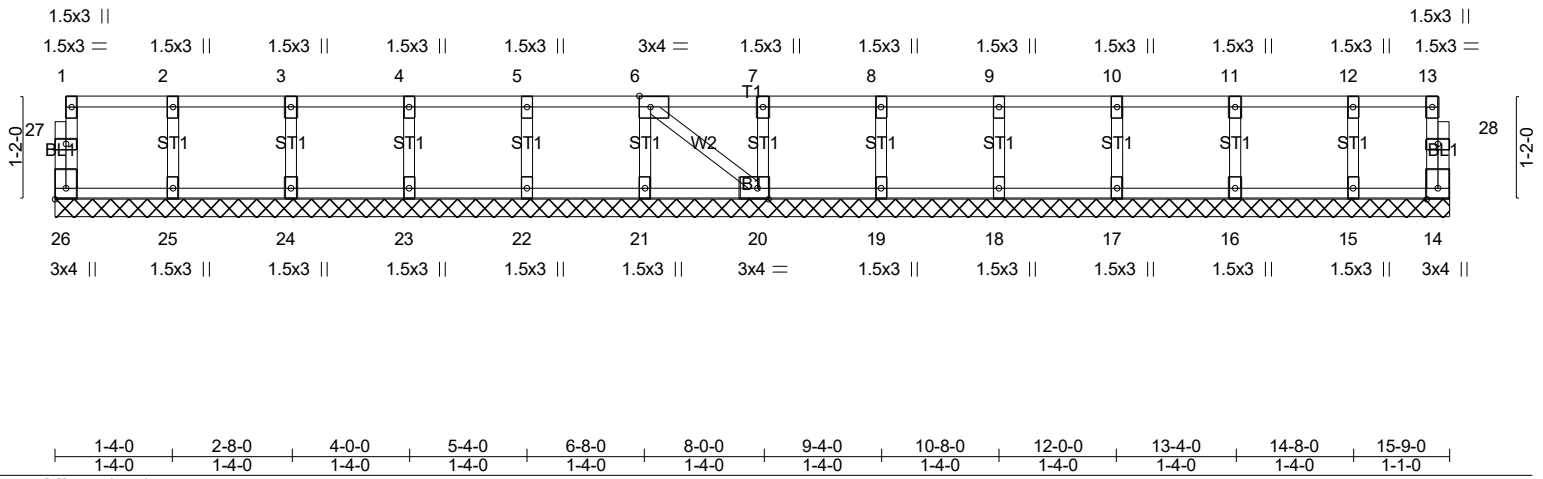

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.06	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(LL) n/a - n/a 999		
BCLL 0.0	Lumber DOL 1.00	WB 0.03	Vert(CT) n/a - n/a 999		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.00 14 n/a n/a		
	Code IRC2021/TPI2014			Weight: 69 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-9-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (5)
1) Gable requires continuous bottom chord bearing.
2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
3) Gable studs spaced at 1-4-0 oc.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-18	Truss Type Floor Supported Gable	Qty 2	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:32 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-NE0uYVB6TB2KvIMfYTdqrupWTkKgFmi3g2yNNDyBhVr

0-1-8

Scale = 1:17.8

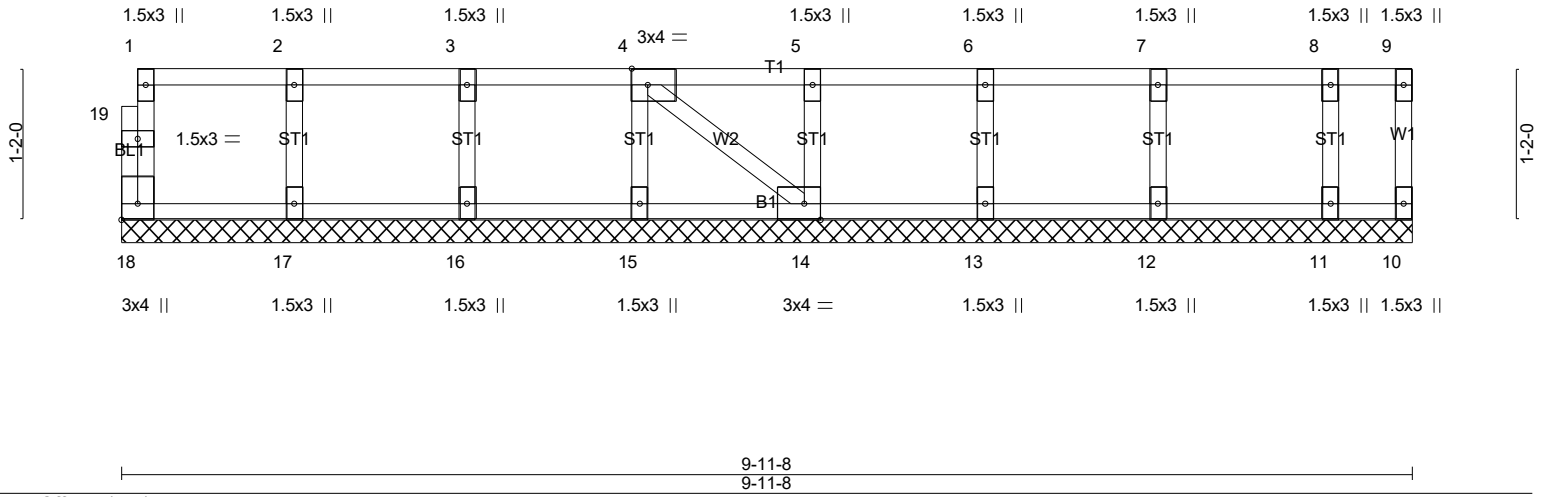


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [14:0-1-8,Edge], [18:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 10 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 45 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 9-11-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 18, 10, 17, 16, 15, 14, 13, 12, 11

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION. Do not erect truss backwards.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7744-F01	Truss F1-19	Truss Type Floor	Qty 5	Ply 1	LOT 0.0011 CAMPBELL RIDGE 290 ALDEN WAY ANGIER, NC Job Reference (optional) # 54776
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 6 13:14:33 2024 Page 1
ID:fcZ0KwZoZQmeXTIMivGJ_CysCYm-rQaGmrCKEUAAAXSxr6B93N5MeK8aC_A1DvixvfyBhVq

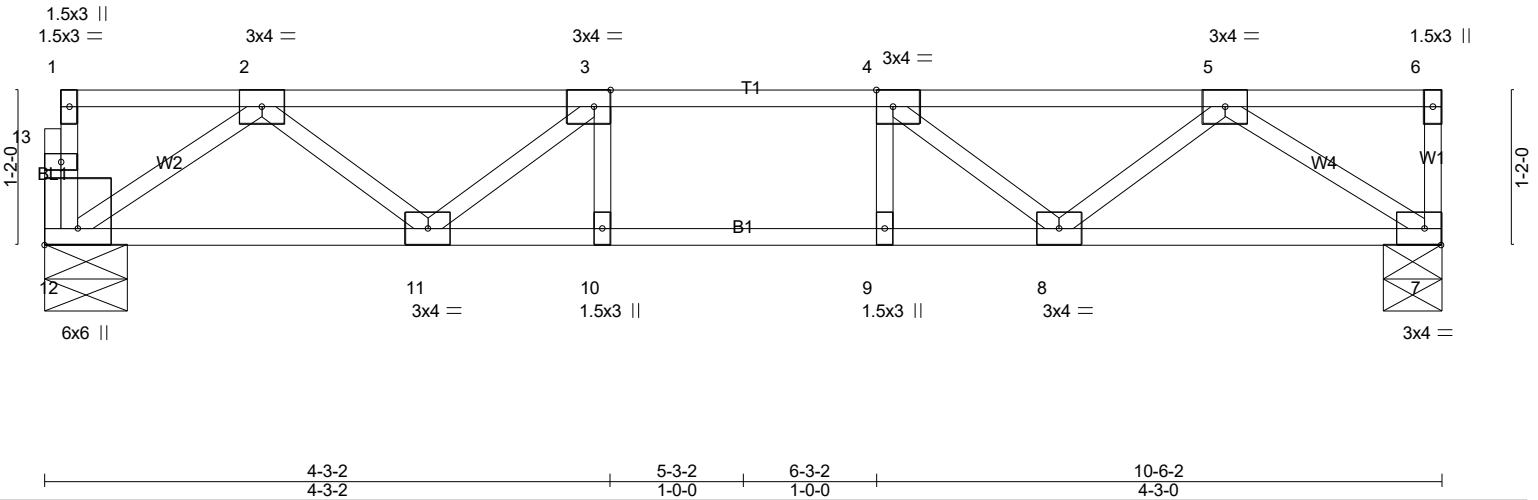



Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [12:Edge,0-3-0]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.24	Vert(LL) -0.06 8-9 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.44	Vert(CT) -0.08 9 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.22	Horz(CT) 0.02 7 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH		Weight: 52 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 12=562/0-7-8 (min. 0-1-8), 7=568/0-5-4 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1068/0, 3-4=-1386/0, 4-5=-1082/0
BOT CHORD 11-12=0/737, 10-11=0/1386, 9-10=0/1386, 8-9=0/1386, 7-8=0/759
WEBS 3-11=-451/0, 2-11=0/432, 2-12=-892/0, 4-8=-439/0, 5-8=0/420, 5-7=-912/0

NOTES- (4)
1) Unbalanced floor live loads have been considered for this design.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
3) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



12/5/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.