

# Harnett County Department of Public Health

PERMIT # SFD2412-0083

## Operation Permit

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ Expansion

PROPERTY LOCATION: 178 GROVE TOWNSHIP WAY

Name: (owner) CLAYTON PROPERTIES

SUBDIVISION LANGDON PRESERVE

LOT # 15

System Installer: BRANKLEY

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 3


Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well \_\_\_\_\_ feet

System Type: IIIb Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

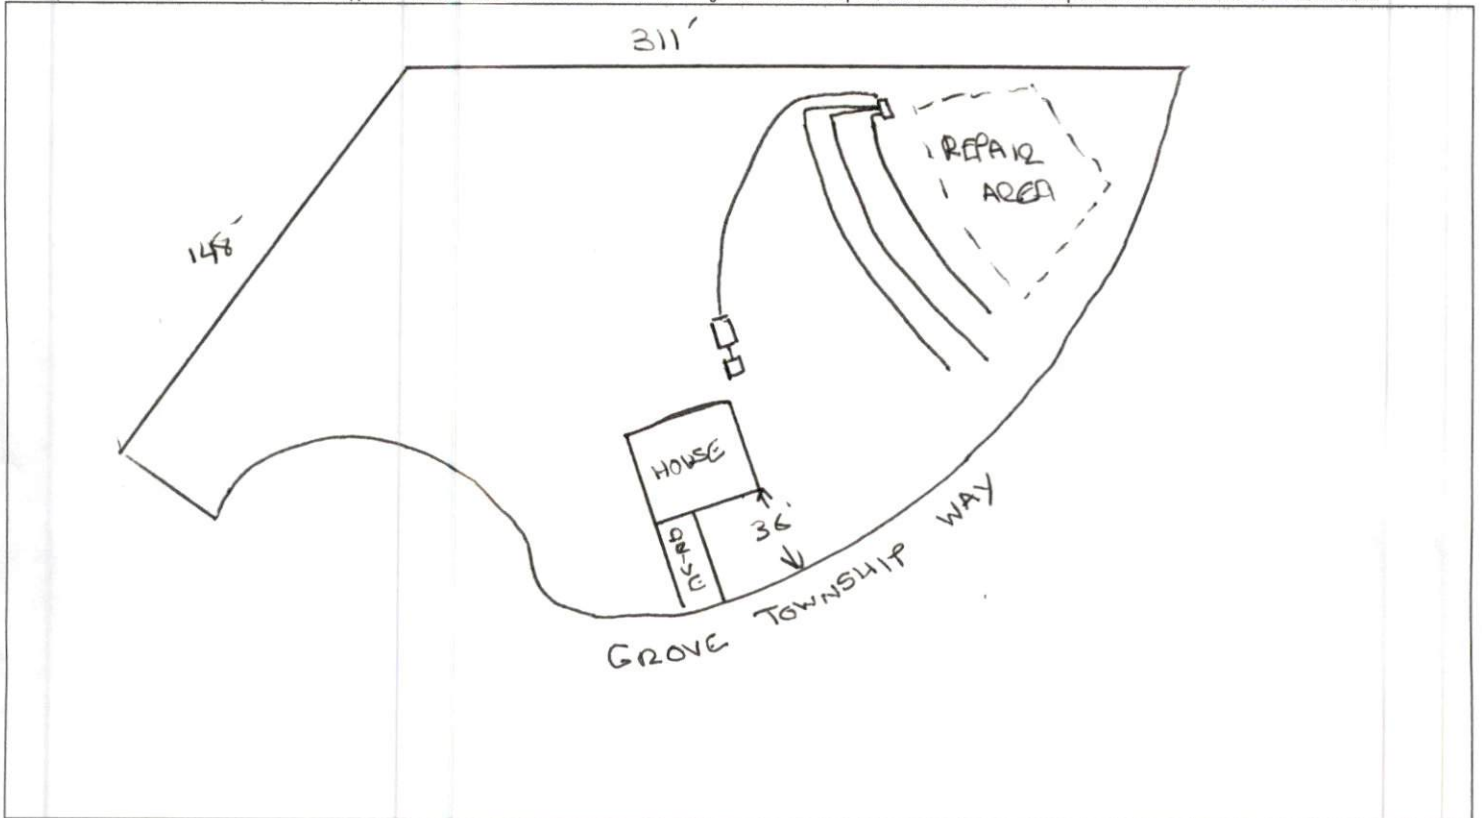

### PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes ☐ No ☒

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

PRESSURE MANIFOLD 1 1/2" SCH 40 1 1/2" SCH 80

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other PUMP TO P2 FLOW Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 3 exact length 85 width of ditches 3 depth of ditches 14 inches

French Drain Required: \_\_\_\_\_ Linear feet 305 TOTAL

Authorized State Agent \_\_\_\_\_

REHS

Date 3/10/25