

# Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 55152

JOB: 24-B429-F01

JOB NAME: LOT 0.0018 CAMPBELL RIDGE

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2018 as well as IRC 2021.

*28 Truss Design(s)*

Trusses:

F1-01, F1-02, F1-03, F1-04, F1-05, F1-06, F1-08, F1-08A, F1-08B, F1-08C, F1-08D, F1-08E, F1-09, F1-10, F1-11, F1-12, F1-13, F1-14, F1-15, F1-16, F1-17, F1-18, F1-19, F1-20, F1-21, F1-



**12/12/2024**

**Mark Morris**

***Warning !—Verify design parameters and read notes before use.***

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSL/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI

Job 24-B429-F01	Truss F1-01	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	-------------------------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:51 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-RqwmHlxA9YwUgVBtDcG8p2yh\_zklMJeusrXIXyy9NDE

0<sub>1</sub>-8

Scale = 1:21.5

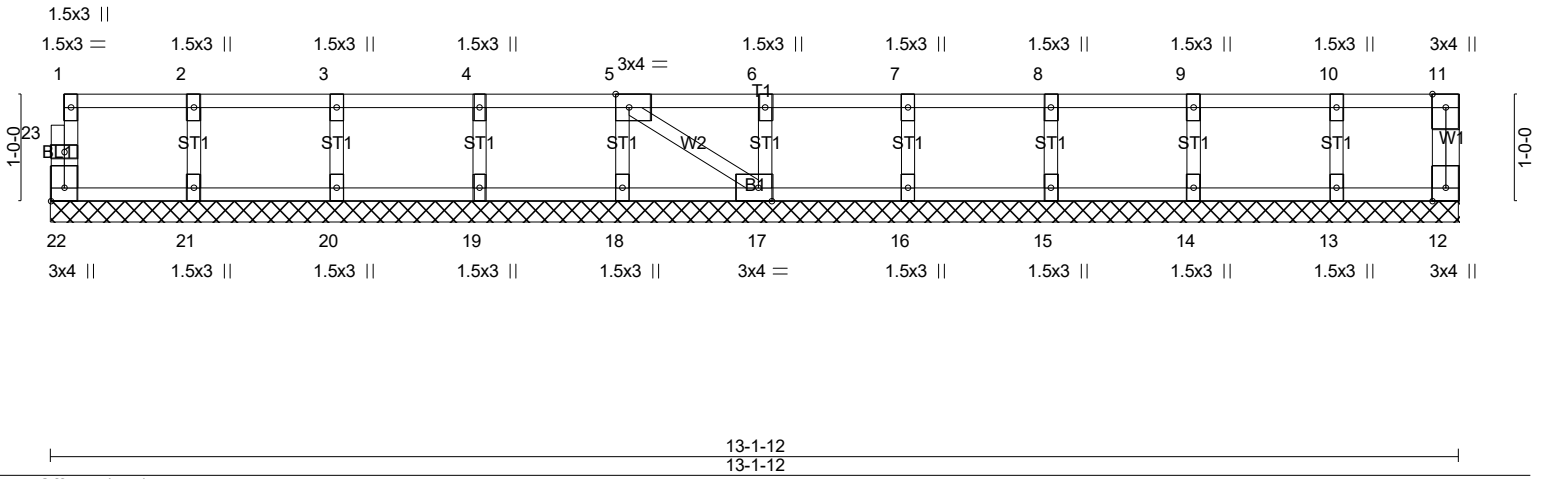


Plate Offsets (X,Y)-- [5:0-1-8,Edge], [17:0-1-8,Edge], [22:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	12	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 55 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)  
OTHERS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 13-1-12.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)  
1) Gable requires continuous bottom chord bearing.  
2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
3) Gable studs spaced at 1-4-0 oc.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
5) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard






12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-02	Truss Type Floor	Qty 5	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:51 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-RqwmHlxA9YwUgVbtDcG8p2ycMzcQMBousrXIXyy9NDE

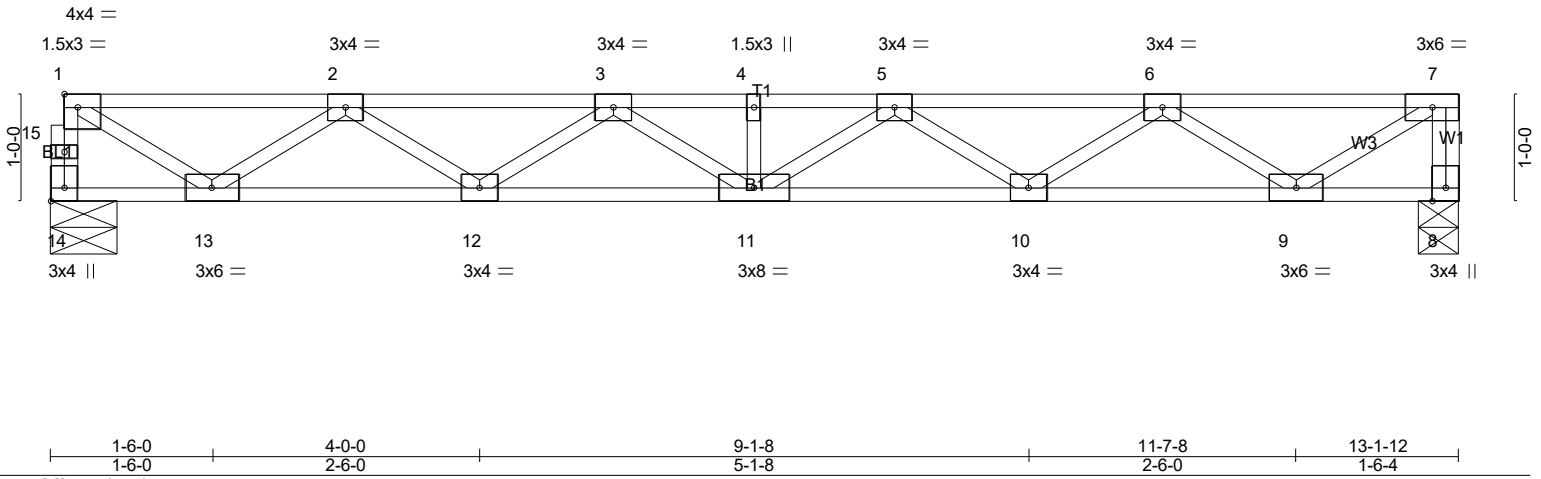

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	2.0-0	TC	0.35	Vert(LL)	-0.12	11	>999	480	MT20	244/190	
TCDL	10.0	Lumber DOL	1.00	BC	0.54	Vert(CT)	-0.17	11	>937	360			
BCLL	0.0	Rep Stress Incr	NO	WB	0.53	Horz(CT)	0.03	8	n/a	n/a			
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH									Weight: 66 lb FT = 20%F, 11%E

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

**REACTIONS.** (lb/size) 14=703/0-7-8 (min. 0-1-8), 8=1349/0-4-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 14-15=-698/0, 1-15=-696/0, 7-8=-1342/0, 1-2=-940/0, 2-3=-2158/0, 3-4=-2605/0, 4-5=-2605/0, 5-6=-2166/0, 6-7=-950/0  
BOT CHORD 12-13=0/1759, 11-12=0/2521, 10-11=0/2523, 9-10=0/1772  
WEBS 1-13=0/1070, 2-13=-1000/0, 2-12=0/487, 3-12=-443/0, 5-10=-436/0, 6-10=0/481, 6-9=-1004/0, 7-9=0/1121

- NOTES-** (4)  
1) Load case(s) 1, 2 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.  
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
3) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard  
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 8-14=-10, 1-7=-100  
Concentrated Loads (lb)  
Vert: 7=-640  
2) Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 8-14=-10, 1-7=-100  
Concentrated Loads (lb)  
Vert: 7=-640



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-03	Truss Type Floor	Qty 1	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:52 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-v0U9Veyovs2Llfm4nKoNMGUJRn?k5dM15VHJ4Oy9NDD

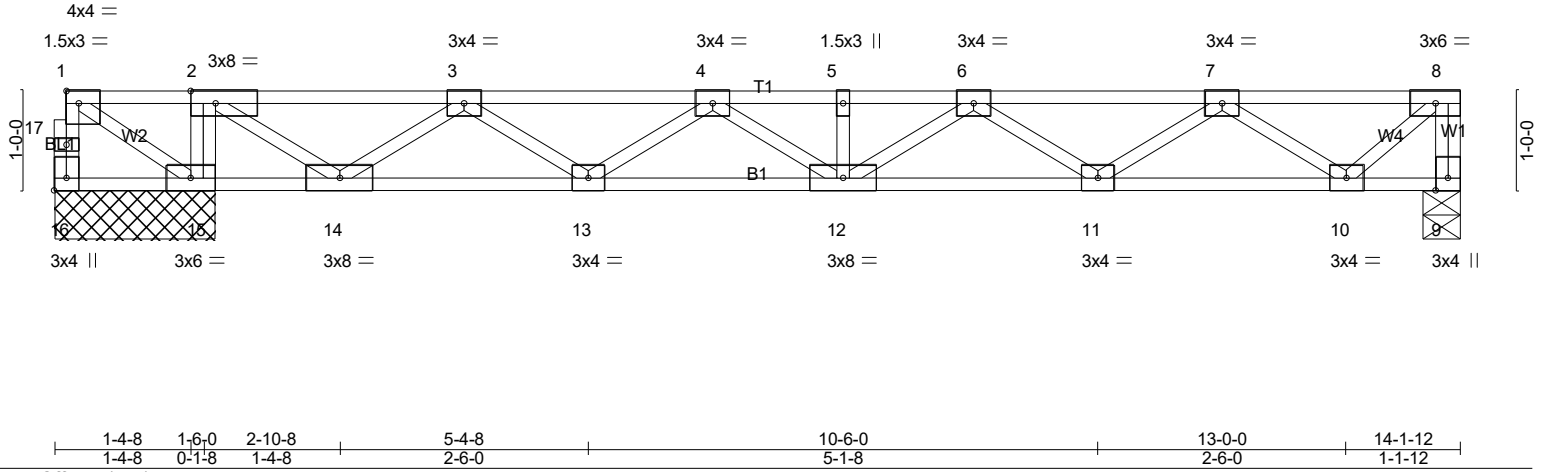



Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-3-0,Edge], [16:Edge,0-1-8]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.59	Vert(LL) -0.07 12 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.34	Vert(CT) -0.10 12 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.58	Horz(CT) 0.01 9 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 73 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.3(flat)	6-0-0 oc bracing: 15-16,14-15.

**REACTIONS.** (lb/size) 16=-964/1-7-8 (min. 0-1-8), 9=575/0-4-8 (min. 0-1-8), 15=1911/1-7-8 (min. 0-1-8)  
Max Uplift 16=-1011(LC 4)  
Max Grav 9=575(LC 4), 15=1911(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 16-17=0/1005, 1-17=0/1003, 8-9=-572/0, 1-2=0/1536, 2-3=0/514, 3-4=-954/0, 4-5=-1670/0, 5-6=-1670/0, 6-7=-1498/0, 7-8=-564/0  
BOT CHORD 14-15=-1536/0, 13-14=0/413, 12-13=0/1456, 11-12=0/1734, 10-11=0/1227  
WEBS 2-15=-891/0, 1-15=-1760/0, 2-14=0/1213, 3-14=-1129/0, 3-13=0/663, 4-13=-615/0, 4-12=0/257, 6-11=-288/0, 7-11=0/332, 7-10=-809/0, 8-10=0/743

- NOTES-** (6)  
1) Unbalanced floor live loads have been considered for this design.  
2) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1011 lb uplift at joint 16.  
3) This truss has large uplift reaction(s) from gravity load case(s). Proper connection is required to secure truss against upward movement at the bearings. Building designer must provide for uplift reactions indicated.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
5) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-04	Truss Type Floor	Qty 8	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) # 55152
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:53 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcY1-NC2XizyQg9ABwpKGK1JcuT1zenHCq5xAJ90scqy9NDC

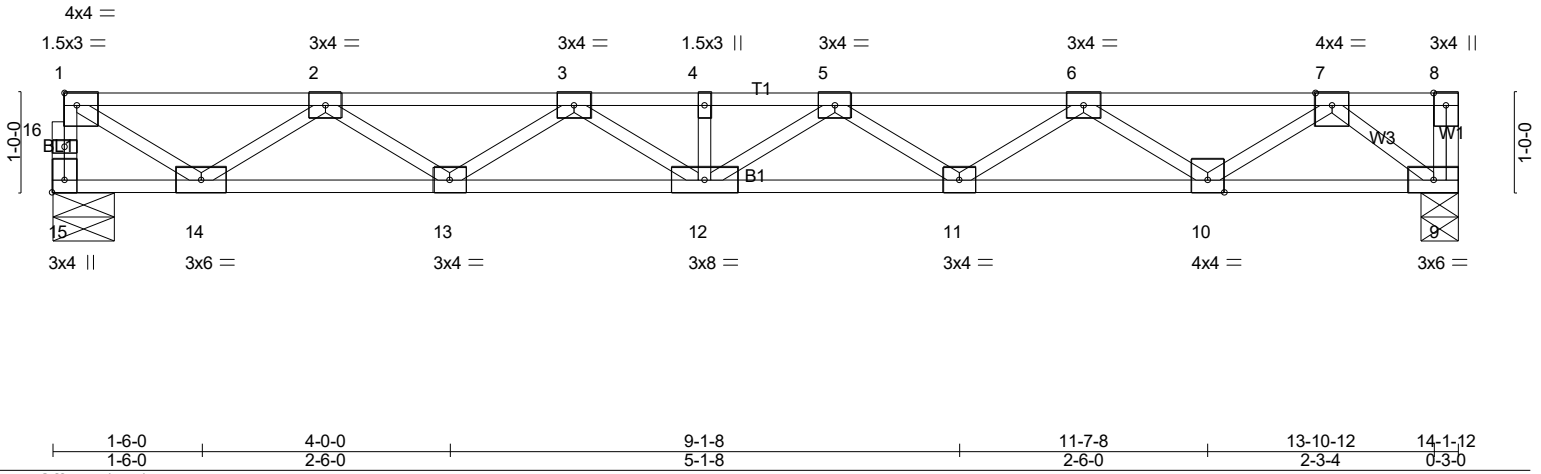




Plate Offsets (X,Y)-- [1:Edge,0-1-8], [15:Edge,0-1-8]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00		TC 0.30	Vert(LL) -0.16	12	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.58	Vert(CT) -0.22	11-12	>764	360		
BCLL 0.0	Rep Stress Incr YES		WB 0.56	Horz(CT) 0.04	9	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 71 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 15=758/0-7-8 (min. 0-1-8), 9=764/0-4-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 15-16=-753/0, 1-16=-751/0, 1-2=-1026/0, 2-3=-2400/0, 3-4=-3005/0, 4-5=-3005/0, 5-6=-2721/0, 6-7=-1692/0  
BOT CHORD 13-14=0/1923, 12-13=0/2841, 11-12=0/3013, 10-11=0/2396, 9-10=0/950  
WEBS 1-14=0/1168, 2-14=-1095/0, 2-13=0/583, 3-13=-539/0, 5-11=-356/0, 6-11=0/398, 6-10=-859/0, 7-10=0/905, 7-9=-1196/0

**NOTES-** (3)  
1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
2) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-05	Floor Supported Gable	1	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:54 2024 Page 1  
 ID:5fxLxLn?C6dWjia?SHK4thzkcYl-OcwwJz3RTI2XzvSulqrRhaCCAmSgOKYpmQ8Gy9NDB

0-1-8

Scale = 1:23.2

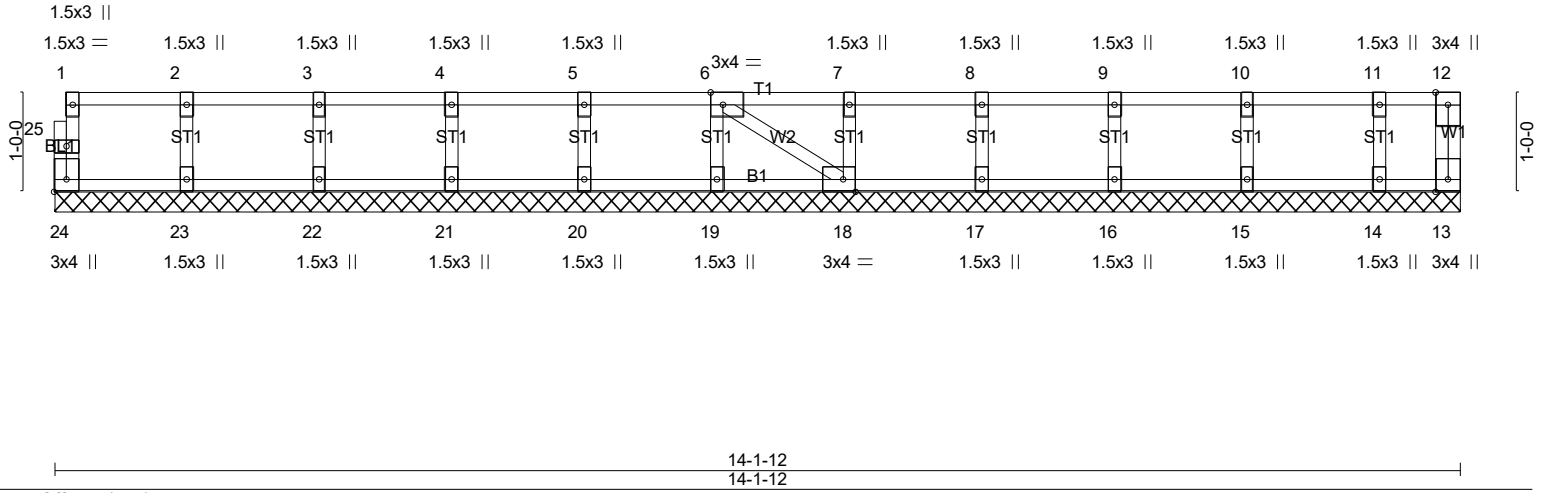


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [18:0-1-8,Edge], [24:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 59 lb	FT = 20%F, 11%E

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)  
 OTHERS 2x4 SP No.3(flat)

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 14-1-12.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 24, 13, 23, 22, 21, 20, 19, 18, 17, 16, 15, 14

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)  
 1) Gable requires continuous bottom chord bearing.  
 2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
 3) Gable studs spaced at 1-4-0 oc.  
 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
 5) CAUTION. Do not erect truss backwards.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-06	Truss Type GABLE	Qty 1	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:54 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-rOcvwJz3RTI2XzvSulqrRhaBpAmQZgIKYpmQ8Gy9NDB

Scale = 1:12.7

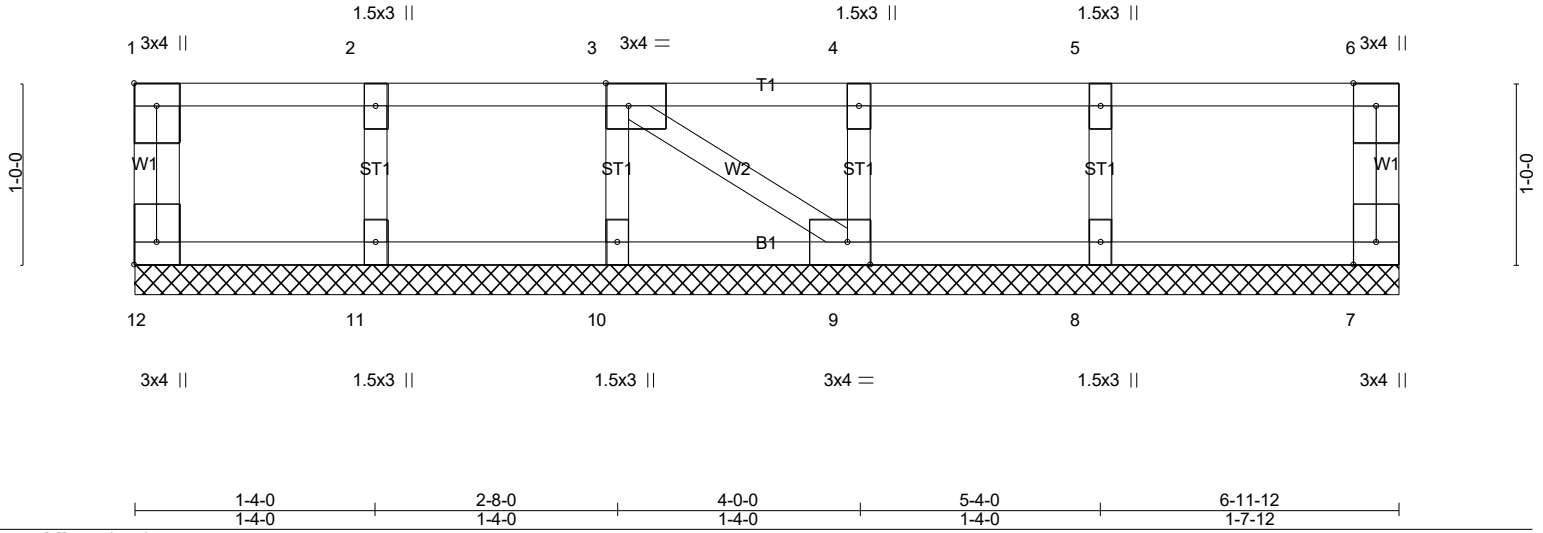


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [9:0-1-8,Edge], [12:Edge,0-1-8]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.08	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.04	Horz(CT) -0.00 9 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P		Weight: 32 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)  
OTHERS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-11-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 6-11-12.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 12, 7, 11, 10, 9, 8

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (5)  
1) Gable requires continuous bottom chord bearing.  
2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
3) Gable studs spaced at 1-4-0 oc.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08	Floor	6	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:55 2024 Page 1  
 ID:5fxLxLn?C6dWjia?SHK4thzkcYI-KbAH7f\_hCnQv96UfSSL4\_u6l3a2q11MTnTVzgjy9NDA

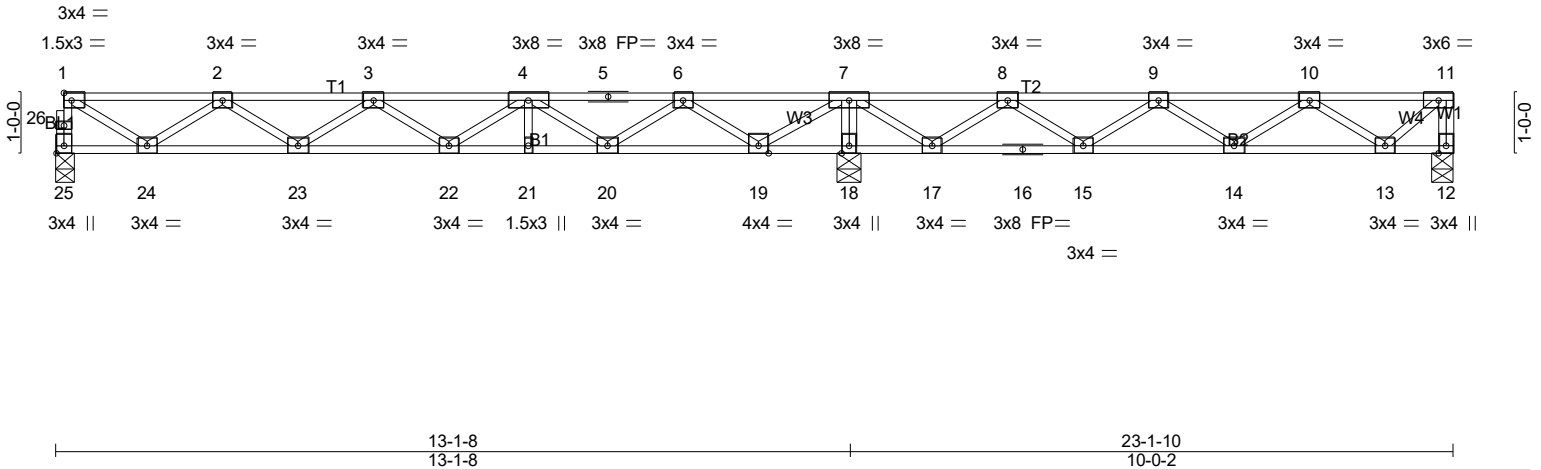



Plate Offsets (X,Y)-- [25:Edge,0-1-8]		13-1-8 13-1-8		23-1-10 10-0-2	
<b>LOADING</b> (psf)	<b>SPACING-</b>	1-4-0	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.31	in (loc)	l/defl	L/d
TCDL 10.0	Lumber DOL 1.00	BC 0.25	Vert(LL) -0.06	22 >999	480
BCLL 0.0	Rep Stress Incr YES	WB 0.43	Vert(CT) -0.08	22 >999	360
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH	Horz(CT) 0.01	18 n/a	n/a
Weight: 115 lb FT = 20%F, 11%E					

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 25=380/0-3-8 (min. 0-1-8), 12=881/0-4-6 (min. 0-1-8), 18=1054/0-4-8 (min. 0-1-8)  
 Max Grav 25=400(LC 3), 12=942(LC 4), 18=1054(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 25-26=-397/0, 1-26=-396/0, 11-12=-940/0, 1-2=-519/0, 2-3=-1142/0, 3-4=-1215/0, 4-5=-747/62, 5-6=-747/62,  
 6-7=0/517, 7-8=0/780, 8-9=-543/385, 9-10=-675/123, 10-11=-278/11  
 BOT CHORD 23-24=0/966, 22-23=0/1295, 21-22=0/1108, 20-21=0/1108, 19-20=-214/377, 18-19=-1301/0, 17-18=-1307/0,  
 16-17=-568/338, 15-16=-568/338, 14-15=-229/723, 13-14=-42/603  
 WEBS 7-18=-1026/0, 1-24=0/589, 2-24=-546/0, 4-20=-475/0, 6-20=0/491, 6-19=-793/0, 7-19=0/909, 7-17=0/705, 8-17=-653/0,  
 8-15=0/363, 9-15=-332/0, 10-13=-397/39, 11-13=-14/368

- NOTES-** (5)  
 1) Unbalanced floor live loads have been considered for this design.  
 2) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.  
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
 4) CAUTION, Do not erect truss backwards.

- LOAD CASE(S)** Standard  
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 12-25=-7, 1-11=-67  
 Concentrated Loads (lb)  
 Vert: 11=-640  
 2) Dead: Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 12-25=-7, 1-11=-67  
 Concentrated Loads (lb)  
 Vert: 11=-640  
 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 12-25=-7, 1-7=-67, 7-11=-13  
 Concentrated Loads (lb)  
 Vert: 11=-640



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08	Floor	6	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:56 2024 Page 2  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-onkL??Jz4YmnG3r0AsJW6fTp\_O31Ucd07FWDy9ND9

**LOAD CASE(S)** Standard

4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-25=-7, 1-7=-13, 7-11=-67

Concentrated Loads (lb)

Vert: 11=-640

5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-25=-7, 1-7=-67, 7-11=-13

Concentrated Loads (lb)

Vert: 11=-640

6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-25=-7, 1-7=-13, 7-11=-67

Concentrated Loads (lb)

Vert: 11=-640



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-08A	Truss Type Floor	Qty 5	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	-----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:57 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcY1-GzI2YL0xkOgdOQe1ZtNY3JBdKOiDmwmEn?4lby9ND8

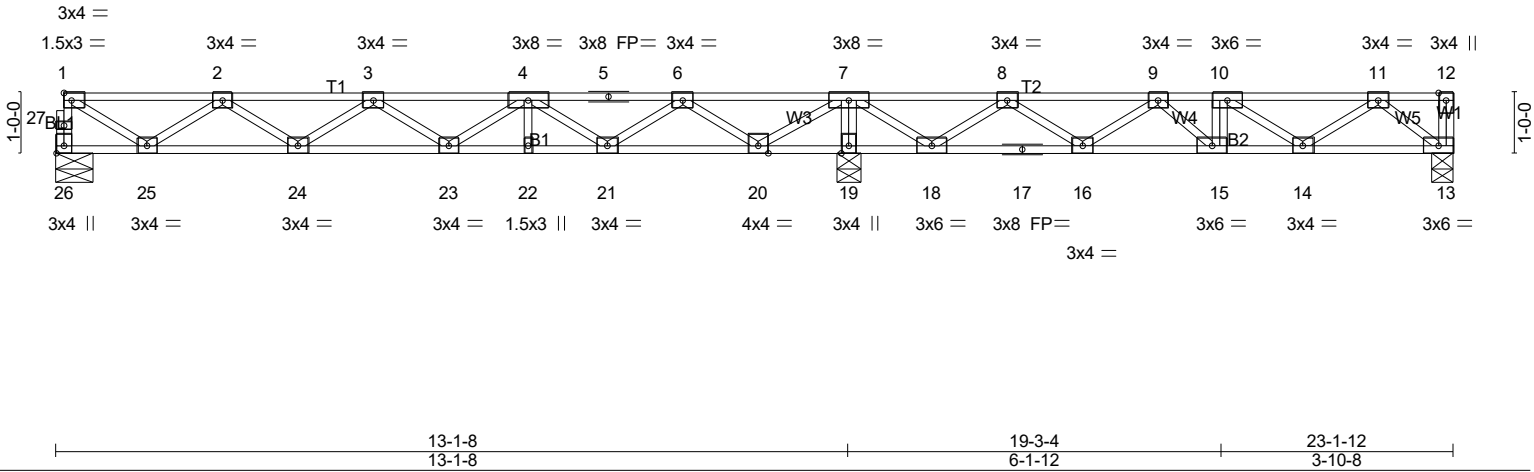



Plate Offsets (X,Y)-- [26:Edge,0-1-8]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.06	23	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.32	Vert(CT)	-0.07	23	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.49	Horz(CT)	0.01	13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
										Weight: 117 lb FT = 20%F, 11%E

**LUMBER-**

TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** (lb/size) 26=360/0-7-8 (min. 0-1-8), 19=2212/0-4-8 (min. 0-1-8), 13=1103/0-4-8 (min. 0-1-8)  
Max Grav 26=381(LC 3), 19=2212(LC 1), 13=1165(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 26-27=-377/0, 1-27=-376/0, 12-13=-649/0, 1-2=-488/0, 2-3=-1056/0, 3-4=-1072/0,  
4-5=-546/264, 5-6=-546/264, 6-7=0/776, 7-8=0/799, 8-9=-1027/0, 9-10=-1674/0,  
10-11=-1153/0  
BOT CHORD 24-25=0/907, 23-24=0/1180, 22-23=-100/936, 21-22=-100/936, 20-21=-445/147,  
19-20=-1589/0, 18-19=-1600/0, 17-18=-333/575, 16-17=-333/575, 15-16=0/1449,  
14-15=0/1674, 13-14=0/653  
WEBS 10-15=-250/0, 7-19=-2177/0, 1-25=0/554, 2-25=-512/0, 4-21=-510/0, 6-21=0/526,  
6-20=-829/0, 7-20=0/942, 7-18=0/1031, 8-18=-965/0, 8-16=0/664, 9-16=-627/0,  
9-15=0/391, 10-14=-618/0, 11-14=0/610, 11-13=-827/0

- NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-12=-67  
Concentrated Loads (lb)  
Vert: 12=-640 7=-960 10=-400  
2) Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-12=-67  
Concentrated Loads (lb)  
Vert: 12=-640 7=-960 10=-400  
3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-7=-67, 7-12=-13



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08A	Floor	5	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:57 2024 Page 2  
ID:5fxLxLn?C6dWjia?SHK4thzkcY1-GzI2YL0xkOgdOQe1ZtNY3JBdKOiDmwymEn?4lby9ND8

**LOAD CASE(S)** Standard

- Concentrated Loads (lb)  
Vert: 12=-640 7=-960 10=-400
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 12=-640 7=-960 10=-400
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-7=-67, 7-12=-13  
Concentrated Loads (lb)  
Vert: 12=-640 7=-960 10=-400
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 12=-640 7=-960 10=-400





12/12/2024

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08B	Floor	1	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:59 2024 Page 1  
 ID:5fxLxLn?C6dWjia?SHK4thzkcYI-CMPoz11BG?wLekoQhIQ08kHzpBOhEqQ3i4UBpUy9ND6

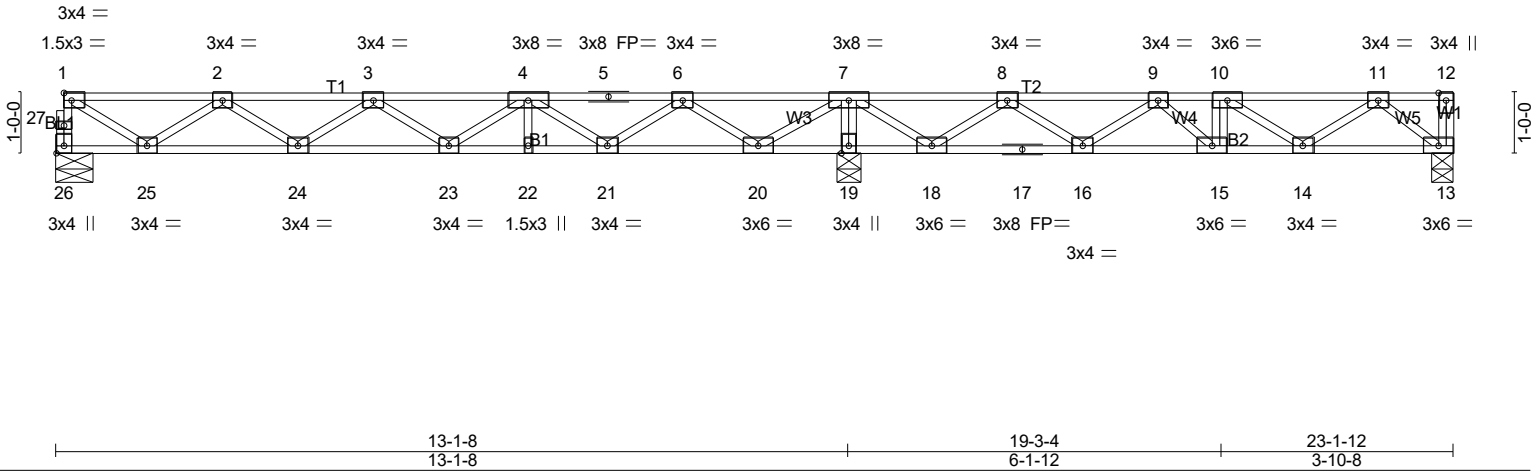

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.06	23	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.32	Vert(CT)	-0.07	23	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.49	Horz(CT)	0.01	13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
										Weight: 117 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 26=360/0-7-8 (min. 0-1-8), 19=1252/0-4-8 (min. 0-1-8), 13=463/0-4-8 (min. 0-1-8)  
 Max Grav 26=380(LC 3), 19=1252(LC 1), 13=524(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 26-27=-377/0, 1-27=-376/0, 1-2=-487/0, 2-3=-1054/0, 3-4=-1069/0, 4-5=-541/269, 5-6=-541/269, 6-7=0/782, 7-8=0/800, 8-9=-1025/0, 9-10=-1674/0, 10-11=-1152/0  
 BOT CHORD 24-25=0/906, 23-24=0/1177, 22-23=-105/932, 21-22=-105/932, 20-21=-450/142, 19-20=-1597/0, 18-19=-1604/0, 17-18=-335/574, 16-17=-335/574, 15-16=0/1448, 14-15=0/1674, 13-14=0/652  
 WEBS 10-15=-251/0, 7-19=-1220/0, 1-25=0/553, 2-25=-511/0, 4-21=-511/0, 6-21=0/527, 6-20=-829/0, 7-20=0/945, 7-18=0/1034, 8-18=-965/0, 8-16=0/663, 9-16=-627/0, 9-15=0/392, 10-14=-618/0, 11-14=0/610, 11-13=-826/0

- NOTES-** (5)  
 1) Unbalanced floor live loads have been considered for this design.  
 2) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.  
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
 4) CAUTION, Do not erect truss backwards.

- LOAD CASE(S)** Standard  
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 13-26=-7, 1-12=-67  
 Concentrated Loads (lb)  
 Vert: 10=-400  
 2) Dead: Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 13-26=-7, 1-12=-67  
 Concentrated Loads (lb)  
 Vert: 10=-400  
 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 13-26=-7, 1-7=-67, 7-12=-13



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08B	Floor	1	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:57:59 2024 Page 2  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-CMPoz11BG?wLekoQhIQ08kHzpBOhEqQ3i4UBpUy9ND6

**LOAD CASE(S)** Standard

- Concentrated Loads (lb)  
Vert: 10=-400
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 10=-400
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-7=-67, 7-12=-13  
Concentrated Loads (lb)  
Vert: 10=-400
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-26=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 10=-400



12/12/2024


**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08C	Floor	5	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:00 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-gYzAAN2p1J2CFuNcF?xPhyp6UvibvEQCwkDkMwy9ND5

0-3-8

0-3-0  
Scale = 1:38.0

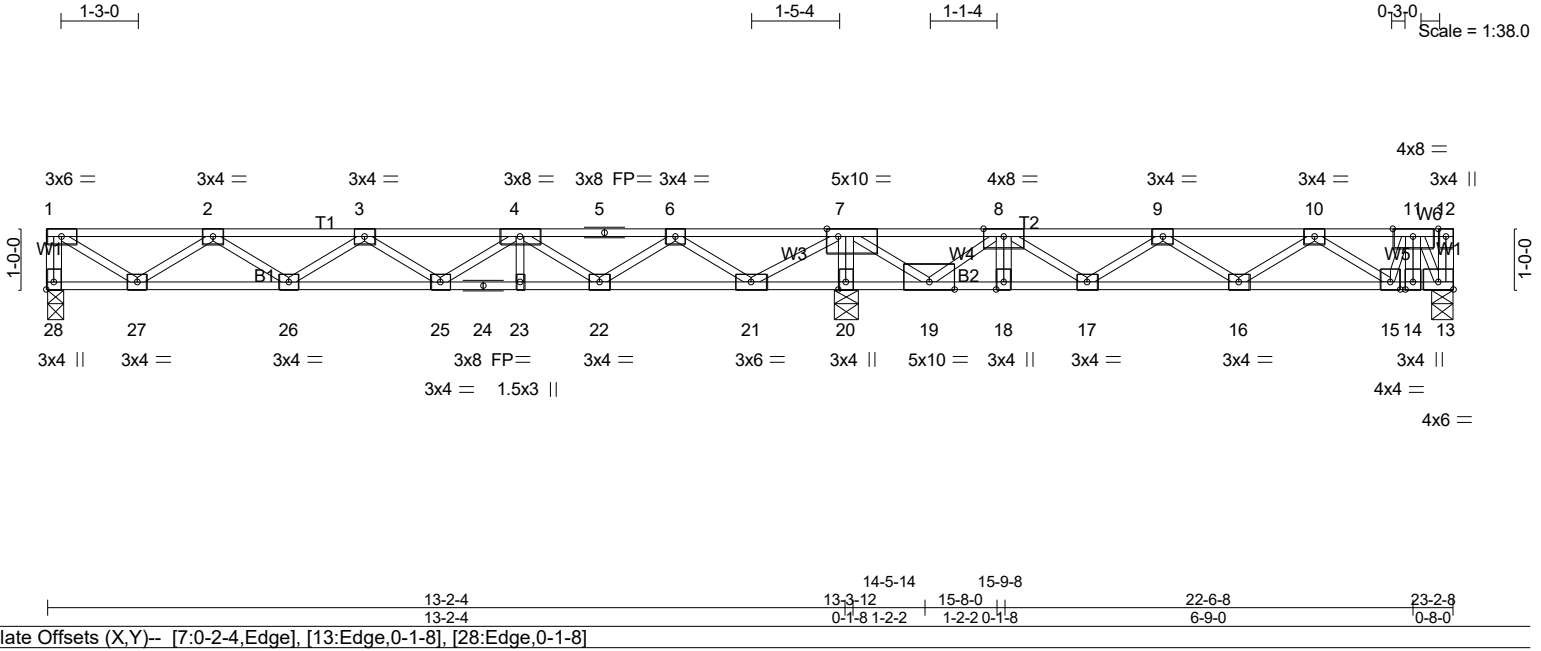

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.46	Vert(LL) -0.06 25 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.45	Vert(CT) -0.09 16-17 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.70	Horz(CT) 0.01 13 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 121 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat) *Except* W2: 2x4 SP No.2(flat)	

**REACTIONS.** (lb/size) 28=319/0-3-8 (min. 0-1-8), 20=2094/0-4-8 (min. 0-1-8), 13=1431/0-4-8 (min. 0-1-8)  
Max Grav 28=340(LC 3), 20=2094(LC 1), 13=1493(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-28=-336/0, 1-2=-416/0, 2-3=-858/89, 3-4=-746/331, 4-5=-86/735, 5-6=-86/735, 6-7=0/1364, 7-8=-398/269, 8-9=-2205/0, 9-10=-1890/0, 10-11=-1070/0  
BOT CHORD 26-27=-16/775, 25-26=-188/917, 24-25=-503/543, 23-24=-503/543, 22-23=-503/543, 21-22=-983/0, 20-21=-2280/0, 19-20=-2296/0, 18-19=0/2204, 17-18=0/2204, 16-17=0/2173, 15-16=0/1587, 14-15=0/890, 13-14=0/890  
WEBS 7-20=-2045/0, 1-27=0/493, 2-27=-438/22, 4-25=0/279, 4-22=-589/0, 6-22=0/606, 6-21=-908/0, 7-21=0/1051, 7-19=0/2483, 8-19=-2305/0, 9-16=-345/0, 10-16=0/371, 10-15=-631/0, 11-15=0/455, 11-13=-1693/0

- NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard

1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-28=-7, 1-12=-67
Concentrated Loads (lb)
Vert: 8=-1120 11=-1040
2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-28=-7, 1-12=-67
Concentrated Loads (lb)
Vert: 8=-1120 11=-1040
3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-28=-7, 1-7=-67, 7-12=-13



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08C	Floor	5	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:00 2024 Page 2  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-gYzAAN2p1J2CFuNcF?xFhYp6UvzivzEQCwkDkMwy9ND5

**LOAD CASE(S)** Standard

- Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-28=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-28=-7, 1-7=-67, 7-12=-13  
Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-28=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040




12/12/2024


**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08D	Floor	2	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:01 2024 Page 1  
 ID:5fxLxLn?C6dWjia?SHK4thzkcYI-8IXYOj3SocA3t1yoojSUD9MJJE?5KikXM9OzHuMy9ND4



Scale = 1:38.0

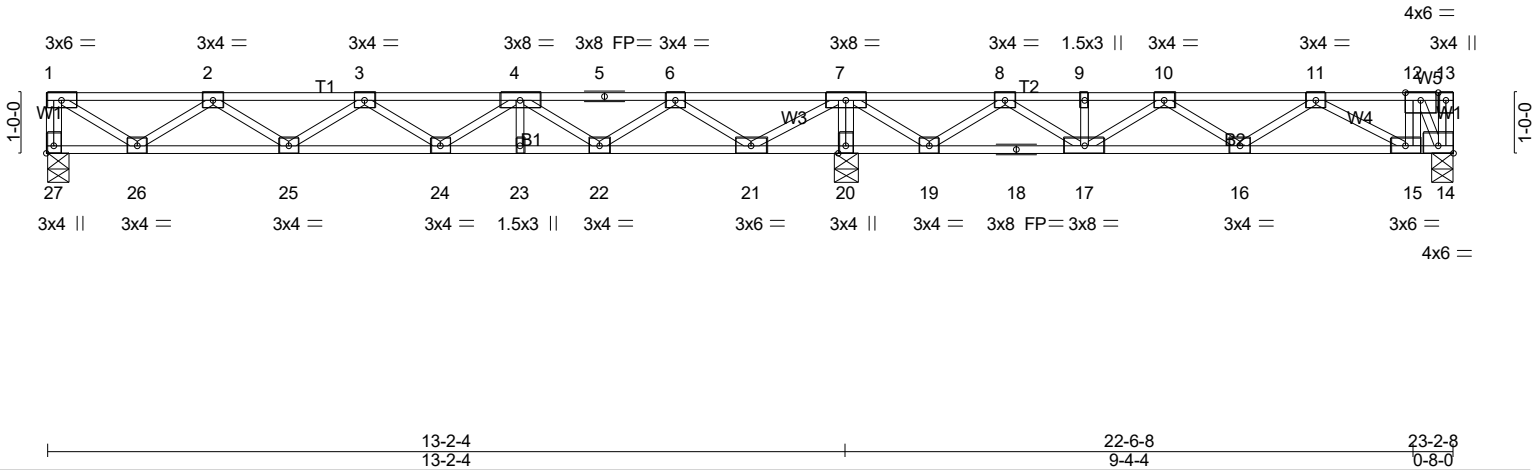

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP			
TCLL	40.0	Plate Grip DOL	1.00	TC	0.33	Vert(LL)	-0.06	in (loc)	24	l/defl	>999	L/d	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.25	Vert(CT)	-0.07		24		>999		360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.45	Horz(CT)	0.01		14		n/a		n/a		
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH											
Weight: 119 lb FT = 20%F, 11%E															

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 27=378/0-4-8 (min. 0-1-8), 20=1134/0-4-8 (min. 0-1-8), 14=1212/0-4-8 (min. 0-1-8)  
 Max Grav 27=398(LC 3), 20=1134(LC 1), 14=1274(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-27=-394/0, 1-2=-507/0, 2-3=-1116/0, 3-4=-1169/0, 4-5=-684/141, 5-6=-684/141, 6-7=0/600, 7-8=0/805, 8-9=-748/193, 9-10=-748/193, 10-11=-1042/0, 11-12=-770/0  
 BOT CHORD 25-26=0/949, 24-25=0/1258, 23-24=0/1054, 22-23=0/1054, 21-22=-305/306, 20-21=-1429/0, 19-20=-1437/0, 18-19=-499/407, 17-18=-499/407, 16-17=0/1008, 15-16=0/1048, 14-15=0/770  
 WEBS 7-20=-1105/0, 1-26=0/601, 2-26=-540/0, 4-22=-486/0, 6-22=0/502, 6-21=-806/0, 7-21=0/950, 7-19=0/825, 8-19=-764/0, 8-17=0/535, 10-17=-420/0, 11-15=-317/175, 12-14=-1464/0

- NOTES-** (5)  
 1) Unbalanced floor live loads have been considered for this design.  
 2) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.  
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
 4) CAUTION, Do not erect truss backwards.

- LOAD CASE(S)** Standard  
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 14-27=-7, 1-13=-67  
 Concentrated Loads (lb)  
 Vert: 12=-1040  
 2) Dead: Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 14-27=-7, 1-13=-67  
 Concentrated Loads (lb)  
 Vert: 12=-1040  
 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (plf)  
 Vert: 14-27=-7, 1-7=-67, 7-13=-13



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08D	Floor	2	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:02 2024 Page 2  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-cx5xb234ZwlwVBW?MQzjmNvU\_PRZRbnVO2irQpy9ND3

**LOAD CASE(S)** Standard

- Concentrated Loads (lb)  
Vert: 12=-1040
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 14-27=-7, 1-7=-13, 7-13=-67  
Concentrated Loads (lb)  
Vert: 12=-1040
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 14-27=-7, 1-7=-67, 7-13=-13  
Concentrated Loads (lb)  
Vert: 12=-1040
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 14-27=-7, 1-7=-13, 7-13=-67  
Concentrated Loads (lb)  
Vert: 12=-1040




12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08E	Floor	2	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:03 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-57fJpO4iKEQn6L5Bw8UylaRdroksAa4fdiSOzFy9ND2

0-3-8  
0-4-0  
Scale = 1:38.0

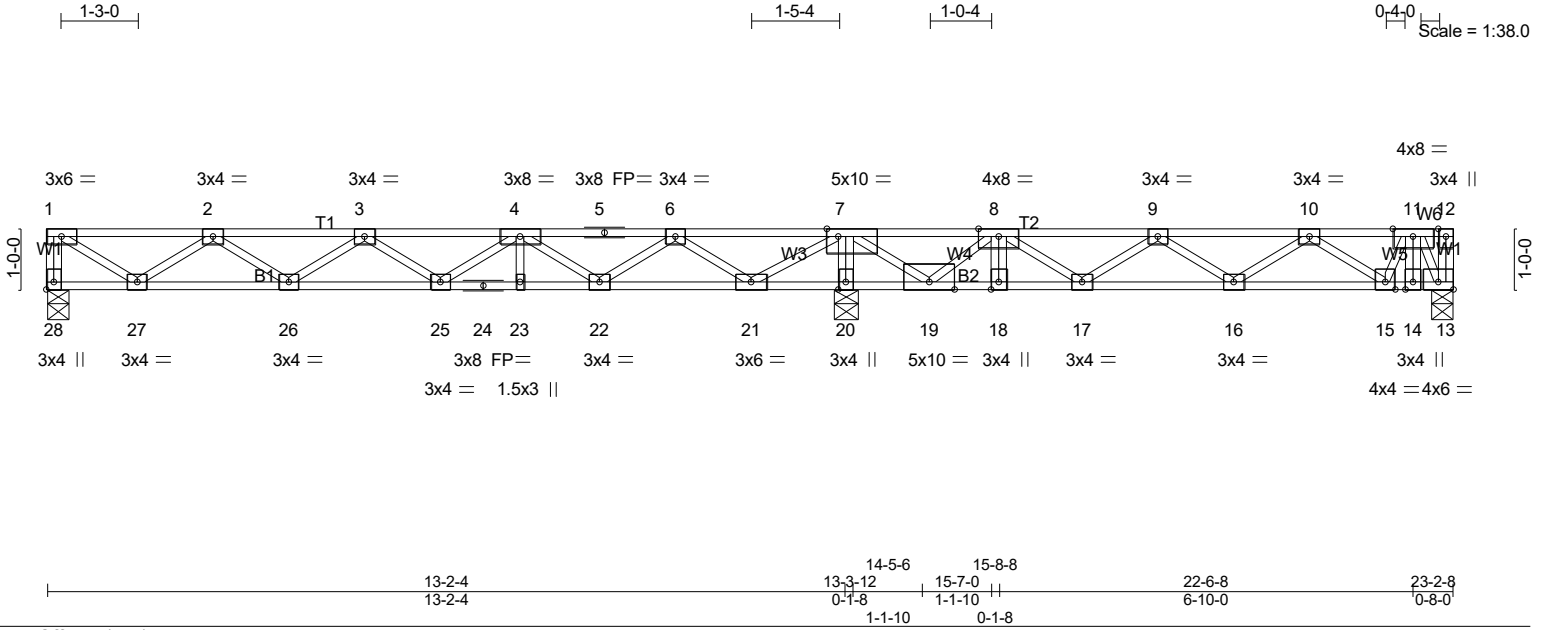

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.45	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.43	Vert(LL) -0.06 25 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.71	Vert(CT) -0.09 16-17 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.01 13 n/a n/a		
	Code IRC2021/TPI2014			Weight: 120 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat) *Except*	
W2: 2x4 SP No.2(flat)	

**REACTIONS.** (lb/size) 28=320/0-4-8 (min. 0-1-8), 20=2101/0-4-8 (min. 0-1-8), 13=1422/0-4-8 (min. 0-1-8)  
Max Grav 28=340(LC 3), 20=2101(LC 1), 13=1485(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-28=-336/0, 1-2=-417/0, 2-3=-861/86, 3-4=-751/326, 4-5=-93/728, 5-6=-93/728, 6-7=0/1355, 7-8=-423/247, 8-9=-2151/0, 9-10=-1878/0, 10-11=-1097/0  
BOT CHORD 26-27=-14/777, 25-26=-184/921, 24-25=-497/549, 23-24=-497/549, 22-23=-497/549, 21-22=-974/0, 20-21=-2270/0, 19-20=-2286/0, 18-19=0/2127, 17-18=0/2127, 16-17=0/2140, 15-16=0/1595, 14-15=0/889, 13-14=0/889  
WEBS 7-20=-2051/0, 1-27=0/494, 2-27=-439/21, 4-25=0/278, 4-22=-588/0, 6-22=0/605, 6-21=-908/0, 7-21=0/1050, 7-19=0/2500, 8-19=-2227/0, 9-16=-320/0, 10-16=0/345, 10-15=-608/0, 11-15=0/449, 11-13=-1688/0

**NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S)
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-28=-7, 1-12=-67
Concentrated Loads (lb)
Vert: 8=-1120 11=-1040
2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-28=-7, 1-12=-67
Concentrated Loads (lb)
Vert: 8=-1120 11=-1040
3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-28=-7, 1-7=-67, 7-12=-13



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-08E	Floor	2	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:03 2024 Page 2  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-57fJpO4iKEQn6L5Bw8UyIaRdroksAa4fdiSOzFy9ND2

**LOAD CASE(S)**

- Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-28=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-28=-7, 1-7=-67, 7-12=-13  
Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 13-28=-7, 1-7=-13, 7-12=-67  
Concentrated Loads (lb)  
Vert: 8=-1120 11=-1040



12/12/2024


**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-09	GABLE	1	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:04 2024 Page 1  
 ID:5fxLxLn?C6dWjia?SHK4thzkcYI-ZKdH0k5K5XYekVgNUR?Bro\_uZCAmVcQorMBxVhy9ND1

0-1-8

Scale = 1:37.5

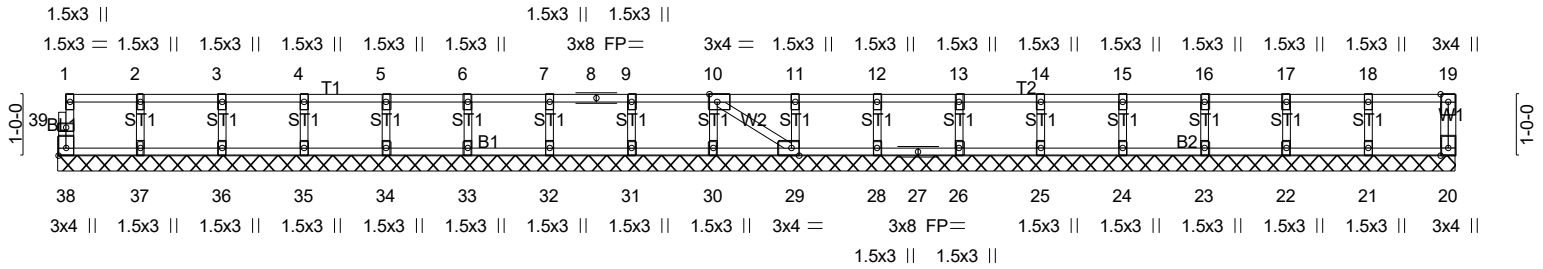

1-4-0	2-8-0	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-4-0	14-8-0	16-0-0	17-4-0	18-8-0	20-0-0	21-4-0	22-9-2
1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-5-2

Plate Offsets (X,Y)-- [10:0-1-8,Edge], [29:0-1-8,Edge], [38:Edge,0-1-8]

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	20	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 92 lb	FT = 20%F, 11%E

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)  
 OTHERS 2x4 SP No.3(flat)


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 22-9-2.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 38, 20, 37, 36, 35, 34, 33, 32, 31, 30, 29, 28, 26, 25, 24, 23, 22, 21

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)  
 1) Gable requires continuous bottom chord bearing.  
 2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
 3) Gable studs spaced at 1-4-0 oc.  
 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
 5) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard

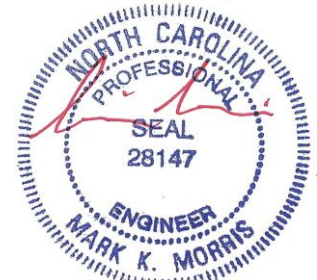

12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-10	Truss Type Floor	Qty 5	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC # 55152
--------------------	----------------	---------------------	----------	----------	---

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:05 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-1Wm3D46ysrgVMfFa1YWQO?X0jcTKeZgx40xV18y9ND0

1-3-0

1-5-4

1-0-0 0-1-8

Scale = 1:26.0

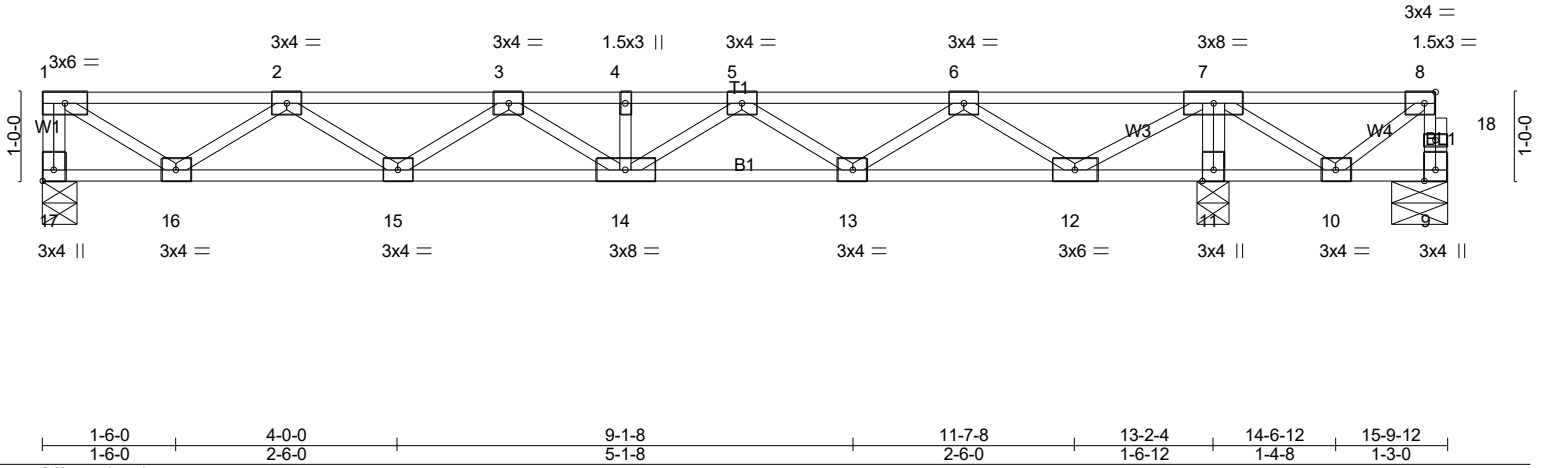


Plate Offsets (X,Y)-- [8:0-1-8,Edge], [17:Edge,0-1-8]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.30	Vert(LL)	-0.05	14	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.24	Vert(CT)	-0.07	14	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.44	Horz(CT)	0.01	11	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 80 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** (lb/size) 17=395/0-4-8 (min. 0-1-8), 9=-353/0-7-8 (min. 0-1-8), 11=1096/0-4-8 (min. 0-1-8)  
Max Uplift 9=-413(LC 3)  
Max Grav 17=395(LC 3), 11=1096(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-17=-391/0, 9-18=0/419, 8-18=0/418, 1-2=-504/0, 2-3=-1098/0, 3-4=-1169/0, 4-5=-1169/0, 5-6=-650/0, 6-7=0/378, 7-8=0/540  
BOT CHORD 15-16=0/943, 14-15=0/1229, 13-14=0/1002, 12-13=0/272, 11-12=-1189/0, 10-11=-1196/0  
WEBS 7-11=-1065/0, 1-16=0/597, 2-16=-536/0, 5-13=-435/0, 6-13=0/468, 6-12=-791/0, 7-12=0/932, 7-10=0/777, 8-10=-661/0

**NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 413 lb uplift at joint 9.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-11	Truss Type Floor	Qty 1	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:06 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkYI-VIKRRQ7ac9pLzpqmbG2fwD3BY0pbN075Jgg2Zay9ND?

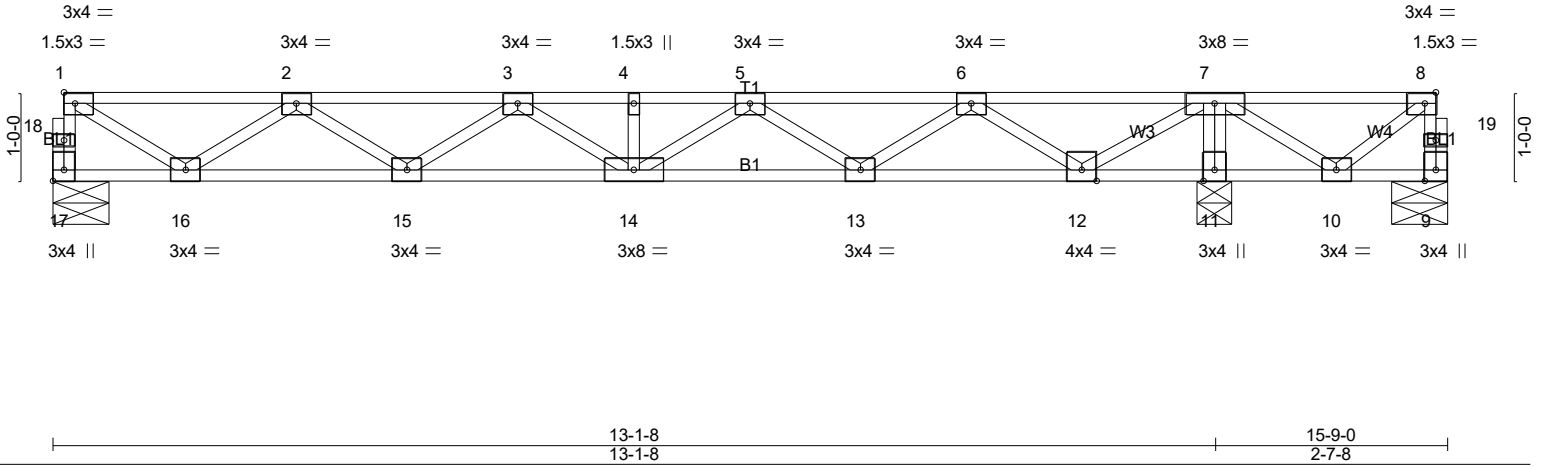


Plate Offsets (X,Y)-- [8:0-1-8,Edge], [17:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.29	Vert(LL)	-0.05	14	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.24	Vert(CT)	-0.07	14	>999	360		
BCLL 0.0	Rep Stress Incr YES	WB 0.43	Horz(CT)	0.01	11	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH							
								Weight: 80 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 17=389/0-7-8 (min. 0-1-8), 9=-348/0-7-8 (min. 0-1-8), 11=1088/0-4-8 (min. 0-1-8)  
Max Uplift9=-409(LC 3)  
Max Grav 17=389(LC 3), 11=1088(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 17-18=-386/0, 1-18=-385/0, 9-19=0/414, 8-19=0/414, 1-2=-503/0, 2-3=-1090/0, 3-4=-1155/0, 4-5=-1155/0, 5-6=-632/0, 6-7=0/399, 7-8=0/535  
BOT CHORD 15-16=0/936, 14-15=0/1219, 13-14=0/986, 11-12=-1178/0, 10-11=-1183/0  
WEBS 7-11=-1057/0, 1-16=0/571, 2-16=-529/0, 5-13=-439/0, 6-13=0/472, 6-12=-791/0, 7-12=0/904, 7-10=0/768, 8-10=-654/0

**NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 409 lb uplift at joint 9.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard




12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-12	Truss Type Floor	Qty 1	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:07 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcY1-zvuqem7CNSxSxByPy9zZuTQcJkQ8v6SiEXKQc60y9ND

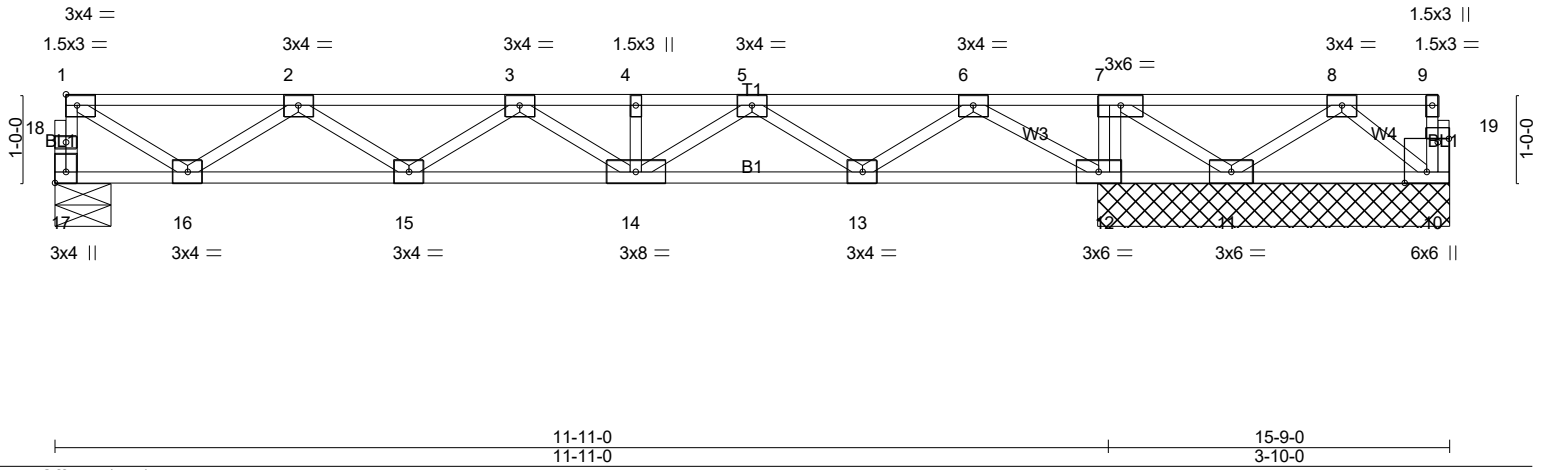

LOADING (psf)		SPACING-		CSI.		DEFL.			PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.45	Vert(LL)	-0.05	14-15	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.30	Vert(CT)	-0.08	14-15	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.01	12	n/a	n/a		
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH							Weight: 80 lb	FT = 20%F, 11%E

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

**REACTIONS.** (lb/size) 17=529/0-7-8 (min. 0-1-8), 10=-90/3-11-8 (min. 0-1-8), 12=1447/3-11-8 (min. 0-1-8), 11=-193/3-11-8 (min. 0-1-8)  
Max Uplift 10=-90(LC 1), 11=-193(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 17-18=-524/0, 1-18=-523/0, 1-2=-669/0, 2-3=-1393/0, 3-4=-1331/0, 4-5=-1331/0, 5-6=-373/0, 6-7=0/1442, 7-8=0/605  
BOT CHORD 15-16=0/1241, 14-15=0/1510, 13-14=0/1009, 12-13=-293/0, 11-12=-1442/0  
WEBS 7-12=-758/0, 1-16=0/759, 2-16=-699/0, 5-14=0/388, 5-13=-776/0, 6-13=0/813, 6-12=-1321/0, 7-11=0/991, 8-11=-577/0

- NOTES-** (4)
- 1) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 90 lb uplift at joint 10 and 193 lb uplift at joint 11.
  - 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 3) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-13	Truss Type Floor	Qty 5	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:08 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-R5SCs68r8m33D6\_9jh47?e9X7pRrurvOm\_99dSy9NCz

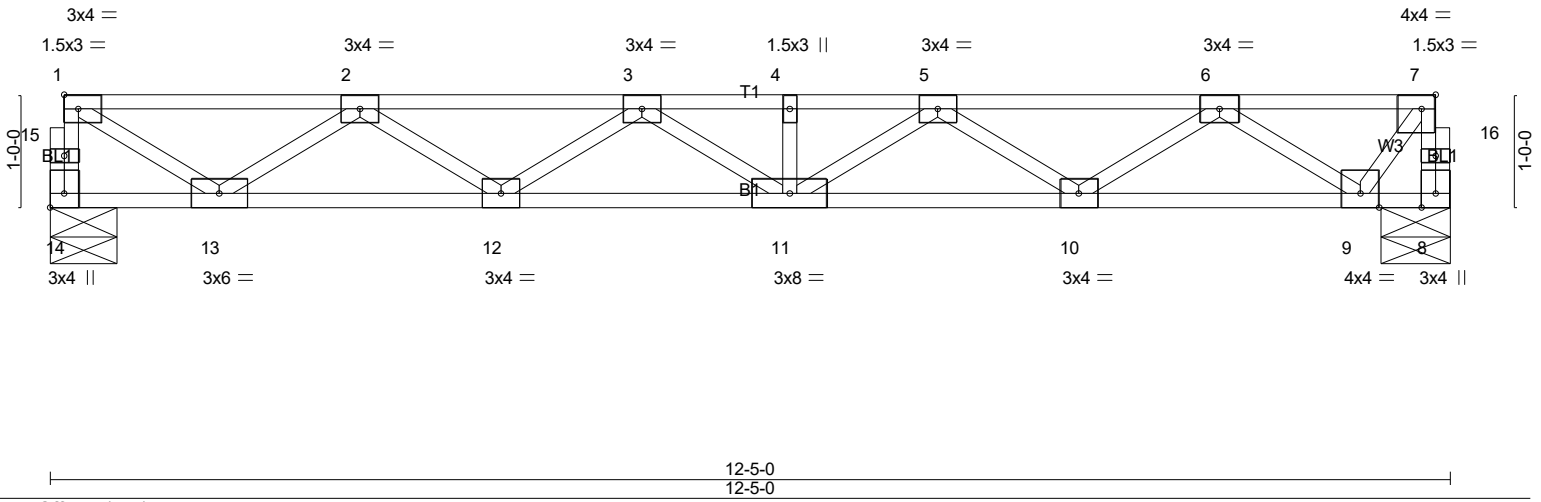




Plate Offsets (X,Y)-- [7:0-1-8,Edge], [14:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.29	Vert(LL)	-0.10	11	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.45	Vert(CT)	-0.13	11	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.48	Horz(CT)	0.03	8	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH							
	Code IRC2021/TPI2014							Weight: 63 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 14=663/0-7-4 (min. 0-1-8), 8=663/0-7-4 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 14-15=-658/0, 1-15=-656/0, 8-16=-665/0, 7-16=-664/0, 1-2=-877/0, 2-3=-1982/0, 3-4=-2309/0, 4-5=-2309/0, 5-6=-1747/0, 6-7=-459/0  
BOT CHORD 12-13=0/1639, 11-12=0/2288, 10-11=0/2179, 9-10=0/1280  
WEBS 1-13=0/998, 2-13=-930/0, 2-12=0/418, 3-12=-374/0, 5-10=-527/0, 6-10=0/570, 6-9=-1003/0, 7-9=0/724

**NOTES-** (2)  
1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.




Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-14	GABLE	1	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:08 2024 Page 1  
 ID:5fxLxLn?C6dWjia?SHK4thzkcYl-R5SCs68r8m33D6\_9jh47?e9bepXdr?pOm\_99dSy9NCz

0<sub>1</sub>8

0<sub>1</sub>8

Scale = 1:20.4

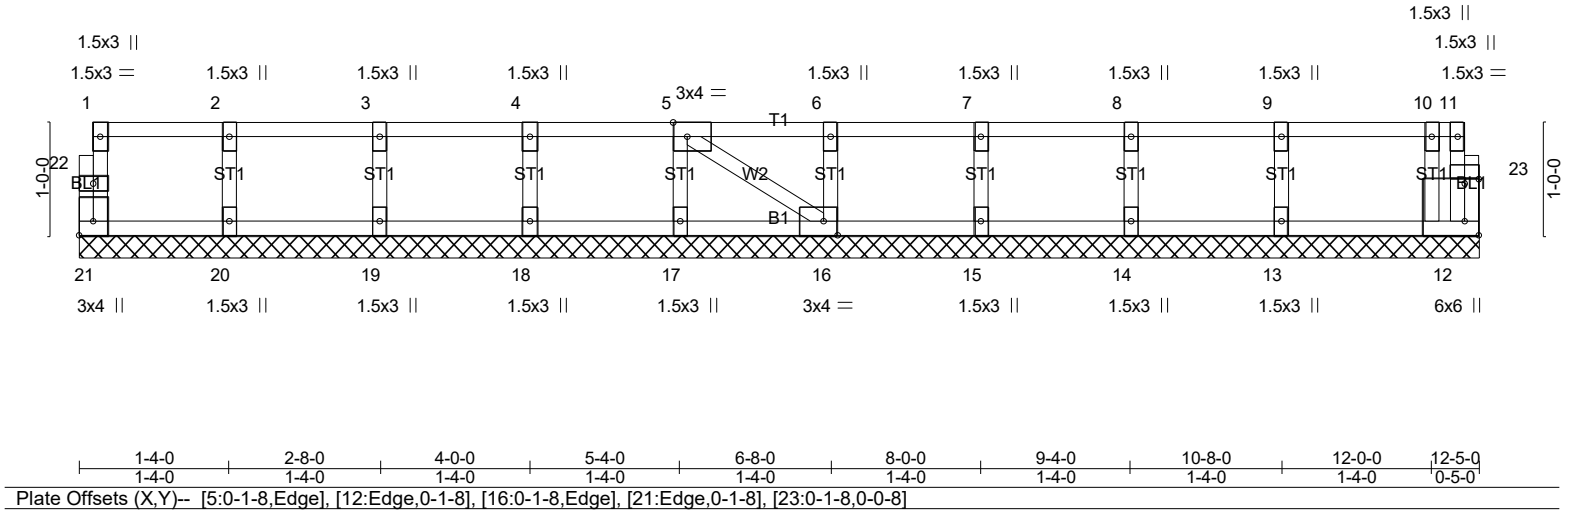

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	12	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 53 lb	FT = 20%F, 11%E

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)  
 OTHERS 2x4 SP No.3(flat)

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 12-5-0.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 21, 12, 20, 19, 18, 17, 16, 15, 14, 13

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (5)
- Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-15	GABLE	1	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:09 2024 Page 1  
 ID:5fxLxLn?C6dWjia?SHK4thzkcY1-vH0a3S9Tv4BwqGZLGObMyrhmQDtyaS5X?evi9vy9NCy

0-1-8

Scale = 1:22.9

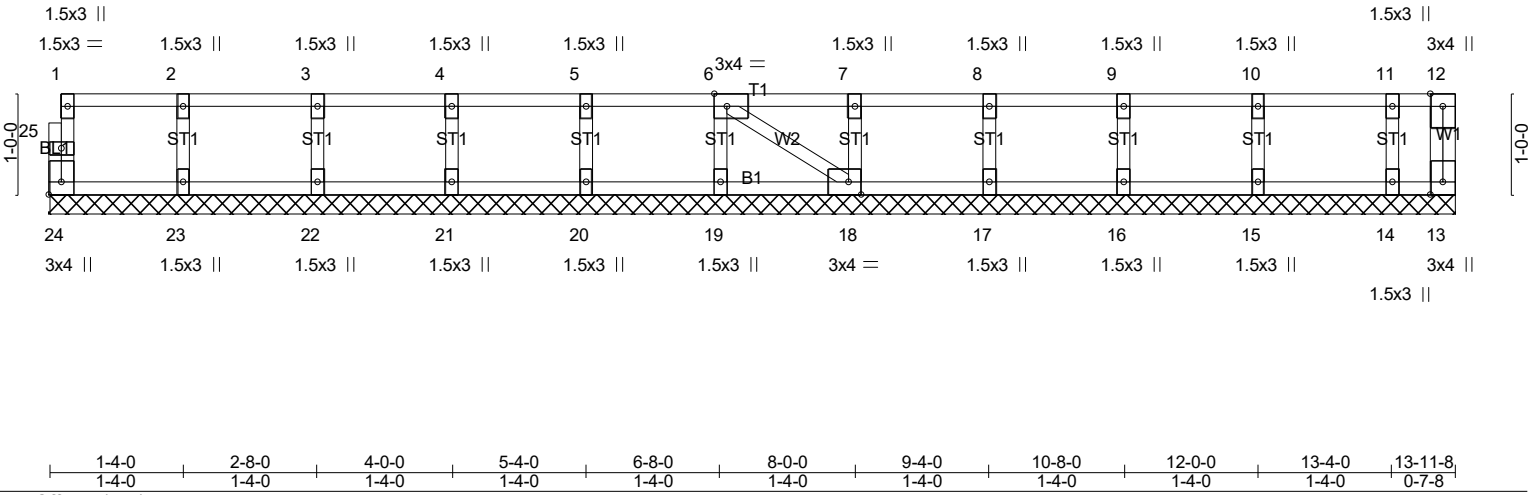


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [18:0-1-8,Edge], [24:Edge,0-1-8]								
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	13	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH					Weight: 59 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS.** All bearings 13-11-8.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 24, 13, 23, 22, 21, 20, 19, 18, 17, 16, 15, 14

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION. Do not erect truss backwards.

**LOAD CASE(S)** Standard






12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-16	Truss Type Floor	Qty 4	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:10 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-NUayHnA5gNjnsQ8Xq66b53EsTd4?Jn2hEleGhLy9NCx

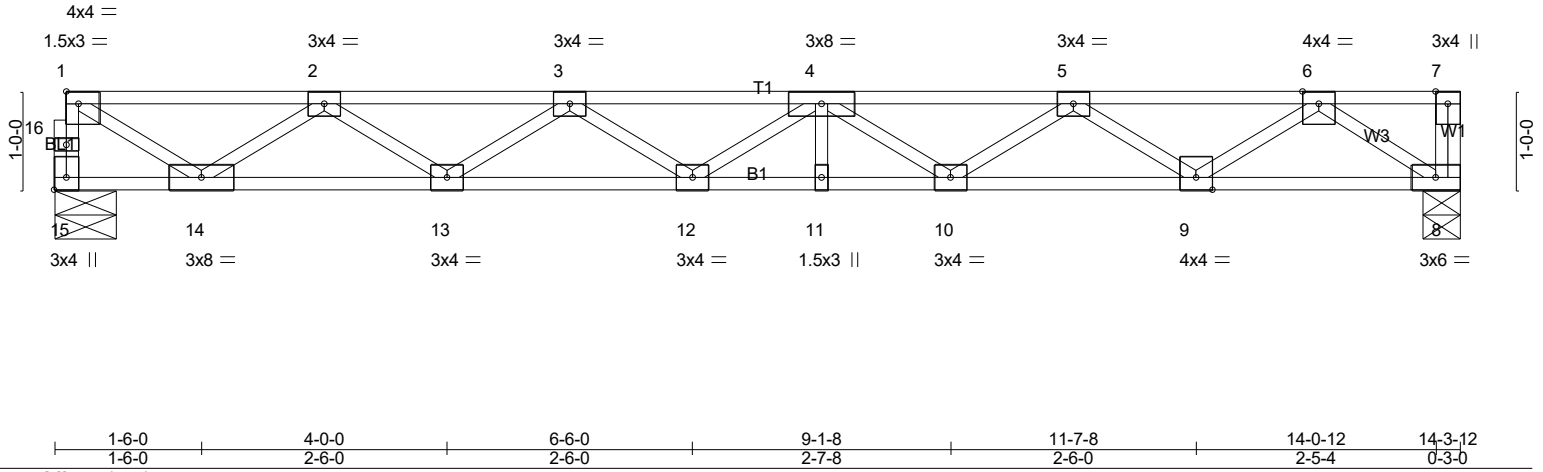

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.36	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.59	Vert(LL) -0.17 11-12 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.56	Vert(CT) -0.23 11-12 >739 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.04 8 n/a n/a		
	Code IRC2021/TPI2014			Weight: 71 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 15=767/0-7-8 (min. 0-1-8), 8=773/0-4-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 15-16=-762/0, 1-16=-760/0, 1-2=-1038/0, 2-3=-2447/0, 3-4=-3029/0, 4-5=-2818/0, 5-6=-1811/0  
BOT CHORD 13-14=0/1946, 12-13=0/2911, 11-12=0/3120, 10-11=0/3120, 9-10=0/2499, 8-9=0/1084  
WEBS 1-14=0/1182, 2-14=-1108/0, 2-13=0/611, 3-13=-567/0, 4-10=-363/0, 5-10=0/389, 5-9=-840/0, 6-9=0/888, 6-8=-1302/0

**NOTES-** (3)  
1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
2) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard




12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-17	Floor Girder	1	1	# 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:11 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-sg8KU7AjRhRe4ajOpdqGnyC1Lu28GqSyOpEny9NCv

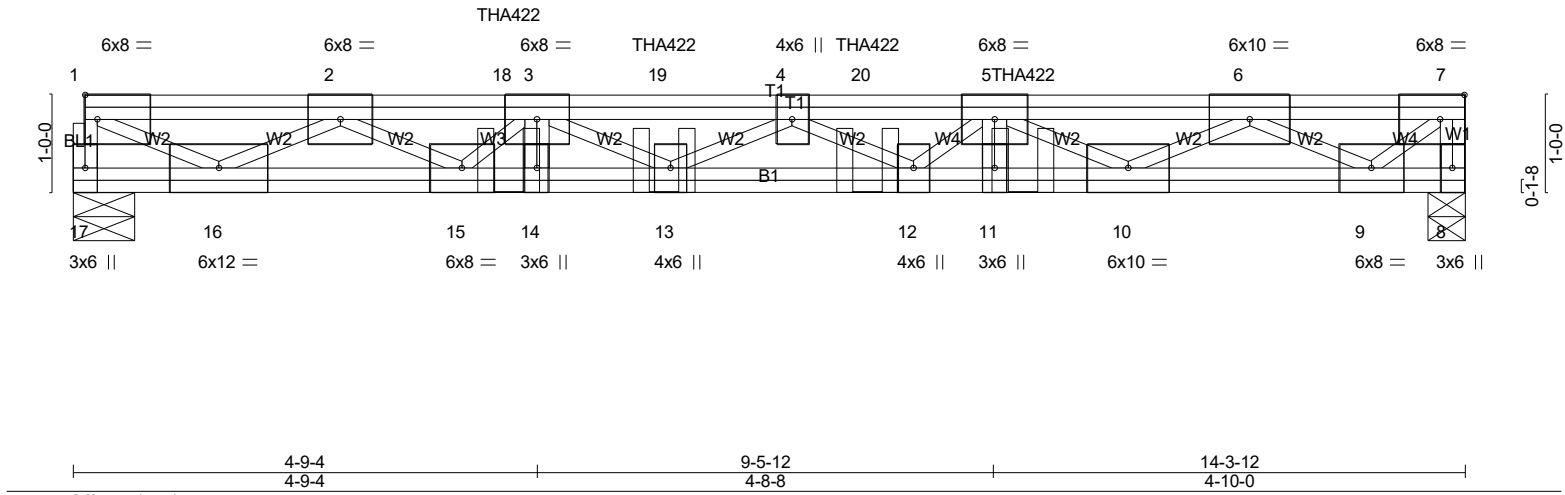

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.62	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.94	Vert(LL) -0.27 12-13 >620 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.95	Vert(CT) -0.36 12-13 >472 360		
BCDL 5.0	Rep Stress Incr NO	Matrix-SH	Horz(CT) 0.05 8 n/a n/a		
	Code IRC2021/TPI2014			Weight: 112 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat) \*Except\*  
W2: 2x4 SP No.2(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-11-1 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 17=1450/0-7-8 (min. 0-1-8), 8=1438/0-4-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-17=-1425/0, 7-8=-1426/0, 1-2=-2417/0, 2-18=-6217/0, 3-18=-6217/0, 3-19=-7812/0, 4-19=-7812/0, 4-20=-7695/0, 5-20=-7695/0, 5-6=-5425/0, 6-7=-1481/0  
BOT CHORD 15-16=0/4529, 14-15=0/7273, 13-14=0/7274, 12-13=0/8277, 11-12=0/7225, 10-11=0/7228, 9-10=0/3667  
WEBS 3-13=0/617, 4-13=-542/0, 4-12=-679/0, 5-12=0/622, 5-10=-2065/0, 6-10=0/2050, 6-9=-2550/0, 7-9=0/1992, 1-16=0/2735, 2-16=-2464/0, 2-15=0/1968, 3-15=-1444/0

**NOTES-** (6)  
1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
2) CAUTION. Do not erect truss backwards.  
3) Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 2-1-2 oc max. starting at 4-5-12 from the left end to 9-9-4 to connect truss(es) F1-20 (1 ply 2x4 SP), F1-19 (1 ply 2x4 SP), F1-18 (1 ply 2x4 SP) to back face of top chord.  
4) Fill all nail holes where hanger is in contact with lumber.  
5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 8-17=-10, 1-7=-100  
Concentrated Loads (lb)  
Vert: 5=-373(B) 18=-351(B) 19=-308(B) 20=-308(B)




12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-18	Truss Type Floor Girder	Qty 1	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	----------------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:12 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-KsijhTBLC?ZVikHwyX83AUJ99RrBnjIzhc7NmEy9NCv

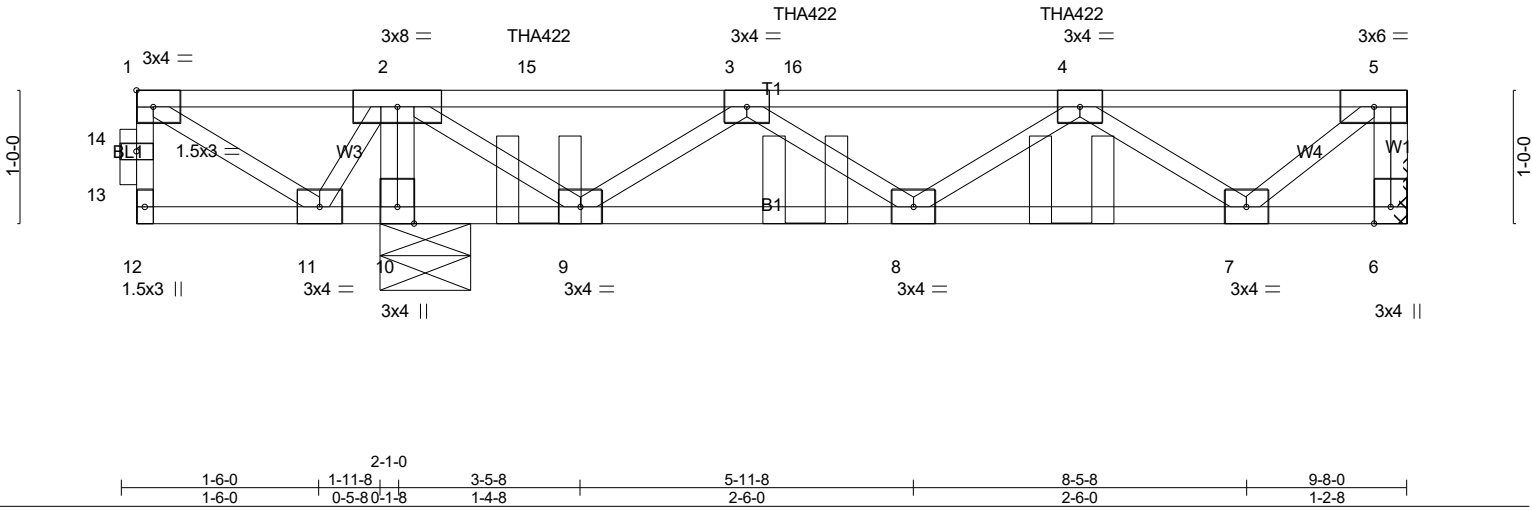

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.48	Vert(LL)	-0.02	8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.29	Vert(CT)	-0.03	8	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.39	Horz(CT)	0.01	6	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 51 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 6=542/Mechanical, 10=871/0-8-0 (min. 0-1-8)  
Max Grav 6=562(LC 4), 10=871(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 5-6=-557/0, 2-15=-703/0, 3-15=-703/0, 3-16=-1276/0, 4-16=-1276/0, 4-5=-576/0  
BOT CHORD 8-9=0/1303, 7-8=0/1213  
WEBS 2-10=-835/0, 2-9=0/812, 3-9=-751/0, 4-7=-778/0, 5-7=0/740

- NOTES-** (8)
- Unbalanced floor live loads have been considered for this design.
  - Refer to girder(s) for truss to truss connections.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Use Simpson Strong-Tie THA422 (Single Chord Girder) or equivalent spaced at 2-0-0 oc max. starting at 3-1-12 from the left end to 7-1-12 to connect truss(es) F1-21A (1 ply 2x4 SP) to back face of top chord.
  - Fill all nail holes where hanger is in contact with lumber.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 6-12=-10, 1-5=-100  
Concentrated Loads (lb)  
Vert: 4=-128(B) 15=-128(B) 16=-128(B)





12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-19	Truss Type Floor Special	Qty 2	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	-----------------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:12 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-KsijhTBLc?ZVikHwyX83AUJDDr?nmUzhc7NmEy9NCv

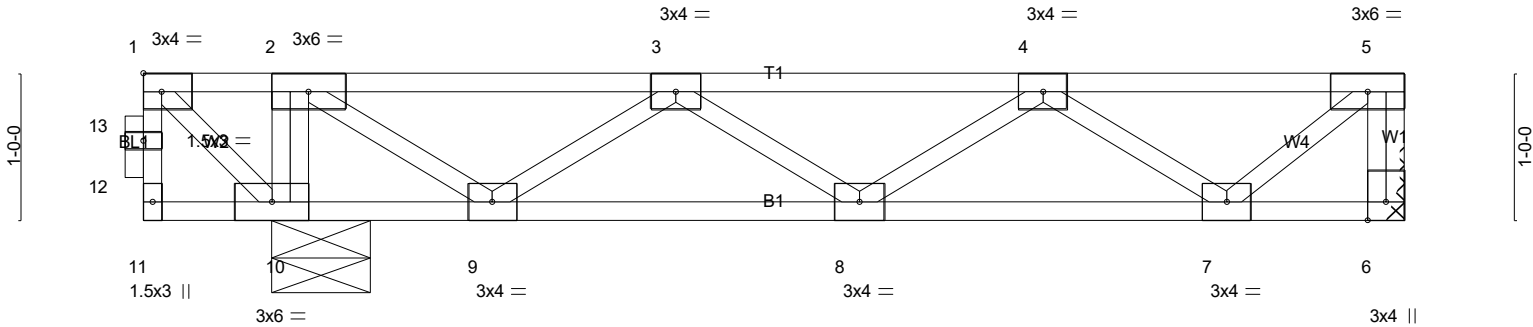

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.22	Vert(LL)	-0.02	8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.18	Vert(CT)	-0.02	8	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.25	Horz(CT)	0.01	6	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						
								Weight: 46 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 9-10.

**REACTIONS.** (lb/size) 6=404/Mechanical, 10=520/0-8-0 (min. 0-1-8)  
Max Grav6=408(LC 4), 10=520(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 5-6=-405/0, 2-3=-472/0, 3-4=-841/0, 4-5=-386/0  
BOT CHORD 8-9=0/841, 7-8=0/804  
WEBS 2-10=-505/0, 2-9=0/518, 3-9=-456/0, 4-7=-510/0, 5-7=0/496

- NOTES-** (5-8)
- Unbalanced floor live loads have been considered for this design.
  - Refer to girder(s) for truss to truss connections.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAINING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard

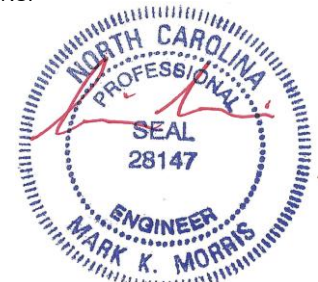


12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-20	Floor Girder	1	1	Job Reference (optional) # 55152

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:13 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYl-o2F5vpCzZlhMjts6VEglihsLAqBUWBf7wGtwlgy9NCu

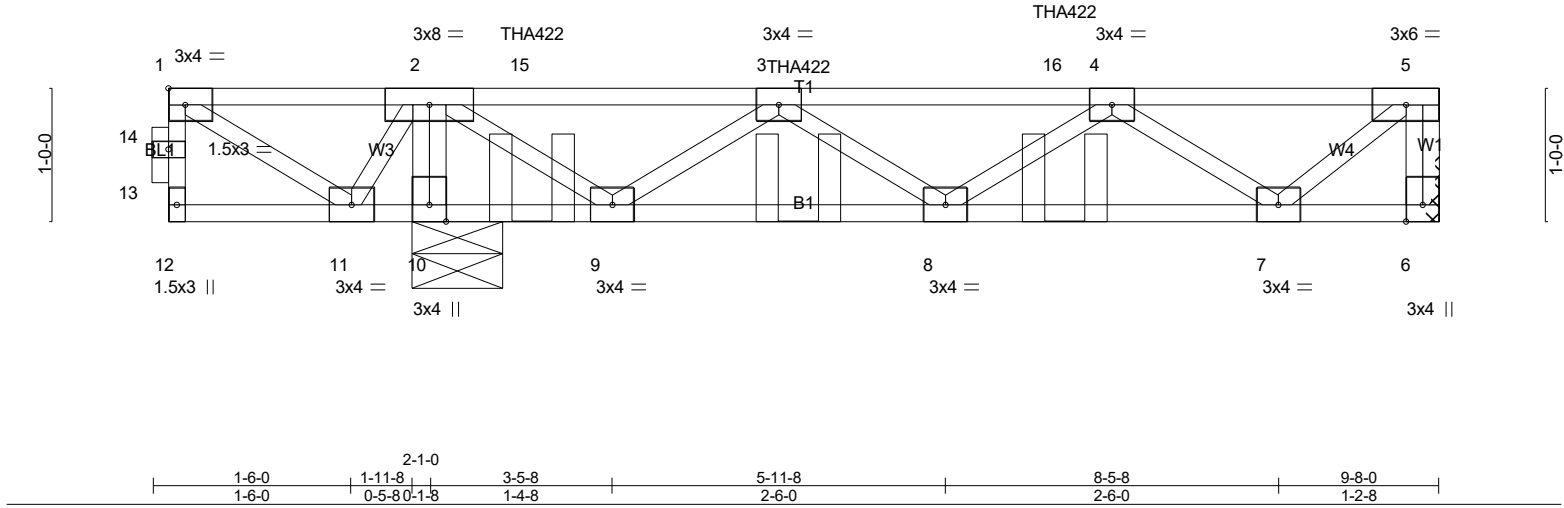

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.39	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.29	Vert(LL) -0.02 8 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.38	Vert(CT) -0.03 8 >999 360		
BCDL 5.0	Rep Stress Incr NO	Matrix-SH	Horz(CT) 0.01 6 n/a n/a		
	Code IRC2021/TPI2014			Weight: 51 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 6=520/Mechanical, 10=883/0-8-0 (min. 0-1-8)  
Max Grav 6=540(LC 4), 10=883(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 5-6=-535/0, 2-15=-695/0, 3-15=-695/0, 3-16=-1243/0, 4-16=-1243/0, 4-5=-553/0  
BOT CHORD 8-9=0/1284, 7-8=0/1165  
WEBS 2-10=-848/0, 2-9=0/797, 3-9=-737/0, 4-7=-746/0, 5-7=0/711

- NOTES-** (8)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) Refer to girder(s) for truss to truss connections.
  - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 4) CAUTION, Do not erect truss backwards.
  - 5) Use Simpson Strong-Tie THA422 (Single Chord Girder) or equivalent spaced at 2-0-0 oc max. starting at 2-10-4 from the left end to 6-10-4 to connect truss(es) F1-21 (1 ply 2x4 SP) to front face of top chord.
  - 6) Fill all nail holes where hanger is in contact with lumber.
  - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 6-12=-100, 1-5=-100  
Concentrated Loads (lb)  
Vert: 3=-125(F) 15=-125(F) 16=-125(F)



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-21	Truss Type Floor	Qty 3	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:13 2024 Page 1  
ID:5fxLxLn?C6dWjja?SHK4thzkcYI-o2F5vpCzzlhMjts6VEglihsNEEqEeWF67wGtwlgy9NCu




Plate Offsets (X,Y)-- [6:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.26	Vert(LL)	-0.00	5	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.09	Vert(CT)	-0.01	4-5	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	4	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 24 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-4-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 6=218/0-7-8 (min. 0-1-8), 4=225/Mechanical

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
BOT CHORD 4-5=0/301  
WEBS 2-4=-351/0

- NOTES-** (4-7)
- 1) Refer to girder(s) for truss to truss connections.
  - 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 3) CAUTION, Do not erect truss backwards.
  - 4) Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - 6) Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - 7) SEE BCSI-B3 SUMMARY SHEET - PERMANENT RESTRAING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard




12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job 24-B429-F01	Truss F1-21A	Truss Type Floor	Qty 3	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	-----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:14 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-GFpT69DckcpDx1R13xBYFvPYmEZpFiBG8wcTq6y9Nct

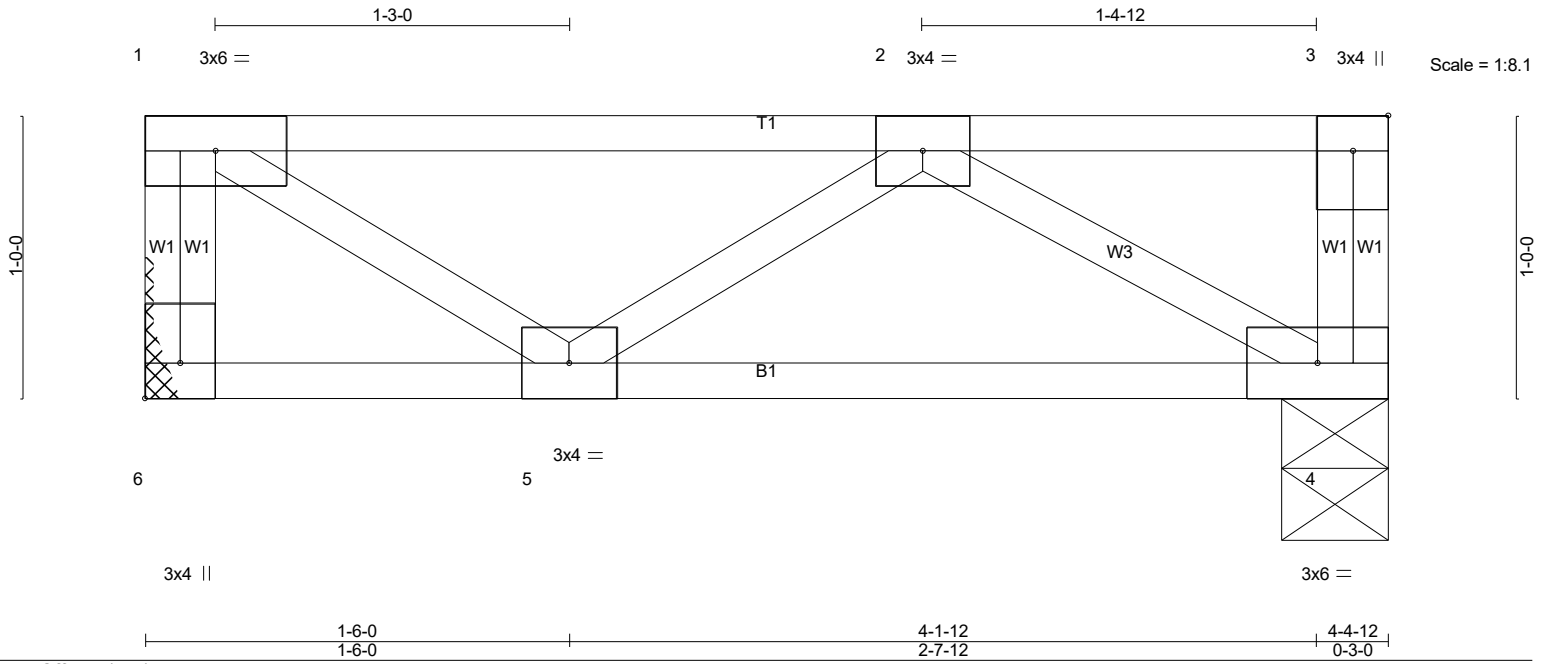

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	40.0	2-0-0	Plate Grip DOL	1.00	TC	0.28	in	(loc)	l/defl	L/d	MT20	244/190	
TCDL	10.0	1.00	Lumber DOL	1.00	BC	0.09	Vert(LL)	-0.00	5	>999	480		
BCLL	0.0	YES	Rep Stress Incr	YES	WB	0.10	Vert(CT)	-0.01	4-5	>999	360		
BCDL	5.0	Code IRC2021/TPI2014	Code IRC2021/TPI2014		Matrix-P		Horz(CT)	0.00	4	n/a	n/a		
											Weight: 24 lb	FT = 20%F, 11%E	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-4-12 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

**REACTIONS.** (lb/size) 6=228/Mechanical, 4=228/0-4-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
BOT CHORD 4-5=0/315  
WEBS 2-4=-363/0

- NOTES-** (3-6)
- 1) Refer to girder(s) for truss to truss connections.
  - 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 3) Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - 4) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - 5) Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - 6) SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAINING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-B429-F01	Truss F1-22	Truss Type GABLE	Qty 1	Ply 1	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC Job Reference (optional) <b># 55152</b>
--------------------	----------------	---------------------	----------	----------	--

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:14 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-GFpT69DckcpDx1R13xBYFvPc8Ea2FjIG8wcTq6y9Nct 1.5x3 ||

0-1-8

1 1.5x3 ||

2 3x4 =

3 1.5x3 ||

4 5 3x4 ||

Scale: 1.5"=1'

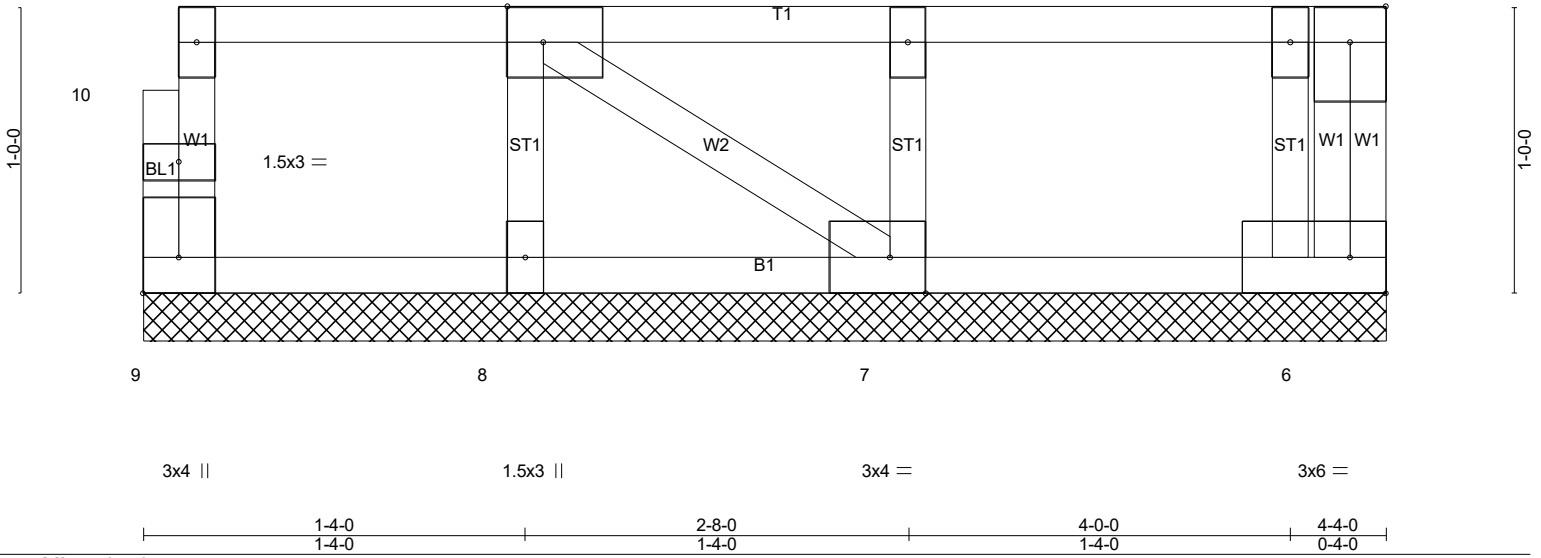


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [7:0-1-8,Edge], [9:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	6	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						
								Weight: 22 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)  
OTHERS 2x4 SP No.3(flat)


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-4-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 4-4-0.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 9, 6, 8, 7

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-9)
- Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAINING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard

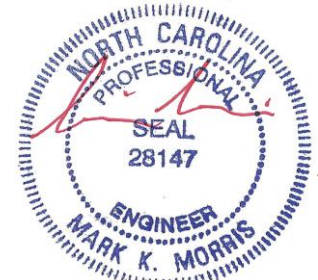


12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0018 CAMPBELL RIDGE   211 ALDEN WAY ANGIER, NC
24-B429-F01	F1-28A	Floor Supported Gable	1	1	Job Reference (optional) <b># 55152</b>

Run: 86.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Fri Dec 13 13:58:15 2024 Page 1  
ID:5fxLxLn?C6dWjia?SHK4thzkcYI-kRNRKVEEVwx4ZB0Vdfino6xnuewH\_AWQNaM1NZy9NCs  
1.5x3 ||

1 3x4 ||                      2 3x4 =                      3 1.5x3 ||                      4 5 3x4 ||                      Scale: 1.5"=1'

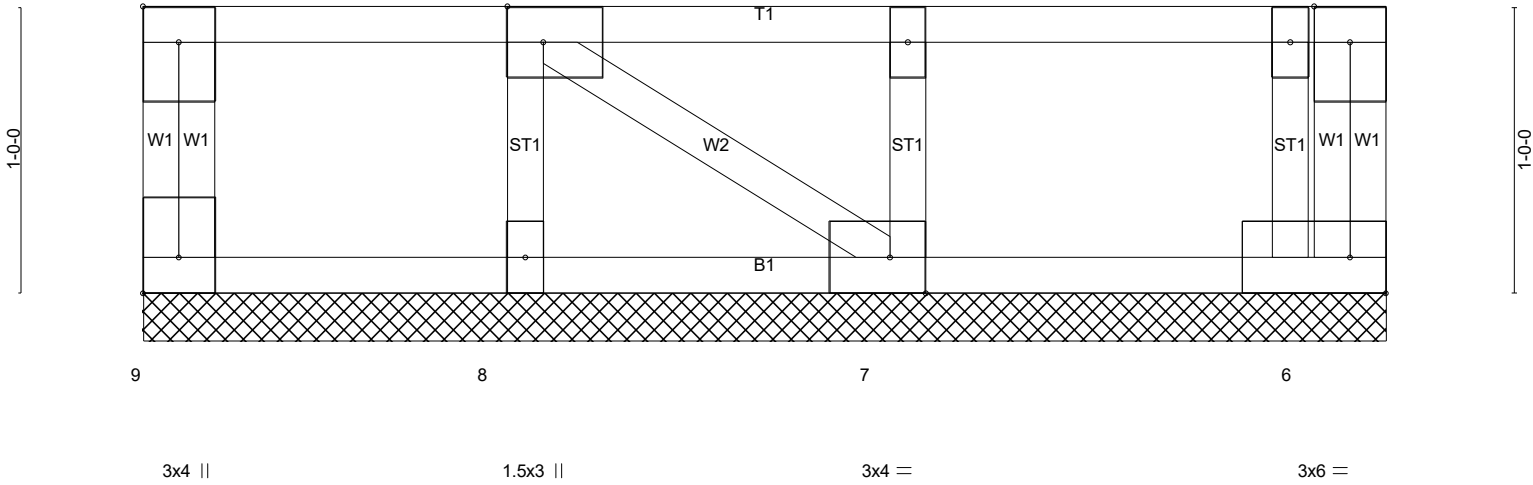

9 8 7 6  
4-4-0  
4-4-0

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-1-8,Edge], [7:0-1-8,Edge], [9:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	6	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 23 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)  
OTHERS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-4-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 4-4-0.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 9, 6, 8, 7

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (5-8)
- 1) Gable requires continuous bottom chord bearing.
  - 2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 3) Gable studs spaced at 1-4-0 oc.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - 7) Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - 8) SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard



12/12/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.