


Job 72435795	Truss F200	Truss Type Truss	Qty 4	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:32

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-jeipkV9qqa6RUNA\_8?aFS07MuErEQKCj4PmQOfyJF2j

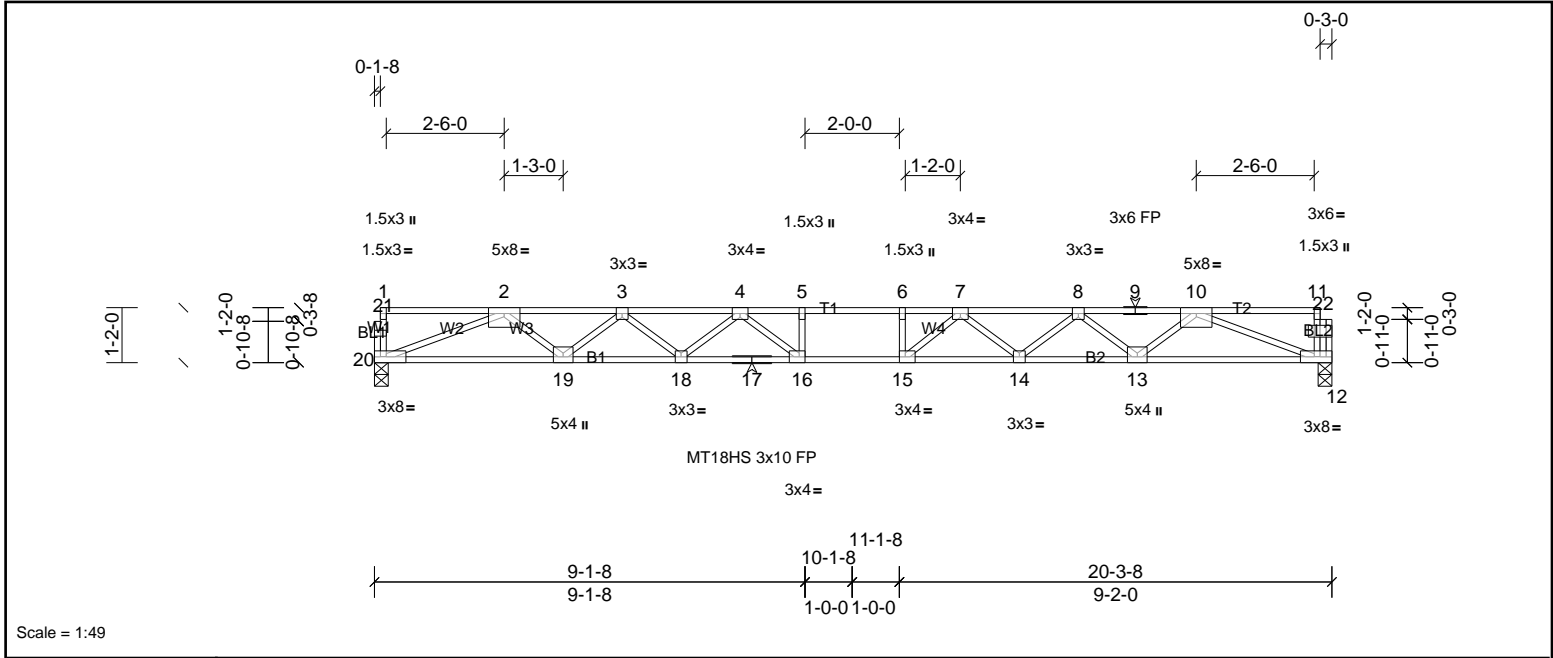

Scale = 1:49

Plate Offsets (X, Y): [12:0-3-8,Edge], [15:0-1-8,Edge], [16:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFLL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.46	15-16	>527	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.63	15-16	>383	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.10	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH								Weight: 100 lb FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS** (lb/size) 12=1086/0-3-8, (min. 0-1-8), 20=1093/0-3-8, (min. 0-1-8)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3267/0, 3-4=-4529/0, 4-5=-5213/0, 5-6=-5213/0, 6-7=-5213/0, 7-8=-4551/0, 8-9=-3307/0, 9-10=-3307/0

BOT CHORD 19-20=0/2442, 18-19=0/4050, 17-18=0/4980, 16-17=0/4980, 15-16=0/5213, 14-15=0/4996, 13-14=0/4081, 12-13=0/2489

WEBS 5-16=-309/11, 6-15=-319/20, 2-20=-2620/0, 2-19=0/1074, 3-19=-1019/0, 3-18=0/624, 4-18=-588/0, 4-16=-151/704, 10-12=-2656/0, 10-13=0/1064, 8-13=-1008/0, 8-14=0/612, 7-14=-579/0, 7-15=-161/695

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72435795	Truss F201	Truss Type Truss	Qty 5	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:33

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-BrGBys9SLPZL?KZLZlmhZLv3YFYl3ddDeQAYBEyJF2i

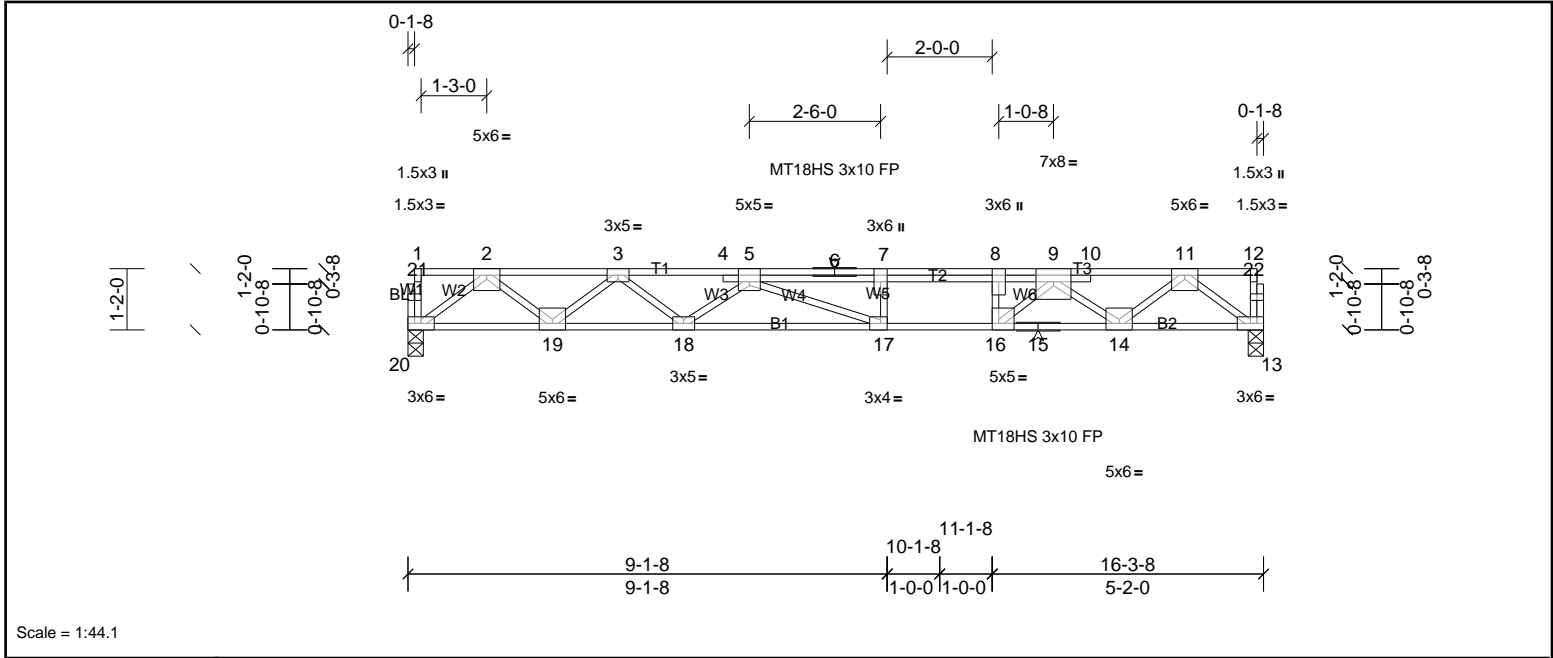


Plate Offsets (X, Y): [5:0-2-8,Edge], [8:0-3-0,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFLL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.72	Vert(LL)	-0.21	17-18	>923	480	MT18HS	244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.81	Vert(CT)	-0.46	17-18	>422	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.88	Horz(CT)	0.07	13	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH								Weight: 90 lb FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP SS(flat)	TOP CHORD Structural wood sheathing directly applied or 5-7-14 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS** (lb/size) 13=1322/0-3-8, (min. 0-1-8), 20=1294/0-3-8, (min. 0-1-8)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2720/0, 3-4=-4533/0, 4-5=-4531/0, 5-6=-5301/0, 6-7=-5301/0, 7-8=-5301/0, 8-9=-5301/0, 9-10=-2814/0, 10-11=-2807/0

BOT CHORD 19-20=0/1631, 18-19=0/3789, 17-18=0/5255, 16-17=0/5301, 15-16=0/4057, 14-15=0/4057, 13-14=0/1644

WEBS 8-16=-1106/0, 2-20=-2042/0, 2-19=0/1418, 3-19=-1392/0, 3-18=0/969, 5-18=-916/0, 5-17=-199/508, 11-13=-2058/0, 11-14=0/1513, 9-14=-1588/0, 9-16=0/1840

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- LOAD CASE(S)** Standard
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 13-20=-10, 1-4=-140, 4-9=-176, 9-12=-140



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72435795	Truss F202	Truss Type Truss	Qty 3	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:33

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-BrGBys9SLPZL?KZLZlmhZLv?cFac3fnDeQAYBEyJF2i

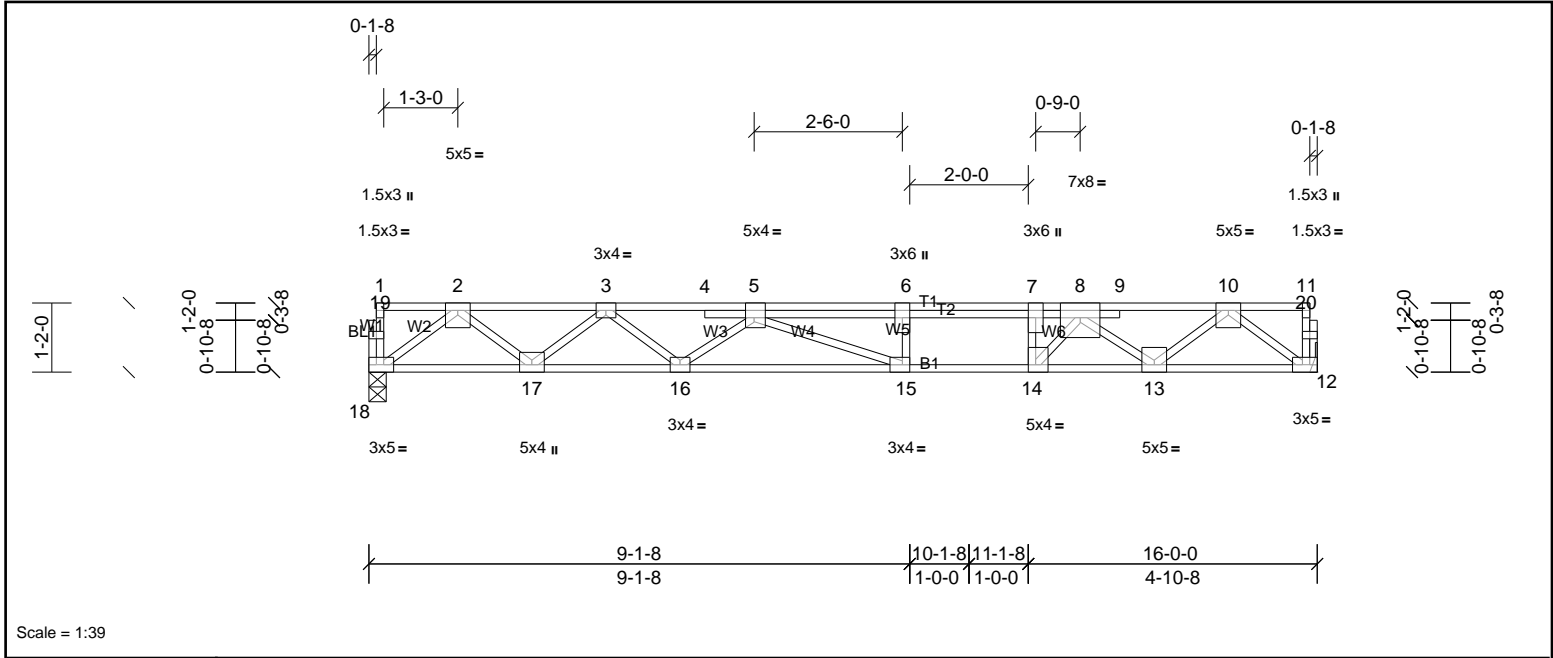


Plate Offsets (X, Y): [5:0-1-12,Edge], [7:0-3-0,Edge], [12:0-2-0,Edge], [14:0-1-8,Edge], [15:0-1-8,Edge], [18:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.97	Vert(LL)	-0.22	15-16	>844	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.66	Vert(CT)	-0.39	15-16	>488	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.74	Horz(CT)	0.06	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 89 lb	FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 4-9-4 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS** (lb/size) 12=1000/ Mechanical, (min. 0-1-8), 18=973/0-3-8, (min. 0-1-8)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2055/0, 3-4=-3470/0, 4-5=-3477/0, 5-6=-3974/0, 6-7=-3974/0, 7-8=-3974/0, 8-9=-2140/0, 9-10=-2136/0  
 BOT CHORD 17-18=0/1227, 16-17=0/2864, 15-16=0/4043, 14-15=0/3974, 13-14=0/3110, 12-13=0/1241  
 WEBS 7-14=-1071/0, 2-18=-1537/0, 2-17=0/1078, 3-17=-1053/0, 3-16=0/789, 5-16=-728/0, 5-15=-296/415, 10-12=-1553/0, 10-13=0/1166, 8-13=-1237/0, 8-14=0/1550

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 3) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard  
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
 Uniform Loads (lb/ft)  
 Vert: 12-18=-10, 1-4=-100, 4-8=-140, 8-11=-100



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss F203	Truss Type Truss	Qty 2	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFPI Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:33

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-BrGBys9SLPZL?KZLZlmhZLv3?Fah3FGDeQaYBEyJF2i

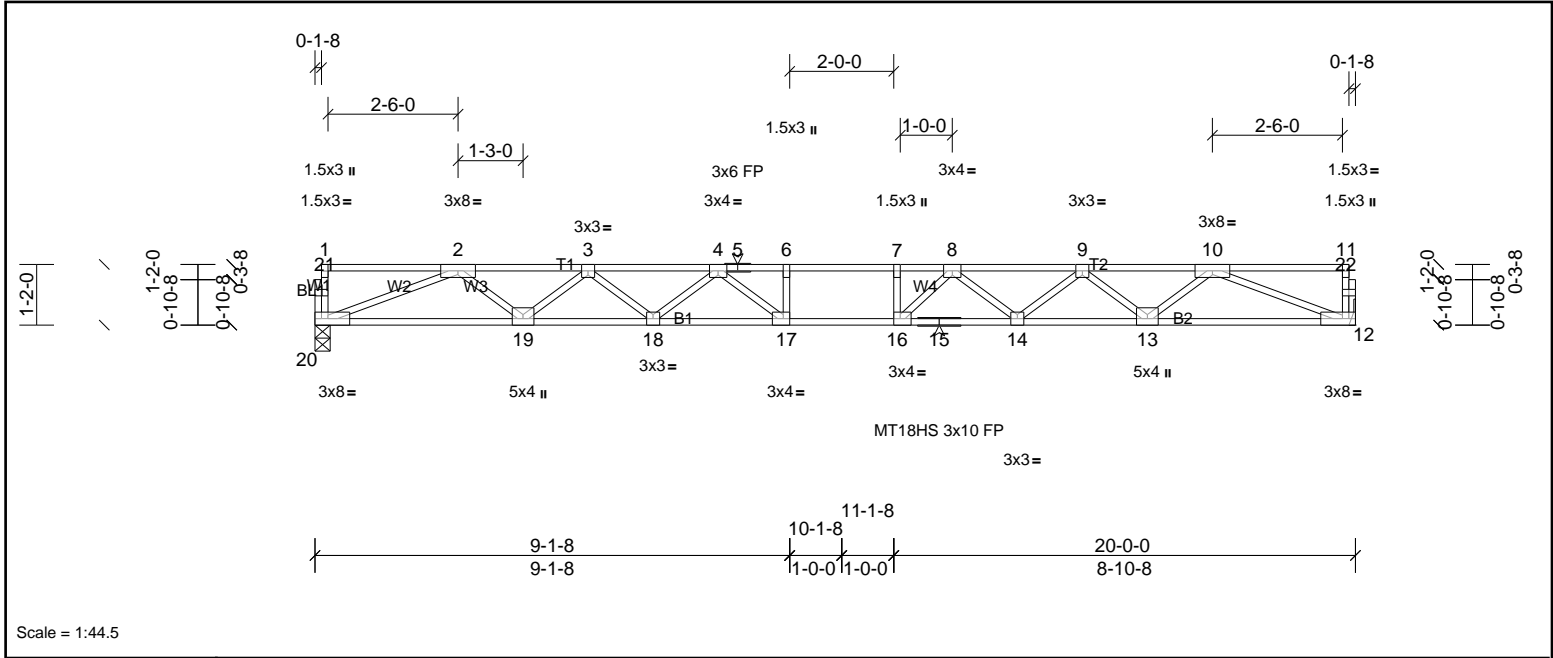

Scale = 1:44.5

Plate Offsets (X, Y):	[16:0-1-8,Edge], [17:0-1-8,Edge]											
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.44	16-17	>543	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.60	16-17	>395	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.71	Horz(CT)	0.09	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 97 lb	FT = 20%F, 12%E

<b>LUMBER</b>		<b>BRACING</b>	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-0-15 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

<b>REACTIONS</b>	(lb/size)	12=1080/ Mechanical, (min. 0-1-8), 20=1080/0-3-8, (min. 0-1-8)
<b>FORCES</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD		2-3=-3220/0, 3-4=-4454/0, 4-5=-5093/0, 5-6=-5093/0, 6-7=-5093/0, 7-8=-5093/0, 8-9=-4449/0, 9-10=-3221/0
BOT CHORD		19-20=0/2411, 18-19=0/3988, 17-18=0/4888, 16-17=0/5093, 15-16=0/4891, 14-15=0/4891, 13-14=0/3987, 12-13=0/2411
WEBS		6-17=-297/18, 7-16=-345/32, 2-20=-2587/0, 2-19=0/1054, 3-19=-1000/0, 3-18=0/606, 4-18=-565/0, 4-17=-166/671, 10-12=-2587/0, 10-13=0/1055, 9-13=-997/0, 9-14=0/601, 8-14=-579/0, 8-16=-159/686

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss F204	Truss Type Truss	Qty 4	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:33

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-BrGBys9SLPZL?KZLZlMhZLv3\_Faf3fzDeQAYBEyJF2i

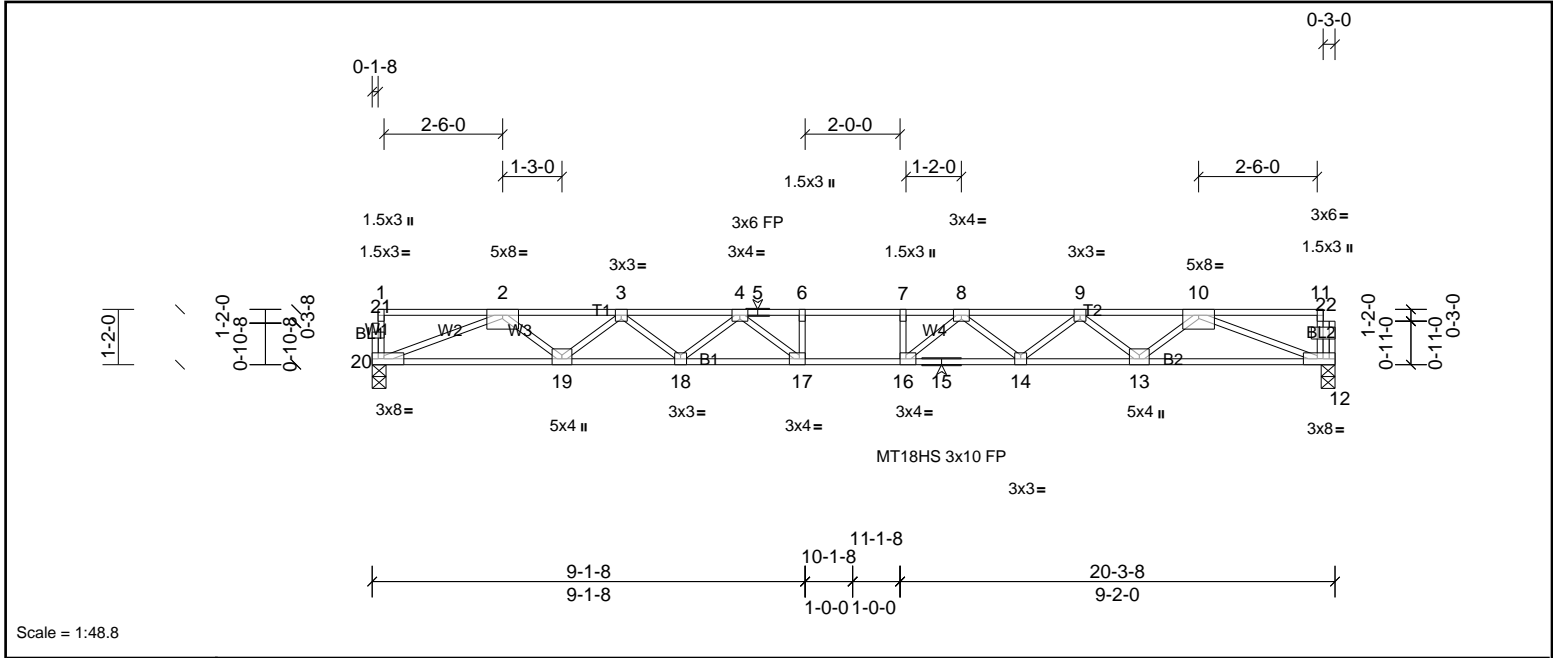

Scale = 1:48.8

Plate Offsets (X, Y):	[12:0-3-8,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]											
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.46	16-17	>527	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.63	16-17	>383	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.10	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 100 lb	FT = 20%F, 12%E

<b>LUMBER</b>		<b>BRACING</b>	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

<b>REACTIONS</b>	(lb/size)	12=1086/0-3-8, (min. 0-1-8), 20=1093/0-3-8, (min. 0-1-8)
<b>FORCES</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD		2-3=-3267/0, 3-4=-4529/0, 4-5=-5213/0, 5-6=-5213/0, 6-7=-5213/0, 7-8=-5213/0, 8-9=-4551/0, 9-10=-3307/0
BOT CHORD		19-20=0/2442, 18-19=0/4050, 17-18=0/4980, 16-17=0/5213, 15-16=0/4996, 14-15=0/4996, 13-14=0/4081, 12-13=0/2489
WEBS		6-17=-309/11, 7-16=-319/20, 2-20=-2620/0, 2-19=0/1074, 3-19=-1019/0, 3-18=0/624, 4-18=-588/0, 4-17=-151/704, 10-12=-2656/0, 10-13=0/1064, 9-13=-1008/0, 9-14=0/612, 8-14=-579/0, 8-16=-161/695

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss F205	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:33

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-BrGBys9SLPZL?KZLZlmhZLvD2Fj3qNDeQAYBEyJF2i

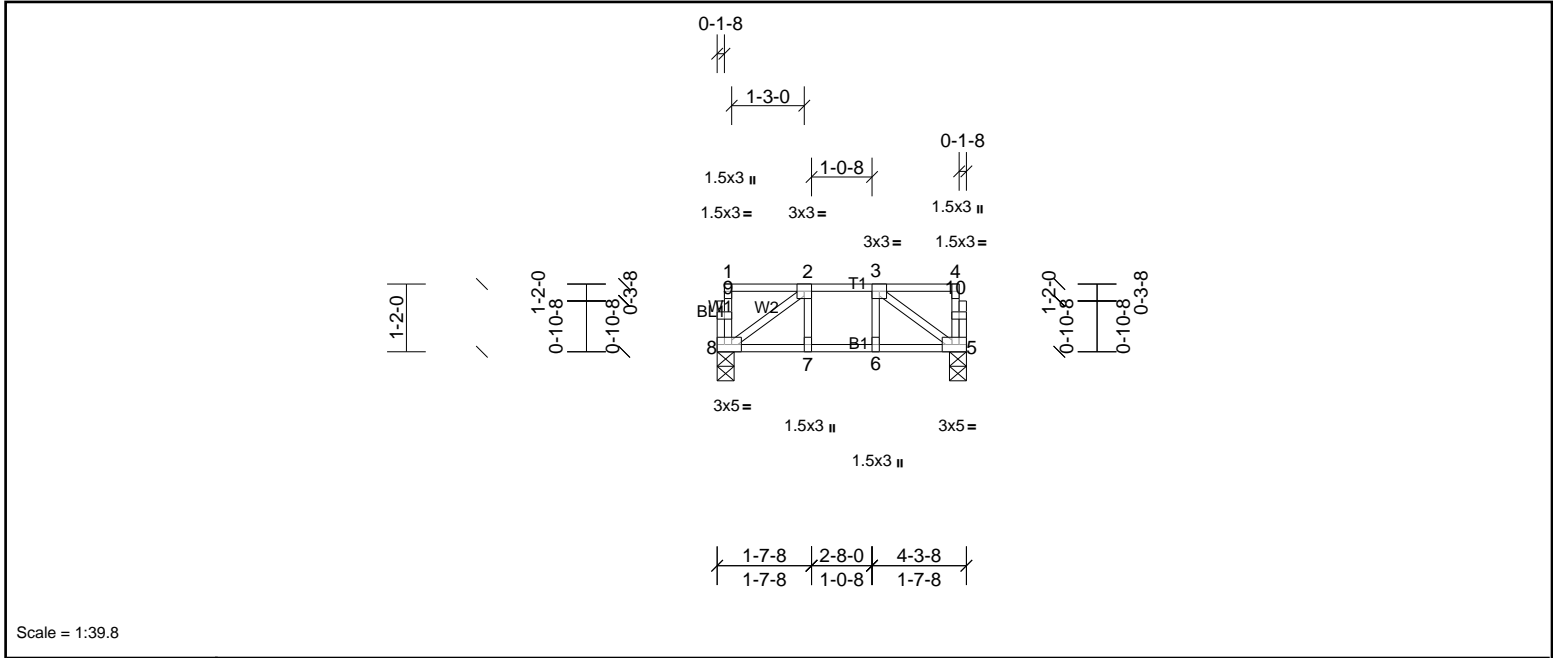

Scale = 1:39.8

Plate Offsets (X, Y): [5:0-2-0,Edge], [8:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.11	Vert(LL)	0.00	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.10	Vert(CT)	-0.01	7-8	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.00	5	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 25 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-3-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

**REACTIONS** (lb/size) 5=216/0-3-8, (min. 0-1-8), 8=216/0-3-8, (min. 0-1-8)  
**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 3-5=-258/0, 2-8=-258/0

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss F206	Truss Type Truss	Qty 16	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	-----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:34

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-BrGBys9SLPZL?KZLZlMhZLv2ZFax3e6DeQAYBEyJF2i

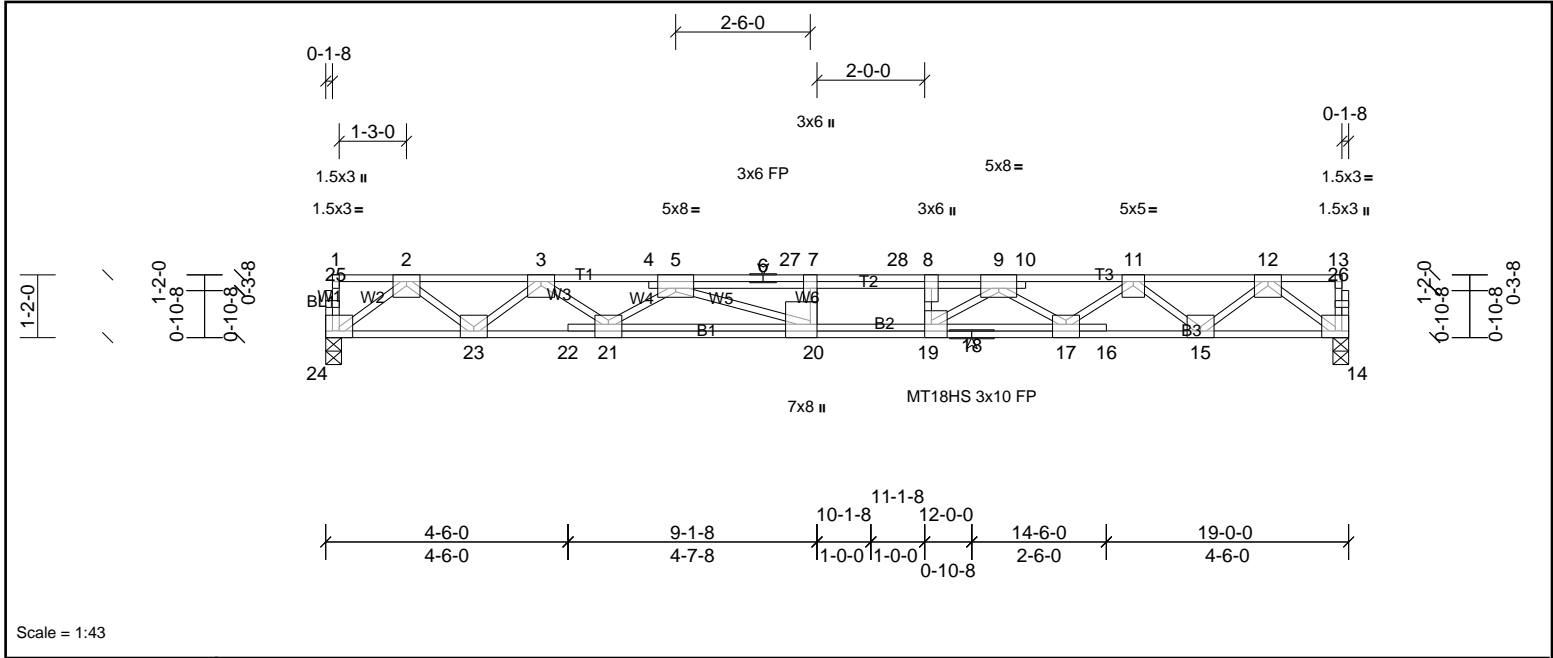

Scale = 1:43

Plate Offsets (X, Y):	[5:0-4-0,Edge], [8:0-3-0,Edge], [9:0-4-0,Edge], [14:Edge,0-1-8], [17:0-3-0,Edge], [19:0-3-0,Edge], [20:0-3-0,Edge], [21:0-3-0,Edge]
-----------------------	---

Loading	(psf)	Spacing	2-0-0	CSI	DEFLL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.79	Vert(LL)	-0.26	20-21	>865	480	MT18HS	244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.70	Vert(CT)	-0.51	20-21	>440	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.78	Horz(CT)	0.08	14	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH								
											Weight: 117 lb	FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP SS(flat)	TOP CHORD Structural wood sheathing directly applied or 5-0-13 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS	(lb/size)	14=1434/0-3-8, (min. 0-1-8), 24=1433/0-3-8, (min. 0-1-8)
<b>FORCES</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3048/0, 3-4=-5393/0, 4-5=-5382/0, 5-6=-7407/0, 6-27=-7407/0, 7-27=-7407/0, 7-28=-7407/0, 8-28=-7407/0, 8-9=-7407/0, 9-10=-5314/0, 10-11=-5329/0, 11-12=-3065/0	
BOT CHORD	23-24=0/1803, 22-23=0/4349, 21-22=0/4340, 20-21=0/6405, 19-20=0/7407, 18-19=0/6408, 17-18=0/6408, 16-17=0/4341, 15-16=0/4351, 14-15=0/1804	
WEBS	7-20=-382/0, 8-19=-606/0, 2-24=-2259/0, 2-23=0/1620, 3-23=-1694/0, 3-21=0/1326, 5-21=-1255/0, 5-20=0/1372, 12-14=-2260/0, 12-15=0/1641, 11-15=-1675/0, 11-17=0/1242, 9-17=-1338/0, 9-19=0/1465	

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 5x6 MT20 unless otherwise indicated.
  - 4) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 5) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S)	Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00	
Uniform Loads (lb/ft)	
Vert: 14-24=-10, 1-27=-140, 27-28=-176, 13-28=-140	



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72435795	Truss F207	Truss Type Truss	Qty 3	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:34

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-f1qa9CA46jhCdT8X6?Hw6YRC0fwao7KNs4vVjgyJF2h

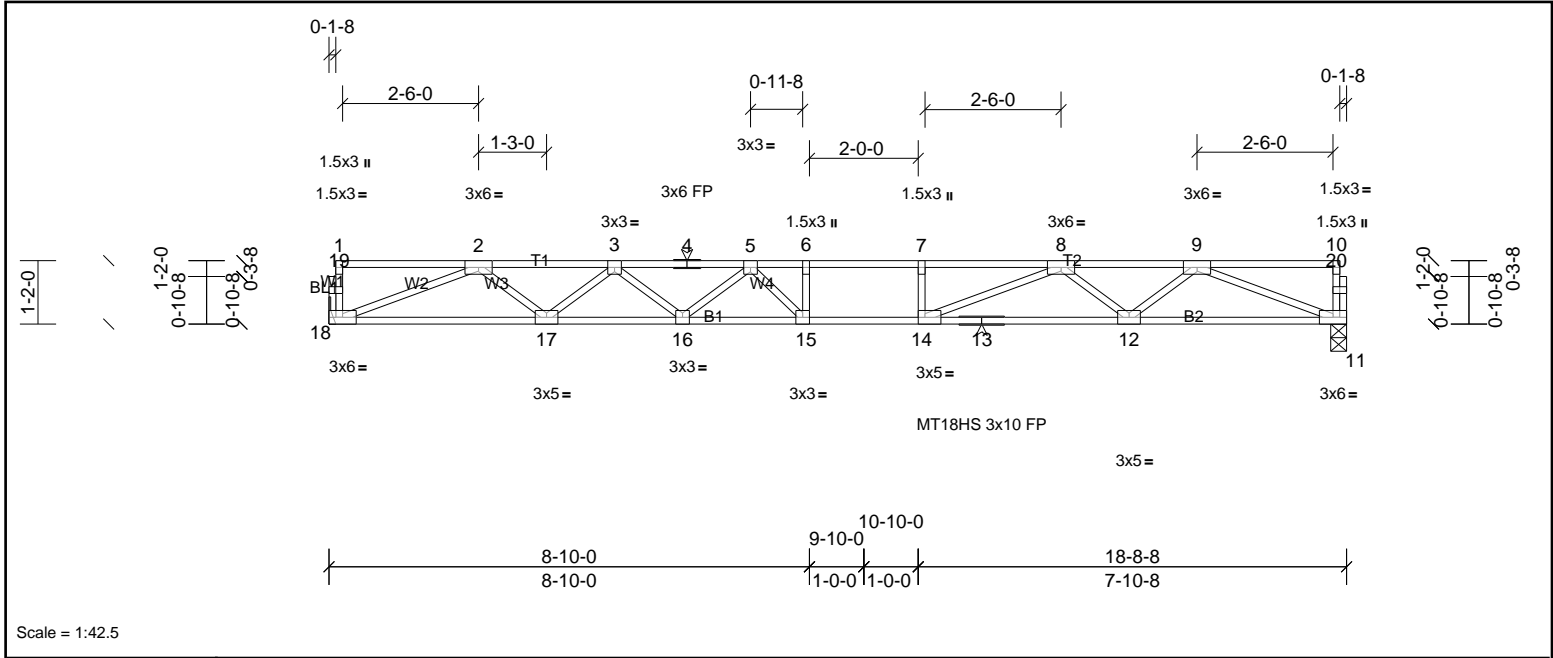


Plate Offsets (X, Y): [14:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFLL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.87	Vert(LL)	-0.35	15	>624	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.67	Vert(CT)	-0.49	15-16	>454	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.66	Horz(CT)	0.08	11	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 91 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	
	11=1009/0-3-8, (min. 0-1-8), 18=1009/ Mechanical, (min. 0-1-8)	
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2957/0, 3-4=-4024/0, 4-5=-4024/0, 5-6=-4436/0, 6-7=-4436/0, 7-8=-4436/0, 8-9=-2958/0	
BOT CHORD	17-18=0/2233, 16-17=0/3640, 15-16=0/4368, 14-15=0/4436, 13-14=0/3636, 12-13=0/3636, 11-12=0/2234	
WEBS	6-15=-281/87, 7-14=-281/0, 2-18=-2395/0, 2-17=0/942, 3-17=-890/0, 3-16=0/500, 5-16=-481/0, 5-15=-278/548, 9-11=-2397/0, 9-12=0/941, 8-12=-883/0, 8-14=0/1097	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.





Job 72435795	Truss FG1	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:34

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-f1qa9CA46jhCdT8X6?Hw6YRDQfuco82Ns4vVjgyJF2h

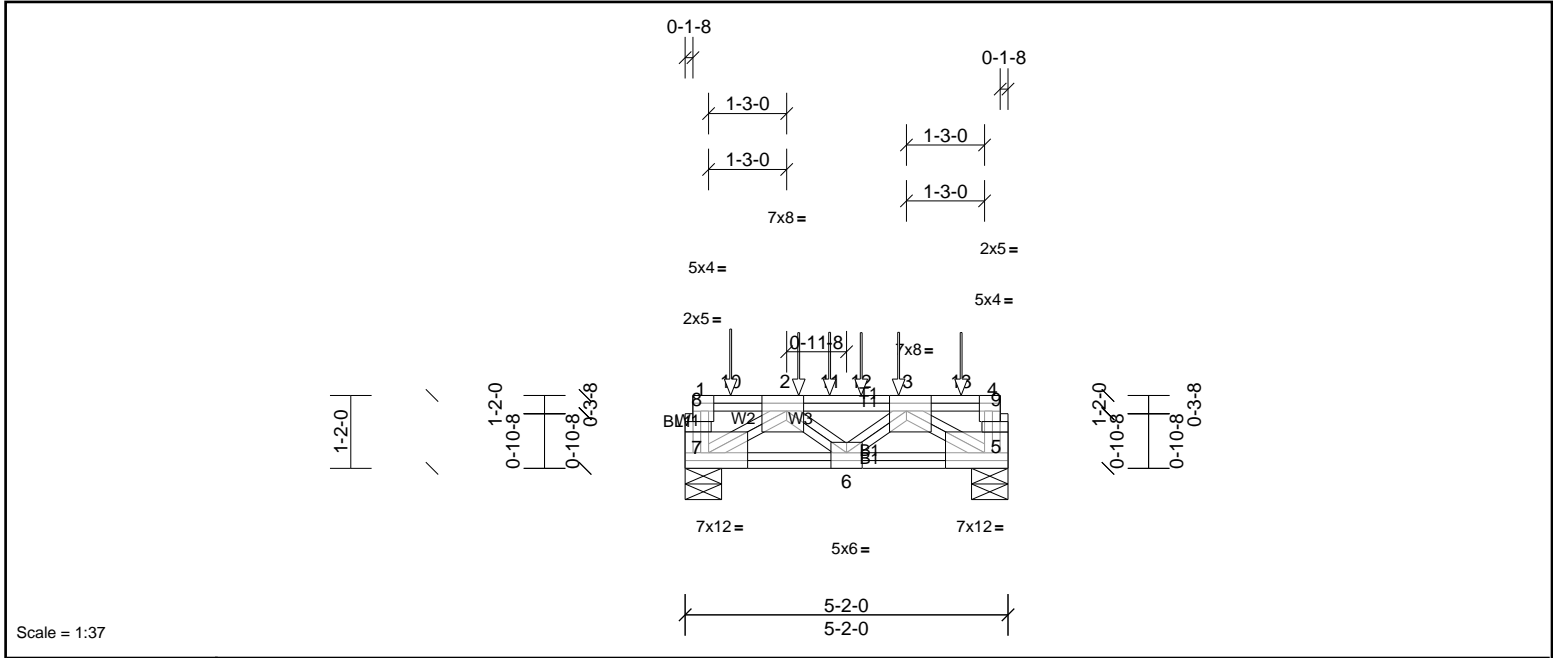


Plate Offsets (X, Y): [1:Edge,0-3-0], [2:0-3-4,Edge], [3:0-3-4,Edge], [4:0-1-8,Edge], [5:Edge,0-3-0], [6:0-3-0,Edge], [7:Edge,0-3-0], [8:0-1-8,0-0-11], [9:0-1-8,0-0-11]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.78	Vert(LL)	-0.03	6	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.80	Vert(CT)	-0.04	6	>999	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.61	Horz(CT)	0.02	5	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 51 lb	FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 5-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS	(lb/size)	5=3202/0-7-0, (min. 0-1-10), 7=4036/0-7-0, (min. 0-2-1)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	7-8=-1058/0, 1-8=-1016/0, 5-9=-440/0, 4-9=-423/0, 2-11=-4403/0, 11-12=-4403/0, 3-12=-4403/0	
BOT CHORD	6-7=0/4607, 5-6=0/4230	
WEBS	2-7=-5404/0, 2-6=-279/0, 3-5=-5005/0	

- NOTES**
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2011 lb down at 0-8-12, 909 lb down at 1-9-13, 980 lb down at 2-3-12, 909 lb down at 2-9-13, and 980 lb down at 3-5-0, and 934 lb down at 4-5-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00	
Uniform Loads (lb/ft)	
	Vert: 5-7=-10, 1-4=-100
Concentrated Loads (lb)	
	Vert: 2=-909 (F), 3=-980 (B), 10=-2011 (B), 11=-980 (B), 12=-909 (F), 13=-934 (F)



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72435795	Truss FG2	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:34

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-f1qa9CA46jhCdT8X6?Hw6YRDFvoo6kNs4vVjgyJF2h

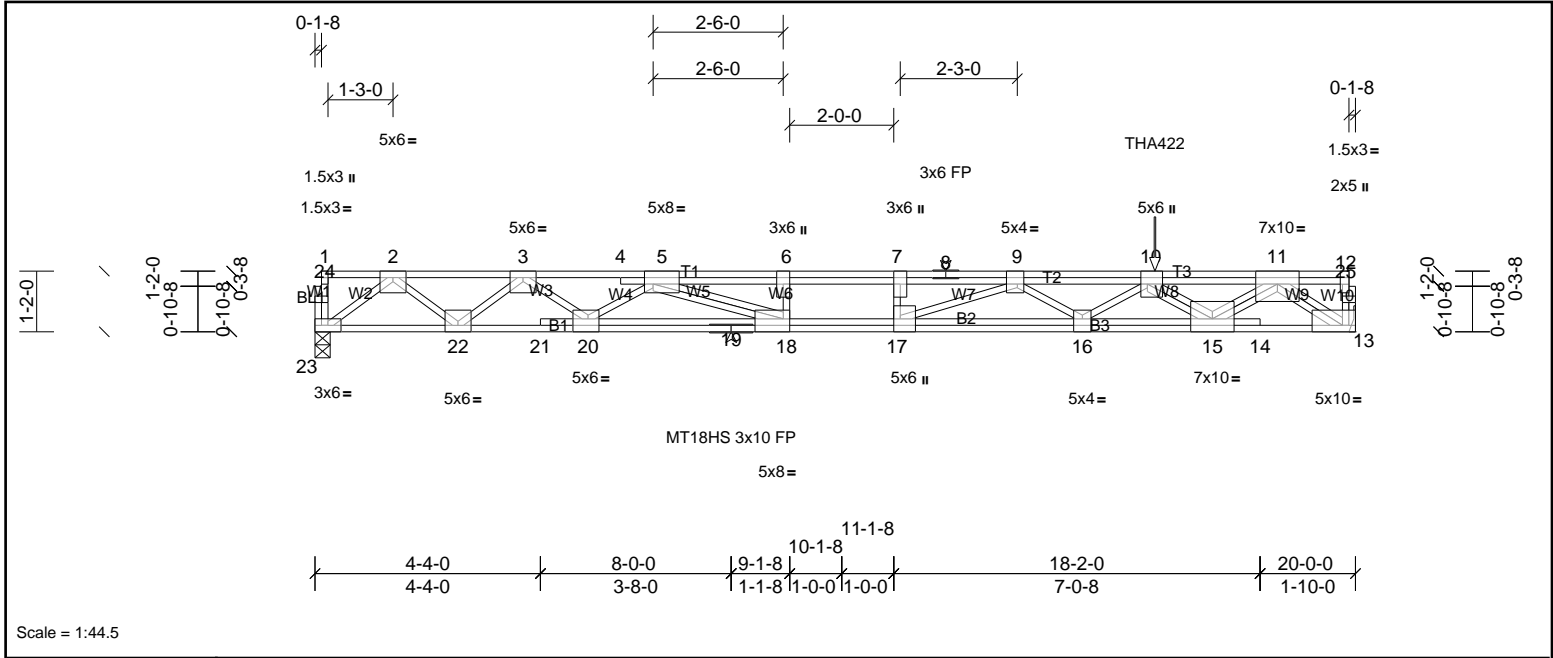


Plate Offsets (X, Y):	[5:0-2-0,Edge], [7:0-3-0,Edge], [9:0-1-8,Edge], [10:0-3-0,Edge], [12:0-3-0,Edge], [13:Edge,0-1-8], [16:0-2-0,Edge], [17:0-3-0,Edge], [18:0-1-8,Edge], [20:0-2-8,Edge]
-----------------------	---

Loading	(psf)	Spacing	1-4-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.79	Vert(LL)	-0.36	16-17	>657	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.72	Vert(CT)	-0.60	16-17	>394	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.76	Horz(CT)	0.09	13	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH								Weight: 147 lb FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 5-0-13 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS	(lb/size)	13=2068/ Mechanical, (min. 0-1-8), 23=1154/0-3-8, (min. 0-1-8)
<b>FORCES</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2623/0, 3-4=-4931/0, 4-5=-4930/0, 5-6=-8106/0, 6-7=-8106/0, 7-8=-8106/0, 8-9=-8106/0, 9-10=-8255/0, 10-11=-5440/0	
BOT CHORD	22-23=0/1475, 21-22=0/3810, 20-21=0/3804, 19-20=0/6294, 18-19=0/6294, 17-18=0/8106, 16-17=0/8430, 15-16=0/7907, 14-15=0/2880, 13-14=0/2885	
WEBS	6-18=-528/0, 10-16=0/490, 9-16=-425/5, 9-17=-819/627, 10-15=-3121/0, 2-23=-1849/0, 2-22=0/1494, 3-22=-1544/0, 3-20=0/1425, 5-20=-1619/0, 5-18=0/2211, 11-15=0/3183, 11-13=-3524/0	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent at 16-1-12 from the left end to connect truss(es) to front face of top chord.
  - Fill all nail holes where hanger is in contact with lumber.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00	Uniform Loads (lb/ft) Vert: 13-23=-7, 1-4=-67, 4-8=-107, 8-12=-67 Concentrated Loads (lb) Vert: 10=-1530 (F)
2) Dead: Lumber Increase=1.00, Plate Increase=1.00	Uniform Loads (lb/ft) Vert: 13-23=-7, 1-4=-67, 4-8=-107, 8-12=-67 Concentrated Loads (lb) Vert: 10=-1530 (F)
3) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00	Uniform Loads (lb/ft) Vert: 13-23=-7, 1-4=-67, 4-7=-107, 7-8=-54, 8-12=-13 Concentrated Loads (lb) Vert: 10=-584 (F)
4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00	Uniform Loads (lb/ft) Vert: 13-23=-7, 1-4=-13, 4-6=-54, 6-8=-107, 8-12=-67



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

Job 72435795	Truss FG2	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:34

Page: 2

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-f1qa9CA46jhCdT8X6?Hw6YRDFvoo6kNs4vVjgyJF2h

Concentrated Loads (lb)

Vert: 10=-1584 (F)

5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (lb/ft)

Vert: 13-23=-7, 1-4=-67, 4-7=-107, 7-8=-54, 8-12=-13

Concentrated Loads (lb)

Vert: 10=-584 (F)

6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (lb/ft)

Vert: 13-23=-7, 1-4=-13, 4-6=-54, 6-8=-107, 8-12=-67

Concentrated Loads (lb)

Vert: 10=-1584 (F)



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss FG3	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:34

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-f1qa9CA46jhCdT8X6?Hw6YRDAfW9oAfNs4vVjgyJF2h

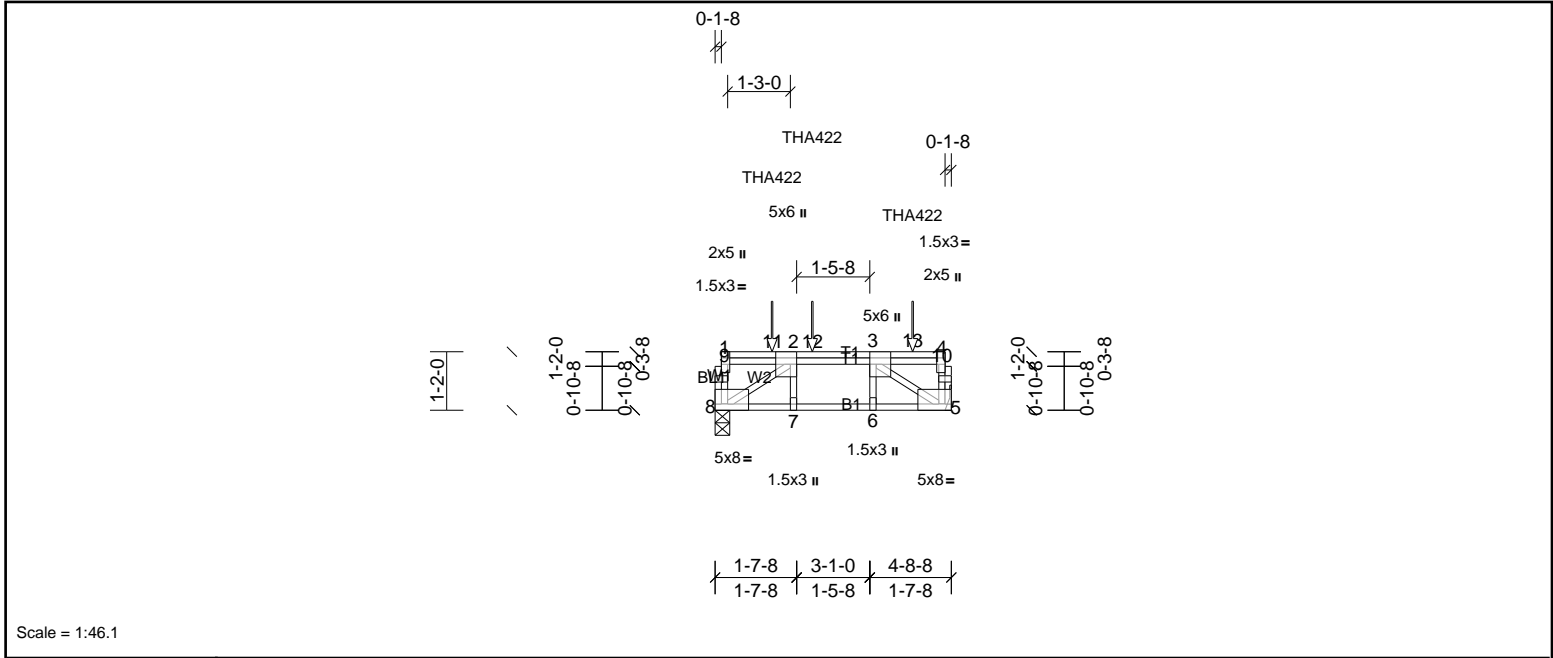

Scale = 1:46.1

Plate Offsets (X, Y):	[2:0-3-0,Edge], [3:0-3-0,Edge], [4:0-3-0,Edge], [5:Edge,0-1-8], [8:Edge,0-1-8]											
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	40.0	Plate Grip DOL	1.00	TC	0.79	Vert(LL)	-0.03	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.70	Vert(CT)	-0.05	7-8	>999	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.51	Horz(CT)	0.01	5	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 32 lb	FT = 20%F, 12%E


<b>LUMBER</b>		<b>BRACING</b>	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-8-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

<b>REACTIONS</b>	(lb/size)	5=1597/ Mechanical, (min. 0-1-8), 8=1605/0-3-8, (min. 0-1-8)
	Max Grav	5=1597 (LC 1), 8=1612 (LC 3)

<b>FORCES</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	8-9=-439/0, 1-9=-438/0, 5-10=-501/25, 4-10=-500/24, 2-12=-1806/0, 3-12=-1806/0
BOT CHORD	7-8=0/1806, 6-7=0/1806, 5-6=0/1806
WEBS	3-5=-2155/0, 2-8=-2158/0

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-1-10 from the left end to 3-11-4 to connect truss(es) to back face of top chord.
  - Fill all nail holes where hanger is in contact with lumber.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

<b>LOAD CASE(S)</b>	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 5-8=-10, 1-4=-100
	Concentrated Loads (lb)
	Vert: 11=-903 (B), 12=-900 (B), 13=-921 (B)

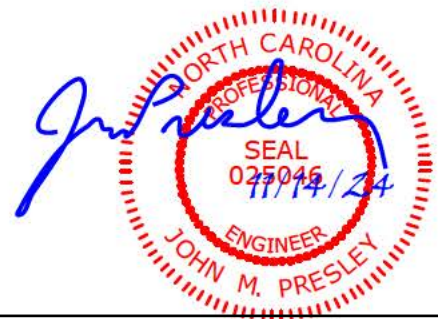

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss K200	Truss Type Truss	Qty 2	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:34

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-f1qa9CA46jhCdT8X6?Hw6YROPf4yoH5Ns4vVjgyJF2h

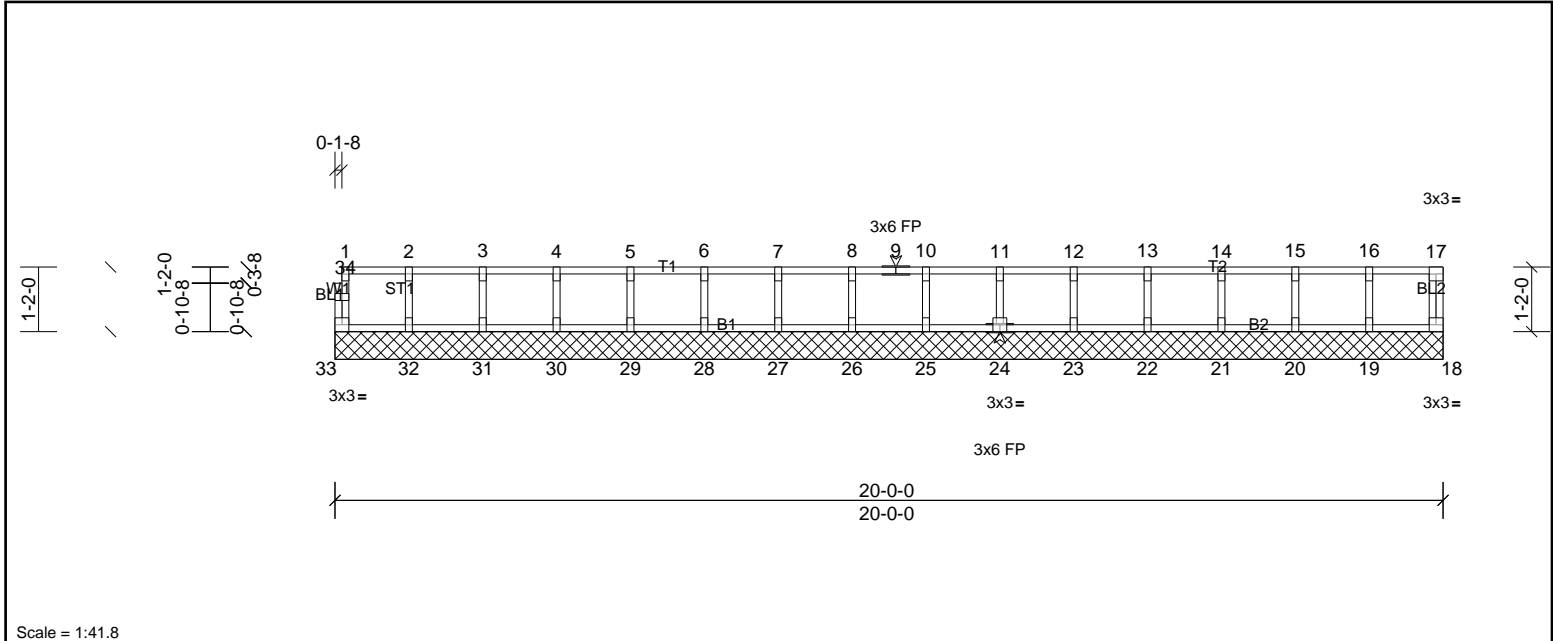

Scale = 1:41.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	18	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 84 lb	FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS** All bearings 20-0-0.  
(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- All plates are 1.5x3 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss K201	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:35

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-f1qa9CA46jhCdT8X6?Hw6YROF4moH3Ns4vVjgyJF2h

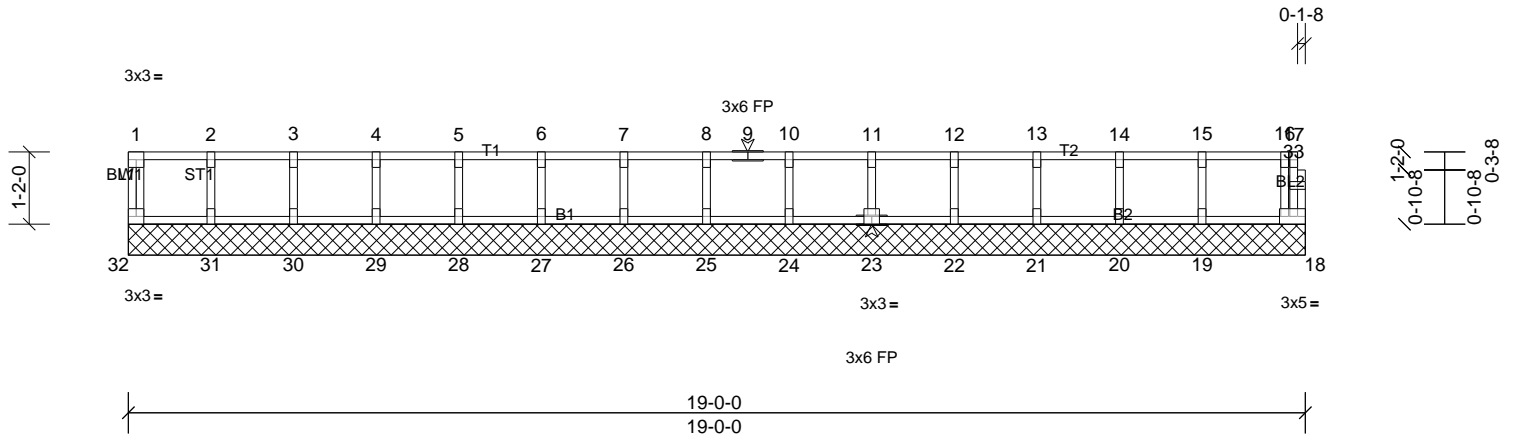

Scale = 1:37.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	18	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 81 lb	FT = 20%F, 12%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS** All bearings 19-0-0.  
(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
  - 2) Gable requires continuous bottom chord bearing.
  - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 4) Gable studs spaced at 1-4-0 oc.
  - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72435795	Truss K202	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL B 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Thu Nov 14 15:04:35

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-7DOyNXBjt1p2Edjigjo9em\_Z?3Q?XkJW5kf2G7yJF2g

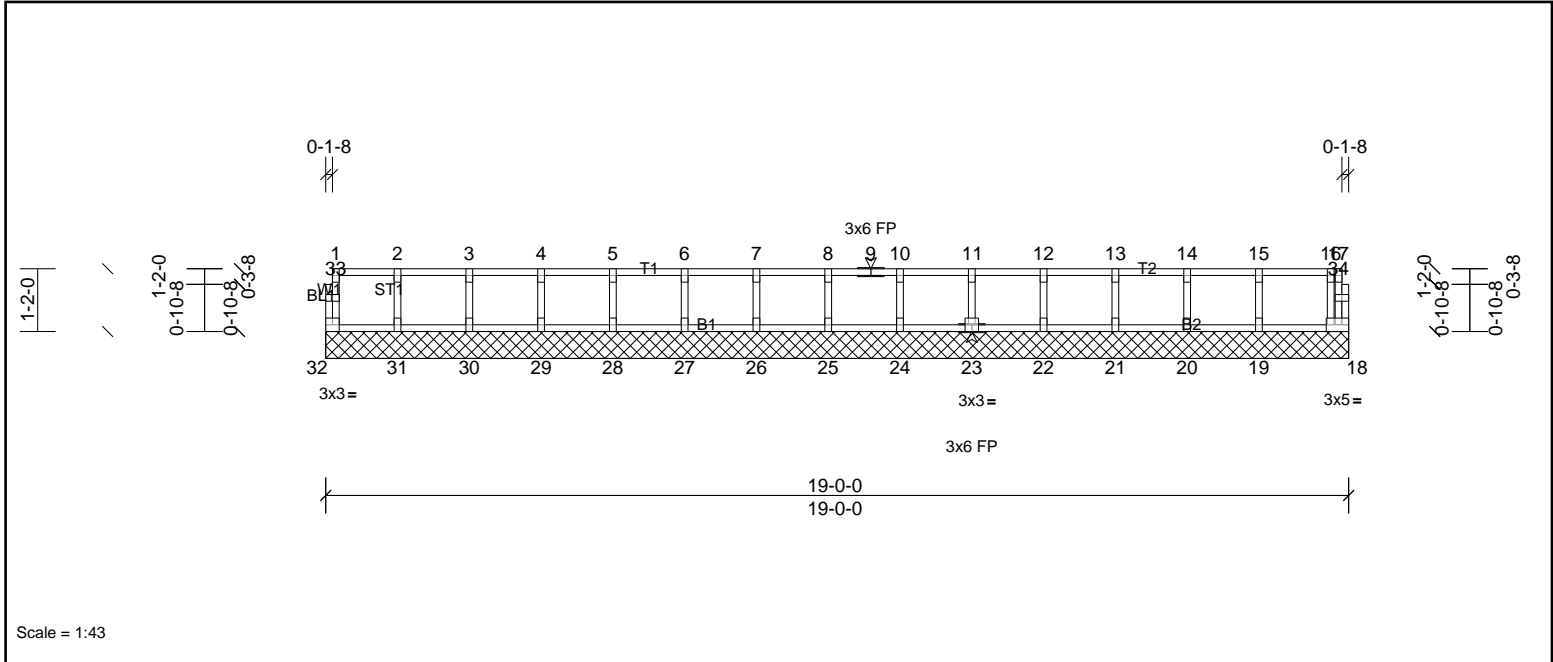

Scale = 1:43

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	18	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 80 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

**REACTIONS** All bearings 19-0-0.  
(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
  - 2) Gable requires continuous bottom chord bearing.
  - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 4) Gable studs spaced at 1-4-0 oc.
  - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

