

Residence for Adams Homes AEC, LLC Plan 3327 "A" FE (R) KC104



GENERAL NOTES:

- ALL WORK IS TO BE DONE IN STRICT ACCORDANCE WITH NORTH CAROLINA STATE RESIDENTIAL BUILDING CODE, 2018 EDITION (HEREIN WITH SHOWN AS N.C.S.R.B.C.).
- DIMENSIONS SHOWN ON DRAWINGS GOVERN OVER SCALE.
- STUD WALL DESIGN SHALL CONFORM TO ALL N.C.S.R.B.C. REQUIREMENTS.
- CONTRACTOR SHALL USE TEMPERED SAFETY GLASS IN ALL LOCATIONS AS REQUIRED BY N.C.S.R.B.C., SECTION R302.4
- ANY HABITABLE ROOM SHALL MEET ALL LIGHT/VENTILATION AND EGRESS AS REQUIRED BY N.C.S.R.B.C., SECTIONS R-303.1 AND R-310.1
- ALL WALLS SHOWN ON FLOOR PLANS ARE 2x4 FRAME UNLESS NOTED OTHERWISE.
- ALL ANGLED WALLS SHOWN ON FLOOR PLANS ARE 45° UNLESS NOTED OTHERWISE.
- ALL WINDOWS SHALL HAVE A MINIMUM DPI RATING OF 25. BUILDER SHALL VERIFY WITH WINDOW MANUFACTURER THAT UNITS INSTALLED MEET THESE REQUIREMENTS AS PER N.C.S.R.B.C., TABLE 301.2(6).
- ENERGY EFFICIENCY REQUIREMENTS FOR THE SPECIFIC CLIMATE ZONE WHERE STRUCTURE IS BEING BUILT SHALL BE IN ACCORDANCE WITH CHAPTER 11 OF THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, AS SHOWN IN TABLES N110.2 AND N110.1.
- TERMITE TREATMENT - BORATE APPLIED TO ALL FRAME MEMBERS WITHIN 24" AFF.

INDEX TO DRAWINGS:

COVER SHEET

- | | |
|------|--------------------------------|
| 1 | FRONT AND LEFT SIDE ELEVATIONS |
| 2 | REAR AND RIGHT SIDE ELEVATIONS |
| 3 | FIRST FLOOR PLAN |
| 4 | SECOND FLOOR PLAN |
| 5 | FIRST FLOOR ELECTRICAL PLAN |
| 6 | SECOND FLOOR ELECTRICAL PLAN |
| OPTI | FLOOR PLAN OPTIONS |
| DI | CONSTRUCTION DETAILS |

- | | |
|------|-----------------------------------|
| S1 | MONO SLAB FOUNDATION PLAN |
| S2 | FIRST FLOOR CEILING FRAMING PLAN |
| S3 | SECOND FLOOR CEILING FRAMING PLAN |
| S4 | ROOF FRAMING PLAN |
| SD1 | STRUCTURAL DETAILS |
| SPEC | STRUCTURAL SPECIFICATIONS |
| ST | PLAN OPTIONS |

RESIDENTIAL BUILDING CODE SUMMARY

- PLANS ARE DESIGNED TO THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.
- HOUSE IS DESIGNED FOR 120 MPH, 3 SECOND GUST (93 MPH FASTEST WIND), EXPOSURE B.
- ANCHOR BOLTS SHALL BE MIN. 1/2" DIAMETER WITH STANDARD WASHER AND NUT AND SHALL EXTEND 7" MIN. INTO MASONRY OR CONCRETE. BOLTS TO BE NO MORE THAN 6' O.C. AND WITHIN 12" OF CORNERS. ALTERNATE ANCHOR STRAPS CAN BE USED INSTEAD OF ANCHOR BOLTS SPACED AT THE EQUIVALENT SPACING AND INSTALLED PER MANUFACTURER'S SPECIFICATION'S EXCEPT AT GARAGE LUG FTG.
- MEAN ROOF HEIGHT: 18'-8"
- COMPONENT & CLADDING DESIGNED FOR THE FOLLOWING LOADS:
MEAN ROOF HGT: UP TO 30' 30'-1" TO 35' 35'-1" TO 40' 40'-1" TO 45'

| | | | | |
|--------|-------------|-------------|-------------|-------------|
| ZONE 1 | 16.5, -18.0 | 17.3, -18.9 | 18.0, -19.6 | 18.5, -20.2 |
| ZONE 2 | 16.5, -21.0 | 17.3, -22.1 | 18.0, -22.9 | 18.5, -23.5 |
| ZONE 3 | 16.5, -21.0 | 17.3, -22.1 | 18.0, -22.9 | 18.5, -23.5 |
| ZONE 4 | 18.0, -19.5 | 18.9, -20.5 | 19.6, -21.3 | 20.2, -21.8 |
| ZONE 5 | 18.0, -24.1 | 18.9, -25.3 | 19.6, -26.3 | 20.2, -27.0 |
- MINIMUM VALUES FOR ENERGY COMPLIANCE: ZONE 4
- MAXIMUM GLAZING U-FACTOR: 0.35
- INSULATING VALUES: CEILING: R-30* / WALLS: R-15 / FLOOR: R-19 / SLABS: R-10. CODE REFERENCE: TABLE N1102.1 (*R-30 ONLY IF UNCOMPRESSED, R-30 REQUIRED IF COMPRESSED)
- FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R703.8 OF THE N.C.R.B.C.
- FIREBLOCKING SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R602.8 OF THE N.C.R.B.C.
- DRAFTSTOPPING SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R302.12 OF THE N.C.R.B.C.

MATERIALS LEGEND

| | | | |
|--|----------------------|--|------------------|
| | EARTH/COMPACT FILL | | FINISH WOOD |
| | CONCRETE | | ROUGH WOOD |
| | BRICK | | BLOCKING |
| | CONCRETE BLOCK/STONE | | PLYWOOD |
| | STEEL | | BATT INSULATION |
| | ALUMINUM | | RIGID INSULATION |

TOILET ACCESSORIES LEGEND

PROVIDE 2x4 BLOCKING IN THE WALL FOR THE FOLLOWING:

| | |
|----|---------------------|
| TB | TOWEL BAR |
| TP | TOILET PAPER HOLDER |
| TR | TOWEL RING |
| MC | MEDICINE CABINET |
| MR | MAGAZINE RACK |

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. ANY ERRORS AND/OR OMISSIONS FOUND IN THIS SET SHOULD IMMEDIATELY BE REPORTED TO ADAMS HOMES FOR CLARIFICATION OR CORRECTION. THE CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION.

AREA CALCULATIONS

| | | | |
|------------|--------|-----------------|-----|
| 1ST FLOOR: | 2421 | GARAGE: | 457 |
| 2ND FLOOR: | 906 | FRONT PORCH: | 48 |
| REC. ROOM: | 0 | PATIO: | 140 |
| TOTAL: | 3327 | BRICK: | 0 |
| | | TOTAL: | 645 |
| WIDTH: | 54'-0" | | |
| DEPTH: | 56'-0" | COV. PORCH OPT: | 224 |


FOUNDATION VENTING CALCULATIONS

NOT NEEDED WITH SLAB FOUNDATION

ATTIC VENTILATION REQUIREMENTS

| | |
|---------------------------------|--------------------------------|
| NATURAL ROOF VENTILATION | MECHANICAL ROOF VENTILATOR |
| 2426 SQ. FT. | 2426 SQ. FT. |
| 150 = 14.51 SQ. FT. VENT REQ'D. | 300 = 4.75 SQ. FT. VENT REQ'D. |


BUILDER TO PROVIDE APPROPRIATE VENTILATING AS REQUIRED PER CODE

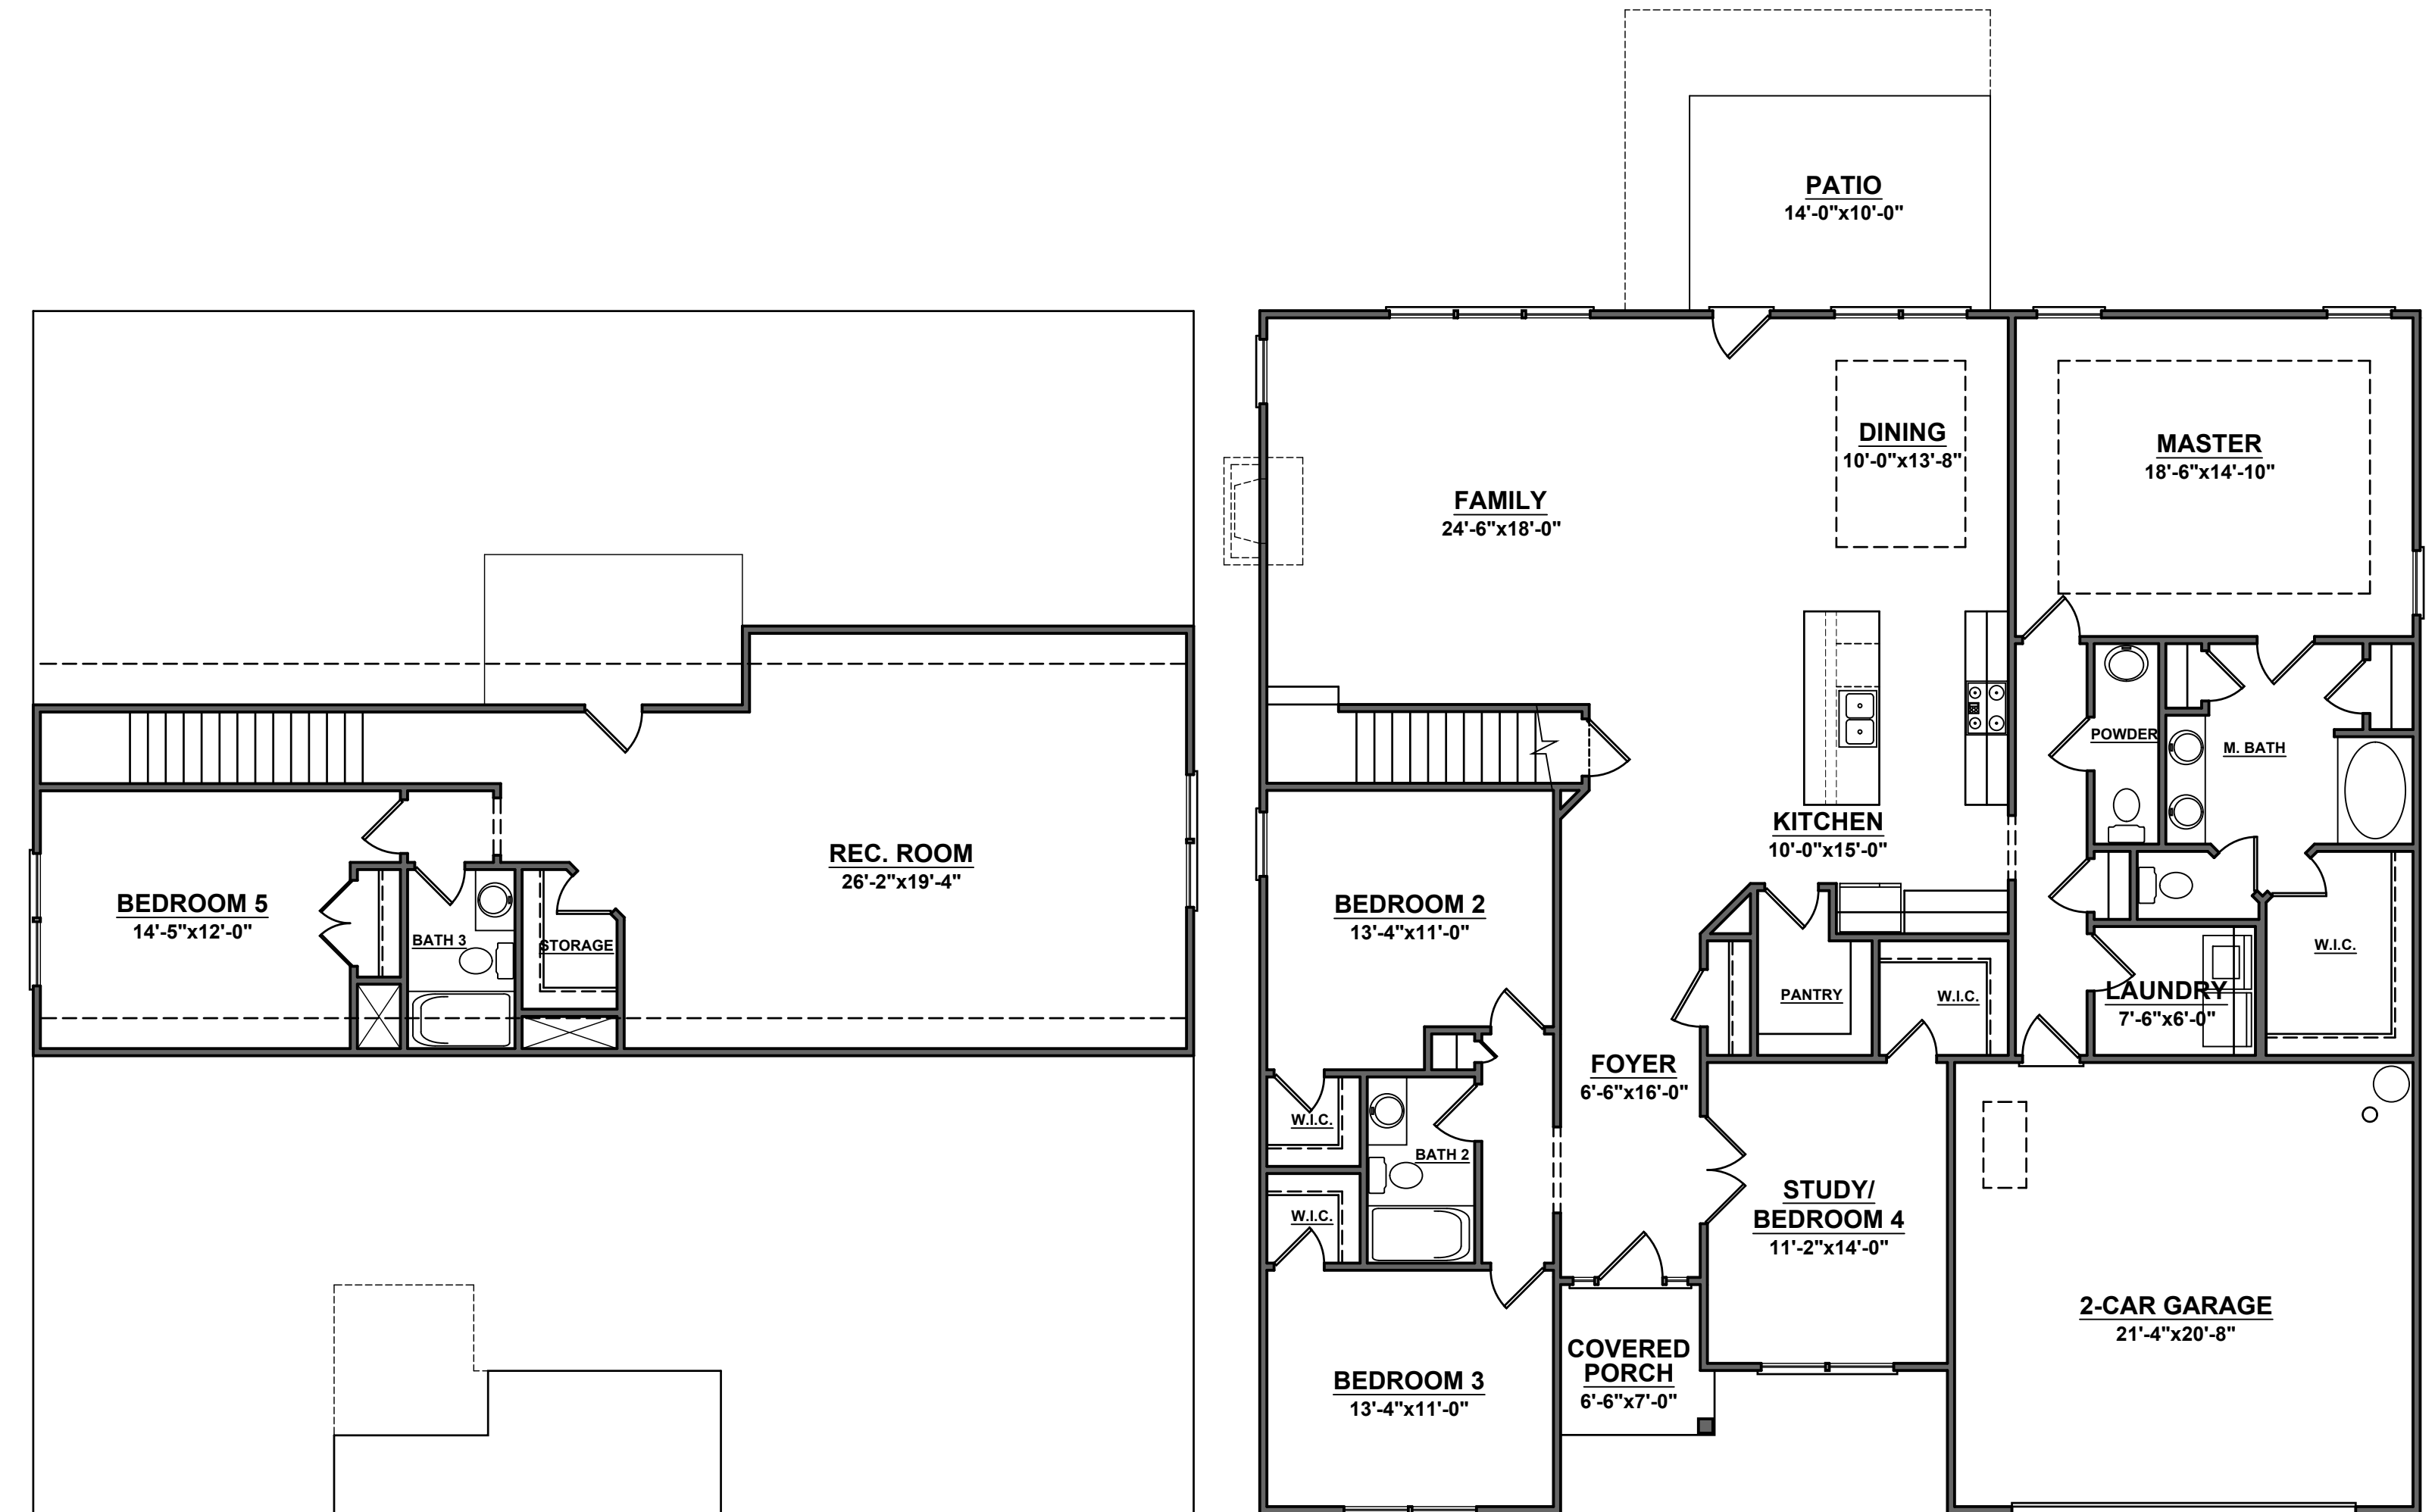

7188




HOMES AEC, LLC

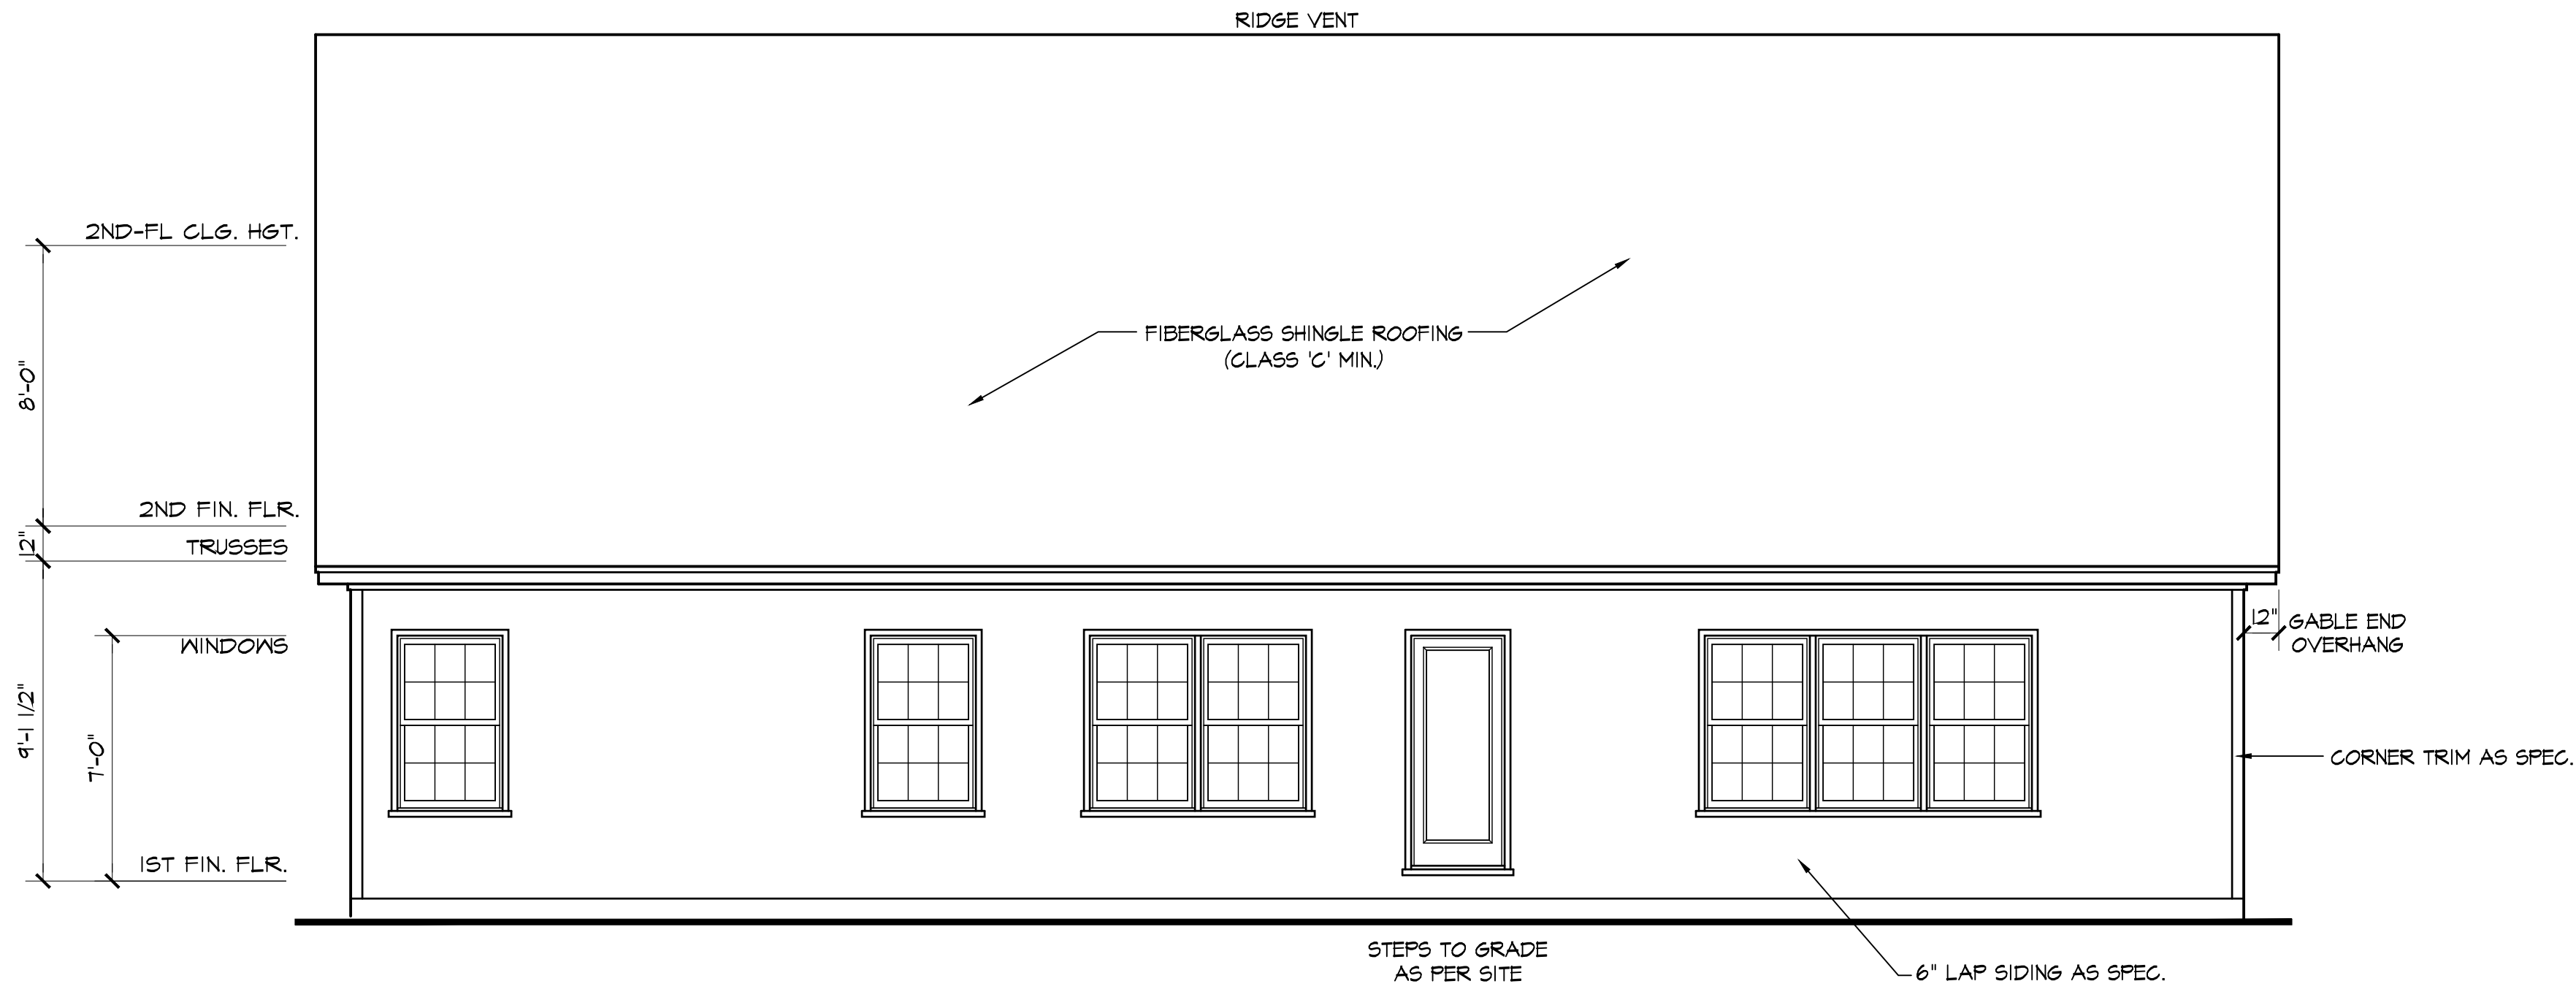

REAR ELEVATION


SCALE: 1/4"=1'-0"
 NOTE - SLOPE ALL GRADES AWAY FROM HOUSE FOR POSITIVE DRAINAGE

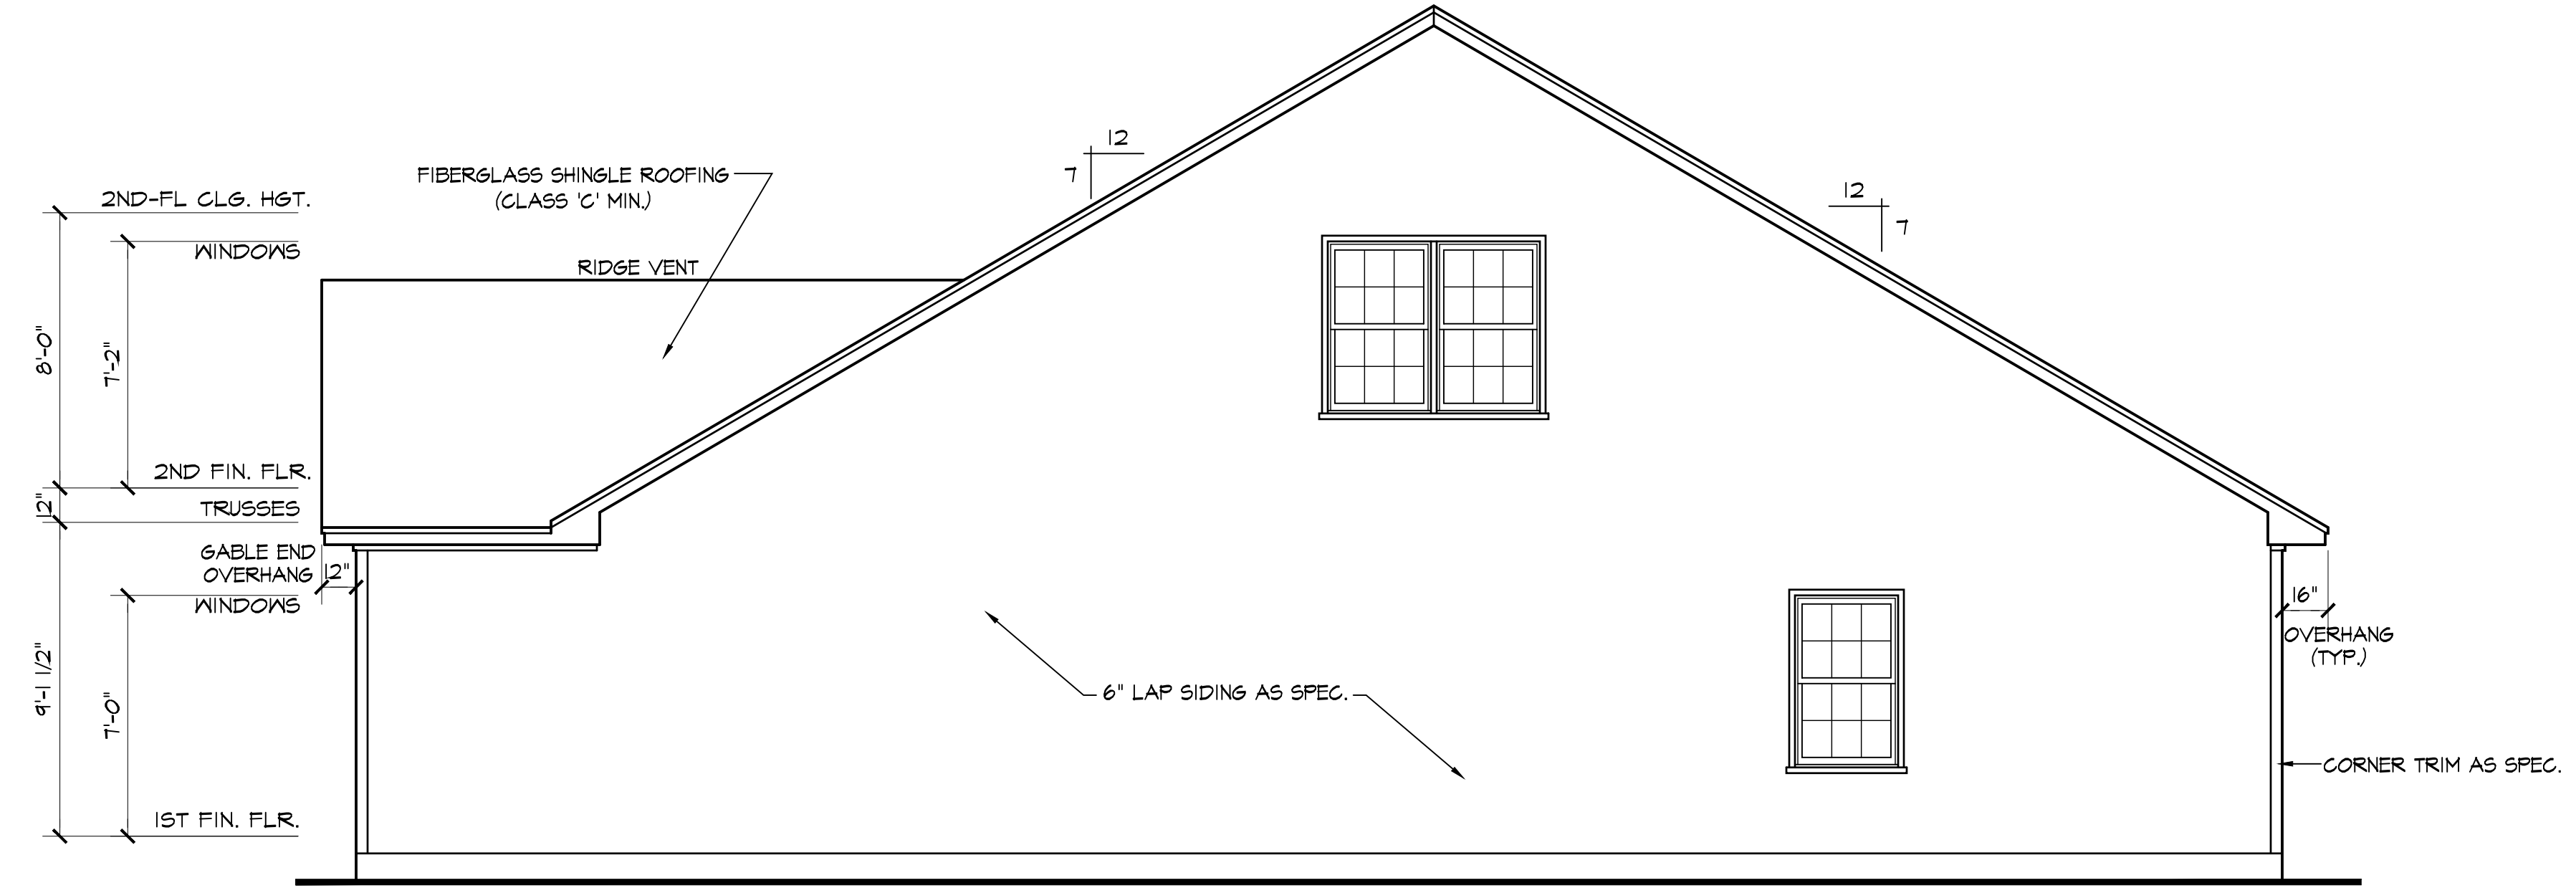

RIGHT SIDE ELEVATION

SCALE: 1/4"=1'-0"

| | |
|------------|-----------|
| DATE DRAWN | 11/8/2024 |
| PROJECT | 7188 |
| REVISIONS | |

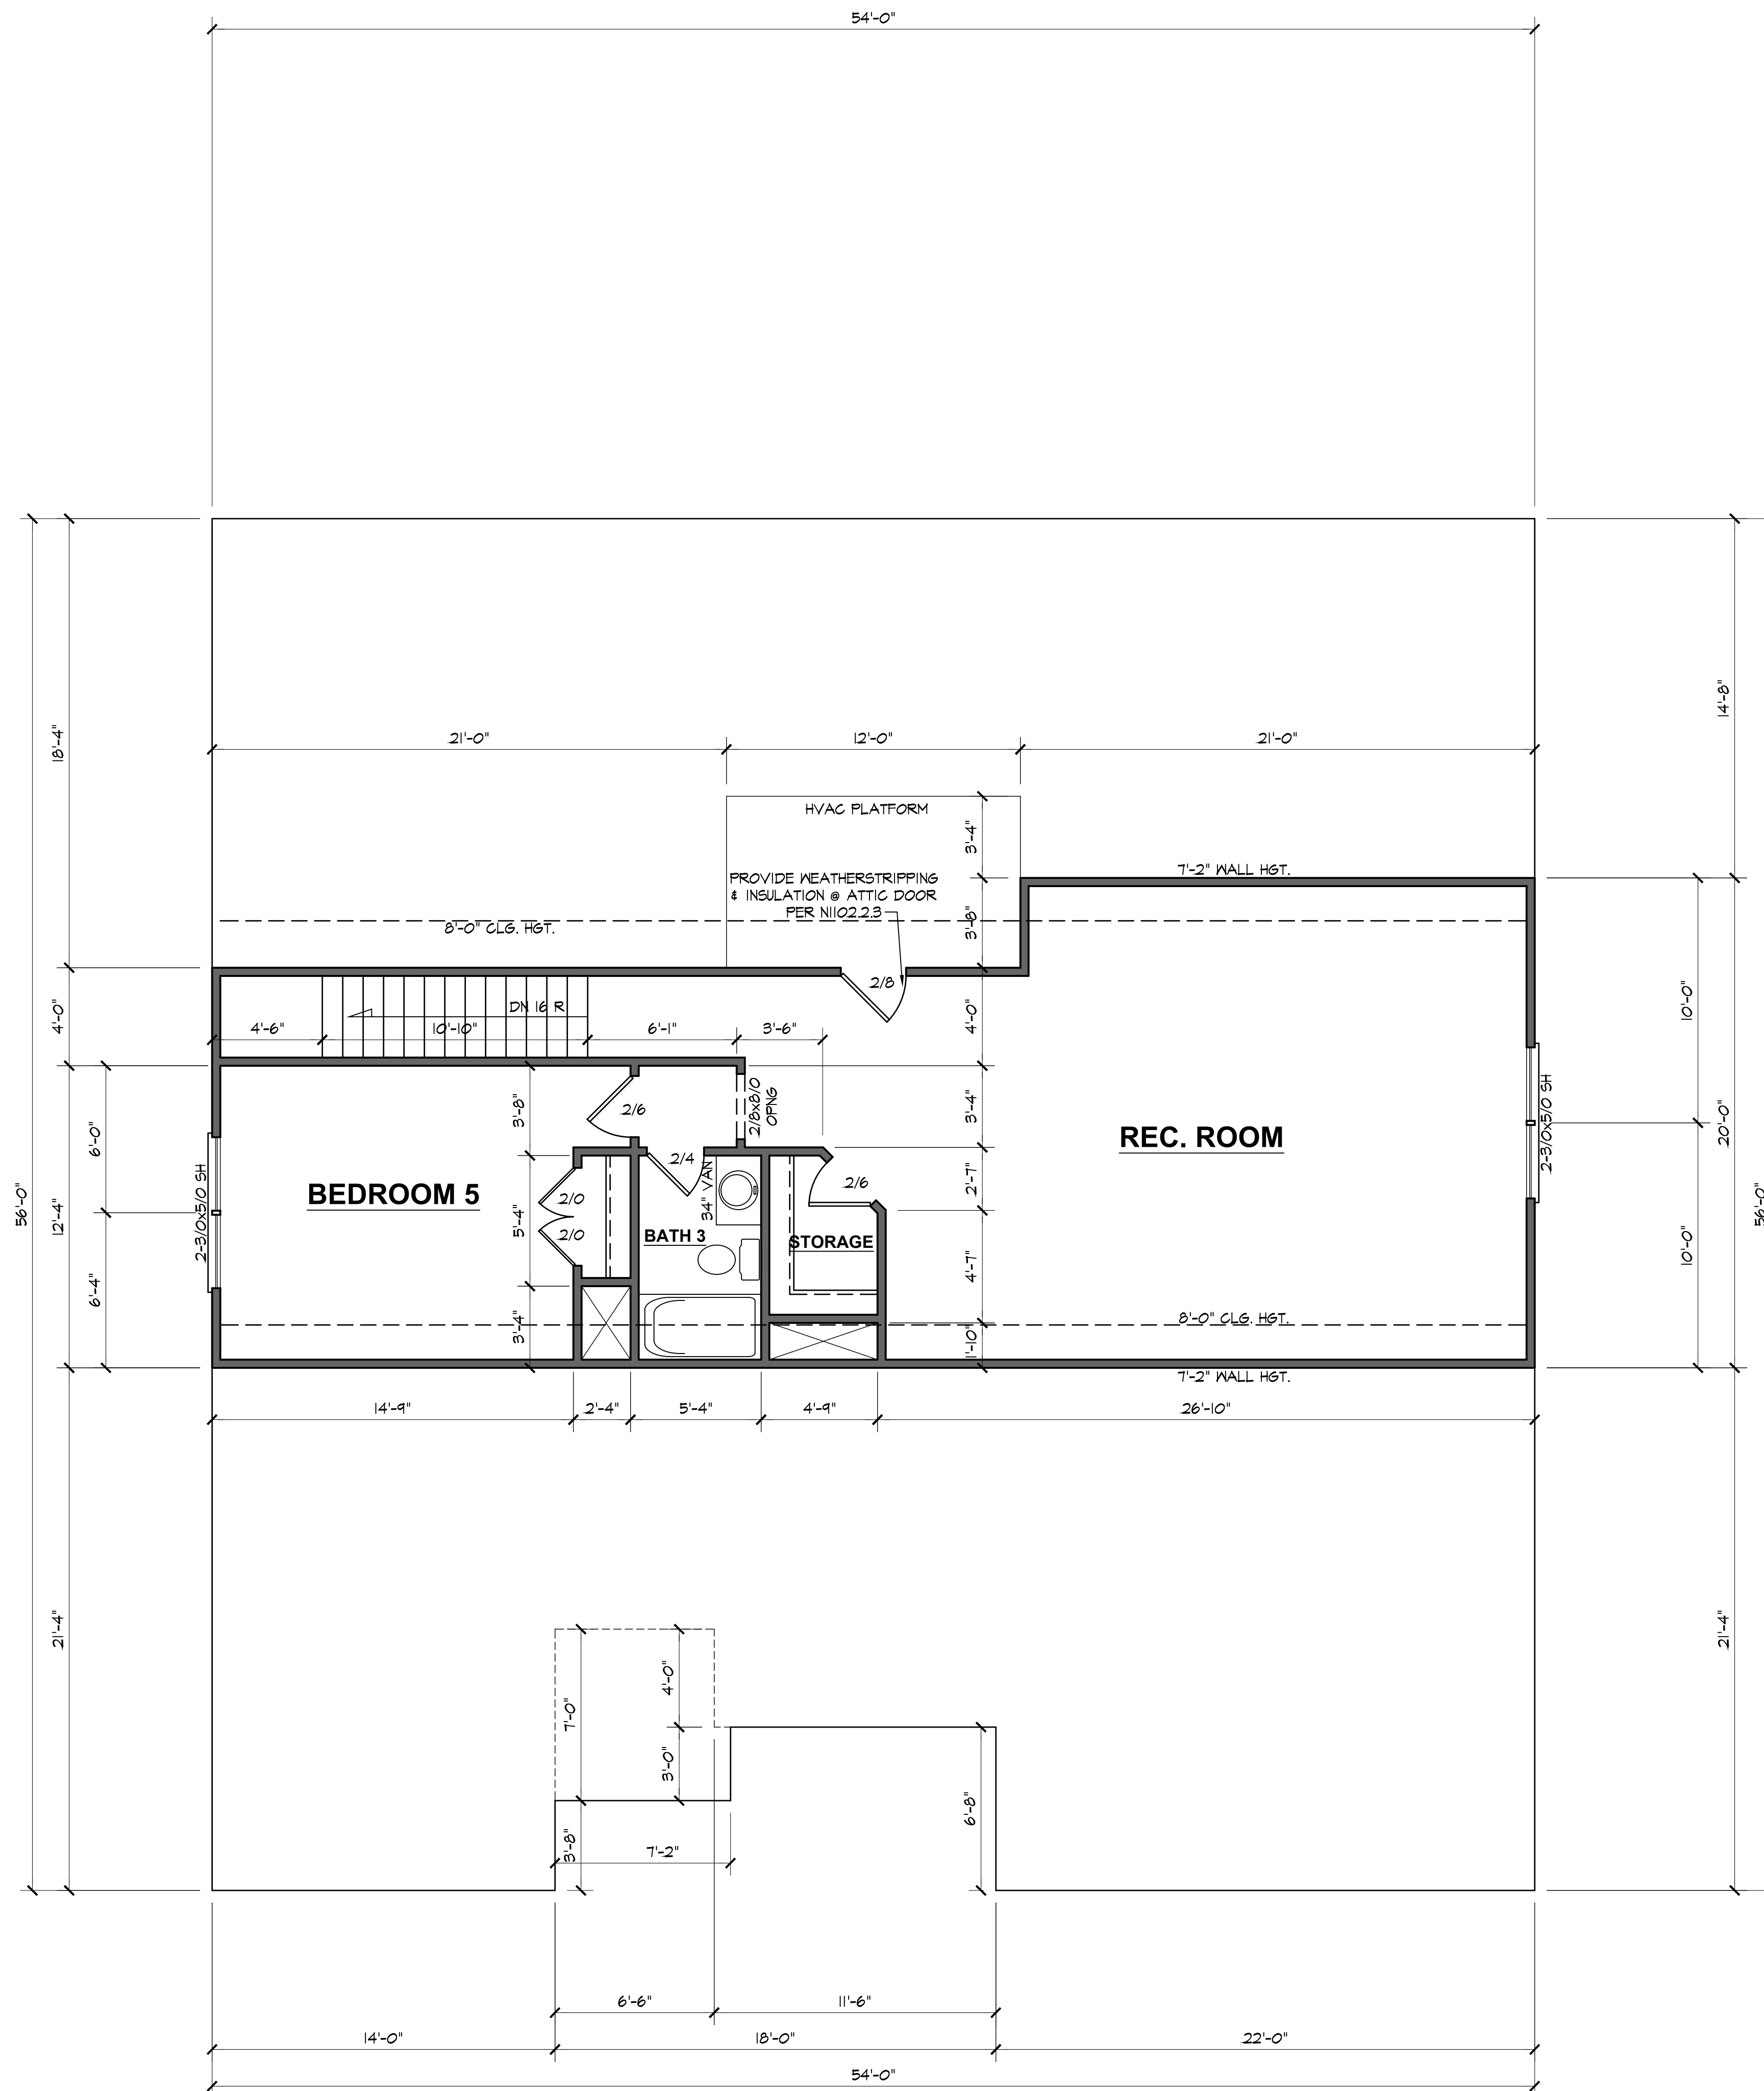


3327 "A" FE (R) KC104

| | |
|------------|-----------|
| DATE DRAWN | 11/8/2024 |
| PROJECT | 7188 |
| REVISIONS | |

SHEET

4

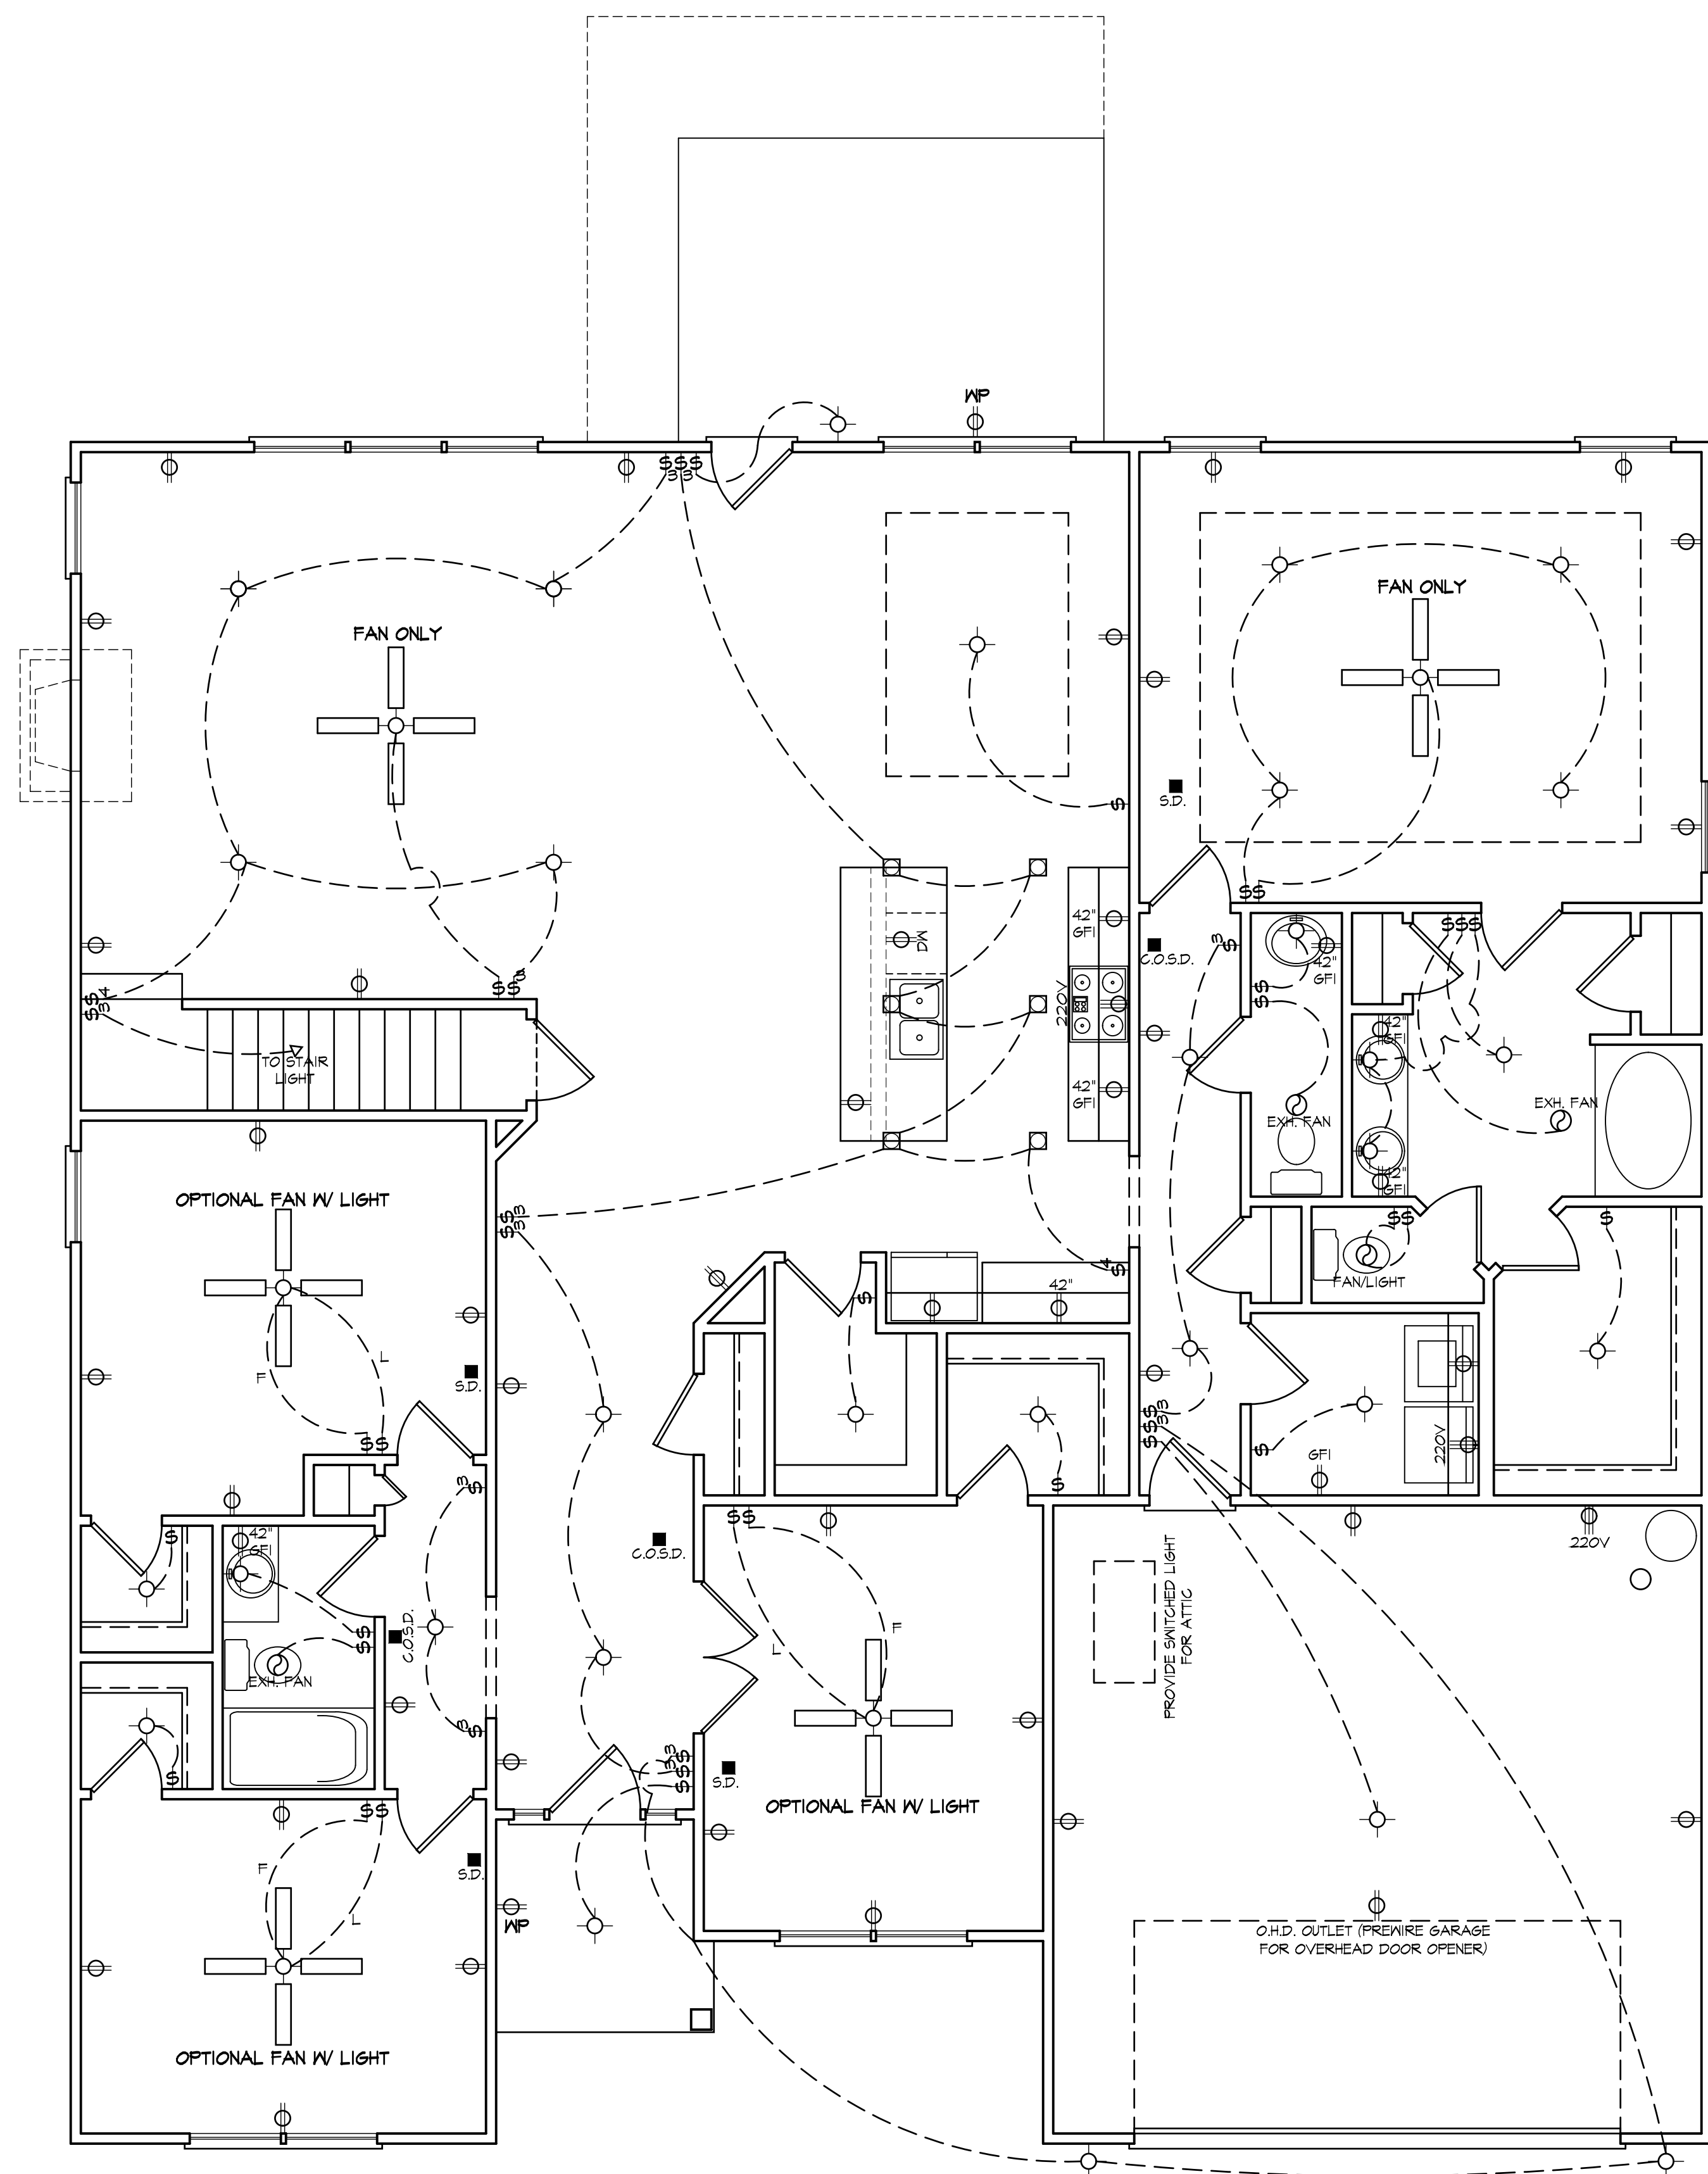

FIRST FLOOR ELECTRICAL PLAN

NOTE - ELECTRICAL RECEPTACLE AND SWITCH QUANTITIES AND LOCATIONS SHOWN ON PLAN ARE FOR ILLUSTRATION PURPOSES ONLY. ACTUAL NUMBER AND LOCATIONS SHALL BE FIELD DETERMINED AS PER CLIENT AND BUILDER EXCEPT WHERE CODE REQUIREMENTS APPLY.


ELECTRICAL LEGEND

- - LIGHT FIXTURE
- ⊙ - FAN/LIGHT
- ⊙MP - WATERPROOF OUTLET
- - RECESSED LIGHTING
- ⌘ - SINGLE FULL SWITCH
- ⌘ - 3-WAY SWITCH
- ⌘ - 4-WAY SWITCH
- ⌘ - DIMMER SWITCH
- - SMOKE DETECTOR
- ⌘ - FLOOD LIGHTS
- ⌘ - EYEBALL SPOTS
- ⊕ - DUPLEX RECEPTACLE (110V)
- ⊕ - 220 VOLT RECEPTACLE
- ⊕ - SWITCHED RECEPTACLE (TOP WIRE ONLY)
- ⊕GFI - GROUND FAULT CIRCUIT INTERRUPTOR
- ⊕ - CLG FAN/LIGHTS
- - TRACK LIGHTS
- - FLUORESCENT LIGHTING
- - CABLE OUTLET
- ▲ - TELEPHONE OUTLET
- △ - COMPUTER DATA OUTLET
- ⊠ - BURGLAR ALARM
- - INTERCOM

NOTE: ALL ELECTRICAL TO BE VERIFIED BY OWNER/BUILDER BEFORE ROUGH-IN.

3327 "A" FE (R) KC104

| | |
|------------|-----------|
| DATE DRAWN | 11/8/2024 |
| PROJECT | 7188 |
| REVISIONS | |

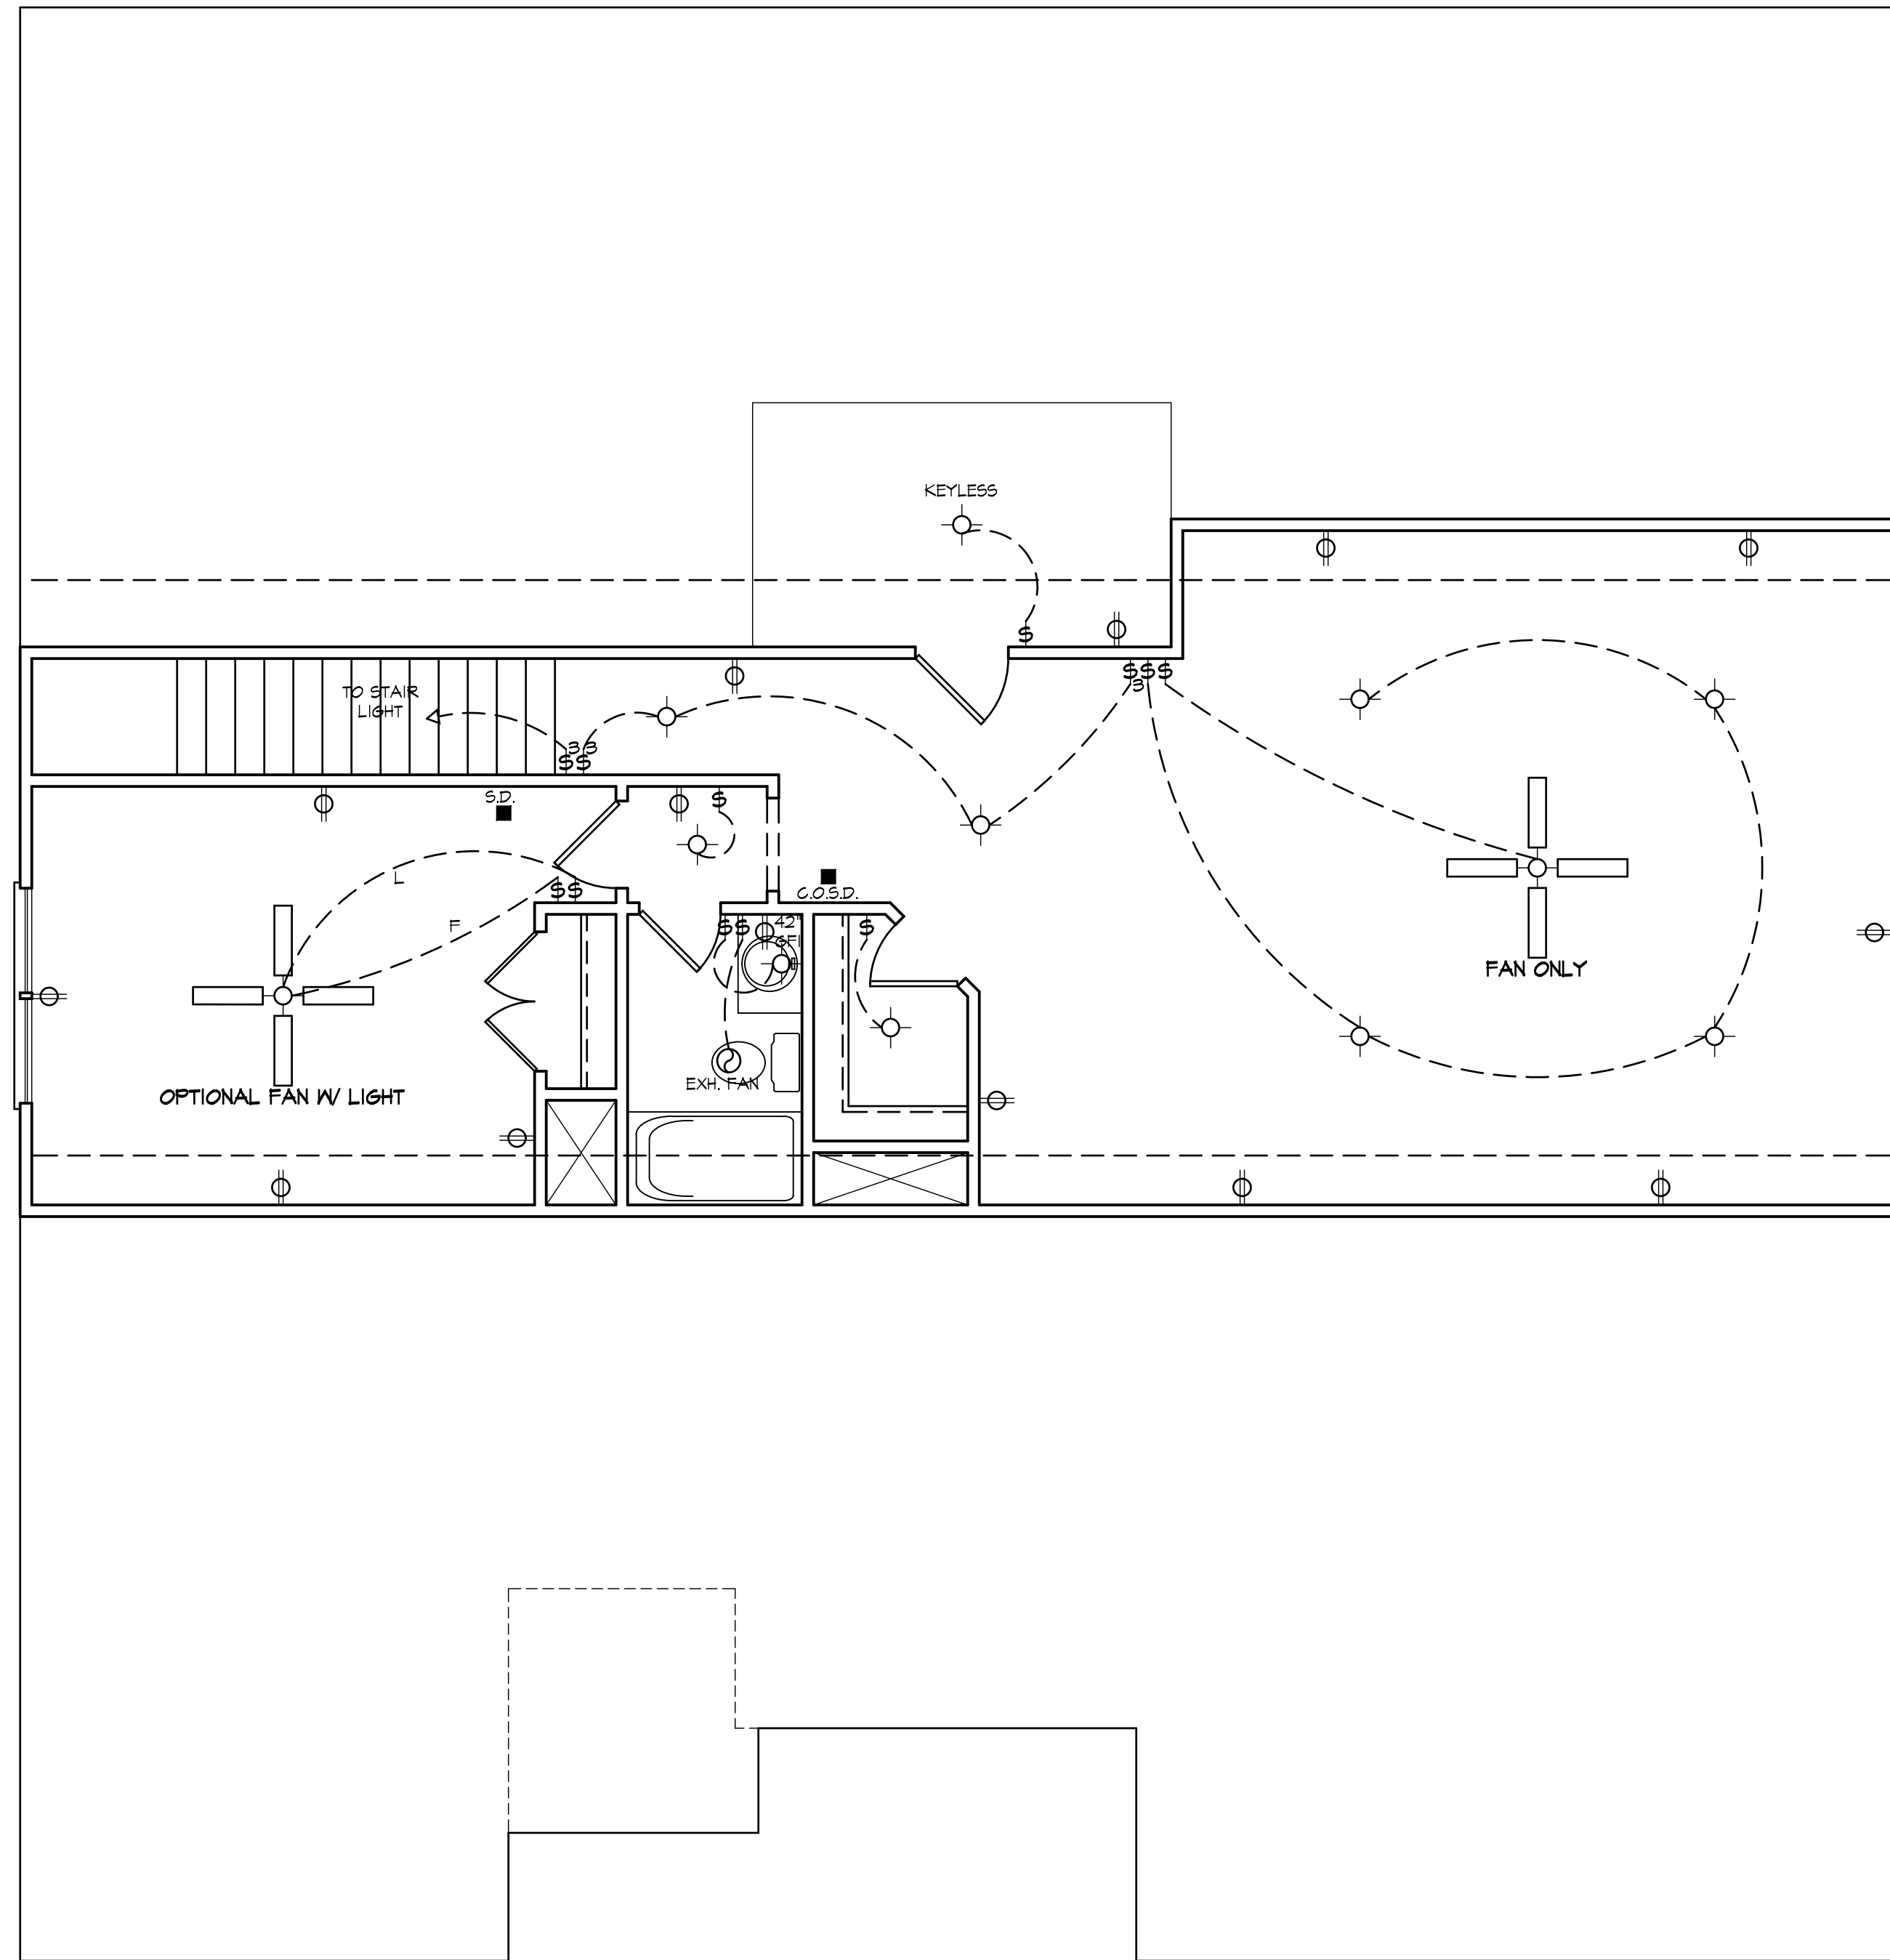

SECOND FLOOR ELECTRICAL PLAN


NOTE - ELECTRICAL RECEPTACLE AND SWITCH QUANTITIES AND LOCATIONS SHOWN ON PLAN ARE FOR ILLUSTRATION PURPOSES ONLY. ACTUAL NUMBER AND LOCATIONS SHALL BE FIELD DETERMINED AS PER CLIENT AND BUILDER EXCEPT WHERE CODE REQUIREMENTS APPLY.

| ELECTRICAL LEGEND | |
|-------------------|---------------------------------------|
| | - LIGHT FIXTURE |
| | - FAN/LIGHT |
| | - WATERPROOF OUTLET |
| | - RECESSED LIGHTING |
| | - SINGLE FULL SWITCH |
| | - 3-WAY SWITCH |
| | - 4-WAY SWITCH |
| | - DIMMER SWITCH |
| | - SMOKE DETECTOR |
| | - FLOOD LIGHTS |
| | - EYEBALL SPOTS |
| | - DUPLEX RECEPTACLE (110V) |
| | - 220 VOLT RECEPTACLE |
| | - SWITCHED RECEPTACLE (TOP WIRE ONLY) |
| | - GROUND FAULT CIRCUIT INTERRUPTOR |
| | - CLG FAN/LIGHTS |
| | - TRACK LIGHTS |
| | - FLUORESCENT LIGHTING |
| | - CABLE OUTLET |
| | - TELEPHONE OUTLET |
| | - COMPUTER DATA OUTLET |
| | - BURGLAR ALARM |
| | - INTERCOM |


NOTE: ALL ELECTRICAL TO BE VERIFIED BY OWNER/BUILDER BEFORE ROUGH-IN.

3327 "A" FE (R) KC104

| | |
|------------|-----------|
| DATE DRAWN | 11/8/2024 |
| PROJECT | 7188 |
| REVISIONS | |

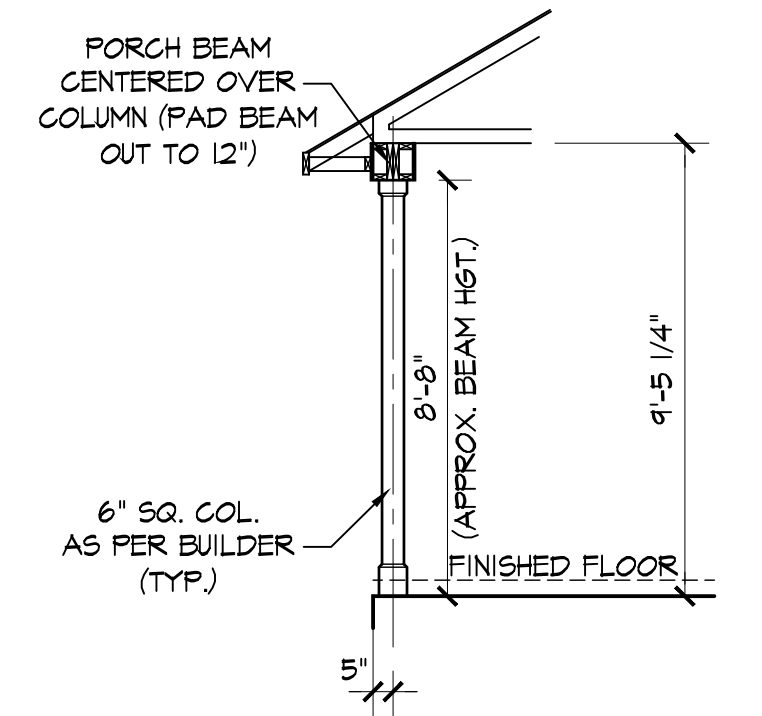


REAR PORCH COLUMN DETAIL

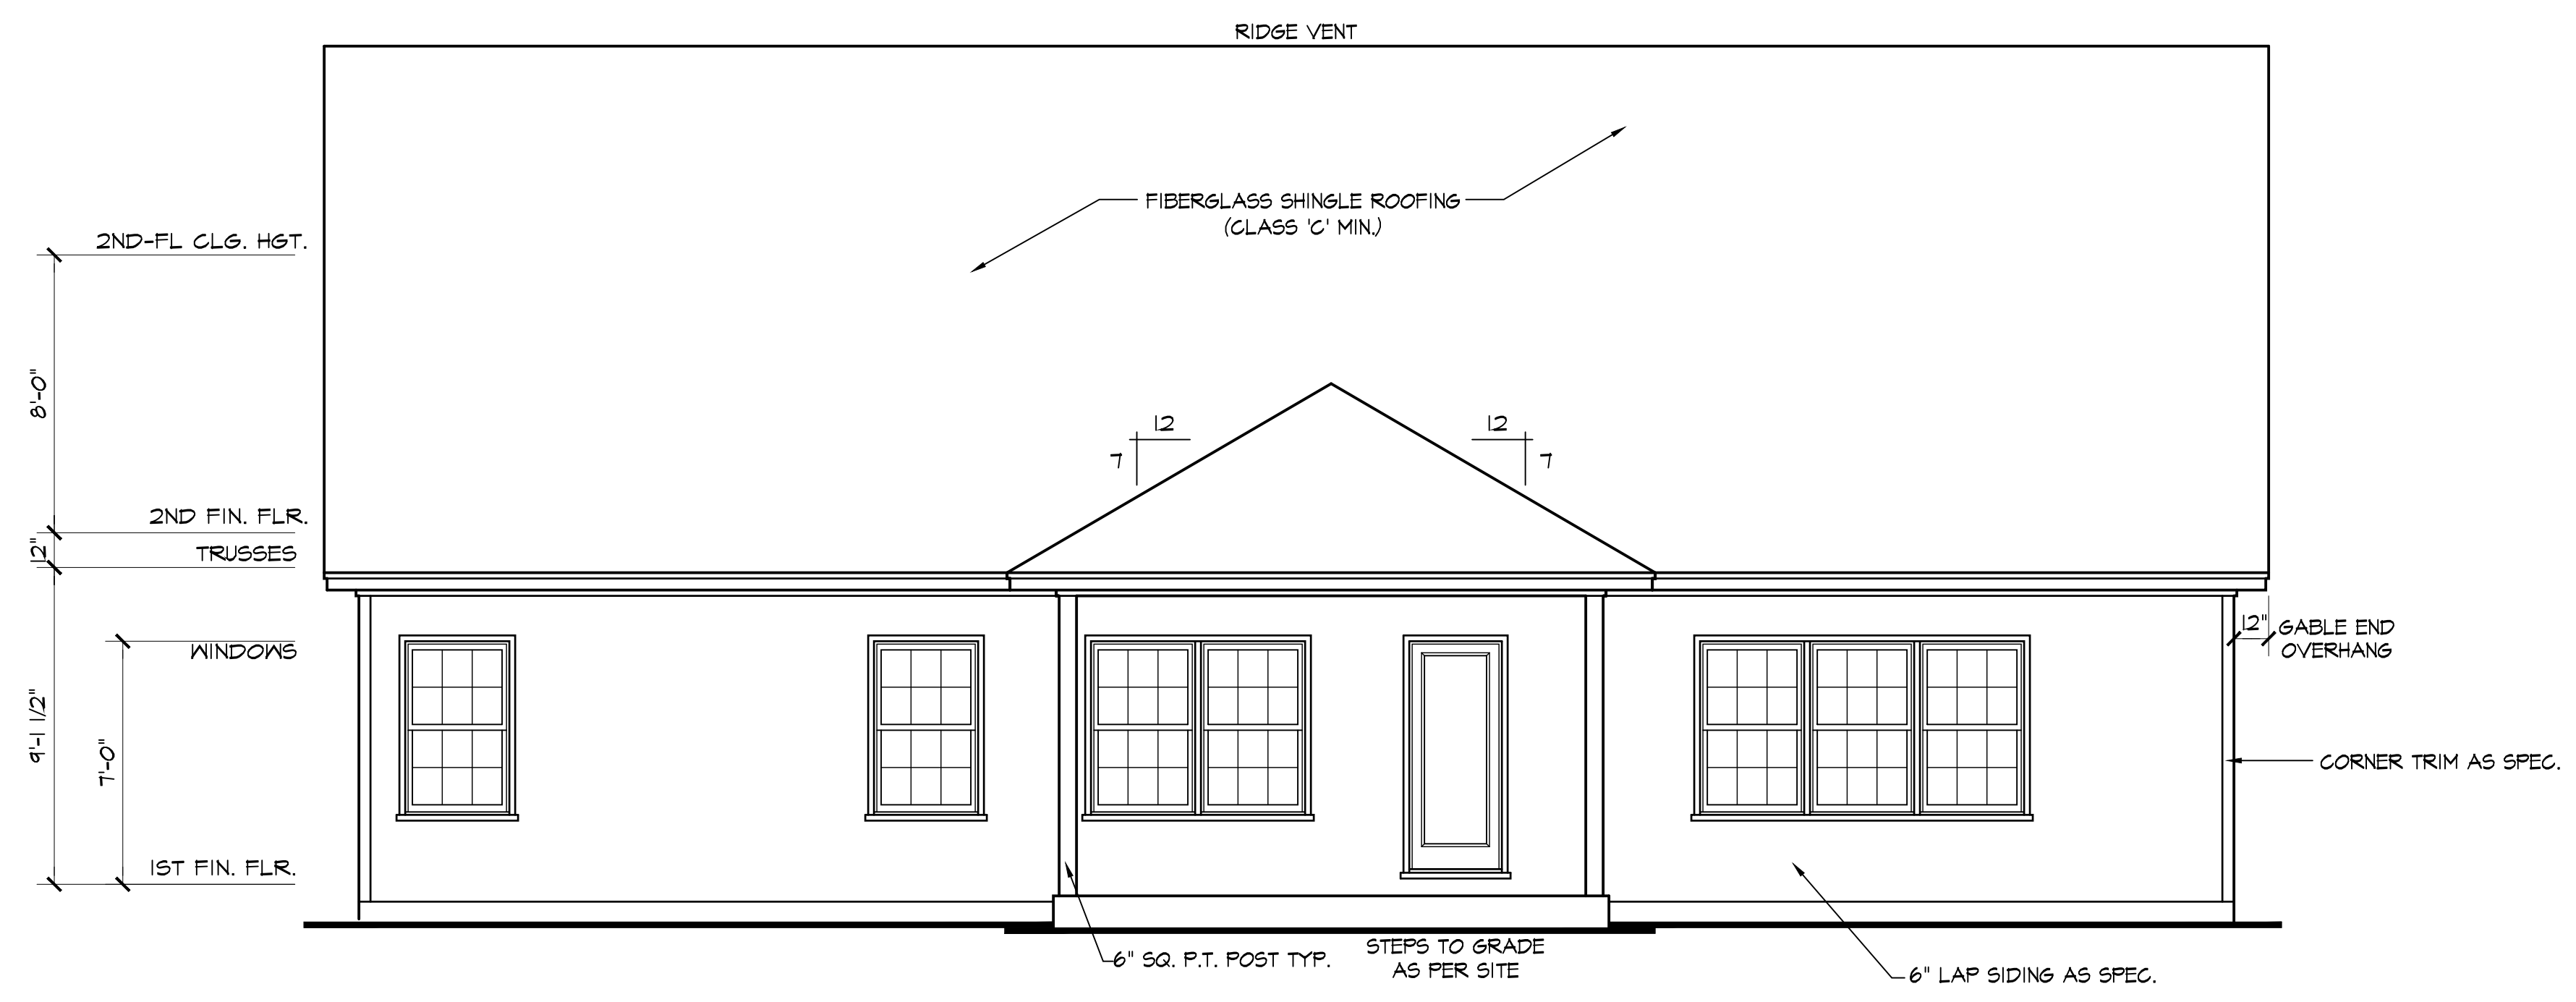


REAR ELEVATION
 SCALE: 1/4"=1'-0"
 NOTE - SLOPE ALL GRADES AWAY FROM HOUSE FOR POSITIVE DRAINAGE


| Y | N | OPTIONAL MASTER BATH |
|---|---|---|
| | | 4' X 3' (1) PC. FIBERGLASS SHOWER IN LIEU OF LINEN CLOSET |
| | | 4' X 4' FIXED OBSCURED GLASS WINDOW |

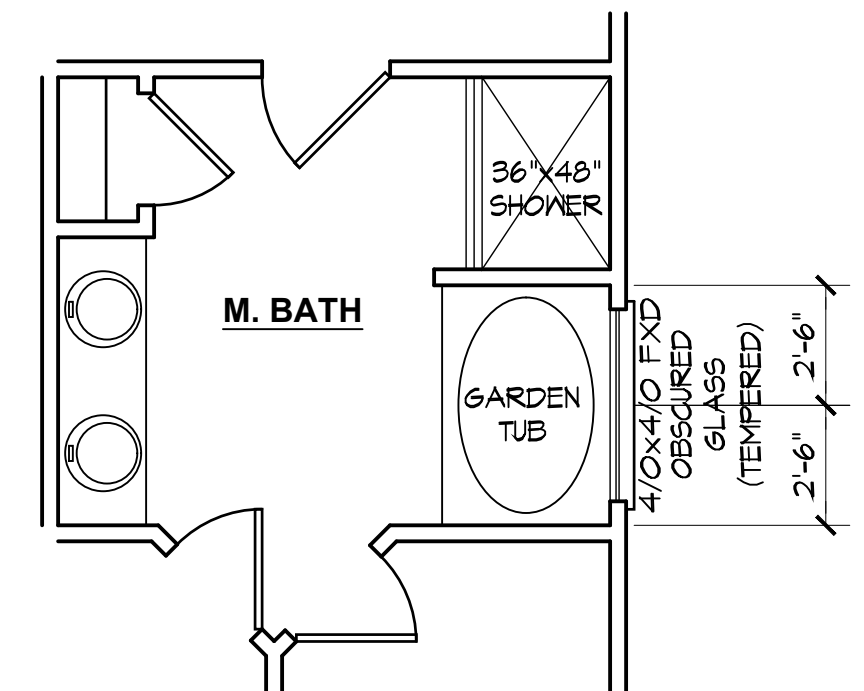


OPTIONAL MASTER BATH
 SEE FLOOR PLAN FOR TYPICAL NOTES & DIMENSIONS

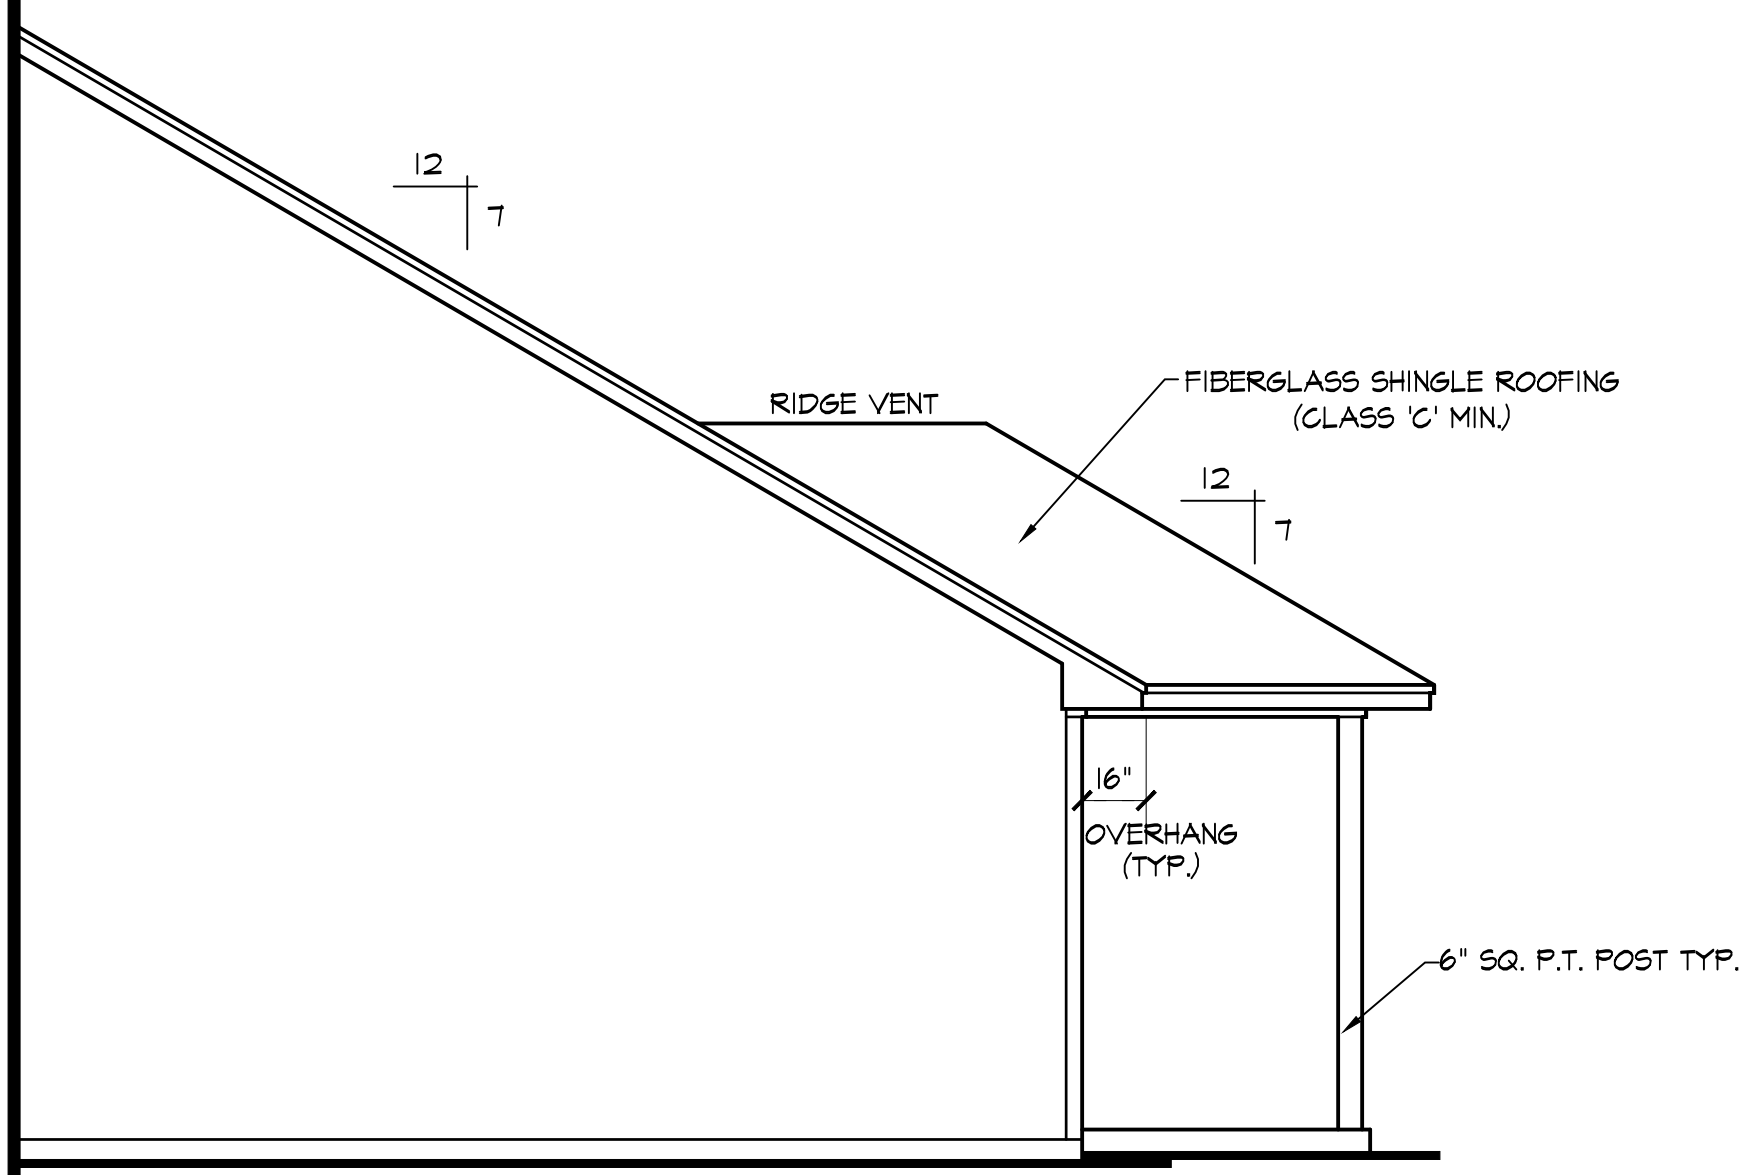

SIDE ELEVATION
 SCALE: 1/4"=1'-0"

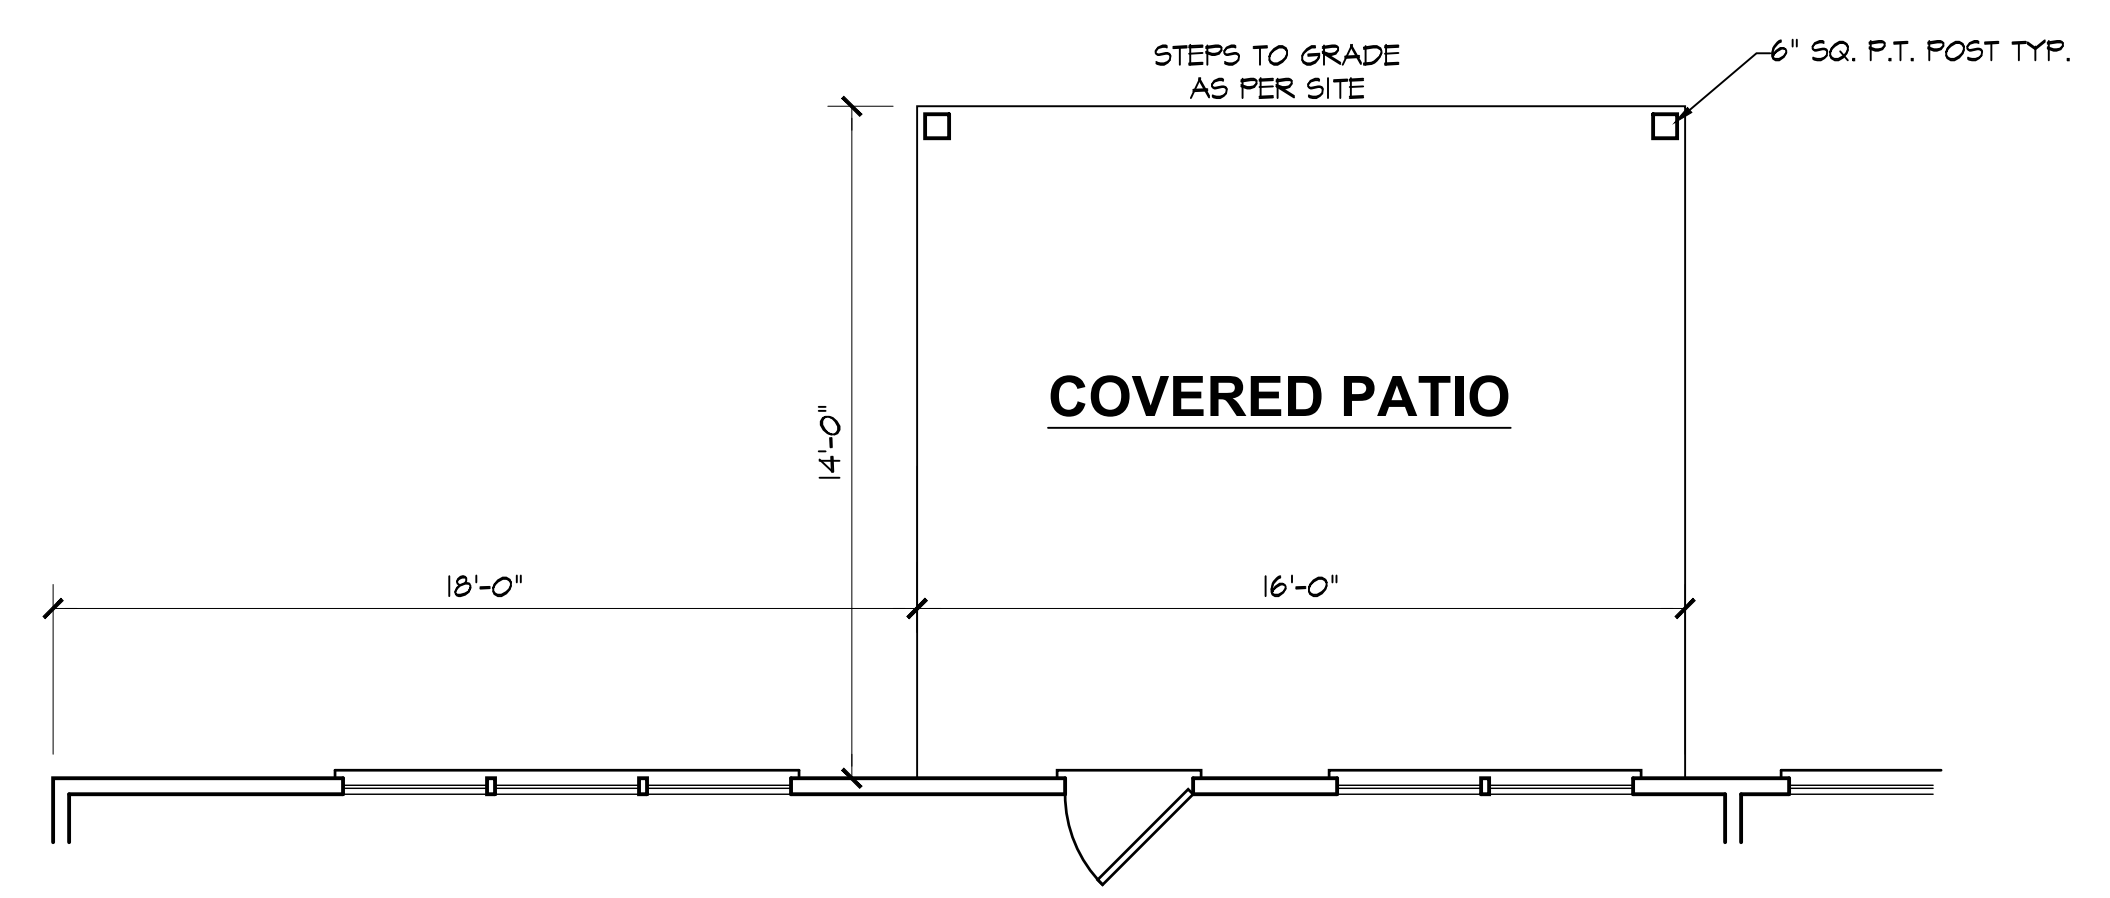


COVERED PORCH
 SCALE: 1/4"=1'-0"

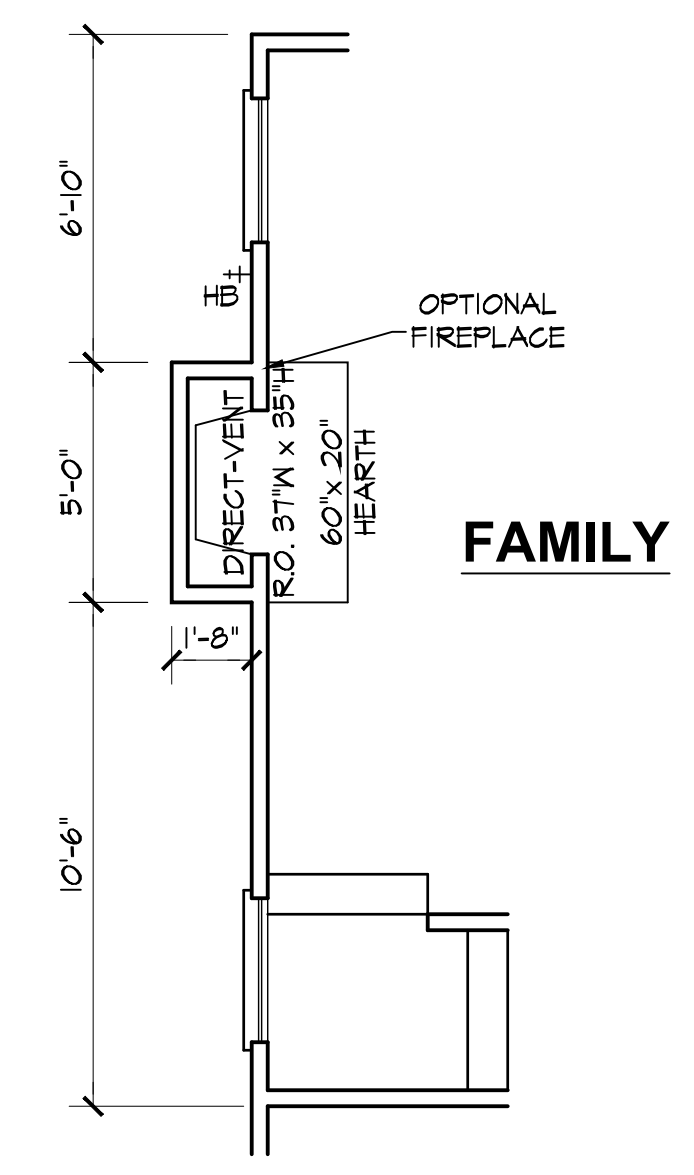

OPTIONAL FIREPLACE
 SEE FLOOR PLAN FOR TYPICAL NOTES & DIMENSIONS

| | |
|------------|-----------|
| DATE DRAWN | 11/8/2024 |
| PROJECT | 7188 |
| REVISIONS | |

The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

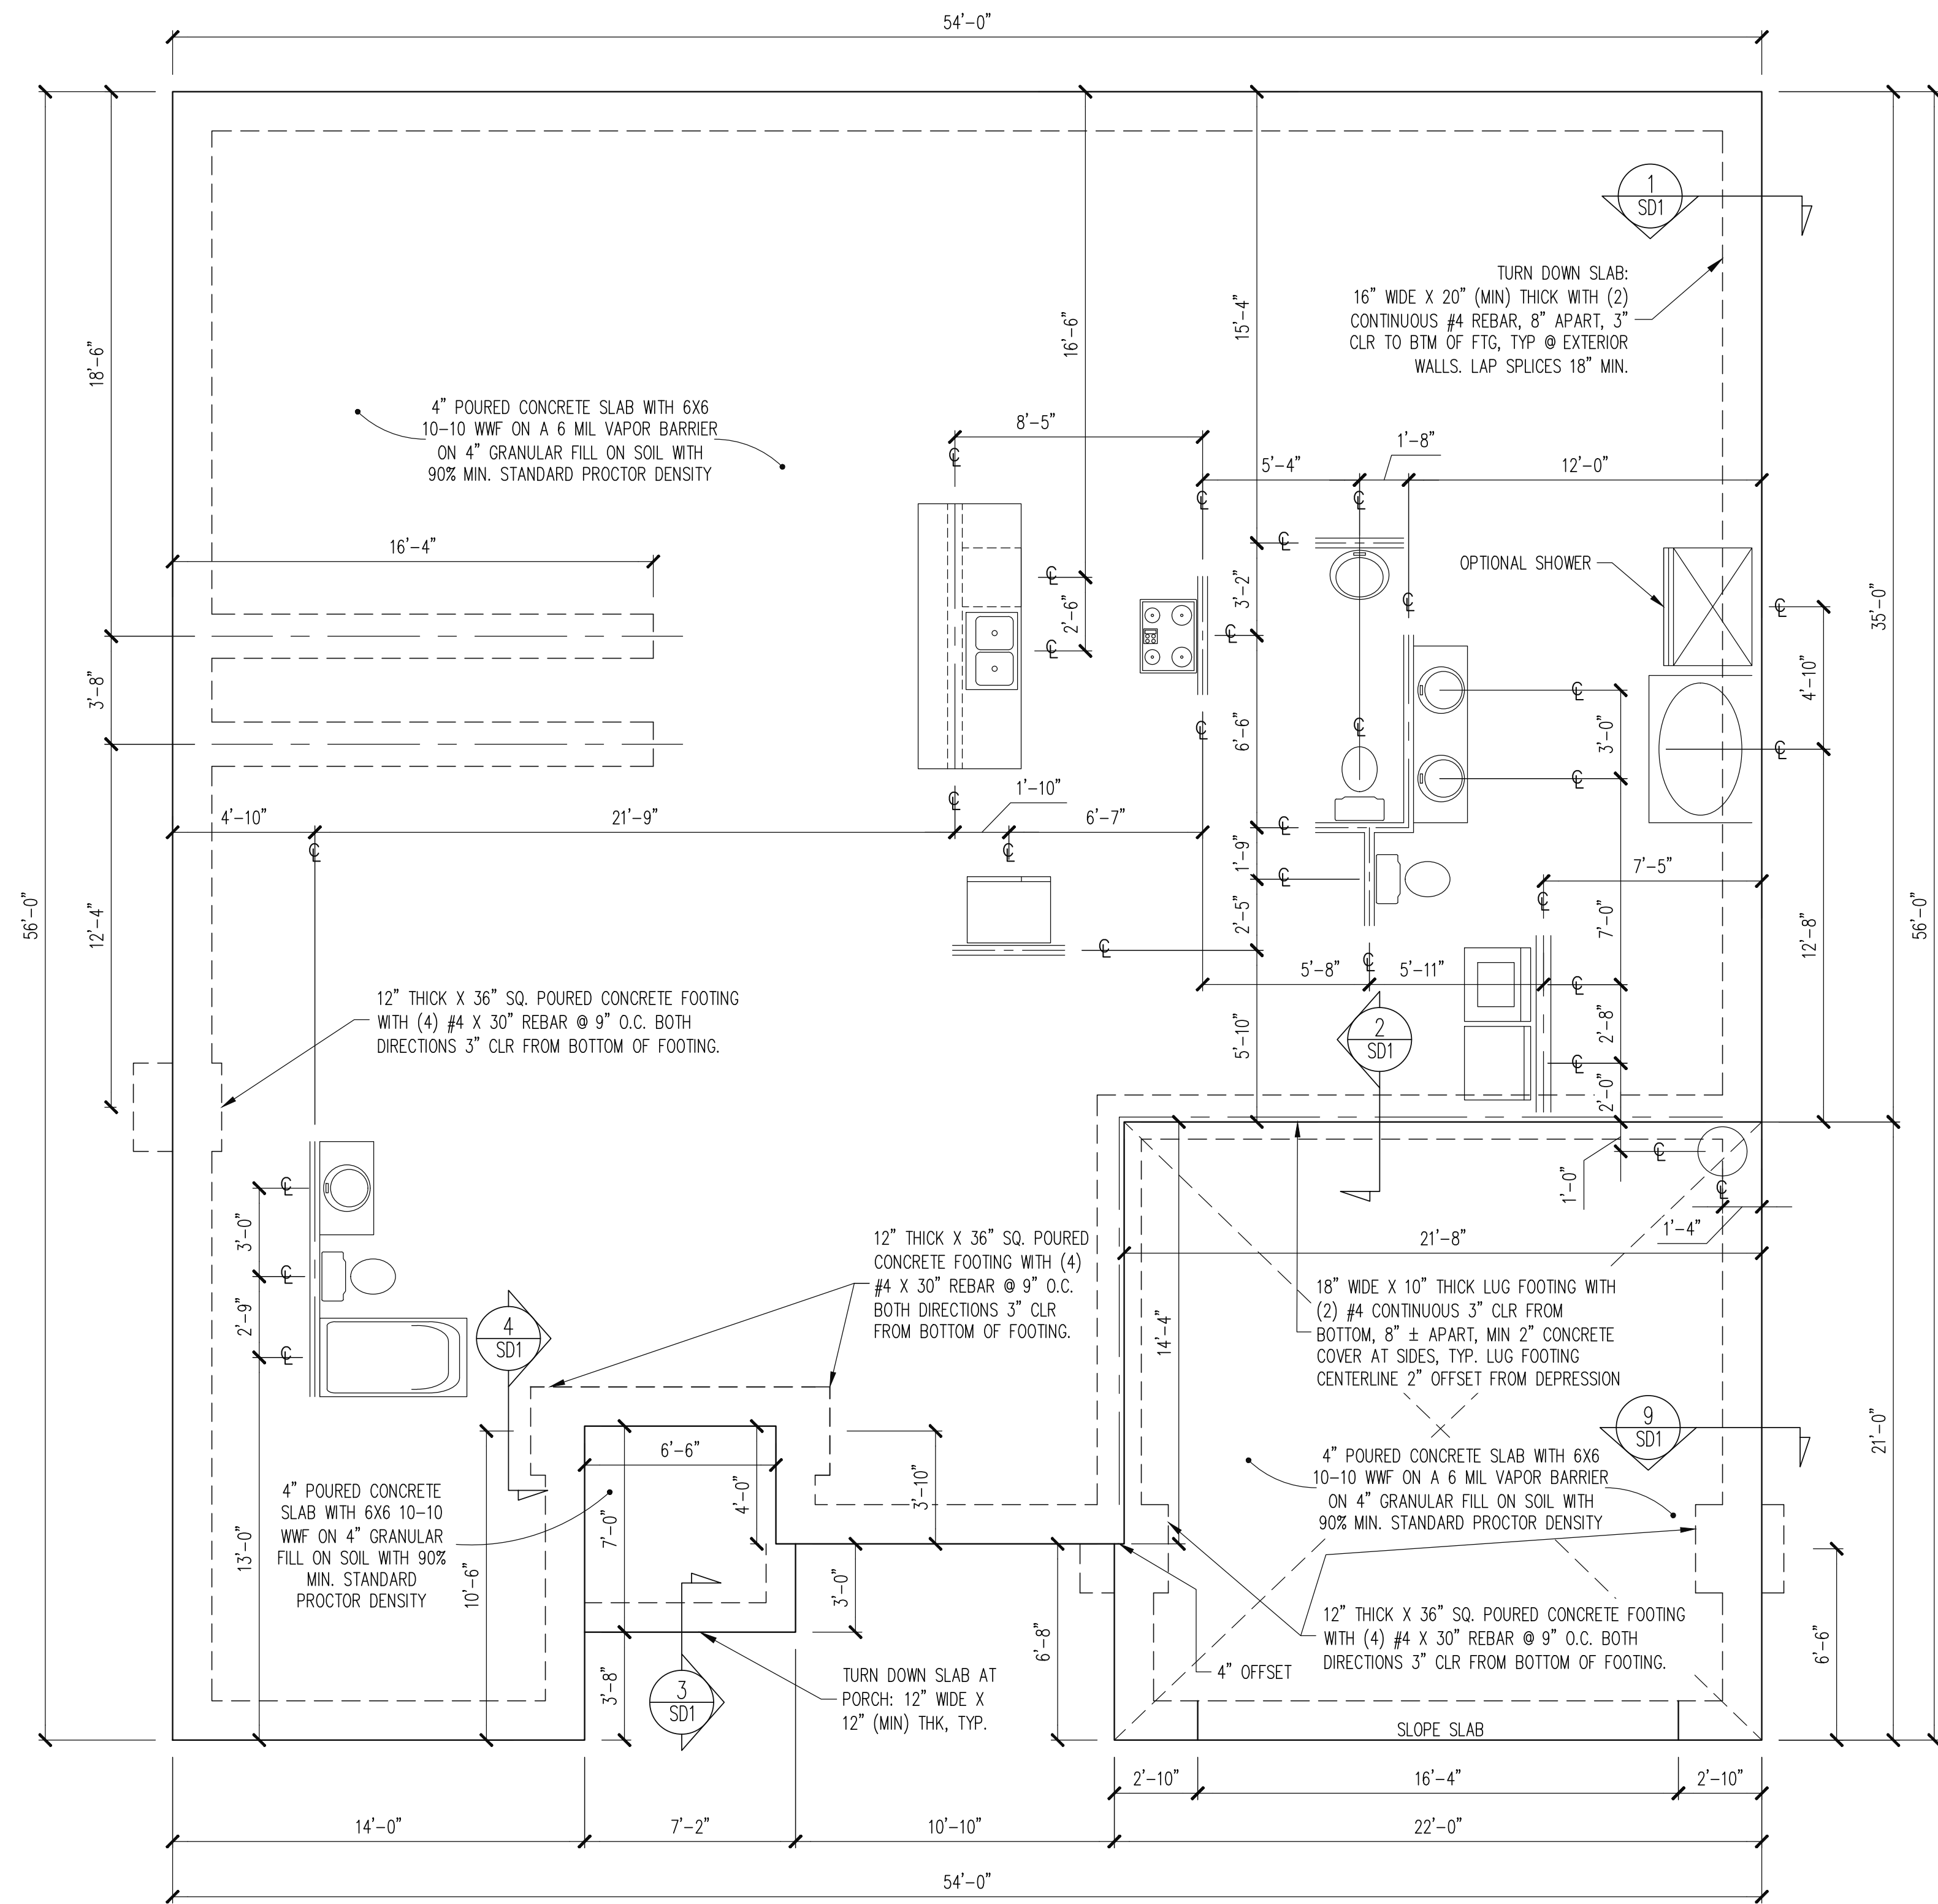

| FOUNDATION SCHEDULE | |
|---------------------|--|
| F1 | 12" THICK X 36" SQ. FOOTING WITH (4) #4 X 28" REBAR @ 9" O.C. BOTH DIRECTIONS 3" CLR FROM BOTTOM OF FOOTING |
| F2 | 18" WIDE X 10" THICK LUG FOOTING WITH (2) #4 CONTINUOUS 3" CLR FROM BOTTOM, 8" ± APART, MIN 2" CONCRETE COVER AT SIDES, TYP. |


NOTES:
-HEIGHT AND BACKFILL LIMITATIONS FOR FOUNDATION WALLS ARE TO BE GOVERNED BY THE NCSBC, LATEST EDITION.

PLAN DESIGNED UNDER
2018 NORTH CAROLINA
RESIDENTIAL CODE

NOTES:
-HEIGHT AND BACKFILL LIMITATIONS FOR FOUNDATION WALLS ARE TO BE GOVERNED BY THE NCSBC, LATEST EDITION.
-FIBER MESH REINFORCED CONCRETE MAY BE USED IN LIEU OF WELDED WIRE FABRIC. SEE SECTION 6.01 OF THE CONSTRUCTION SPECIFICATIONS FOR ALLOWABLE SUBSTITUTION DETAILS.
-ALL APPLIANCE AND PLUMBING LOCATIONS ARE FOR REFERENCE ONLY. FINAL LOCATIONS MUST BE VERIFIED WITH ARCHITECTURAL FLOOR PLANS.

ELEVATION A

FOUNDATION PLAN
MONO SLAB OPTION
1/4" = 1'-0"

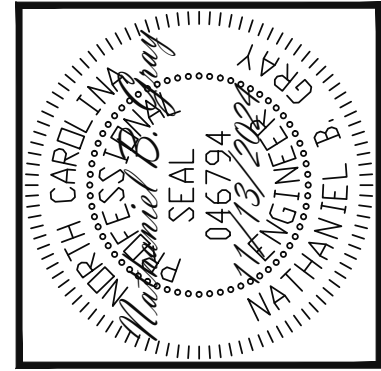

Engineering Tech Associates, P.A.
STRUCTURAL ENGINEERS
License No. C3870
318 W Millbrook Road, Unit 201
Raleigh, North Carolina 27609
Phone (919) 844-1661

| |
|---------------------|
| ADAMS HOMES |
| STRUCTURAL ADDENDUM |
| SCOPE: |
| LOT #: |
| 104 KIPLING CREEK |
| 3327 MASTER |


ENG: NBC/WHF
DATE: 11/13/2024

PLAN NO.
3327

PROJECT NO.
24-18-668

SHEET NO.
S1
1 of 6

The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

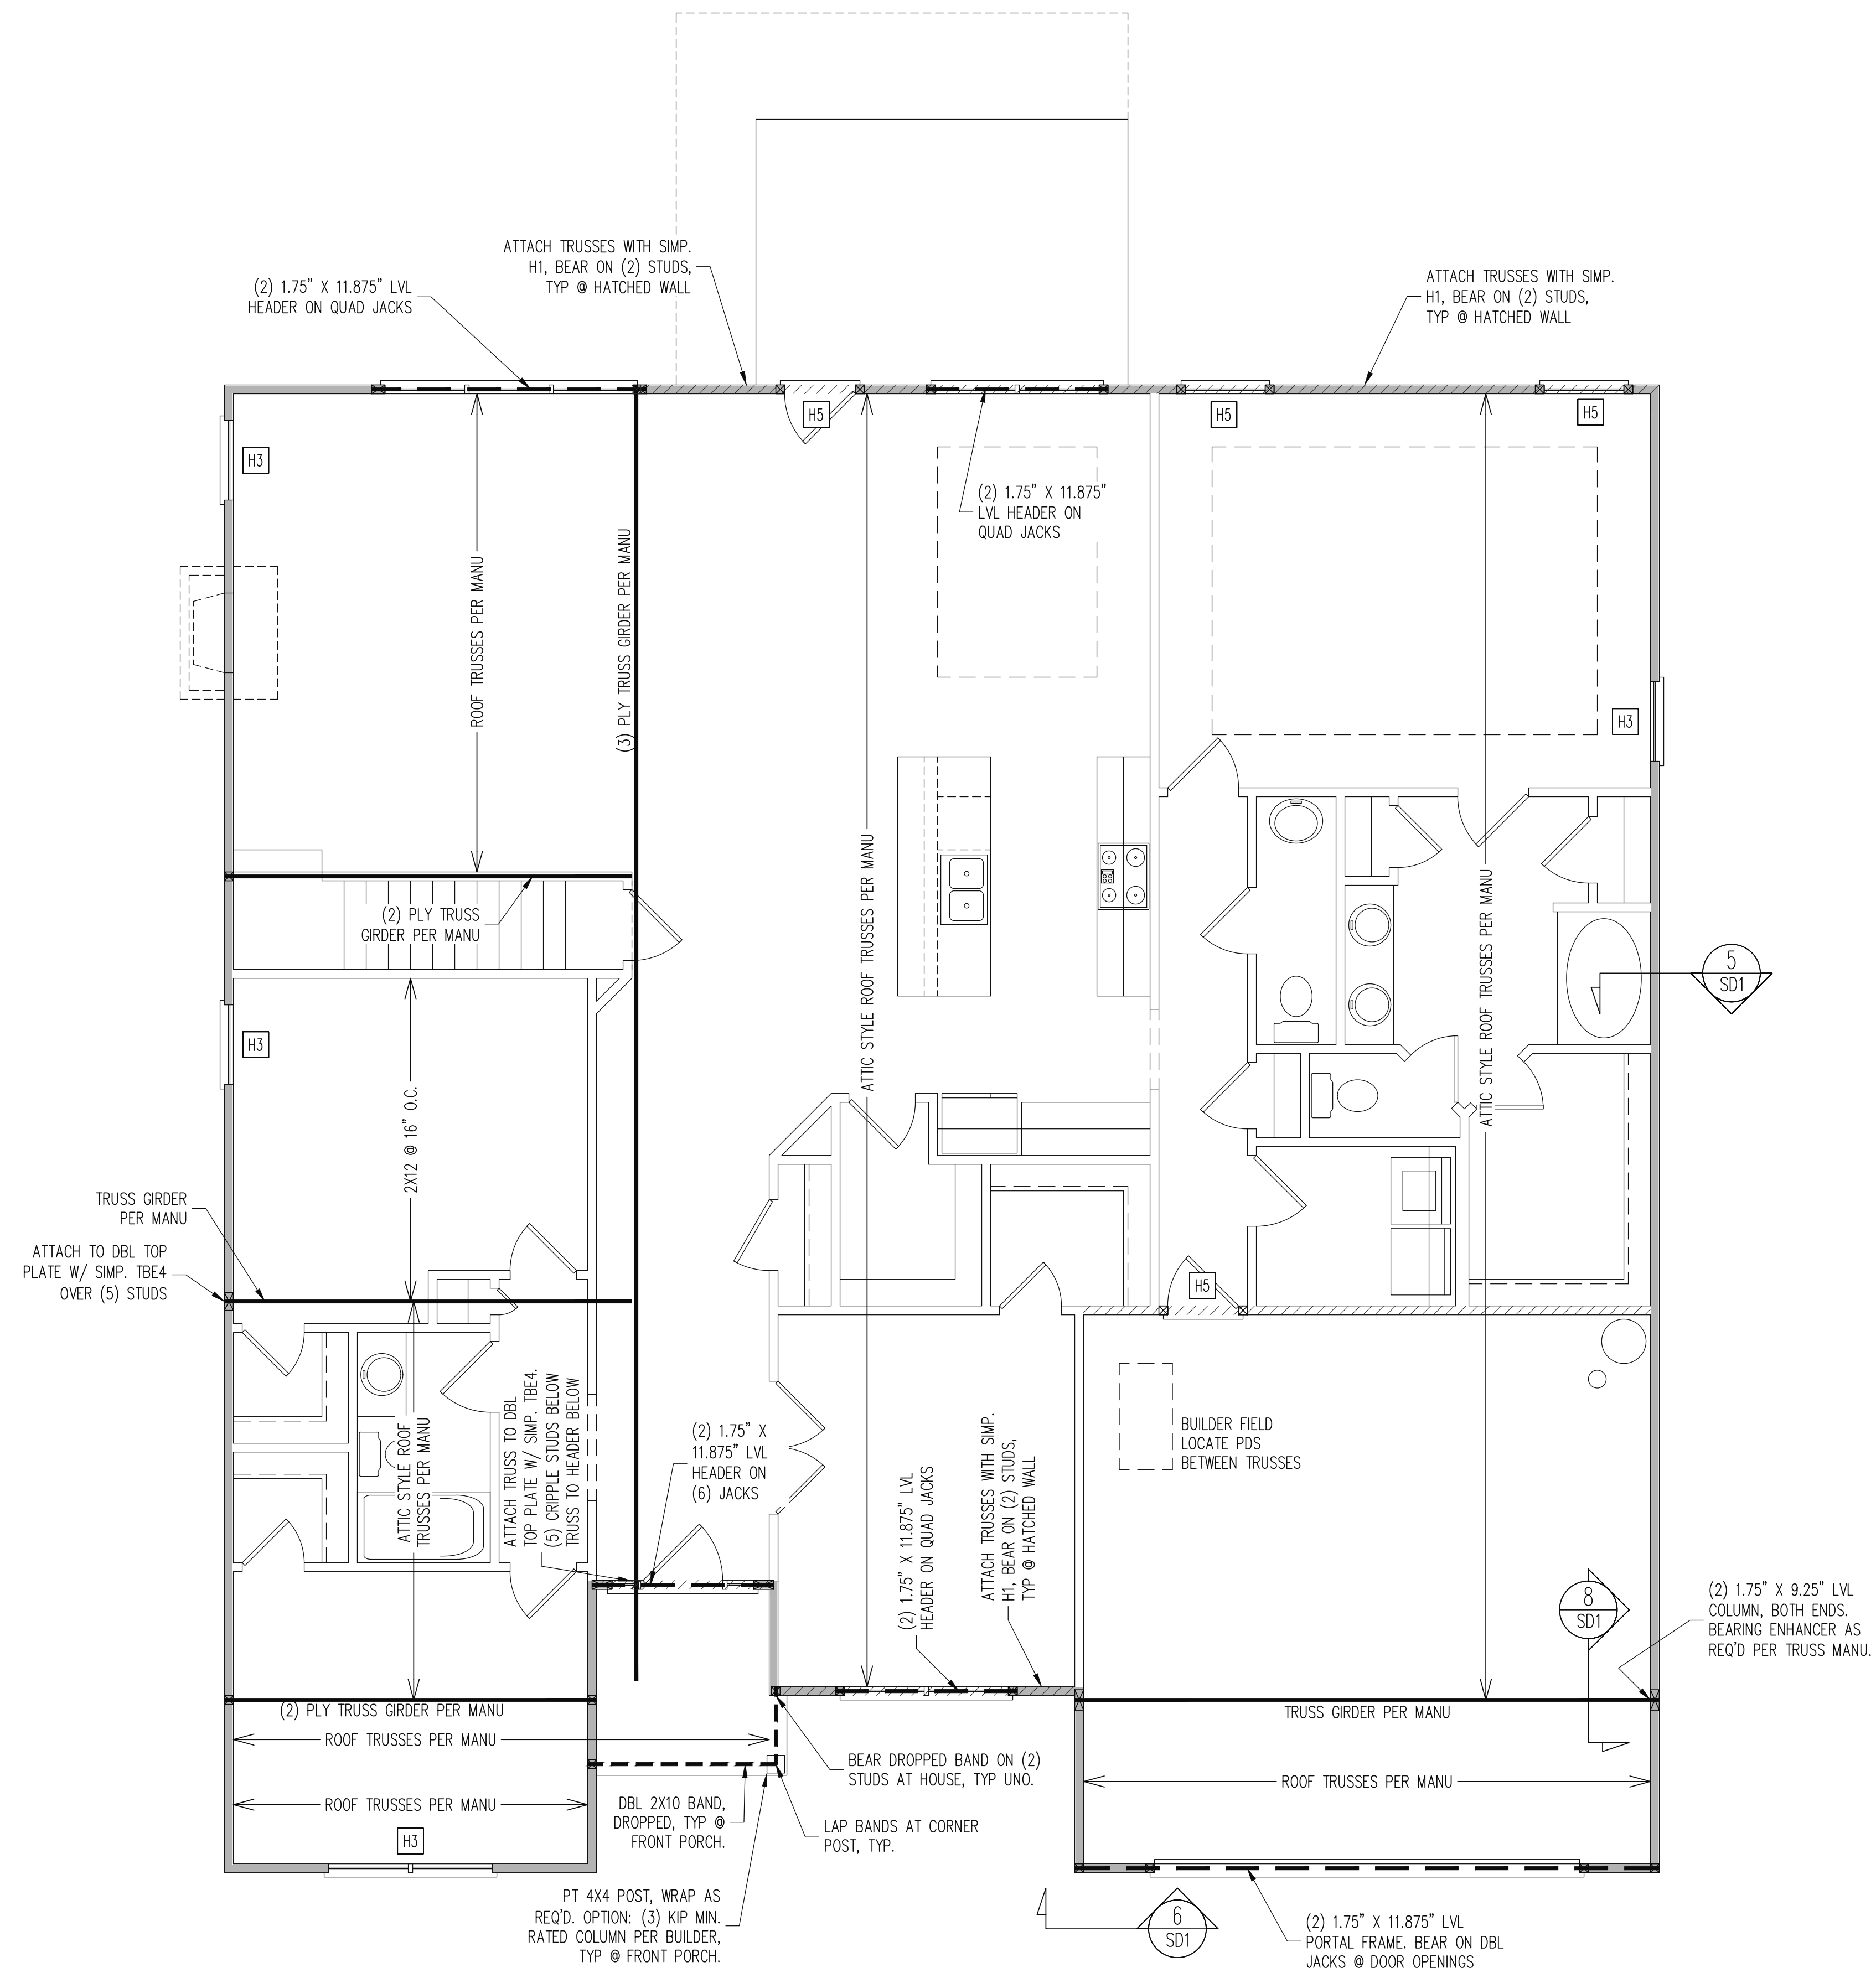

REQUIRED STUDS FOR BEAM SUPPORT

REFER TO SECTIONS 5.02 - 5.06 OF THE CONSTRUCTION SPECIFICATIONS FOR REQUIRED NUMBER OF STUDS FOR BEAM SUPPORT, TYP UNO.

HEADER SCHEDULE

- H1 SINGLE 2X4 TURNED FLAT (A)
 - H2 (2) 2X4'S ON SINGLE JACKS (B)
 - H3 (2) 2X10'S ON SINGLE JACKS (C)
 - H4 (2) 1.75" X 9.25" LVL'S ON DBL JACKS
 - H5 (2) 2X10'S ON DBL JACKS
-
- (A) TYPICAL FOR INTERIOR NON LOAD BEARING WALLS ONLY, ROUGH OPENING 38" MAX.
 - (B) TYPICAL FOR INTERIOR NON LOAD BEARING WALLS ONLY, ROUGH OPNG 38" TO 74" MAX.
 - (C) TYPICAL FOR ALL CONDITIONS NOT LISTED IN (A) OR (B) UNO.

NOTES:
 -HEADERS IN NON LOAD BEARING INTERIOR WALLS ARE NOT LABELED.
 -KING STUDS EXTERIOR WALLS:
 SINGLE KING STUDS FOR 6" MAX OPENINGS.
 DBL KING STUDS FOR 10" MAX OPENINGS.
 TRPL KING STUDS FOR 14" MAX OPENINGS.
 QUAD KING STUDS FOR 18" MAX OPENINGS.
 FOR 2X6 WALLS, ONE HALF THE AMOUNT OF KING STUDS REQUIRED (ROUND UP) UNO


WALL BRACING

ALL EXTERIOR STUD WALLS ARE TO BE CONTINUOUSLY SHEATHED WITH 7/16 APA RATED OSB NAILED TO STUDS WITH 8d NAILS @ 6" O.C. AT PANEL EDGES, 12" O.C. IN PANEL FIELD.

SINGLE JOIST, CONTINUOUS RIM JOIST, OR BLOCKING OF EQUAL DEPTH IS REQUIRED ABOVE AND BELOW ALL BRACED WALLS. NAIL BLOCKING ABOVE WALL TO TOP PLATE WITH 8d TOE NAILS @ 6" O.C. NAIL SOLE PLATE OF BRACED WALL TO BLOCKING BELOW WITH (3) 16d NAILS @ 16" O.C. BLOCKING AT HORIZONTAL JOINTS IN BRACED WALL LINES ONLY REQUIRED AT SHADED WALLS, UNO.

SHADED WALLS:

 PROVIDED CONTINUOUS SHEATHING = 255' MIN.
 -WALL BRACING IS BY ENGINEERED DESIGN AND NOT PRESCRIPTIVE PER SECTION 602.10 OF THE 2018 NCR. CONTINUOUS SHEATHING HAS BEEN PROVIDED, ALONG WITH ALTERNATIVE METHODS TO INSURE THE MINIMUM INTENT OF SECTION 602.10 OF THE 2018 NCR HAS BEEN MET AND EXCEEDED.

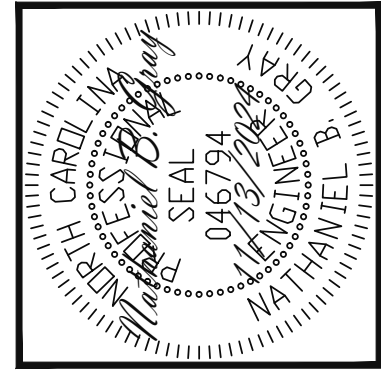

STRUCTURAL ENGINEERS
 License No. C3870
 318 W Millbrook Road, Unit 201
 Raleigh, North Carolina 27609
 Phone (919) 844-1661
Engineering Tech Associates, P.A.

ADAMS HOMES
 STRUCTURAL ADDENDUM
 SCOPE: 104 KIPLING CREEK
 LOT #: 3327 MASTER


ENG: NBC/WHF
 DATE: 11/13/2024
 PLAN NO.: 3327
 PROJECT NO.: 24-18-668
 SHEET NO.: S2
 2 of 6

ELEVATION A

1ST FLOOR FRAMING PLAN

WALLS AND CEILING
 1/4" = 1'-0"

The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

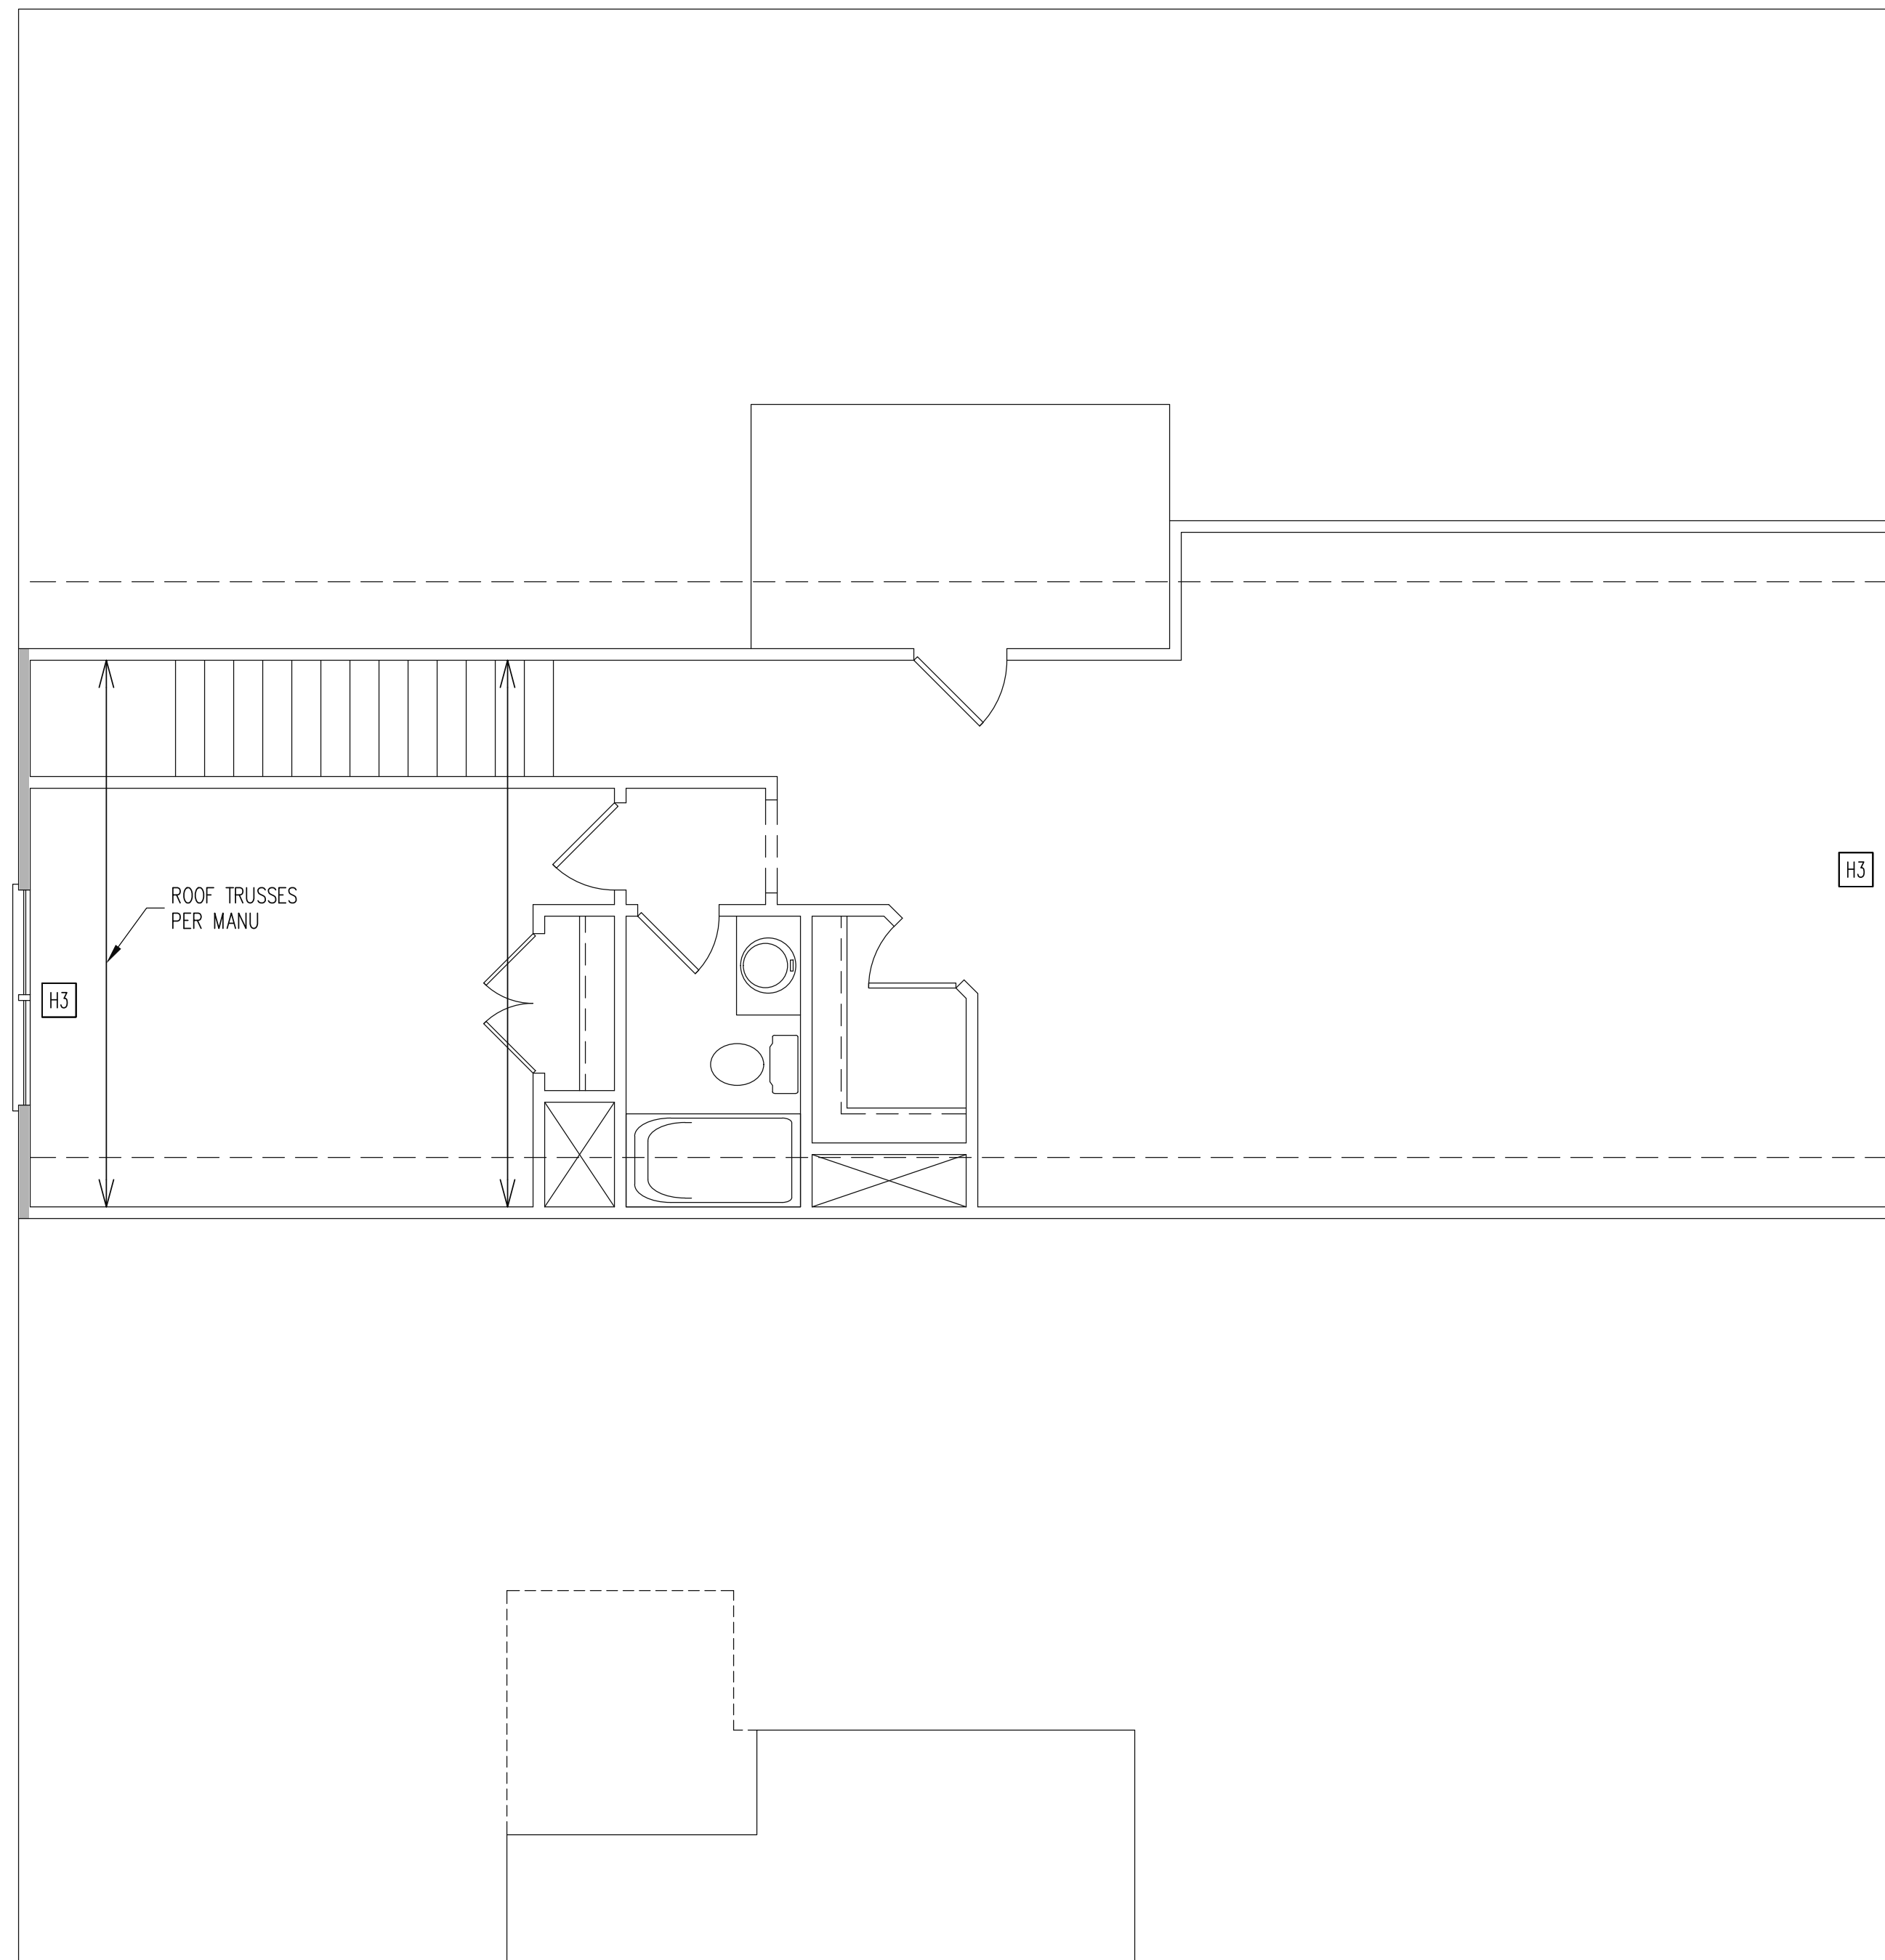

REQUIRED STUDS FOR BEAM SUPPORT

REFER TO SECTIONS 5.02 - 5.06 OF THE CONSTRUCTION SPECIFICATIONS FOR REQUIRED NUMBER OF STUDS FOR BEAM SUPPORT, TYP UNO.

HEADER SCHEDULE

- H1 SINGLE 2X4 TURNED FLAT (A)
- H2 (2) 2X4'S ON SINGLE JACKS (B)
- H3 (2) 2X10'S ON SINGLE JACKS (C)
- H4 (2) 1.75" X 9.25" LVL'S ON DBL JACKS
- H5 (3) 2X10'S ON SINGLE 2X6 JACKS
- H6 (3) 1.75" X 9.25" LVL'S ON DBL 2X6 JACKS

- (A) TYPICAL FOR INTERIOR NON LOAD BEARING WALLS ONLY, ROUGH OPENING 38" MAX.
- (B) TYPICAL FOR INTERIOR NON LOAD BEARING WALLS ONLY, ROUGH OPNG 38" TO 74" MAX.
- (C) TYPICAL FOR ALL CONDITIONS NOT LISTED IN (A) OR (B) UNO.

NOTES:
 -HEADERS IN NON LOAD BEARING INTERIOR WALLS ARE NOT LABELED.
 -KING STUDS EXTERIOR WALLS:
 SINGLE KING STUDS FOR 6" MAX OPENINGS.
 DBL KING STUDS FOR 10" MAX OPENINGS.
 TRPL KING STUDS FOR 14" MAX OPENINGS.
 QUAD KING STUDS FOR 18" MAX OPENINGS.
 FOR 2X6 WALLS, ONE HALF THE AMOUNT OF KING STUDS REQUIRED (ROUND UP) UNO


WALL BRACING

ALL EXTERIOR STUD WALLS ARE TO BE CONTINUOUSLY SHEATHED WITH 7/16 APA RATED OSB NAILED TO STUDS WITH 8d NAILS @ 6" O.C. AT PANEL EDGES, 12" O.C. IN PANEL FIELD.

SINGLE JOIST, CONTINUOUS RIM JOIST, OR BLOCKING OF EQUAL DEPTH IS REQUIRED ABOVE AND BELOW ALL BRACED WALLS. NAIL BLOCKING ABOVE WALL TO TOP PLATE WITH 8d TOE NAILS @ 6" O.C. NAIL SOLE PLATE OF BRACED WALL TO BLOCKING BELOW WITH (3) 16d NAILS @ 16" O.C. BLOCKING AT HORIZONTAL JOINTS IN BRACED WALL LINES ONLY REQUIRED AT SHADED WALLS, UNO.

SHADED WALLS:

 PROVIDED CONTINUOUS SHEATHING = 3/8" MIN.
 -WALL BRACING IS BY ENGINEERED DESIGN AND NOT PRESCRIPTIVE PER SECTION 602.10 OF THE 2018 NCRS. CONTINUOUS SHEATHING HAS BEEN PROVIDED, ALONG WITH ALTERNATIVE METHODS TO INSURE THE MINIMUM INTENT OF SECTION 602.10 OF THE 2018 NCRS HAS BEEN MET AND EXCEEDED.

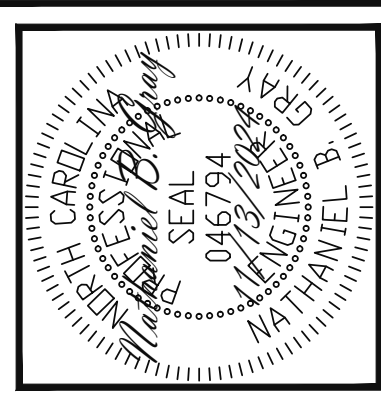

STRUCTURAL ENGINEERS
 License No. C-3870
 318 W Millbrook Road, Unit 201
 Raleigh, North Carolina 27609
 Phone (919) 844-1661
Engineering Tech Associates, P.A.

| | |
|-------------|---------------------|
| ADAMS HOMES | STRUCTURAL ADDENDUM |
| SCOPE: | 104 KIPLING CREEK |
| LOT #: | 3327 MASTER |

ENG: NBC/WHF
 DATE: 11/13/2024


PLAN NO.
 3327

PROJECT NO.
 24-18-668

SHEET NO.
 S3
 3 of 6

2ND FLOOR FRAMING PLAN

WALLS AND CEILING
 1/4" = 1'-0"

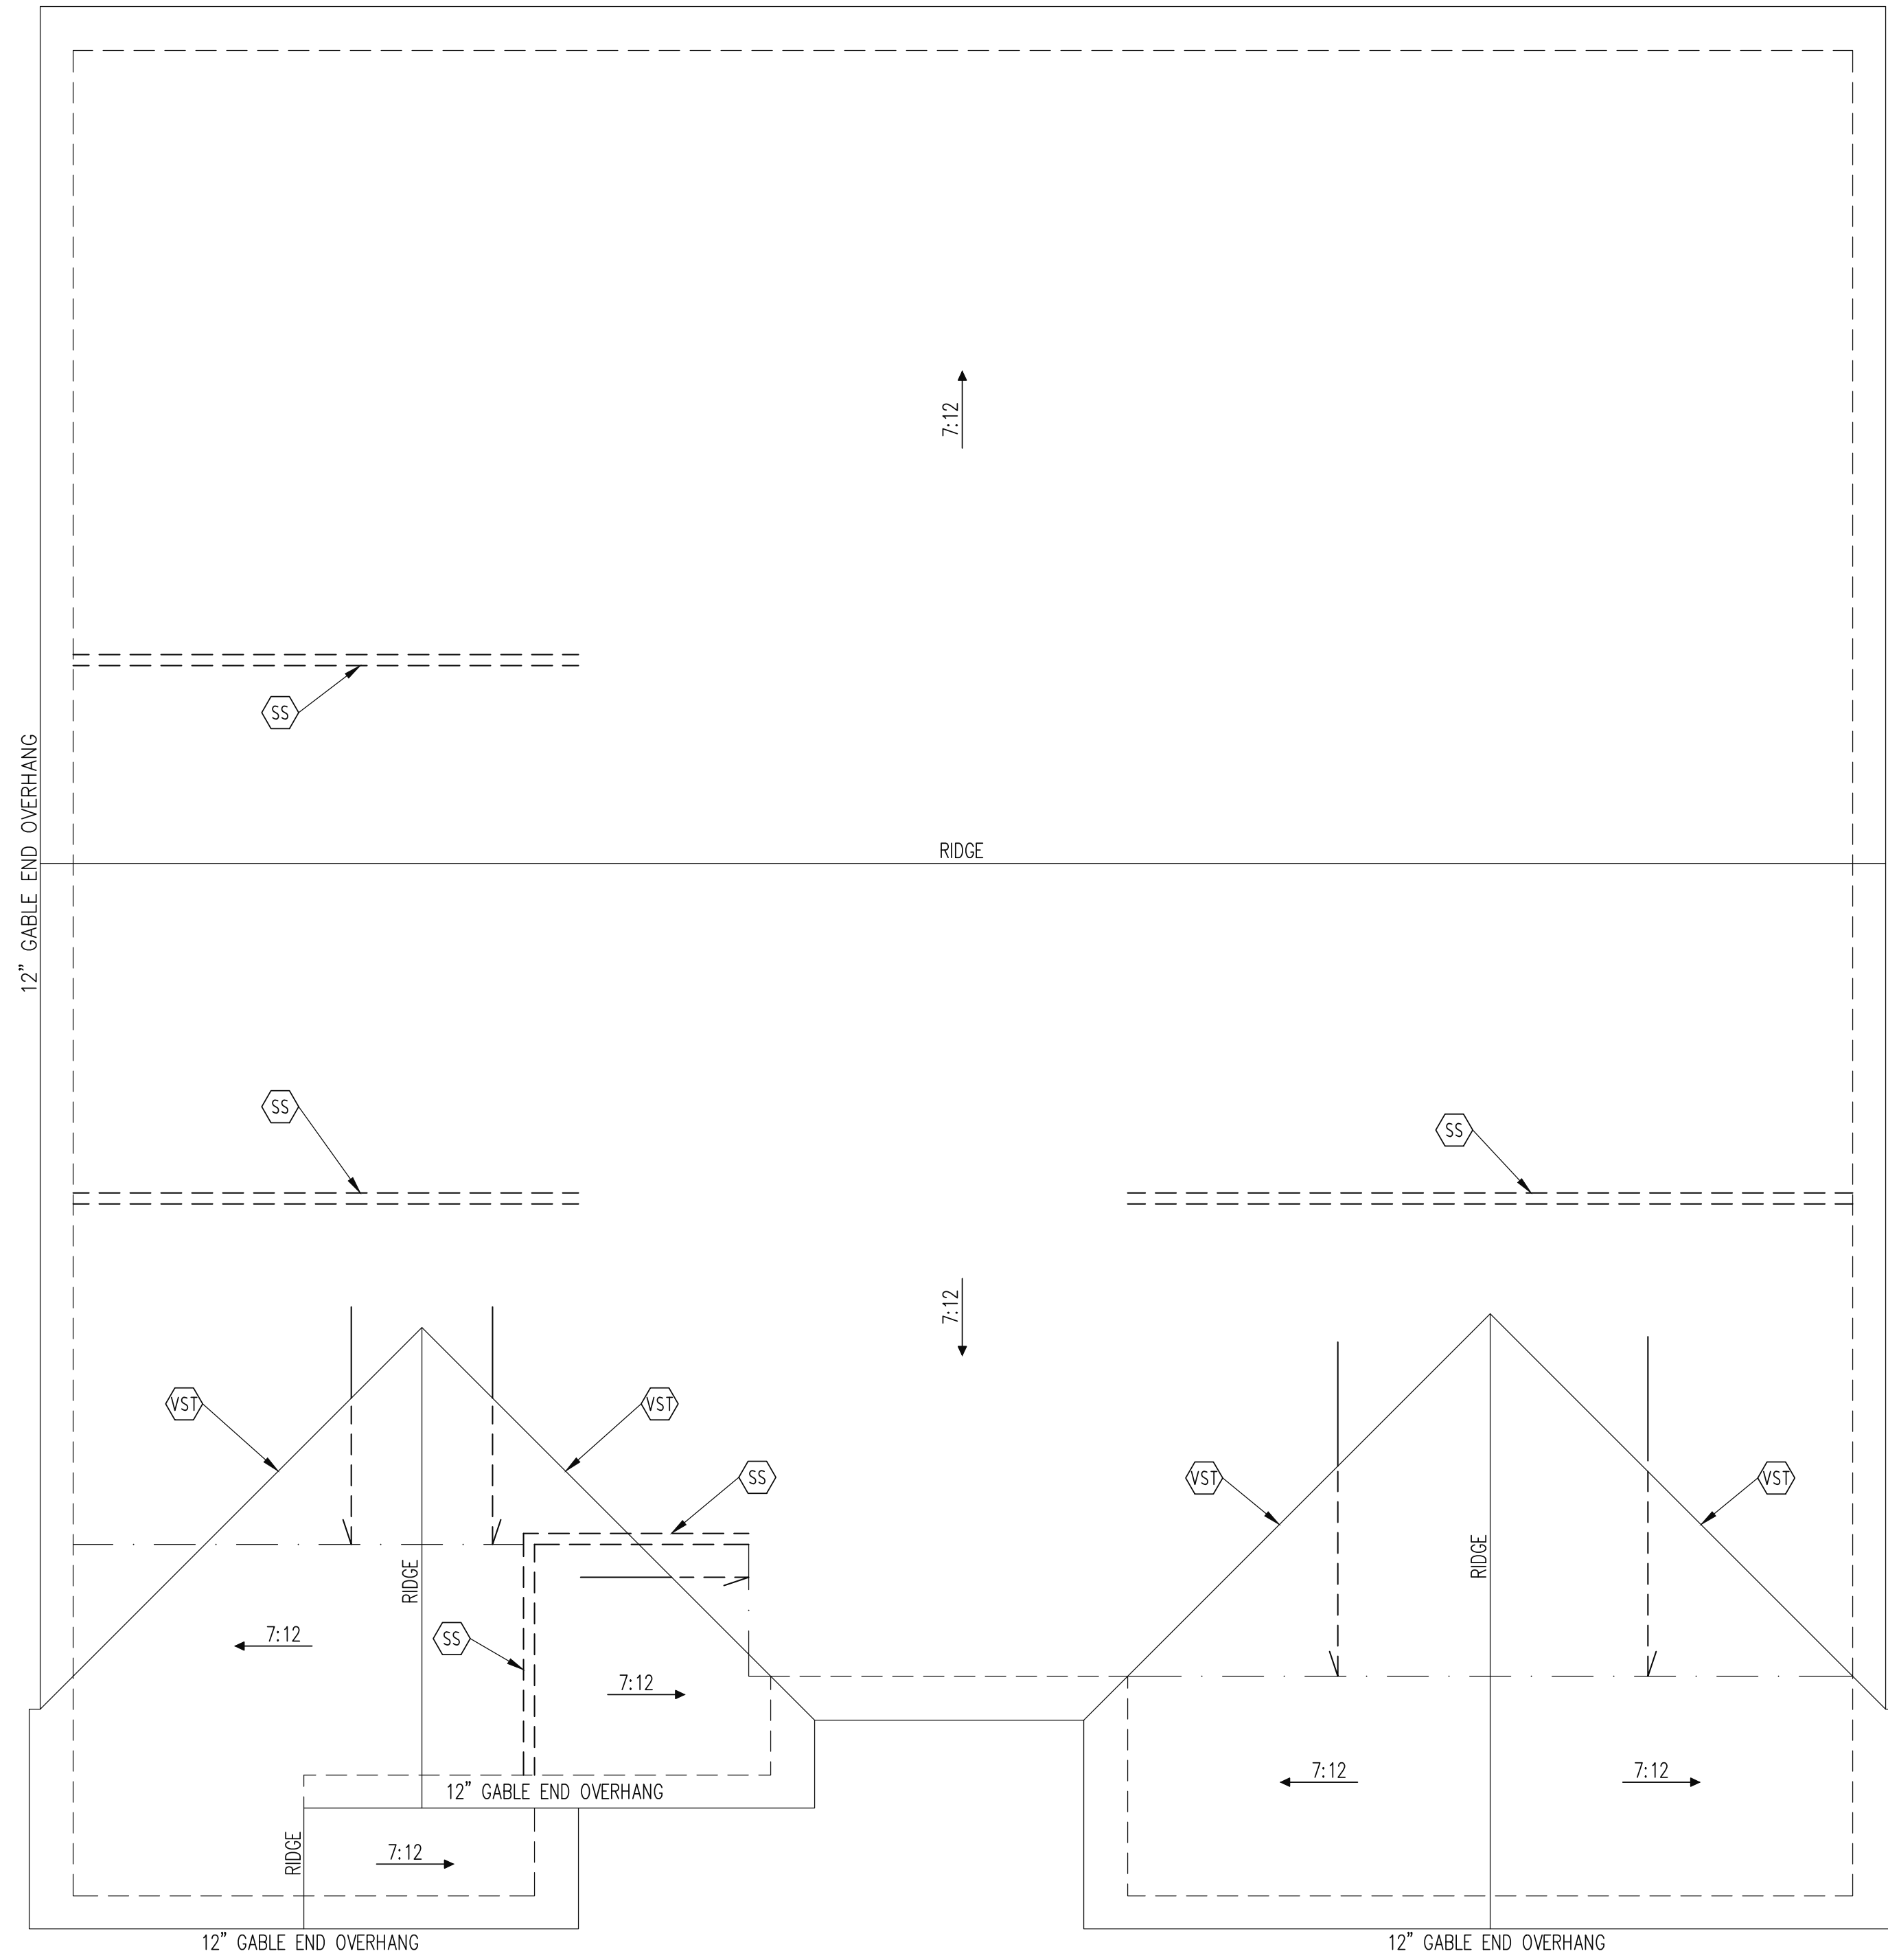

ELEVATION A


The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

TRUSS UPLIFT CONNECTORS
 EXPOSURE B, 120 MPH, ANY EXPOS. 24" O.C. MAX. ROOF TRUSS SPACING
 TRUSSES SHALL BE ATTACHED TO SUPPORT WALL FOR UPLIFT RESISTANCE. CONTINUOUS OSB WALL SHEATHING BELOW PROVIDES CONTINUOUS UPLIFT RESISTANCE TO FOUNDATION. ALL TRUSSES ATTACHED TO BEAMS SHALL BE ATTACHED TO SUPPORTING MEMBER PER SCHEDULE BELOW.
 ROOF SPAN IS MEASURED HORIZONTALLY BETWEEN FURTHEST SUPPORT POINTS.
 CONNECTOR NAILING PER TABLE 602.3(1) NRCBC 2018 EDITION
 OVER 18' (1) SIMPSON HZ-54 HURRICANE CLIP TO DBL. TOP PLATE OR BEAM

FRAMING SCHEDULE
 ROOF ONLY
 AN SUPPORT BRICK VENEER WITH ANGLE ATTACHED TO MODIFIED STUD WALL
 BR SUPPORT BRICK VENEER PER SECT.703.7 OF THE NCRG, LATEST EDITION.
 VST VALLEY SET TRUSSES PER MANU
 SS SUPPORT TRUSSES ON WALL BELOW

FRAMING NOTES
 ROOF ONLY
 -ROOF TRUSSES PER MANU. TYPICAL U.N.O.
 -ROOF PITCHES 7:12 TYP U.N.O.
 -VERIFY ALL KNEEWALL HEIGHTS, ROOF PITCHES, AND ARCHITECTURAL OVERHANGS PRIOR TO CONSTRUCTION

ROOF FRAMING PLAN
 1/4" = 1'-0"

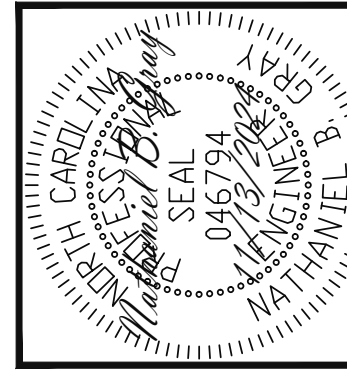

Engineering Tech Associates, P.A.
 STRUCTURAL ENGINEERS
 License No. C-3870
 318 W Millbrook Road, Unit 201
 Raleigh, North Carolina 27609
 Phone (919) 844-1661

ADAMS HOMES
 STRUCTURAL ADDENDUM
 SCOPE: 104 KIPLING CREEK
 LOT #: 3327 MASTER

ENG: NBC/WHF
 DATE: 11/13/2024

PLAN NO.
 3327

PROJECT NO.
 24-18-668

SHEET NO.
 S4

4 of 6

CONSTRUCTION SPECIFICATIONS

PART 1: GENERAL

- CONSTRUCTION SHALL MEET THE REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.
- STRUCTURAL STEEL SHALL MEET THE REQUIREMENTS OF THE AISC SPECIFICATION FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS.
- REINFORCED CAST IN PLACE CONCRETE SHALL BE PROPORTIONED, MIXED AND PLACED IN ACCORDANCE WITH THE SPECIFICATIONS OF ACI 318, LATEST EDITION.
- MASONRY CONSTRUCTION SHALL CONFORM TO THE SPECIFICATIONS OF ACI 530-95, LATEST EDITION.
- METHODS, PROCEDURES AND SEQUENCES OF CONSTRUCTION ARE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO MAINTAIN AND INSURE THE INTEGRITY OF THE STRUCTURE AT ALL STAGES OF CONSTRUCTION.

PART 2: DIMENSIONS

- DIMENSIONS SHOWN SHALL GOVERN OVER SCALE ON THESE DRAWINGS.

PART 3: DESIGN LOADS

| USE | LIVE LOAD (PSF) | DEAD LOAD (PSF) |
|---|-----------------|--------------------|
| BALCONIES, DECKS, ATTICS WITH FIXED STAIR ACCESS, DWELLING UNITS (INCLUDING SLEEPING ROOMS), ATTICS WITH FIXED STAIR ACCESS, STAIRS, FIRE ESCAPES | 40 | 10 |
| GARAGES (PASSENGER CARS ONLY) | 50 | --- |
| ATTICS (NO STORAGE, LESS THAN 5' HEADROOM) | 10 | 10 |
| ATTICS (WITH STORAGE) | 20 | 10 |
| ROOF | 20 | 10 (15 FOR VAULTS) |

- NOTES: - INDIVIDUAL STAIR TREADS ARE TO BE DESIGNED FOR THE UNIFORMLY DISTRIBUTED LIVE LOAD OR A 300 LB. CONCENTRATED LOAD ACTING OVER AN AREA OF 4 SQ. IN., WHICHEVER PROVIDES THE GREATER STRESS.
- CHAIR RAILS AND HAND RAILS ARE TO BE DESIGNED FOR A SINGLE CONCENTRATED LOAD OF 200 LB. APPLIED IN ANY DIRECTION AT ANY POINT ALONG THE TOP.
- BUILDER TO VERIFY DEAD LOAD DOES NOT EXCEED 10 PSF WHEN HEAVY FLOOR OR ROOF FINISHES SUCH AS TILE OR SLATE ARE UTILIZED.

- INTERIOR WALLS: 5 PSF LATERAL.
- BASIC WIND DESIGN VELOCITY OF 120 MPH.
- LOAD DURATION FACTOR FOR ROOF STRUCTURAL MEMBERS IS 1.15.
- SOIL BEARING CAPACITY 2000 PSF (PRESUMPTIVE).

PART 4: MATERIALS

- STRUCTURAL STEEL SQUARE AND RECTANGULAR TUBING SHALL CONFORM TO ASTM A500 GRADE B MINIMUM GRADE. ALL OTHER STRUCTURAL STEEL SHALL CONFORM TO ASTM A992 MINIMUM GRADE TYP. UNO.
- REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615 GRADE 60 TYP UNO.
- SOLID SAWN WOOD FRAMING DESIGN IS BASED ON NO. 2 SPRUCE PINE FIR FOR JOISTS, RAFTERS, WOOD GIRDERS/BEAMS, STUDS, ETC. ALLOWANCE HAS BEEN MADE FOR STP #2 SUBSTITUTION TYP. UNO.
- LVL OR PSL MINIMUM ALLOWABLE DESIGN STRESSES ARE AS FOLLOWS:
E= 1.9 X 10⁶ PSI, F_b = 2600 PSI, F_v = 285 PSI, F_c = 750 PSI
- LSL MINIMUM ALLOWABLE DESIGN STRESSES ARE AS FOLLOWS:
E= 1.3 X 10⁶ PSI, F_b = 1700 PSI, F_v = 400 PSI, F_c = 680 PSI
- BOLTS SHALL CONFORM TO ASTM A307 MINIMUM GRADE TYP UNO.
- WELDING ELECTRODES SHALL BE E70XX
- LUMBER IN CONTACT WITH THE GROUND, CONCRETE OR MASONRY SHALL BE PRESSURE TREATED IN ACCORDANCE WITH ANPA STANDARD C-15. ALL OTHER EXPOSED LUMBER SHALL BE TREATED IN ACCORDANCE WITH ANPA STANDARD C-2 OR BY ANY METHOD GIVING EQUAL PROTECTION. THE BUILDING CODE OFFICE MAY ALSO APPROVE A NATURAL DECAY RESISTANT WOOD PER SECTION 19-6(A).









- CAST IN PLACE CONCRETE SHALL BE OF NORMAL WEIGHT AND SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS TYP. UNO.
- CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C 90 OR ASTM C 55.
- MORTAR SHALL BE TYPE S CONFORMING TO ASTM C 476.
- NAILS SHALL BE COMMON WIRE NAILS TYP. UNO.
- LAG SCREWS SHALL CONFORM TO ANS/ASME STANDARD B18.21-1981.

PART 5: CONSTRUCTION

- FLITCH PLATE BEAMS SHALL CONSIST OF A CONTINUOUS STEEL PLATE BOLTED BETWEEN TWO PIECES OF CONTINUOUS LUMBER AS SIZED ON THE PLANS. BOLT PIERCES TOGETHER USING 1/2" # BOLTS STAGGERED AT 24" O.C. STAGGERED 10" TO BOTTOM OF THE BEAM. MAINTAIN A 2" EDGE DISTANCE. PLACE TWO BOLTS, ONE ABOVE THE OTHER, 6" FROM EACH END OF THE BEAM.
- STEEL, LVL, AND FLITCH PLATE BEAMS BEARING ON A STUD WALL PERPENDICULAR TO THE BEAM SHALL BEAR FULL WIDTH ON THE SUPPORTING WALL INDICATED AND SHALL BE SUPPORTED BY A MINIMUM OF THREE GANGED STUDS, OR A GANGED STUD COLUMN WITH A NUMBER OF STUDS SUCH THAT THE STUD COLUMN IS AT LEAST AS WIDE AS THE BEAM BEING SUPPORTED, WHICHEVER IS GREATER, TYP. UNO.
- STEEL, LVL, AND FLITCH PLATE BEAMS BEARING ONTO THE END OF A STUD WALL PARALLEL TO THE BEAM SHALL BEAR A MINIMUM OF 4 1/2" ONTO THE WALL AND BE SUPPORTED BY A TRIPLE STUD GANGED COLUMN TYP. UNO.
- SOLID SAWN LUMBER GANGED BEAMS BEARING ON A STUD WALL PERPENDICULAR TO THE BEAM SHALL BEAR FULL WIDTH ON THE SUPPORTING WALL INDICATED (LESS 1 1/2" TO ALLOW FOR A CONTINUOUS RM JOIST) AND SHALL BE SUPPORTED BY A TRIPLE STUD GANGED COLUMN TYP. UNO.
- SOLID SAWN LUMBER GANGED BEAMS BEARING ONTO THE END OF A STUD WALL PARALLEL TO THE BEAM SHALL BEAR A MINIMUM OF 5" ONTO THE WALL AND BE SUPPORTED BY A TRIPLE STUD GANGED COLUMN TYP. UNO.
- EXTRA JOISTS OR SINGLE LVL MEMBERS OF 1 1/2" OR LESS WIDTH, BEARING ON A STUD WALL PERPENDICULAR TO THE BEAM SHALL BEAR ON THE WALL A MINIMUM OF 2" AND SHALL BE SUPPORTED BY ONE ADDITIONAL STUD.
- SOLID SAWN LUMBER JOISTS THAT ARE GANGED TO FORM A BEAM SHALL HAVE ADJACENT MEMBERS IN THE BEAM NAILED TOGETHER WITH THREE ROWS OF 10d NAILS @ 16" O.C.
- LVL MEMBERS THAT ARE GANGED TO FORM A BEAM SHALL HAVE ADJACENT MEMBERS IN THE BEAM FASTENED TOGETHER PER MANUFACTURERS RECOMMENDATIONS, TYP. UNO.
- STUDS THAT ARE GANGED TO FORM A COLUMN SHALL HAVE ADJACENT STUDS WITHIN THE COLUMN NAILED TOGETHER WITH ONE ROW OF 10d NAILS AT 8" O.C. (TWO ROWS OF 10d NAILS @ 8" O.C., 3" APART, FOR 2X8 OR 2X10 STUDS) ALL COLUMNS SHALL BE CONTINUOUS DOWN TO THE FOUNDATION OR OTHER PROPERLY DESIGNED STRUCTURAL ELEMENT SUCH AS A BEAM. COLUMNS TRANSFERRING LOADS THROUGH FLOOR LEVELS SHALL BE SOLIDLY BLOCKED FOR THE FULL WIDTH OF THE STUD COLUMN WITHIN THE CAVITY FORMED BY THE FLOOR JOISTS.
- STUD WALLS SHALL CONSIST OF 2X4 STUDS SPACED AT 16" O.C. UNO. STUDS SHALL BE CONTINUOUS FROM SOLE PLATE AT FLOOR TO DOUBLE TOP PLATE AT THE CEILING OR ROOF. NO INTERMEDIATE BANDS OR PLATES SHALL CAUSE DISCONTINUITIES IN A STUD WALL EXCEPT AS REQUIRED FOR DOOR OR WINDOW OPENINGS. THE KING STUDS FOR SUCH OPENINGS SHALL BE CONTINUOUS.
- PILOT HOLES SHALL BE USED FOR LAG SCREW INSTALLATION AND SHALL BE BORED ACCORDING TO NDS SPECIFICATIONS.
- ALL WELDING SHALL BE PERFORMED BY AN AWS CERTIFIED WELDER
- ALL CONCRETE, INCLUDING CONCRETE FOR FOOTINGS, IS TO BE CAST IN PLACE, TYP. UNO.
- BOLTS AND LAG SCREWS USED FOR BOLTING WOOD MEMBERS SHALL HAVE STANDARD WASHERS INSTALLED FOR THE NUTS AND BOLT / SCREW HEADS

PART 6: SUBSTITUTIONS

- IN LIEU OF SUBSTITUTED MEMBER IN SLABS: SYNTHETIC POLYPROPYLENE FIBRILLATED MICRO FIBERS, FIBER LENGTH 1 1/2", DOSAGE RATE 1 1/2 LBS./CU. YD.
- OTHER MATERIAL OR MEMBER SIZE SUBSTITUTIONS REQUIRE THE WRITTEN AUTHORIZATION OF THE DESIGNER. UNAUTHORIZED DEVIATIONS ARE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

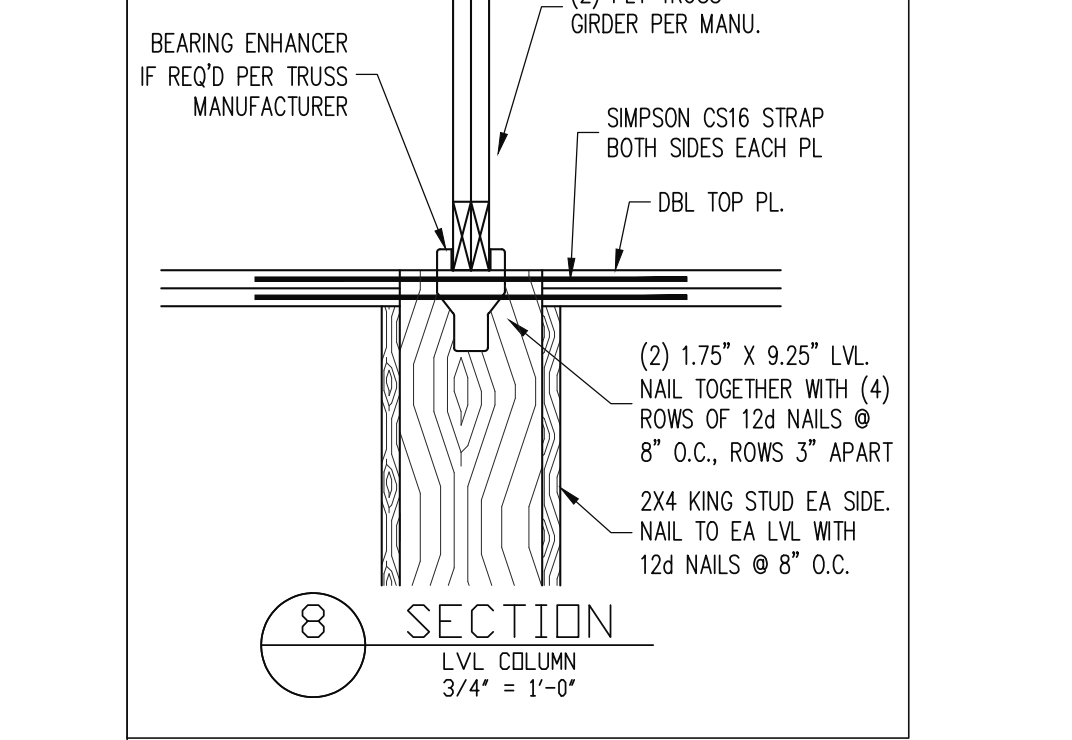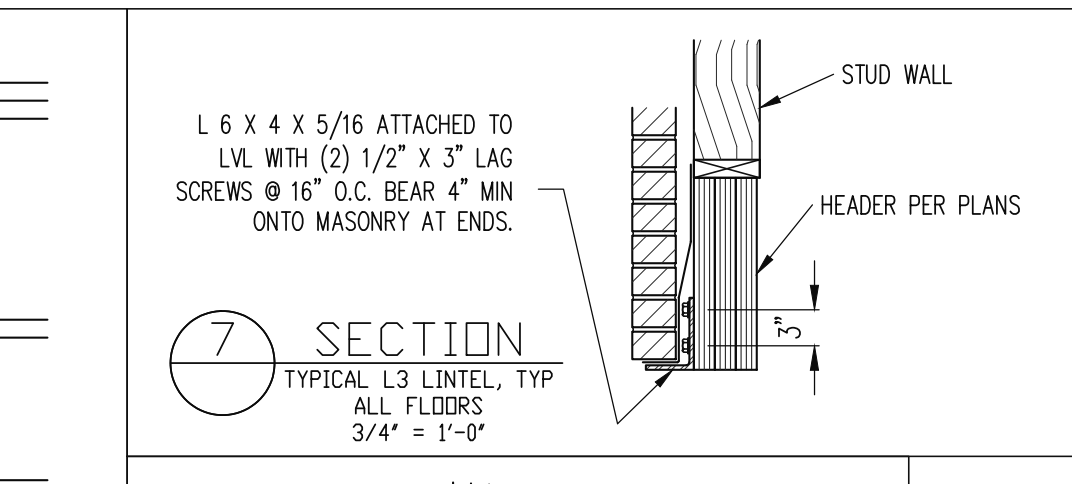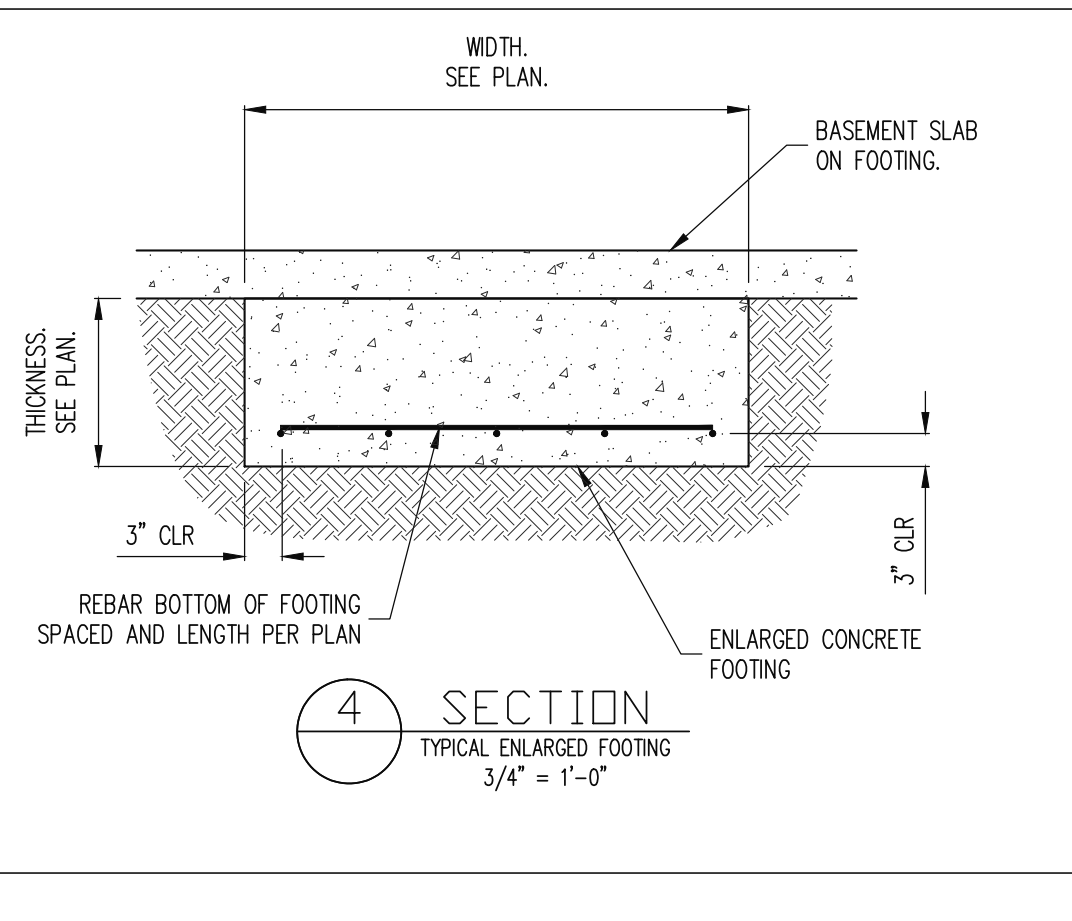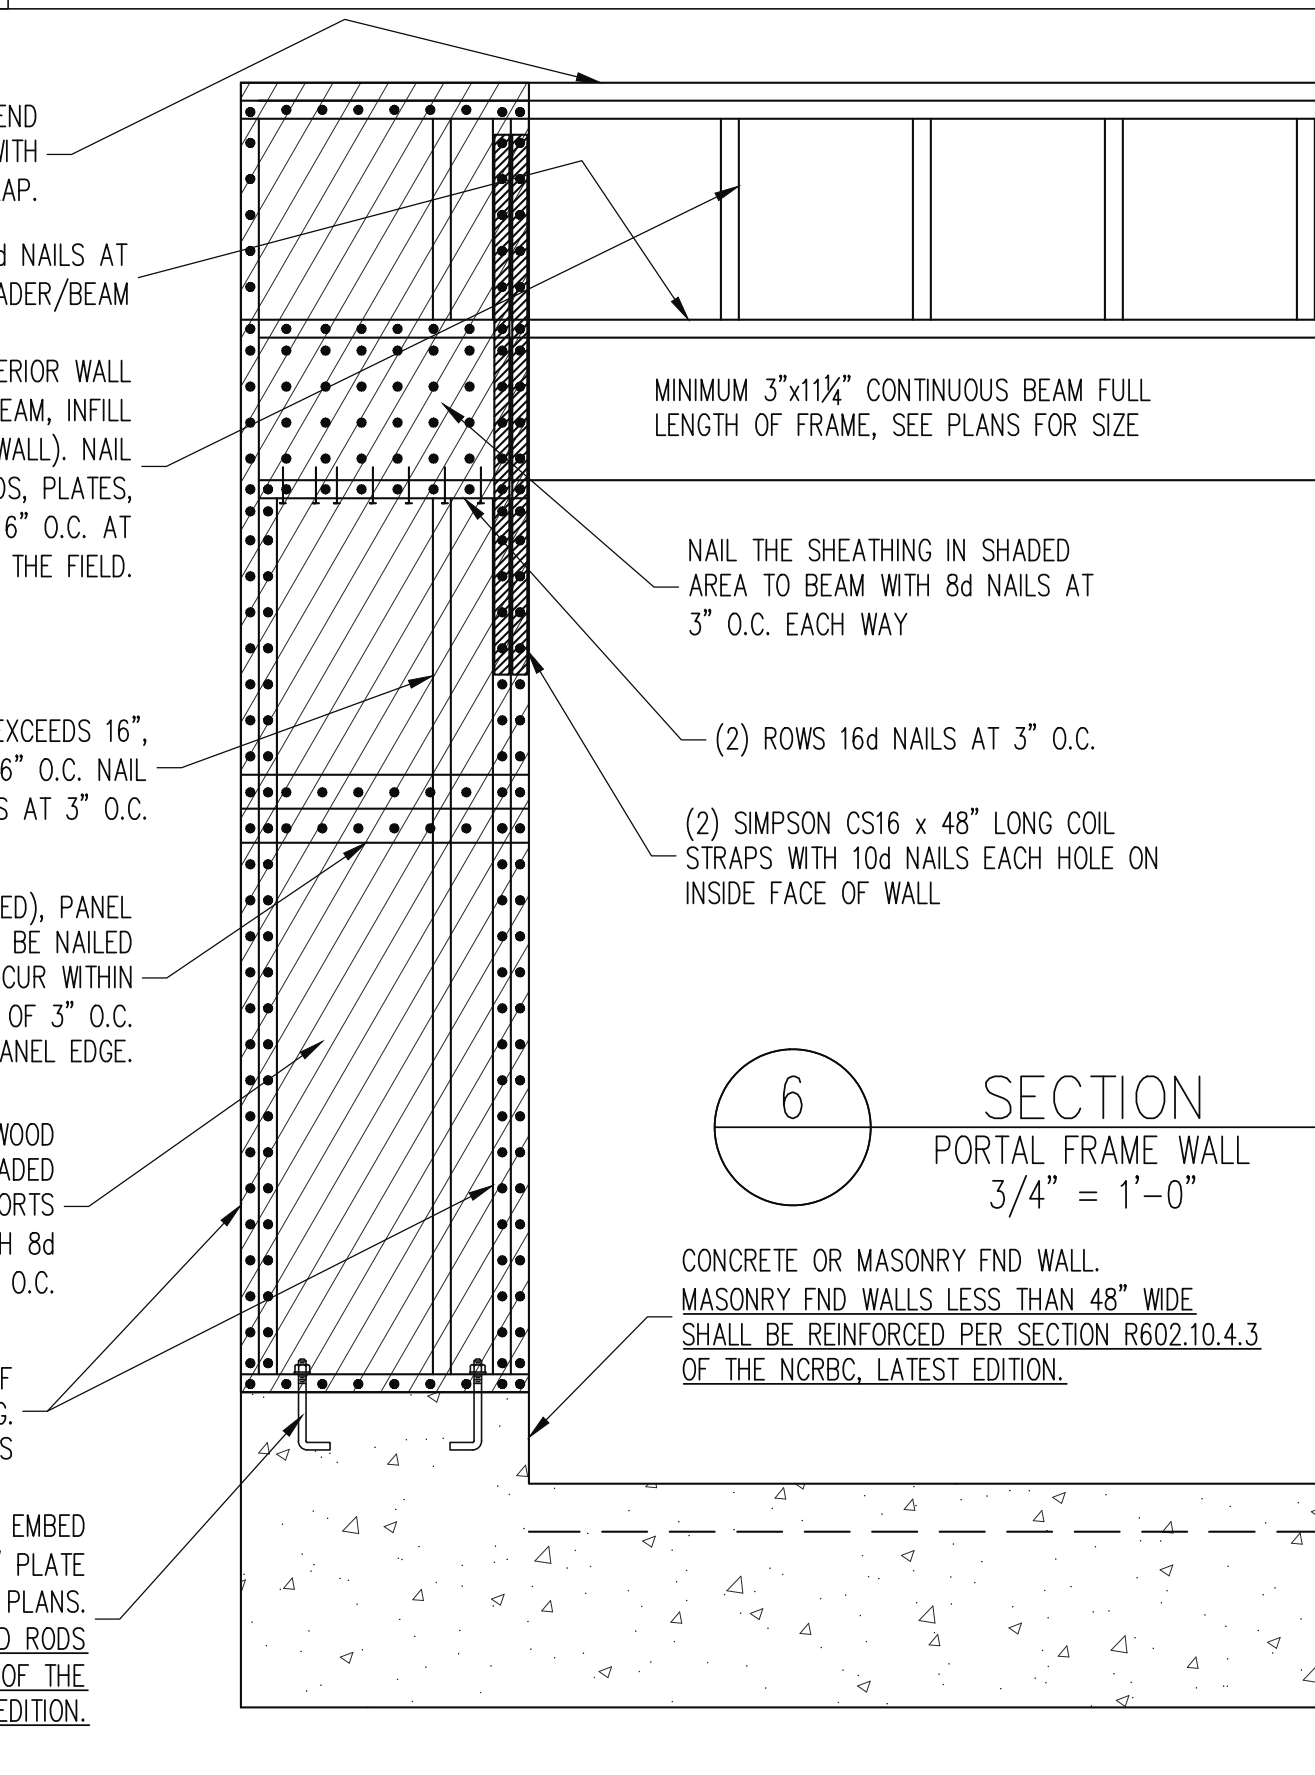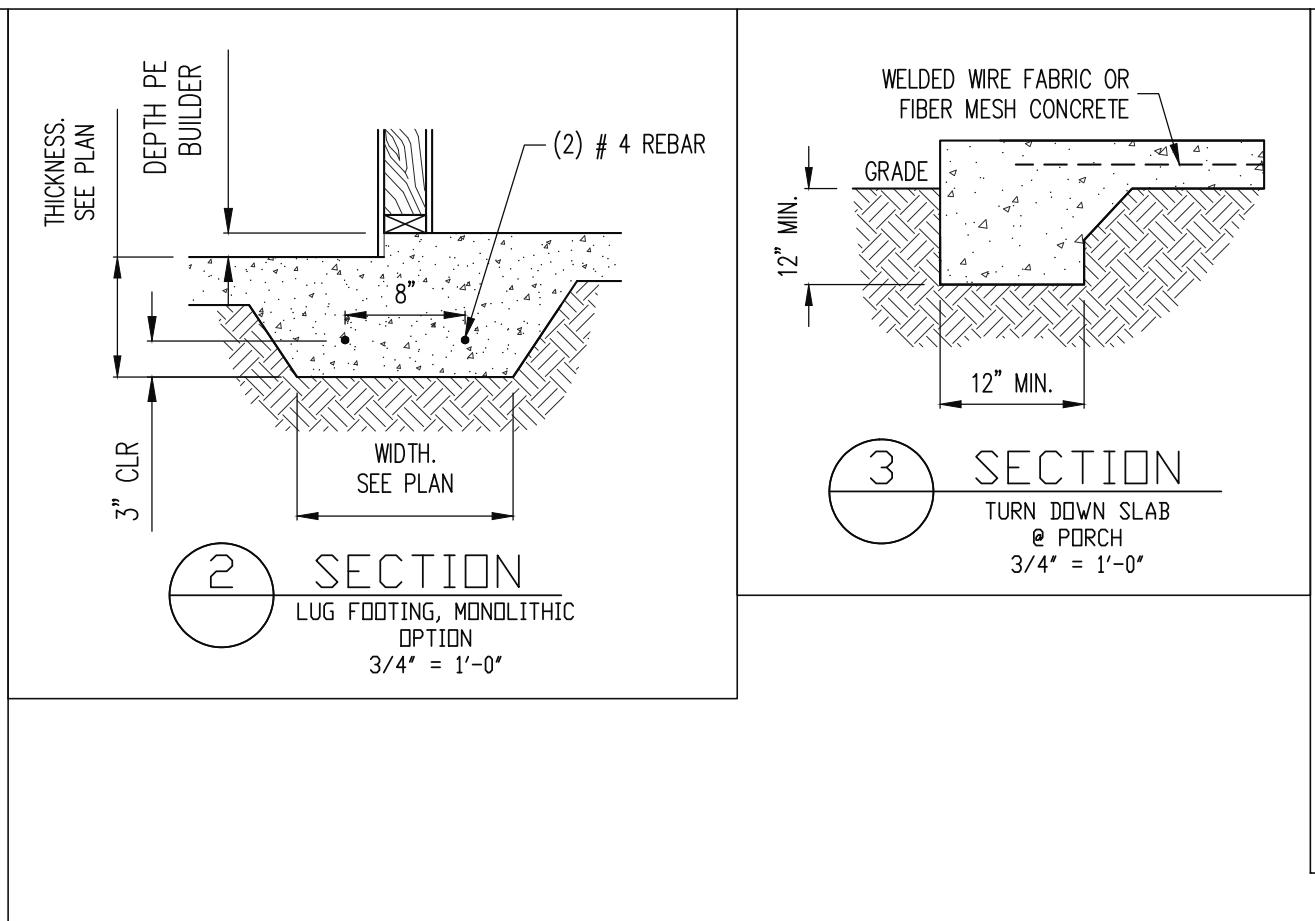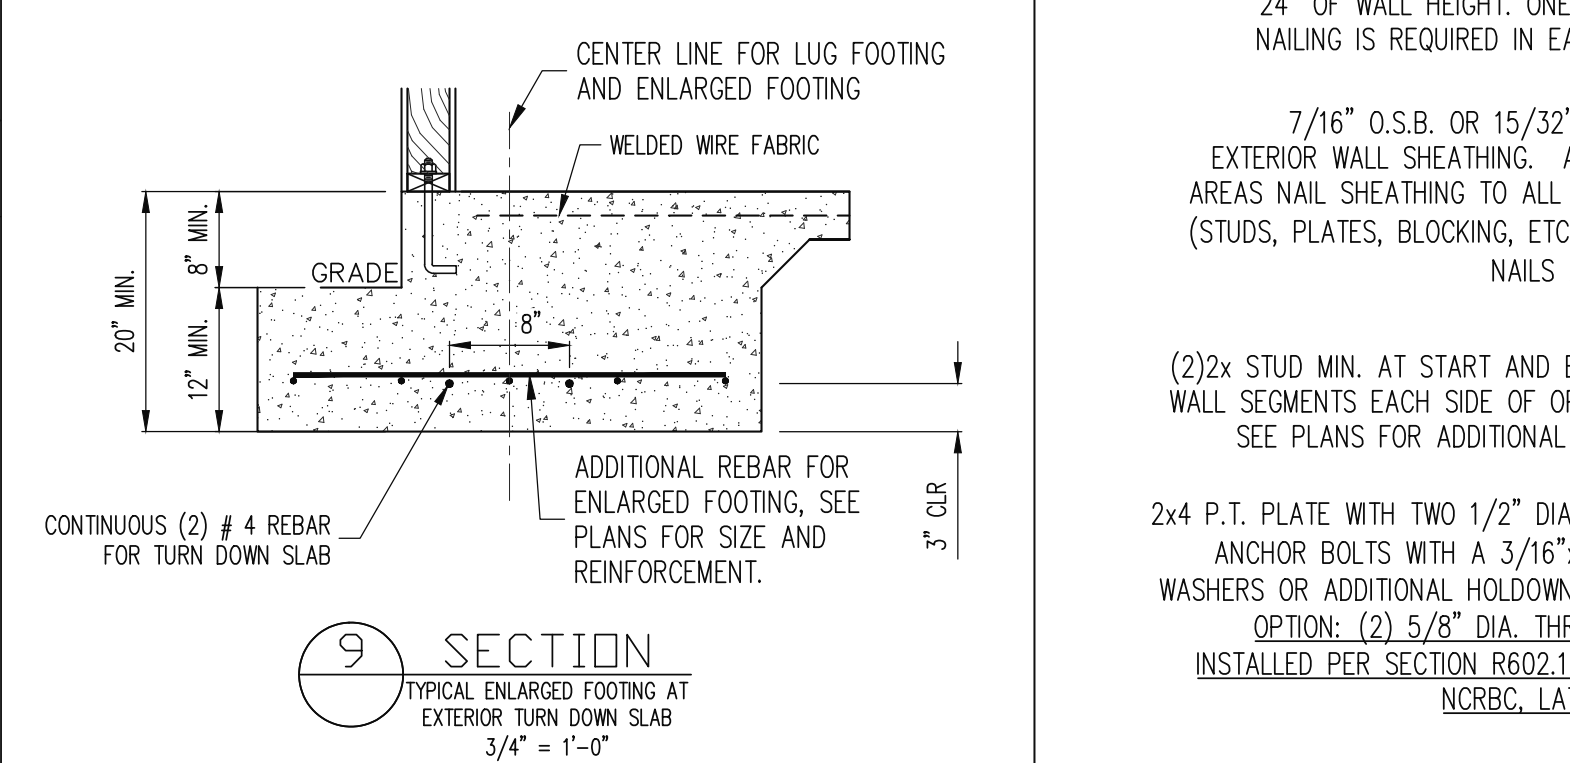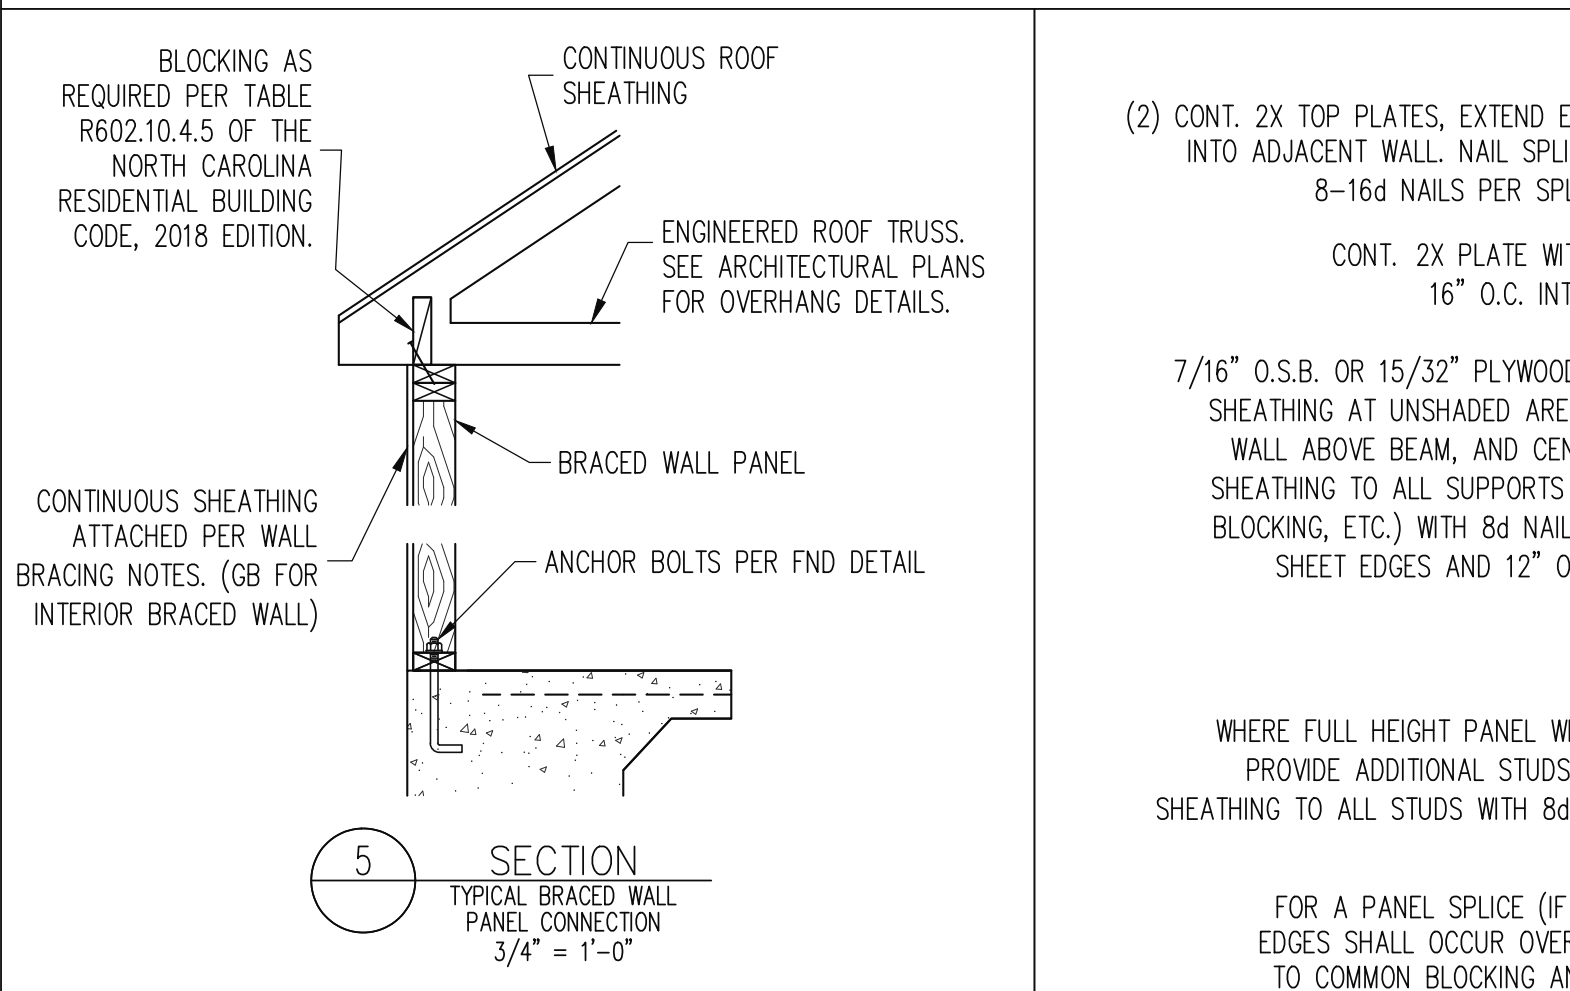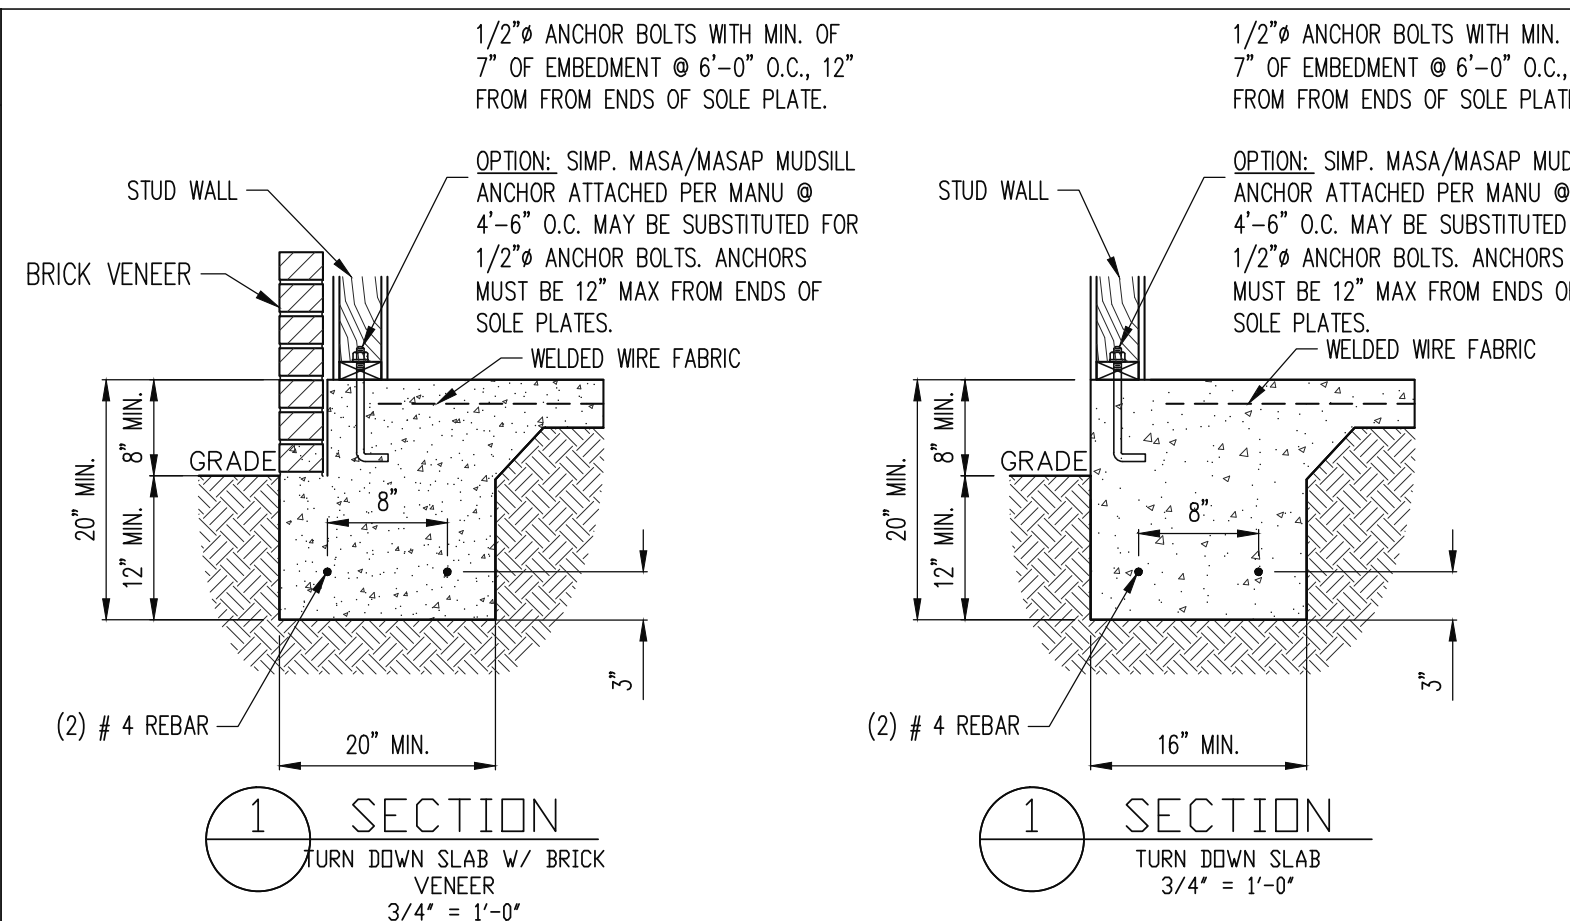

DECK SPECIFICATIONS

- A DECK IS AN EXPOSED EXTERIOR WOOD FLOOR STRUCTURE WHICH MAY BE ATTACHED TO A STRUCTURE OR BE FREE STANDING. ROOFED PORCHES, OPEN OR SCREENED IN, MAY BE CONSTRUCTED USING THESE PROVISIONS.
- SUPPORT POSTS SHALL BE SUPPORTED BY A FOOTING.
- WHEN ATTACHED TO A STRUCTURE, THE STRUCTURE TO WHICH ATTACHED SHALL HAVE A TREATED WOOD BAND FOR THE LENGTH OF THE DECK, OR CORROSION RESISTANT FLASHING SHALL BE USED TO PREVENT MOISTURE FROM COMING IN CONTACT WITH THE UNTREATED FRAMING OF THE STRUCTURE. THE DECK BAND AND THE STRUCTURE BAND SHALL BE CONSTRUCTED IN CONTACT WITH EACH OTHER EXCEPT AT BRICK VENEER AND WHERE PLYWOOD SHEATHING IS REQUIRED AND PROPERLY FLASHED. SIDING SHALL NOT BE INSTALLED BETWEEN THE STRUCTURE AND THE DECK BAND. IF ATTACHED TO A BRICK VENEER STRUCTURE, NEITHER FLASHING NOR A TREATED BAND FOR THE BRICK STRUCTURE IS REQUIRED. IN ADDITION, THE TREATED DECK BAND SHALL BE CONSTRUCTED IN CONTACT WITH THE BRICK VENEER.
- WHEN THE DECK IS SUPPORTED AT THE STRUCTURE BY ATTACHING THE DECK TO THE STRUCTURE, THE FOLLOWING ATTACHMENT SCHEDULES SHALL APPLY FOR ATTACHING THE DECK BAND TO THE STRUCTURE:

| JOIST SPAN | DECKING |
|------------|------------|
| 12' O.C. | 1" S4S |
| 16' O.C. | 1" T&G |
| 24' O.C. | 1 1/4" S4S |
| 32' O.C. | 2" S4S |

| POST SIZE | MAX POST HEIGHT |
|------------|-----------------|
| 4x4 | 8' |
| 4x6 | 20' |
| ENGINEERED | 20' |

- NOTES: 1) THIS TABLE IS BASED ON NO. 2 TREATED SOUTHERN PINE POSTS.
2) THIS TABLE IS BASED ON A MAXIMUM TRIBUTARY AREA OF 128 SQ. FT.
3) POST HEIGHT IS FROM TOP OF FOOTING TO BOTTOM OF GIRDER.

- DECKS SHALL BE BRACED TO PROVIDE LATERAL STABILITY BY ONE OF THE FOLLOWING METHODS:

| POST SIZE | TRIBUT. AREA | POST HEIGHT | EMB. DEPTH | CONC. DIAM. |
|-----------|--------------|-------------|------------|-------------|
| 4x4 | 48 SQ. FT. | 4'-0" | 2'-6" | 1'-0" |
| 6x6 | 120 SQ. FT. | 6'-0" | 3'-6" | 1'-0" |

- D. 2X6 DIAGONAL VERTICAL CROSS BRACING SHALL BE PROVIDED IN TWO PERPENDICULAR DIRECTIONS FOR FREE STANDING DECKS OR PARALLEL TO THE STRUCTURE AT THE EXTERIOR COLUMN LINE FOR ATTACHED DECKS. THE BRACES SHALL BE ATTACHED TO THE POSTS WITH ONE - 5/8" # BOLT AT EACH END OF THE BRACE.
- NOTES: 1) ALL NAILS AND BOLTS ARE TO BE HOT DIPPED GALVANIZED.
2) MINIMUM EDGE DISTANCE FOR BOLTS IS 2 1/2".
3) NAILS MUST PENETRATE THE SUPPORTING STRUCTURE BAND A MINIMUM OF 1 1/2".

| REQUIRED FASTENERS | JOIST LENGTH | |
|----------------------------|---|---|
| | UP TO 8' MAX. | UP TO 16' MAX. |
| A. BRICK VENEER STRUCTURES | ONE - 5/8" # BOLT @ 42" O.C. AND (2) ROWS OF 12d NAILS @ 8" O.C. OR TWO ROWS OF SIMPSON SDWS224008 @ d = 32" O.C. STAGGERED | ONE - 5/8" # BOLT @ 20" O.C. AND (3) ROWS OF 12d NAILS @ 6" O.C. OR TWO ROWS OF SIMPSON SDWS224008 @ d = 16" O.C. STAGGERED |
| | ONE - 5/8" # BOLT @ 28" O.C. | ONE - 5/8" # BOLT @ 16" O.C. |

NOTES


ALL WORK IS TO BE DONE IN STRICT ACCORDANCE WITH STATE AND LOCAL CODES. THE BUILDER IS RESPONSIBLE FOR REVIEWING PLANS PRIOR TO CONSTRUCTION. IF ENGINEERING SERVICES HAS BEEN PROVIDED THE BUILDER SHALL VERIFY THAT THE FOUNDATION AND STRUCTURAL PLANS HAVE BEEN SEALED BY AN ENGINEER REGISTERED BY THE STATE. IF THE PLANS HAVE NOT BEEN SEALED AND SEALED, THE BUILDER SHALL IMMEDIATELY CONTACT ENGINEERING TECH BEFORE PROCEEDING FURTHER. ANY ERRORS DUE TO A FAILURE TO FOLLOW THE ABOVE PROCEDURES SHALL NOT BE THE RESPONSIBILITY OF ENGINEERING TECH. ALL FINAL SETS OF THE SAME PLAN ISSUED TO A BUILDER SHOULD BE REVIEWED FOR UNIFORMITY, ESPECIALLY IF PRIOR SETS OF PLANS HAVE BEEN ISSUED AS STUDY COPIES.

ENGINEERING TECH DOES NOT PERFORM PENETRATION, ROOF VENT, OR ATTIC CALCULATIONS OR ANY OTHER AREA CALCULATIONS THAT ARE NOT RELATED TO STRUCTURAL ENGINEERING.

TRUSSES TO BE DESIGNED BY AN ENGINEER REGISTERED IN NORTH CAROLINA. FINAL TRUSS DRAWING SHOULD BE SUBMITTED TO ENGINEERING TECH ASSOCIATES, PA FOR REVIEW.

ABBREVIATIONS

| | | | | | |
|-------|----------------------|------|-------------------------|------|------------------------|
| ABV | ABOVE | FND | FOUNDATION | TJ | TRIPLE JOIST |
| B | BOTH | FTC | FOOTING | TYP | TYPICAL |
| B.E. | BOTH ENDS | HDC | HOT DIPPED GALVANIZED | TRPL | TRIPLE |
| BTWN | BETWEEN | HR | HANGER | TSP | TRIPLE STUD POCKET |
| CONC | CONCRETE | LVL | LAMINATED VENEER LUMBER | UNO | UNLESS NOTED OTHERWISE |
| CS | CONTINUOUS SHEATHING | LSL | LUMBER STRAND LUMBER | XJ | EXTRA JOIST |
| DIA | DIAMETER | NTS | NOT TO SCALE | | |
| DBL | DOUBLE | O.C. | ON CENTER | | |
| DJ | DOUBLE JOIST | PSL | PARALLEL STRAND LUMBER | | |
| DSP | DOUBLE STUD POCKET | PT | PRESSURE TREATED | | |
| EQ | EQUAL | QU | QUAD JOIST | | |
| EACH | EACH | SP | STUD POCKET | | |
| FLG | FLANGE | SP | STUD POCKET | | |
| FL PL | FLITCH PLATE | SQ | SQUARE | | |
| FLR | FLOOR | | | | |

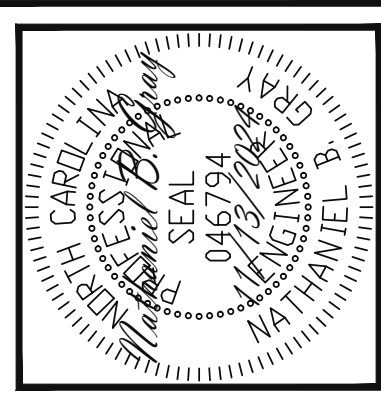

STRUCTURAL ENGINEERS
License No. C-3870
318 W Millbrook Road, Unit 201
Raleigh, North Carolina 27609
Phone (919) 844-1661
ASSOCIATES, P.A.

ADAMS HOMES
STRUCTURAL ADDENDUM
SCOPE: 104 KIPLING CREEK
LOT #: 3327 MASTER

ENG: NBC/WHF
DATE: 11/13/2024

PLAN NO.
3327

PROJECT NO.
24-18-668

SHEET NO.
SD1
5 of 6

