


	Customer: Street 1: City: Customer Ph...	Job Name: Olaniyi 2024-SAN-071 Level: 1st Floor Label: 1DB1 - Type: Beam	2 Ply Member 2.1 RigidLam SP LVL 1-3/4 x 9-1/4	Status: Design Passed
---	---	---	---	---------------------------------

Illustration Not to Scale. Pitch: 0/12
 Designed by Single Member Design Engine in MiTek® Structure Version 8.7.2.270.Update13.8
 Report Version: 2021.03.26 02/20/2025 14:44

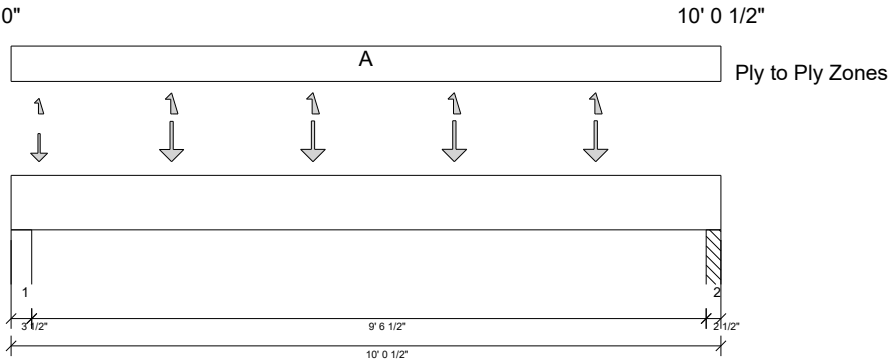

DESIGN INFORMATION	
Building Code:	IRC 2018
Design Methodology:	ASD
Risk Category:	II (General Construction) Residential
Service Condition:	Dry
LL Deflection Limit:	L/360, 0.75" (absolute)
TL Deflection Limit:	L/240, 1.00" (absolute)

Lateral Restraint Requirements:
Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:
Top: 1'- 10 1/2" Bottom: 9'- 9"

- Bearing Stress of Support Material:**
- 1323 psi Wall @ 0'- 2 1/2"
 - 725 psi Column @ 9'- 11"

ANALYSIS RESULTS							
Design Criteria	Location	Load Combination	LDF	Design	Limit	Result	
Max Pos. Moment:	4'- 3 1/4"	D + Lr	1.15	2761 lb ft	15536 lb ft	Passed - 18%	
Max Shear:	9'- 3/4"	D + Lr	1.15	994 lb	7198 lb	Passed - 14%	
Live Load (LL) Pos. Defl.:	5'- 13/16"	Lr		0.058"	L/360	Passed - L/999	
Total Load (TL) Pos. Defl.:	5'- 13/16"	D + Lr		0.114"	L/240	Passed - L/999	

SUPPORT AND REACTION INFORMATION								
ID	Input Bearing Length	Controlling Load Combination	LDF	Downward Reaction	Uplift Reaction	Resistance of Member	Resistance of Support	Result
1	3 1/2"	D + Lr	1.15	1180 lb		9188 lb	16207 lb	Passed - 13%
2	2 1/2"	D + Lr	1.15	1002 lb		6562 lb	6344 lb	Passed - 16%

LOADING										
Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)	
Self Weight	0'	10'- 1/2"	Self Weight	Top	9 lb/ft	-	-	-	-	-
Point	0'- 4 3/4"	0'- 4 3/4"	SP02(c05)	Top	155 lb	-	-	117 lb	26/-90 lb	
Point	2'- 3 1/4"	2'- 3 1/4"	SP02(c04)	Top	214 lb	-	-	236 lb	52/-181 lb	
Point	4'- 3 1/4"	4'- 3 1/4"	SP02(c03)	Top	216 lb	-	-	240 lb	53/-185 lb	
Point	6'- 3 1/4"	6'- 3 1/4"	SP02(c02)	Top	217 lb	-	-	242 lb	53/-184 lb	
Point	8'- 3 1/4"	8'- 3 1/4"	SP02(c01)	Top	217 lb	-	-	242 lb	53/-184 lb	

UNFACTORED REACTIONS										
ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)		
1	0'	0'- 3 1/2"	E3(i19)	611 lb	-	-	574 lb	219 lb/- 532 lb		
2	9'- 10"	10'- 1/2"	PBO2(i25)	494 lb	-	-	503 lb	219 lb/- 532 lb		

- DESIGN NOTES**
- The dead loads used in the design of this member were applied to the structure as projected dead loads.
 - Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
 - Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
 - Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
 - This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
 - Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
 - Beam Stability Factor used in the calculation for Allowable Max Pos Moment (CL) = 0.99

- PLY TO PLY CONNECTION**
- Zone A: Factored load = 0 plf. Use 12d (0.131"x3.25") nails. LDF = 1.00. Qty = 22. Row = 2, Spacing = 12"
12d (0.131"x3.25") nails properties: D = 0.131" , L = 3.25". Fastener capacity = 105 lbs. X1 = 2" , Y1 = 0.75" , Y2 = 1.5"
Install fasteners from one face.
X1 = Minimum end distance, X2 = Minimum edge distance, Y2 = Minimum row spacing.



Customer:
Street 1:
City:
Customer Ph...

Job Name: **Olaniyi 2024-SAN-071**
Level: **1st Floor**
Label: **1DB1 -**
Type: **Beam**

2 Ply Member
2.1 RigidLam SP LVL 1-3/4
x 9-1/4

Status:
Design
Passed

PLY TO PLY CONNECTION

FASTENER INSTALLATION – 2 ROWS (FROM ONE FACE)

