



Customer:
Street 1:
City:
Customer Ph...

Job Name: **Olaniyi 2024-SAN-071**
Level: **1st Floor**
Label: **1FB3 -**
Type: **Beam**


2 Ply Member
2.1 RigidLam SP LVL 1-3/4
x 16

Status:
Design
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version
8.7.2.270.Update13.8

Report Version: 2021.03.26 02/20/2025 14:43

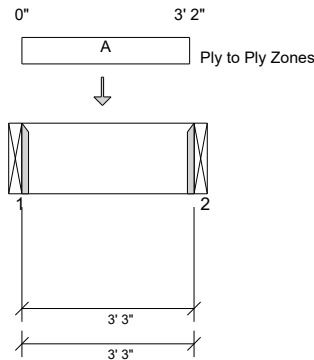

DESIGN INFORMATION

Building Code: IRC 2018
Design Methodology: ASD
Risk Category: II (General Construction)
Residential
Service Condition: Dry
LL Deflection Limit: L/360, 0.75" (absolute)
TL Deflection Limit: L/240, 1.00" (absolute)

Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 7"

Bearing Stress of Support Material:

- 405 psi Beam @ 0'
- 405 psi Beam @ 3'- 3"

ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Max Pos. Moment:	1'- 6 1/4"	D + L	1.00	174 lb ft	36421 lb ft	Passed - 0%
Max Shear:	1'- 4"	D + L	1.00	106 lb	10827 lb	Passed - 1%

SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Downward Reaction	Uplift Reaction	Resistance of Member	Resistance of Support	Result
1	1 1/2"	D + L	1.00	126 lb		3937 lb	-	Passed - 3%
2	1 1/2"	D + L	1.00	113 lb		3937 lb	-	Passed - 3%

CONNECTOR INFORMATION

ID	Part No.	Manufacturer	Nailing Requirements			Other Information or Requirement for Reinforcement Accessories
			Top	Face	Member	
1	HU416	Simpson	-	-	-	Connector manually specified by the user.
2	HU416	Simpson	-	-	-	Connector manually specified by the user.

* Connectors: Refer to manufacturer's specifications, fasteners requirements and installation instruction. Where header fasteners are longer than the width of the supporting member, install backer block or clinch header nails.

LOADING

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)
Self Weight	0'	3'- 3"	Self Weight	Top	15 lb/ft	-	-	-	-
Point	1'- 6 1/4"	1'- 6 1/4"	1F05(c01)	Back	52 lb	139 lb	-	-	-

UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)
1	0'	0'	1FB2()	52 lb	74 lb	-	-	-
2	3'- 3"	3'- 3"	1FB2()	48 lb	65 lb	-	-	-

DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as projected dead loads.
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (CL) = 1.00

PLY TO PLY CONNECTION

- Zone A: Factored load = 131 plf. Use 12d (0.131"x3.25") nails. LDF = 1.00. Qty = 12. Row = 3, Spacing = 12"
12d (0.131"x3.25") nails properties: D = 0.131" , L = 3.25". Fastener capacity = 105 lbs. X1 = 2" , Y1 = 0.75", Y2 = 1.5"
Install fasteners from one face.
X1 = Minimum end distance, X2 = Minimum edge distance, Y2 = Minimum row spacing.



Customer:
Street 1:
City:
Customer Ph...

Job Name: **Olaniyi 2024-SAN-071**
Level: **1st Floor**
Label: **1FB3 -**
Type: **Beam**

2 Ply Member
2.1 RigidLam SP LVL 1-3/4
x 16

Status:
Design
Passed

PLY TO PLY CONNECTION

FASTENER INSTALLATION – 3 ROWS (FROM ONE FACE)

