

SFD 2591-0120

Harnett County Department of Public Health


PERMIT # 2591-0120

Operation Permit

☒ New Installation ☐ Septic Tank ☐ Nitrification Line ☐ Repair ☐ ExpansionPROPERTY LOCATION: 111 Priming way, AngierName: (owner) Davidson HomesSUBDIVISION Tobacco RoadLOT # 74System Installer: Genes BackhoeBasement with plumbing: ☐ Garage ☒ Number of Bedrooms 4Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feetSystem Type: 25% Reduction IIb EZflow Types V and VI Systems expire in 5 years.(In accordance with Table V a) 25% reduction

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

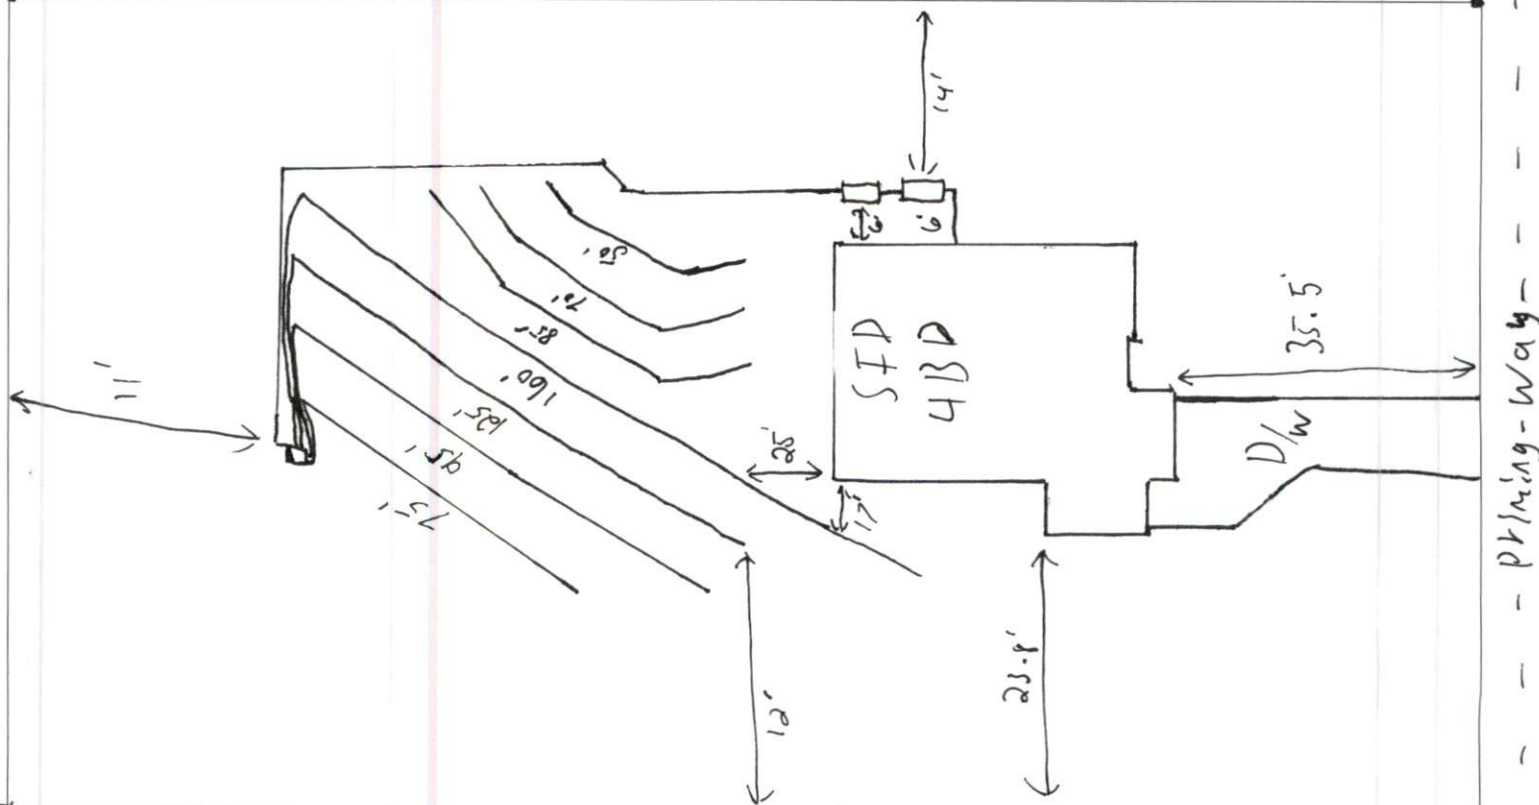

* Needs Pump & Alarm

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☒

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

☐ D-Box ☒ Pump ☒ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other 25% Reduction IIb EZflow Septic Tank: low gallons Pump Tank: low gallonsSubsurface Drainage Field No. of ditches 4 exact length of each ditch 75' 95' 125' 160' feet width of ditches 3 feet depth of ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent REHSDate 8-13-25