



| | | | | | |
|--------------|-------|------------|-----|-----|--------------------------|
| Job | Truss | Truss Type | Qty | Ply | LGI HOMESICARY RF |
| 72510073REP2 | V6 | Truss | 1 | 1 | Job Reference (optional) |

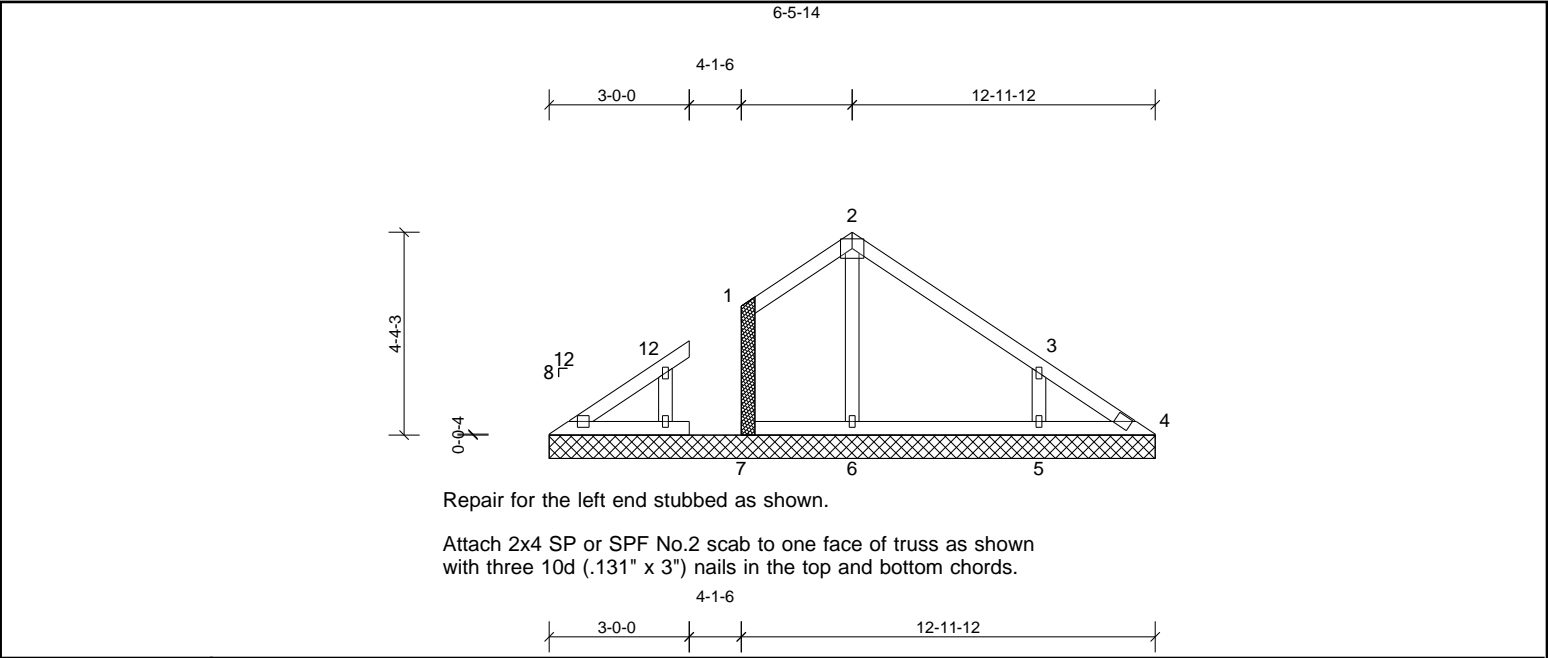

| | | | | | | | | | | | | |
|-----------------------|-------|------------------|-----------------|------------|------|-------------|------|-------|--------|-----|---------------|-------------|
| Plate Offsets (X, Y): | | [8:0-1-15,0-1-8] | | | | | | | | | | |
| Loading | (psf) | Spacing | 2-0-0 | CSI | | DEFL | in | (loc) | I/defl | L/d | PLATES | GRIP |
| TCLL (roof) | 20.0 | Plate Grip DOL | 1.15 | TC | 0.19 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 244/190 |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.09 | Vert(TL) | n/a | - | n/a | 999 | | |
| BCLL | 0.0 * | Rep Stress Incr | YES | WB | 0.07 | Horiz(TL) | 0.00 | 4 | n/a | n/a | | |
| BCDL | 10.0 | Code | IRC2015/TPI2014 | Matrix-MSH | | | | | | | Weight: 51 lb | FT = 20% |

| | | | |
|------------------|---|----------------|---|
| LUMBER | | BRACING | |
| TOP CHORD | 2x4 SP No.2 | TOP CHORD | Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD | 2x4 SP No.2 | BOT CHORD | Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS | 2x4 SP No.3 | | |
| OTHERS | 2x4 SP No.3 | | |
| REACTIONS | | | |
| | All bearings 12-11-12. | | |
| (lb) - Max Horiz | 7=132 (LC 11) | | |
| Max Uplift | All uplift 100 (lb) or less at joint(s) 4, 6, 7 except 5=119 (LC 11) | | |
| Max Grav | All reactions 250 (lb) or less at joint(s) 4, 7 except 5=327 (LC 18), 6=272 (LC 18) | | |
| FORCES | | | |
| WEBS | (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. | | |
| | 3-5=-260/176 | | |

- NOTES (10)**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All additional member connections shall be provided by others for forces as indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 6, 7 except (jt=lb) 5=119.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This repair has been prepared based on information and use conditions supplied by client. Designer has made a good faith effort to outline damage and repair conditions as reported by client. When actual field conditions do not approximate those indicated on this drawing, client shall immediately inform the engineer and refrain from applying the repair.

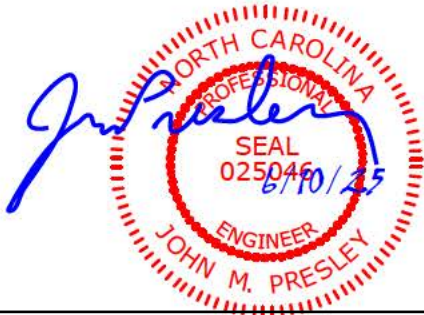

| | | | | | |
|--------------|-------|------------|-----|-----|--------------------------|
| Job | Truss | Truss Type | Qty | Ply | LGI HOMESICARY RF |
| 72510073REP2 | V7 | Truss | 1 | 1 | Job Reference (optional) |

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, JMP

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Tue Jun 10 09:53:3

Page: 1

ID:ztaeHHc2QKxnixZXp?o1VOzS4mi-0FgNV_CBj?efOAdPs_qE0H8x15Csft_Dhjmfxbz7kOW


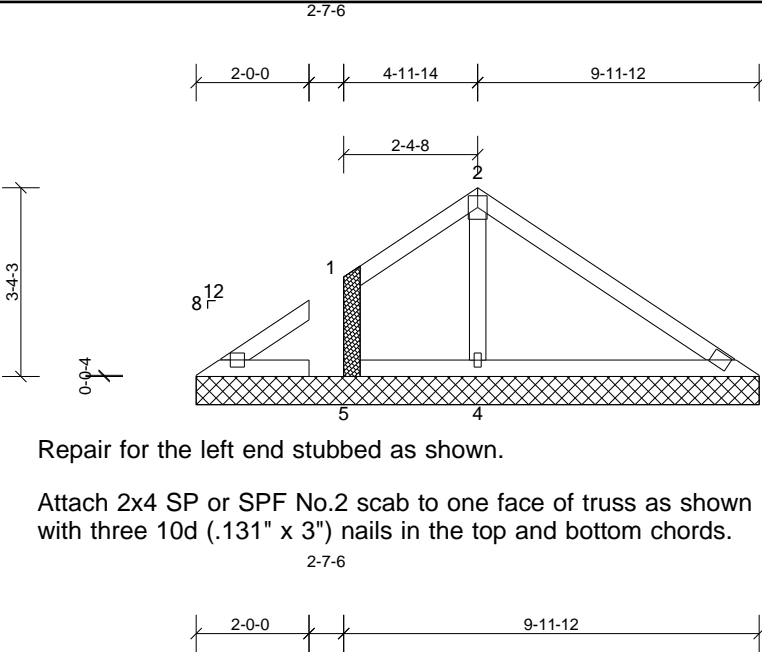


Plate Offsets (X, Y): [6:0-1-15,0-1-8]

| Loading | (psf) | Spacing | 2-0-0 | CSI | DEFL | in | (loc) | I/defl | L/d | PLATES | GRIP |
|-------------|-------|-----------------|-----------------|------------|------|-----------|-------|--------|-----|---------------|----------|
| TCLL (roof) | 20.0 | Plate Grip DOL | 1.15 | TC | 0.26 | Vert(LL) | n/a | - | n/a | 999 | 244/190 |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.31 | Vert(TL) | n/a | - | n/a | 999 | |
| BCLL | 0.0* | Rep Stress Incr | YES | WB | 0.06 | Horiz(TL) | 0.01 | 3 | n/a | n/a | |
| BCDL | 10.0 | Code | IRC2015/TPI2014 | Matrix-MSH | | | | | | Weight: 36 lb | FT = 20% |

| LUMBER | BRACING |
|--|---|
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 9-11-12 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS 2x4 SP No.3 | |
| OTHERS 2x4 SP No.3 | |
| REACTIONS (lb/size) | |
| 3=171/9-11-12, (min. 0-1-8), 4=384/9-11-12, (min. 0-1-8), 5=34/9-11-12, (min. 0-1-8) | |
| Max Horiz 5=92 (LC 11) | |
| Max Uplift 3=17 (LC 11), 4=69 (LC 11), 5=35 (LC 10) | |
| Max Grav 3=172 (LC 22), 4=388 (LC 18), 5=61 (LC 21) | |
| FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. | |

- NOTES (10)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All additional member connections shall be provided by others for forces as indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 3, 69 lb uplift at joint 4 and 35 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This repair has been prepared based on information and use conditions supplied by client. Designer has made a good faith effort to outline damage and repair conditions as reported by client. When actual field conditions do not approximate those indicated on this drawing, client shall immediately inform the engineer and refrain from applying the repair.

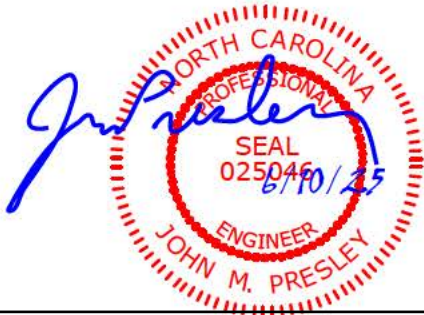

| | | | | | |
|--------------|-------|------------|-----|-----|--------------------------|
| Job | Truss | Truss Type | Qty | Ply | LGI HOMESICARY RF |
| 72510073REP2 | V8 | Truss | 1 | 1 | Job Reference (optional) |

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, JMP

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Tue Jun 10 09:53:34

Page: 1

ID:ztaeHHc2QKxnixZxp?o1VOzS4mi-UREIiKdpUJmW0KCcQhLTYUh4FUZQOJ8NwNWD32z7kOV

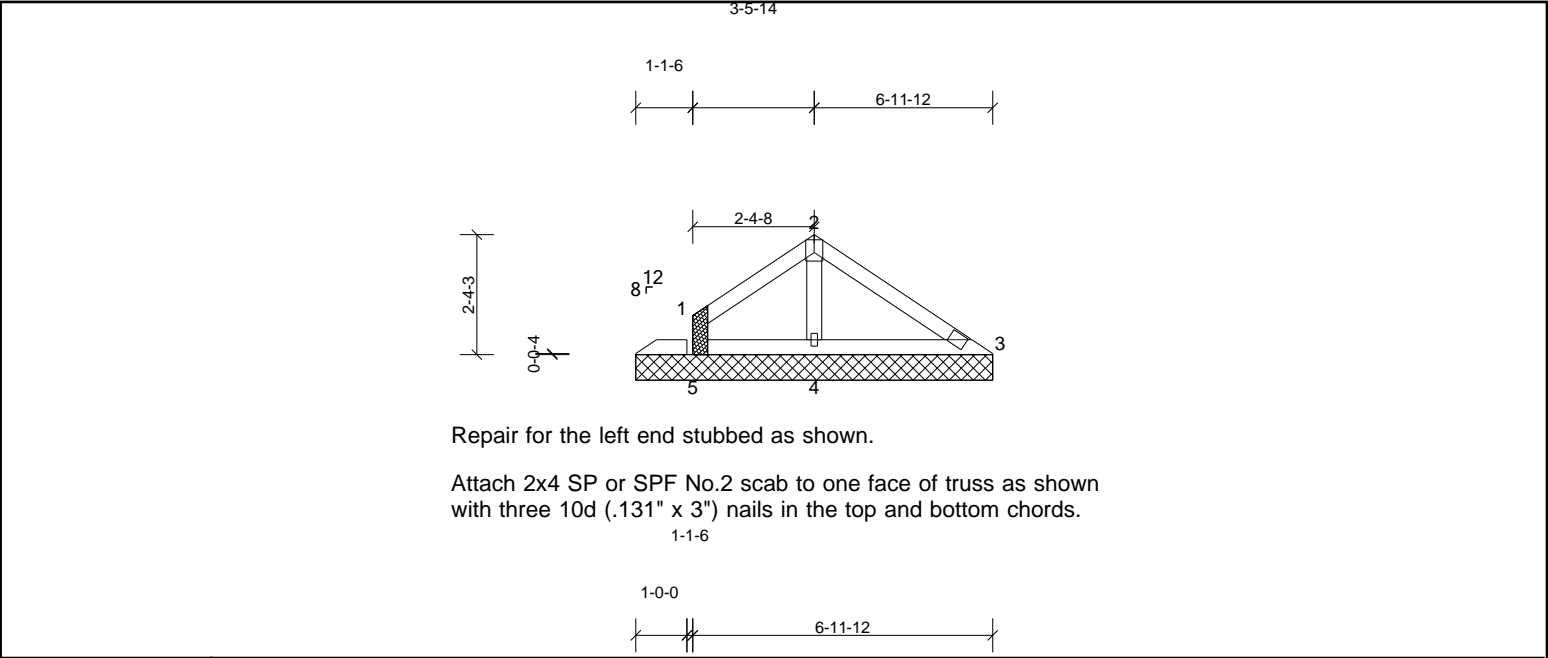


Plate Offsets (X, Y): [2-0-2-0,0-3-0]

| Loading | (psf) | Spacing | 2-0-0 | CSI | | DEFL | in | (loc) | I/defl | L/d | PLATES | GRIP |
|-------------|-------|-----------------|-----------------|------------|------|----------|------|-------|--------|-----|---------------|----------|
| TCLL (roof) | 20.0 | Plate Grip DOL | 1.15 | TC | 0.42 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 244/190 |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.16 | Vert(CT) | n/a | - | n/a | 999 | | |
| BCLL | 0.0* | Rep Stress Incr | YES | WB | 0.07 | Horz(CT) | 0.00 | 3 | n/a | n/a | | |
| BCDL | 10.0 | Code | IRC2015/TPI2014 | Matrix-MSH | | | | | | | Weight: 24 lb | FT = 20% |

| LUMBER | | BRACING | |
|-----------|-------------|-----------|---|
| TOP CHORD | 2x4 SP No.2 | TOP CHORD | Structural wood sheathing directly applied or 6-11-12 oc purlins. |
| BOT CHORD | 2x4 SP No.2 | BOT CHORD | Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS | 2x4 SP No.3 | | |
| OTHERS | 2x4 SP No.3 | | |

| | | |
|-----------|------------|---|
| REACTIONS | (lb/size) | 3=86/6-11-12, (min. 0-1-8), 4=368/6-11-12, (min. 0-1-8), 5=16/6-11-12, (min. 0-1-8) |
| | Max Horiz | 5=64 (LC 7) |
| | Max Uplift | 3=11 (LC 11), 4=44 (LC 11) |
| | Max Grav | 3=89 (LC 18), 4=368 (LC 1), 5=31 (LC 3) |

| | |
|--------|--|
| FORCES | (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. |
| WEBS | 2-4=-301/220 |

- NOTES (9)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All additional member connections shall be provided by others for forces as indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 3 and 44 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This repair has been prepared based on information and use conditions supplied by client. Designer has made a good faith effort to outline damage and repair conditions as reported by client. When actual field conditions do not approximate those indicated on this drawing, client shall immediately inform the engineer and refrain from applying the repair.

