

Harnett County Department of Public Health

PERMIT # SFD 2502-0135

Operation Permit

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ Expansion

PROPERTY LOCATION: 386 Adams Pointe Ct, Angier

Name: (owner) DRB Group North Carolina SUBDIVISION Honey cutt Hills LOT # 30

System Installer: Weather Master

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 4

Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feet

System Type: 25% Reduction Type III (b) 24 chambers Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.


This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

*Septic Contractor Installed During wet conditions.

*Needs Septic Lines and Supply Line Installed

*Needs pump + Alarm for Final

*Need to see Routed Water Line Setback

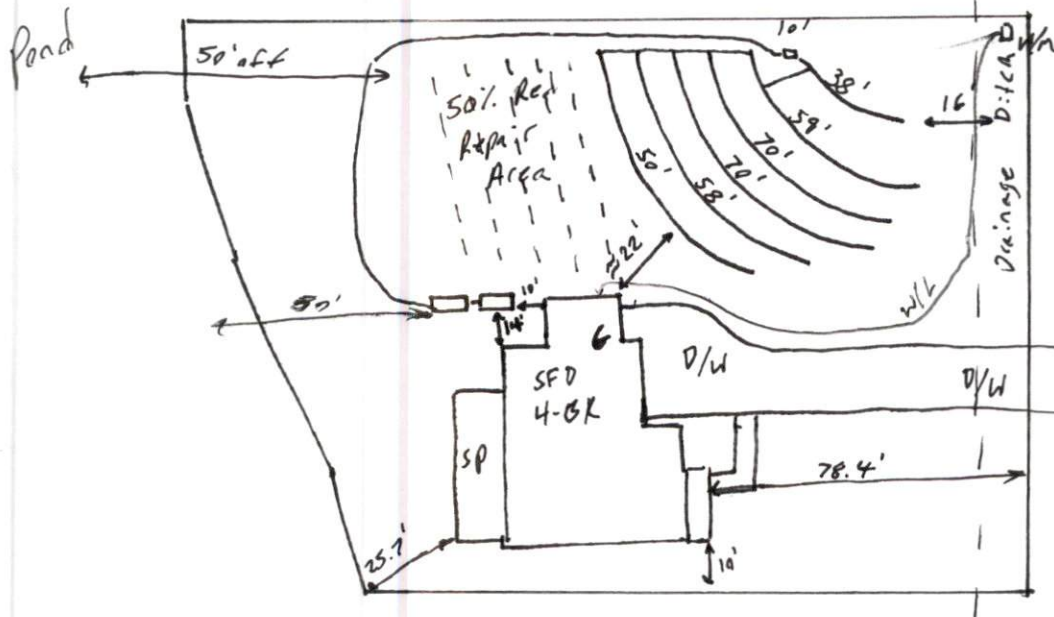

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☐

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other Type III (b) 24 chambers Septic Tank: 1,000 gallons Pump Tank: 1,000 gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 345' width of ditches 3' depth of ditches 20"-24" inches

French Drain Required: _____ Linear feet

Authorized State Agent Mr. J. REHS

Date 9-22-23