DEPARTMENT OF HEALTH AND HUMAN SERVICES
DIVISION OF PUBLIC HEALTH, ENVIRONMENTAL HEALTH SECTION
ON-SITE WATER PROTECTION BRANCH

PROPERTY ID #: SFD2502-0140
COUNTY: Harnett

SOIL/SITE EVALUATION *for* ON-SITE WASTEWATER SYSTEM

(Complete all fields in full)

OWNER: Milton Built Homes LLC DATE EVALUATED: 3-18-25
ADDRESS: 9481 NC 42
PROPOSED FACILITY: SFD PROPOSED DESIGN FLOW (.0400): 360 PROPERTY SIZE: ____
LOCATION OF SITE: ____ PROPERTY RECORDED: ____
WATER SUPPLY: (Public) Single Family Well Shared Well Spring Other ____ WATER SUPPLY SETBACK: ____
EVALUATION METHOD: (Auger Boring) Pit Cut TYPE OF WASTEWATER: (Domestic) High Strength IPWW

PROFILE #	.0502 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY .0503 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY .0503 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .0504 SOIL WETNESS/ COLOR	.0505 SOIL DEPTH	.0506 SAPRO CLASS	.0507 RESTR HORIZ	.0509 PROFILE CLASS & LTAR*	.0503 SLOPE CORRECTION
1, 2, 3, 4, 5, 6	2-3% LS	0-11	SL, gr		7.5YR 7/1 38"-42"	48"			.3	
		11-42	SCL, SBK	Fr, SS, SP, SE						
		42-48	CL, WK SBK							
7, 10, 2	2-3% LS	0-15	SL, gr		7.5YR 7/1=29"	48"			.3	
		15-29	SCL, SBK	Fr, SS, SP, SE						
		29-48	CL, WK SBK							
8, 9, 3	2-3% LS	0-11	SL, gr		7.5YR 7/2:38"	48"		Heavy Water Table at 18"	.3	
		11-38	SCL, SBK	Fr, SS, SP, SE						
		38-48	CL, WK SBK							
4										

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.0508)	✓	✓
System Type(s)	25% Red	50% Red
Site LTAR	.3	.3
Maximum Trench Depth	18-25"	18-25"

SITE CLASSIFICATION (.0509): 5
EVALUATED BY: RL
OTHER(S) PRESENT: ____

Comments: ____

LEGEND

LANDSCAPE POSITION	SOIL GROUP	SOIL TEXTURE	CONVENTIONAL LTAR (gpd/ft²)	SAPROLITE LTAR (gpd/ft²)	LPP LTAR (gpd/ft²)	MINERALOGY/ CONSISTENCE		STRUCTURE
CC (Concave slope)	I	S (Sand)	0.8 - 1.2	0.6 - 0.8	0.4 -0.6	MOIST	WET	SG (Single grain)
CV (Convex Slope)		LS (Loamy sand)		0.5 -0.7		Lo (Loose)	NS (Non-sticky)	M (Massive)
D (Drainage way)	II	SL (Sandy loam)	0.6 - 0.8	0.4 -0.6	0.3 - 0.4	VFR (Very friable)	SS (Slightly sticky)	GR (Granular)
FP (Flood plain)		L (Loam)		0.2 - 0.4		FR (Friable)	S (Sticky)	SBK (Subangular blocky)
FS (Foot slope)	III	SiL (Silt loam)	0.3 - 0.6	0.1 - 0.3	0.15 - 0.3	FI (Firm)	VS (Very sticky)	ABK (Angular blocky)
H (Head slope)		SCL (Sandy clay loam)		0.05 - 0.15**		VFI (Very firm)	NP (Non-plastic)	PR (Prismatic)
L (Linear Slope)		CL (Clay loam)		None		EFI (Extremely firm)	SP (Slightly plastic)	PL (Platy)
N (Nose slope)		SiCL (Silty clay loam)					P (Plastic)	
R (Ridge/summit)		Si (Silt)					VP (Very plastic)	
S (Shoulder slope)	IV	SC (Sandy clay)	0.1 - 0.4		0.05 - 0.2	SEXP (Slightly expansive)		
T (Terrace)		SiC (Silty clay)				EXP (Expansive)		
TS (Toe Slope)		C (Clay)						
		O (Organic)	None					

* Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.
**Sandy clay loam saprolite can only be used with advanced pretreatment in accordance with 15A NCAC 18E .1200.

HORIZON DEPTH In inches below natural soil surface
DEPTH OF FILL In inches from land surface
RESTRICTIVE HORIZON Thickness and depth from land surface
SAPROLITE S(suitable) or U(unsuitable); Evaluation of saprolite shall be by pits.
SOIL WETNESS Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION S (Suitable) or U (Unsuitable)

Show profile locations and other site features (dimensions, reference or benchmark, and North).

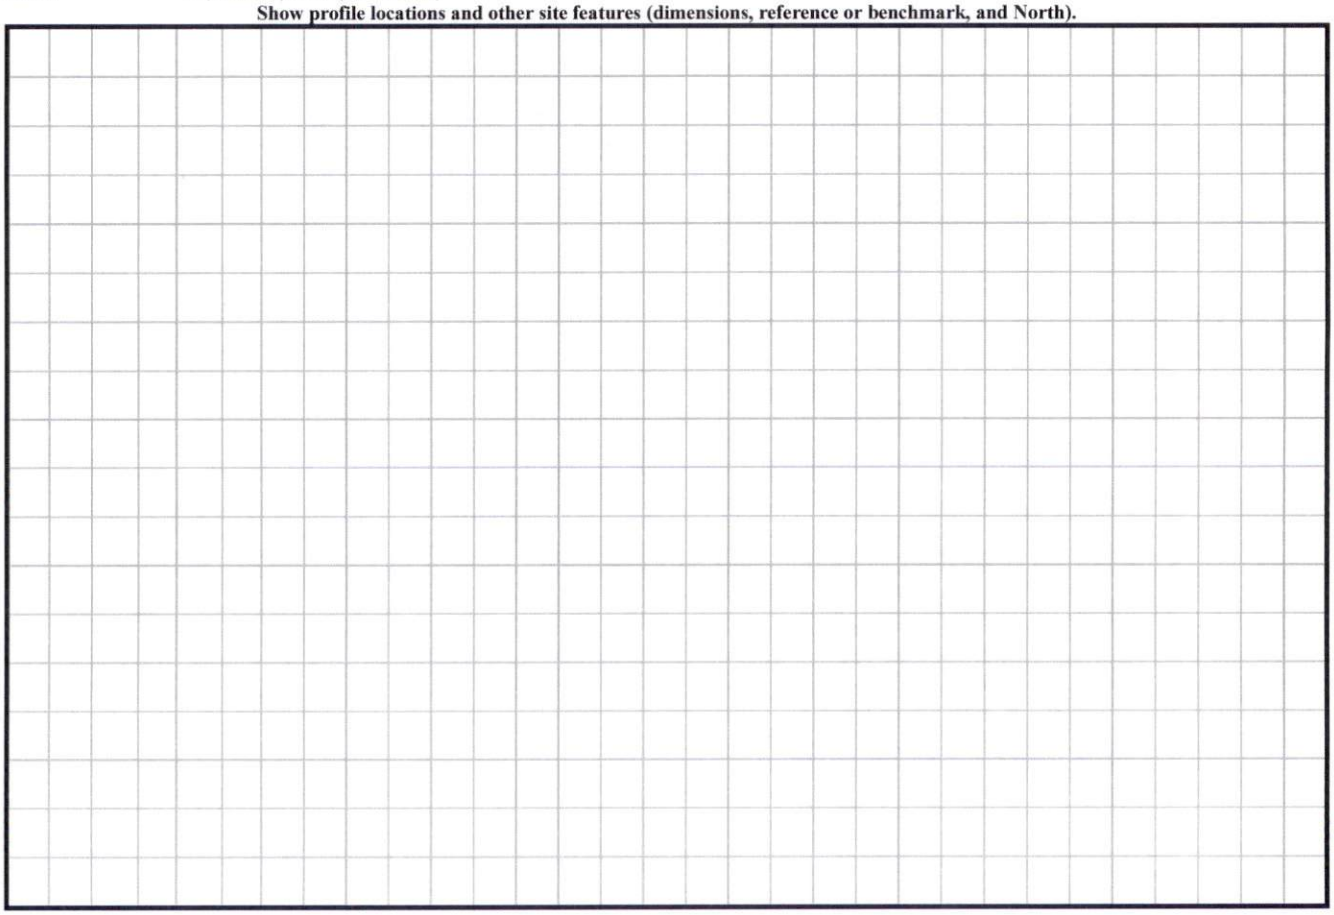

Harnett County Environmental Health

SITE SKETCH

PIN 0625-59-2180.000 Permit Number SFD2502-0140

Milton Built Homes, LLC — Applicant's Name

Lot 7 — Subdivision/Section/Lot Number

Ren Levocz — Authorized State Agent

06/17/2025 — Date

System components represent approximate contours only. The contractor must flag the system prior to beginning the installation to ensure that the proper grade is maintained.

Scale = NTS

Soil Notes