

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A ROOF
72500978	A1	Truss	6	1	Job Reference (optional) 27LDP

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:55:10

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-O6skDMpCLOiKXYMXkGdi?y8swGNq9hBwk3AOaVzvo_F

Page: 1

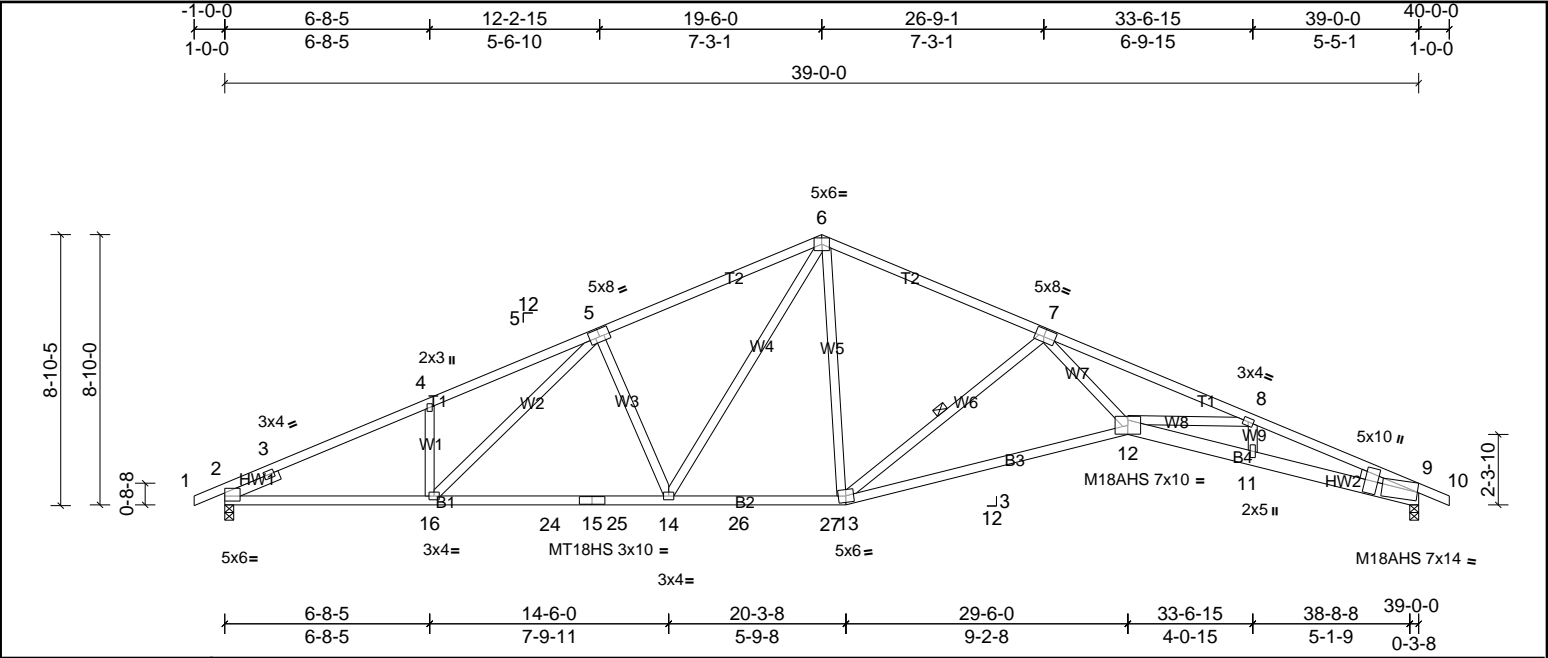


Plate Offsets (X, Y): [2:Edge,0-3-3], [5:0-4-0,0-3-0], [7:0-3-8,0-3-0], [9:0-0-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	-0.40	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.95	Vert(CT)	-0.99	12-13	>472	180	MT18HS	244/190
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.84	Horz(CT)	0.33	9	n/a	n/a	M18AHS	186/179
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 216 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2 *Except* T1:2x4 SP SS	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.1 *Except* B4:2x6 SP SS, B2:2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	2x4 SP No.3 *Except* W7:2x4 SP No.2	WEBS	1 Row at midpt
WEDGE	Right: 2x4 SP No.2		7-13
SLIDER	Left 2x4 SP No.3 -- 1-11-0		
REACTIONS	(lb/size)		
	2=1620/0-3-8, (min. 0-2-9), 9=1620/0-3-8, (min. 0-2-9)		
	Max Horiz 2=149 (LC 11)		
	Max Uplift 2=241 (LC 10), 9=241 (LC 11)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-858/64, 3-4=-3002/782, 4-5=-2944/880, 5-6=-2473/793, 6-7=-2104/671, 7-8=-5890/1400, 8-9=-5590/1410		
BOT CHORD	2-16=-603/2690, 16-24=-511/2419, 15-24=-511/2419, 15-25=-511/2419, 14-25=-511/2419, 14-26=-264/1801, 26-27=-264/1801, 13-27=-264/1801, 12-13=-776/3563, 11-12=-1240/5284, 9-11=-1218/5180		
WEBS	6-13=-121/631, 7-13=-2060/609, 7-12=-544/3034, 8-12=0/381, 6-14=-246/820, 5-14=-593/317, 5-16=-136/437, 8-11=-359/138		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 241 lb uplift at joint 2 and 241 lb uplift at joint 9.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A ROOF
72500978	A1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MITek Industries, Inc. Mon Jan 13 11:55:11

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-slQ6Riqq66qB8ixjHz8xX9gF7gxJuJF3yivx6yzvo_E

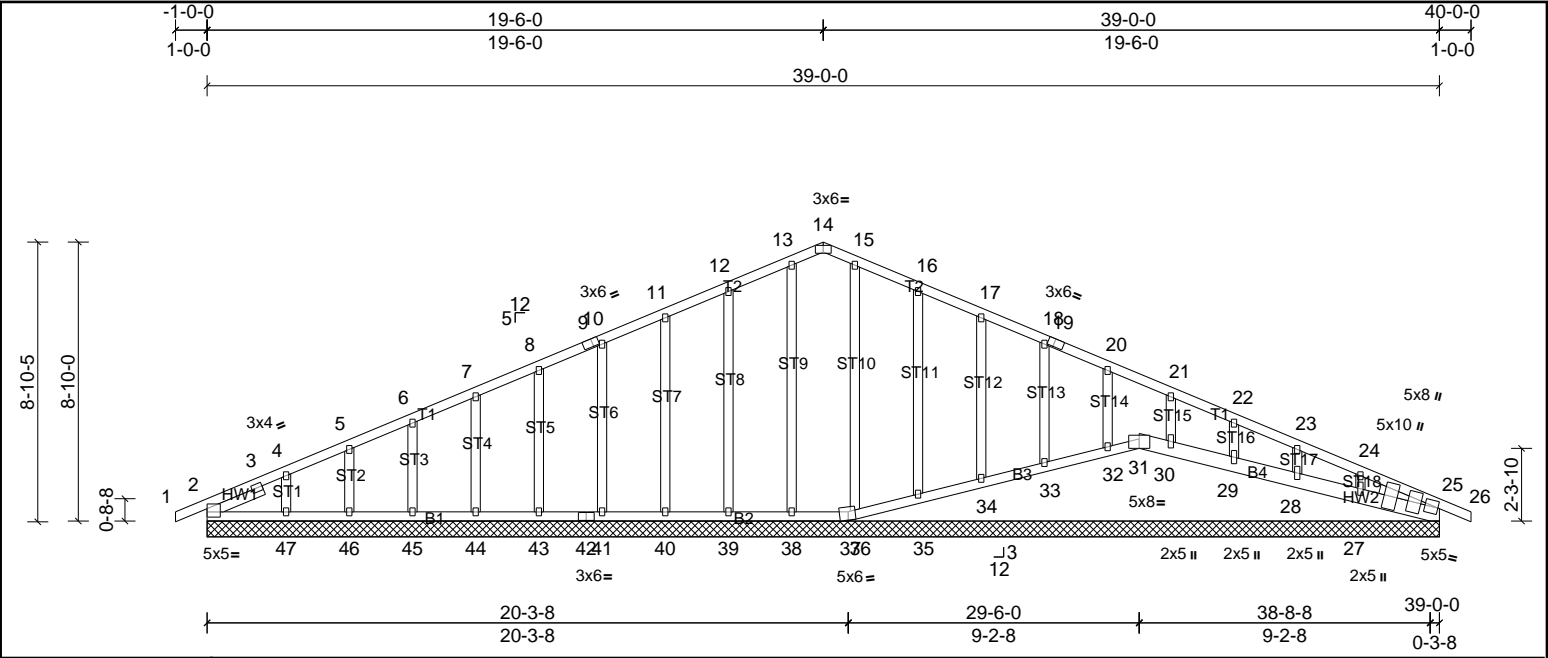


Plate Offsets (X, Y): [2:Edge,0-2-0], [9:0-2-7,Edge], [14:0-3-0,Edge], [19:0-2-7,Edge], [25:0-0-10,0-2-7], [31:0-4-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.01	25	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 245 lb	FT = 20%

LUMBER	BRACING
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2 *Except* B4:2x6 SP No.2
OTHERS	2x4 SP No.3
WEDGE	Right: 2x4 SP No.2
SLIDER	Left 2x4 SP No.3 -- 1-11-0

REACTIONS	FORCES
All bearings 39-0-0.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
(lb) - Max Horiz	2=149 (LC 15)
Max Uplift	All uplift 100 (lb) or less at joint(s) 2, 25, 27, 28, 29, 30, 32, 33, 34, 35, 37, 39, 40, 41, 43, 44, 45, 46, 47
Max Grav	All reactions 250 (lb) or less at joint(s) 2, 25, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 43, 44, 45, 46, 47

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2'-0" oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 37, 25, 39, 40, 41, 43, 44, 45, 46, 47, 35, 34, 33, 32, 30, 29, 28, 27.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 31, 36, 35, 34, 33, 32, 30, 29, 28, 27.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72500978	Truss A2	Truss Type Truss	Qty 10	Ply 1	MUNGO HOMES - MCDOWELL A ROOF Job Reference (optional)
-----------------	-------------	---------------------	-----------	----------	---

UFPI Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MITek Industries, Inc. Mon Jan 13 11:55:11

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-slQ6Rlqq66qB8ixjHz8xX9g4kgiuuBE3yvx6yzvo_E

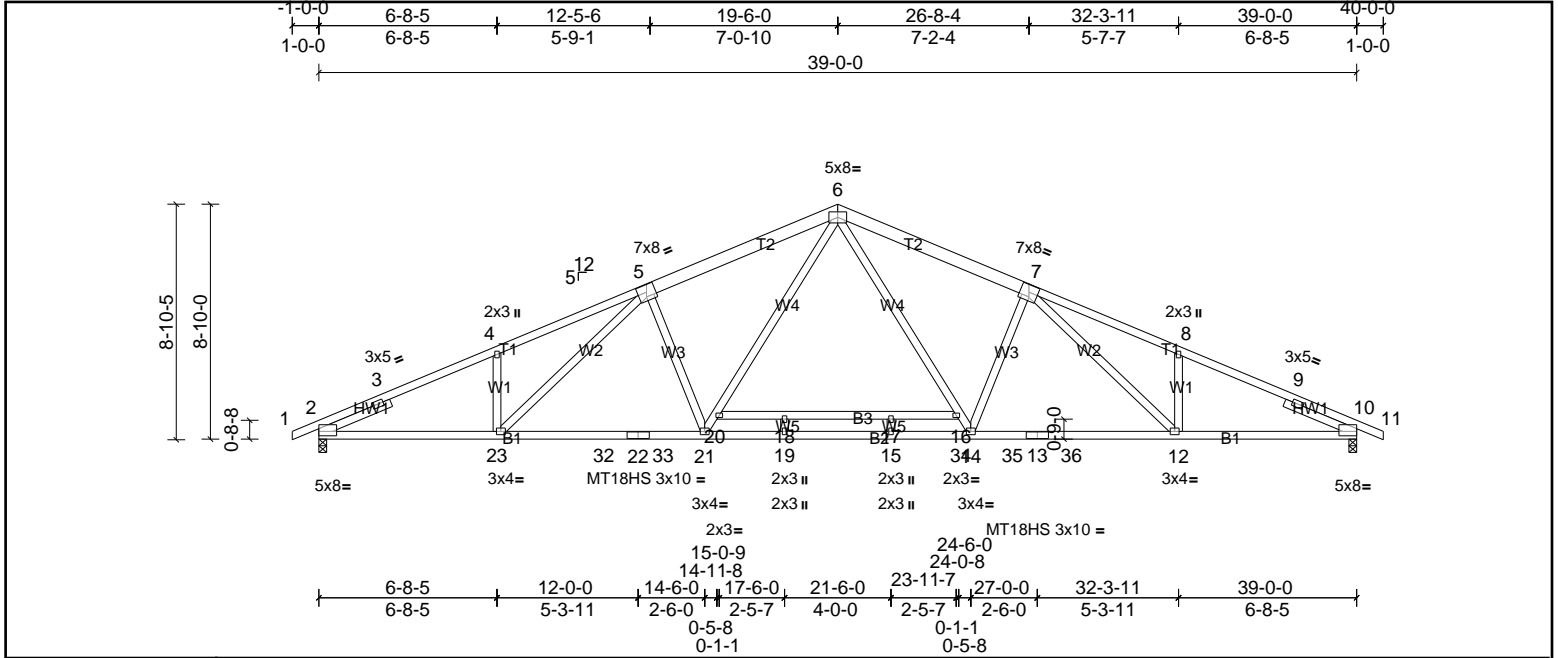


Plate Offsets (X, Y): [2:Edge,0-3-3], [5:0-4-0,0-3-4], [7:0-4-0,0-3-4], [10:Edge,0-3-3]

Loading	(psf)	Spacing	2-3-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.78	Vert(LL)	-0.44	15-19	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.96	Vert(CT)	-0.91	15-19	>515	180	MT18HS	244/190
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.67	Horz(CT)	0.15	10	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 238 lb	FT = 20%

LUMBER

TOP CHORD 2x6 SP No.2 *Except* T1:2x4 SP SS
BOT CHORD 2x4 SP SS *Except* B3:2x4 SP No.2
WEBS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 2-11-0, Right 2x4 SP No.3 -- 2-11-0

BRACING

TOP CHORD 2-0-0 oc purlins (2-8-12 max.)
(Switched from sheeted: Spacing > 2-0-0).
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(lb/size) 2=1927/0-3-8, (min. 0-3-0), 10=1927/0-3-8, (min. 0-3-0)
Max Horiz 2=166 (LC 11)
Max Uplift 2=209 (LC 10), 10=209 (LC 11)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1061/103, 3-4=-3631/754, 4-5=-3583/873, 5-6=-3215/719, 6-7=-3215/719, 7-8=-3583/873, 8-9=-3631/754, 9-10=-1052/103
BOT CHORD 2-23=-565/3281, 23-32=-414/3077, 22-32=-414/3077, 22-33=-414/3077, 21-33=-414/3077, 19-21=-195/2421, 15-19=-195/2421, 15-34=-195/2421, 14-34=-195/2421, 14-35=-414/3077, 13-35=-414/3077, 13-36=-414/3077, 12-36=-414/3077, 10-12=-565/3281
WEBS 5-21=-608/353, 20-21=-194/1044, 6-20=-157/1170, 6-16=-157/1170, 14-16=-194/1044, 7-14=-608/353, 5-23=-217/465, 7-12=-217/465

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- All plates are 2x3 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 209 lb uplift at joint 2 and 209 lb uplift at joint 10.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72500978	Truss A2G	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL A ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	---

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:55:12

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-KV_Ve2rStPy2msWwrhIA4NDQr4HTdmVCBNfVfOzvo_D

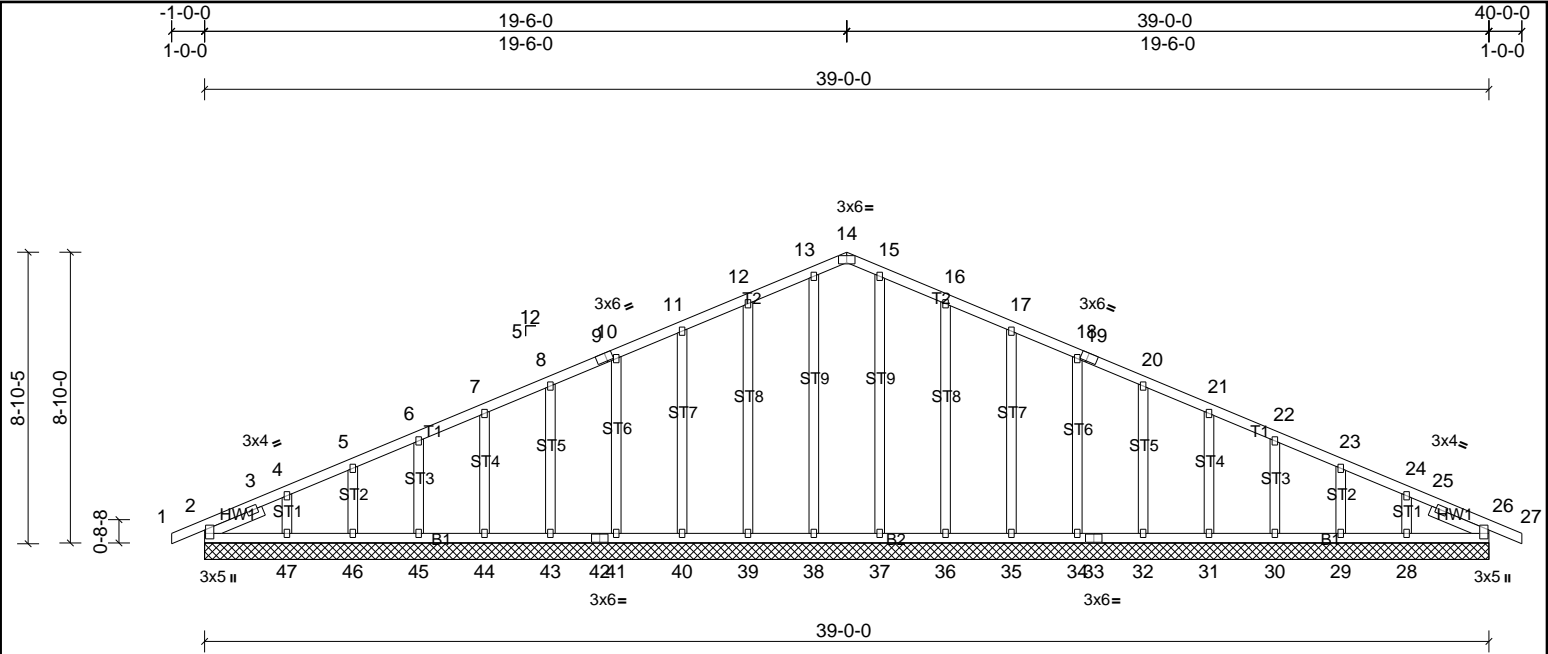


Plate Offsets (X, Y): [2:0-3-3,0-0-6], [9:0-2-7,Edge], [14:0-3-0,Edge], [19:0-2-7,Edge], [26:0-3-3,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.01	26	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 251 lb
											FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	
SLIDER Left 2x4 SP No.3 -- 1-11-0, Right 2x4 SP No.3 -- 1-11-0	

REACTIONS	All bearings 39-0-0.
(lb) - Max Horiz	2=149 (LC 11)
Max Uplift	All uplift 100 (lb) or less at joint(s) 2, 28, 29, 30, 31, 32, 34, 35, 36, 39, 40, 41, 43, 44, 45, 46, 47
Max Grav	All reactions 250 (lb) or less at joint(s) 2, 26, 28, 29, 30, 31, 32, 34, 35, 36, 37, 38, 39, 40, 41, 43, 44, 45, 46, 47

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 39, 40, 41, 43, 44, 45, 46, 47, 36, 35, 34, 32, 31, 30, 29, 28.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:55:12 Page: 1
ID:g6xmDaGgGpr4T8wcGw4bQWzKH9V-KV_Ve2rStPy2msWrrhfA4NDQH4GpdoDCBNfV0zvo_D

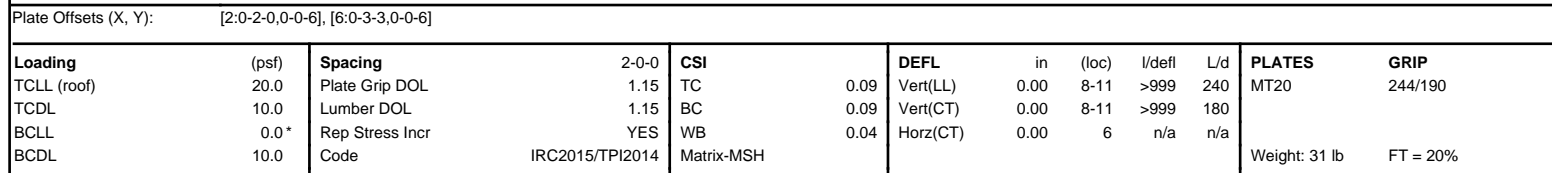

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 107 lb uplift at joint 2 and 107 lb uplift at joint 6.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

