

April 2, 2025

Mr. Rich Sherman  
New Home Inc.  
[rich.sherman@newhomeinc.com](mailto:rich.sherman@newhomeinc.com)

**Report of Footing Examination  
Duncan's Creek - Lot 36  
635 Beacon Hill Road  
Lillington, North Carolina  
Our Project Number 121-22-110410**

Gentlemen:

As requested, our representative was present onsite on April 1, 2025, to retest the shallow subsurface soils of the footing excavations of Lot 36 of the residential home located at 635 Beacon Hill Road in Lillington, North Carolina due to recent rainfall. Based upon our understanding of the planned residential construction, we have assumed an allowable soil bearing capacity of 2,000 pounds per square foot (psf).

Our testing consisted of visual observations, hand rod probing, and dynamic cone penetrometer testing in accordance with ASTM STP-399 at selected locations to a maximum depth of 3 feet below the bearing surface. Our scope did not include mechanically drilled soil test borings to evaluate deeper subsurface soil conditions that could affect foundation support. Deeper borings can be provided, if desired. The results of the footing examinations indicated that the design bearing pressure of 2,000 pounds per square foot (psf) was available at the locations and depths tested at the time of our investigation.


Exposure to the environment, especially rainfall, may weaken the soils at the foundation bearing surface, if they are exposed for extended periods of time prior to concrete placement. If the foundation bearing surface becomes softened due to exposure, the soft soils should be removed prior to placement of concrete.

If you have any questions concerning this information, please contact us.

Sincerely,

NV5 Engineers and Consultants, Inc. (F-1333)

William M. Cruikshank, P.E.  
Geotechnical Engineer

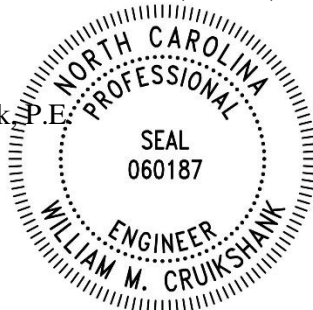

A handwritten signature in black ink, appearing to read "Justin R. Pescosolido".

Justin R. Pescosolido, P.E.  
Principal Geotechnical Engineer