

**Mark Morris, P.E.**

#126, 1317-M, Summerville, SC 29483  
843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 57150  
JOB: 25-1836-F02  
JOB NAME: LOT 0.0025 CAMPBELL RIDGE  
Wind Code: N/A  
Wind Speed: Vult= N/A  
Exposure Category: N/A  
Mean Roof Height (feet): N/A  
These truss designs comply with IRC 2015 as well as IRC 2018.  
*16 Truss Design(s)*

**Trusses:**

F01, F02, F03, F04, F05, F06, F07, F08, F09, F10, F12, F13, F14, F15, F16, F17



**2/25/2025**

**Mark Morris**

***Warning !—Verify design parameters and read notes before use.***

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F01	Floor Supported Gable	1	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:35 2025 Page 1  
ID:C6coucD2lwHaZ3sGy11mE3yowb3-\_u3TrcWXvhLrPD171eptRM0D4ky\_8Q8\_ThmlBvzhF?2

0-1-8

0-1-8

Scale = 1:19.9

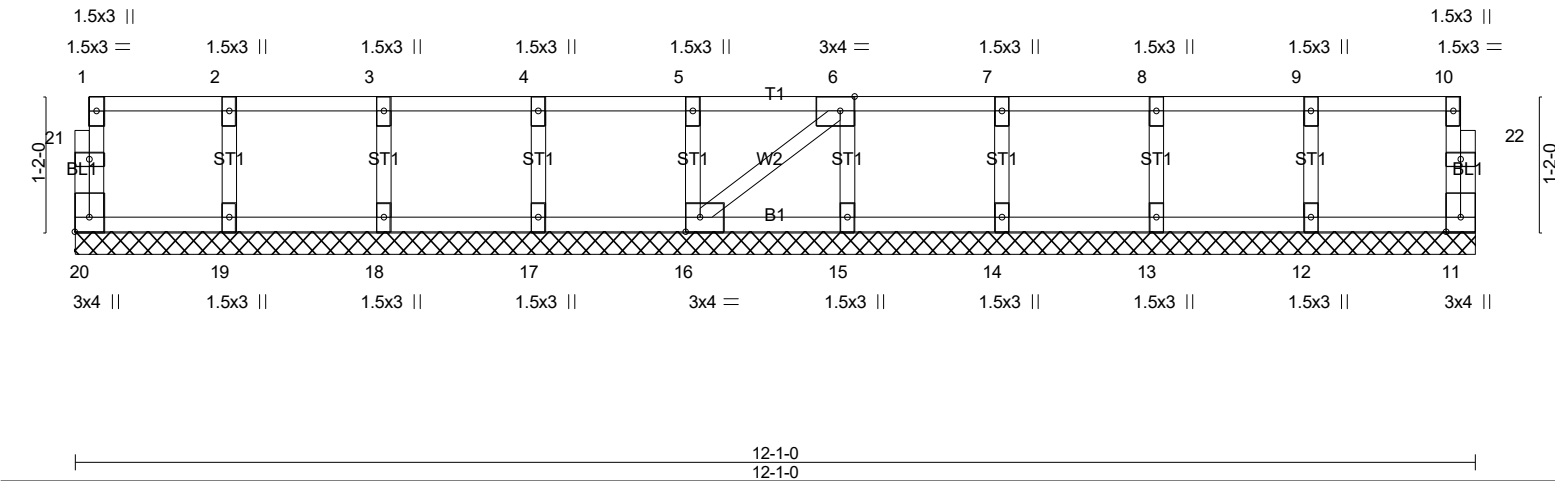


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [16:0-1-8,Edge], [20:Edge,0-1-8]		12-1-0		12-1-0	
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	in (loc)	L/d
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL)	n/a -	n/a 999
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT)	n/a -	n/a 999
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00 11	n/a n/a
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
			PLATES	GRIP	
			MT20	244/190	
			Weight: 54 lb	FT = 20%F, 11%E	


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 12-1-0.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 20, 11, 19, 18, 17, 16, 15, 14, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (5)  
1) Gable requires continuous bottom chord bearing.  
2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
3) Gable studs spaced at 1-4-0 oc.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

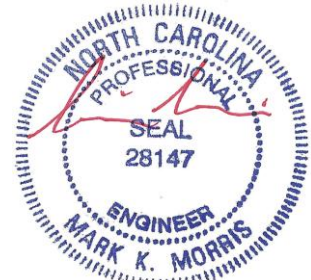

2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F02	Floor	5	1	Job Reference (optional) <b># 57150</b>

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:36 2025 Page 1  
ID:C6coucD2lwHaZ3sGy11mE3yowb3-S4dr2yW9g?Ti1NcJbMK6\_ZZLF8BTtos8hLVrjLzhF?1

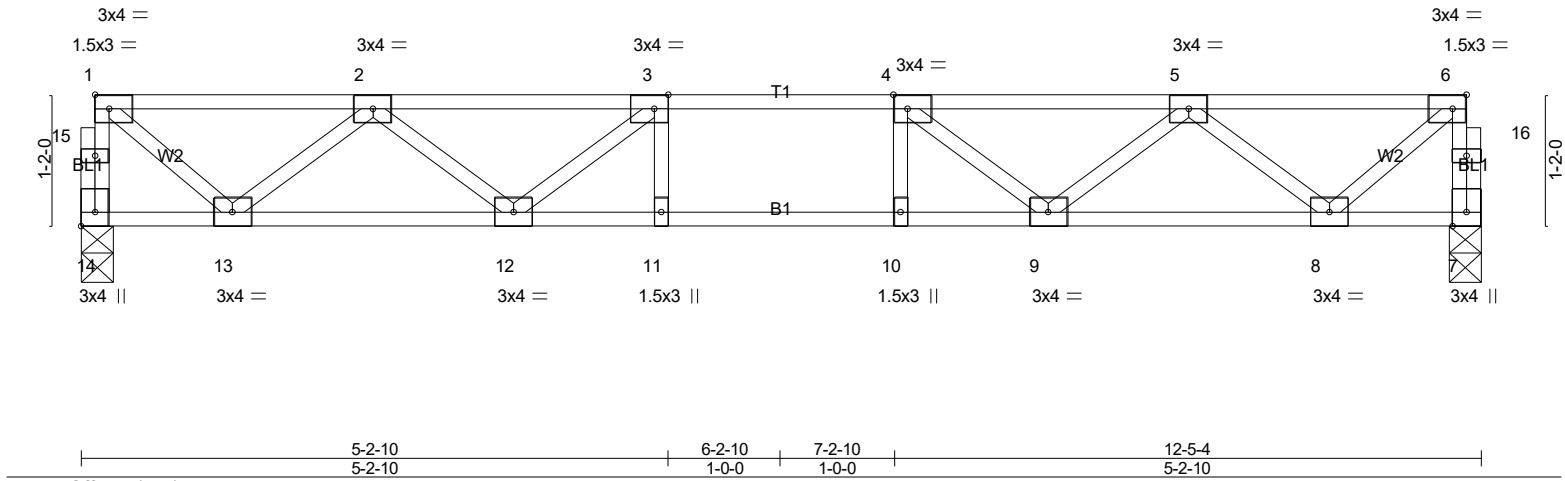



Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [6:0-1-8,Edge], [14:Edge,0-1-8]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	1-7-3	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	L/defl	L/d
TCLL 40.0	Plate Grip DOL	1.00	TC 0.23	Vert(LL)	-0.07 11-12	>999	480
TCDL 10.0	Lumber DOL	1.00	BC 0.44	Vert(CT)	-0.09 11	>999	360
BCLL 0.0	Rep Stress Incr	YES	WB 0.32	Horz(CT)	0.02 7	n/a	n/a
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH				
				<b>PLATES</b>	<b>GRIP</b>		
				MT20	244/190		
				Weight: 62 lb		FT = 20%F, 11%E	

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 14=531/0-3-6 (min. 0-1-8), 7=531/0-3-6 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 14-15=-528/0, 1-15=-527/0, 7-16=-528/0, 6-16=-527/0, 1-2=-533/0, 2-3=-1304/0, 3-4=-1546/0, 4-5=-1304/0, 5-6=-533/0


BOT CHORD 12-13=0/1055, 11-12=0/1546, 10-11=0/1546, 9-10=0/1546, 8-9=0/1055

WEBS 3-12=-396/0, 2-12=0/335, 2-13=-679/0, 1-13=0/675, 4-9=-396/0, 5-9=0/335, 5-8=-679/0, 6-8=0/675

**NOTES-** (3-6)

- Unbalanced floor live loads have been considered for this design.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
- Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
- SEE BCSI-B3 SUMMARY SHEET - PERMANENT RESTRAING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard

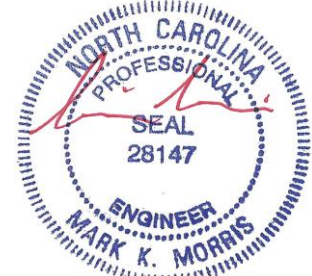

2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F03	Floor	1	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:36 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-S4dr2yW9g?T11NcJbMK6\_ZZLE8BTod8hLvrJLzhF?1

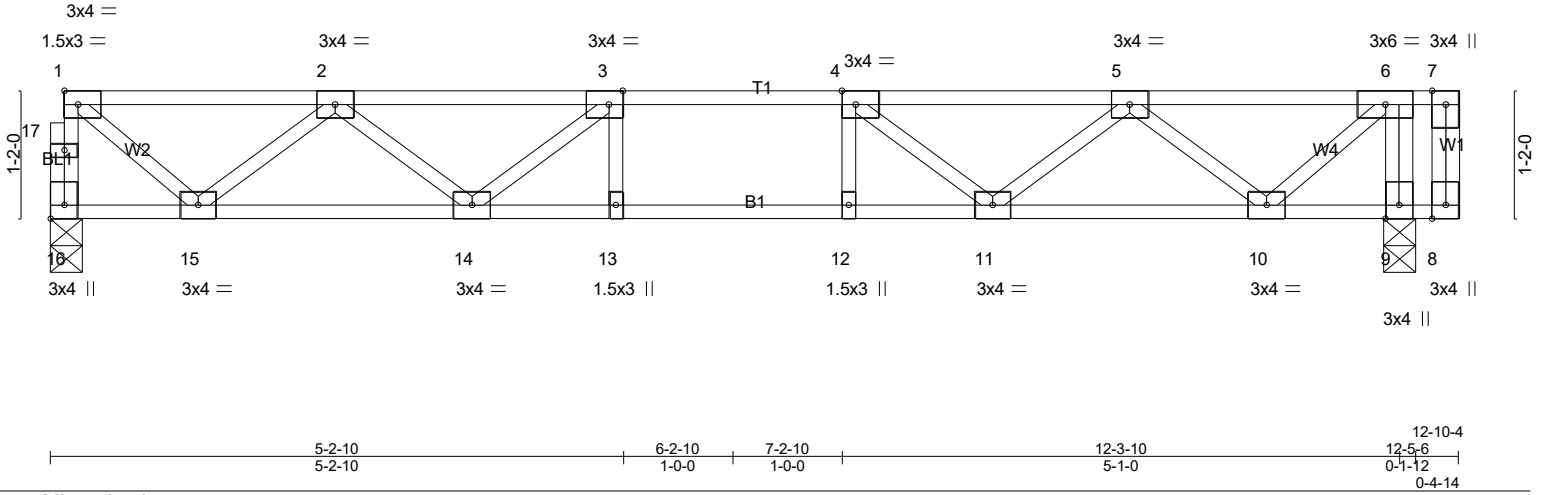



Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [16:Edge,0-1-8]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 1-7-3		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES</b> <b>GRIP</b>			
TCLL	40.0	Plate Grip DOL	1.00	TC	0.23	Vert(LL)	-0.07	13-14	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.44	Vert(CT)	-0.09	13-14	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.34	Horz(CT)	0.02	9	n/a	n/a		
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH							Weight: 67 lb	FT = 20%F, 11%E


<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 16=530/0-3-6 (min. 0-1-8), 9=574/0-3-8 (min. 0-1-8)  
Max Grav 16=530(LC 3), 9=574(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 16-17=-528/0, 1-17=-527/0, 1-2=-532/0, 2-3=-1302/0, 3-4=-1543/0, 4-5=-1297/0, 5-6=-535/0  
BOT CHORD 14-15=0/1053, 13-14=0/1543, 12-13=0/1543, 11-12=0/1543, 10-11=0/1046  
WEBS 6-9=-615/0, 3-14=-395/0, 2-14=0/334, 2-15=-678/0, 1-15=0/674, 4-11=-400/0, 5-11=0/338, 5-10=-666/0, 6-10=0/707

- NOTES-** (4-7)
- Unbalanced floor live loads have been considered for this design.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAINING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard

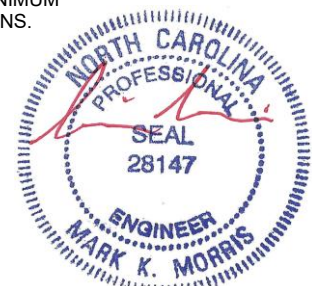


2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F04	Floor	1	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:37 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-wGBEGIXnRJbZeXBW93rLWn5VOYWkcF2Hw?FPGnzhF?0

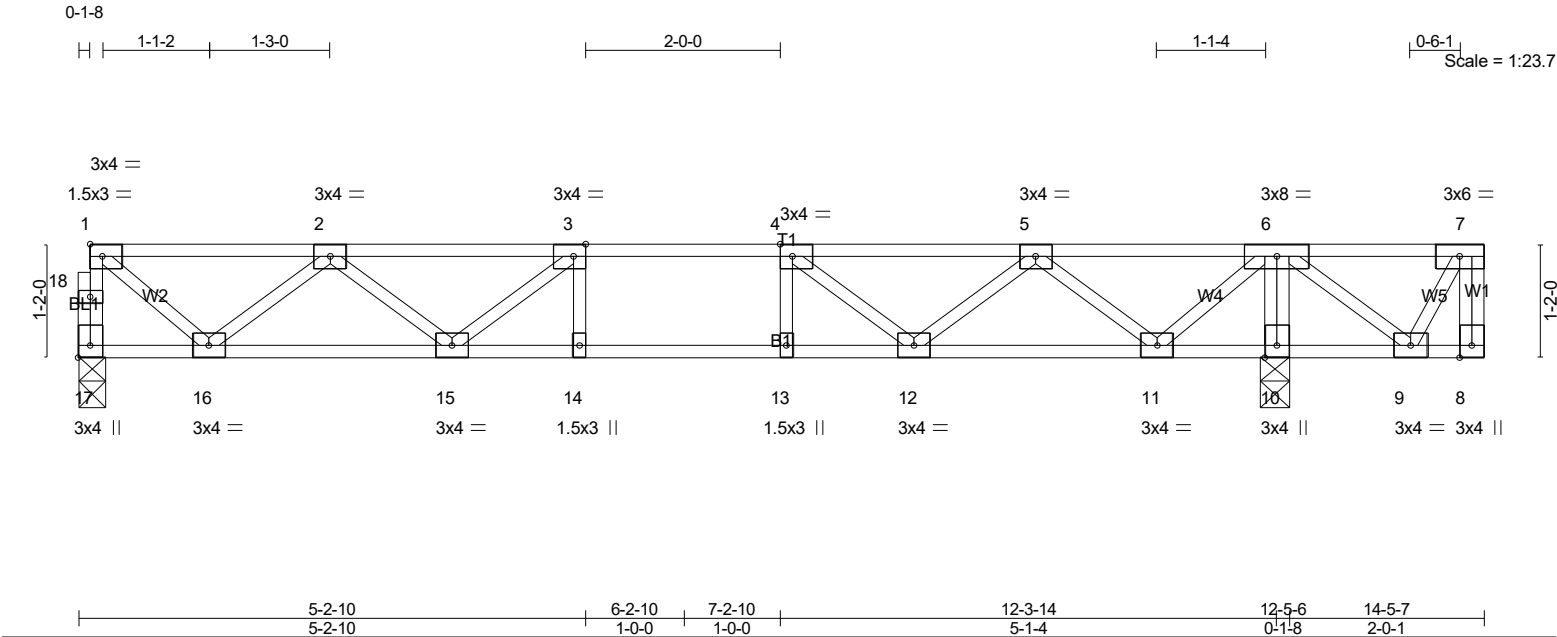

LOADING (psf)	SPACING-	1-7-3	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.27	Vert(LL)	-0.07 14-15	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.46	Vert(CT)	-0.09 14-15	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.33	Horz(CT)	0.02 10	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 75 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 10-11,9-10.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 17=517/0-3-6 (min. 0-1-8), 10=727/0-3-8 (min. 0-1-8)  
Max Grav 17=527(LC 3), 10=727(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 17-18=-525/0, 1-18=-524/0, 1-2=-529/0, 2-3=-1292/0, 3-4=-1526/0, 4-5=-1275/0, 5-6=-503/0  
BOT CHORD 15-16=0/1047, 14-15=0/1526, 13-14=0/1526, 12-13=0/1526, 11-12=0/1017  
WEBS 6-10=-707/0, 3-15=-387/0, 2-15=0/328, 2-16=-674/0, 1-16=0/670, 4-12=-440/0, 5-12=0/366, 5-11=-672/0, 6-11=0/684

- NOTES- (4-7)
- Unbalanced floor live loads have been considered for this design.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION. Do not erect truss backwards.
  - Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

LOAD CASE(S) Standard



2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:38 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-PTkcTeYQCcJQGhmiinMa3 ef4yrbLizR9f yoEzhF???

	5-2-10	6-2-10	7-2-10		12-3-14	12-5-6	16-0-9
	5-2-10	1-0-0	1-0-0		5-1-4	0-1-8	3-7-3
Plate Offsets (X,Y)--	[3:0-1-8,Edge], [4:0-1-8,Edge], [19:Edge,0-1-8]						

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.




Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:38 2025 Page 1  
ID:C6coucD2lwHaZ3sGy11mE3yowb3-PTkcTeYQCcjQGhmiinMa3 egyysQLlR9f yoEzhF???

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F07	FLOOR	7	1	
					Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:39 2025 Page 1  
ID:C6coucD2lwHaZ3sGy1mE3yowb3-tfl\_g\_Z2zwrHurLuGUtpbCpGM4a47waOJkVKgzhF?

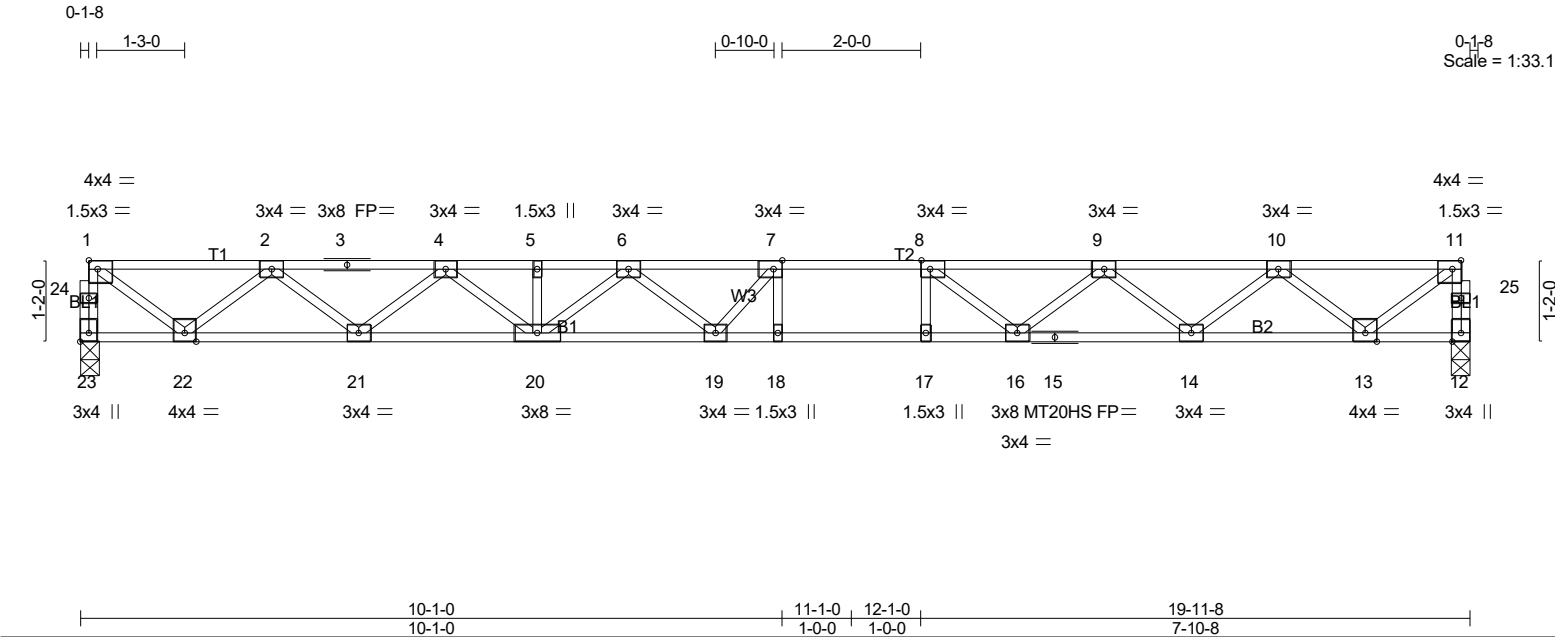

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.43	Vert(LL)	-0.32	18	>736	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.99	Vert(CT)	-0.44	18-19	>535	360	MT20HS	187/143
BCLL 0.0	Rep Stress Incr	YES	WB 0.49	Horz(CT)	0.06	12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
										Weight: 100 lb FT = 20%F, 11%E

<b>LUMBER-</b>			<b>BRACING-</b>		
TOP CHORD	2x4 SP No.1(flat)		TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD	2x4 SP No.1(flat)		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 18-19,17-18.	
WEBS	2x4 SP No.3(flat)				

**REACTIONS.** (lb/size) 23=718/0-3-8 (min. 0-1-8), 12=718/0-3-0 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 23-24=-715/0, 1-24=-714/0, 12-25=-714/0, 11-25=-713/0, 1-2=-855/0, 2-3=-2137/0, 3-4=-2137/0, 4-5=-2994/0, 5-6=-2994/0, 6-7=-3356/0, 7-8=-3344/0, 8-9=-2961/0, 9-10=-2139/0, 10-11=-854/0

BOT CHORD 21-22=0/1614, 20-21=0/2638, 19-20=0/3277, 18-19=0/3344, 17-18=0/3344, 16-17=0/3344, 15-16=0/2637, 14-15=0/2637, 13-14=0/1614

WEBS 1-22=0/1037, 2-22=-987/0, 2-21=0/681, 4-21=-652/0, 4-20=0/455, 6-20=-361/0, 6-19=-49/276, 8-16=-623/0, 9-16=0/468, 9-14=-648/0, 10-14=0/684, 10-13=-988/0, 11-13=0/1036, 7-19=-288/250


**NOTES-** (4)

1) Unbalanced floor live loads have been considered for this design.

2) All plates are MT20 plates unless otherwise indicated.

3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard




2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F08	Floor	3	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:40 2025 Page 1  
ID:C6coucD2lwHaZ3sGy11mE3yowb3-LrsMuKagkEz8V?w4qBP28PjzDIVJpbjczT3r6zhF\_z

0-1-8  
  
0-1-8  
Scale = 1:33.1

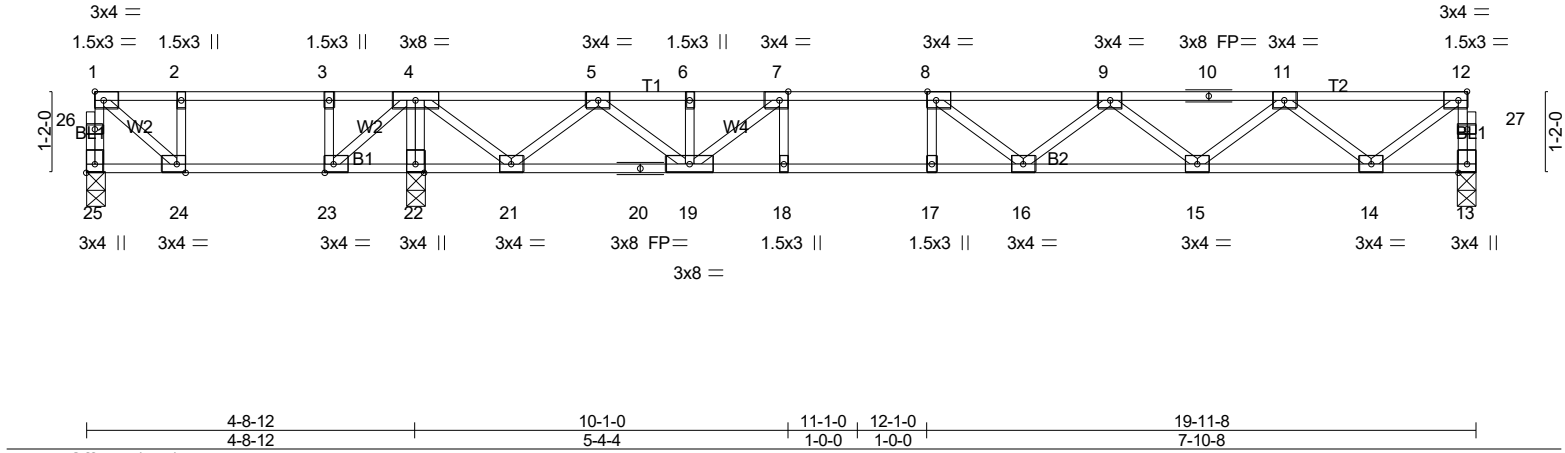


Plate Offsets (X,Y)--		[7:0-1-8,Edge], [8:0-1-8,Edge], [12:0-1-8,Edge], [23:0-1-8,Edge], [24:0-1-8,Edge], [25:Edge,0-1-8]	
<b>LOADING</b> (psf)	<b>SPACING</b>	<b>CSI</b>	<b>DEFL.</b>
TCLL 40.0	1-4-0	TC 0.48	in (loc) l/defl L/d
TCDL 10.0	Plate Grip DOL 1.00	BC 0.70	Vert(LL) -0.17 16-17 >999 480
BCLL 0.0	Lumber DOL 1.00	WB 0.39	Vert(CT) -0.22 16-17 >807 360
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 13 n/a n/a
	Code IRC2021/TPI2014		
		<b>PLATES</b>	<b>GRIP</b>
		MT20	244/190
		Weight: 101 lb FT = 20%F, 11%E	

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 25=99/0-3-8 (min. 0-1-8), 13=530/0-3-0 (min. 0-1-8), 22=809/0-3-8 (min. 0-1-8)  
Max Horz 25=26(LC 4)  
Max Uplift 25=-49(LC 11), 13=-46(LC 7)  
Max Grav 25=157(LC 12), 13=549(LC 18), 22=809(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 13-27=-546/48, 12-27=-545/47, 2-3=-311/289, 3-4=-435/442, 4-5=-664/364, 5-6=-1327/11,  
6-7=-1403/180, 7-8=-1789/0, 8-9=-1817/0, 9-10=-1450/0, 10-11=-1450/0, 11-12=-625/44  
BOT CHORD 22-23=-455/225, 21-22=-452/226, 20-21=0/1105, 19-20=0/963, 18-19=-207/1882,  
17-18=0/1789, 16-17=0/1789, 15-16=0/1750, 14-15=-25/1139  
WEBS 7-18=-124/260, 4-22=-839/0, 4-23=-93/440, 4-21=-77/852, 5-21=-760/90, 5-19=-105/544,  
8-16=-436/441, 9-16=-249/347, 9-15=-475/144, 11-15=-135/505, 11-14=-744/119,  
12-14=-93/787, 7-19=-908/379

**NOTES-** (6)  
1) Unbalanced floor live loads have been considered for this design.  
2) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 49 lb uplift at joint 25 and 46 lb uplift at joint 13.  
3) This truss has been designed for a total drag load of 125 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 4-8-12 to 19-11-8 for 163.8 plf.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
5) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard




2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F09	Floor	1	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:41 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-p2Qk5faIVX5?78UHOvwHhdGBB9u8Y3WtrdDcOZzhF\_y

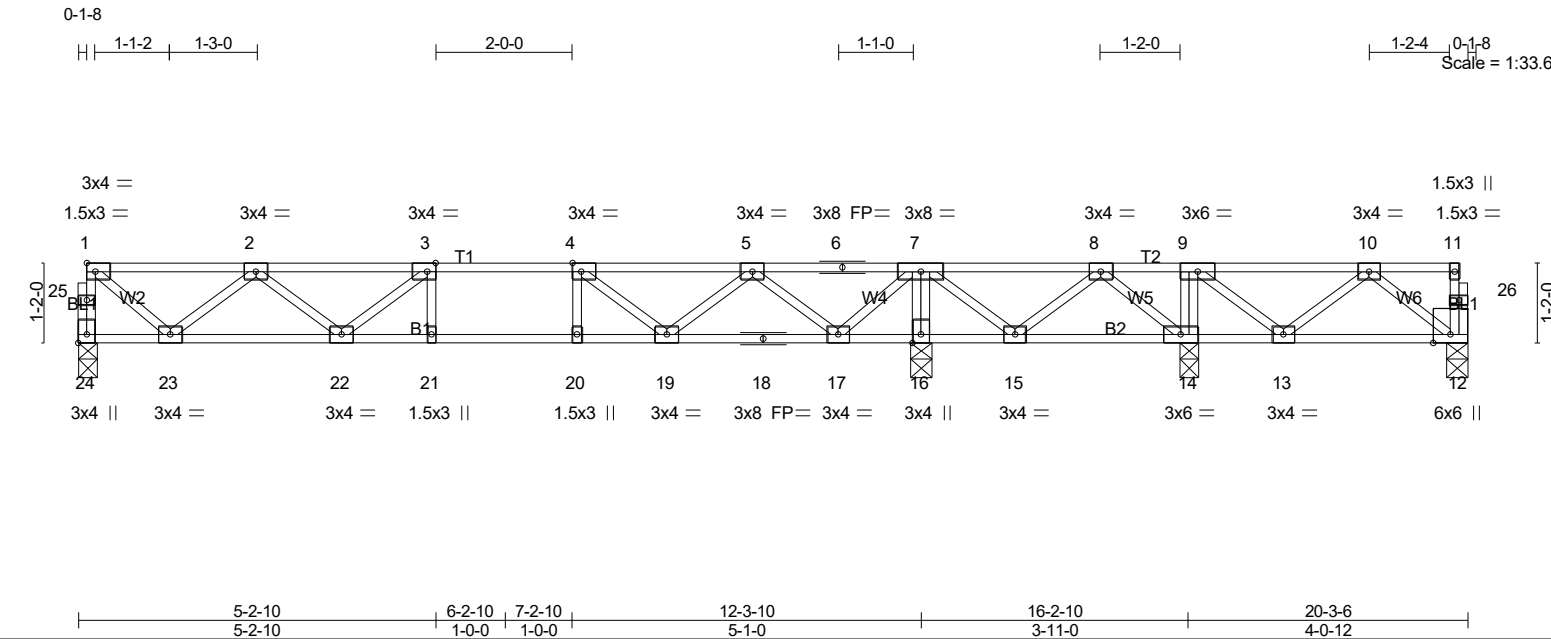

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.28	Vert(LL)	-0.07 21-22	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.47	Vert(CT)	-0.10 21-22	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.36	Horz(CT)	0.01 16	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
									Weight: 105 lb FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. All bearings 0-3-8 except (jt=length) 24=0-3-6.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 12 except 24=471(LC 5), 16=940(LC 3), 14=350(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 24-25=-466/0, 1-25=-465/0, 1-2=-464/0, 2-3=-1088/0, 3-4=-1196/0, 4-5=-818/0, 5-6=-117/290, 6-7=-117/290, 7-8=0/468  
BOT CHORD 22-23=0/921, 21-22=0/1196, 20-21=0/1196, 19-20=0/1196, 18-19=0/481, 17-18=0/481, 16-17=-788/0, 15-16=-784/0, 14-15=-255/58  
WEBS 7-16=-922/0, 9-14=-256/0, 2-23=-596/0, 1-23=0/587, 4-19=-491/0, 5-19=0/445, 5-17=-744/0, 7-17=0/755, 7-15=0/398, 8-15=-359/0, 8-14=-155/267

- NOTES- (4-7)
- Unbalanced floor live loads have been considered for this design.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

LOAD CASE(S) Standard

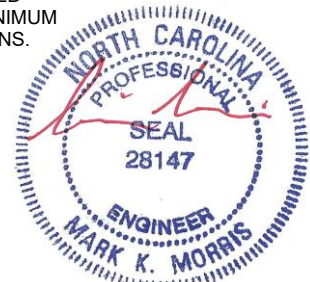


2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F10	Floor	1	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:41 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-p2Qk5faIVX5?78UHOvwHhdGBq9uoY3XtrdDcOZzhF\_y

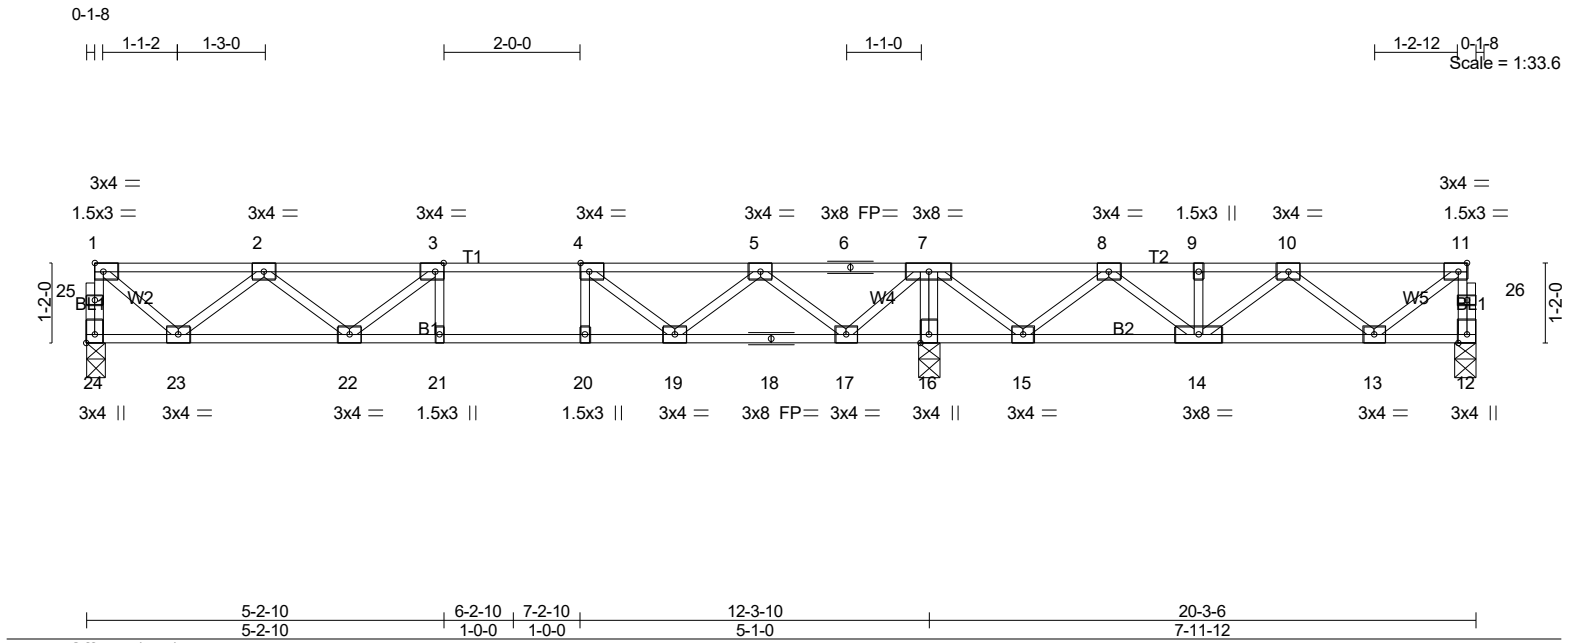

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.30	Vert(LL)	-0.07 21-22	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.49	Vert(CT)	-0.10 21-22	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.36	Horz(CT)	0.01 12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 104 lb	FT = 20%F, 11%E

#### LUMBER-

TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** (lb/size) 24=462/0-3-6 (min. 0-1-8), 12=234/0-3-8 (min. 0-1-8), 16=1055/0-3-8 (min. 0-1-8)  
Max Grav 24=473(LC 3), 12=295(LC 4), 16=1055(LC 1)


**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 24-25=-468/0, 1-25=-467/0, 12-26=-291/0, 11-26=-291/0, 1-2=-466/0, 2-3=-1096/0,  
3-4=-1208/0, 4-5=-835/0, 5-6=-1/353, 6-7=-1/353, 7-8=-64/449, 8-9=-477/152,  
9-10=-477/152, 10-11=-275/20  
BOT CHORD 22-23=0/926, 21-22=0/1208, 20-21=0/1208, 19-20=0/1208, 18-19=-4/501, 17-18=-4/501,  
16-17=-857/0, 15-16=-852/0, 14-15=-292/385, 13-14=-59/505  
WEBS 7-16=-1035/0, 2-23=-599/0, 1-23=0/590, 4-19=-511/0, 5-19=0/458, 5-17=-742/0,  
7-17=0/754, 7-15=0/568, 8-15=-523/0, 10-13=-299/51, 11-13=-25/331

#### NOTES- (4-7)

- Unbalanced floor live loads have been considered for this design.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.
- Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
- Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
- SEE BCSI-B3 SUMMARY SHEET - PERMANENT RESTRAING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard

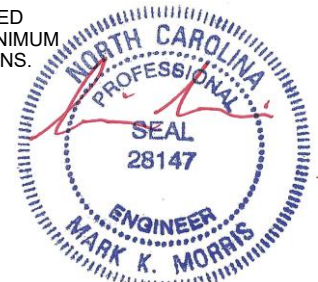


2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F12	Floor	2	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:42 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-HE\_7J?bwGrDslI3TxcRWDqoHQZ7yHVC04Hy9w?zhF\_x



0-1-8

Scale = 1:23.1

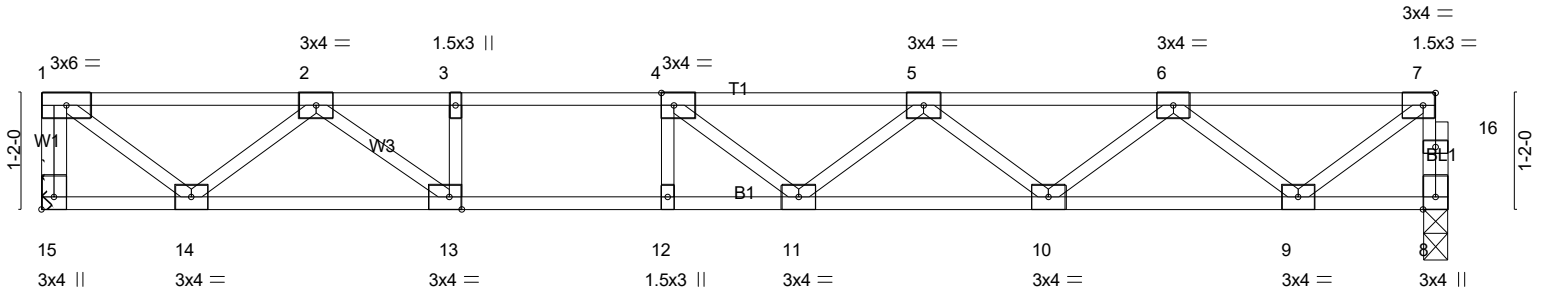

4-2-8		5-2-8		6-2-8		14-1-0					
4-2-8		1-0-0		1-0-0		7-10-8					
Plate Offsets (X,Y)-- [4:0-1-8,Edge], [7:0-1-8,Edge], [13:0-1-8,Edge], [15:Edge,0-1-8]											
<b>LOADING</b> (psf)		<b>SPACING-</b> 1-7-3		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>		<b>GRIP</b>	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.63	Vert(LL)	-0.18 11-12	>918	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.88	Vert(CT)	-0.24 11-12	>679	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.39	Horz(CT)	0.03 8	n/a	n/a		
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 70 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 15=608/Mechanical, 8=603/0-3-0 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-15=-584/0, 8-16=-600/0, 7-16=-599/0, 1-2=-647/0, 2-3=-1848/0, 3-4=-1848/0, 4-5=-1966/0, 5-6=-1613/0, 6-7=-684/0


BOT CHORD 13-14=0/1288, 12-13=0/1848, 11-12=0/1848, 10-11=0/1937, 9-10=0/1278

WEBS 3-13=-291/0, 1-14=0/812, 2-14=-834/0, 2-13=0/782, 4-11=-129/255, 5-10=-423/0, 6-10=0/436, 6-9=-772/0, 7-9=0/828

**NOTES-** (5)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard

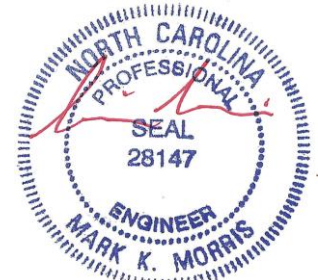

2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F13	Floor Supported Gable	1	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:42 2025 Page 1  
ID:lovsufdhNr7VckecRyt1FFyBNDc-HE\_7J?bwGrDsll3TxcRWDqoQKZKdHbs04Hy9w?zhF\_x

0-1-8

Scale: 1/2"=1'

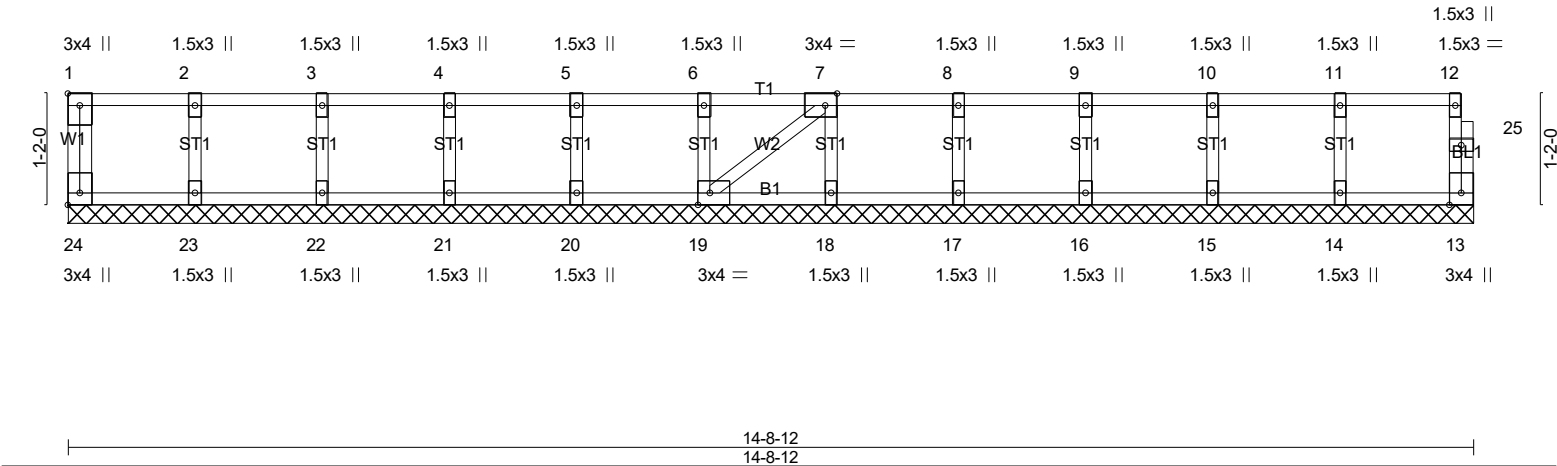


Plate Offsets (X,Y)--		[1:Edge,0-1-8], [7:0-1-8,Edge], [19:0-1-8,Edge], [24:Edge,0-1-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06
TCDL 10.0	Lumber DOL	1.00	BC 0.01
BCLL 0.0	Rep Stress Incr	YES	WB 0.03
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH
DEFL.	in (loc)	L/d	PLATES GRIP
Vert(LL)	n/a -	n/a 999	MT20 244/190
Vert(CT)	n/a -	n/a 999	
Horz(CT)	0.00 13	n/a n/a	
		Weight: 65 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 14-8-12.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 24, 13, 23, 22, 21, 20, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (6)  
1) Gable requires continuous bottom chord bearing.  
2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
3) Gable studs spaced at 1-4-0 oc.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F14	Floor	1	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:42 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-HE\_7J?bwGrDslI3TxcRWDqoLIZCOHXv04Hy9w?zhF\_x

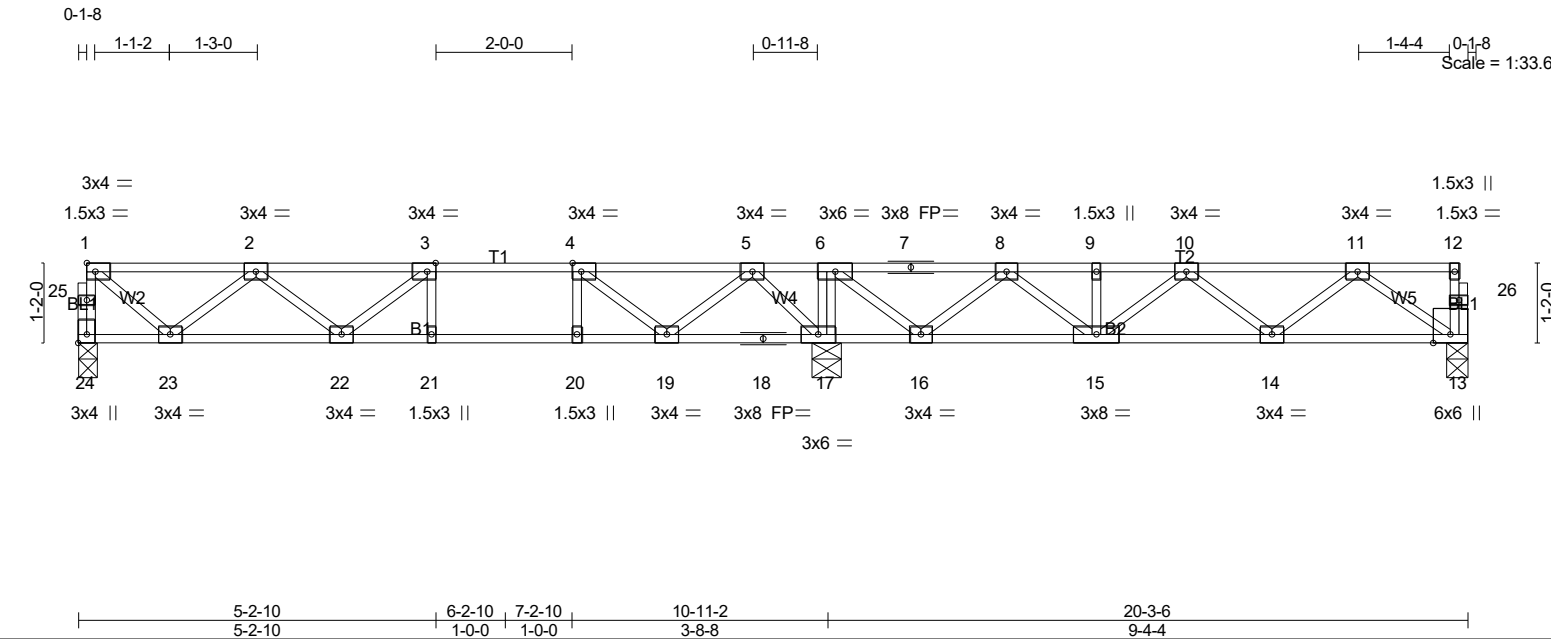

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.35	Vert(LL)	-0.08	21-22	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.53	Vert(CT)	-0.10	21-22	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.29	Horz(CT)	0.02	13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 104 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 17-19,16-17.
WEBS 2x4 SP No.3(flat)	
<b>REACTIONS.</b> (lb/size) 24=425/0-3-6 (min. 0-1-8), 17=979/0-5-8 (min. 0-1-8), 13=348/0-3-8 (min. 0-1-8) Max Grav24=443(LC 3), 17=979(LC 1), 13=379(LC 7)	

<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 24-25=-438/0, 1-25=-437/0, 1-2=-432/0, 2-3=-989/0, 3-4=-1037/0, 4-5=-588/25, 5-6=0/602, 6-7=-262/124, 7-8=-262/124, 8-9=-767/0, 9-10=-767/0, 10-11=-666/0
BOT CHORD 22-23=0/860, 21-22=0/1037, 20-21=0/1037, 19-20=0/1037, 16-17=-602/0, 15-16=0/622, 14-15=0/826, 13-14=0/479
WEBS 6-17=-526/0, 2-23=-557/0, 1-23=0/546, 4-19=-629/0, 5-19=0/529, 5-17=-650/0, 6-16=0/599, 8-16=-551/0, 8-15=0/266, 11-13=-584/0

- NOTES-** (4-7)
- Unbalanced floor live loads have been considered for this design.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.
  - Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.
  - SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard



2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:43 2025 Page 1  
ID:lovsufdhNr7VckecRyt1FFyBNDc-IQYVWLcY19LiMSeFVKylm2LPZzSi0rtAlxijSRzhF\_w

Structural drawing of a bridge truss. The drawing shows a side elevation of the truss structure with various members and joints labeled. Dimensions are provided for the overall structure and individual members. The scale is 1/2" = 1'.

Dimensions:

- Overall length: 1-3-0
- Overall height: 0-5-12
- Overall width: 2-0-0
- Overall depth: 1-0-0
- Overall width (right side): 0-1-8

Scale: 1/2" = 1'

Members and Joints:

- Members: 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100, 101, 102, 103, 104, 105, 106, 107, 108, 109, 110, 111, 112, 113, 114, 115, 116, 117, 118, 119, 120, 121, 122, 123, 124, 125, 126, 127, 128, 129, 130, 131, 132, 133, 134, 135, 136, 137, 138, 139, 140, 141, 142, 143, 144, 145, 146, 147, 148, 149, 150, 151, 152, 153, 154, 155, 156, 157, 158, 159, 160, 161, 162, 163, 164, 165, 166, 167, 168, 169, 170, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794, 795, 796, 797, 798, 799, 800,

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals
BOT CHORD 2x4 SP No.1(flat)	(Switched from sheeted: Spacing > 2-0-0).
WEBS 2x4 SP No.3(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
<b>REACTIONS.</b> (lb/size) 20=1152/Mechanical, 13=1274/0-3-8 (min. 0-1-8)	

**NOTES-** (9)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 5) CAUTION, Do not erect truss backwards.
- 6) Use Simpson Strong-Tie THA422 (Single Chord Girder) or equivalent spaced at 5-11-8 oc max. starting at 2-0-12 from the left end to 14-0-4 to connect truss(es) F16 (1 ply 2x4 SP) to front face of top chord.
- 7) Fill all nail holes where hanger is in contact with lumber.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).


A circular professional engineer seal for the State of North Carolina. The outer ring contains the text "NORTH CAROLINA" at the top and "ENGINEER" at the bottom. Inside the ring, the word "PROFESSIONAL" is arched over the word "SEAL". Below "SEAL" is the license number "28147". At the bottom of the seal, the name "MARK K. MORRIS" is printed. A red ink signature is written across the seal, overlapping the "PROFESSIONAL" and "SEAL" text.

2/25/2025

**Warning 1—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F16	FLOOR	5	1	Job Reference (optional) # 57150

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:43 2025 Page 1  
ID:lovstufdhNr7VckecRyt1FFyBNDc-IQYVWLcY19LiMSeFVKylm2LR?zgn02PAIxijsRzhF\_w3x6 =

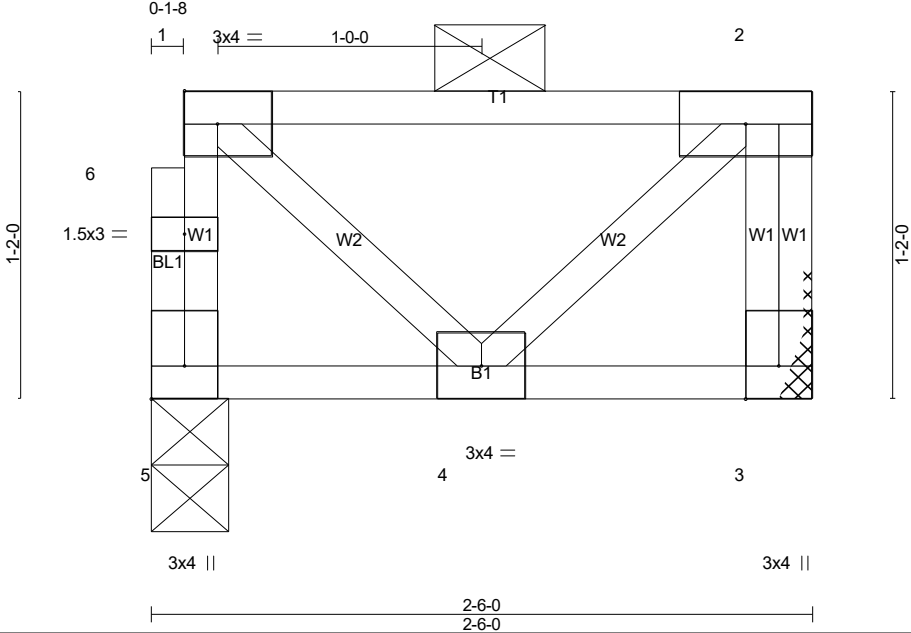

Scale = 1:8.7

Plate Offsets (X,Y)-- [5:Edge,0-1-8]					
LOADING (psf)	SPACING-	4-0-0	CSI.	DEFL.	in (loc) l/defl L/d
TCLL 40.0	Plate Grip DOL	1.00	TC 0.64	Vert(LL) -0.00	4 >999 480
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT) -0.00	5 >999 360
BCLL 0.0	Rep Stress Incr	NO	WB 0.01	Horz(CT) 0.00	3 n/a n/a
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P		
				PLATES	GRIP
				MT20	244/190
				Weight: 16 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD 2-0-0 oc purlins, except end verticals
BOT CHORD 2x4 SP No.1(flat)	(Switched from sheeted: Spacing > 2-0-0).
WEBS 2x4 SP No.3(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 5=235/0-3-8 (min. 0-1-8), 3=247/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES- (5)
- 1) Refer to girder(s) for truss to truss connections.
  - 2) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0025 CAMPBELL RIDGE   63 PINON DRIVE ANGIER, NC
25-1836-F02	F17	Floor	11	1	Job Reference (optional) <b># 57150</b>

Run: 8.430 s Feb 12 2021 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Wed Feb 26 15:10:43 2025 Page 1  
ID: C6coucD2lwHaZ3sGy11mE3yowb3-IQYVWLcY19LiMSeFVKylm2LXFzX90zDAlxijSRzhF\_w

0-8-12 1-3-0 2-0-0 1-2-14 0-1-8

Scale: 1/2"=1'

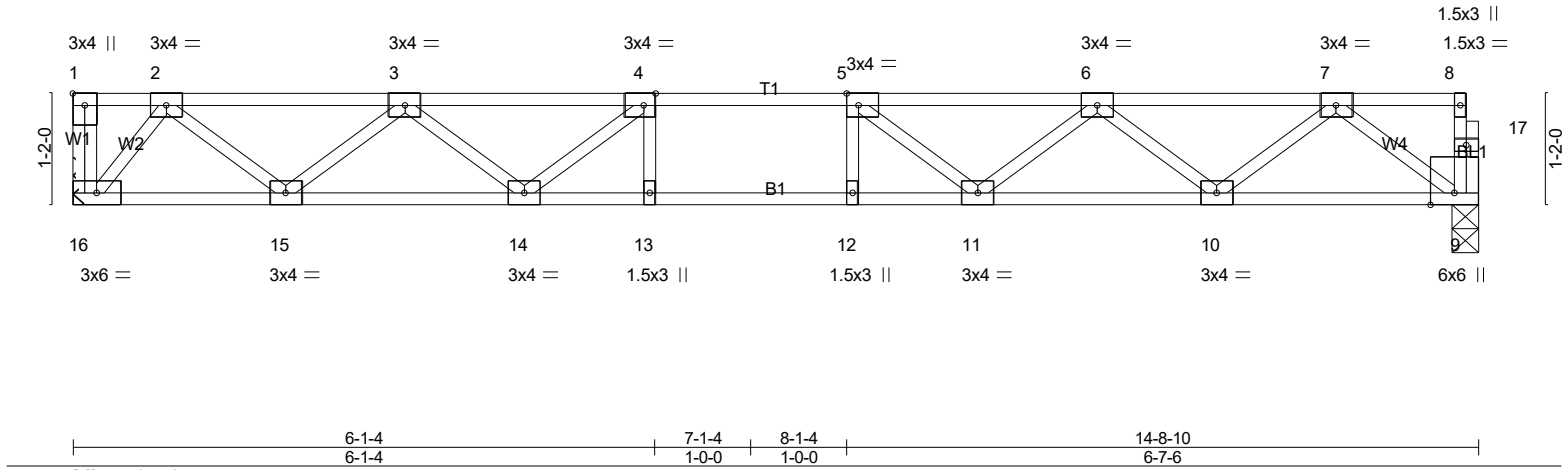


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [4:0-1-8,Edge], [5:0-1-8,Edge]																			
<b>LOADING</b> (psf)		<b>SPACING-</b>		1-7-3		<b>CSI.</b>		<b>DEFL.</b>		in (loc) l/defl L/d		<b>PLATES</b>		<b>GRIP</b>					
TCLL	40.0	Plate Grip DOL		1.00		TC 0.31		Vert(LL)		-0.12 11-12		>999		480		MT20		244/190	
TCDL	10.0	Lumber DOL		1.00		BC 0.63		Vert(CT)		-0.16 11-12		>999		360					
BCLL	0.0	Rep Stress Incr		YES		WB 0.35		Horz(CT)		0.03 9		n/a		n/a					
BCDL	5.0	Code IRC2021/TPI2014				Matrix-SH													
										Weight: 74 lb FT = 20%F, 11%E									

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 16=636/Mechanical, 9=631/0-3-6 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1074/0, 3-4=-1888/0, 4-5=-2183/0, 5-6=-1988/0, 6-7=-1284/0  
BOT CHORD 15-16=0/517, 14-15=0/1605, 13-14=0/2183, 12-13=0/2183, 11-12=0/2183, 10-11=0/1768, 9-10=0/775  
WEBS 4-14=-493/0, 3-14=0/396, 3-15=-691/0, 2-15=0/725, 2-16=-815/0, 5-11=-405/0, 6-11=0/339, 6-10=-629/0, 7-10=0/663, 7-9=-973/0

**NOTES-** (5-8)  
1) Unbalanced floor live loads have been considered for this design.  
2) Refer to girder(s) for truss to truss connections.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.  
5) Graphical bracing representation does not depict the size, type or the orientation of the brace on the member. Symbol only indicates that the member must be braced.  
6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.  
7) Web bracing shown is for lateral support of individual web members only. Refer to BCSI - Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses for additional bracing guidelines, including diagonal bracing.  
8) SEE BCSI-B3 SUMMARY SHEET- PERMANENT RESTRAINING/BRACING OF CHORDS & WEB MEMBERS FOR RECOMMENDED MINIMUM BRACING REQUIREMENTS OF TOP CHORD, BOTTOM CHORD, AND WEB PLANES. IN ADDITION TO THESE MINIMUM GUIDELINES, ALWAYS CONSULT THE PROJECT ARCHITECT OR ENGINEER FOR ADDITIONAL BRACING CONSIDERATIONS.

**LOAD CASE(S)** Standard

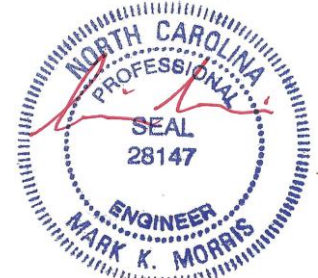

2/25/2025

**Warning !—Verify design parameters and read notes before use.** This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.