

CONSTRUCTION AUTHORIZATION FOR G.S. 130A-335(a2)

County: Harnett

Pre-Construction Conference Required: Yes ☐ No ☒

PIN/Lot Identifier: 0519-69-7624.000

Issued To: LGI Homes NC LLC

Property Location: 88 Teepee Drive, Lillington, NC

AOWE/PE Plans/Evaluations Provided: Yes ☒ No ☐ If yes, name and license number of AOWE/PE: Scott Mitchell - PE 27458

Facility Type: Single-Family Dwelling Unit

Number of bedrooms: 4 Number of Occupants: 8 or less Other: \_\_\_\_\_

☒ New ☐ Expansion ☐ Repair ☐ System Relocation ☐ Change of Use

Basement? ☐ Yes ☒ No Basement Fixtures? ☐ Yes ☐ No

Crawl Space? ☐ Yes ☒ No Slab Foundation? ☒ Yes ☐ No

Type of Wastewater System\* IIIb (Initial) IIIbe (Repair)

\*Please include system classification for proposed wastewater system types in accordance with Rule .1301 Table XXXII

Design Daily Flow: 480 GPD Wastewater Strength: ☒ Domestic ☐ High Strength ☐ Industrial Process WW

Session Law 2014-120 Section 53, Engineering Design Utilizing Low-flow Fixtures and Low-flow Technologies? ☐ Yes ☒ No  
(if yes, please provide engineering documentation)

Effluent Standard: ☒ DSE ☐ HSE ☐ NSF/ANSI 40 ☐ TS-I ☐ TS-II ☐ RCW

Type of Water Supply: ☐ Private well ☐ Public well ☐ Shared well ☒ Municipal Supply ☐ Spring ☐ Other: \_\_\_\_\_

**Installation Requirements/Conditions**

Septic Tank Size: 1,000 gallons Total Trench/Bed Length: 405 feet Trench/Bed Spacing: 9 feet on center  
Trench/Bed Width: 36 inches LTAR: 0.3 gpd/ft<sup>2</sup> Usable Depth to LC (Initial)\*: 38" <sup>\*Limiting condition</sup>

Soil Cover: 12 inches Slope Corrected Maximum Trench/Bed Depth\*: 24 inches <sup>\*Measured on the downhill side of the trench</sup>

Pump Tank Size (if applicable): 1,000 gallons Requires more than 1 pump? ☐ Yes ☒ No

Pump Requirements: 15 ft. TDH vs. 24 GPM Grease Trap Size (if applicable): N/A gallons

Distribution Method: ☐ Serial ☐ D-Box or Parallel ☒ Pressure Manifold(s) ☐ LPP ☐ Other: \_\_\_\_\_

Artificial Drainage Required: Yes ☐ No ☒ If yes, please specify details: \_\_\_\_\_

**Legal Agreements** (If the answer is "Yes" to any type of legal agreements, please attach a copy of the agreement.)

Multi-party Agreement Required [.0204(g)]: ☐ Yes ☒ No Declaration of Restrictive Covenants: ☐ Yes ☒ No

Easement, Right-of-Way, or Encroachment Agreement Required [.0301(b)]: ☐ Yes ☒ No

Management Entity Required: ☐ Yes ☒ No Minimum O&M Requirements: \_\_\_\_\_

**Permit conditions:**

Trench walls shall be raked when any Group III or Group IV soils are present.

Photo documentation of trench sidewall raking is required, where Group III or Group IV soils are present.

All lot corners and boundaries shall be clearly marked by a licensed surveyor prior to system installation.

Septic system installation not allowed when soil moisture conditions are near saturation within initial or repair drainfield areas.

No garbage disposals / insinkerators allowed in the house. County shall provide system O&M guidance materials to Owner.

The requirements of 15A NCAC 18E are incorporated by reference into this permit and shall be met. Systems shall be installed in accordance with the attached site sketch. This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be affected by a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of 15A NCAC 18E, or 15A NCAC 18A, 1900, as applicable, and to the conditions of this permit.

AOWE/PE Print Name: B. Scott Mitchell

AOWE/PE Signature: \_\_\_\_\_

Date: March 13, 2025

This AOWE/PE submittal is pursuant to and meets the requirements of G.S. 130A-335(a2) and (a5).

\*see attached site sketch\*

### ***This Section for Local Health Department Use Only***

Initial submittal received: \_\_\_\_\_ by \_\_\_\_\_  
Date Initials

G.S. 130A-335(a5) states the following:

*When an applicant for a Construction Authorization, or an Improvement Permit and Construction Authorization together, submits a Construction Authorization, or an Improvement Permit and Construction Authorization application together, the permit fee charged by the local health department, the common form developed by the Department, and any necessary signed and sealed plans or evaluations conducted by a person licensed pursuant to Chapter 89C of the General Statutes as a licensed engineer or a person certified pursuant to Article 5 of Chapter 90A of the General Statutes as an Authorized On-Site Wastewater Evaluator, the local health department shall, within five business days of receiving the application, conduct a completeness review of the submittal. A determination of completeness means that the Construction Authorization or Improvement Permit and Construction Authorization includes all of the required components. If the local health department determines that the Construction Authorization or Improvement Permit and Construction Authorization is incomplete, the local health department shall notify the applicant of the components needed to complete the Construction Authorization or Improvement Permit and Construction Authorization. The applicant may submit additional information to the local health department to cure the deficiencies in the Construction Authorization or Improvement Permit and Construction Authorization. The local health department shall make a final determination as to whether the Construction Authorization or Improvement Permit and Construction Authorization is complete within five business days after the local health department receives the additional information from the applicant. If the local health department fails to act within any period set out in this subsection, the applicant may treat the failure to act as a determination of completeness. The applicant may apply for the building permit for the project upon the decision of completeness of the Construction Authorization or Improvement Permit and Construction Authorization by the local health department or if the local health department fails to act within five business days. The Authorized On-Site Wastewater Evaluator or licensed engineer submitting the evaluation pursuant to this subsection may request that the local health department revoke or suspend the Construction Authorization or Improvement Permit and Construction Authorization for cause. Upon written request of the Authorized On-Site Wastewater Evaluator or licensed engineer, the local health department shall suspend or revoke the Construction Authorization or Improvement Permit and Construction Authorization pursuant to G.S. 130A-23. The Department shall develop a common form for use as the Construction Authorization.*

The review for completeness of this Construction Authorization was conducted in accordance with G.S. 130A-335(a5). This

Construction Authorization is determined to be:

☐ Incomplete (If box is checked, information in this section is required.)

The following items are missing: \_\_\_\_\_  
\_\_\_\_\_

Copies of this were sent to the AOWE/PE and the Applicant on \_\_\_\_\_  
Date

State Authorized Agent: \_\_\_\_\_ Date: \_\_\_\_\_

☐ Complete

State Authorized Agent: \_\_\_\_\_ Date of Issuance: \_\_\_\_\_

**This Construction Authorization is issued pursuant to G.S. 130A-335(a2) and (a5) using the signed and sealed plans or evaluations attached here. This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be affected by a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.**

**The Department, the Department's authorized agents, and the local health departments shall be discharged and released from any liabilities, duties, and responsibilities imposed by statute or in common law from any claim arising out of or attributed to plans, evaluations, preconstruction conference findings, submittals, or actions from a person licensed pursuant to Chapter 89C of the General Statutes as a licensed engineer or a person certified pursuant to Article 5 of Chapter 90A of the General Statutes as an Authorized On-Site Wastewater Evaluator in GS 130A-335(a2), (a5), and (a7). The Department, the Department's authorized agents, and the local health departments shall be responsible and bear liability for their actions and evaluations and other obligations under State law or rule, including the issuance of the operations permit pursuant to GS 130A-337.**

**Construction Authorization Expiration Date:** \_\_\_\_\_

**\*See attached site sketch\***



## Re-submittal of Construction Authorization

LHD USE ONLY: This CA resubmittal received: \_\_\_\_\_ by \_\_\_\_\_  
Date Initials

The following items are being resubmitted pursuant to G.S. 130A-335(a5) for issuance of the Construction Authorization:

---

---

---

---

I, \_\_\_\_\_ hereby attest that the information required to be included with this re-submittal  
*Authorized Onsite Wastewater Evaluator (Print Name)*  
is accurate and complete to the best of my knowledge and that the proposed Construction Authorization meets all applicable federal, State, and local laws, regulations, rules, and ordinances.

\_\_\_\_\_  
*Signature of Authorized On-Site Wastewater Evaluator*

\_\_\_\_\_  
*Date*

*The section below is for Local Health Department use after submittal of items noted as missing above.*

### LHD Follow-up Completeness Review of Construction Authorization

The review for completeness of this Construction Authorization re-submittal was conducted in accordance with G.S. 130A-335(a5). This Construction Authorization is determined to be:

☐ Incomplete (If box is checked, information in this section is required.)

The following items are missing:

---

---

Copies of this were sent to the AOWE/PE and the Applicant on \_\_\_\_\_  
Date

State Authorized Agent: \_\_\_\_\_

Date: \_\_\_\_\_

☐ Complete

State Authorized Agent: \_\_\_\_\_

Date: \_\_\_\_\_



# **Mitchell Environmental, P.A.**

I hereby authorize representatives of Mitchell Environmental, P.A., to provide subsurface wastewater evaluations and septic system designs on my behalf, for the issuance of an IP and CA, for the property identified below.

For Improvement Permit (IP) issuance:

**"The LSS/LG evaluation(s) attached to this application is to be used to issue an Improvement Permit in accordance with G.S. 130A-335(a2) and (a3)."**

For Construction Authorization (CA) issuance:

**"The plans or evaluations attached to this application are to be used to issue a Construction Authorization in accordance with G.S. 130A-335(a2), (a5), and (a6)."**

The LSS evaluation attached to this application was used to produce and design a subsurface wastewater septic system for permitting to obtain an IP and CA in accordance with G.S. 130A-335(a2), (a3), (a5), and (a6).

Lot 41 (110 Teepee Dr), Lot 42 (88 Teepee Dr)  
Lot 39 (154 Teepee Dr), Lot 40 (132 Teepee Dr)

Subject Property (Address, PIN, etc.): Lot 59 (20 Camp Rock Rd), Lot 46 (17 Camp Rock Rd)

Property Owner Name (Print): LGI Homes

Owner Representative (Print): Keith Sears

Owner Representative (Sign): Keith Sears

Date: 3/7/25



MITCENV-01

EMARTY

## CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)

1/16/2025

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

**IMPORTANT:** If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must have ADDITIONAL INSURED provisions or be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

PRODUCER <b>Alera Group</b> 4131 Parklake Avenue, Suite 225 Raleigh, NC 27612	CONTACT NAME: <b>Select Business Unit</b>	
	PHONE (A/C, No, Ext): <b>(919) 469-2473</b>	FAX (A/C, No): <b>(919) 467-4987</b>
	E-MAIL ADDRESS: <b>em@trisure.com</b>	
	INSURER(S) AFFORDING COVERAGE	NAIC #
	INSURER A : <b>Westchester Surplus Lines</b>	<b>10172</b>
INSURED  <b>Mitchell Environmental PA</b> <b>Scott Mitchell</b> <b>5601 Maggie Run Lane</b> <b>Fuquay Varina, NC 27526</b>	INSURER B : <b>Sirius America Insurance Company</b>	<b>38776</b>
	INSURER C :	
	INSURER D :	
	INSURER E :	
	INSURER F :	

## COVERAGES

## CERTIFICATE NUMBER:

## REVISION NUMBER:


THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL INSD	SUBR WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
A	<input checked="" type="checkbox"/> COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input checked="" type="checkbox"/> OCCUR  GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input checked="" type="checkbox"/> PROJECT <input type="checkbox"/> LOC OTHER:			G28210486009	1/27/2025	1/27/2026	EACH OCCURRENCE \$ <b>1,000,000</b>
							DAMAGE TO RENTED PREMISES (Ea occurrence) \$ <b>50,000</b>
							MED EXP (Any one person) \$ <b>10,000</b>
							PERSONAL & ADV INJURY \$ <b>1,000,000</b>
							GENERAL AGGREGATE \$ <b>2,000,000</b>
							PRODUCTS - COMP/OP AGG \$ <b>2,000,000</b>
							\$
	AUTOMOBILE LIABILITY <input type="checkbox"/> ANY AUTO OWNED AUTOS ONLY <input type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> HIRED AUTOS ONLY <input type="checkbox"/> NON-OWNED AUTOS ONLY						COMBINED SINGLE LIMIT (Ea accident) \$
							BODILY INJURY (Per person) \$
							BODILY INJURY (Per accident) \$
							PROPERTY DAMAGE (Per accident) \$
							\$
A	UMBRELLA LIAB <input checked="" type="checkbox"/> EXCESS LIAB <input checked="" type="checkbox"/>			G46616182008	1/27/2025	1/27/2026	EACH OCCURRENCE \$ <b>1,000,000</b>
	DED <input type="checkbox"/> RETENTION \$						AGGREGATE \$ <b>1,000,000</b>
							\$
B	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) <input type="checkbox"/> Y / N If yes, describe under DESCRIPTION OF OPERATIONS below		N / A	WC PC 602055-000	2/7/2025	2/7/2026	PER STATUTE <input type="checkbox"/> OTH-ER <input type="checkbox"/>
							E.L. EACH ACCIDENT \$ <b>1,000,000</b>
							E.L. DISEASE - EA EMPLOYEE \$ <b>1,000,000</b>
							E.L. DISEASE - POLICY LIMIT \$ <b>1,000,000</b>
A	Professional Liabili			G28210486009	1/27/2025	1/27/2026	Limit \$ <b>1,000,000</b>
A	Professional Liabili			G28210486009	1/27/2025	1/27/2026	Limit \$ <b>1,000,000</b>

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)  
Operations of the Named Insured covered by the above referenced policies.

## CERTIFICATE HOLDER

## CANCELLATION

<b>LGI Homes – NC, LLC</b> 1450 Lake Robbins Drive Suite 430 The Woodlands, TX 77380	SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.
	AUTHORIZED REPRESENTATIVE 

# **Mitchell Environmental, P.A.**

## **SEPTIC SYSTEM DESIGN**

**for**

### **BOONE TRAIL VILLAGE SUBDIVISION- LOT 42**

**Lillington, Harnett County, North Carolina**

**Submitted to:**

Harnett County Health Department  
307 Cornelius Harnett Blvd.  
Lillington, NC 27546

**Prepared for:**

LGI Homes  
1450 Lake Robbins Drive  
Suite 430  
The Woodlands, Texas 77380

**Prepared by:**

Scott Mitchell, PE, LSS  
Adam Aycok, EI

**DATE: March 13, 2025**  
**PROJECT NO.: 1624**





## Harnett County GIS

**PID:** 130519 0103 47

**PIN:** 0519-69-7624.000

**Account Number:** 1500028388

**Owner:** LGI HOMES NC LLC

**Mailing Address:** 1450 LAKE ROBBINS DR STE 430 THE WOODLANDS, TX 77380-3294

**Physical Address:** 88 TEEPEE DR LILLINGTON, NC 27546 ac

**Description:** LOT#42 BOONE TRAIL VILLAGE PH1 MAP#2024-600

**Surveyed/Deeded Acreage:** 0.6

**Calculated Acreage:** 0.6

**Deed Date:**

**Deed Book/Page:** 4144 - 0878

**Plat(Survey) Book/Page:** 2024 - 600

**Last Sale:** 2022 - 4

**Sale Price:** \$2220000

**Qualified Code:** A

**Vacant or Improved:** V

**Transfer of Split:** T

**Actual Year Built:**

**Heated Area :** SqFt

**Building Count :** 0

**Building Value:** \$0

**Parcel Outbuilding Value:** \$0

**Parcel Land Value:** 26460

**Market Value:** \$26460

**Deferred Value:** \$0

**Total Assessed Value:** \$26460

**Zoning:** RA-30 - 0.6 acres (100.0%)

**Zoning Jurisdiction:** Harnett County

**Wetlands:** No

**FEMA Flood:** Minimal Flood Risk

**Within 1mi of Agriculture District:** Yes

**Elementary School:** Boone Trail Elementary

**Middle School:** Western Harnett Middle

**High School:** Western Harnett High

**Fire Department:** Boone Trail


**EMS Department:** Medic 12, D12 EMS

**Law Enforcement:** Harnett County Sheriff

**Voter Precinct:** Boone Trail

**County Commissioner :** Duncan Edward Jagers

**School Board Member:** John Hair

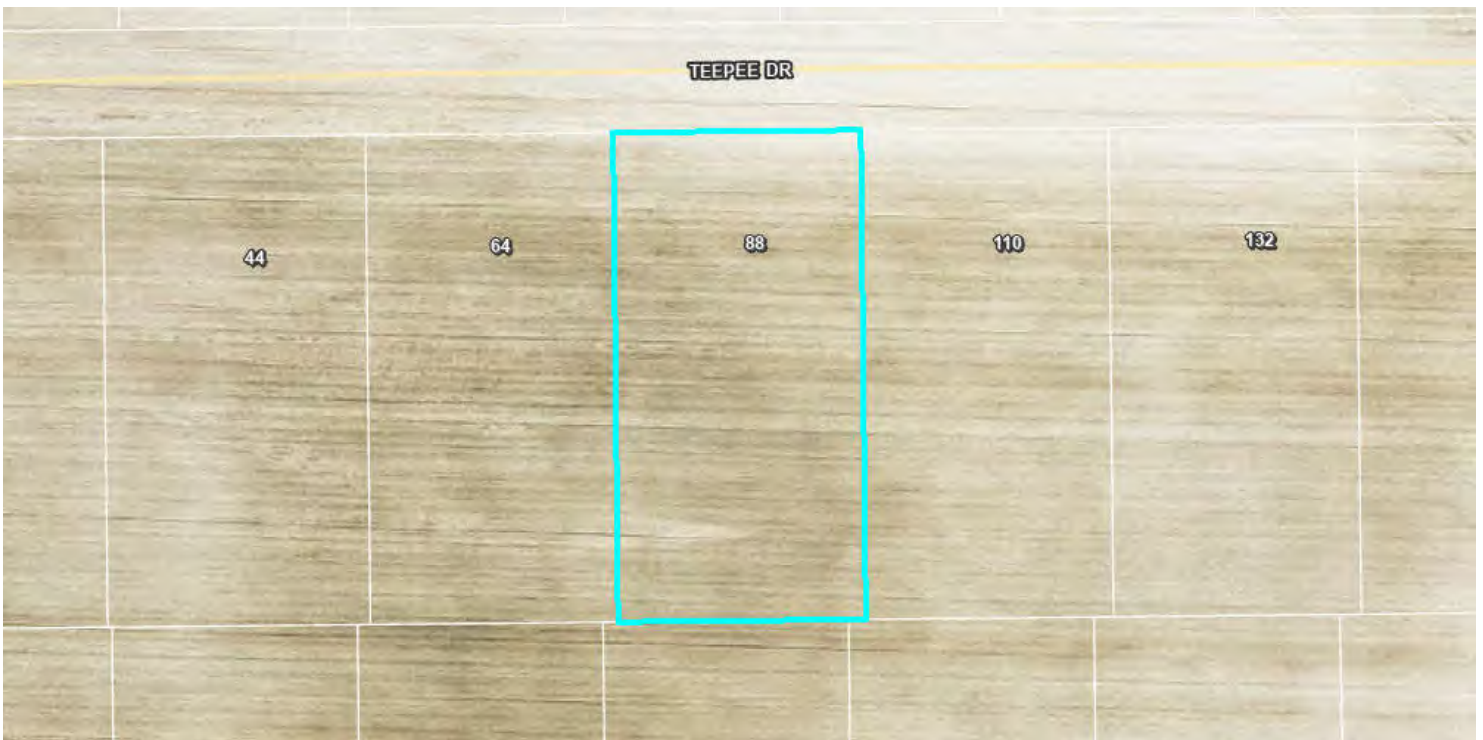



**PRESSURE MANIFOLD DESIGN**Name: LGI Homes

P.I.N. #: 0519-69-7624

D #: N/A

Address: 88 Teepee Drive

Subdiv: Boone Trail VillageLot#: 42# of BDR: 4 Daily Flow: 480 gal/day L.T.A.R.: 0.300 gal/day/sq.ftSeptic Tank: 1000 gals (min.) Pump Tank: 1000 gals (min.) Sq. Foot: 1215 Stone Depth: N/A  
(EZ Flow)Number of Taps: 3 Length of Trenches: 135 ft(See Tap Chart for Details)Depth of Trenches: see Harnett County permit Manifold Length: 36 inManifold Diameter: 4 in sch 80pvc (minimum) Tap Configuration: 6 in spacing 1 side(s) of manifoldSupply Line: length: 180 ft Diameter: 2 in sch 40pvcFriction Loss + Fitting Loss: 2.78 ft(supply line length + 70' for fittings in pump tank)Design Head: 2.0 ft Elevation Head: 8.58 ftVent Hole Size: 3/16 in Orifice Coefficient of Discharge: 0.60Orifice Coefficient of Contraction: 0.62 Orifice Coefficient of Velocity: 0.97Maximum Head Supplied by Selected Pump(s) at Total Design Flowrate: 23 ftOrifice / Vent Hole Flowrate: 1.99 gpm Head Loss at Orifice / Vent Hole: 1.46 ftTotal Head: 14.82 ft Pump to Deliver: 23.32 gals/min at 14.82 ft headDosing Volume: 173.75 gals.Drawdown: 173.75 gals divided by 18 gals/in = 9.65 inchesSJE Rhombus Installer Friendly Series simplex control panel, or equivalent, required  
A septic tank filter, or equal is required.Possible pumps: Hydromatic: Goulds: Myers:  
Zoeller: 151 Other:**TAP CHART**

Bench Mark	4.89	is = 100.00	set at	EG at 41/42 back EIP			Design Head:	2.0	
Pump tank elev.		7	97.89	Pump elev.	92.89		Manifold elev.	101.47	
line	color	rod read	Elevation	length	hole size	flow/tap	gal/day	trench area	LINE LTAR
5	Lime	4.42	100.47	135	1/2in SCH 40	7.11	160.00	405	0.3951
6	Red	4.56	100.33	135	1/2in SCH 40	7.11	160.00	405	0.3951
7	Blue	4.68	100.21	135	1/2in SCH 40	7.11	160.00	405	0.3951
		total	feet =	405	gal/min =	21.3	LTAR =		0.3000
% of Pipe Vol.		66		Des. Flow	480.00	(ltar + 5%)		0.3150	
Dose Volume		173.75		Pump Run=	22.50	(ltar W/ INOV)		0.4000	
Dose Pump Time		8.15		Tank Gal/IN	18	(ltar + 5%)		0.4200	
Drawdown in Inches		9.65		Elev. Head	8.58				
Supply Line Length		180							
Comments:									

## PRESSURE MANIFOLD DESIGN

Name: LGI Homes

P.I.N. #: 0519-69-7624



D #: N/A

Address: 88 Teepee Drive

Subdiv: Boone Trail VillageLot#: 42# of BDR: 4 Daily Flow: 480 gal/day L.T.A.R.: 0.300 gal/day/sq.ftSeptic Tank: 1000 gals (min.) Pump Tank: 1000 gals (min.) Sq. Foot: 804 Stone Depth: N/A  
(PPBPS)Number of Taps: 4 Length of Trenches: 67 ft(See Tap Chart for Details)Depth of Trenches: see Harnett County permit Manifold Length: 42 inManifold Diameter: 4 in sch 80pvc (minimum) Tap Configuration: 6 in spacing 1 side(s) of manifoldSupply Line: length: 220 ft Diameter: 2 in sch 40pvcFriction Loss + Fitting Loss: 3.39 ft(supply line length + 70' for fittings in pump tank)Design Head: 2.0 ft Elevation Head: 9.65 ftVent Hole Size: 3/16 in Orifice Coefficient of Discharge: 0.60Orifice Coefficient of Contraction: 0.62 Orifice Coefficient of Velocity: 0.97Maximum Head Supplied by Selected Pump(s) at Total Design Flowrate: 23 ftOrifice / Vent Hole Flowrate: 1.99 gpm Head Loss at Orifice / Vent Hole: 1.46 ftTotal Head: 16.50 ft Pump to Deliver: 23.91 gals/min at 16.50 ft headDosing Volume: 217.75 gals.Drawdown: 217.75 gals divided by 18 gals/in = 12.10 inchesSJE Rhombus Installer Friendly Series simplex control panel, or equivalent, required  
A septic tank filter, or equal is required.Possible pumps: Hydromatic: Goulds: Myers:  
Zoeller: 151 Other:

## TAP CHART

Bench Mark	4.89	is = 100.00	set at	EG at 41/42 back EIP			Design Head:	2.0	
Pump tank elev.		7	97.89	Pump elev.	92.89		Manifold elev.	102.54	
line	color	rod read	Elevation	length	hole size	flow/tap	gal/day	trench area	LINE LTAR
1	Purple	3.35	101.54	67	1/2in SCH 80	5.48	120.00	201	0.5970
2	Pink	3.75	101.14	67	1/2in SCH 80	5.48	120.00	201	0.5970
3	Orange	3.87	101.02	67	1/2in SCH 80	5.48	120.00	201	0.5970
4	White	4.05	100.84	67	1/2in SCH 80	5.48	120.00	201	0.5970
		total	feet =	268	gal/min =	21.9	<u>LTAR =</u>		0.3000
% of Pipe Vol.		125		<u>Des. Flow</u>	480.00			(ltar + 5%)	0.3150
Dose Volume		217.75		<u>Pump Run=</u>	21.90			(ltar W/ PPBPS)	0.6000
Dose Pump Time		9.93		<u>Tank Gal/IN</u>	18			(ltar + 5%)	0.6300
Drawdown in Inches		12.10		<u>Elev. Head</u>	9.65				
Supply Line Length		220							
Comments: 15 panels per trench									

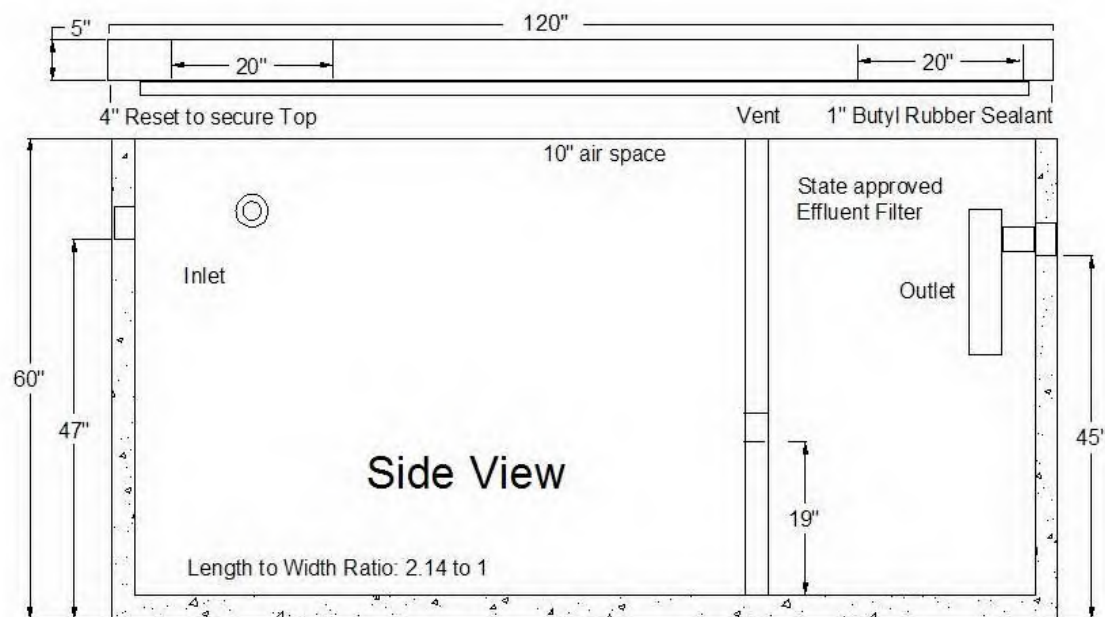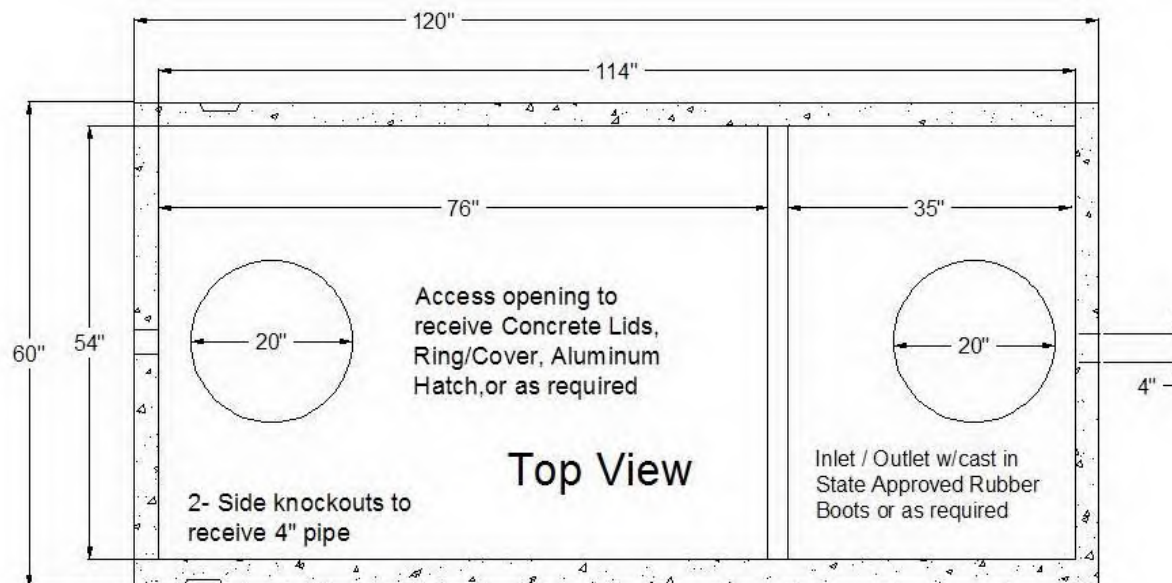

## STB - 345 - Top Seam

Approval Date: 12 - 09 - 99

Liquid Capacity 1007 Gallons

Non Traffic Rated

Reinforcing Schedule: # 3 Grade 60 Rebar

4500 PSI Concrete w/ State Approved Structural Fiber

Est. Weight: 8,200 lbs.

Manufactured By:

**GARNERS**

Septic Tanks, Inc.

Eddie Garner, President


919-718-5181

121 Stanton Hill Road

Carthage, NC 28327

Fax 919-775-2229

Eddie@garnersseptic tanks.com

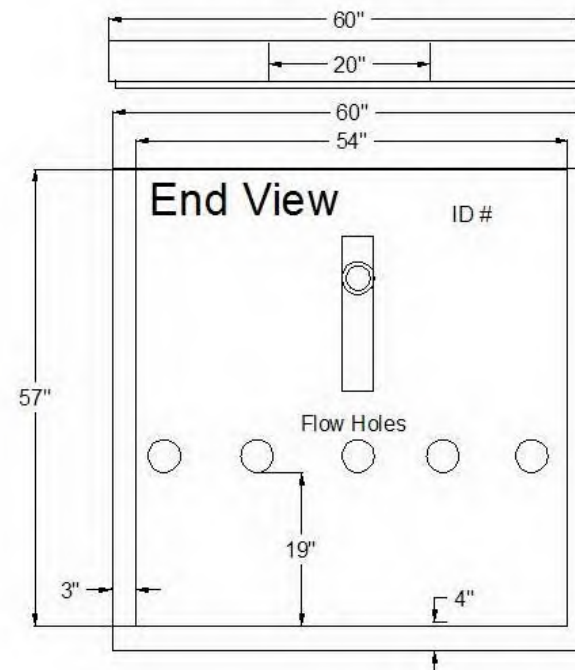

## PL-68 Filter and Tee

PL-68 is much more than just an effluent filter. The housing can also be used as an inlet baffle (tee) or an outlet baffle. The housing is designed to accept Polylok's snap in gas deflector to deflect gas bubbles away from the tee and to keep the solids in the tank.

### Features:

- Offers 68 linear feet of 1/16" filter slots, which significantly extends time between cleaning.
- Accepts 3/4" PVC handle.
- Locks in any 360° position when used with PL-68 Tee.
- PL-68 Housing can be used as an inlet or outlet tee.
- Gasket prevents bypass.

### PL-68 Installation:

Ideal for residential waste flows up to 800 gallons per day (GPD). Easily installs in any new or existing 4" outlet tee.

1. Locate the outlet of the septic tank.
2. Remove the tank cover and pump tank if necessary.
3. Glue the filter housing to the outlet pipe, or use a Polylok Extend & Lok if not enough pipe exists.
4. Insert the PL-68 filter into tee.
5. Replace and secure the septic tank cover.


### PL-68 Maintenance:

The PL-68 Effluent Filter will operate efficiently for several years under normal conditions before requiring cleaning. It is recommended that the filter be cleaned every time the tank is pumped, or at least every three years.

1. Do not use plumbing when filter is removed.
2. Pull PL-68 out of the tee.
3. Hose off filter over the septic tank. Make sure all solids fall back into septic tank.
4. Insert filter back into tee/housing.

### Related Products:

PL-68 Filter Concrete Baffle  
Extend & Lok<sup>TM</sup>

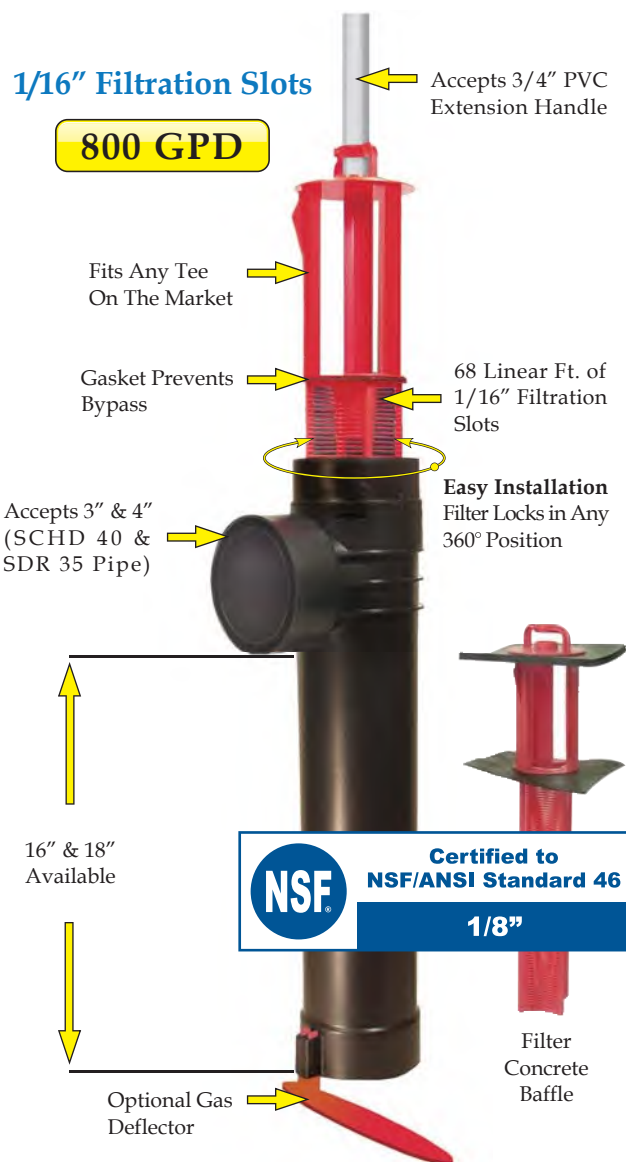

**Extend & Lok<sup>TM</sup>**  
Easily installs  
into existing tanks.



Spacer Bushing  
4" SCHD 40  
to SDR 35




Spacer Bushing  
4" SCHD 40  
to 110mm Pipe



2" Extender



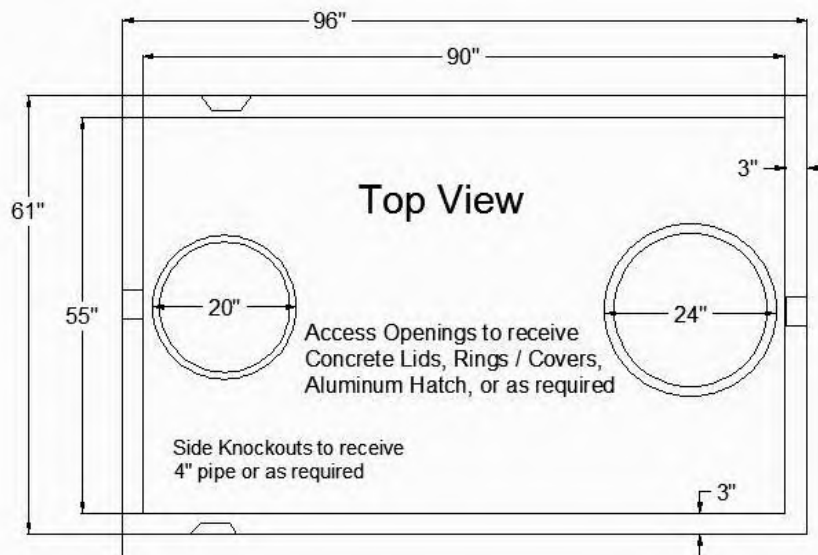

## PT - 214

Date: 12-16-93

Non Traffic Rated

Liquid Capacity 1,028 Gallons

18 gals. per inch

Reinforcing Schedule: # 3 Grade 60 Rebar

4500 PSI Concrete w/ State Approved Structural Fiber

2 yds. Est Weight 8200 lbs

Manufactured By:

**GARNERS**  
 Septic Tanks, Inc.

Eddie Garner, President



919-718-5181

121 Stanton Hill Road

Carthage, NC 28327

Fax 919-775-2229

Eddie@garnersseptic tanks.com

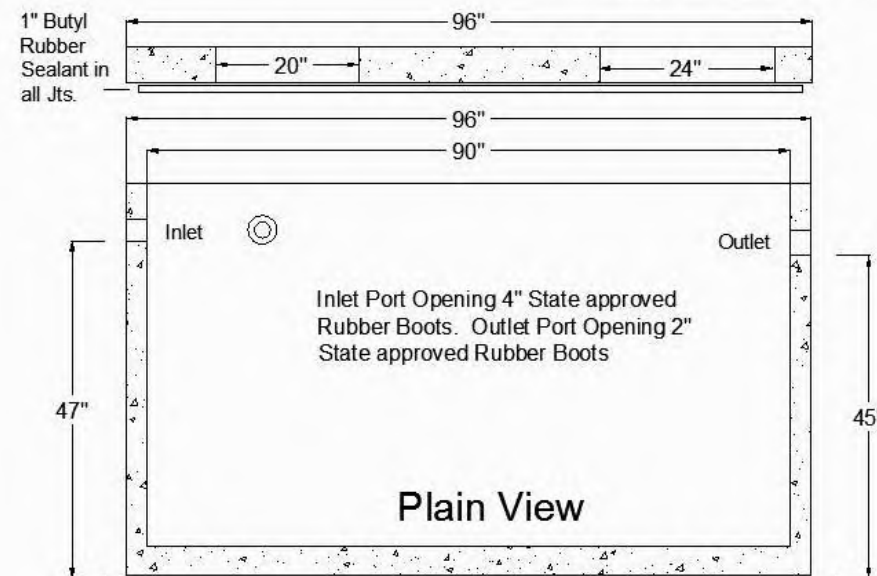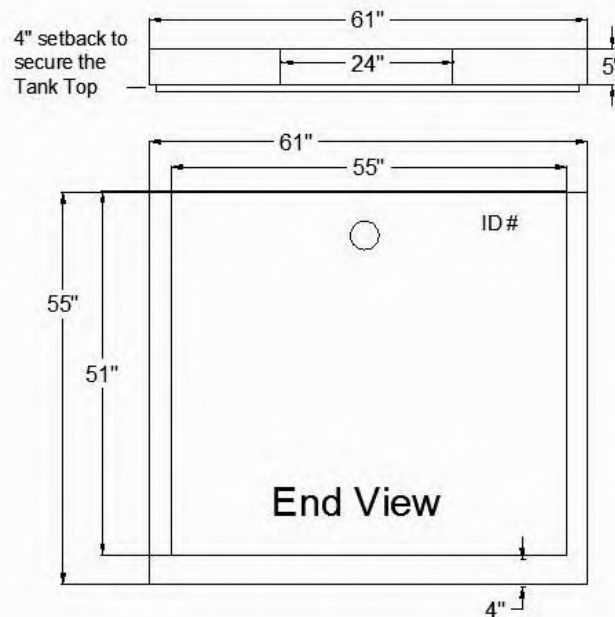

# INSTALLER FRIENDLY SERIES® - IFS Single Phase Simplex (Demand/TD)

Single phase, simplex demand dose or timed dose, float controlled system for pump control and system monitoring.

The IFS simplex control panel is designed to control one 120, 208, 240 VAC single phase pump in water and sewage installations.

The IFS control panel features an easy-to-use touch pad with display on the inner door for programming and system monitoring.

The panel configuration can be easily converted in the field to either a timed dose or demand dose.


## TOUCH PAD FEATURES

- A. **Float Indicators** illuminate when floats are activated. Alarm will activate if a float operates out of sequence.
- B. **HOA (Hand-Off-Automatic) Buttons** control pump mode with indication. Hand mode defaults to Automatic when stop level or redundant off level is reached.
- C. **Pump Run Indicator** illuminates when pump is called to run.
- D. **LED Display** shows system information including: mode, pump elapsed time (hh:mm), events (cycles), alarm counter, float error count, timed dose override counter (timed dose only), and ON/OFF times (timed dose only).
- E. **NEXT Push Button** toggles display.
- F. **UP and SET Push Buttons** set pump ON/OFF times (timed dose only).


## PANEL COMPONENTS

1. **Enclosure** base measures 10 X 8 X 4 inches (25.4 X 20.32 X 10.16 cm). NEMA 4X (ultraviolet stabilized thermoplastic with removable mounting feet for outdoor or indoor use). **Note:** Options, voltage, and amp range selected may change enclosure size and component layout.
2. **Red Alarm Beacon** provides 360° visual check of alarm condition.
3. **Exterior Alarm Test/Normal/Silence Switch** allows horn and light to be tested and horn to be silenced in an alarm condition. Alarm automatically resets once alarm condition is cleared.
4. **Alarm Horn** provides audio warning of alarm condition (83 to 85 decibel rating).
5. **Circuit Breaker** (optional) provides pump disconnect and branch circuit protection.
6. **Power Relay** controls pump by switching electrical lines. Definite purpose contactor used when pump full load amps are above 15.
7. **Float Connection Terminal Block**
8. **Incoming Control/Alarm Power & Pump Terminal Block**
9. **Control Power Indicator/Fuse** indicator light illuminates if control power is present in panel. Alarm will activate if control fuse is blown.
10. **Alarm Power Indicator/Fuse** indicator light illuminates if alarm power is present in panel.
11. **Ground Lug**

**NOTE:** Schematic/Wiring Diagram and Pump Specification Label are located inside the panel on enclosure cover

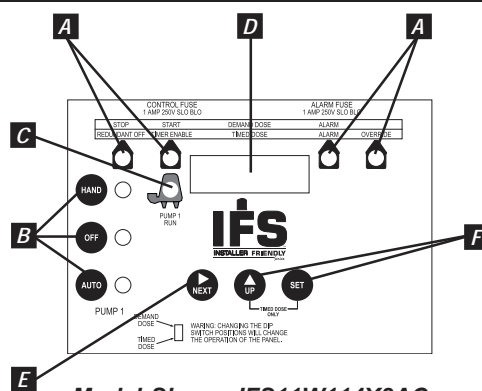

Model Shown IFS11W114X8AC  
(Inner door view)

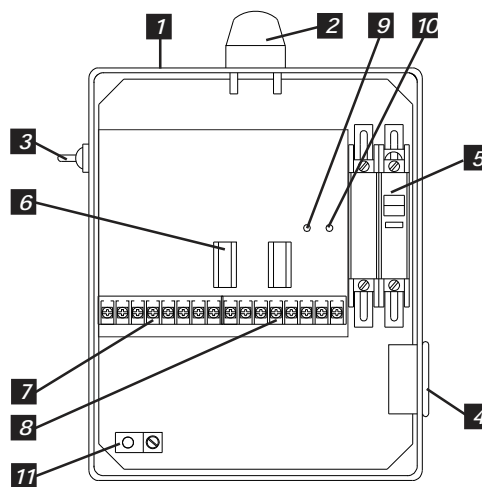

Model Shown IFS11W114X8AC  
(Inside view)

Reg. Cdn Pat. & TM Off

## FEATURES

- Entire control system (panel and switches) is UL Listed to meet and/or exceed industry safety standards
- Dual safety certification for the United States and Canada
- Standard package includes:
  - Demand Dose** - three 20' SJE MilliAmpMaster™ control switches
  - Timed Dose** - two 20' SJE MilliAmpMaster™ control switches
- Complete with step-by-step installation instructions
- Three-year limited warranty



**SJE Rhombus**

PO Box 1708, Detroit Lakes, MN 56502  
1-888-DIAL-SJE • 1-218-847-1317  
1-218-847-4617 Fax  
email: sje@sjerhombus.com  
**www.sjerhombus.com**

SEE BACKSIDE FOR COMPLETE LISTING OF AVAILABLE OPTIONS.

IFS

2

1

W

Note

Note

4

H

8AC, 10E, 10F

15A

MODEL IFS

MODEL TYPE

☐

X

1 = SPLX TIMED DOSE (includes option 8AC standard)

2 = SPLX DEMAND DOSE (includes option 8AC standard)

ALARM PACKAGE

☒

1 = alarm package (includes test/normal/silence switch, fuse, red light & horn)

ENCLOSURE RATING

☒

W = NEMA 4X

STARTING DEVICE

☐

☐

1 = 120/208/240 VAC

9 = 120 VAC

PUMP FULL LOAD AMPS

☐

☐

☐

0 = 0-7 FLA

1 = 7-15 FLA

2 = 15-20 FLA

PUMP DISCONNECTS

☐

X

0 = no pump disconnect

4 = circuit breaker

120 VAC (must select starting device option 9)

120/208/240 VAC (must select starting device option 1)

SWITCH APPLICATIONS

☒

☐

H = floats (Timed dose = low level and alarm / Demand dose = stop, start, and alarm) (select 17 option)

X = no float

timed dose

demand Dose

Note: Pump down applications only.

OPTIONS Listed below

Note: Starting device, pump full load amps, cord length, and float type to be selected by installer and their electrician upon selection of pump.

If additional features are required, call the factory for a quote on an Engineered Custom control panel.

CODE	DESCRIPTION	CODE	DESCRIPTION
<input type="checkbox"/>	1J Duo alarm inputs	<input type="checkbox"/>	11D NEMA 4X remote alarm panel (must select option 6A)
<input type="checkbox"/>	3A Alarm flasher	<input checked="" type="checkbox"/>	15A Control / Alarm circuit breaker
<input type="checkbox"/>	3B Manual reset alarm	<input type="checkbox"/>	16A 10' cord in lieu of 20' (per float)
<input type="checkbox"/>	4A Redundant off (select option 4D if floats are required)	<input type="checkbox"/>	16B 15' cord in lieu of 20' (per float)
	Demand Dose	<input type="checkbox"/>	16C 30' cord in lieu of 20' (per float)
	Timed Dose	<input type="checkbox"/>	16D 40' cord in lieu of 20' (per float)
<input type="checkbox"/>	4D Redundant off float	<input type="checkbox"/>	17C Sensor Float® / internally weighted ▲ (per float)
<input type="checkbox"/>	6A Auxiliary alarm contacts, form C	<input type="checkbox"/>	17D Sensor Float® / externally weighted ▲ (per float)
<input checked="" type="checkbox"/>	8AC Display board includes: ETM counter, events (cycles) counter, alarm counter, and override counter (timed dose only). (Included as standard.)	<input type="checkbox"/>	17G MilliAmpMaster™ / pipe clamp ● (per float)
<input checked="" type="checkbox"/>	10E Lockable latch - NEMA 4X	<input type="checkbox"/>	17H MilliAmpMaster™ / externally weighted ● (per float)
<input checked="" type="checkbox"/>	10F Lightning arrestor (must select pump circuit breaker, control and alarm power combined)	<input type="checkbox"/>	17J Sensor Float® / pipe clamp ▲ (per float)
<input type="checkbox"/>	10K Anti-condensation heater	<input type="checkbox"/>	18A Timer override option with float (timed dose only)
<input type="checkbox"/>	11C NEMA 1 remote alarm panel (must select option 6A)		● Mechanically-activated ▲ Mercury-activated

SAMPLE

MODEL

IFS

1

1

W

9

1

4

H

8AC 10E 17G

Model Type

Alarm Package

Enclosure Rating

Starting Device

Pump Full Load Amps

Pump Disconnects

Switch Application

Options: Display, Lockable Latch,

SJE MilliAmpMaster™/pipe clamp

Product information presented here reflects conditions at time of publication. Consult factory regarding discrepancies or inconsistencies.



## TECHNICAL DATA SHEET

### DOSE-MATE SERIES

*Models 151, 152, 153 Effluent Pumps*


#### PRODUCT SPECIFICATIONS

<b>MOTOR</b>	Horse Power	1/3 (151), 4/10 (152), 1/2 (153)
	Voltage	115 or 230
	Phase	1 Ph
	Hertz	60 Hz
	RPM	3450
	Type	Permanent split capacitor
	Insulation	Class B
	Amps	3.0 - 10.5
<b>PUMP</b>	Operation	Automatic or nonautomatic
	Discharge Size	1-1/2" NPT
	Solids Handling	1/2" (12 mm), 3/4" (19 mm) spherical solids
	Cord Length	20' (6 m)
	Cord Type	UL listed power cord
	Max. Head	44' (13.4 m)
	Max. Flow Rate	77 GPM (291 LPM)
	Max. Operating Temp.	130 °F (54 °C)
	Cooling	Oil filled
	Motor Protection	Auto reset thermal overload
<b>MATERIALS</b>	Cap	Cast iron
	Motor Housing	Cast iron
	Pump Housing	Cast iron
	Base	Plastic or cast iron
	Upper Bearing	Sleeve bearing
	Lower Bearing	Ball bearing
	Mechanical Seals	Carbon and ceramic
	Impeller Type	Non-clogging vortex
	Impeller	Engineered thermoplastic
	Hardware	Stainless steel
	Motor Shaft	AISI 1215 steel
	Gasket	Neoprene


NOTE: The sizing of effluent systems normally requires variable level float(s) controls and properly sized basins to achieve required pumping cycles or dosing timers with nonautomatic pumps.

NOTE: See model comparison chart for specific details.

#### MODEL 151

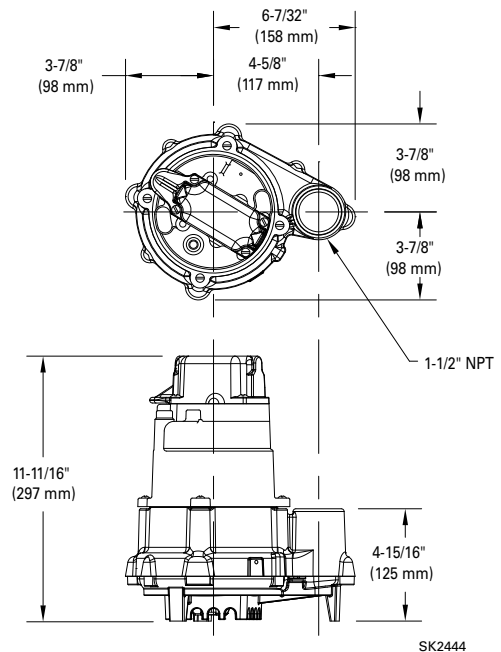

#### MODELS 152 & 153

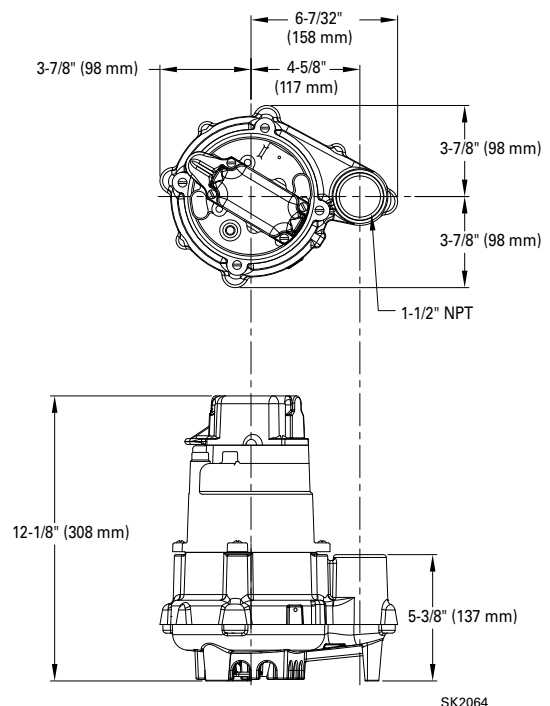


Tested to UL Standard UL778  
and Certified to CSA  
Standard CSA22.2 No. 108





## TOTAL DYNAMIC HEAD FLOW PER MINUTE

MODEL		151		152		153	
Feet	Meters	Gal.	Liters	Gal.	Liters	Gal.	Liters
5	1.5	50	189	69	261	77	291
10	3.0	45	170	61	231	70	265
15	4.6	38	144	53	201	61	231
20	6.1	29	110	44	167	52	197
25	7.6	16	61	34	129	42	159
30	9.1	--	--	23	87	33	125
35	10.7	--	--	--	--	22	85
40	12.2	--	--	--	--	11	42
Shut-off Head:		30 ft. (9.1m)		38 ft. (11.6m)		44 ft. (13.4m)	

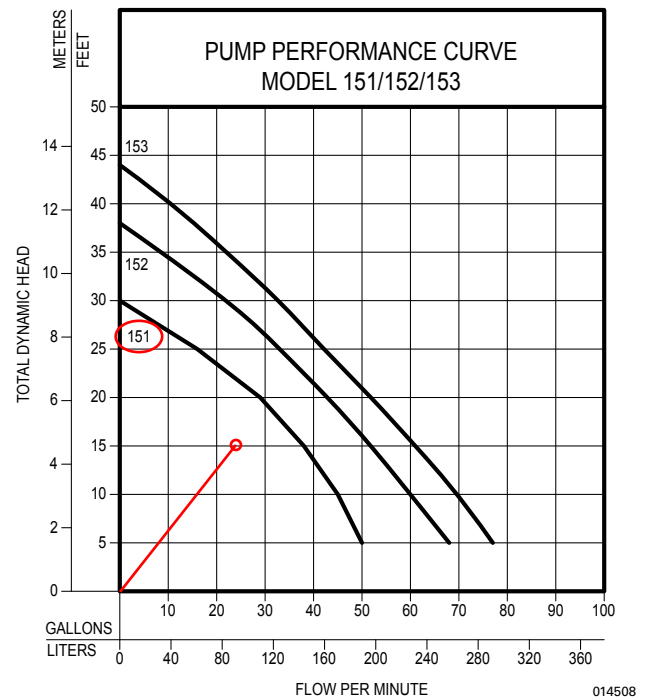

Model	MODEL COMPARISON										
	Seal	Mode	Volts	Ph	Amps	HP	Hz	Lbs	Kg	Simplex	Duplex
N151	Single	Non	115	1	6.0	1/3	60	32	15	1	2 or 3
E151	Single	Non	230	1	3.0	1/3	60	32	15	1	2 or 3
BN151	Single	Auto	115	1	6.0	1/3	60	33	15	*	2 or 3
BE151	Single	Auto	230	1	3.0	1/3	60	33	15	*	2 or 3
N152	Single	Non	115	1	8.5	4/10	60	37	17	1	2 or 3
E152	Single	Non	230	1	4.3	4/10	60	37	17	1	2 or 3
BN152	Single	Auto	115	1	8.5	4/10	60	39	18	*	2 or 3
BE152	Single	Non	230	1	4.3	4/10	60	39	18	*	2 or 3
N153	Single	Non	115	1	10.5	1/2	60	37	17		
BN153	Single	Auto	115	1	10.5	1/2	60	39	18	*	2 or 3
E153	Single	Non	230	1	5.3	1/2	60	37	17	1	2 or 3
BE153	Single	Non	230	1	5.3	1/2	60	39	18	*	2 or 3

\*BN and BE models include a 20' (6 m) piggyback variable level pump switch. Additional cord lengths are available in 25' (8 m) and 35' (11 m). 50' (15 m) cords are available for 230 V units only.


NOTE: Model 151 has a plastic base. Models 152 & 153 have a cast iron base.

## SELECTION GUIDE

- For automatic, use single piggyback variable level float switch or double piggyback variable level float switch. Refer to FM0477.
- See FM1228 for correct model of simplex control panel.
- See FM0712 for correct model of duplex control panel.

### OPTIONAL PUMP STAND P/N 10-2421

- Reduces potential clogging by debris
  - Replaces rocks or bricks under the pump
  - Made of durable, noncorrosive ABS
  - Raises pump 2" (5 cm) off bottom of basin
  - Provides the ability to raise intake by adding sections of 1½" or 2" (DN40 or DN50) PVC piping
  - Attaches securely to pump
  - Accommodates sump, dewatering and effluent applications
- NOTE: Make sure float is free from obstruction.

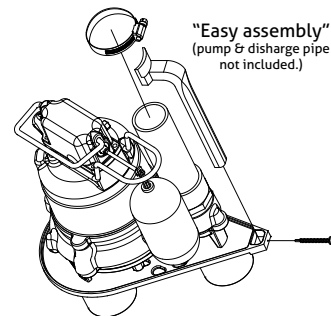

All installation of controls, protection devices and wiring should be done by a qualified licensed electrician. All electrical and safety codes should be followed including the most recent National Electrical Code (NEC) and the Occupational Safety and Health Act (OSHA).

© Copyright 2017 Zoeller® Co. All rights reserved.

502-778-2731 | 800-928-7867 | 3649 Cane Run Road | Louisville, KY 40211-1961 | zoellerpumps.com



EZflow by Infiltrator is an environmentally friendly replacement to traditional stone and pipe drainfields using an engineered geosynthetic aggregate modular design. The EZflow system is designed to improve infiltration performance by eliminating the fines associated with crushed stone, and reducing compaction and embedment associated with stone. Preassembled units include a 3" or 4" perforated pipe surrounded by aggregate and held in place with a durable high-strength netting. This product comes in easy-to-contour 5' and 10' lengths and in diameters of 7, 8, 9, 10, 12, 13, or 14 inches.

#### Lightweight expanded polystyrene

construction offers structural integrity and resists compaction. Engineered flow-channels increase void space creating improved water flow and greater storage.



## Compared with stone and pipe, benefits include:

- Always clean and free of fines
- Bundles are quick to install, saving costs on heavy machinery and labor
- Modular construction allows configurations to match trench dimensions for most system shapes and sizes
- Engineered for optimal storage and absorption efficiencies
- Ability to contour along sloped sites and around trees or landscaping
- Lightweight system is perfect for repairs and tight job sites
- Easily hand-carried into position reducing time and labor
- 5' or 10' lengths with simple snap, internal couplers
- Easier cleanup at the job site with the elimination of stone
- Manufactured from recycled materials rather than a mined natural resource
- A wide variety of diameters and configurations to meet any installation professional's needs
- Approved in many jurisdictions with an increased efficiency rating, reducing drainfield size
- Backed by the leader in the onsite wastewater industry



## Bundle System Configurations: Available in 7", 8", 9", 10", 12", 13" and 14" diameter bundles.




**Single Bundle**

0701P-GEO 1201P-GEO  
0801P-GEO 1401P-GEO  
1201P-GEO 1801P-GEO  
1001P-GEO



**Triangular Bundle**

1003T-GEO 1303T-GEO  
1203T-GEO 1403T-GEO

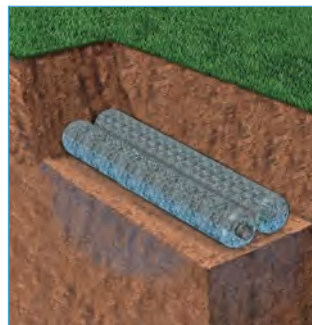

**Horizontal Bundles**

0705H-GEO 1303H-GEO  
0904H-GEO 1202H-GEO  
1002H-GEO 1203H-GEO



1206H-GEO 1402H-GEO  
1303H-GEO 1802H-GEO



**Vertical Bundles**

1002V-GEO 1006V-GEO 1203V-GEO 1206V-GEO  
1003V-GEO 1202V-GEO 1204V-GEO 1402V-GEO  
1004V-GEO



### Notes:

1. Other systems include 10" and 12" bed systems. Bed size will dictate the number of bundles.
2. System dimensions are dependent upon bundle diameter and configuration.
3. LLP is for "Low Pressure Pipe" in which a pressurized distribution pipe is field installed within the corrugated pipe.
4. Internal pipe and couplings meet the requirements of ASTM F405.
5. Bundles are also available without geotextile between the netting and synthetic aggregate.

### INFILTRATOR WATER TECHNOLOGIES STANDARD LIMITED WARRANTY

(a) The structural integrity of each EZflow by Infiltrator expanded polystyrene drainfield system and other accessories manufactured by EZflow by Infiltrator ("Units"), when installed and operated in a leachfield of an onsite septic system in accordance with Infiltrator's instructions, is warranted to the original purchaser ("Holder") against defective materials and workmanship for one year from the date that the septic permit is issued for the septic system containing the Units; provided, however, that if a septic permit is not required by applicable law, the warranty period will begin upon the date that installation of the septic system commences. To exercise its warranty rights, Holder must notify Infiltrator in writing at its Corporate Headquarters in Old Saybrook, Connecticut within fifteen (15) days of the alleged defect. Infiltrator will supply replacement Units for Units determined by EZflow by Infiltrator to be covered by this Limited Warranty. EZflow by Infiltrator's liability specifically excludes the cost of removal and/or installation of the Units.

(b) THE LIMITED WARRANTY AND REMEDIES IN SUBPARAGRAPH (a) ARE EXCLUSIVE. THERE ARE NO OTHER WARRANTIES WITH RESPECT TO THE UNITS, INCLUDING NO IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE

(c) This Limited Warranty shall be void if any part of the EZflow system is manufactured by anyone other than EZflow by Infiltrator. The Limited Warranty does not extend to incidental, consequential, special or indirect damages. Infiltrator shall not be liable for penalties or liquidated damages, including loss of production and profits, labor and materials, overhead costs, or other losses or expenses incurred by the Holder or any third party. Specifically excluded from Limited Warranty coverage are damage to the Units due to ordinary wear and tear, alteration, accident, misuse, abuse or neglect of the Units; the Units being subjected to vehicle traffic or other conditions which are not permitted by the installation instructions; failure to maintain the minimum ground covers set forth in the installation instructions; the placement of improper materials into the system containing the Units; failure of the Units or the septic system due to improper siting or improper sizing, excessive water usage, improper grease disposal, or improper operation; or any other event not caused by Infiltrator. This Limited Warranty shall be void if the Holder fails to comply with all of the terms set forth in this Limited Warranty. Further, in no event shall Infiltrator be responsible for any loss or damage to the Holder, the Units, or any third party resulting from installation or shipment, or from any product liability claims of Holder or any third party. For this Limited Warranty to apply, the Units must be installed in accordance with all site conditions required by state and local codes; all other applicable laws; and Infiltrator's installation instructions.

(d) No representative of Infiltrator has the authority to change or extend this Limited Warranty. No warranty applies to any party other than the original Holder.

The above represents the Standard Limited Warranty offered by Infiltrator. A limited number of states and counties have different warranty requirements. Any purchaser of Units should contact Infiltrator's Corporate Headquarters in Old Saybrook, Connecticut, prior to such purchase, to obtain a copy of the applicable warranty, and should carefully read that warranty prior to the purchase of Units.



4 Business Park Road  
P.O. Box 768  
Old Saybrook, CT 06475  
860-577-7000 • Fax 860-577-7001  
1-800-221-4436  
[www.infiltratorwater.com](http://www.infiltratorwater.com)

U.S. Patents: 4,759,661; 5,017,041; 5,156,488; 5,336,017; 5,401,116; 5,401,459; 5,511,903; 5,716,163; 5,588,778; 5,839,844 Canadian Patents: 1,329,959; 2,004,564 Other patents pending. Infiltrator, Equalizer, Quick4, and SideWinder are registered trademarks of Infiltrator Water Technologies. Infiltrator is a registered trademark in France. Infiltrator Water Technologies is a registered trademark in Mexico. Contour, MicroLeaching, PolyTuff, ChamberSpacer, MultiPort, PosiLock, QuickCut, QuickPlay, SnapLock and StraightLock are trademarks of Infiltrator Water Technologies. PolyLok is a trademark of PolyLok, Inc. TUF-TITE is a registered trademark of TUF-TITE, INC. Ultra-Rib is a trademark of IPEX Inc.

© 2015 Infiltrator Water Technologies, LLC. All rights reserved. Printed in U.S.A.

EZ01 0315AG

**Contact Infiltrator Water Technologies' Technical Services Department for assistance at 1-800-221-4436**

4-Bedroom  
LTAR: 0.3 gpd/ft<sup>2</sup>  
Initial: Pump-to-Innovative 25%  
Reduction Status Product utilizing  
lines 5-7 (405')  
Repair: Pump-to-PPBPS utilizing  
lines 1-4 (268')

TEEPEE DRIVE

115.00'

Water Meter

PROP  
CONC  
DRIVE

PROPOSED  
MARIE  
STEMWALL

PATIO

42

41

43

226.78'


226.78'

107.00'

SITE  
BOUNDARY

Initial septic drainfield


Repair septic drainfield

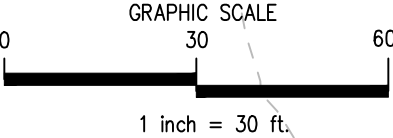

Notes:  
-No soil cuts within 20 feet of septic trenches.  
-No swales within 30 feet of septic trenches  
unless approved, in writing, by Engineer.

MITCHELL ENVIRONMENTAL, PA  
C-2911


1501 LAKESTONE VILLAGE LANE  
SUITE 205  
FUQUAY VARINA, NC 27526



PREPARED FOR : LQ Homes 5511 Capital Center Drive Suite 560 Raleigh, NC 27612		REVISION NO.	DATE	SHEET NUMBER  1 of 7	Boone Trail Village Lot 42 Overall Septic
DATE : March 13, 2025		Original Submittal	March 13, 2025		
DESIGNER CONTACT: ADAM AYCOCK, EI		Revision 1	----		
DRAWN BY: ADAM AYCOCK, EI		Revision 2	----		
		Revision 3	----		
		Master Set	----		





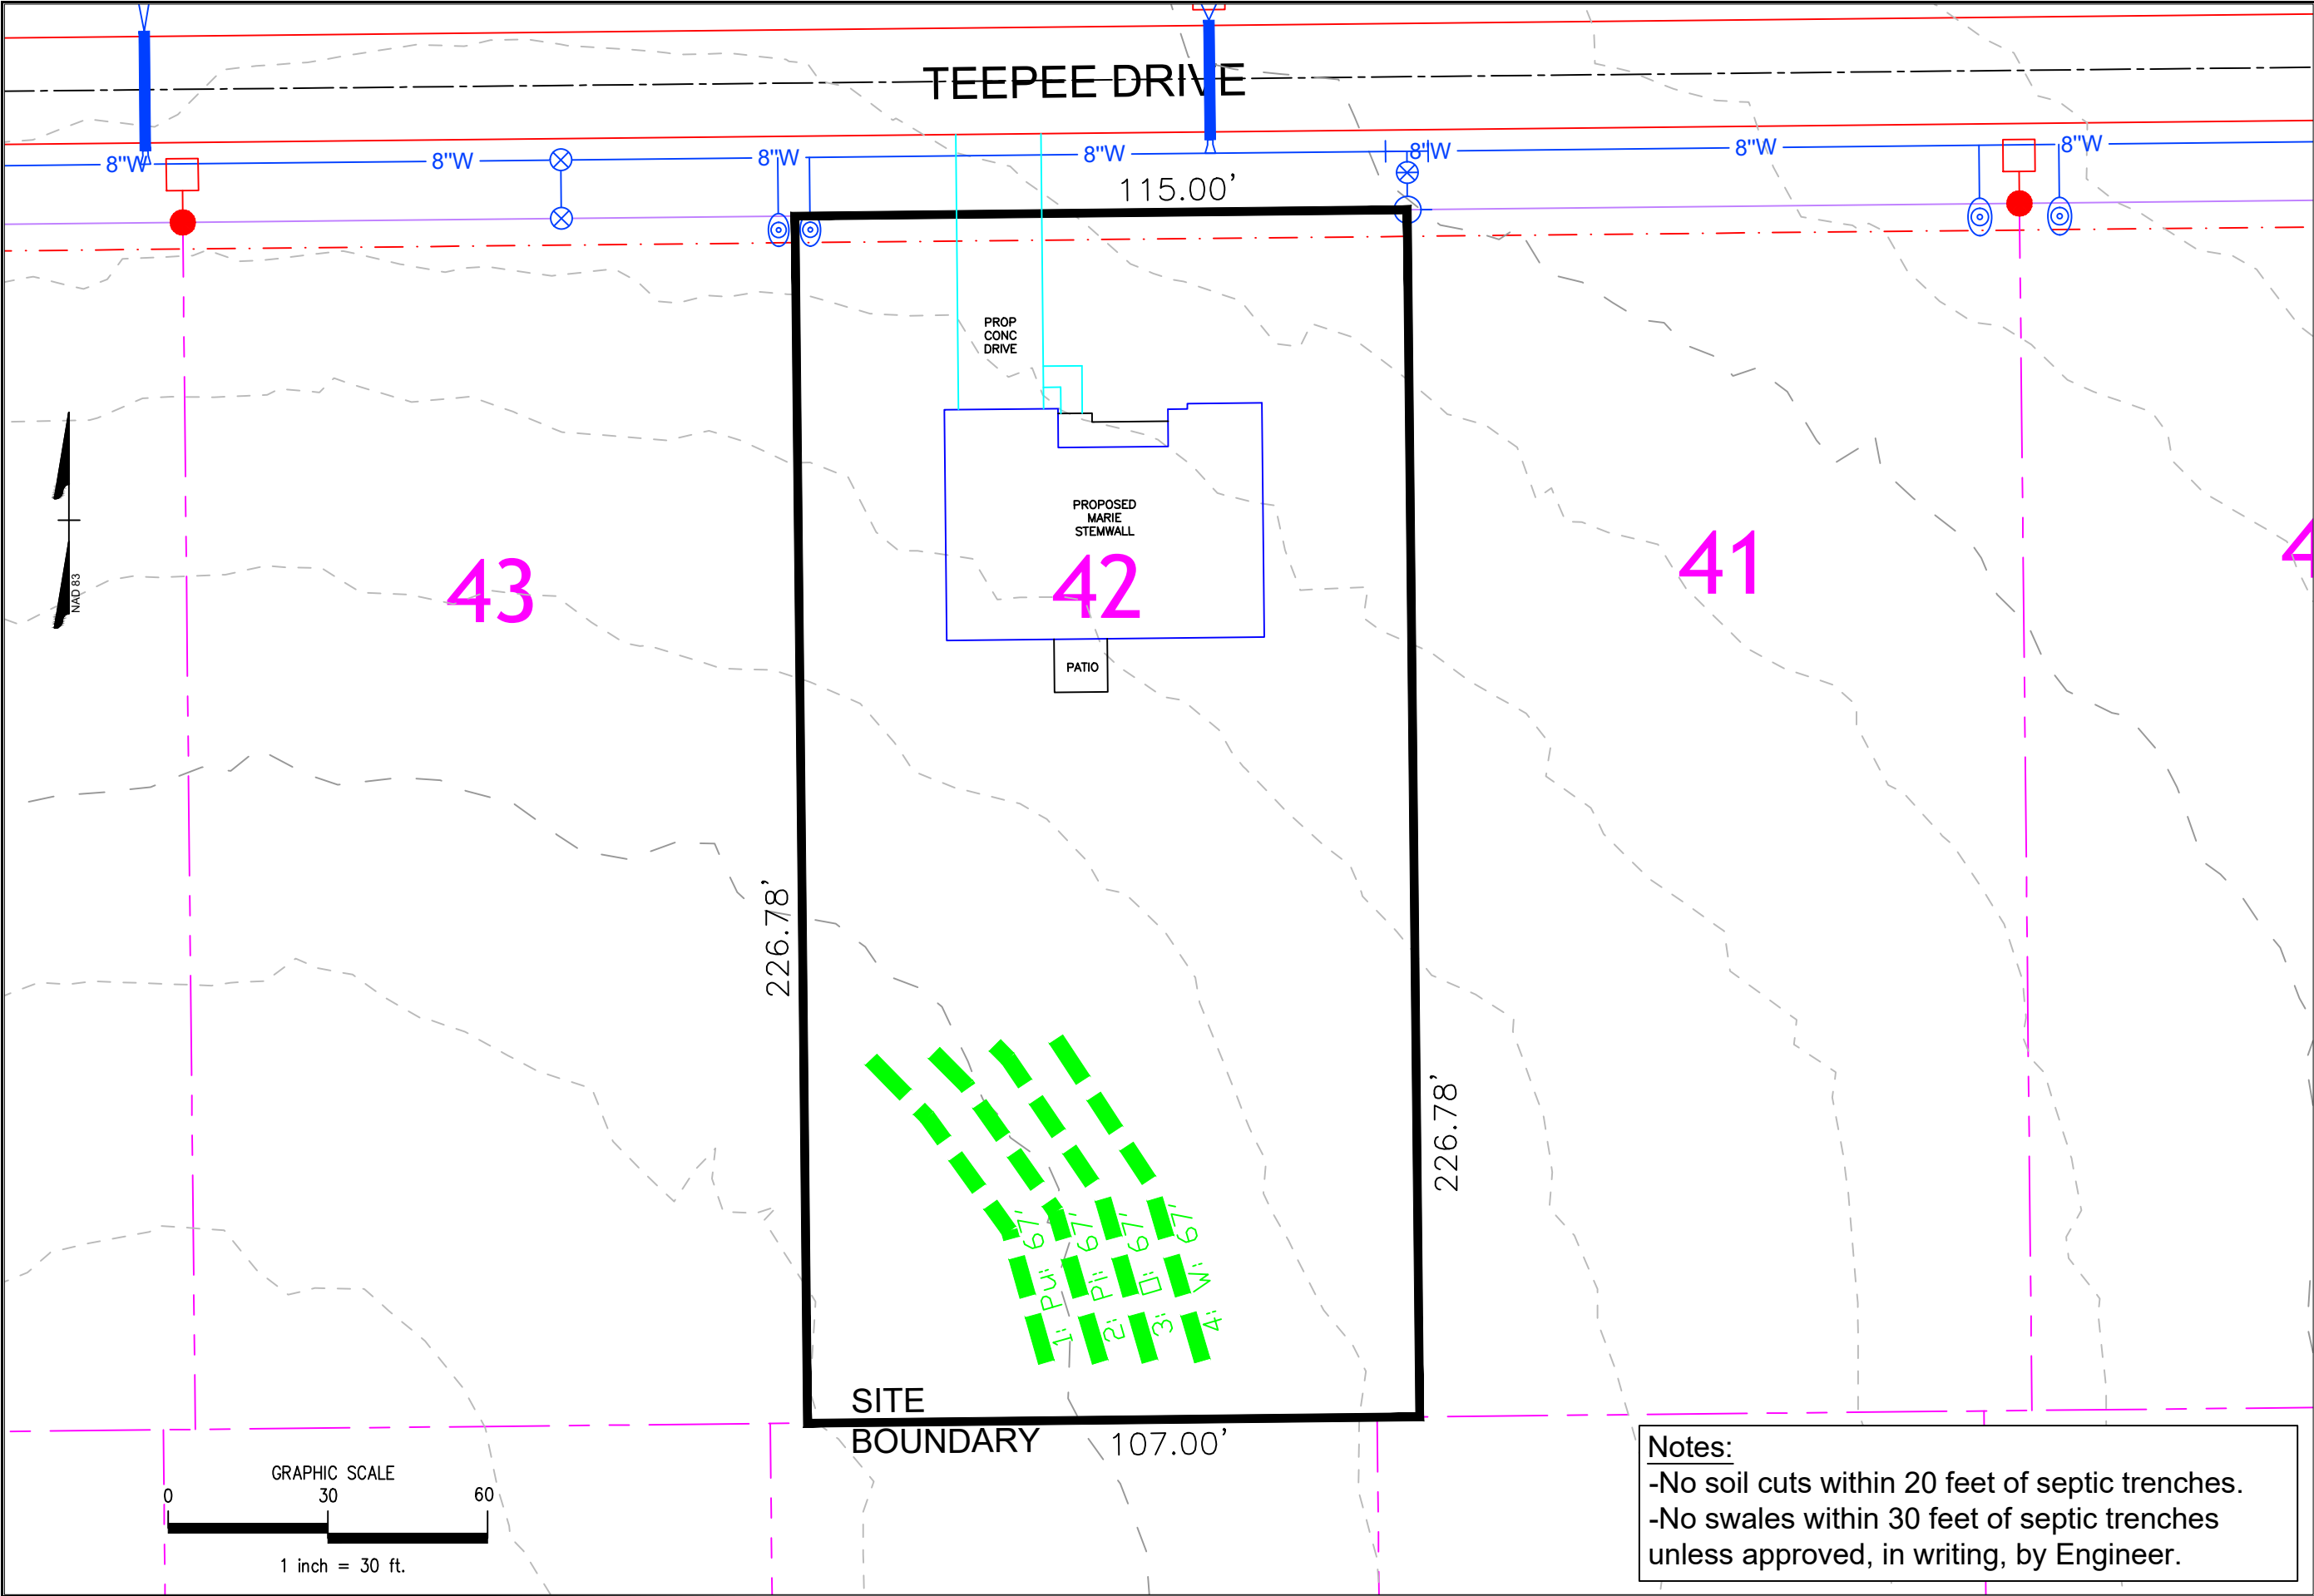

Notes:  
-No soil cuts within 20 feet of septic trenches.  
-No swales within 30 feet of septic trenches  
unless approved, in writing, by Engineer.

MITCHELL ENVIRONMENTAL, PA  
C-2911

1501 LAKESTONE VILLAGE LANE  
SUITE 205  
FUQUAY VARINA, NC 27526

PREPARED FOR : LQ Homes  
5511 Capital Center Drive  
Suite 560  
Raleigh, NC 27612

DATE : March 13, 2025

DESIGNER CONTACT:  
ADAM AYCOCK, EI

DRAWN BY:  
ADAM AYCOCK, EI

REVISION NO.  
Original Submittal

Revision 1

Revision 2

Revision 3

Master Set

DATE  
March 13, 2025

-----


-----

-----


-----

SHEET NUMBER  
3 of 7


Boone Trail Village  
Lot 42  
Repair Nitrification Field

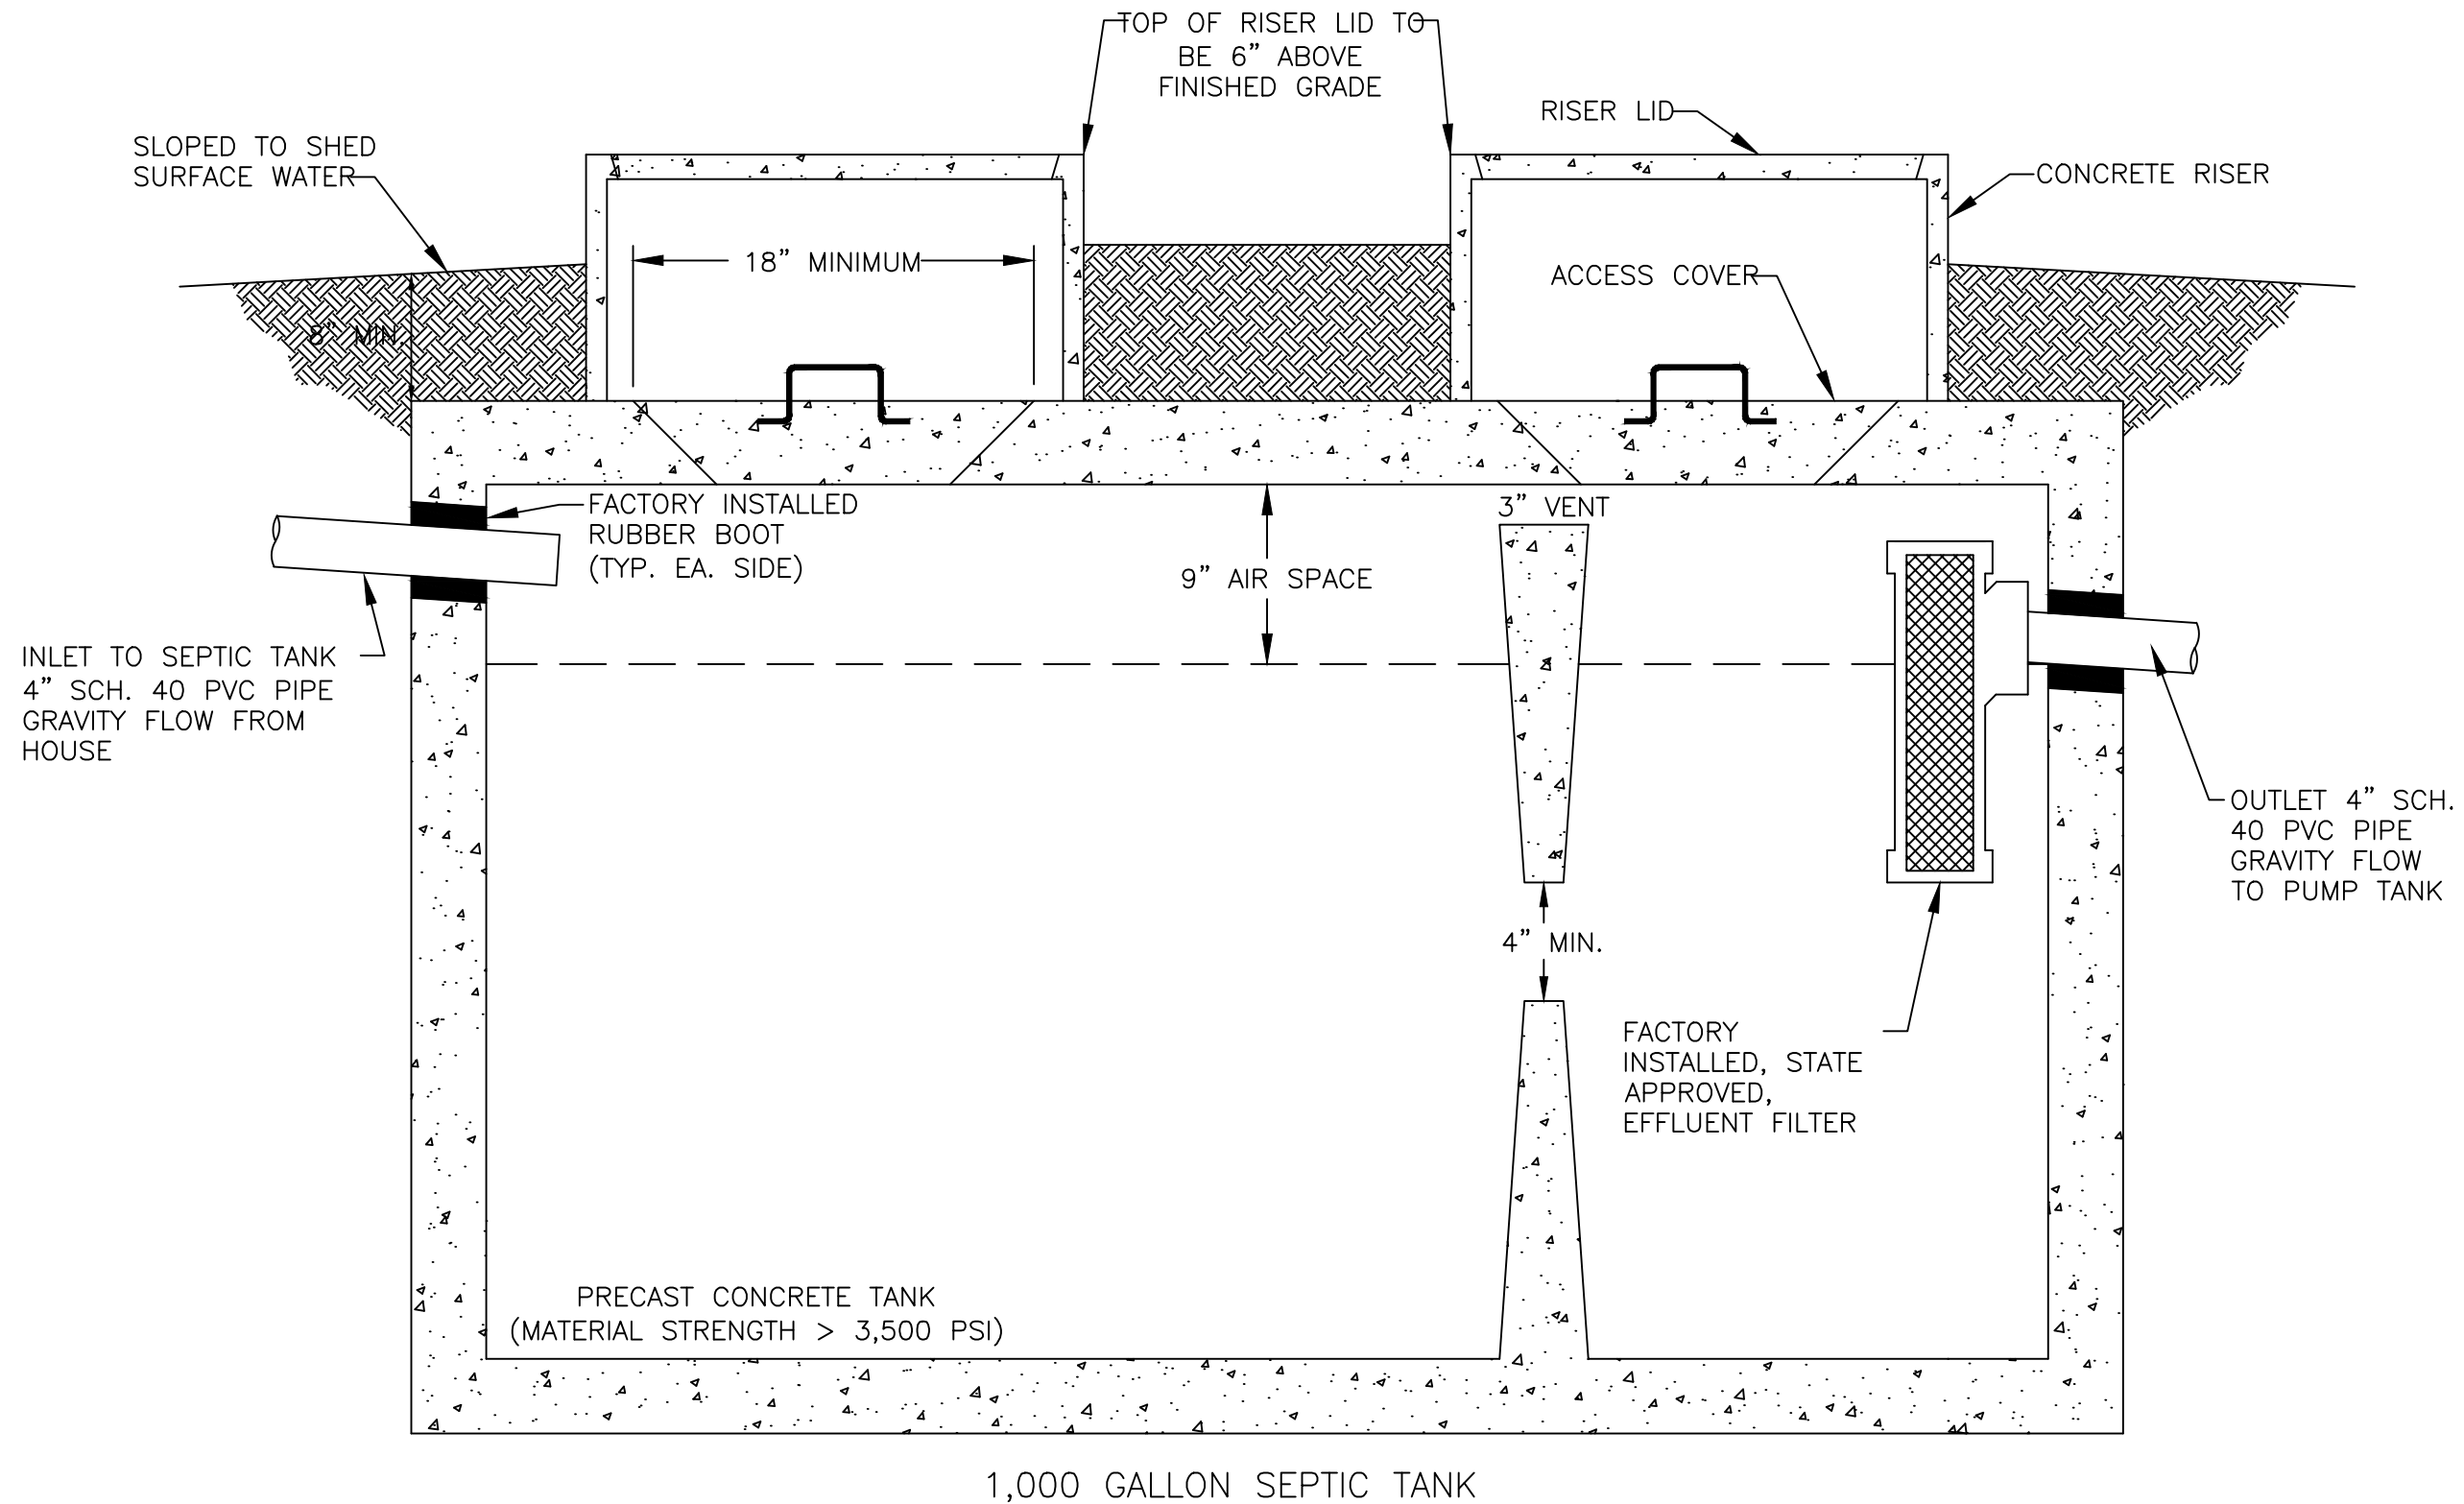

SEPTIC TANK DETAIL  
N.T.S.

	SHEET NUMBER		4 of 7		Boone Trail Village Lot 42 Septic Tank Detail	
	REVISION NO.	DATE	Original Submittal	Revision 1	Revision 2	Revision 3
	Original Submittal	March 13, 2025	Original Submittal	Revision 1	Revision 2	Revision 3
PREPARED FOR : LQ Homes 5511 Capital Center Drive Suite 560 Raleigh, NC 27612		DATE : March 13, 2025		DESIGNER CONTACT: ADAM AYCOCK, EI		DRAWN BY: ADAM AYCOCK, EI
MITCHELL ENVIRONMENTAL, PA C-2911		1501 LAKESTONE VILLAGE LANE SUITE 205 FUQUAY VARINA, NC 27526				

\* DRAWDOWN SPECIFIED 18.0 GALLONS PER INCH

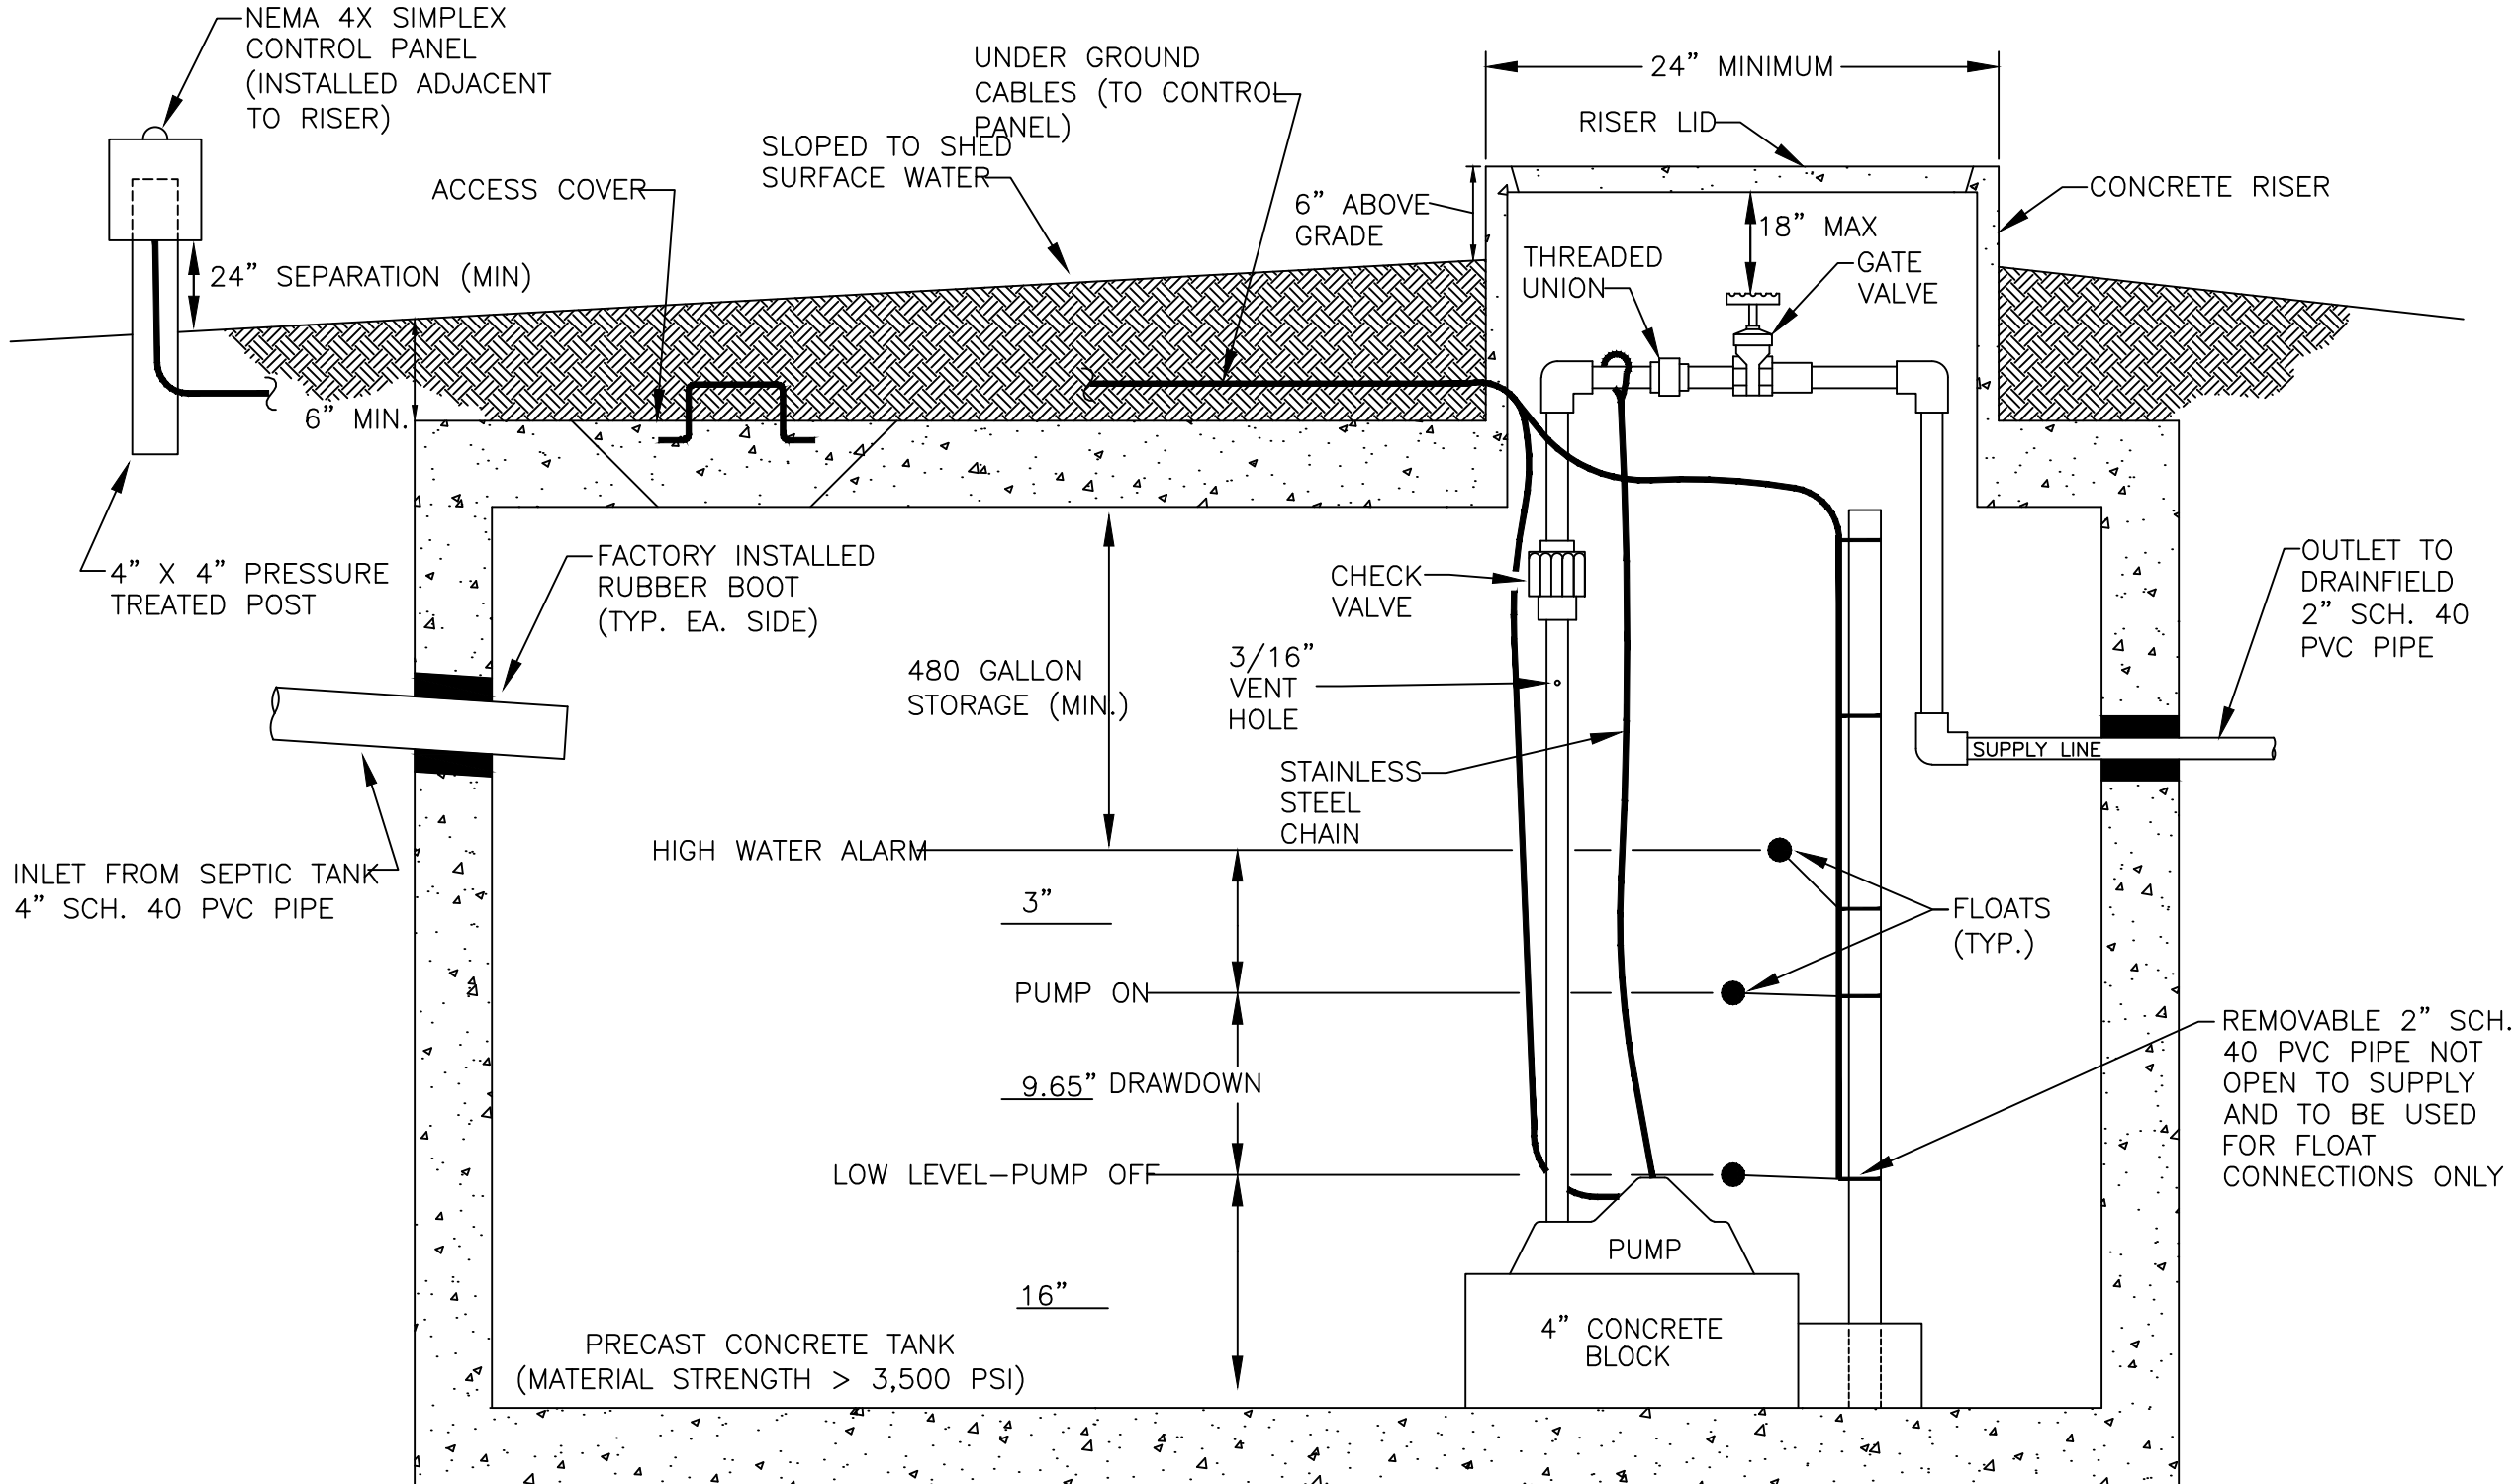

## 1,000 GALLON PUMP TANK

### PUMP TANK DETAIL

N.T.S.

**SHEET NUMBER**

5 of 7

**Boone Trail Village**  
**Lot 42**  
**Pump Tank Detail**

DATE March 13, 20

March 13, 20

REVISION NO.

Original Submitt

Revision 1

**Reviser 7**

Master Set

Master Set

PREPARED FOR : LSI Homes  
5511 Capital Center Drive  
Suite 560  
Raleigh, NC 27612


DATE : March 13, 2025

DESIGNER CONTACT:  
ADAM AYCOCK E

DRAWN BY:  
ADAM AYCOCK. E1

MITCHELL ENVIRONMENTAL, PA  
C-2911

1501 LAKESTONE VILLAGE LANE  
SUITE 205  
FUQUAY VARINA, NC 27526






**PRESSURE MANIFOLD DETAIL**  
**FOR BOONE TRAIL VILLAGE LOT 42 INITIAL SEPTIC SYSTEM**  
N.T.S.

NOTE: MANIFOLD MAY NEED TO BE FLIPPED SO THAT  
SUPPLY LINE ENTRANCE AND CLEANOUTS ARE  
REVERSED. SEE SITE PLAN.

NOTE: THE NUMBER OF TAPS MAY VARY FROM LOT  
TO LOT. SEE DESIGN SHEET FOR NUMBER OF TAPS.

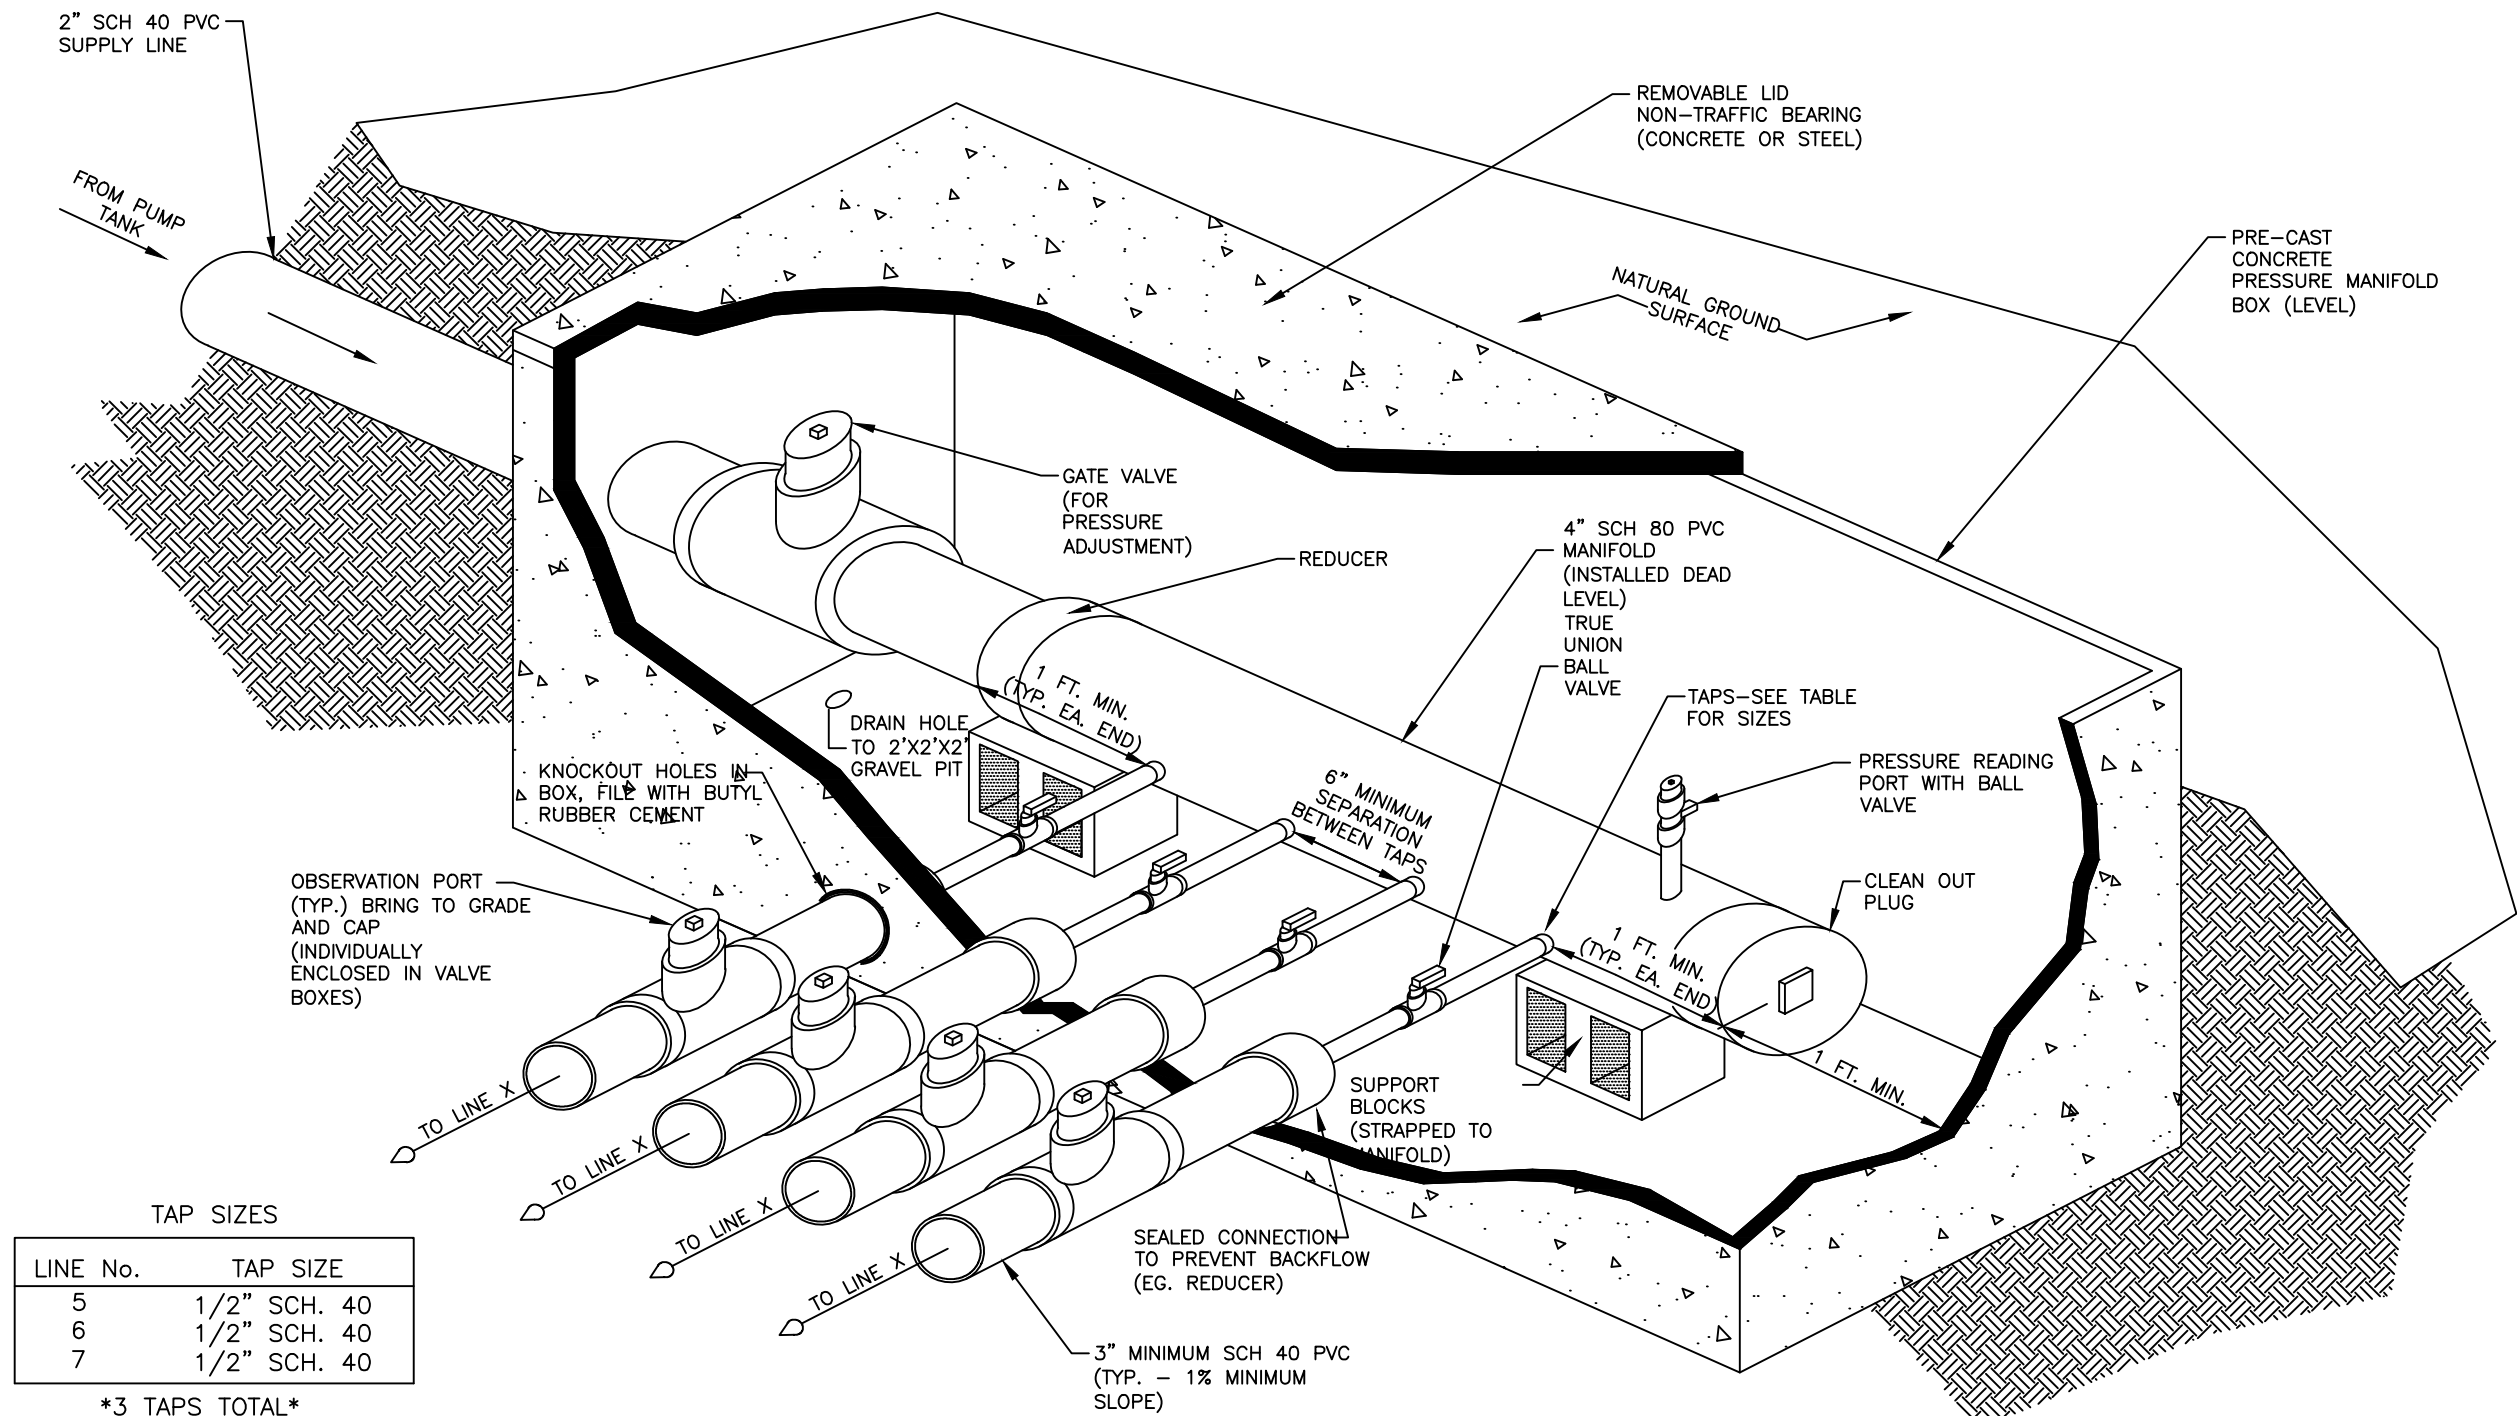


TAP SIZES

LINE No.	TAP SIZE
5	1/2" SCH. 40
6	1/2" SCH. 40
7	1/2" SCH. 40


\*3 TAPS TOTAL\*

SHEET NUMBER	6 of 7	Boone Trail Village Lot 42 Pressure Manifold Detail
DATE	March 13, 2025	
REVISION NO.	Original Submittal	
	Revision 1	
	Revision 2	
	Revision 3	
	Master Set	
PREPARED FOR :	LJI Homes 5511 Capital Center Drive Suite 560 Raleigh, NC 27612	
DATE :	March 13, 2025	
DESIGNER CONTACT:	ADAM AYCOCK, EI	
DRAWN BY:	ADAM AYCOCK, EI	
MITCHELL ENVIRONMENTAL, PA C-2911 1501 LAKESTONE VILLAGE LANE SUITE 205 FUQUAY VARINA, NC 27526		



NITRIFICATION TRENCH  
DETAIL FOR EZ-FLOW


N.T.S.

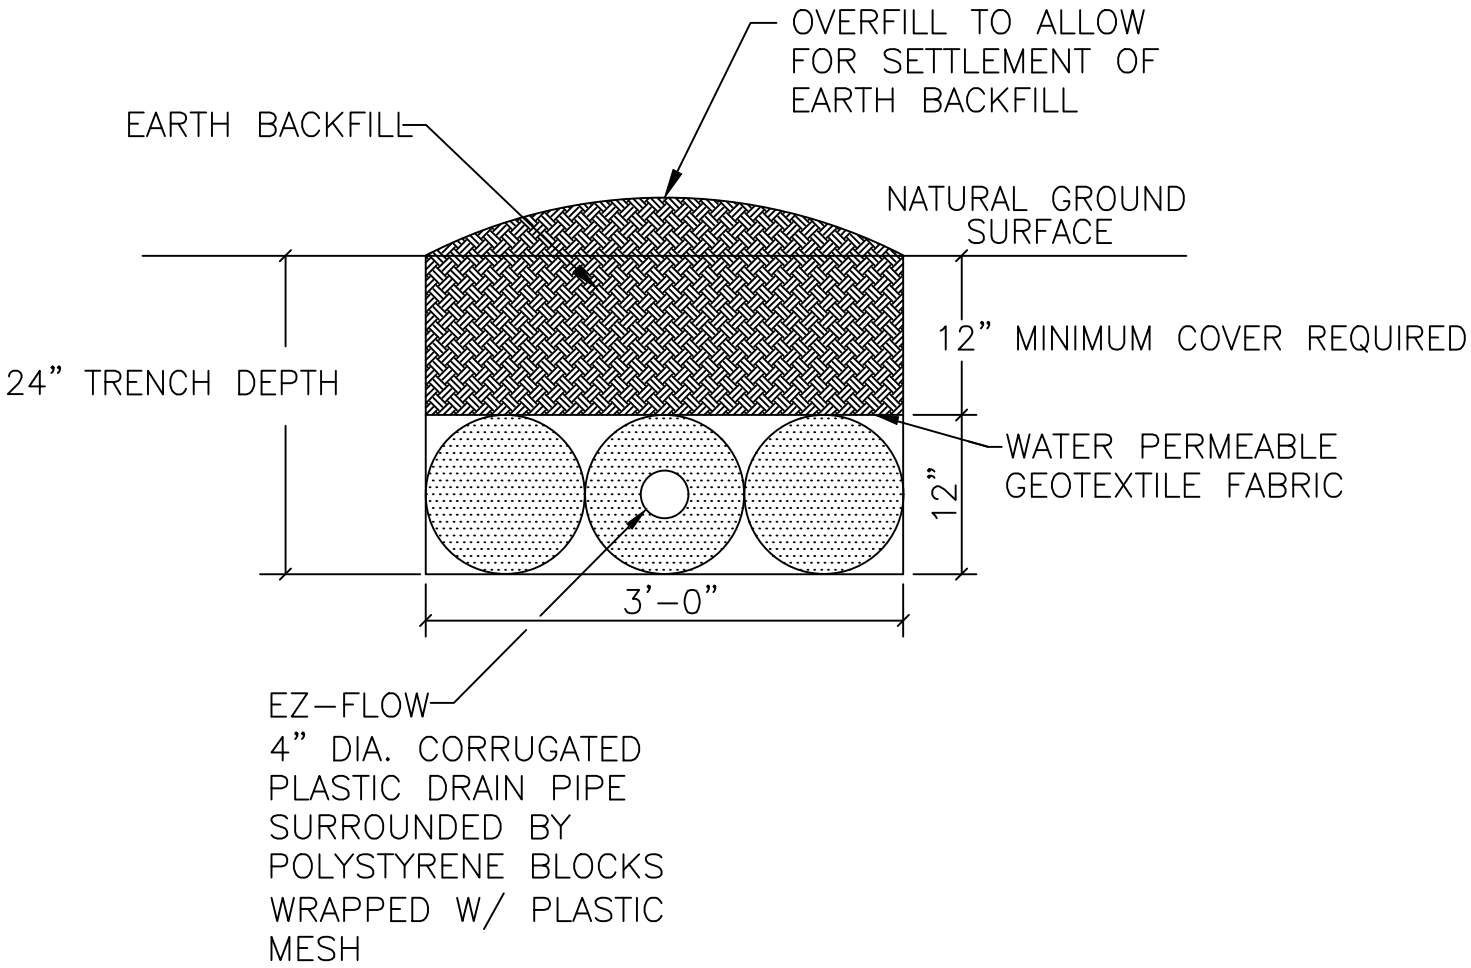

NOTES:

1. PERFORATED CORRUGATED PLASTIC PIPE SHALL MEET REQUIREMENTS OF ASTM D 2729.
2. PIPE SHALL BE LEVEL.
3. ENDCAP SHALL BE PROVIDED AT END OF ALL CORRUGATED PLASTIC PIPE LINES.
4. TRENCH BOTTOM SHALL BE LEVEL.
5. HAND RAKE TRENCH WALLS PRIOR TO PLACEMENT OF TRENCH MEDIA IF SOIL SMEARING IS PRESENT.

SHEET NUMBER		DATE	REVISION NO.	LGI Homes PREPARED FOR : 5511 Capital Center Drive Suite 560 Raleigh, NC 27612	
7 of 7		March 13, 2025	Original Submittal	DATE : March 13, 2025	
		-----	Revision 1	DESIGNER CONTACT:	
		-----	Revision 2	ADAM AYCOCK, EI	
		-----	Revision 3	DRAWN BY:	
Boone Trail Village Lot 42 Trench Detail		-----	Master Set	ADAM AYCOCK, EI	
		-----			



MITCHELL ENVIRONMENTAL, PA  
C-2911  
1501 LAKESTONE VILLAGE LANE  
SUITE 205  
FUQUAY VARINA, NC 27526