


Southeastern Soil & Environmental Associates, Inc.

P.O. Box 9321
Fayetteville, NC 28311
Phone/Fax (910) 822-4540
Email mike@southeasternsoil.com

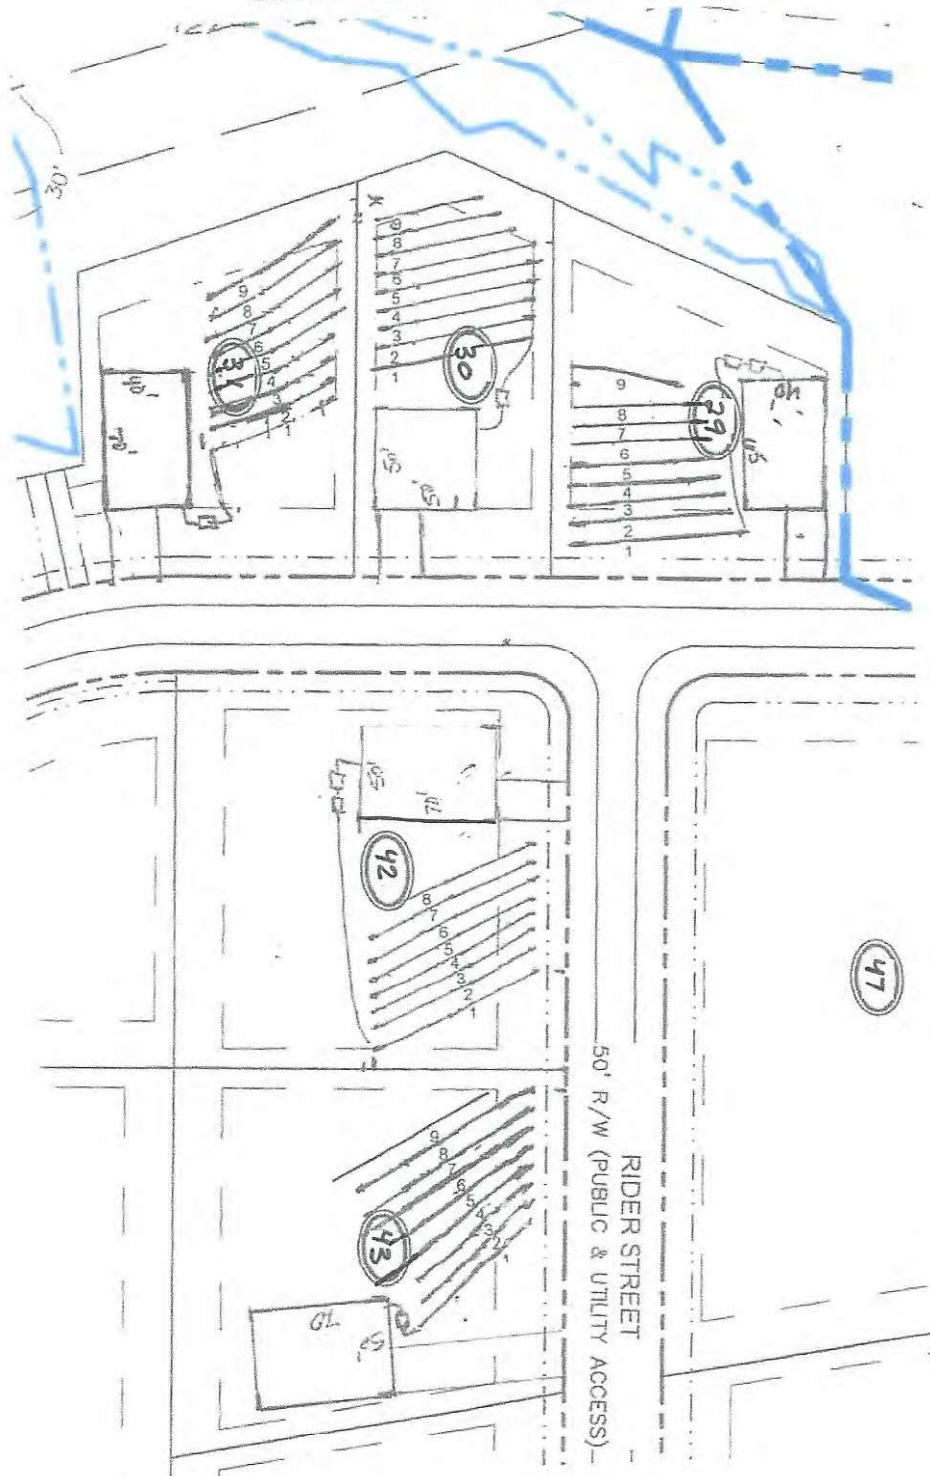

*check LTAR

SOUTHEASTERN SOIL & ENVIRONMENTAL ASSOC., INC.

PROPOSED SUBSURFACE WASTE DISPOSAL SYSTEM DETAIL SHEET

SUBDIVISION: BRAYDEN PRESERVE

LOT 42

^{Pump}
INITIAL SYSTEM: Approved 25% Reduction

^{Pump}
REPAIR: Approved 25% Reduction

DISTRIBUTION: P-Box

DISTRIBUTION P-Box

BENCHMARK: 100.0

LOCATION FC TOS 44/45

NO. BEDROOMS: 3

LTAR 0.3 gpd/ft²

SEPTIC TANK SIZE 1000

PUMP TANK SIZE 1,000

LINE	FLAG COLOR	ELEVATION	LENGTH
1	0	93.59	75 (45)
2	W	93.33	75 (45)
3	0	92.93	75 (45)
4	W	92.58	75 (45)
300 340 AVAIL			
5	0	92.41	75 (45)
6	W	92.00	75 (45)
7	0	91.41	75 (45)
8	W	91.08	75
300 330 AVAIL			

BY B.C. RAYNOR

DATE 01/23/2024

TYPICAL PROFILE

THERE SHALL BE NO GRADING,

0-10 LS VFR GR

CUTTING, LOGGING OR OTHER SOIL

10-30 SCLAY FI SBK

DISTURBANCE IN SEPTIC AREA

9m ≥ 25"

HEALTH DEPARTMENT USE ONLY.

DESIGNS DO NOT GUARANTEE FUNCTIONALITY