

Job 72503861	Truss A1	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - TELFAIR B ROOF Job Reference (optional)	32 CBR
-----------------	-------------	---------------------	----------	----------	--	--------

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:26

Page: 1

ID:a?q6?71yTv6SHVH?OlZqv2z8gqv-YXYQ87MzgYGIPi0Hlmcu??nztu?sUqV8ovkRSWzmaNd

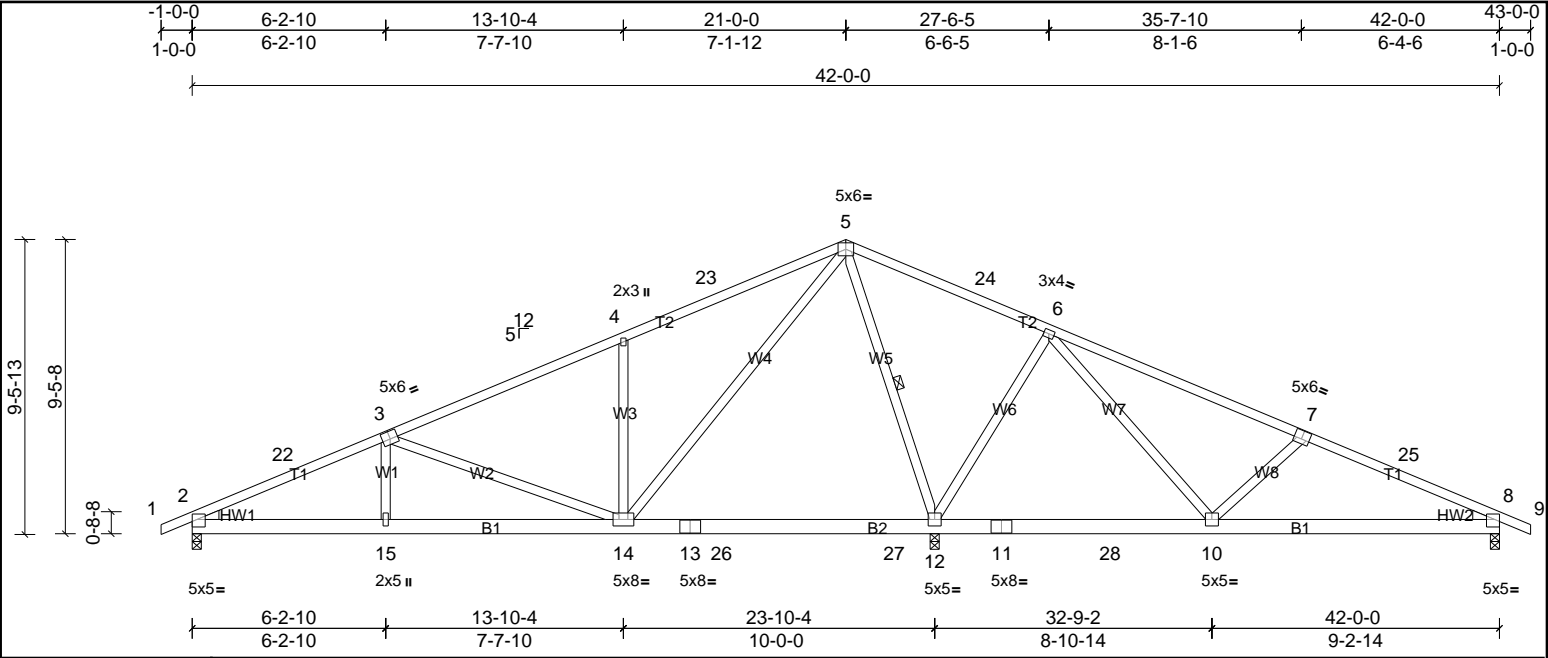


Plate Offsets (X, Y): [3:0-3-0,0-3-0], [7:0-3-0,0-3-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.09	12-14	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.15	12-14	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.85	Horz(CT)	0.01	12	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 254 lb	FT = 20%

LUMBER			BRACING		
TOP CHORD	2x4 SP No.2		TOP CHORD	Structural wood sheathing directly applied or 4-9-10 oc purlins.	
BOT CHORD	2x6 SP No.2		BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.	
WEBS	2x4 SP No.3		WEBS	1 Row at midpt	5-12
WEDGE	Left: 2x4 SP No.2				
	Right: 2x4 SP No.2				
REACTIONS					
	(lb/size)	2=774/0-3-8, (min. 0-1-8), 8=471/0-3-8, (min. 0-1-8), 12=2235/0-3-8, (min. 0-3-8)			
	Max Horiz	2=-160 (LC 11)			
	Max Uplift	2=-155 (LC 10), 8=-123 (LC 11), 12=-238 (LC 10)			
	Max Grav	2=827 (LC 21), 8=556 (LC 22), 12=2235 (LC 1)			
FORCES					
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.				
TOP CHORD		2-22=-1329/220, 3-22=-1201/235, 3-4=-682/142, 4-23=-696/255, 5-23=-601/285, 5-24=-6/843, 6-24=-33/708, 6-7=-377/147, 7-25=-562/198, 8-25=-689/182			
BOT CHORD		2-15=-298/1163, 14-15=-300/1160, 13-14=-285/268, 13-26=-285/268, 26-27=-285/268, 12-27=-285/268, 11-12=-365/164, 11-28=-365/164, 10-28=-365/164, 8-10=-105/580			
WEBS		4-14=-488/286, 5-14=-324/1165, 5-12=-1448/289, 6-12=-758/310, 6-10=-93/662, 7-10=-457/261, 3-14=-667/223			

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) -1-0-0 to 3-2-6, Interior (1) 3-2-6 to 16-9-10, Exterior (2) 16-9-10 to 25-2-6, Interior (1) 25-2-6 to 38-9-10, Exterior (2) 38-9-10 to 43-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 155 lb uplift at joint 2, 238 lb uplift at joint 12 and 123 lb uplift at joint 8.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR B ROOF
72503861	A1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:26

Page: 1

ID:a?q6?71yTv6SHVH?OlZqv2z8gqv-YXyQ87MzgYGiPl0Hlmcu??n79u4nU?U8ovkRSWzmaNd

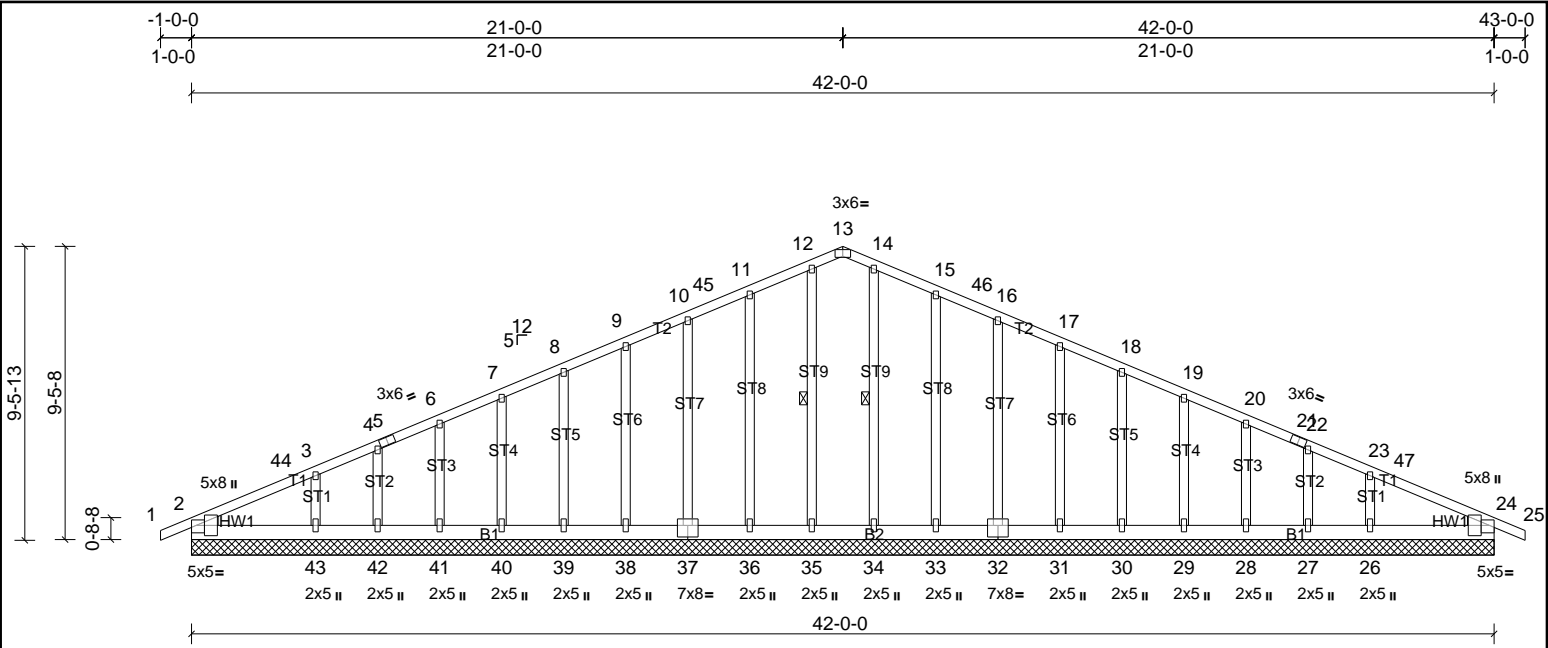


Plate Offsets (X, Y): [2:Edge,0-2-2], [13:0-3-0,Edge], [24:Edge,0-2-2], [32:0-4-0,0-4-8], [37:0-4-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.01	24	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							
										Weight: 305 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
OTHERS 2x4 SP No.3
WEDGE Left: 2x4 SP No.2
Right: 2x4 SP No.2

REACTIONS

All bearings 42-0-0.
(lb) - Max Horiz 2=160 (LC 15)
Max Uplift All uplift 100 (lb) or less at joint(s) 27, 28, 29, 30, 31, 32, 33, 36, 37, 38, 39, 40, 41, 42 except 26=108 (LC 11), 43=111 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 2, 24, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42 except 26=311 (LC 22), 43=311 (LC 21)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 11-12=87/254, 12-13=85/259, 13-14=85/259, 14-15=87/254

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner (3) 1-0-0 to 3-2-6, Exterior (2) 3-2-6 to 16-9-10, Corner (3) 16-9-10 to 25-2-6, Exterior (2) 25-2-6 to 38-9-10, Corner (3) 38-9-10 to 43-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only.
- All plates are 2x3 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 36, 37, 38, 39, 40, 41, 42, 33, 32, 31, 30, 29, 28, 27 except (jt=lb) 43=110, 26=107.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 24.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 12-35, 14-34



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR B ROOF
72503861	A1T	Truss	6	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:27

Page: 1

ID:a?q6?71yTv6SHVH?OIzqv2z8gqv-1j6oLTNbRsOY1ubUsU77XDK65IFADGBH1YT_yzmaNc

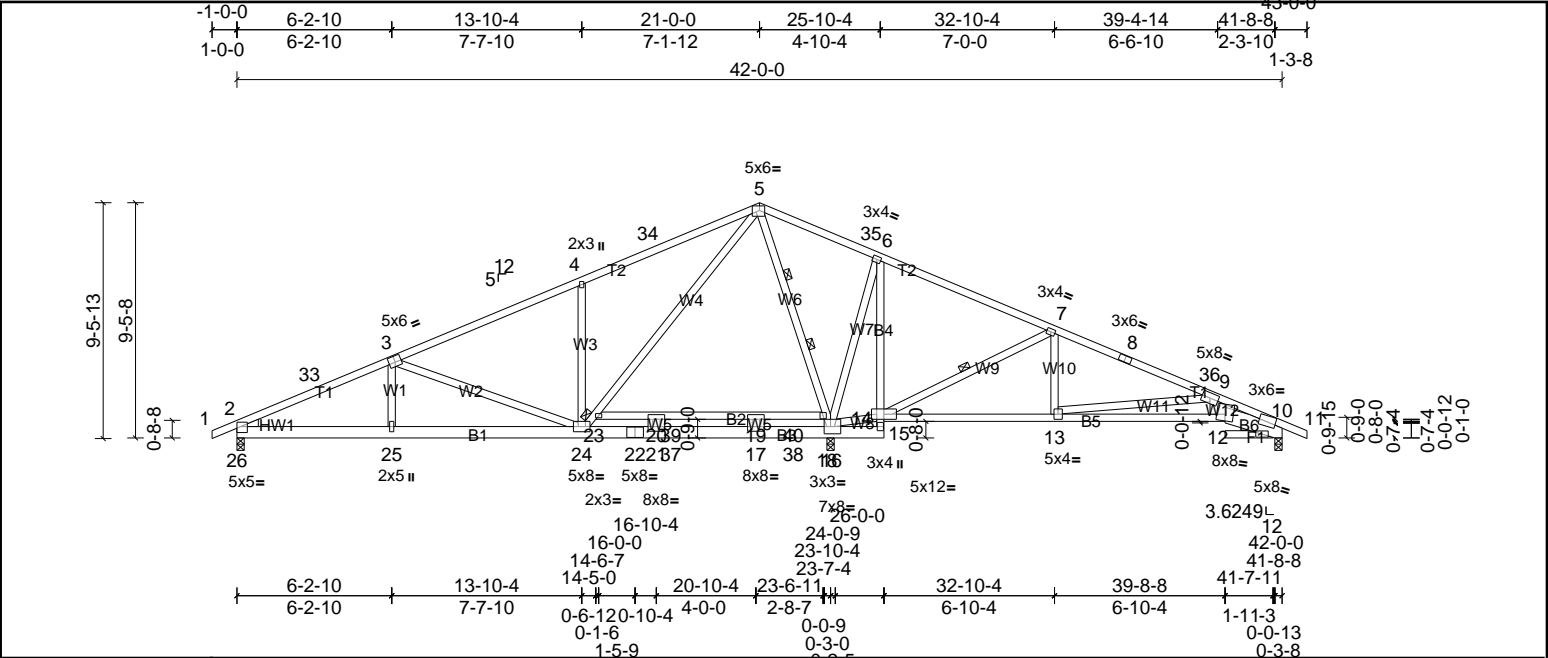


Plate Offsets (X, Y): [3:0-3-0,0-3-0], [5:0-2-8,0-2-4], [10:0-3-12,0-1-4], [12:0-4-0,0-3-4]

Loading	(psf)	Spacing	2-3-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.17	19-20	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.29	19-20	>992	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.95	Horz(CT)	0.03	10	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 283 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	2-0-0 oc purlins (4-5-5 max.)
BOT CHORD	2x6 SP No.2 *Except* B4,F1:2x4 SP No.3, B5,B2:2x4 SP No.2, B6:2x8 SP No.2		(Switched from sheeted: Spacing > 2-0-0).
WEBS	2x4 SP No.3 *Except* W12:2x8 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEDGE	Left: 2x4 SP No.2	WEBS	1 Row at midpt 7-14
		WEBS	2 Rows at 1/3 pts 5-18
REACTIONS			
(lb/size)	2=837/0-3-8, (min. 0-1-8), 10=422/0-3-8, (min. 0-1-8), 16=2867/0-3-8, (req. 0-4-8)		
Max Horiz	2=-180 (LC 11)		
Max Uplift	2=-168 (LC 10), 10=-131 (LC 11), 16=-180 (LC 11)		
Max Grav	2=941 (LC 21), 10=498 (LC 22), 16=2867 (LC 1)		
FORCES			
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.			
TOP CHORD	2-33=-1510/238, 3-33=-1366/255, 3-4=-822/135, 4-34=-834/262, 5-34=-745/296, 5-35=0/1154, 6-35=0/1040, 6-7=-31/1051, 7-8=-91/283, 8-36=-228/252, 9-10=-1222/284		
BOT CHORD	2-25=-327/1322, 24-25=-329/1320, 22-24=-454/343, 21-22=-454/343, 21-37=-454/343, 17-37=-454/343, 17-38=-454/343, 16-38=-454/343, 15-16=-337/0, 14-15=-471/0, 6-14=-251/132, 12-13=-273/1095, 10-12=-229/1157		
WEBS	23-24=-310/1394, 5-23=-286/1436, 5-18=-1807/241, 16-18=-1841/219, 14-16=-720/354, 7-14=-958/267, 7-13=0/433, 9-13=-947/306, 4-24=-548/322, 3-24=-737/265, 6-16=-521/289, 9-12=0/298		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) -1-0-0 to 3-2-6, Interior (1) 3-2-6 to 16-9-10, Exterior (2) 16-9-10 to 25-2-6, Interior (1) 25-2-6 to 38-9-10, Exterior (2) 38-9-10 to 43-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - WARNING: Required bearing size at joint(s) 16 greater than input bearing size.
 - Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 168 lb uplift at joint 2, 180 lb uplift at joint 16 and 131 lb uplift at joint 10.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR B ROOF
72503861	A2	Truss	10	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:27

Page: 1

ID:a?q6?771yTv6SHVH?OIzqv2z8gqv-1j6oLTNbRsOY1ubUsU77XDK5CICHDJyH1YT_yzmaNc

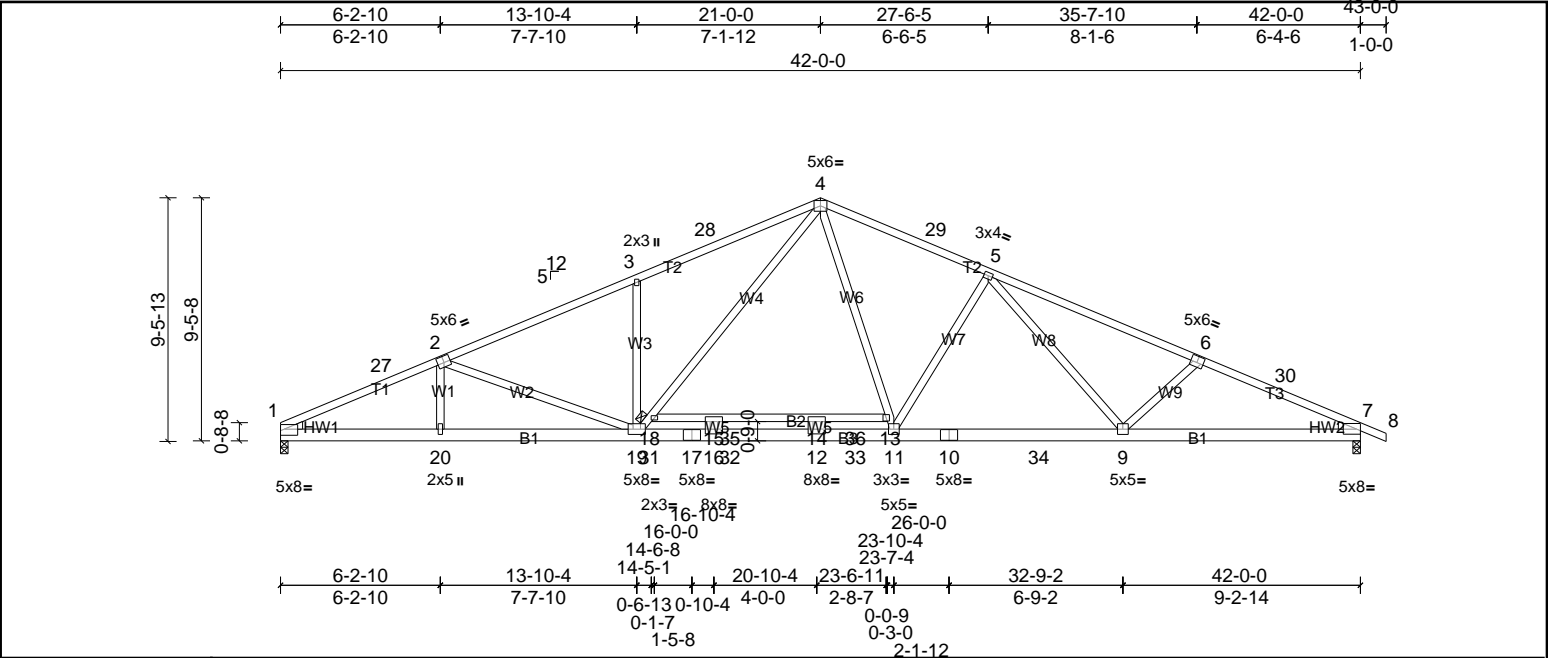


Plate Offsets (X, Y): [2:0-3-0,0-3-0], [6:0-3-0,0-3-0], [7:Edge,0-1-10]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	-0.32	14-15	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.99	Vert(CT)	-0.63	14-15	>794	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.70	Horz(CT)	0.11	7	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 267 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1 *Except* T1,T3:2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x6 SP SS *Except* B3:2x6 SP No.2, B2:2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	2x4 SP No.3		
WEDGE	Left: 2x4 SP No.2 Right: 2x4 SP No.2		
REACTIONS			
	(lb/size) 1=1782/0-3-8, (min. 0-2-13), 7=1826/0-3-8, (min. 0-2-14)		
	Max Horiz 1=167 (LC 11)		
	Max Uplift 1=174 (LC 10), 7=207 (LC 11)		
FORCES			
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-27=-3585/371, 2-27=-3459/385, 2-3=-3334/331, 3-28=-3345/429, 4-28=-3268/449, 4-29=-2818/374, 5-29=-2892/347, 5-6=-3428/389, 6-30=-3559/421, 7-30=-3666/395		
BOT CHORD	1-20=-391/3237, 19-20=-393/3240, 19-31=-28/2318, 17-31=-28/2318, 16-17=-28/2318, 16-32=-28/2318, 12-32=-28/2318, 12-33=-28/2318, 11-33=-28/2318, 10-11=-147/2875, 10-34=-147/2875, 9-34=-147/2875, 7-9=-289/3320		
WEBS	3-19=-492/287, 18-19=-266/1195, 4-18=-244/1244, 4-13=-100/1151, 11-13=-120/1088, 5-11=-671/309, 5-9=-87/441, 6-9=-401/256, 2-19=-431/231		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) 0-0-0 to 4-2-6, Interior (1) 4-2-6 to 16-9-10, Exterior (2) 16-9-10 to 25-2-6, Interior (1) 25-2-6 to 38-9-10, Exterior (2) 38-9-10 to 43-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 174 lb uplift at joint 1 and 207 lb uplift at joint 7.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR B ROOF
72503861	A2G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:28

Page: 1

ID:a?q6?71yTv6SHVH?OlZqv2z8gqv-VvgAZpODC9WPf2AgQBEM4QtTfhmoyv_RGCDYXPzmaNb

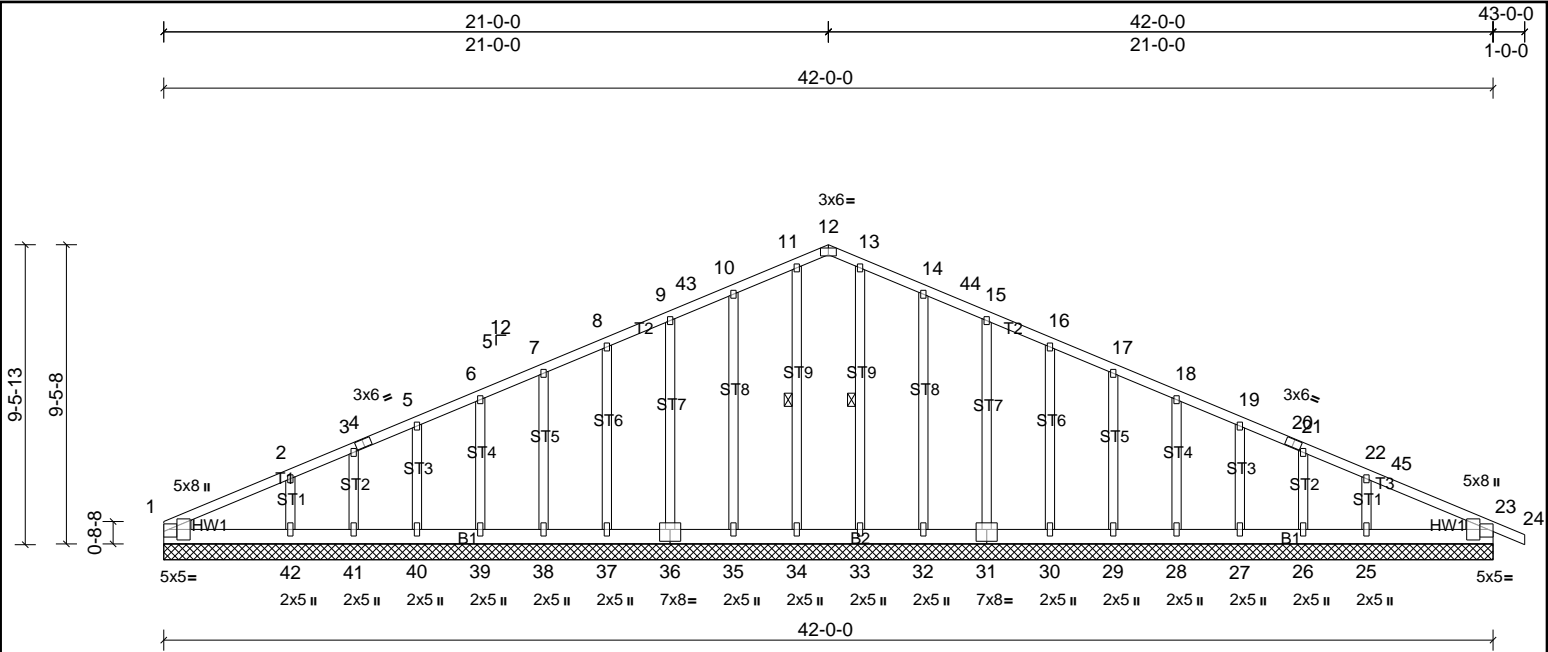


Plate Offsets (X, Y): [1:Edge,0-2-2], [12:0-3-0,Edge], [23:Edge,0-2-2], [31:0-4-0,0-4-8], [36:0-4-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(CT)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.01	23	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							
										Weight: 304 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3	WEBS	1 Row at midpt
WEDGE	Left: 2x4 SP No.2 Right: 2x4 SP No.2		11-34, 13-33
REACTIONS			
All bearings 42-0-0.			
(lb) - Max Horiz 1=162 (LC 11)			
Max Uplift All uplift 100 (lb) or less at joint(s) 26, 27, 28, 29, 30, 31, 32, 35, 36, 37, 38, 39, 40, 41 except 25=108 (LC 11), 42=117 (LC 10)			
Max Grav All reactions 250 (lb) or less at joint(s) 1, 23, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41 except 25=311 (LC 22), 42=328 (LC 21)			
FORCES			
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.			
TOP CHORD 10-11=87/254, 11-12=85/260, 12-13=85/260, 13-14=87/254			

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner (3) 0-0-0 to 4-0-0, Exterior (2) 4-0-0 to 16-9-10, Corner (3) 16-9-10 to 25-2-6, Exterior (2) 25-2-6 to 38-9-10, Corner (3) 38-9-10 to 43-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 35, 36, 37, 38, 39, 40, 41, 32, 31, 30, 29, 28, 27, 26 except (jt=lb) 42=117, 25=107.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72503861	Truss P1	Truss Type Truss	Qty 11	Ply 1	MUNGO HOMES - TELFAIR B ROOF Job Reference (optional)
-----------------	-------------	---------------------	-----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:28

Page: 1

ID:a?q6?71yTv6SHVH?OlZqv2z8gqv-VvgAZpODC9WPl2AgQBEM4QtTGHmQyxCRGCDYXPzmaNb

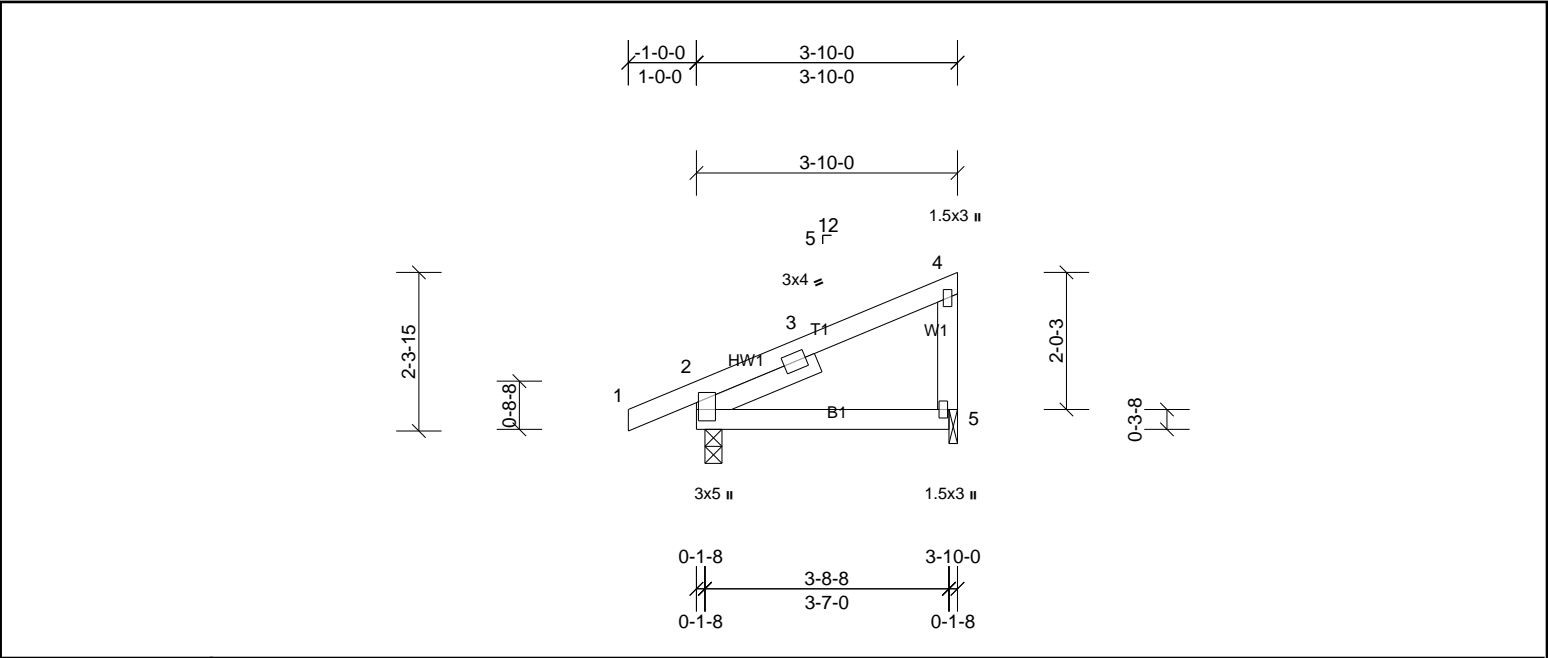


Plate Offsets (X, Y): [2:0-3-3,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	0.01	5-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(CT)	-0.02	5-8	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 19 lb	FT = 20%

LUMBER				BRACING	
TOP CHORD	2x4 SP No.2			TOP CHORD	Structural wood sheathing directly applied or 3-10-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2			BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3				
SLIDER	Left 2x4 SP No.3 -- 1-11-0				

REACTIONS	(lb/size)	2=216/0-3-0, (min. 0-1-8), 5=139/0-1-8, (min. 0-1-8)
	Max Horiz	2=87 (LC 9)
	Max Uplift	2=45 (LC 10), 5=38 (LC 10)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 2 and 38 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job 72503861	Truss V1	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - TELFAIR B ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:28

Page: 1

ID:a?q6?71yTv6SHVH?OIzqv2z8gqv-VvgAZpODC9WPF2AgQBEM4QtRmhlpyxDRGCDYXPzmaNb

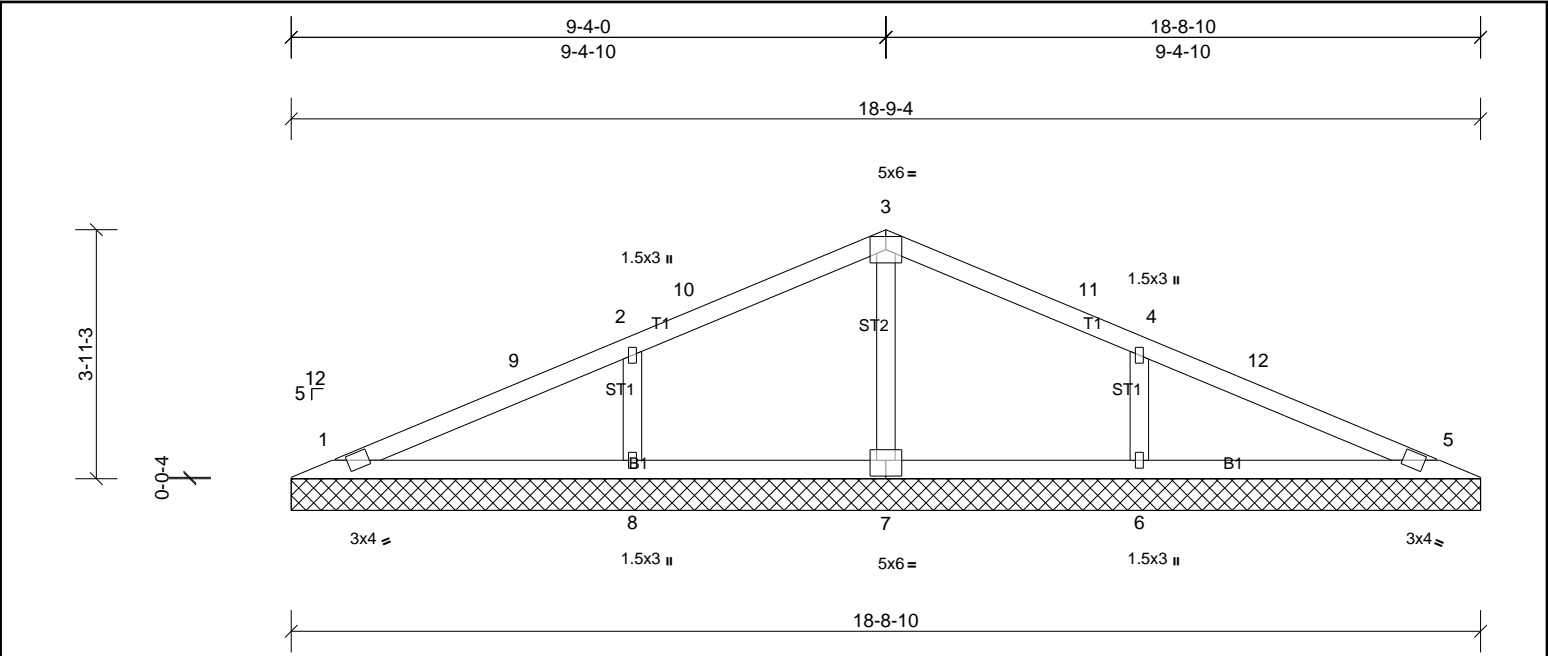


Plate Offsets (X, Y): [7:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 66 lb
											FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS	All bearings 18-9-4.
(lb) - Max Horiz	1=63 (LC 10)
Max Uplift	All uplift 100 (lb) or less at joint(s) 1, 5 except 6=128 (LC 11), 8=128 (LC 10)
Max Grav	All reactions 250 (lb) or less at joint(s) 1, 5, 7 except 6=424 (LC 22), 8=424 (LC 21)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS	2-8=-306/172, 4-6=-306/172

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) 0-9-1 to 3-9-1, Interior (1) 3-9-1 to 6-5-4, Exterior (2) 6-5-4 to 12-5-4, Interior (1) 12-5-4 to 15-1-7, Exterior (2) 15-1-7 to 18-1-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=128, 6=128.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR B ROOF
72503861	V2	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:28

Page: 1

ID:a?q6?71yTv6SHVH?OIzqv2z8gqv-VvgAZpODC9WPf2AgQBeM4QtMjhdywnRGCDYXPzmaNb

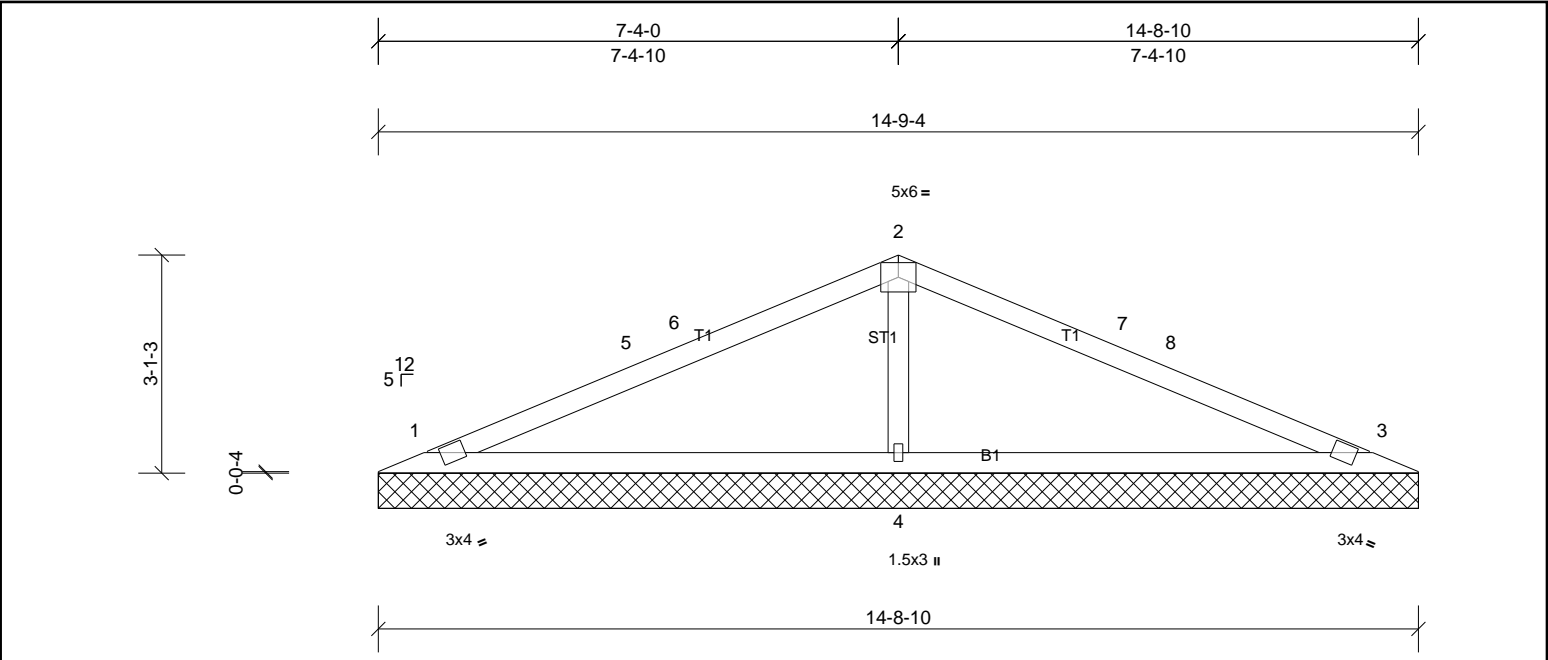

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.60	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.43	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							
										Weight: 47 lb	FT = 20%

LUMBER			BRACING		
TOP CHORD	2x4 SP No.2		TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.	
BOT CHORD	2x4 SP No.2		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
OTHERS	2x4 SP No.3				
REACTIONS	(lb/size)	1=232/14-9-4, (min. 0-1-11), 3=232/14-9-4, (min. 0-1-11), 4=606/14-9-4, (min. 0-1-11)			
	Max Horiz	1=49 (LC 14)			
	Max Uplift	1=52 (LC 10), 3=60 (LC 11), 4=47 (LC 10)			
	Max Grav	1=239 (LC 21), 3=239 (LC 22), 4=606 (LC 1)			
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.				
WEBS	2-4=-384/179				


- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) 0-9-1 to 3-9-1, Interior (1) 3-9-1 to 4-5-4, Exterior (2) 4-5-4 to 10-5-4, Interior (1) 10-5-4 to 11-1-7, Exterior (2) 11-1-7 to 14-1-7 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 1, 60 lb uplift at joint 3 and 47 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR B ROOF
72503861	V3	Truss	1	1	Job Reference (optional)

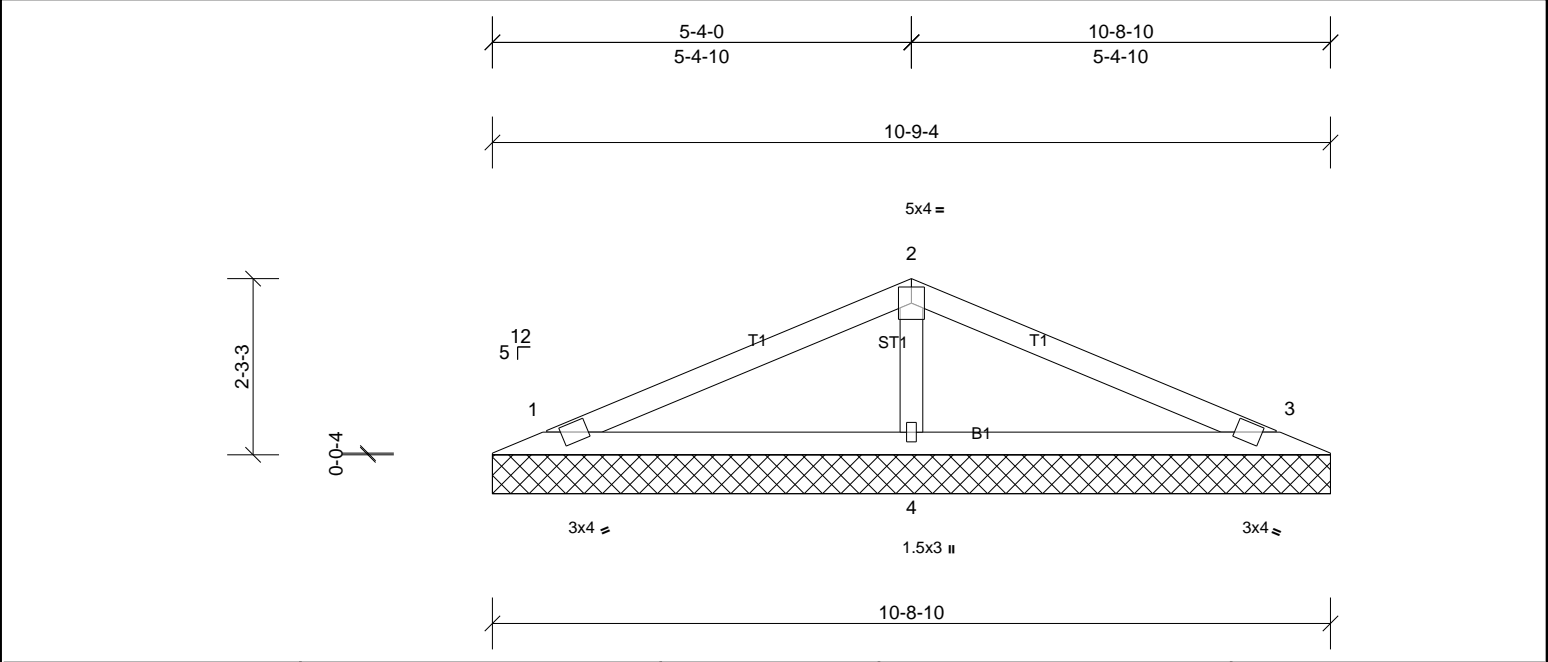

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.21	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.06	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 34 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	


REACTIONS	(lb/size)	1=163/10-9-4, (min. 0-1-8), 3=163/10-9-4, (min. 0-1-8), 4=424/10-9-4, (min. 0-1-8)
	Max Horiz	1=34 (LC 14)
	Max Uplift	1=-36 (LC 10), 3=-42 (LC 11), 4=-33 (LC 10)
	Max Grav	1=167 (LC 21), 3=167 (LC 22), 4=424 (LC 1)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS	2-4=-269/149

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 1, 42 lb uplift at joint 3 and 33 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Feb 10 10:45:29 Page: 1
ID:a?g6?71yTv6SHVH?OIzqv2z8gqv-z6DYm8PrzTeGGCIszvAbcePeW539hORaVsy53rmaNa



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS	(lb/size) 1=215/6-9-4, (min. 0-1-8), 3=215/6-9-4, (min. 0-1-8)		
	Max Horiz 1=20 (LC 10)		
	Max Uplift 1=-30 (LC 10), 3=-30 (LC 11)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-2=-278/151, 2-3=-278/151		



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCE and Truss Plant Institute.