

Job 72436981	Truss F200	Truss Type Truss	Qty 11	Ply 1	MUNGO HOMES-RUSSELL 2ND FLR Job Reference (optional) 29 LDP
-----------------	---------------	---------------------	-----------	----------	---

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:44

Page: 1

ID:Y?I0TELA5G72hK6FRQkx8OyE?ZL-W4mjpS3q0j6ZOV5jj8Sypxi97zqVlxUbsJPc4uzdNU

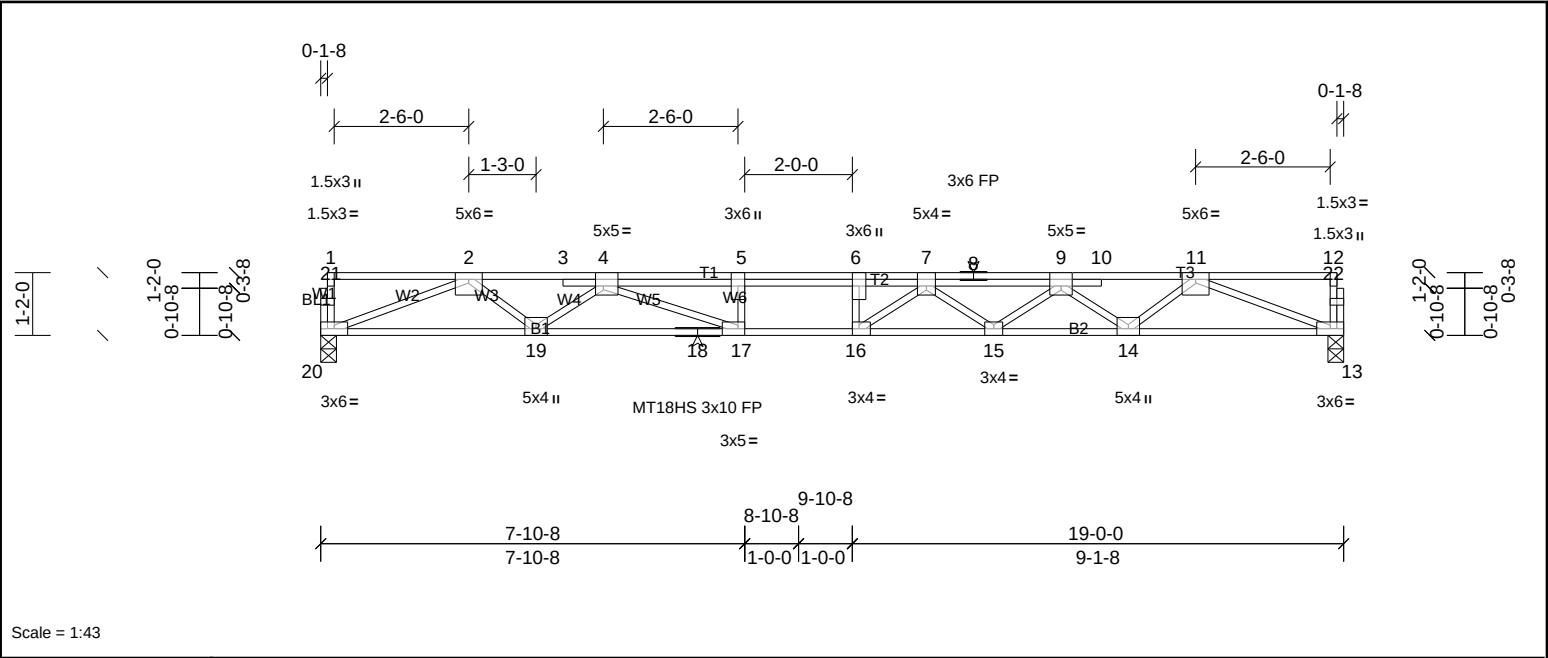


Plate Offsets (X, Y): [4:0-1-12,Edge], [6:0-3-0,Edge], [7:0-2-0,Edge], [9:0-2-8,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.28	Vert(LL)	-0.31	16	>737	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.44	16	>506	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.69	Horz(CT)	0.09	13	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 106 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP SS(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	13=1061/0-3-8, (min. 0-1-8), 20=1066/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3200/0, 3-4=-3202/0, 4-5=-5165/0, 5-6=-5165/0, 6-7=-5165/0, 7-8=-4548/0, 8-9=-4548/0, 9-10=-3182/0, 10-11=-3180/0	
BOT CHORD	19-20=0/2362, 18-19=0/4042, 17-18=0/4042, 16-17=0/5165, 15-16=0/5035, 14-15=0/4024, 13-14=0/2346	
WEBS	5-17=-437/0, 6-16=-357/139, 2-20=-2533/0, 2-19=0/1092, 4-19=-1070/0, 4-17=0/1402, 11-13=-2517/0, 11-14=0/1086, 9-14=-1073/0, 9-15=0/665, 7-15=-619/0, 7-16=-267/675	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 13-20=-10, 1-5=-100, 5-6=-136, 6-12=-100



Job 72436981	Truss F203	Truss Type Truss	Qty 6	Ply 1	MUNGO HOMES-RUSSELL 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	---

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:45

Page: 1

ID:FogodrQdAJ2S4IDz1dGQAYyE?Sn-SSuUE854YLMHeoF6qZUQuMnPonUnDuZuJduj7nzdNTy

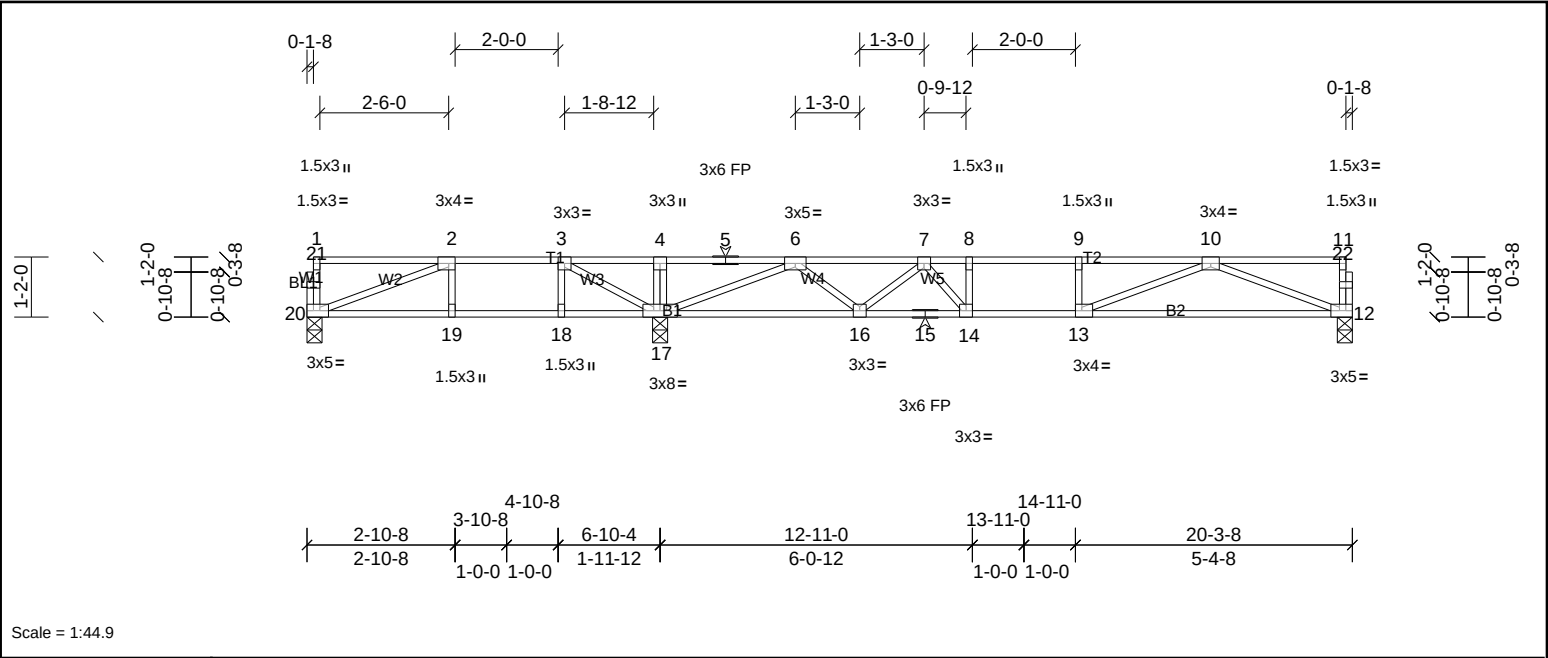


Plate Offsets (X, Y): [2:0-1-8,Edge], [12:0-2-0,Edge], [13:0-1-8,Edge], [20:0-2-0,Edge]


Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.66	Vert(LL)	-0.14	12-13	>999	480	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.79	Vert(CT)	-0.23	12-13	>694	360	
BCLL	0.0	Rep Stress Incr	NO	WB	0.46	Horz(CT)	0.04	12	n/a	n/a	
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							
										Weight: 98 lb	FT = 20%F, 11%E

LUMBER			BRACING				
TOP CHORD	2x4 SP No.2(flat)		TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.			
BOT CHORD	2x4 SP No.2(flat)		BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.			
WEBS	2x4 SP No.3(flat)						
OTHERS	2x4 SP No.3(flat)						
REACTIONS							
	(lb/size)	12=696/0-3-8, (min. 0-1-8), 17=1187/0-3-8, (min. 0-1-8), 20=309/0-3-8, (min. 0-1-8)					
	Max Grav	12=705 (LC 7), 17=1192 (LC 8), 20=366 (LC 3)					
FORCES							
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.						
TOP CHORD		2-3=-588/90, 3-4=-31/517, 4-5=-28/522, 5-6=-28/522, 6-7=-1715/0, 7-8=-2176/0, 8-9=-2176/0, 9-10=-2176/0					
BOT CHORD		19-20=-90/588, 18-19=-90/588, 17-18=-90/588, 16-17=0/1314, 15-16=0/2070, 14-15=0/2070, 13-14=0/2176, 12-13=0/1467					
WEBS		8-14=-270/0, 2-20=-622/99, 3-17=-833/0, 10-12=-1572/0, 10-13=0/784, 6-17=-1697/0, 6-16=0/559, 7-16=-515/0, 7-14=-46/430					

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:45 Page: 1
ID:r1axiF0kt35eqFuBri7h64yE?S1-SSuUE854YLMHeoF6gZUQuMnNjU4DpeuJdu7hznDNTy

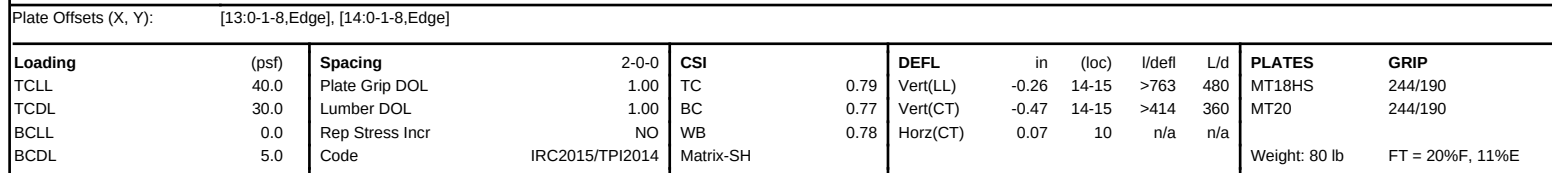

NOTES	
1)	Unbalanced floor live loads have been considered for this design.
2)	All plates are MT20 plates unless otherwise indicated.
3)	This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
4)	Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL 2ND FLR
72436981	F205	Truss	10	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:46

Page: 1

ID:z4viZKaDoV0_zU_D54TiW_yE?RI-SSuUE854YLMHeoF6qZUQuMnNxnUQDoOuJduj7nzdNTy

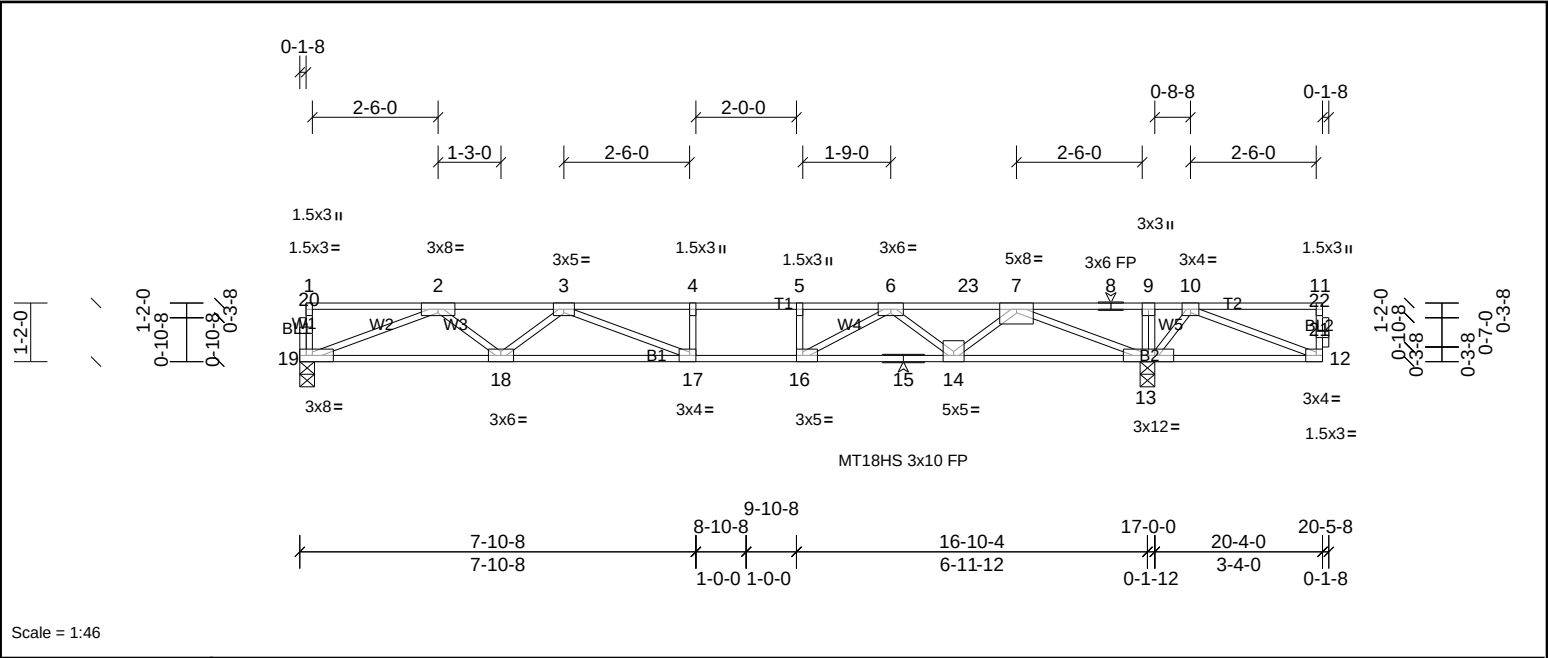


Plate Offsets (X, Y):		[16:0-1-8,Edge], [17:0-1-8,Edge]										
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.78	Vert(LL)	-0.27	17-18	>741	480	MT18HS	244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.81	Vert(CT)	-0.49	17-18	>405	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.86	Horz(CT)	0.07	13	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 100 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP SS(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-6-15 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.3(flat)		6-0-0 oc bracing: 12-13.
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	13=2074/0-3-8, (min. 0-1-8), 19=1191/0-3-8, (min. 0-1-8)
	Max Grav	13=2074 (LC 1), 19=1219 (LC 3)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-3470/0, 3-4=-4759/0, 4-5=-4759/0, 5-6=-4759/0, 6-23=-3174/0, 7-23=-3174/0, 7-8=0/998, 8-9=0/998, 9-10=0/992
BOT CHORD	18-19=0/2664, 17-18=0/4205, 16-17=0/4759, 15-16=0/4003, 14-15=0/4003, 13-14=0/2339, 12-13=-477/0
WEBS	4-17=-278/0, 5-16=-435/0, 9-13=-324/0, 2-19=-2856/0, 2-18=0/1049, 3-18=-957/0, 3-17=0/895, 7-13=-3141/0, 7-14=0/1126, 6-14=-1129/0, 6-16=0/1224, 10-12=0/515, 10-13=-797/0

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 12-19=-10, 1-23=-140, 11-23=-176



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL 2ND FLR
72436981	F206	Truss	6	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:46

Page: 1

ID:w?5J7e0oKZYtI0k8Ce68zayE?Qk-xeSsRU6JJeU7FyqlOG?fRZKZaAqJyFK2YHeGgDzdNTx

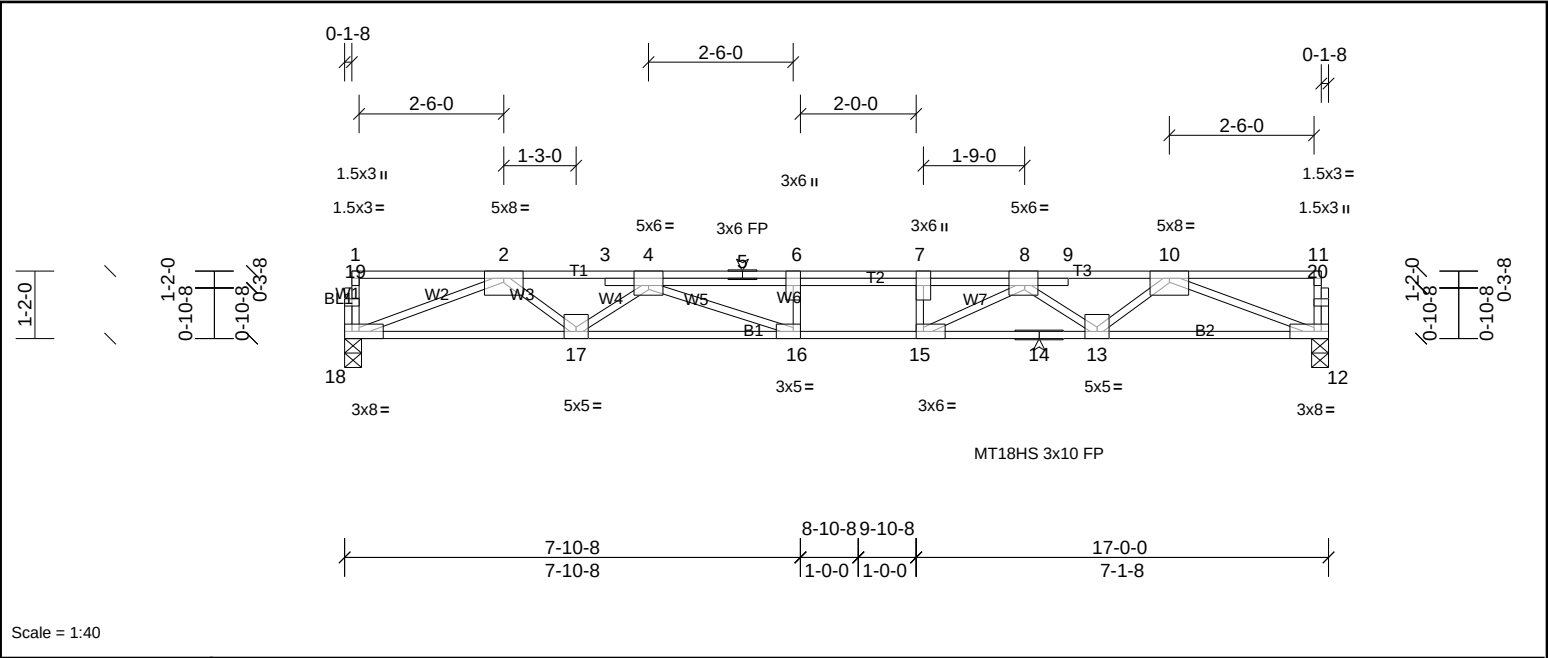


Plate Offsets (X, Y): [4:0-3-0,Edge], [7:0-3-0,Edge], [8:0-2-12,Edge], [15:0-1-8,Edge], [16:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.72	Vert(LL)	-0.22	16-17	>934	480	MT18HS 244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.77	Vert(CT)	-0.46	16-17	>435	360	MT20 244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.88	Horz(CT)	0.09	12	n/a	n/a	
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 93 lb FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-8-5 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	12=1330/0-3-8, (min. 0-1-8), 18=1360/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-4028/0, 3-4=-4035/0, 4-5=-5943/0, 5-6=-5943/0, 6-7=-5943/0, 7-8=-5943/0, 8-9=-3887/0, 9-10=-3884/0	
BOT CHORD	17-18=0/2993, 16-17=0/5068, 15-16=0/5943, 14-15=0/4871, 13-14=0/4871, 12-13=0/2923	
WEBS	6-16=-395/0, 7-15=-621/0, 2-18=-3210/0, 2-17=0/1347, 4-17=-1321/0, 4-16=0/1206, 10-12=-3135/0, 10-13=0/1251, 8-13=-1254/0, 8-15=0/1464	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 12-18=-10, 1-3=-140, 3-7=-176, 7-11=-140



Job 72436981	Truss F207	Truss Type Truss	Qty 4	Ply 1	MUNGO HOMES-RUSSELL 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	---

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:46

Page: 1

ID:DdXO9rlsgxZTAiZlcgYnyeyE?QM-xeSsRU6iJeU7FyqlOG?fRZKX5ArSyFW2YHeGgDzdNTx

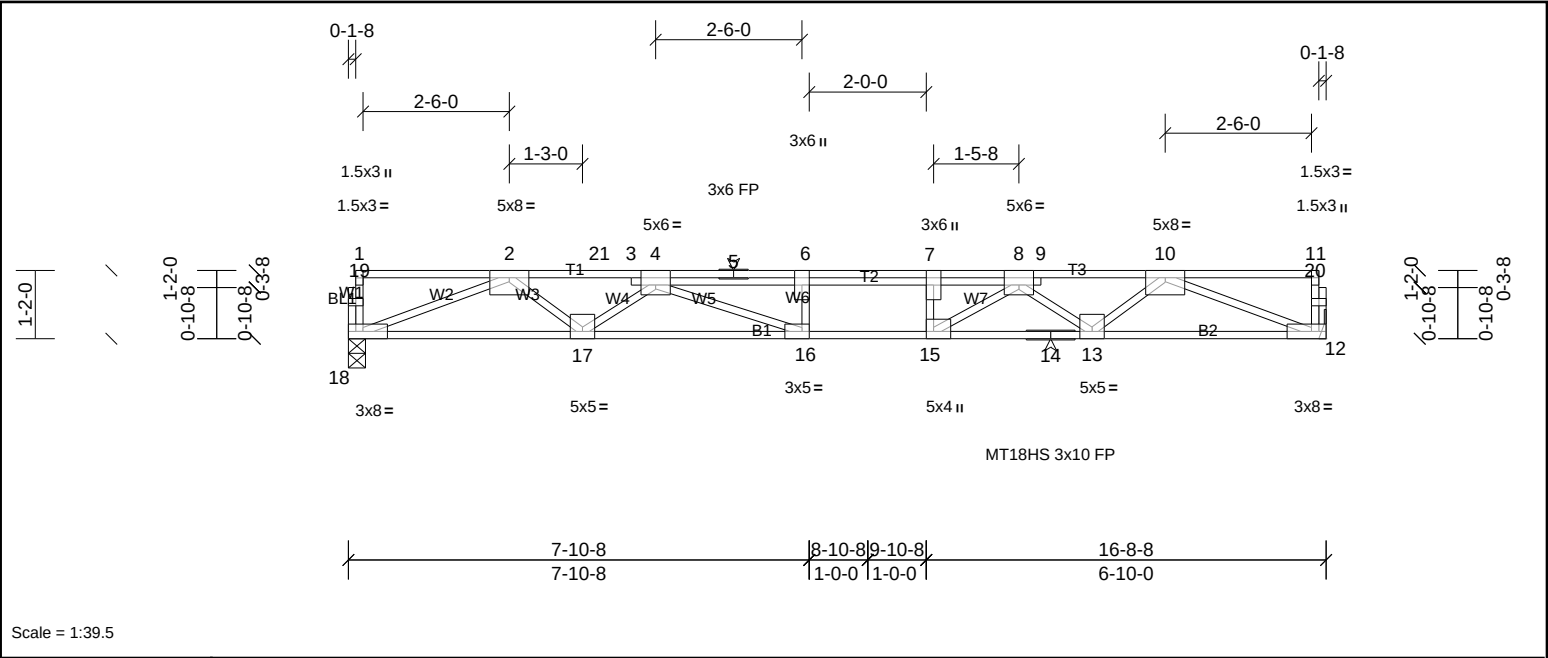


Plate Offsets (X, Y): [4:0-3-0,Edge], [7:0-3-0,Edge], [8:0-3-0,Edge], [15:0-1-8,Edge], [16:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.88	Vert(LL)	-0.21	16-17	>946	480	MT18HS	244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.76	Vert(CT)	-0.45	16-17	>437	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.87	Horz(CT)	0.08	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 90 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-11-2 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS (lb/size) 12=1312/ Mechanical, (min. 0-1-8), 18=1342/0-3-8, (min. 0-1-8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-21=-3947/0, 3-21=-3947/0, 3-4=-3940/0, 4-5=-5760/0, 5-6=-5760/0, 6-7=-5760/0, 7-8=-5760/0, 8-9=-3778/0, 9-10=-3800/0

BOT CHORD 17-18=0/2953, 16-17=0/4941, 15-16=0/5760, 14-15=0/4748, 13-14=0/4748, 12-13=0/2882

WEBS 6-16=-374/0, 7-15=-697/0, 2-18=-3167/0, 2-17=0/1293, 4-17=-1263/0, 4-16=0/1134, 10-12=-3091/0, 10-13=0/1195, 8-13=-1204/0, 8-15=0/1432

- NOTES
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard


1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (lb/ft)

Vert: 12-18=-10, 1-21=-140, 7-21=-176, 7-11=-140



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:46 Page: 1
ID:9wPDsvsVaW4cYkLCLVRSonyE_LD-xeSsRU6iJeU7FyqIQOG?RZKWgArKyFi2YHeGgDzdNTX



Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.91	Vert(LL)	-0.26	15-17	>764	480	MT18HS	244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.77	Vert(CT)	-0.45	15-17	>435	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.84	Horz(CT)	0.08	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 89 lb	FT = 20%F, 11%E

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 4-10-5 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

FORCES		(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-3825/0, 3-4=-3798/0, 4-5=-5674/0, 5-6=-5674/0, 6-7=-5674/0, 7-8=-3718/0, 8-9=-3749/0, 9-10=-3749/0	
BOT CHORD	17-18=0/2873, 16-17=0/4772, 15-16=0/4772, 14-15=0/5674, 13-14=0/4681, 12-13=0/2851	
WEBS	5-15=-353/0, 6-14=-803/0, 10-12=-3058/0, 10-13=0/1169, 7-13=-1184/0, 7-14=0/1564, 2-18=-3081/0, 2-17=0/1239, 4-17=-1203/0, 4-15=0/1071	

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 5) Use Simpson Strong-Tie TH4A22 (6-16d Girder, 6-10d Truss) or equivalent at 7-8-12 from the left end to connect truss(es) to front face of top chord.
- 6) Fill all nail holes where hanger is in contact with lumber.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (lb/ft)
Vert: 12-18=-10, 1-11=-140
Concentrated Loads (lb)
Vert: 5=-176 (F)



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL 2ND FLR
72436981	FG3	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:47

Page: 1

ID:2YMeRnnRhJzYswzaSXeE7TyE?l?-Pr?Efq7K4yc_t6Pvy_WuznsvjaJNhugBnxNpCfzdNTw

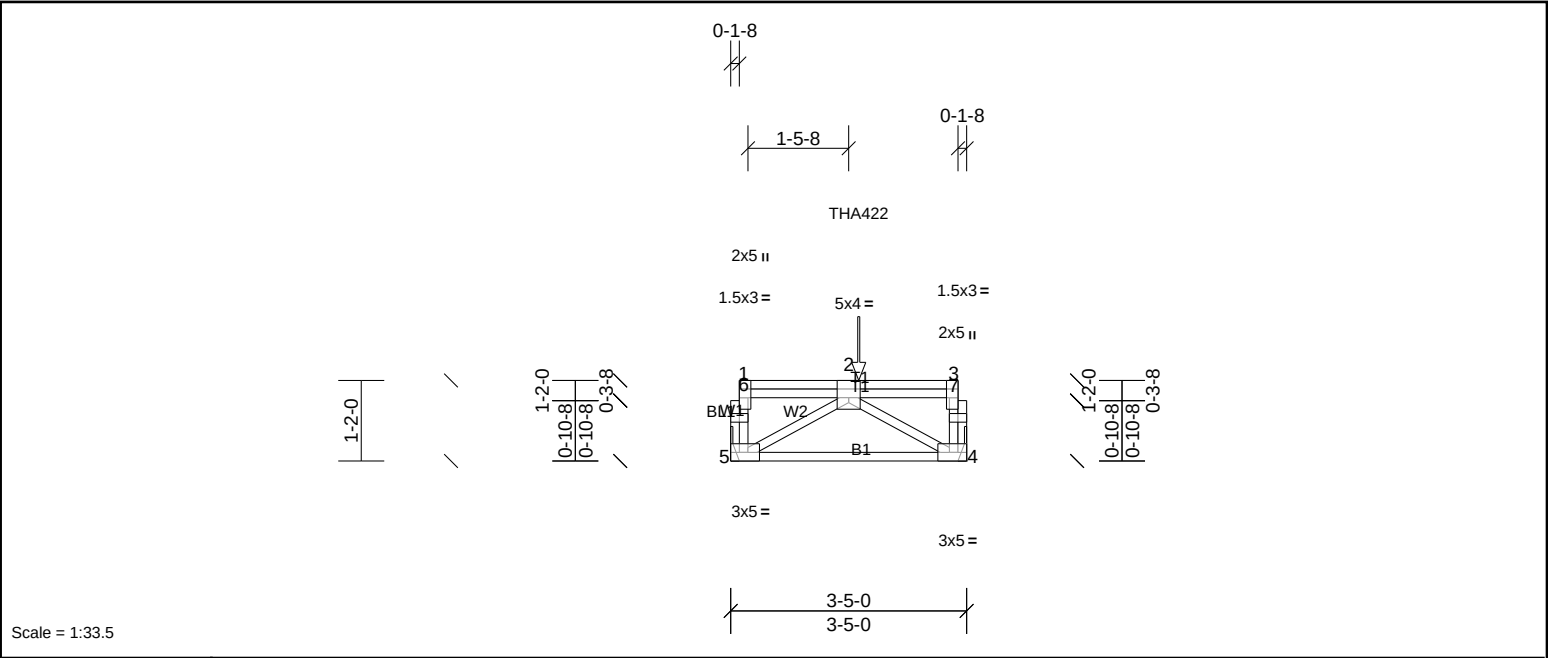


Plate Offsets (X, Y): [2:0-2-0,Edge], [3:0-3-0,Edge], [4:0-2-0,Edge], [5:0-2-0,Edge]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.20	Vert(CT)	-0.02	4-5	>999	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.10	Horz(CT)	0.00	4	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-P							Weight: 24 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 3-5-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		
REACTIONS (lb/size) 4=316/ Mechanical, (min. 0-1-8), 5=316/ Mechanical, (min. 0-1-8)			
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.			
BOT CHORD	4-5=0/376		
WEBS	2-4=-437/0, 2-5=-437/0		

- NOTES**
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent at 1-10-4 from the left end to connect truss(es) to front face of top chord.
 - Fill all nail holes where hanger is in contact with lumber.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (lb/ft)
Vert: 4-5=-10, 1-3=-100
Concentrated Loads (lb)
Vert: 2=-297 (F)



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL 2ND FLR
72436981	FG5	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:47

Page: 1

ID:5QsKfPUOdLX8ZxMONo8?X_yE?DD-Pr?Efq7K4yc_t6PVy_WuznsgGaBuhi_BnxNpCfzdNTw

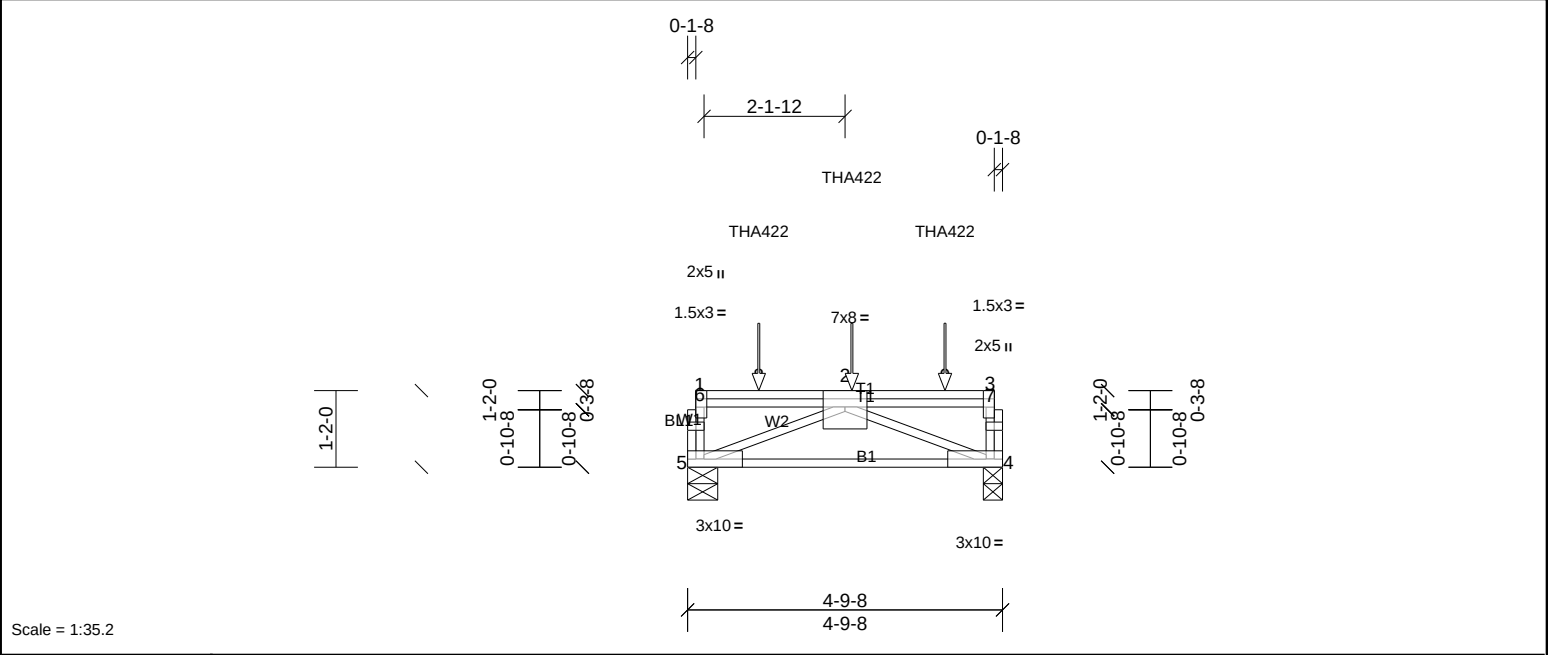


Plate Offsets (X, Y):													[3:0-3-0,Edge]							
Loading		(psf)	Spacing		2-0-0		CSI		DEFL		in	(loc)	l/defl	L/d	PLATES		GRIP			
TCLL		40.0	Plate Grip DOL		1.00		TC		0.98		Vert(LL)	n/a	-	n/a	999	MT20		244/190		
TCDL		30.0	Lumber DOL		1.00		BC		0.75		Vert(CT)	-0.06	4-5	>897	360					
BCLL		0.0	Rep Stress Incr		NO		WB		0.85		Horz(CT)	0.02	4	n/a	n/a					
BCDL		5.0	Code		IRC2015/TPI2014		Matrix-P										Weight: 32 lb		FT = 20%F, 11%E	

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-9-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	4=2163/0-3-8, (min. 0-1-8), 5=2045/0-5-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	5-6=-706/0, 1-6=-704/0, 4-7=-827/0, 3-7=-825/0	
BOT CHORD	4-5=0/3103	
WEBS	2-5=-3330/0, 2-4=-3321/0	

- NOTES**
- 1) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 2) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 3) Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 1-5-0 oc max. starting at 1-1-0 from the left end to 3-11-0 to connect truss(es) to back face of top chord.
 - 4) Fill all nail holes where hanger is in contact with lumber.
 - 5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 4-5=-10, 1-3=-140
	Concentrated Loads (lb)
	Vert: 2=-1172 (B), 8=-1179 (B), 9=-1194 (B)



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL 2ND FLR
72436981	FG6	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:47

Page: 1

ID:6kHpOvkk48bceYi?wZjoaTyE_lo-Pr?Efq7K4yc_t6PVy_WuznsqBaKXhrGBnxNpCfzdNTw

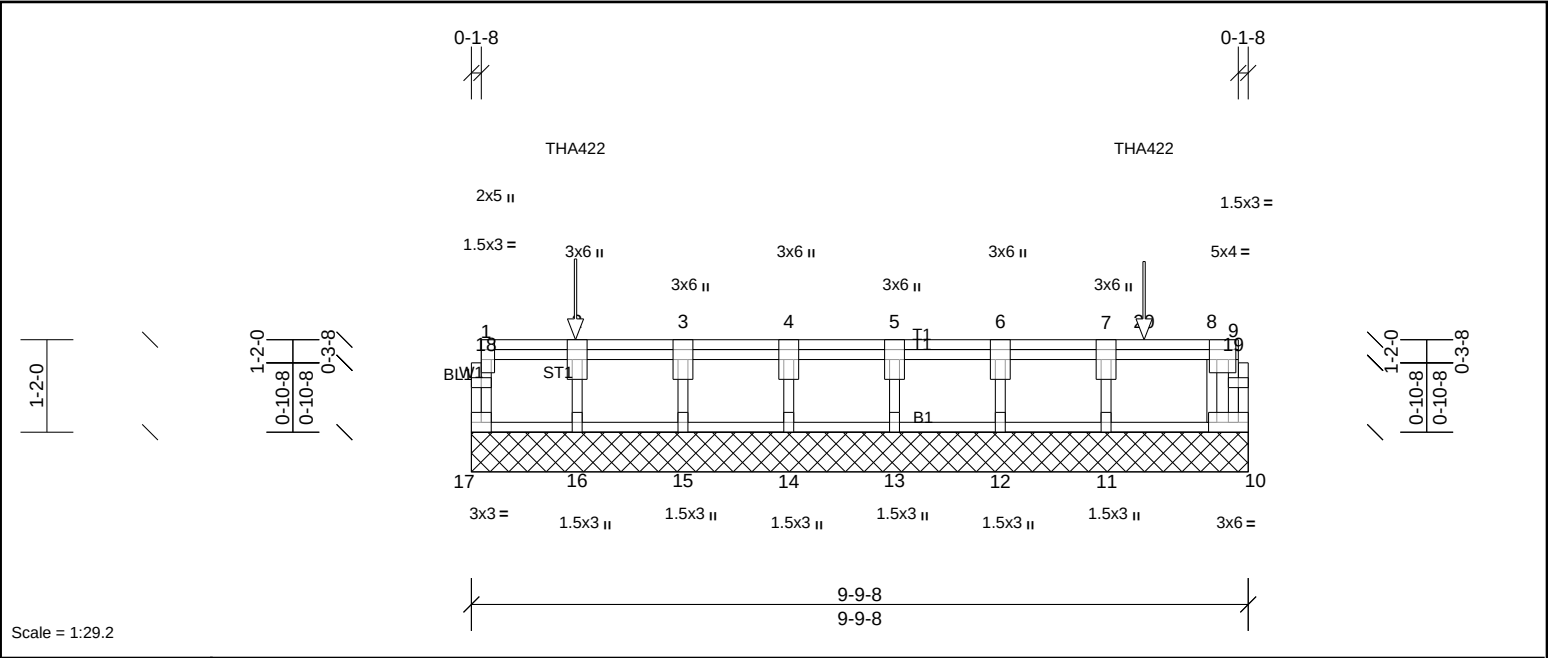


Plate Offsets (X, Y):		[9:0-2-0,Edge]										
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.34	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.13	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	NO	WB	0.26	Horiz(TL)	0.00	10	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 56 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS		All bearings 9-9-8.
(lb) - Max Grav		All reactions 250 (lb) or less at joint(s) 12, 13, 14, 15, 17 except 10=274 (LC 1), 11=751 (LC 1), 16=1127 (LC 1)
FORCES		(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS		2-16=-1134/0, 7-11=-723/0, 8-10=-313/0

- NOTES**
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 7-2-0 oc max. starting at 1-3-12 from the left end to 8-5-12 to connect truss(es) to back face of top chord.
 - Fill all nail holes where hanger is in contact with lumber.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).


LOAD CASE(S)		Standard
1)		Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
		Uniform Loads (lb/ft)
		Vert: 10-17=-10, 1-9=-100
		Concentrated Loads (lb)
		Vert: 2=-1079 (B), 20=-690 (B)



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL 2ND FLR
72436981	K200	Truss	1	1	Job Reference (optional)

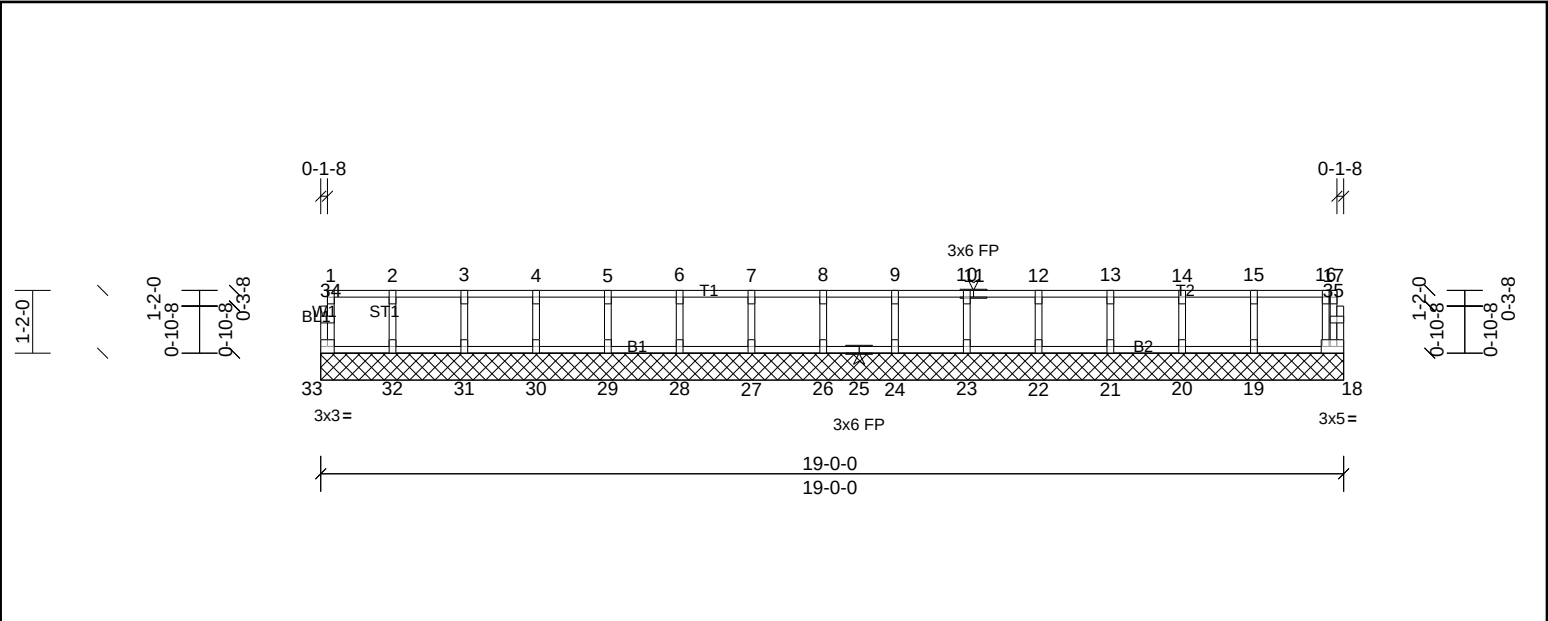

Loading	(psf)	Spacing	2'-0"-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	18	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 80 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6'-0"-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10'-0"-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	All bearings 19'-0"-0.
(lb) - Max Grav	All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23, 24, 26, 27, 28, 29, 30, 31, 32, 33

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
---------------	--

- NOTES**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1'-4"-0 oc.
 - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10'-0"-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL 2ND FLR
72436981	K203	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Mar 07 08:47:48

Page: 1

ID:hOGwAMxz?qlKXdCc985uVDyE?XH-t1ZcsA7zrGkrVG_hWh17W_P23_hYQM2L?b7Nk6zdNTv

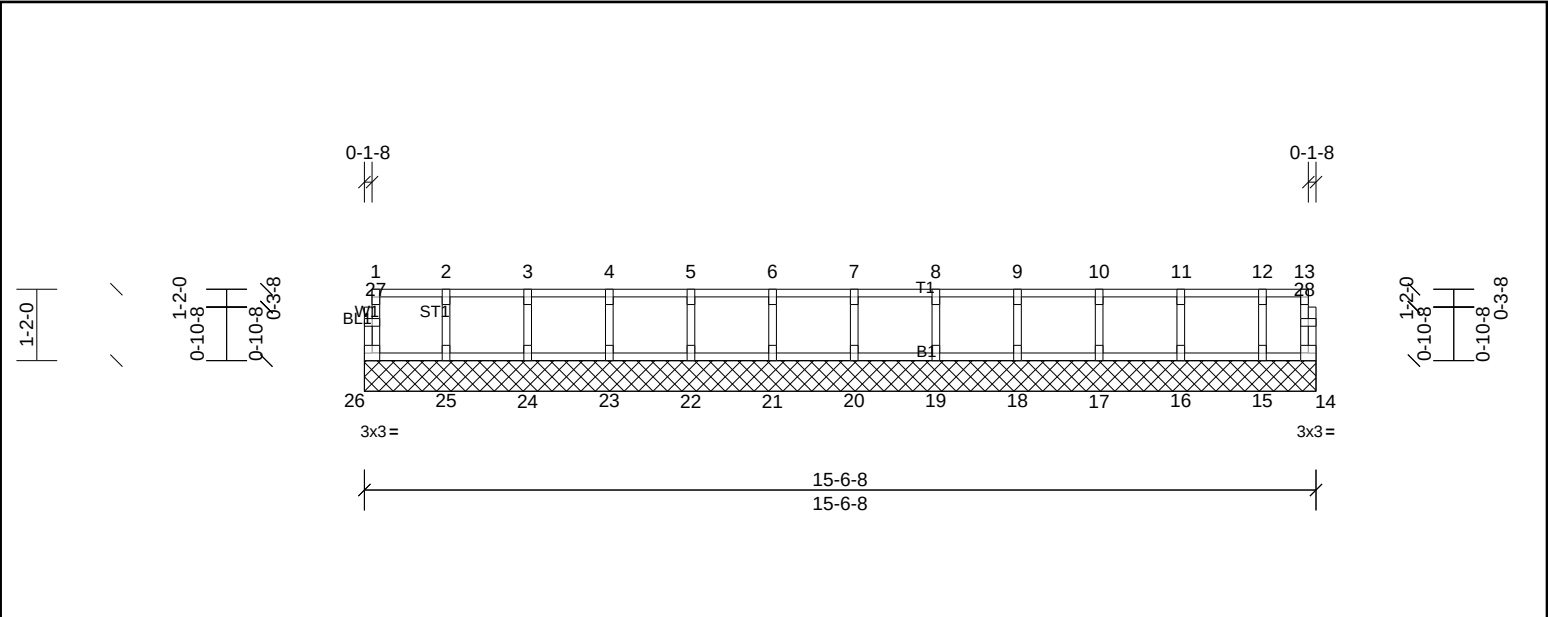

Scale = 1:37.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	14	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 66 lb	FT = 20%F, 11%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS All bearings 15-6-8.
(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

