

Harnett County Department of Public Health

PERMIT # SFD 2504-0019

Operation Permit

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ Expansion

PROPERTY LOCATION: 158 Alice Trace, Angier

Name: (owner) Clayton Properties Group SUBDIVISION Langdon Preserve LOT # 29

System Installer: David Brantley

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 3


Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feet

System Type: 25' Reduction Type III(b) Jet Chambers Types V and VI Systems expire in 5 years.

(In accordance with Table V a) manifold Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

**Needs Pump + Alarm For Final*

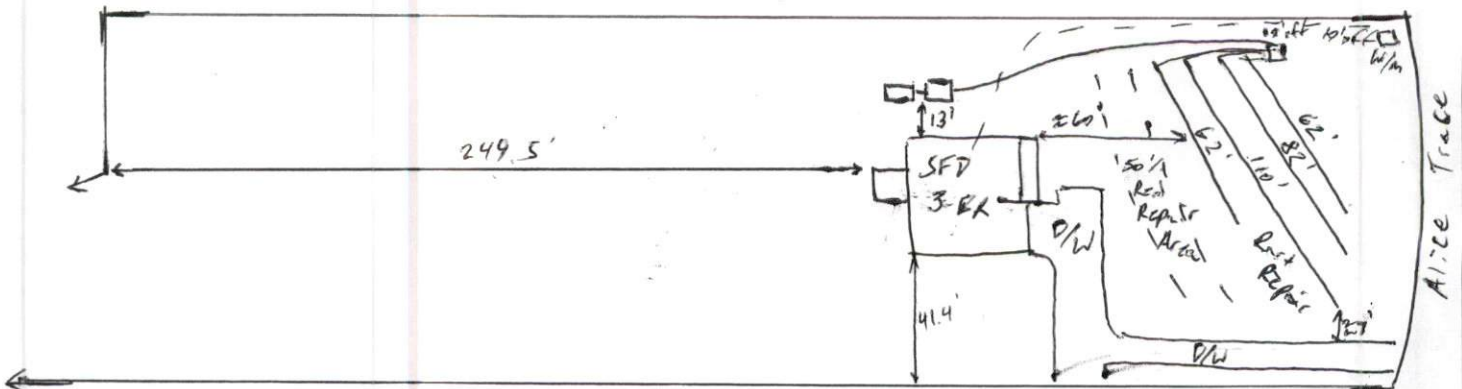

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes ☐ No ☐
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: _____
- V. Other: _____

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other Type III(b) Jet Chambers Septic Tank: 1,000 gallons Pump Tank: 1,000 gallons
Subsurface No. of 4 exact length 62' width of 3' depth of 22"
Drainage Field ditches 4 of each ditch 110' ditches 3' ditches 22" inches
French Drain Required: _____ Linear feet 62'

Authorized State Agent REHS

Date 9-11-25