

RE: 2508-3320-A - Blake Pond Lot 00.0125 OWF Repair

Trenco  
818 Soundside Rd  
Edenton, NC 27932

**Site Information:**

Project Customer: DRB Raleigh Project Name: Blake Pond Lot 00.0125

Lot/Block: Subdivision: Blake Pond

Model:

Address: 125 Celtic Lane

City: Lillington State: NC

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2021/TPI2014

Wind Code: ASCE 7-16

Wind Speed: 115 mph

Roof Load: 40.0 psf

Mean Roof Height (feet): 25

Design Program: MiTek 20/20 25.2

Design Method: MWFRS (Envelope)/C-C hybrid Wind ASCE 7-16

Floor Load: N/A psf

Exposure Category: B

No.	Seal#	Truss Name	Date
1	I75478823	1FGE1	8/7/25

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Structural, LLC.

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2025.

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



Job	Truss	Truss Type	Qty	Ply	Blake Pond Lot 00.0125 OWF Repair
2508-3320-A	1FGE1	Floor Supported Gable	1	1	175478823
Job Reference (optional)					


Structural, LLC, Thurmont, MD - 21788,

Run: 25.20 E May 29 2025 Print: 25.20 E May 29 2025 MiTek Industries, Inc. Thu Aug 07 12:08:10

Page: 1

ID: IABkdbUF1qHwDbD596NNV6z5KMVW-ZlbS6tIC21O5GX3UHien5YusTHkseTVyuEPRMCyqF04

REPAIR:  
MODIFY BEARING CONDITION AS SHOWN

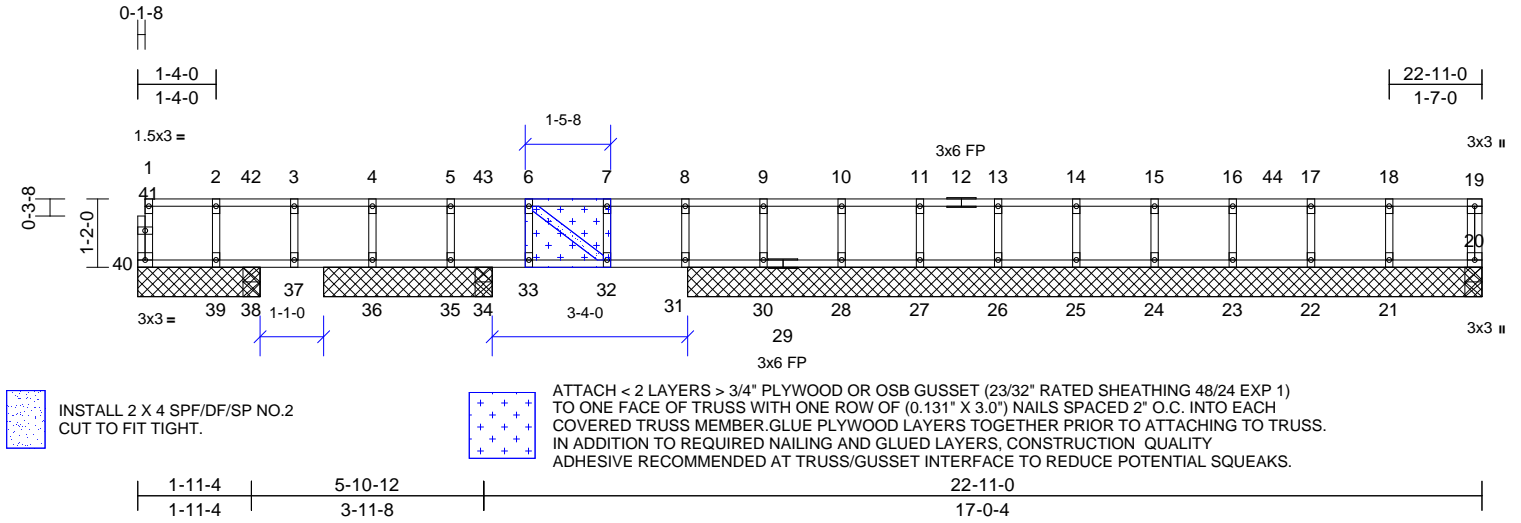

Loading (psf)		Spacing		CSI		DEFL		PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.35	Vert(LL)	-0.03 32-33 >999 480	MT20		244/190	
TCDL	10.0	Lumber DOL	1.00	BC	0.41	Vert(CT)	-0.04 32-33 >999 360				
BCLL	0.0	Rep Stress Incr	NO	WB	0.05	Horz(CT)	0.00 20 n/a n/a				
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-R							
								Weight: 95 lb	FT = 20%F, 12%E		

**LUMBER**  
TOP CHORD 2x4 SP No.2(flat)  
BOT CHORD 2x4 SP No.2(flat)  
WEBS 2x4 SP No.3(flat)  
OTHERS 2x4 SP No.3(flat)

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


**REACTIONS** (lb/size) 20=65/13-6-8, 21=105/13-6-8, 22=237/13-6-8, 23=234/13-6-8, 24=93/13-6-8, 25=123/13-6-8, 26=117/13-6-8, 27=112/13-6-8, 28=137/13-6-8, 30=41/13-6-8, 31=273/13-6-8, 34=268/0-3-8, 35=23/2-10-8, 36=168/2-10-8, 38=114/0-3-8, 39=78/2-1-0, 40=46/2-1-0  
Max Uplift 35=52 (LC 6)  
Max Grav 20=65 (LC 7), 21=109 (LC 6), 22=238 (LC 7), 23=234 (LC 6), 24=93 (LC 7), 25=123 (LC 6), 26=117 (LC 7), 27=112 (LC 6), 28=137 (LC 7), 30=42 (LC 6), 31=273 (LC 7), 34=268 (LC 1), 35=47 (LC 5), 36=173 (LC 5), 38=119 (LC 6), 39=86 (LC 7), 40=50 (LC 7)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 40-41=-42/2, 1-41=-41/3, 19-20=-61/0, 1-2=-12/0, 2-42=-12/0, 3-42=-12/0, 3-4=-12/0, 4-5=-12/0, 5-43=-12/0, 6-43=-12/0, 6-7=-12/0, 7-8=-12/0, 8-9=-12/0, 9-10=-12/0, 10-11=-12/0, 11-12=-12/0, 12-13=-12/0, 13-14=-12/0, 14-15=-12/0, 15-16=-12/0, 16-44=-12/0, 17-44=-12/0, 17-18=-12/0, 18-19=-12/0

**BOT CHORD** 39-40=0/12, 38-39=0/12, 37-38=0/12, 36-37=0/12, 35-36=0/12, 34-35=0/12, 33-34=0/12, 32-33=0/12, 31-32=0/12, 30-31=0/12, 29-30=0/12, 28-29=0/12, 27-28=0/12, 26-27=0/12, 25-26=0/12, 24-25=0/12, 23-24=0/12, 22-23=0/12, 21-22=0/12, 20-21=0/12  
**WEBS** 2-39=-124/0, 3-37=-86/0, 4-36=-125/0, 5-35=-132/0, 6-33=-117/0, 7-32=-35/0, 8-31=-188/0, 9-30=-69/0, 10-28=-117/0, 11-27=-104/0, 13-26=-106/0, 14-25=-113/0, 15-24=-82/0, 16-23=-223/0, 17-22=-228/0, 18-21=-93/0

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - All plates are 1.5x3 (||) MT20 unless otherwise indicated.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - N/A
  - Load case(s) 1, 2, 4, 6, 7, 9, 11, 12 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
- LOAD CASE(S)** Standard
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 20-40=-8, 1-19=-80

- Concentrated Loads (lb)  
Vert: 44=-200
- Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 20-40=-8, 1-19=-80
  - Concentrated Loads (lb)  
Vert: 44=-200
  - 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 20-40=-8, 1-2=-80, 2-42=-16, 5-42=-80, 5-43=-16, 19-43=-80
  - Concentrated Loads (lb)  
Vert: 44=-200
  - 4th Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 20-40=-8, 1-2=-16, 2-5=-80, 5-43=-16, 19-43=-80
  - Concentrated Loads (lb)  
Vert: 44=-200
  - 5th Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)

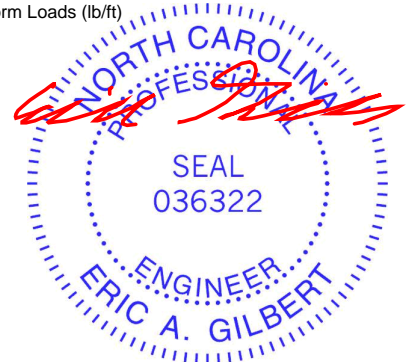

August 7, 2025

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Blake Pond Lot 00.0125 OWF Repair
2508-3320-A	1FGE1	Floor Supported Gable	1	1	I75478823
					Job Reference (optional)

Structural, LLC, Thurmont, MD - 21788,

Run: 25.20 E May 29 2025 Print: 25.2.0 E May 29 2025 MiTek Industries, Inc. Thu Aug 07 12:08:10  
ID:IAbkdbUf1qHWdbD596NNV6z5KMW-ZlbS6tIC21O5GX3UHien5YusTHkseTVyuEPRMCyqF04

Page: 2

- Vert: 20-40=-8, 1-42=-80, 5-42=-16, 5-19=-80  
Concentrated Loads (lb)  
Vert: 44=-200
- 9) 7th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 20-40=-8, 1-2=-80, 2-42=-16, 5-42=-80, 5-43=-16, 19-43=-80  
Concentrated Loads (lb)  
Vert: 44=-200
- 11) 9th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 20-40=-8, 1-2=-16, 2-5=-80, 5-43=-16, 19-43=-80  
Concentrated Loads (lb)  
Vert: 44=-200
- 12) 10th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (lb/ft)  
Vert: 20-40=-8, 1-42=-80, 5-42=-16, 5-19=-80  
Concentrated Loads (lb)  
Vert: 44=-200




August 7, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate  
818 Soundside Road  
Edenton, NC 27932

# Symbols

## PLATE LOCATION AND ORIENTATION



\* Plate location details available in MITek software or upon request.

## PLATE SIZE

**4 X 4**

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

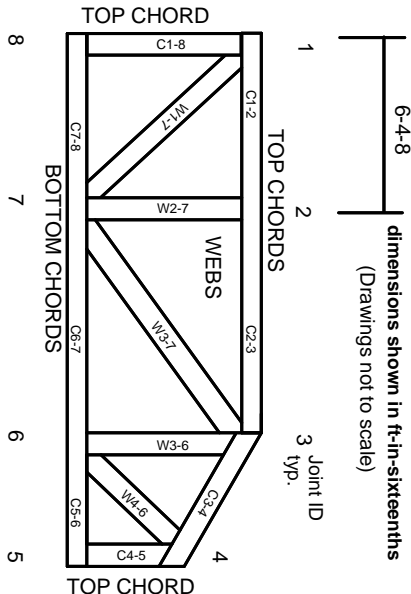

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

# General Safety Notes

**Failure to Follow Could Cause Property Damage or Personal Injury**

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

**MITek**

ENGINEERING BY  
**TRENCO**  
A MITek Affiliate

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023