
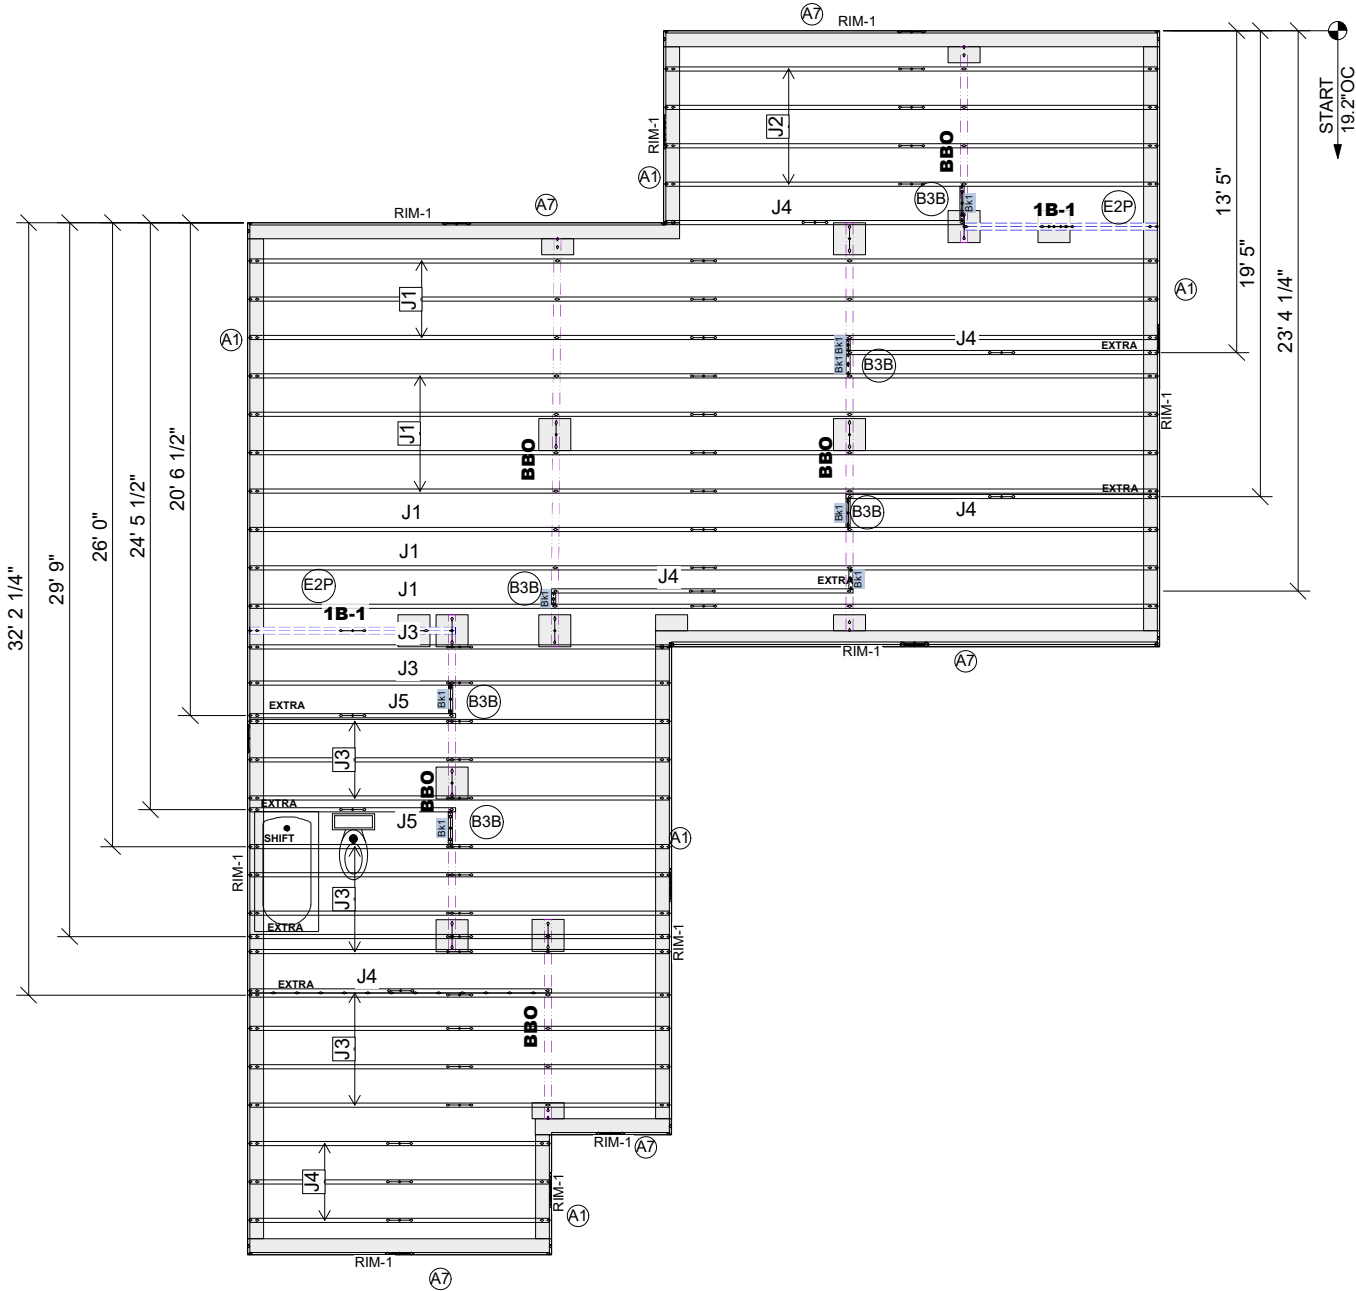


THIS IS AN ENGINEERED WOOD PRODUCT (EWP) MEMBER PLACEMENT DIAGRAM ONLY; NOT AN ENGINEERED DOCUMENT. EWP members are designed as individual building components to be incorporated into the building design at the specification of the building designer. The Contractor is responsible for the temporary bracing of the floor system, and the building designer is responsible for the permanent bracing and blocking of the floor system and the overall structure. The design of the support structure including but not limited to headers, beams, walls, and columns is also the responsibility of the building designer. It is the responsibility of the General Contractor to verify that the provided layout matches the final intended construction plans, loading conditions, and use. If they do not, it is the responsibility of the General Contractor to notify UFP and provide plans containing the latest specifications and designs. UFP will not be responsible for plan changes by others after final approval of shop drawings, or for errors or modifications made on-site during construction. DO NOT CUT, NOTCH, DRILL, OR OTHERWISE "REPAIR" EWP MEMBERS IN ANY WAY WITHOUT PRIOR WRITTEN AUTHORIZATION BY A LICENSED PROFESSIONAL DESIGNATED BY UFP. The Framer is responsible to verify all dimensions, including adjusting member spacing within tolerances to allow for the drop and rise of plumbing/HVAC, unless noted otherwise. All connectors on this project are to be installed per the connector manufacturer's specifications. All connectors shown that are not joist to joist are suggestions only and are to be verified by the Building Designer or Engineer of Record for suitability to this particular project. UFP accepts no responsibility for the specific application or suitability of any connector that is not joist to joist as they apply to this specific structure.

FLOOR PLACEMENT PLAN

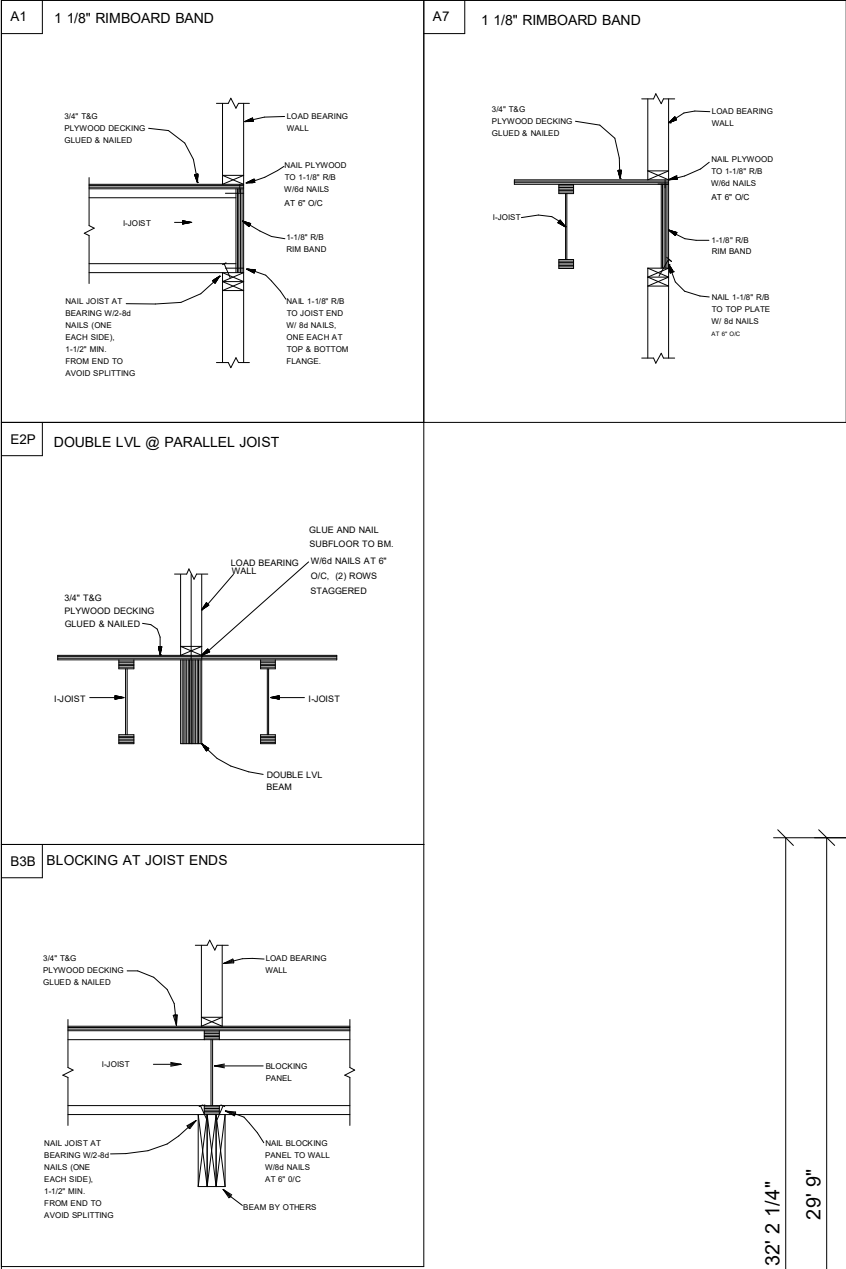

● Avoid Plumbing Drops

**FIELD LOCATE
PLUMBING DROPS/CAN
LIGHTS, ETC... PRIOR
TO JOIST
SECUREMENT TO
AVOID INTERFERENCE.**

LAYOUT FOR 19.2" O/C

1= 19-3/16"	9= 172-13/16"
2= 38-3/8"	10= 192"
3=57-5/8"	11= 211-3/16"
4= 76-13/16"	12= 230-3/8"
5= 96"	13= 249-13/16"
6= 115-3/16"	14= 268-13/16"
7= 134-3/8"	15= 288"
8= 153-5/8"	

- GENERAL NOTES:**
- 1.) TOP CHORD OF JOISTS ARE PAINTED RED AT NUMBERED END. PLACE PAINTED END AS NOTED ON PLAN.
 - 2.) FOLLOW SPECIAL SPACING AND LOCATION DIMENSIONS FOR EXTRAS OR SHIFTED JOISTS AS SHOWN ON PLAN.
 - 3.) ALL INTERIOR WALL PLATES MUST BE LEVEL WITH OUTSIDE WALL TOP PLATES.
 - 4.) DO NOT STACK CONSTRUCTION LOADS ON UN-BRACED JOISTS.
 - 5.) PROVIDE SOLID SUPPORT BELOW ALL BEAM AND HEADER BEARING POINTS IN WALL AND JOIST SPACES CONTINUOUS DOWN TO THE FOUNDATION.
 - 6.) LOCATE CRIPPLE STUDS IN JOIST SPACE DIRECTLY BELOW HEADER JACKS AT ALL FIRST FLOOR EXTERIOR DOOR LOCATIONS.
 - 7.) INSTALL NAILS IN ALL HOLES PROVIDED IN JOIST HANGERS EXCEPT AT BOTTOM CHORD SEAT. PLACE A DAB OF GLUE IN THE HANGER SEAT BEFORE SETTING JOISTS.
 - 8.) IMPORTANT NOTE! NO STRUCTURAL ANALYSIS OF CONVENTIONAL HEADERS HAS BEEN CONDUCTED IF NOT NOTED. THEY ARE CONSIDERED TO BE ADEQUATE TO SUPPORT THE APPLIED LOADS.

PLAN LEGEND	
1B-, 2B-	"INDICATES BEAM ABOVE TOP PLATE (FLUSH WITH FLOOR SYSTEM)
H-, 1H-, GDH-	INDICATES BEAM BELOW TOP PLATE (DROPPED BELOW FLOOR SYSTEM)
	"BEAMS MAY PROTRUDE ABOVE OR BELOW DECKING OR TOP PLATE RESPECTIVELY. REFER TO DETAIL IF BEAM IS A DIFFERENT DEPTH THAN FLOOR SYSTEM"
	SINGLE PLY BEAM (ADD LINE FOR EACH ADDITIONAL PLY)
SHIFT	SHIFT JOIST TO MISS PLUMBING, ALIGN WITH WALL OR SUPPORT FURNITURE
EXTRA	A JOIST ADDED TO THE LAYOUT IN ADDITION TO THE ON CENTER JOISTS
DOUBLE	TWO JOISTS SIDE BY SIDE (ONLY ASSEMBLED IF NOTED)
ALL DIMENSIONS TO CENTERLINE UNLESS OTHERWISE NOTED	

- FRAMER NOTE**
1. GLUE AND NAIL PLYWOOD SUBFLOOR TO BEAMS AND GIRDERS AT 6" O/C WHERE NO WALL IS ABOVE.
 2. FILL HANGER SEAT WITH GLUE BEFORE SETTING JOIST IN HANGER. FILL ROUND HOLES WITH NAILS.

CRITICAL !!

INSTALL 2X4 SQUASH BLOCKS IN FLOOR TRUSS SPACE BELOW ALL EXTERIOR DOOR HEADER JACKS. CUT 1/16" TALLER THAN TRUSS.

**FIELD VERIFY DIMENSIONS TO
JOISTS LOCATED UNDER WALLS!!**

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	38' 0"	11 7/8" TJI@ 210	1	10	MFD
J2	21' 0"	11 7/8" TJI@ 210	1	4	MFD
J3	18' 0"	11 7/8" TJI@ 210	1	14	MFD
J4	13' 0"	11 7/8" TJI@ 210	1	8	MFD
J5	9' 0"	11 7/8" TJI@ 210	1	2	MFD
1B-1	9' 0"	1 3/4" x 11 7/8" 2.0E Microllam® LVL	2	4	MFD
RIM-1	16' 0"	1 1/8" x 11 7/8" TJ@ Rim Board	1	13	FF
Bk1	2' 0"	11 7/8" TJI@ 210	1	8	MFD

UFP SITE BUILT

A UFP INDUSTRIES COMPANY

Burlington, NC

Chesapeake, VA

Clinton, NC

Conway, SC

Jefferson, GA

Stanfield, NC

Locust, NC

Liberty, NC

Ooltewah, TN

Pearisburg, VA

Stanfield, NC

Customer Service (800) 476-9356



This drawing is property of UFP Site Built, LLC. Any unauthorized use of this document without written permission is prohibited. UFP relinquishes ownership of delivered product upon delivery. Owner of product must obtain UFP's authorization prior to any alteration or modification of product. UFP will not be held responsible for any unauthorized modifications done or costs incurred without prior written authorization from UFP.

PBS NEW HOMES

DUNCANS CREEK 126

SELMA

275 DUNCANS CREEK
LILLINGTON, NC, 27546

REVISIONS		DSN
DATE	DESCRIPTION	

DESIGNER DV
LAYOUT DATE 04/15/2025
ARCH DATE -
STRUC DATE -
JOB #: 25032385F1

SCALE: 1/8"=1'

PLACEMENT PLAN



FLUSH LVL BEAM LIST						
Fab Type	Net Qty	Plies	Product	Length	PlotID	
MFD	3	3	1 3/4" x 14" 2.0E Microllam® LVL	14' 0"	2B-1	
MFD	2	2	1 3/4" x 14" 2.0E Microllam® LVL	12' 0"	2B-2	

DESIGNER: AM					
LAYOUT DATE: 4-8-25					
ARCH DATE -					
STRUC DATE -					
JOB #:					
2500298572					

NEW HOMES

LOT 126 DUNCAN'S CREEK


This drawing is property of UFP Site Built, LLC. Any unauthorized use of this document without written permission is prohibited. UFP relinquishes ownership of delivered product upon delivery. Owner of product must obtain UFP's authorization prior to any alteration or modification of product; UFP will not be held responsible for any unauthorized modifications done or costs incurred without prior written authorization from UFP.



UFP SITE BUILT
A UFP INDUSTRIES COMPANY

Burlington, NC Locust, NC
Chesapeake, VA Liberty, NC
Clinton, NC Ooltewah, TN
Conway, SC Pearisburg, VA
Jefferson, GA Stanfield, NC

Customer Service (800) 476-9356



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:08 Page: 1
ID:5vNTJP5Gwa4?a3RdtUeGwyibUp-ZZvuAsWabdXZH7GjXoIAEwKyH_Um1I4uZDd1M6zRtlb


[illegible]

REACTIONS	(lb/size)	5=387/ Mechanical, 8=387/0-3-8, (min. 0-1-8)
------------------	-----------	--

NOTES _____

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH 2ND FL
72509817	2F1	Truss	12	1	Job Reference (optional)

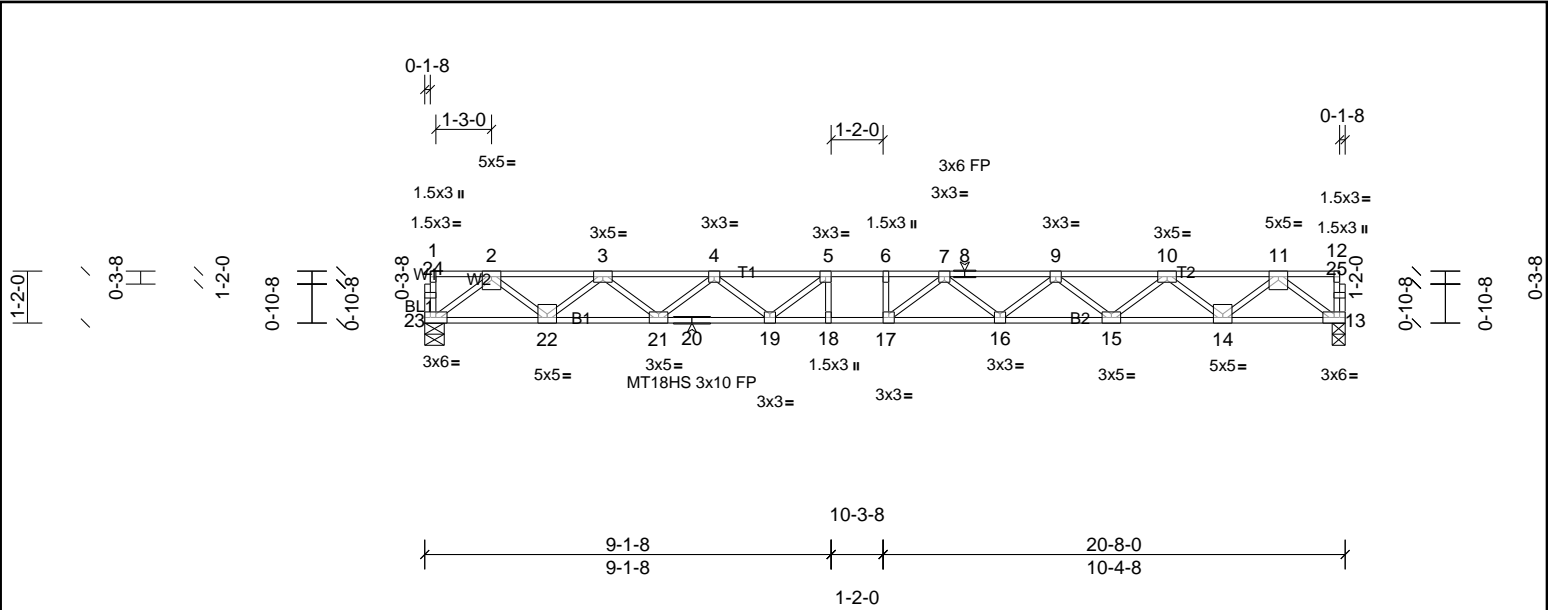

Scale = 1:52

Loading	(psf)	Spacing		2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL		1.00	TC	0.49	Vert(LL)	-0.45	17	>542	480	MT18HS	244/190
TCDL	10.0	Lumber DOL		1.00	BC	0.65	Vert(CT)	-0.62	16-17	>393	360	MT20	244/190
BCLL	0.0	Rep Stress Incr		YES	WB	0.63	Horz(CT)	0.10	13	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014		Matrix-SH							Weight: 103 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP SS(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-10-15 oc purlins, except end verticals. Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD	2x4 SP SS(flat)		
WEBS	2x4 SP No.3(flat)	BOT CHORD	
OTHERS	2x4 SP No.3(flat)		
REACTIONS	(lb/size)	13=1117/0-3-8, (min. 0-1-8), 23=1117/0-5-4, (min. 0-1-8)	
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-2429/0, 3-4=-4099/0, 4-5=-5098/0, 5-6=-5454/0, 6-7=-5454/0, 7-8=-5104/0, 8-9=-5104/0, 9-10=-4097/0, 10-11=-2430/0		
BOT CHORD	22-23=0/1408, 21-22=0/3418, 20-21=0/4749, 19-20=0/4749, 18-19=0/5454, 17-18=0/5454, 16-17=0/5416, 15-16=0/4752, 14-15=0/3417, 13-14=0/1408		
WEBS	11-13=-1763/0, 2-23=-1763/0, 11-14=0/1330, 2-22=0/1330, 10-14=-1285/0, 3-22=-1287/0, 10-15=0/886, 3-21=0/887, 9-15=-853/0, 4-21=-847/0, 9-16=0/457, 4-19=0/578, 7-16=-443/0, 5-19=-689/23, 7-17=-329/481		

- NOTES
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



Job 72509817	Truss 2F2	Truss Type Truss	Qty 2	Ply 1	PBS\SELMA FRENCH COUNTRY RH 2ND FL Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

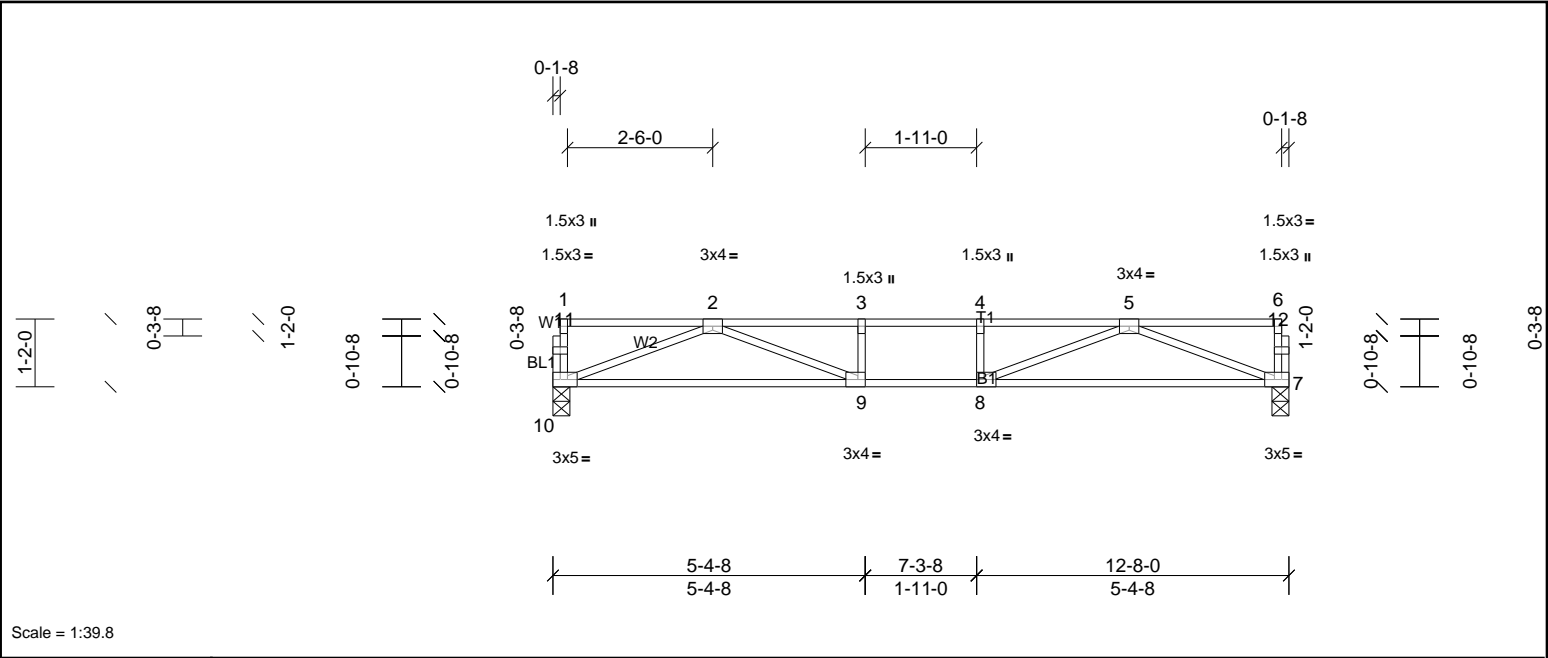


Plate Offsets (X, Y): [7:0-2-0,Edge], [8:0-1-8,Edge], [9:0-1-8,Edge], [10:0-2-0,Edge]													
Loading		(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL		40.0	Plate Grip DOL	1.00	TC	0.55	Vert(LL)	-0.18	9-10	>837	480	MT20	244/190
TCDL		10.0	Lumber DOL	1.00	BC	0.73	Vert(CT)	-0.26	9-10	>571	360		
BCLL		0.0	Rep Stress Incr	YES	WB	0.41	Horz(CT)	0.03	7	n/a	n/a		
BCDL		5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 61 lb	FT = 20%F, 11%E

LUMBER
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 7=677/0-3-8, (min. 0-1-8), 10=677/0-3-8, (min. 0-1-8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2026/0, 3-4=-2026/0, 4-5=-2026/0
BOT CHORD 9-10=0/1396, 8-9=0/2026, 7-8=0/1396
WEBS 5-7=-1495/0, 2-10=-1495/0, 5-8=0/782, 2-9=0/782

NOTES
1) Unbalanced floor live loads have been considered for this design.
2) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.




Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH 2ND FL
72509817	2F3	Truss	10	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:07

Page: 1

ID:5vNTJP5GWa4? a3RdtuUeGwyibUp-5NLWzWWyqJPig_hX_5nxhjiniCa0iIQILZuUqfzRtlc

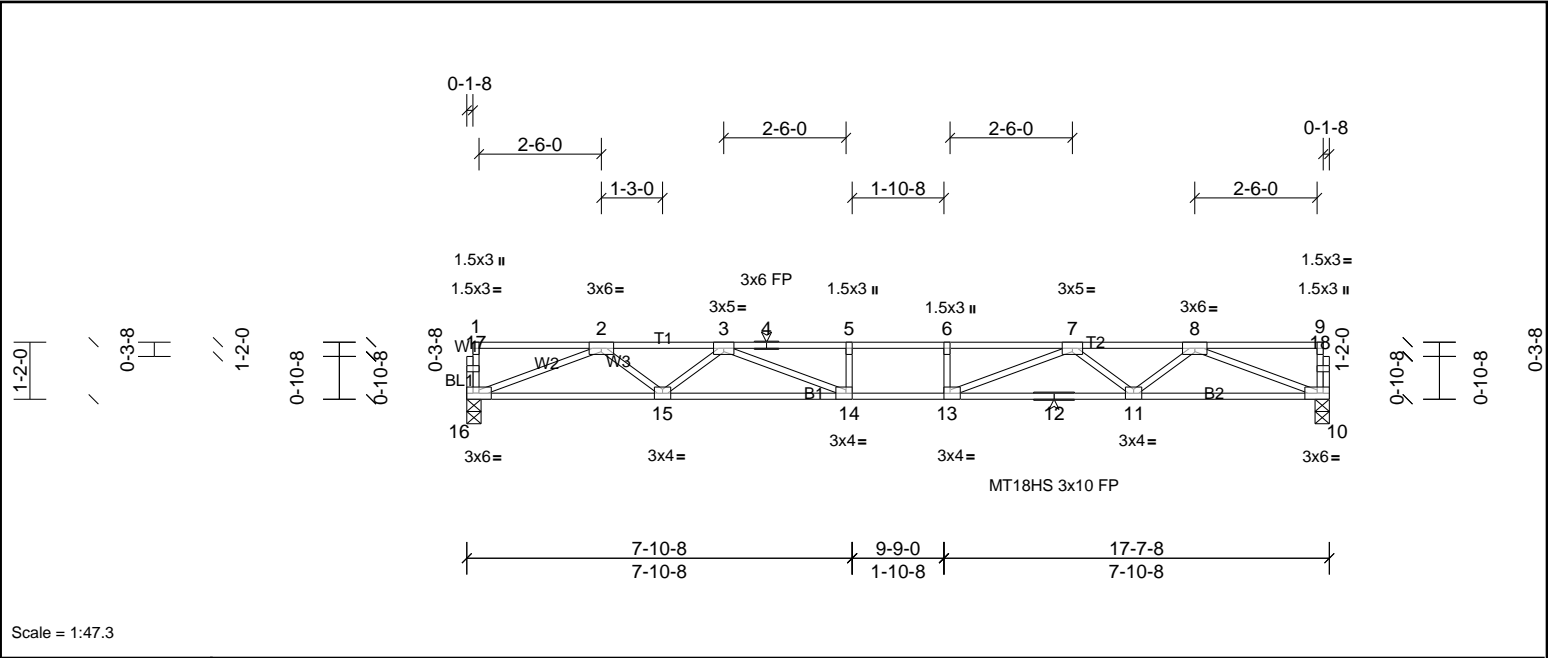


Scale = 1:47.3

Plate Offsets (X, Y):		[13:0-1-8,Edge], [14:0-1-8,Edge]										
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.81	Vert(LL)	-0.32	14-15	>658	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.85	Vert(CT)	-0.43	14-15	>484	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.07	10	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 85 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-6-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		
REACTIONS	(lb/size)	10=949/0-3-8, (min. 0-1-8), 16=949/0-3-8, (min. 0-1-8)	
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-2744/0, 3-4=-3957/0, 4-5=-3957/0, 5-6=-3957/0, 6-7=-3957/0, 7-8=-2744/0		
BOT CHORD	15-16=0/2087, 14-15=0/3348, 13-14=0/3957, 12-13=0/3348, 11-12=0/3348, 10-11=0/2087		
WEBS	8-10=-2239/0, 2-16=-2239/0, 8-11=0/855, 2-15=0/855, 7-11=-787/0, 3-15=-787/0, 7-13=0/933, 3-14=0/933		
NOTES			
1)	Unbalanced floor live loads have been considered for this design.		
2)	All plates are MT20 plates unless otherwise indicated.		
3)	This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.		
4)	Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.		



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:08 Page: 1
ID:5vNTJP5GWa4? a3RdtuUeGwyibUp-ZZvuAsWabdXZH7GjXoIAEwKyQ_VN1J0uZdD1M6zRtlb



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size) 5=363/ Mechanical, 8=363/ Mechanical
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-622/0
BOT CHORD	7-8=0/622, 6-7=0/622, 5-6=0/622
WEBS	3-5=-660/0, 2-8=-660/0

NOTES	
1)	Unbalanced floor live loads have been considered for this design.
2)	This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
3)	Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.


is waived at their sole discretion or restricted by state insurance.

A circular red ink seal for a North Carolina Professional Engineer. The outer ring contains the text "NORTH CAROLINA" at the top and "ENGINEER" at the bottom. Inside the ring, the name "JOHN M. PRESLEY" is printed. In the center, the word "SEAL" is above the license number "025046". A handwritten signature "John Presley" in blue ink is written across the seal. A handwritten date "4/11/25" is written in blue ink over the license number.

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:09 Page: 1
ID:5vNTJP5GWa4?a3RdtUeGwyibUp-1ITGOCXCMwfQrHrw5WpPm8s36Okumf1otNbuYzRtla

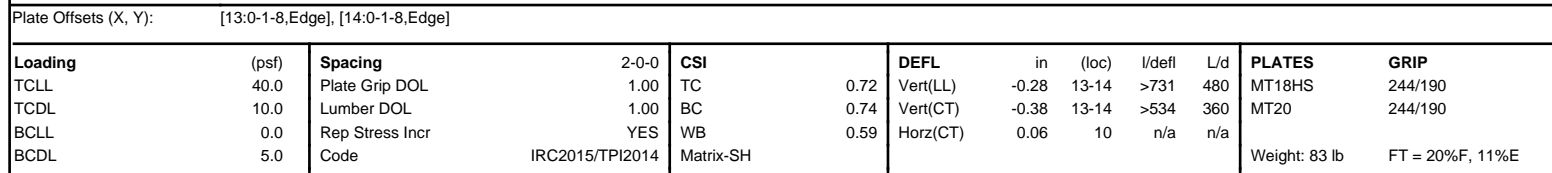

REACTIONS	(lb/size)	10=922/0-3-8, (min. 0-1-8), 16=922/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2642/0, 3-4=-3750/0, 4-5=-3750/0, 5-6=-3750/0, 6-7=-3750/0, 7-8=-2642/0	
BOT CHORD	15-16=0/2018, 14-15=0/3215, 13-14=0/3750, 12-13=0/3215, 11-12=0/3215, 10-11=0/2018	
WEBS	8-10=-2164/0, 2-16=-2164/0, 8-11=0/813, 2-15=0/813, 7-11=-745/0, 3-15=-745/0, 7-13=0/828, 3-14=0/828	


NOTES

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

A circular red ink seal for a North Carolina Professional Engineer. The outer ring contains the text "NORTH CAROLINA" at the top and "ENGINEER" at the bottom. The inner ring contains the text "PROFESSIONAL". In the center, the word "SEAL" is printed above the license number "025046". A blue ink signature, "John M. Presley", is written across the seal. Below the license number, the date "4/11/25" is handwritten in blue ink.

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

Job 72509817	Truss 2F7	Truss Type Truss	Qty 6	Ply 1	PBS\SELMA FRENCH COUNTRY RH 2ND FL Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

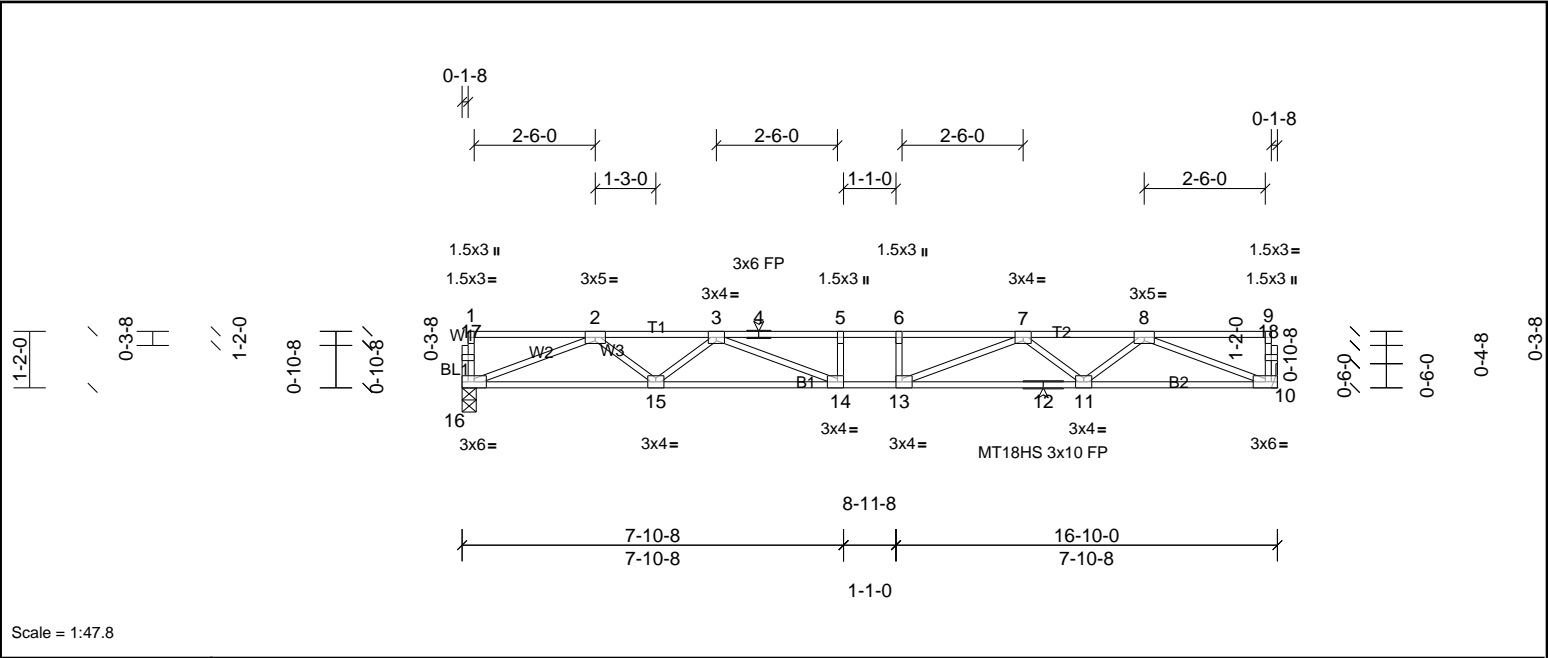

Scale = 1:47.8

Plate Offsets (X, Y): [13:0-1-8,Edge], [14:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.67	Vert(LL)	-0.27	13-14	>726	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.96	Vert(CT)	-0.38	13-14	>531	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.58	Horz(CT)	0.07	10	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 82 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-6-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	10=906/ Mechanical, 16=906/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2583/0, 3-4=-3632/0, 4-5=-3632/0, 5-6=-3632/0, 6-7=-3632/0, 7-8=-2583/0	
BOT CHORD	15-16=0/1978, 14-15=0/3136, 13-14=0/3632, 12-13=0/3136, 11-12=0/3136, 10-11=0/1978	
WEBS	8-10=-2121/0, 2-16=-2121/0, 8-11=0/788, 2-15=0/788, 7-11=-720/0, 3-15=-720/0, 7-13=0/771, 3-14=0/771	

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH 2ND FL
72509817	2F8	Truss	7	1	Job Reference (optional)


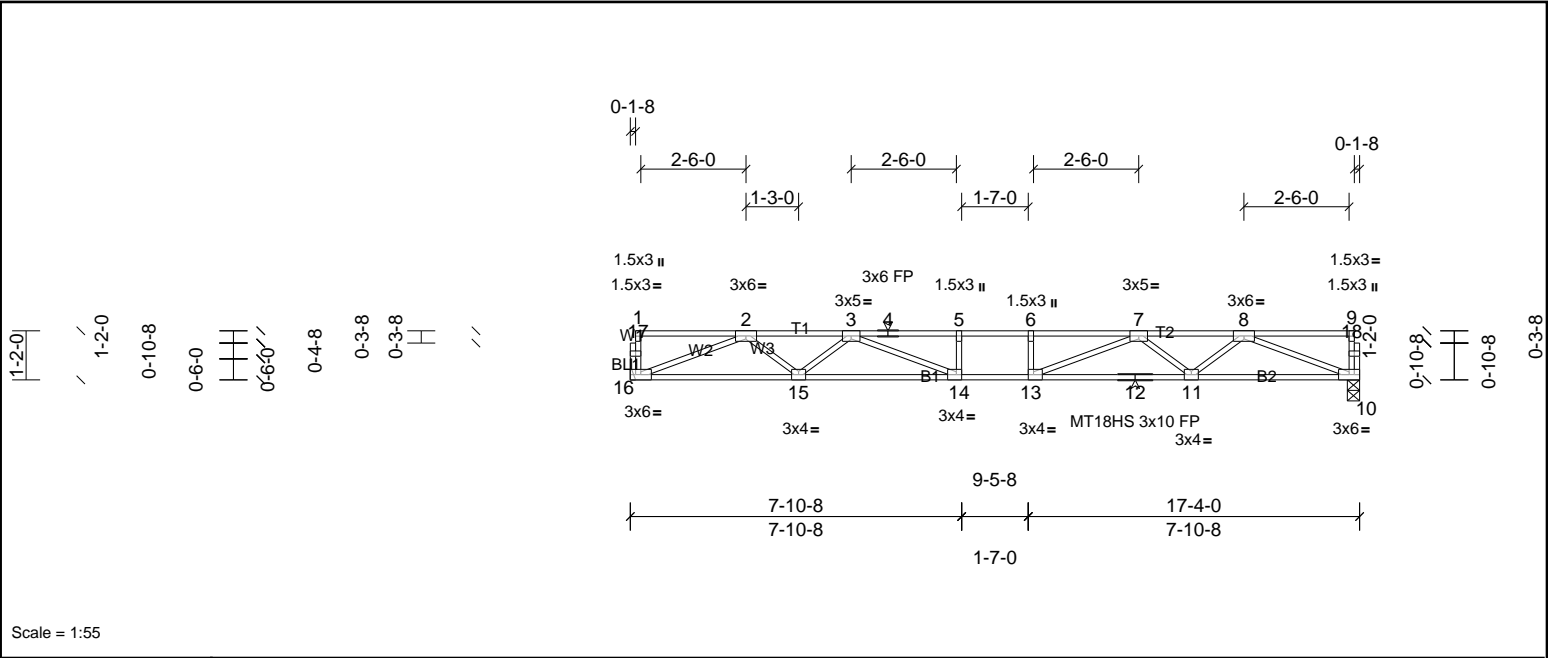


Plate Offsets (X, Y):		[13:0-1-8,Edge], [14:0-1-8,Edge]										
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.29	13-14	>707	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.79	Vert(CT)	-0.40	13-14	>516	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.07	10	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 84 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-3-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		
REACTIONS			
(lb/size)		10=933/0-3-8, (min. 0-1-8), 16=933/ Mechanical	
FORCES		(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD		2-3=-2685/0, 3-4=-3836/0, 4-5=-3836/0, 5-6=-3836/0, 6-7=-3836/0, 7-8=-2685/0	
BOT CHORD		15-16=0/2047, 14-15=0/3270, 13-14=0/3836, 12-13=0/3270, 11-12=0/3270, 10-11=0/2047	
WEBS		8-10=-2195/0, 2-16=-2195/0, 8-11=0/830, 2-15=0/830, 7-11=-762/0, 3-15=-762/0, 7-13=0/871, 3-14=0/871	
NOTES			
1)		Unbalanced floor live loads have been considered for this design.	
2)		All plates are MT20 plates unless otherwise indicated.	
3)		This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.	
4)		Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.	



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:10 Page: 1
ID:w3kkaSA06Qr9l_vnD8b2VByibUj-Vy1ebYYq7EnGXRQ6fDKeJLPbn8MV9dB1X68R_zRtlZ



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	
WEBS	2x4 SP No.3(flat)		Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3(flat)		
REACTIONS	(lb/size)	7=782/ Mechanical, 10=804/ Mechanical	
	Max Grav	7=799 (LC 4), 10=826 (LC 3)	
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-1428/0, 3-13=-1428/0, 4-13=-1428/0, 4-5=-1428/0		
BOT CHORD	9-10=0/1048, 8-9=0/1428, 7-8=0/1001		
WEBS	5-7=-1224/0, 2-10=-1282/0, 5-8=0/825, 2-9=0/766, 3-9=-430/0, 4-8=-448/0		

- | LOAD CASE(S) | Standard |
|--------------|---|
| 1) | Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00 |
| | Uniform Loads (lb/ft) |
| | Vert: 7-10=-10, 1-6=-100 |
| | Concentrated Loads (lb) |
| | Vert: 5=-287, 2=-287, 13=-287 |

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH 2ND FL
72509817	2FG2	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:11

Page: 1

ID:w3kkaSA06Qr9I_vnD8b2VByibUj-z8b1ptZSuYv79b_IDxrtZyWeBQSEbTKGBshzRzRtIY

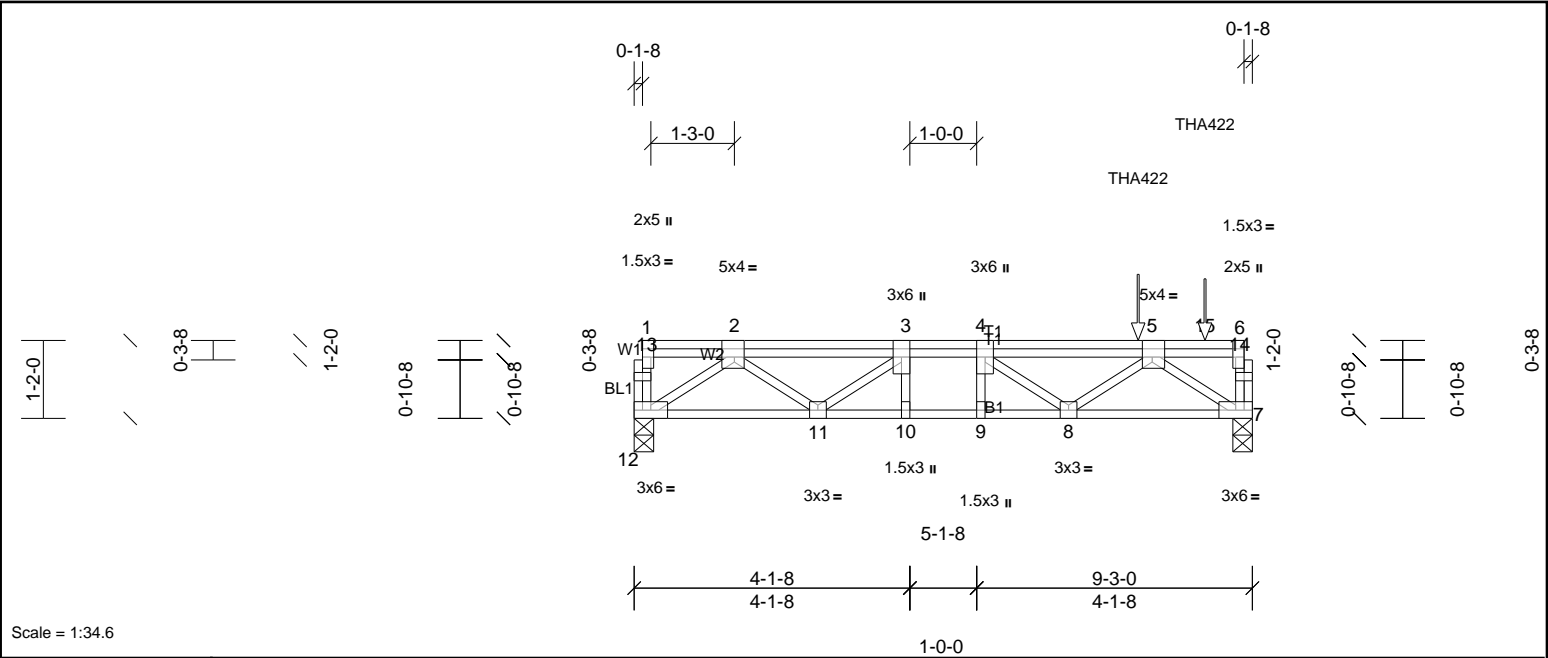

Scale = 1:34.6

Plate Offsets (X, Y): [2:0-1-12,Edge], [5:0-1-12,Edge], [6:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.27	Vert(LL)	-0.04	8-9	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.67	Vert(CT)	-0.06	8-9	>999	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.48	Horz(CT)	0.02	7	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 61 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS (lb/size) 7=1372/0-3-8, (min. 0-1-8), 12=618/0-3-8, (min. 0-1-8)
Max Grav 7=1428 (LC 4), 12=618 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1252/0, 3-4=-1730/0, 4-5=-1708/0
BOT CHORD 11-12=0/781, 10-11=0/1730, 9-10=0/1730, 8-9=0/1730, 7-8=0/1683
WEBS 5-7=-2049/0, 2-12=-954/0, 5-8=-83/254, 2-11=0/611, 3-11=-635/0

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 1-0-0 oc max. starting at 7-6-8 from the left end to 8-6-8 to connect truss(es) to back face of top chord.
 - Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (lb/ft)
Vert: 7-12=-10, 1-6=-100
Concentrated Loads (lb)
Vert: 5=-726, 15=-287



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MITek Industries, Inc. Fri Apr 11 07:24:11 Page: ID:tvvqLZnnu9jmDcxCrscw3zSkNx-z8b1ptZSuYv79b_IDxrtZyZdBadEIVKGBshRzRtl




LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

A circular red professional engineer seal for John M. Presley, North Carolina. The seal contains the text "NORTH CAROLINA", "PROFESSIONAL", "SEAL", "025046", "ENGINEER", and "JOHN M. PRESLEY". A blue ink signature "John M. Presley" is written across the seal, and the date "4/11/25" is handwritten in blue ink next to the license number.

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SRCFA and Truss Plate Institute.

Job	Truss	Truss Type	Qty	Ply	PBS/SELMA FRENCH COUNTRY RH 2ND FL
72509817	2KW2	Truss	1	1	Job Reference (optional)

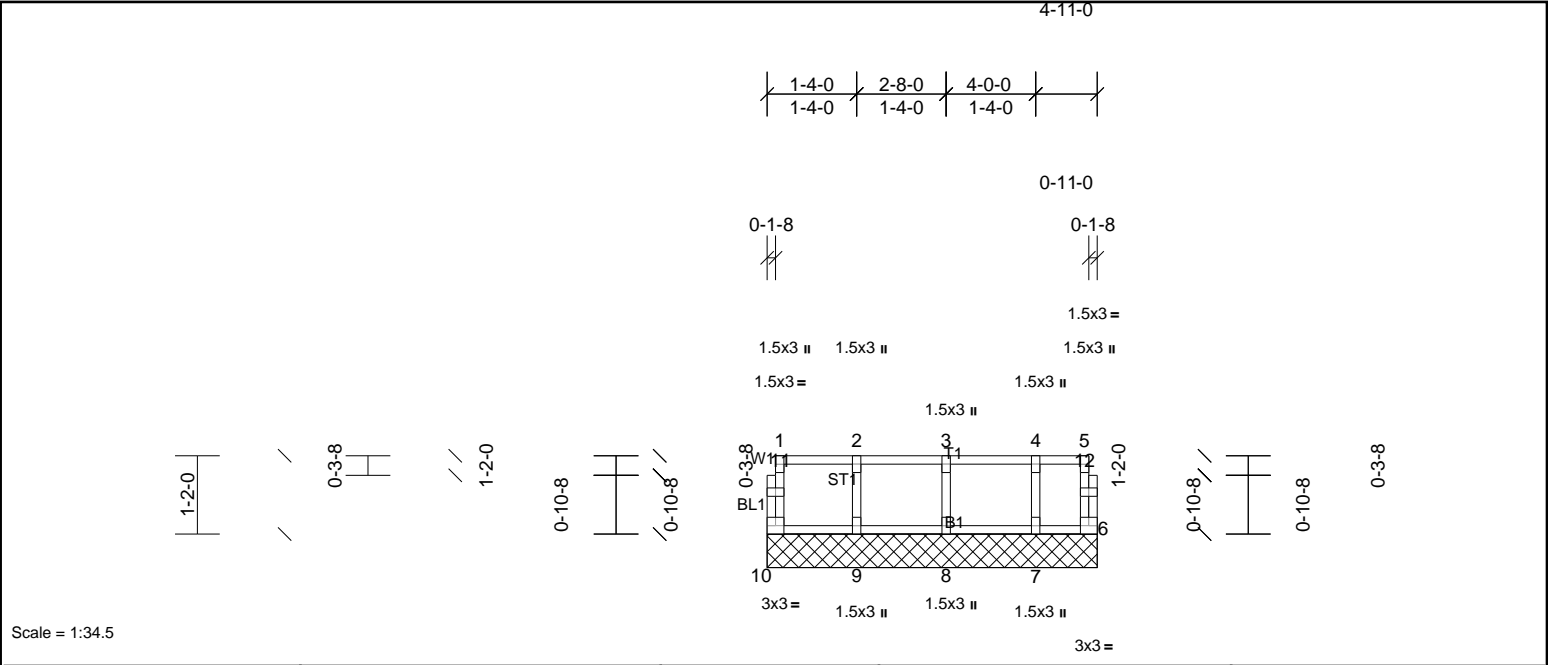

Loading	(psf)	Spacing	1-7-3	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	n/a	-	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 23 lb	FT = 20%F, 11%E


LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 4-11-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS	All bearings 4-11-0. (lb) - Max Grav All reactions 250 (lb) or less at joint(s) 6, 7, 8, 9, 10
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH 2ND FL
72509817	2KW3	Truss	1	1	Job Reference (optional)

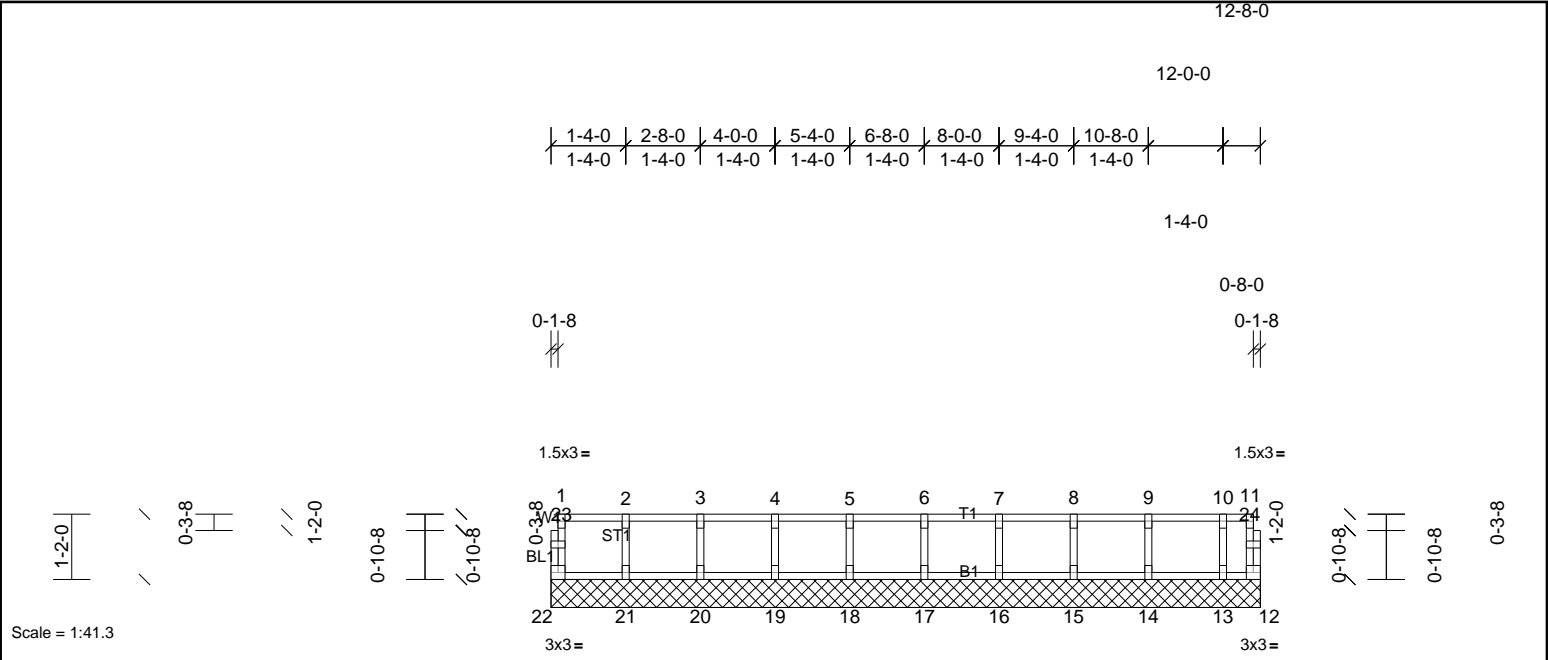

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	n/a	-	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 55 lb	FT = 20%F, 11%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	


REACTIONS All bearings 12-8-0.
(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- 1) All plates are 1.5x3 (||) MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:12 Page: ID:5vNTJP5GWa4a3RdtUeGwyibUp-RK9P0DZ4fr1_mIZvmeN6OmUkCbwi9kUUrBfVztRtl

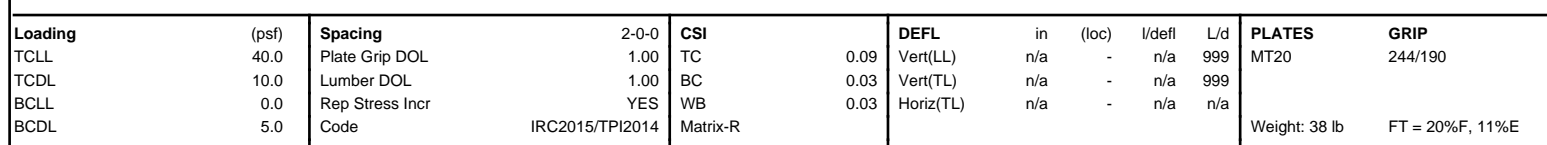


REACTIONS	All bearings 8-4-0.
	(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 9, 10, 11, 12, 13, 14, 15
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

A circular red ink seal for the State of North Carolina. The outer ring contains the text "NORTH CAROLINA" at the top and "JOHN M. PRESLEY" at the bottom. Inside the ring, the words "PROFESSIONAL" and "ENGINEER" are positioned at the top and bottom respectively. In the center, the word "SEAL" is above the license number "025046". A handwritten signature "John Presley" in blue ink is written across the seal. To the right of the seal, the date "4/11/25" is handwritten in blue ink.

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:24:12 Page: 1
ID:5vNTJP5GWa4?a3RdtuUeGwyibUp-RK9P0DZ4fr1_miZVmeN6OmUkNbw0z9KUUrBfVtzRtlX

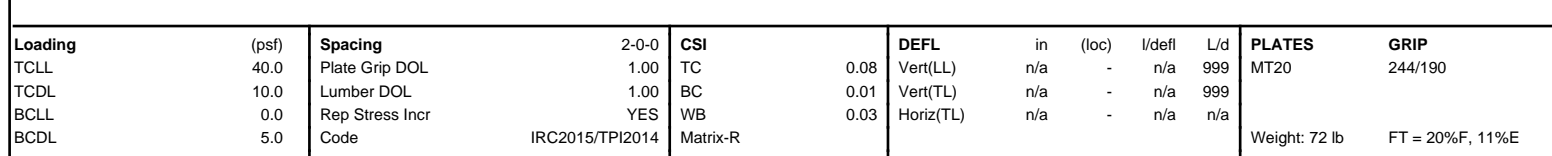

REACTIONS	All bearings 17-1-8.
(lb) - Max Grav	All reactions 250 (lb) or less at joint(s) 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


NOTES

- 1) All plates are 1.5x3 (II) MT20 unless otherwise indicated.
- 2) Gable requires continuous bottom chord bearing.
- 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH 2ND FL
72509817	2KW6	Truss	1	1	Job Reference (optional)

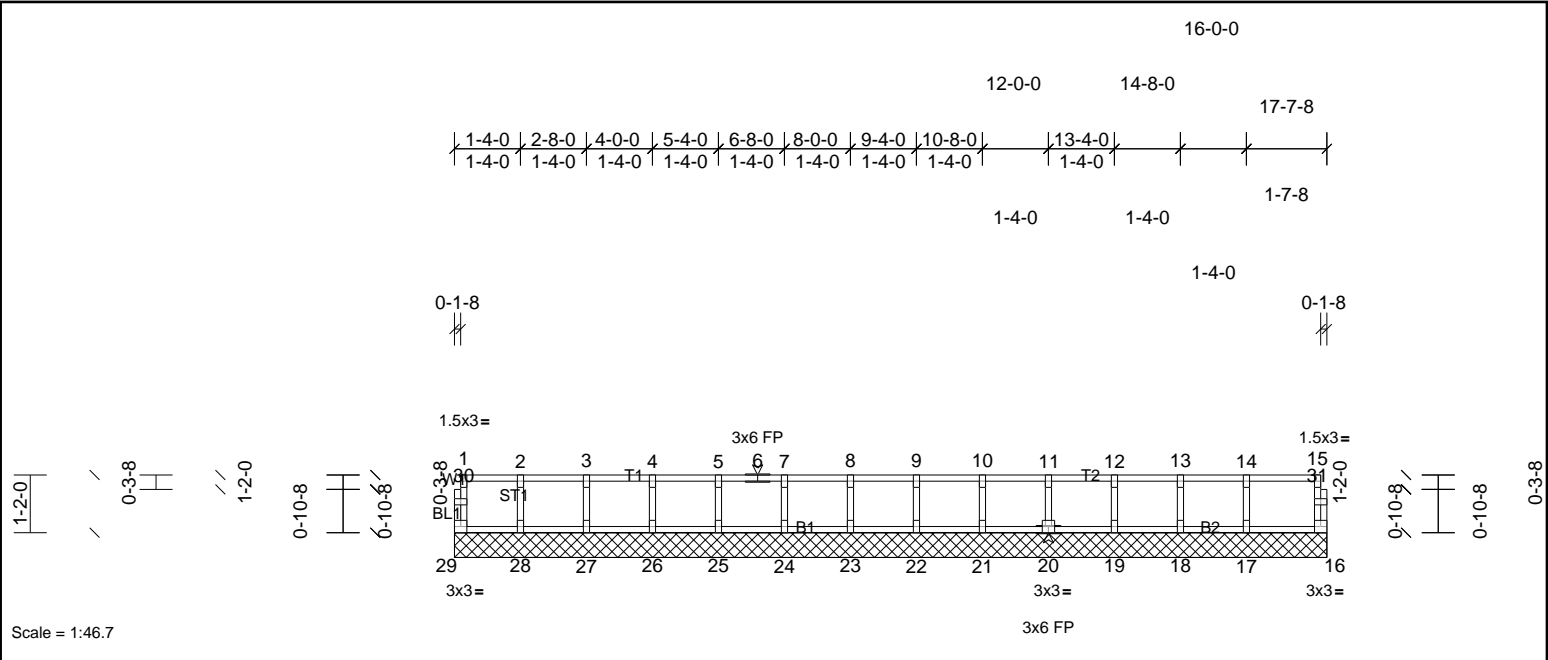

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.10	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	n/a	-	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 73 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	All bearings 17-7-8.
(lb) - Max Grav	All reactions 250 (lb) or less at joint(s) 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
--------	--

- NOTES**
- 1) All plates are 1.5x3 (||) MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



Job	Truss	Truss Type	Qty	Ply	PBS/SELMA FRENCH COUNTRY RH RF
72509811	A1	Truss	3	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:08

Page: 1

ID:pN15YSds96dmsqp4S7Hy2ByibU7-z1PusRcn0UuY4WJMIM6fgjzkENVviG979u8liOzRtWh

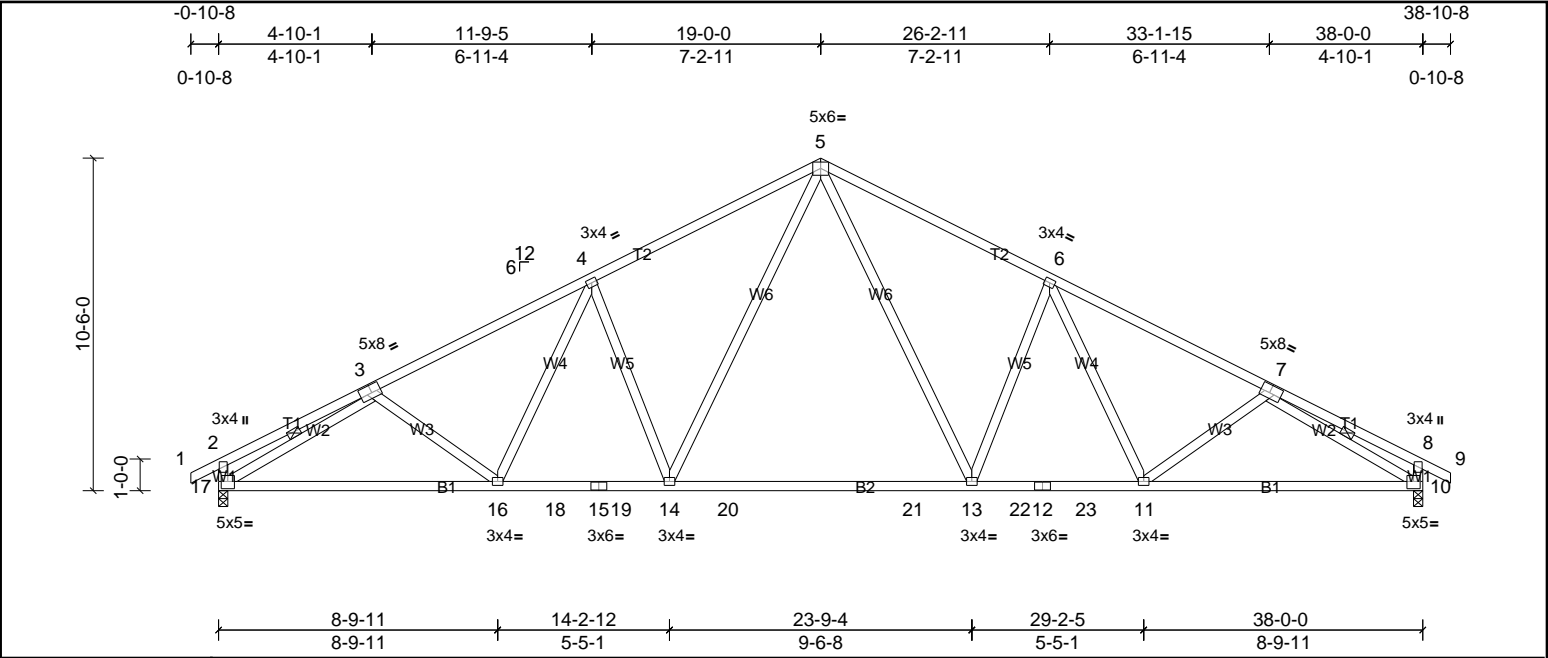


Plate Offsets (X, Y): [3:0-3-8,0-3-0], [7:0-3-8,0-3-0], [10:0-2-8,0-2-4], [17:0-2-8,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.77	Vert(LL)	-0.32	13-14	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.85	Vert(CT)	-0.61	13-14	>747	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.56	Horz(CT)	0.11	10	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 228 lb	FT = 20%

LUMBER			BRACING		
TOP CHORD	2x4 SP No.2		TOP CHORD	Structural wood sheathing directly applied, except end verticals.	
BOT CHORD	2x4 SP No.2 *Except* B2:2x4 SP No.1		BOT CHORD	Rigid ceiling directly applied or 8-3-10 oc bracing.	
WEBS	2x4 SP No.3		WEBS	1 Row at midpt	3-17, 7-10
REACTIONS	(lb/size)	10=1570/0-3-8, (min. 0-1-14), 17=1570/0-3-8, (min. 0-1-14)			
	Max Horiz	17=-155 (LC 8)			
	Max Uplift	10=-226 (LC 11), 17=-226 (LC 10)			
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.				
TOP CHORD	2-3=-355/102, 3-4=-2275/658, 4-5=-2058/717, 5-6=-2058/717, 6-7=-2275/658, 7-8=-355/102, 2-17=-329/166, 8-10=-329/166				
BOT CHORD	16-17=-471/1994, 16-18=-328/1915, 15-18=-328/1915, 15-19=-328/1915, 14-19=-328/1915, 14-20=-120/1425, 20-21=-120/1425, 13-21=-120/1425, 13-22=-328/1915, 12-22=-328/1915, 12-23=-328/1915, 11-23=-328/1915, 10-11=-471/1994				
WEBS	3-17=-2080/598, 4-14=-561/317, 5-14=-229/814, 5-13=-229/814, 6-13=-561/317, 7-10=-2080/598				

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" x 6'-0" tall by 2'-0" x 0'-0" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 226 lb uplift at joint 17 and 226 lb uplift at joint 10.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.



PLACEMENT PLAN



ROOF HANGER LIST		
6	HUS26	8

[illegible]

This drawing is property of UFP Site Built, LLC. Any unauthorized use of this document without written permission is prohibited. UFP relinquishes ownership of delivered product upon delivery. Owner of product must obtain UFP's authorization prior to any alteration or modification of product; UFP will not be held responsible for any unauthorized modifications done or costs incurred without prior written authorization from UFP.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	A1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:10

Page: 1

ID:t_vL7mccdUN2cWfiKiEUzmyibU9-soePiof4jOzZ7c8xCBbqZ7Z6_3ZeAij4W6Wr9zRtWd

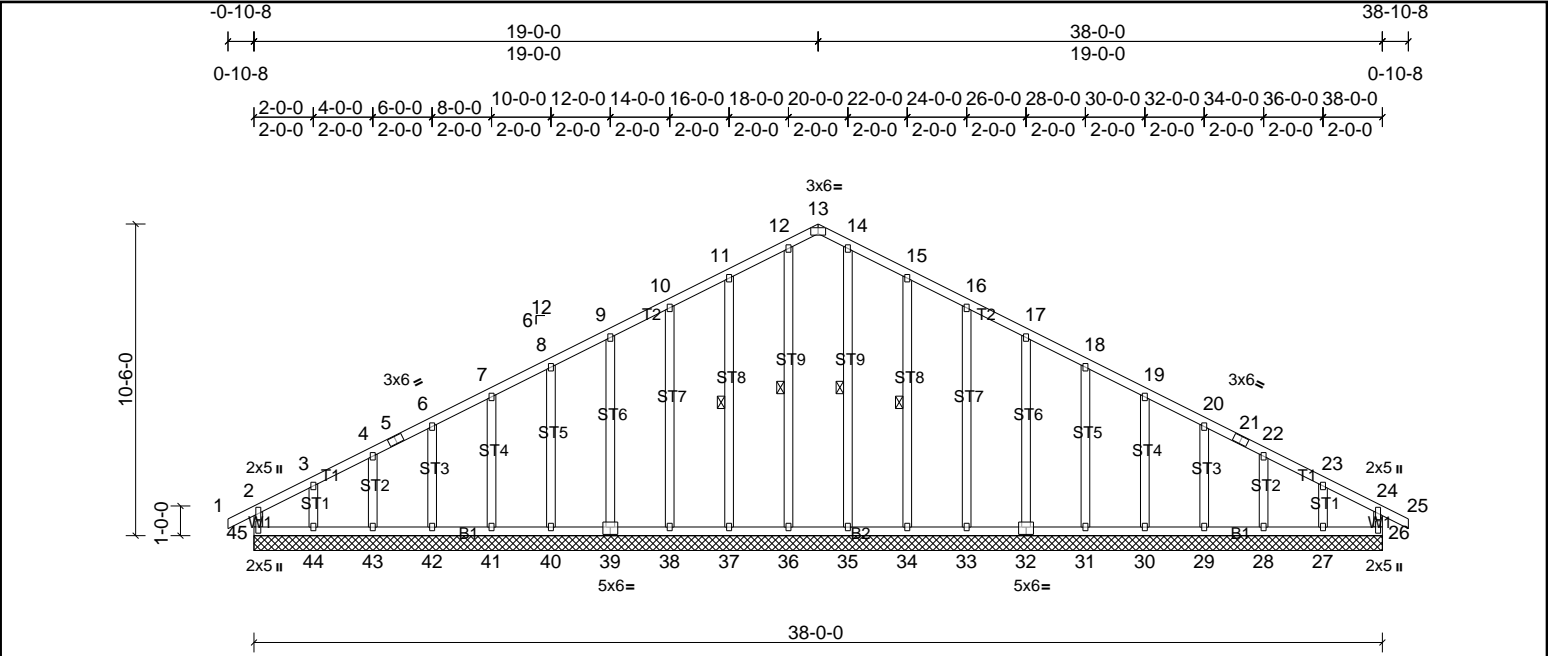


Plate Offsets (X, Y): [13:0-3-0,Edge], [32:0-3-0,0-3-0], [39:0-3-0,0-3-0]


Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.01	26	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 271 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10'-0" oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt
OTHERS	2x4 SP No.3		12-36, 14-35, 11-37, 15-34

REACTIONS All bearings 38'-0".
(lb) - Max Horiz 45=-155 (LC 8)
Max Uplift All uplift 100 (lb) or less at joint(s) 26, 28, 29, 30, 31, 32, 33, 34, 37, 38, 39, 40, 41, 42, 43, 45 except 27=-138 (LC 11), 44=-155 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 10-11=-111/281, 11-12=-135/348, 12-13=-119/302, 13-14=-119/302, 14-15=-135/348, 15-16=-111/281

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 (||) MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2'-0" oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 45, 26, 37, 38, 39, 40, 41, 42, 43, 34, 33, 32, 31, 30, 29, 28 except (jt=lb) 44=154, 27=138.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

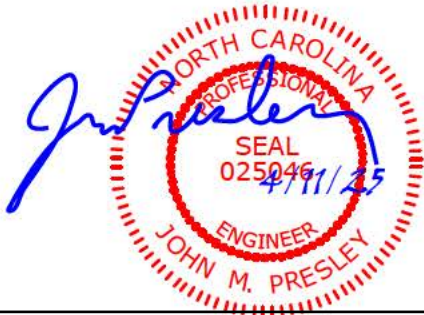

Job	Truss	Truss Type	Qty	Ply	PBS/SELMA FRENCH COUNTRY RH RF
72509811	A3	Truss	3	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:11

Page: 1

ID:ae_hfNWDHLU2HSdMQkrAlyibUG-K?Cnw8gwr0WqAHBKUwiqNmge9OC8NWxsJ9r3NbZrRtWc

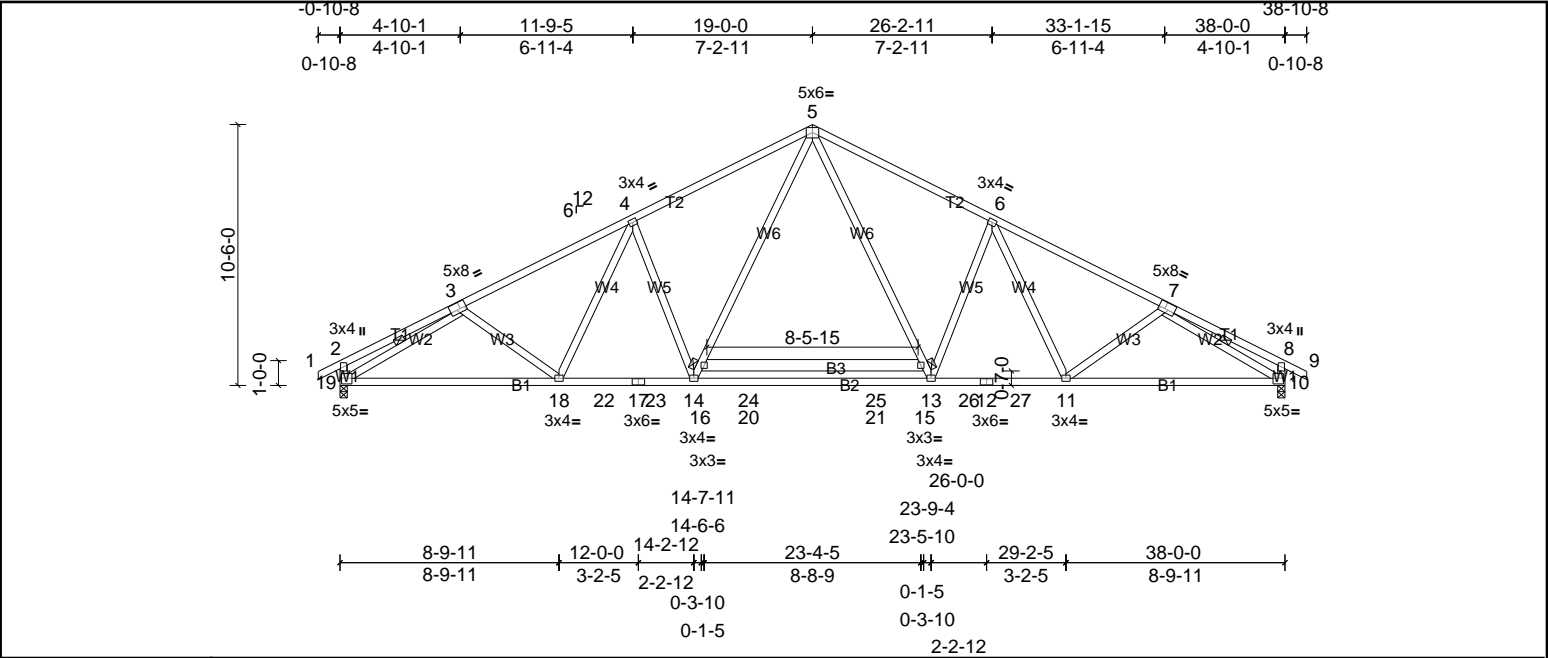


Plate Offsets (X, Y): [3:0-3-0,0-3-4], [7:0-3-0,0-3-4], [10:0-2-12,0-2-4], [19:0-2-12,0-2-4]

Loading	(psf)	Spacing	2-1-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	-0.31	13-14	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.91	Vert(CT)	-0.61	13-14	>742	180	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.59	Horz(CT)	0.12	10	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 249 lb	FT = 20%

LUMBER			BRACING		
TOP CHORD	2x4 SP No.2 *Except* T2:2x4 SP SS		TOP CHORD	2-0-0 oc purlins (3-10-0 max.), except end verticals	
BOT CHORD	2x4 SP No.1 *Except* B3:2x6 SP No.2		BOT CHORD	(Switched from sheeted: Spacing > 2-0-0).	
WEBS	2x4 SP No.3		WEBS	Rigid ceiling directly applied or 6-0-0 oc bracing.	
REACTIONS	(lb/size)	10=1729/0-3-8, (min. 0-2-1), 19=1729/0-3-8, (min. 0-2-1)		1 Row at midpt	3-19, 7-10
	Max Horiz	19=-162 (LC 8)			
	Max Uplift	10=-179 (LC 11), 19=-179 (LC 10)			
	Max Grav	10=1747 (LC 2), 19=1747 (LC 2)			
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.				
TOP CHORD	2-3=-391/105, 3-4=-2675/578, 4-5=-2470/633, 5-6=-2470/633, 6-7=-2675/578, 7-8=-391/105, 2-19=-356/172, 8-10=-356/172				
BOT CHORD	18-19=-405/2296, 18-22=-242/2281, 17-22=-242/2281, 17-23=-242/2281, 14-23=-242/2281, 14-24=-40/1823, 24-25=-40/1823, 13-25=-40/1823, 13-26=-242/2281, 12-26=-242/2281, 12-27=-242/2281, 11-27=-242/2281, 10-11=-405/2285				
WEBS	4-14=-574/337, 14-16=-237/805, 5-16=-183/1010, 5-15=-183/1010, 13-15=-237/805, 6-13=-574/337, 3-19=-2395/521, 7-10=-2395/521				

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 179 lb uplift at joint 19 and 179 lb uplift at joint 10.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job 72509811	Truss A4	Truss Type Truss	Qty 7	Ply 1	PBS/SELMA FRENCH COUNTRY RH RF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:12

Page: 1

ID:SPDCVkJKZ?Tl3w7fahnL8yibUC-oBmA7UgYcKehoRmW2dD3w_DploXN6z0?Xpbdv1zRtWb


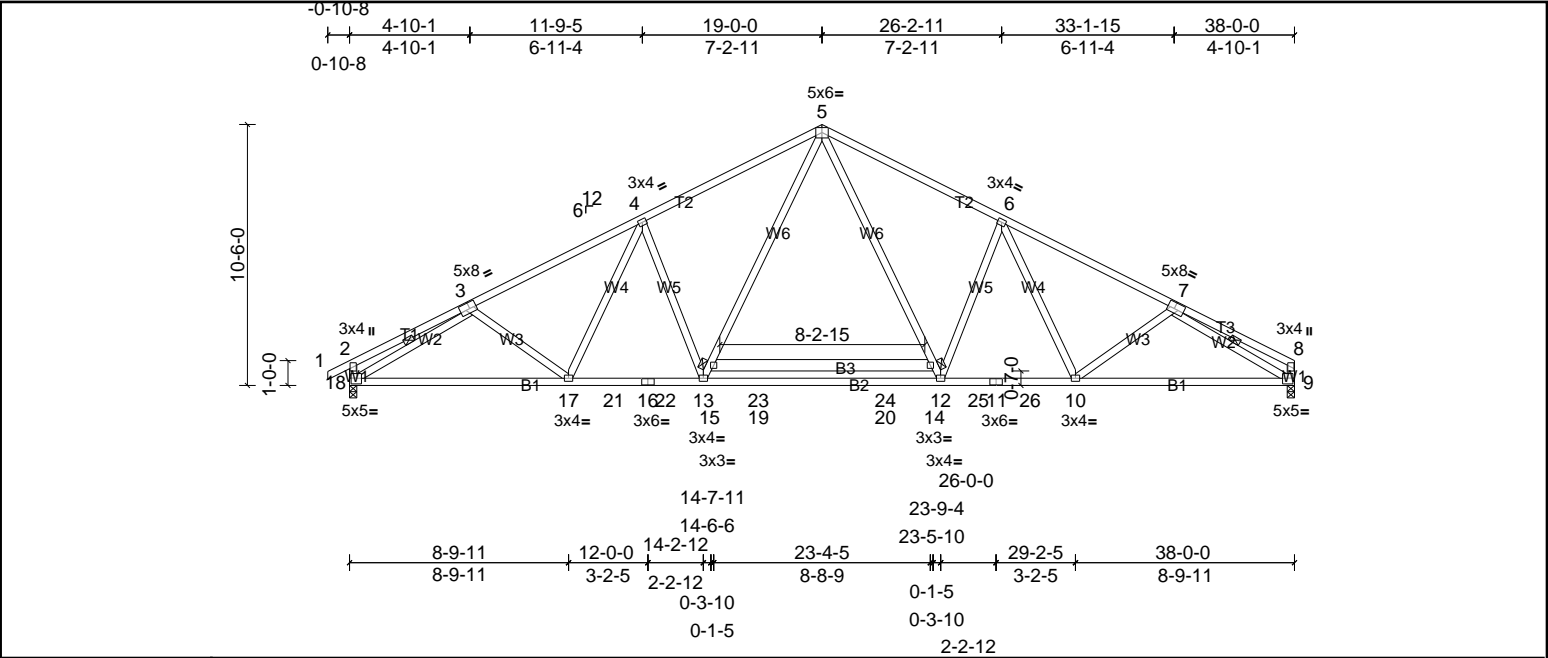


Plate Offsets (X, Y):											[3:0-3-4,0-3-0], [7:0-3-4,0-3-0], [9:0-2-4,0-2-12], [18:0-2-4,0-2-12]													
Loading		(psf)	Spacing		2-1-0		CSI		DEFL		in		(loc)		l/defl		L/d		PLATES		GRIP			
TCLL (roof)		20.0	Plate Grip DOL		1.15		TC		0.64		Vert(LL)		-0.31		12-13		>999		240		MT20		244/190	
TCDL		10.0	Lumber DOL		1.15		BC		0.91		Vert(CT)		-0.61		12-13		>741		180					
BCLL		0.0 *	Rep Stress Incr		NO		WB		0.60		Horz(CT)		0.12		9		n/a		n/a					
BCDL		10.0	Code		IRC2015/TPI2014		Matrix-MSH														Weight: 248 lb		FT = 20%	

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2 *Except* T2:2x4 SP SS	TOP CHORD	2-0-0 oc purlins (3-9-14 max.), except end verticals
BOT CHORD	2x4 SP No.1 *Except* B3:2x6 SP No.2	(Switched from sheeted: Spacing > 2-0-0).	
WEBS	2x4 SP No.3	Rigid ceiling directly applied or 6-0-0 oc bracing.	
REACTIONS	(lb/size)	1 Row at midpt	3-18, 7-9
	9=1664/0-3-8, (min. 0-2-0), 18=1730/0-3-8, (min. 0-2-1)		
	Max Horiz 18=165 (LC 7)		
	Max Uplift 9=155 (LC 11), 18=179 (LC 10)		
	Max Grav 9=1693 (LC 2), 18=1748 (LC 2)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-18=-356/173, 8-9=-257/90, 2-3=-391/105, 3-4=-2676/578, 4-5=-2471/634, 5-6=-2472/634, 6-7=-2681/581, 7-8=-346/76		
BOT CHORD	17-18=-443/2290, 17-21=-281/2282, 16-21=-281/2282, 16-22=-281/2282, 13-22=-281/2282, 13-23=-78/1824, 23-24=-78/1824, 12-24=-78/1824, 12-25=-281/2283, 11-25=-281/2283, 11-26=-281/2283, 10-26=-281/2283, 9-10=-448/2297		
WEBS	3-18=-2396/522, 7-9=-2456/555, 4-13=-574/337, 13-15=-237/805, 5-15=-183/1010, 5-14=-183/1012, 12-14=-238/806, 6-12=-576/337		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 179 lb uplift at joint 18 and 155 lb uplift at joint 9.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

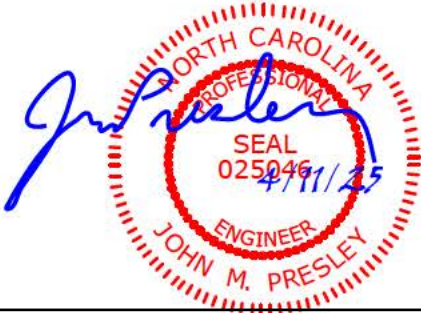

Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	A4G	Truss	1	1	Job Reference (optional)

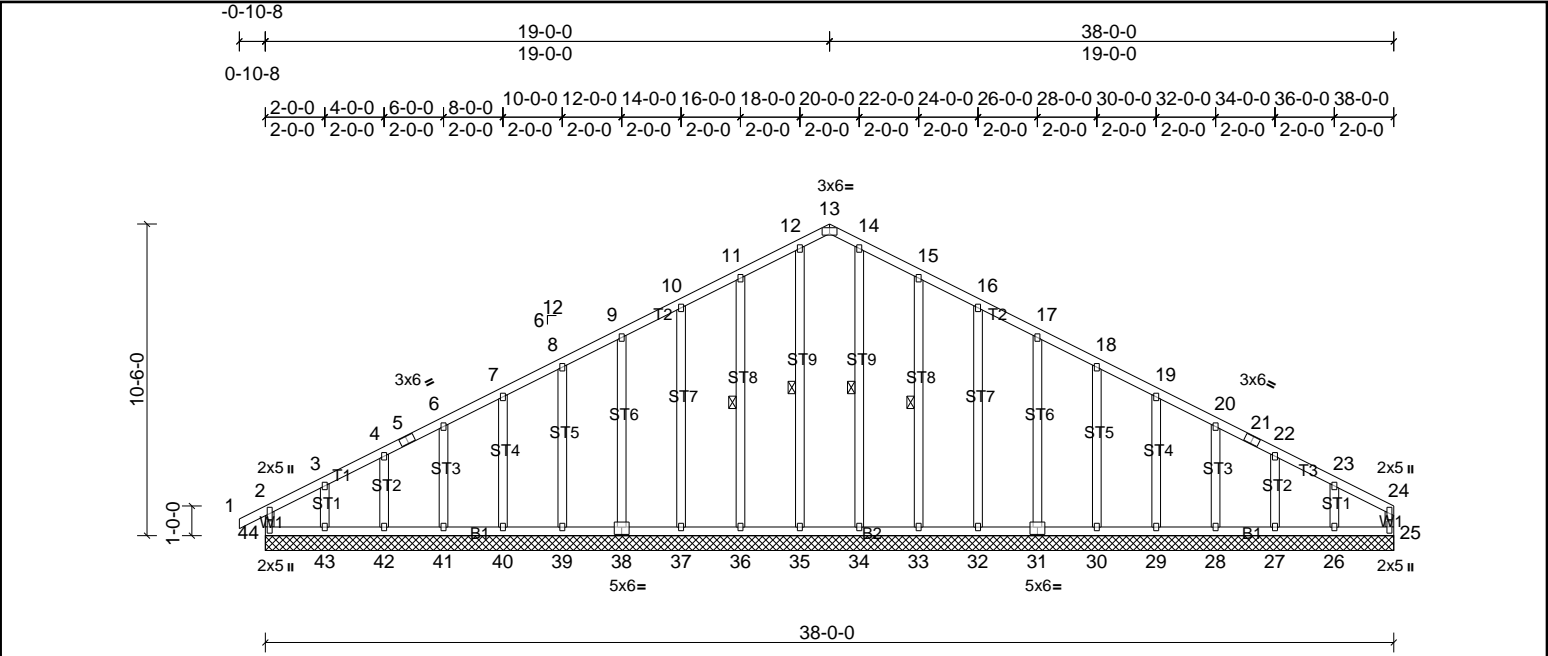


Plate Offsets (X, Y):	[13:0-3-0,Edge], [31:0-3-0,0-3-0], [38:0-3-0,0-3-0]
-----------------------	---

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.01	25	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 269 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt
OTHERS 2x4 SP No.3	

REACTIONS	All bearings 38'-0-0. (lb) - Max Horiz 44=159 (LC 7) Max Uplift All uplift 100 (lb) or less at joint(s) 25, 27, 28, 29, 30, 31, 32, 33, 36, 37, 38, 39, 40, 41, 42, 44 except 26=139 (LC 11), 43=156 (LC 10) Max Grav All reactions 250 (lb) or less at joint(s) 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	10-11=116/279, 11-12=140/346, 12-13=123/300, 13-14=123/300, 14-15=140/346, 15-16=116/279

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 (||) MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2'-0" oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 44, 25, 36, 37, 38, 39, 40, 41, 42, 33, 32, 31, 30, 29, 28, 27 except (jt=lb) 43=156, 26=138.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	B1	Truss	2	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:13

Page: 1

ID:W16S43YTpyllWlmkY9fJGjybUE-GNKYKqhANemYQbLjcLkISBI?uC?arY49mTKASUzRtWa

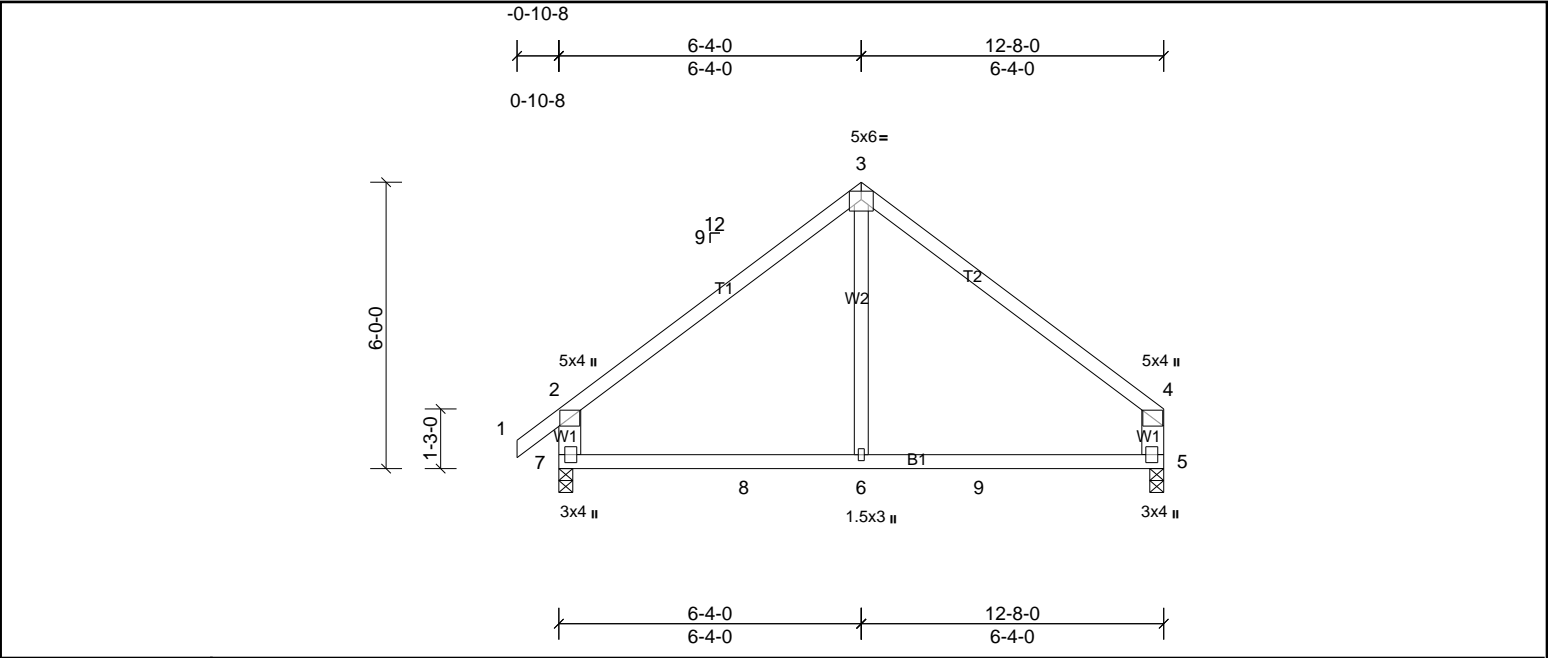


Plate Offsets (X, Y): [5:0-2-0,0-1-0], [7:0-2-0,0-1-8]


Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.55	Vert(LL)	-0.05	6-7	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.40	Vert(CT)	-0.09	6-7	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horz(CT)	0.01	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							
										Weight: 57 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10'-0" oc bracing.
WEBS	2x6 SP No.2 *Except* W2:2x4 SP No.3		

REACTIONS	(lb/size)	5=485/0-3-8, (min. 0-1-8), 7=558/0-3-8, (min. 0-1-8)
	Max Horiz	7=174 (LC 9)
	Max Uplift	5=53 (LC 11), 7=77 (LC 10)
	Max Grav	5=510 (LC 18), 7=577 (LC 17)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-536/138, 3-4=-528/137, 2-7=-502/203, 4-5=-427/147
BOT CHORD	7-8=-13/366, 6-8=-13/366, 6-9=-13/366, 5-9=-13/366
WEBS	3-6=0/266


- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 77 lb uplift at joint 7 and 53 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

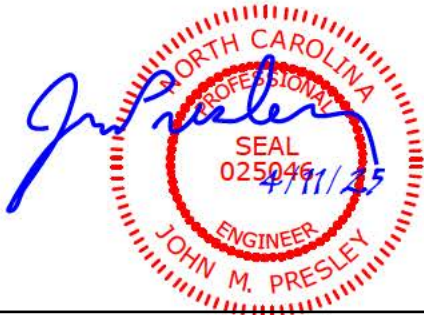

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:14 Page: 1
ID:lxDa0ikMteq?4CnfvGSr7JyspE9-GNKYKqhANemYQbLjclKlSBi58C4brZj9mTKASuZrtWa



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only.
- 4) All plates are 1.5x3 (||) MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18, 11, 16, 13 except (jt=lb) 17=145, 12=134.
- 11) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	B2L	Truss	1	2	Job Reference (optional)

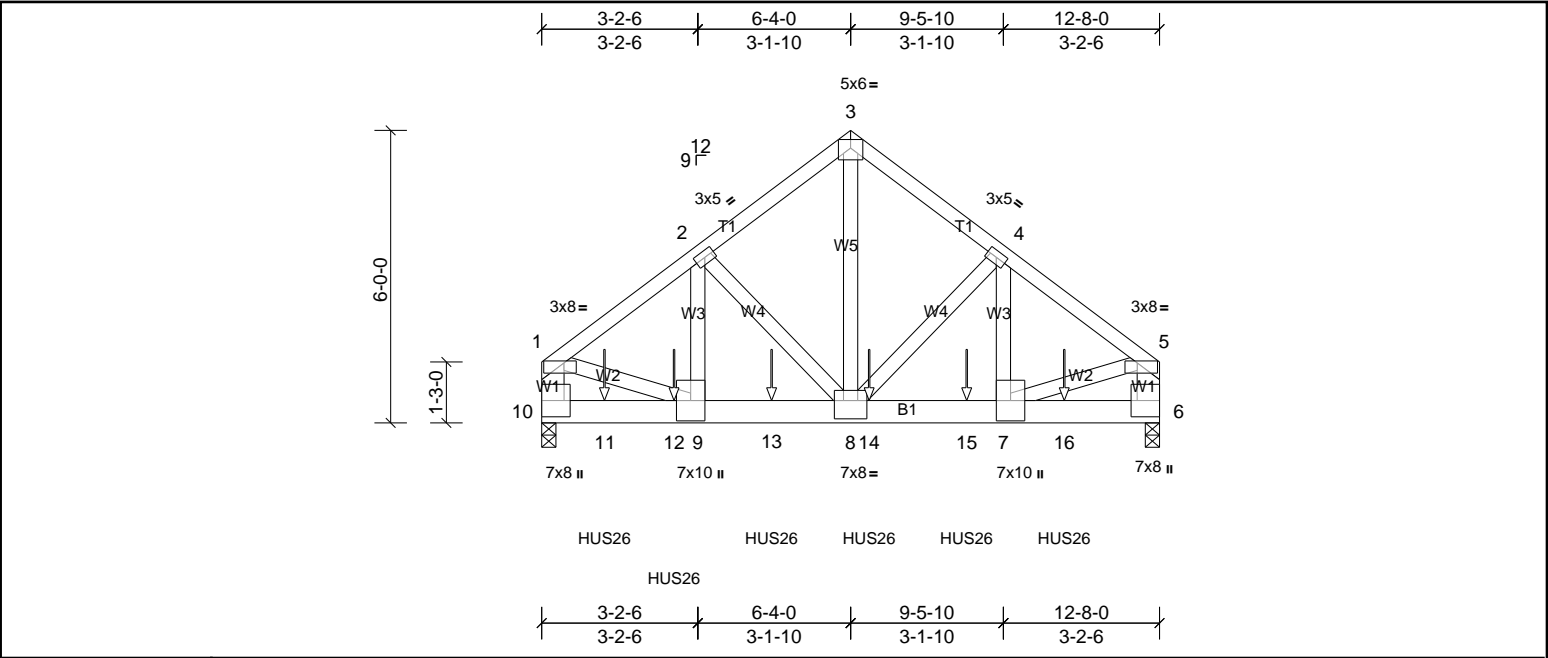


Plate Offsets (X, Y):	[1:0-5-0,0-0-8], [5:0-5-0,0-0-8], [6:Edge,0-5-8], [8:0-4-0,0-4-8]
-----------------------	---

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	-0.04	7-8	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.08	7-8	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.96	Horz(CT)	0.01	6	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 188 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-4-8 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3 *Except* W1:2x6 SP No.2		

REACTIONS	(lb/size)	6=4996/0-3-8, (min. 0-2-15), 10=5843/0-3-8, (min. 0-3-7)
	Max Horiz	10=157 (LC 5)
	Max Uplift	6=513 (LC 9), 10=599 (LC 8)
	Max Grav	6=5013 (LC 2), 10=5875 (LC 2)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-5350/567, 2-3=-4065/492, 3-4=-4065/492, 4-5=-5083/540, 1-10=-4490/478, 5-6=-4321/461
BOT CHORD	10-11=-203/757, 11-12=-203/757, 9-12=-203/757, 9-13=-457/4225, 8-13=-457/4225, 8-14=-390/4013, 14-15=-390/4013, 7-15=-390/4013, 7-16=-66/487, 6-16=-66/487
WEBS	1-9=-357/3752, 5-7=-356/3724, 2-9=-167/1714, 2-8=-1434/243, 3-8=-506/4631, 4-8=-1131/212, 4-7=-130/1333

- NOTES**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 3 rows staggered at 0-8-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 599 lb uplift at joint 10 and 513 lb uplift at joint 6.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-3-7 from the left end to 10-8-9 to connect truss(es) to front face of bottom chord.
 - Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S)	Standard
1)	Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
	Uniform Loads (lb/ft)
	Vert: 1-3=-60, 3-5=-60, 6-10=-20
	Concentrated Loads (lb)
	Vert: 11=-1644, 12=-1644, 13=-1644, 14=-1644, 15=-1644, 16=-1644



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	C1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:14

Page: 1

ID:cNLNblKhzWdSndxtljCj0EysX6k-kZuwYAio8xuP1lwwA2FX?PIHfCRSa0RI?74j_wzRtWZ

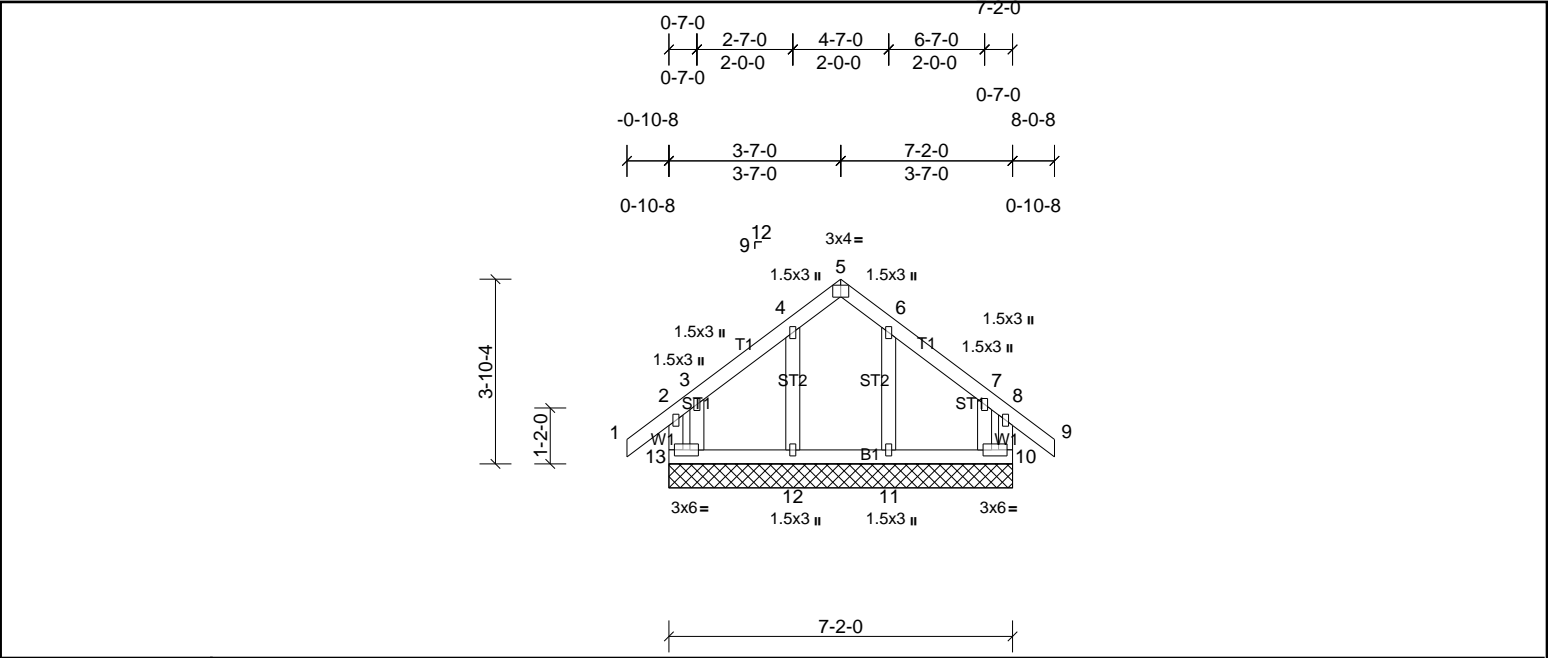


Plate Offsets (X, Y): [5:0-2-0,Edge]


Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	10	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 41 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS All bearings 7-2-0.
(lb) - Max Horiz 13=-122 (LC 8)
Max Uplift All uplift 100 (lb) or less at joint(s) 10, 11, 12, 13
Max Grav All reactions 250 (lb) or less at joint(s) 10, 11, 12, 13

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13, 10, 12, 11.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.

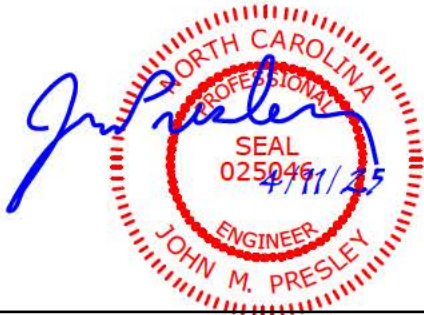

Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	C2	Truss	3	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:15

Page: 1

ID:LTAAED5HaN0kl36xsNqyx0ysX4S-CmSIIVjQvF0GfuV5jlnmXcrNF?jcJT8SDnpHWMzRtWY

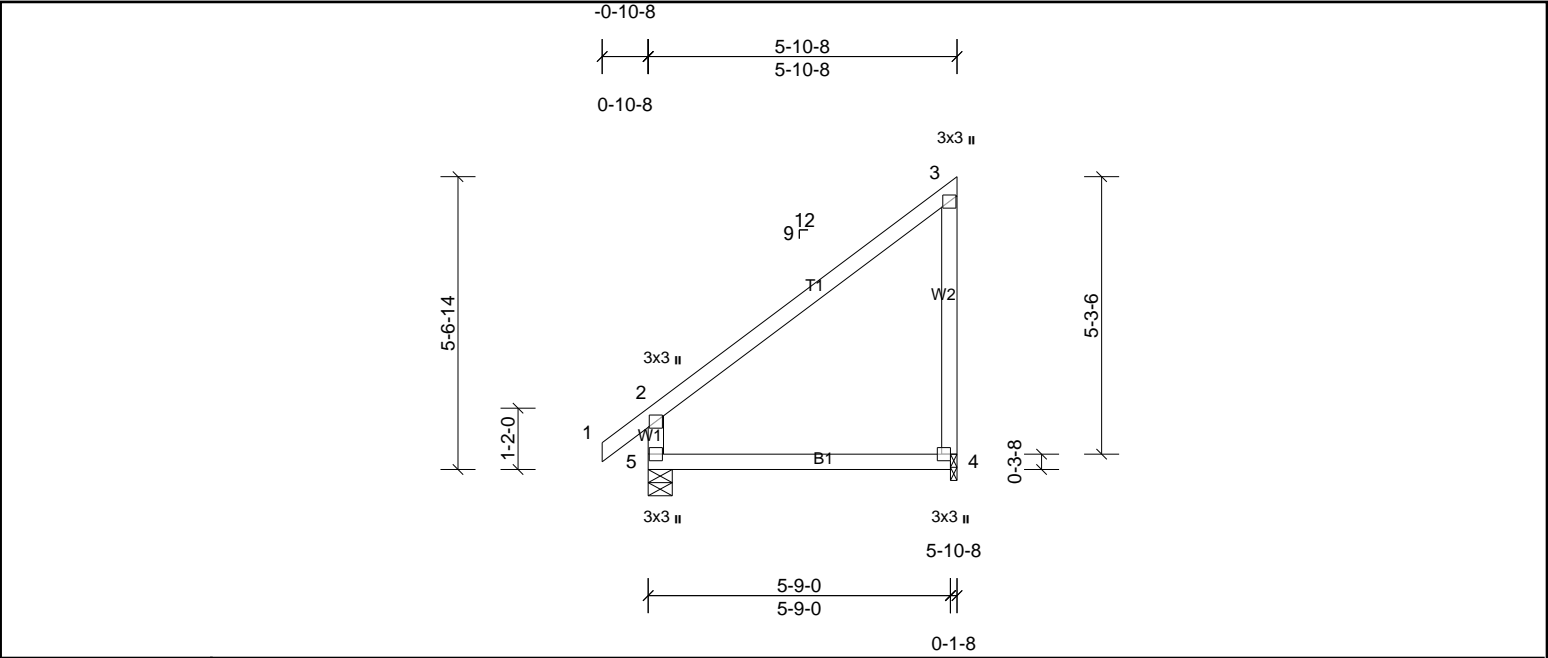


Plate Offsets (X, Y): [4:Edge,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	-0.04	4-5	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.30	Vert(CT)	-0.08	4-5	>807	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 30 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-10-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS	(lb/size)	4=218/0-1-8, (min. 0-1-8), 5=290/0-5-8, (min. 0-1-8)
	Max Horiz	5=214 (LC 9)
	Max Uplift	4=91 (LC 7), 5=24 (LC 10)
	Max Grav	4=265 (LC 17), 5=290 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 5 and 91 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job 72509811	Truss D1	Truss Type Truss	Qty 4	Ply 1	PBS/SELMA FRENCH COUNTRY RH RF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:15

Page: 1

ID:DyiEBTgkS1?LjIXf7GqffqyibU4-CmSIIVjQvF0GfuV5jlnmXcrLN?b7JlaSDnpHWMzRtWY

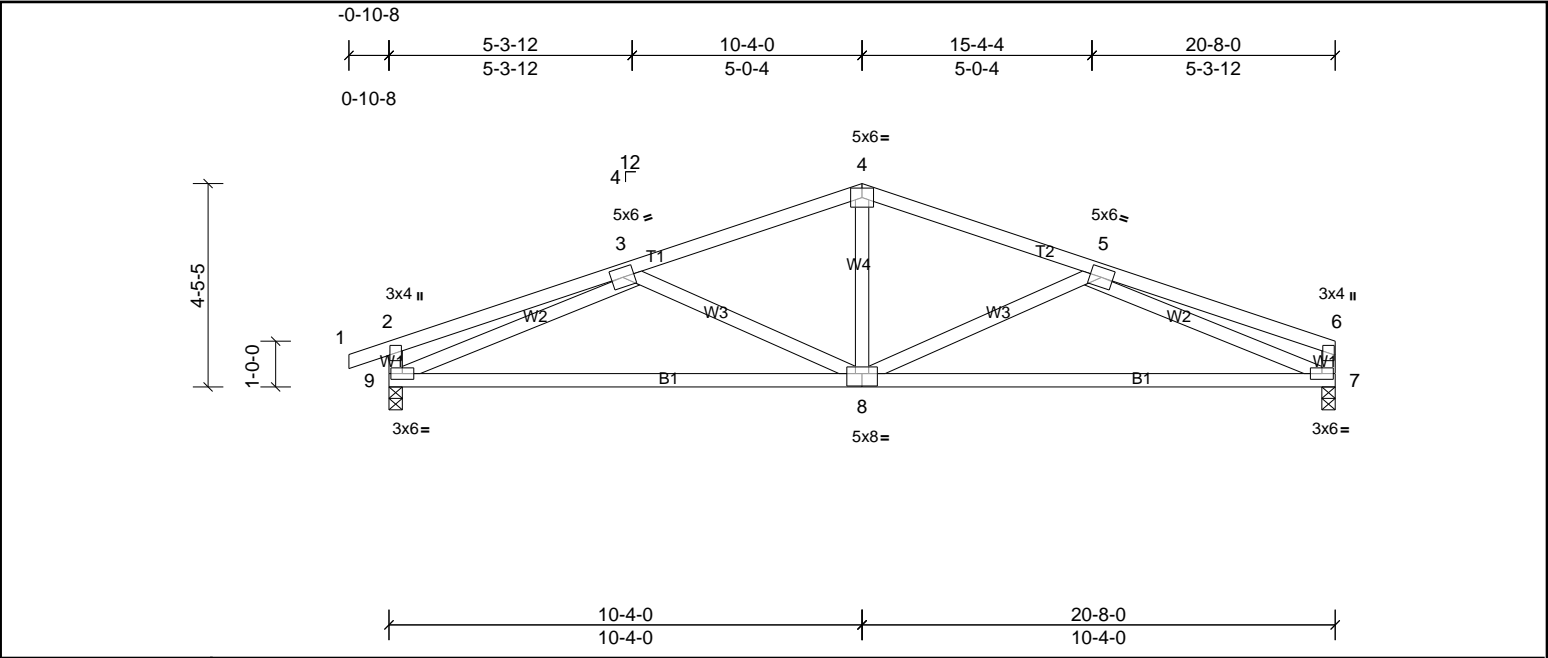


Plate Offsets (X, Y): [8:0-4-0,0-3-4]


Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.55	Vert(LL)	-0.19	8-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.78	Vert(CT)	-0.39	8-9	>621	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.74	Horz(CT)	0.04	7	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 105 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-10 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS	(lb/size)	7=813/0-3-8, (min. 0-1-8), 9=878/0-3-8, (min. 0-1-8)
	Max Horiz	9=46 (LC 14)
	Max Uplift	7=130 (LC 7), 9=173 (LC 6)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-331/85, 3-4=-1173/315, 4-5=-1174/315, 5-6=-296/59, 2-9=-307/165
BOT CHORD	8-9=-336/1267, 7-8=-343/1279
WEBS	3-9=-1109/364, 5-7=-1162/395, 4-8=-44/475, 3-8=-278/213, 5-8=-291/217

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00" tall by 2'-00"-00" wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 173 lb uplift at joint 9 and 130 lb uplift at joint 7.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

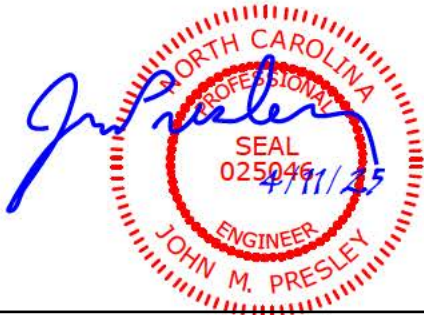

Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	D1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:16

Page: 1

ID:h8GcOpgNDK7CKR6shzLuC1yibU3-gy0gzrj3fY87H23HHTI?4qNcJP742wmbSRZq2pzRtWX

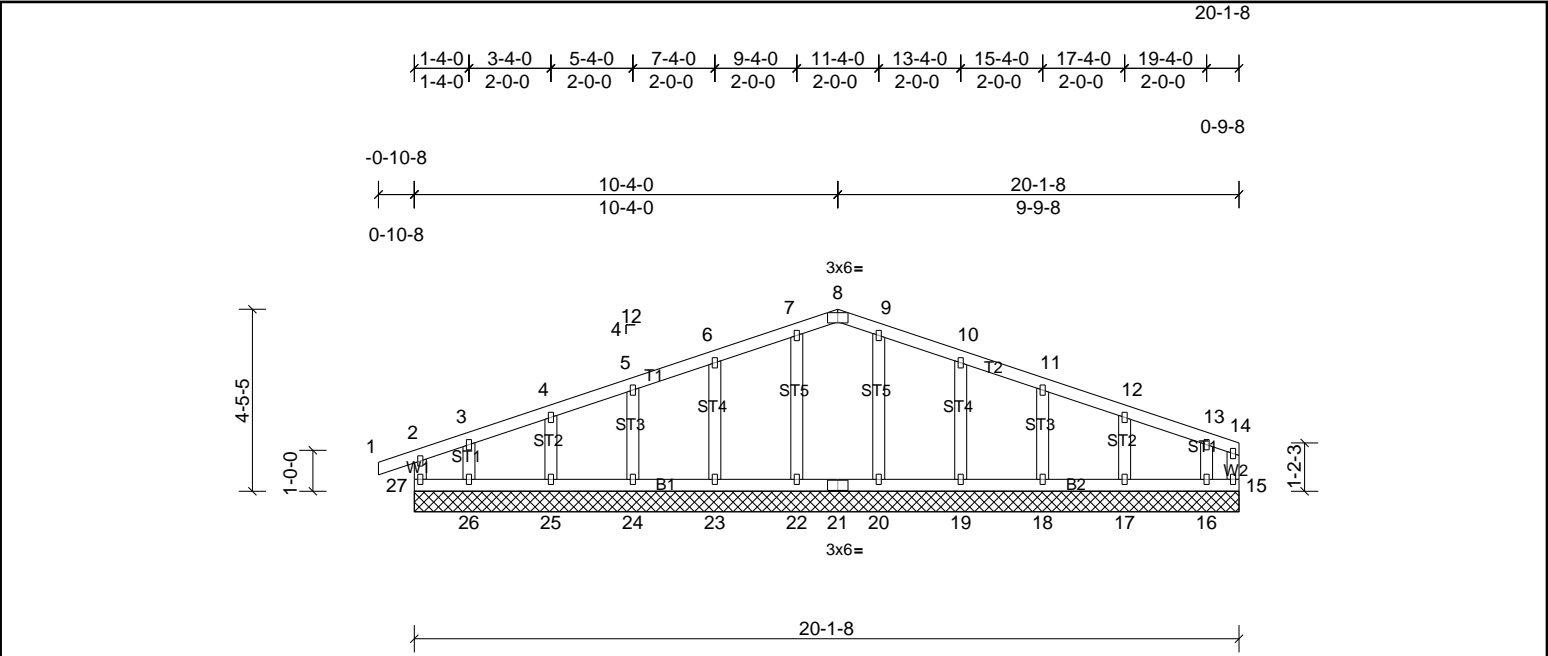


Plate Offsets (X, Y): [8:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	15	n/a	n/a	Weight: 98 lb
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS All bearings 20-1-8.
(lb) - Max Horiz 27=46 (LC 14)
Max Uplift All uplift 100 (lb) or less at joint(s) 15, 16, 17, 18, 19, 22, 23, 24, 25, 26, 27
Max Grav All reactions 250 (lb) or less at joint(s) 15, 16, 17, 18, 19, 20, 22, 23, 24, 25, 26, 27

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 1.5x3 (||) MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 27, 15, 22, 23, 24, 25, 26, 19, 18, 17, 16.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	E1	Truss	9	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:16

Page: 1

ID:mnThZmQwTbQ0U86m?azclhzSIFv-gy0gzrj3fY87H23HHTI?4qNXKP1_2p2bSRZq2pzRtWX

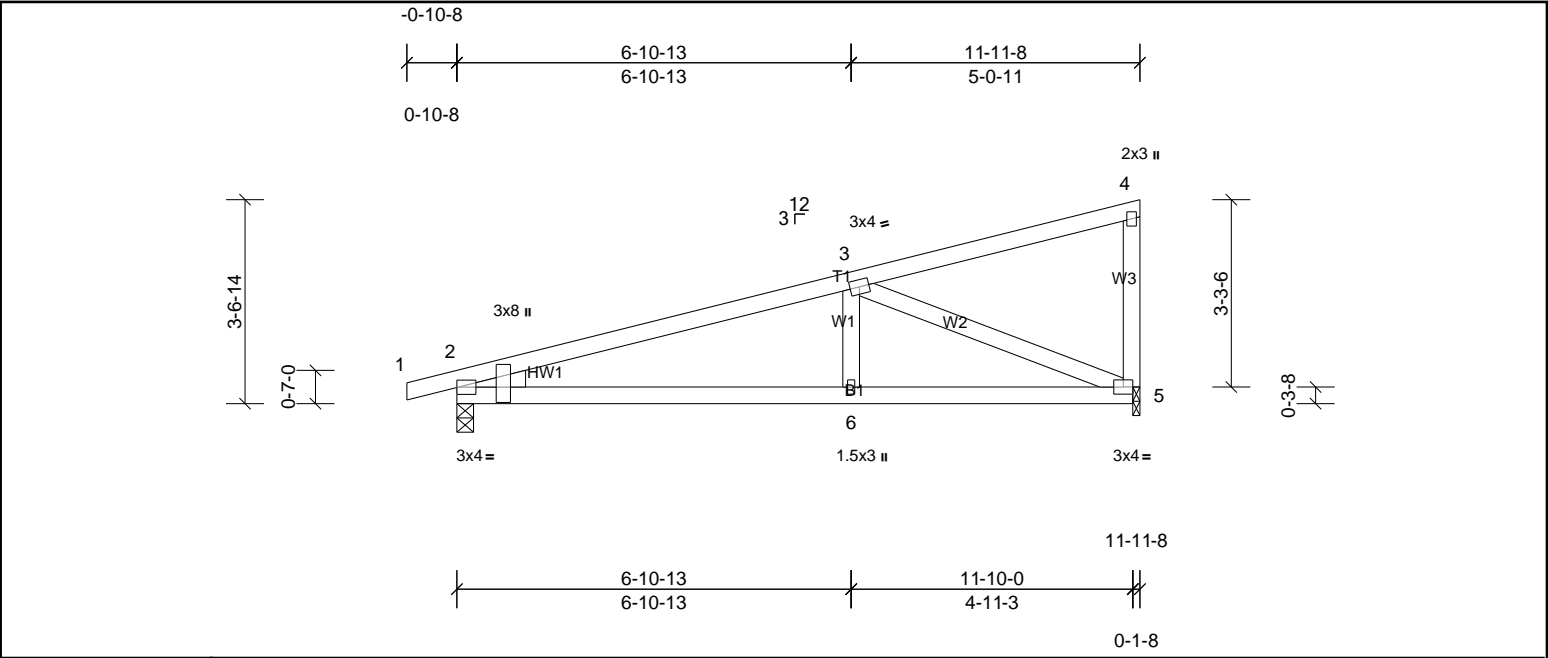


Plate Offsets (X, Y): [2:Edge,0-1-7], [2:0-3-2,0-8-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.41	Vert(LL)	0.11	6-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.10	6-9	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 53 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-9-2 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-1-5 oc bracing.
WEBS	2x4 SP No.3		
WEDGE	Left: 2x4 SP No.2		
REACTIONS	(lb/size)		
	2=527/0-3-8, (min. 0-1-8), 5=471/0-1-8, (min. 0-1-8)		
	Max Horiz 2=131 (LC 6)		
	Max Uplift 2=230 (LC 6), 5=227 (LC 6)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-865/765		
BOT CHORD	2-6=-838/805, 5-6=-838/805		
WEBS	3-6=-272/255, 3-5=-855/891		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 230 lb uplift at joint 2 and 227 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	E1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:16

Page: 1

ID:LUJzVYbiAuB1AIASeqWDuJezSIFh-gy0gzrj3fY87H23HHTI?4qNQcPxM2sObSRZq2pzRtWX

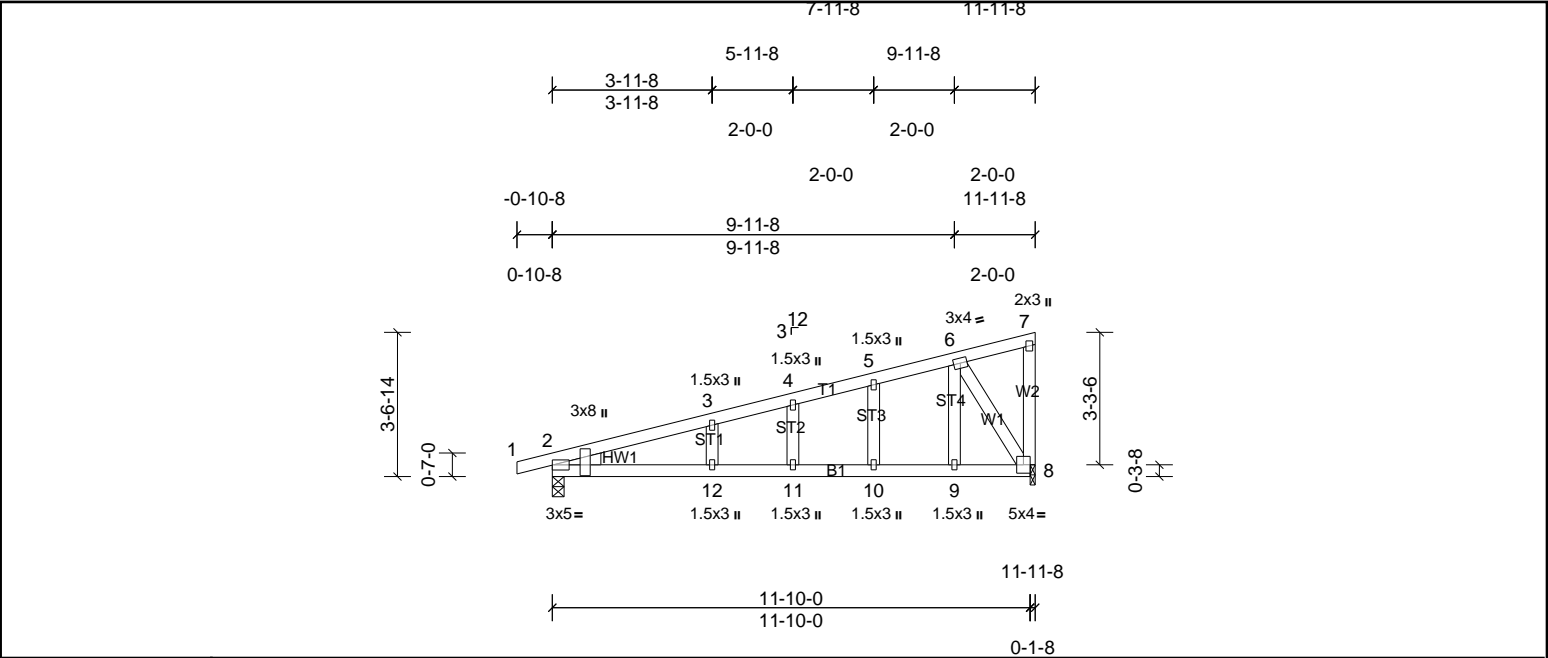


Plate Offsets (X, Y): [2:Edge,0-1-7], [2:0-3-2,0-8-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	0.44	11-12	>319	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.78	Vert(CT)	-0.47	11-12	>302	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.32	Horz(CT)	0.04	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 58 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-11-2 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1	BOT CHORD	Rigid ceiling directly applied or 6-9-8 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		
WEDGE	Left: 2x4 SP No.2		
REACTIONS	(lb/size)		
	2=527/0-3-8, (min. 0-1-8), 8=471/0-1-8, (min. 0-1-8)		
	Max Horiz 2=131 (LC 6)		
	Max Uplift 2=230 (LC 6), 8=227 (LC 6)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-594/484, 3-4=-569/491, 4-5=-554/500, 5-6=-531/506		
BOT CHORD	2-12=-567/546, 11-12=-567/546, 10-11=-567/546, 9-10=-567/546, 8-9=-567/546		
WEBS	6-9=-540/478, 6-8=-1022/1062		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 8.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 230 lb uplift at joint 2 and 227 lb uplift at joint 8.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	E2	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:17

Page: 1

ID: jtsifaVpyR5c7aFq4h3xjyzSIDD-88a3ABkhQsH_uCeUrApEd1wCpQVnNdlh5IObFzRtWW

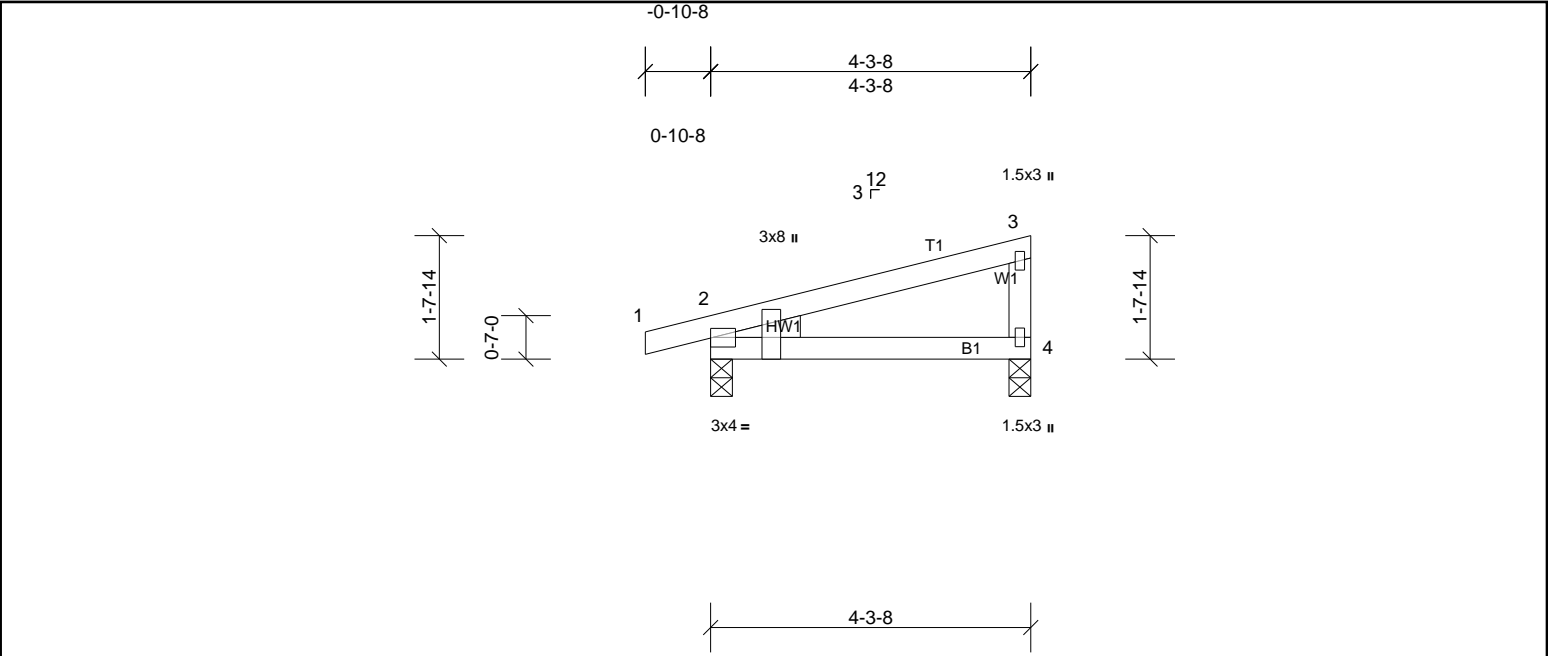


Plate Offsets (X, Y): [2:Edge,0-1-7], [2:0-3-6,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	0.03	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.03	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 18 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-3-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		
WEDGE	Left: 2x4 SP No.2		

REACTIONS	(lb/size)	2=224/0-3-8, (min. 0-1-8), 4=160/0-3-8, (min. 0-1-8)
	Max Horiz	2=54 (LC 6)
	Max Uplift	2=106 (LC 6), 4=79 (LC 6)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 79 lb uplift at joint 4 and 106 lb uplift at joint 2.
 - 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	V1	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:17


Page: 1

ID:a51rBrFFb48toMckMCLrd4ysXIS-88a3ABkhQsH_uCeUrApEd1wmfpSvnNlh5IObFzRtWW

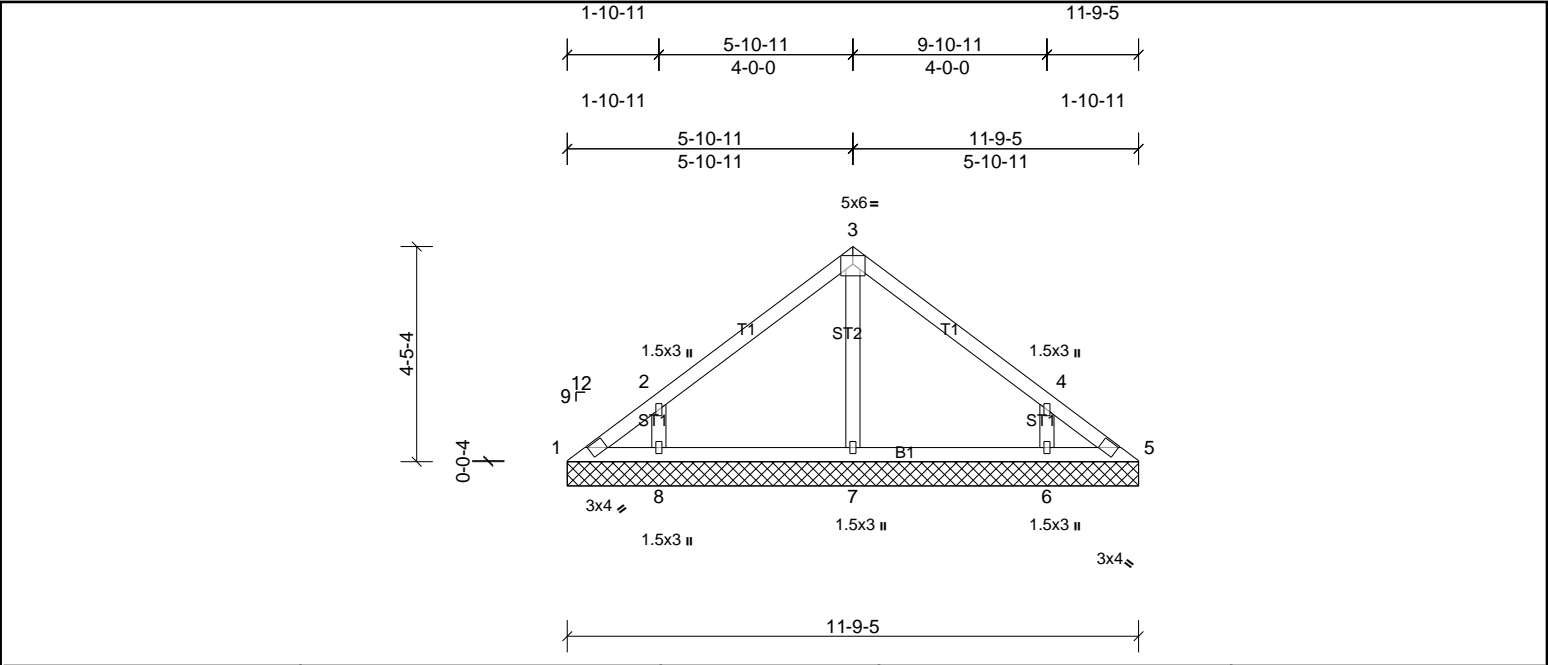


Loading	(psf)	Spacing	2'-0" 0"	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 46 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10'-0" oc bracing.
OTHERS	2x4 SP No.3		
REACTIONS			
	All bearings 11'-9".		
(lb) - Max Horiz	1=110 (LC 7)		
Max Uplift	All uplift 100 (lb) or less at joint(s) 1, 5 except 6=141 (LC 11), 8=144 (LC 10)		
Max Grav	All reactions 250 (lb) or less at joint(s) 1, 5, 7 except 6=322 (LC 18), 8=326 (LC 17)		
FORCES			
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
WEBS	2-8=281/210, 4-6=281/208		
NOTES			
1)	Unbalanced roof live loads have been considered for this design.		
2)	Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60		
3)	Gable requires continuous bottom chord bearing.		
4)	This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.		
5)	* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members.		
6)	Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=144, 6=140.		
7)	This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.		

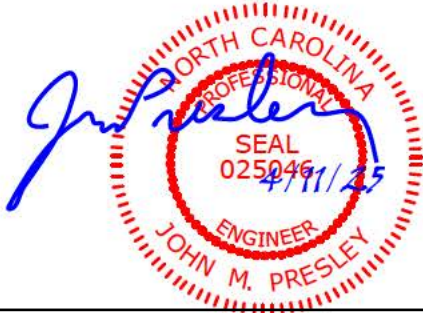


Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	V2	Truss	1	1	Job Reference (optional)

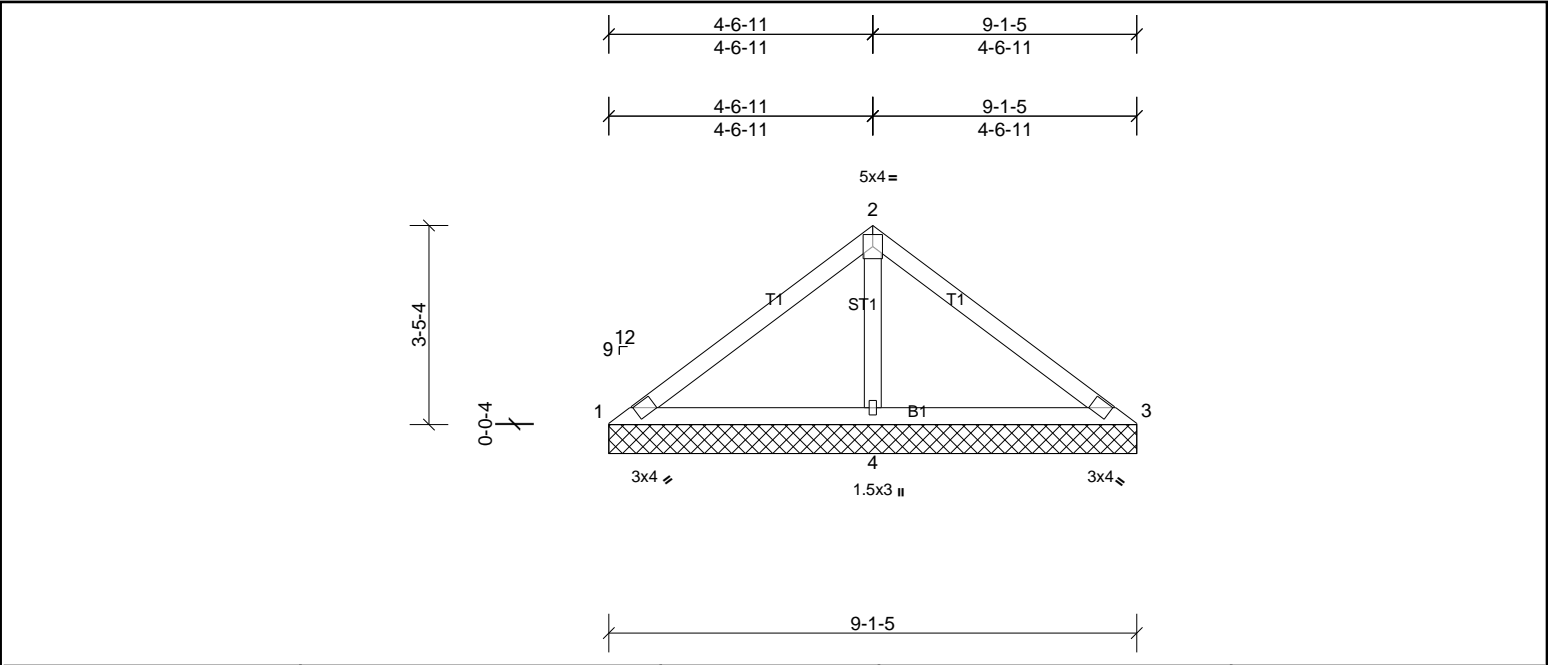

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.22	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 33 lb	FT = 20%

LUMBER			BRACING	
TOP CHORD	2x4 SP No.2		TOP CHORD	Structural wood sheathing directly applied or 9-1-5 oc purlins. Rigid ceiling directly applied or 6-0-0 oc bracing.
BOT CHORD	2x4 SP No.2		BOT CHORD	
OTHERS	2x4 SP No.3			
REACTIONS	(lb/size)	1=37/9-1-5, (min. 0-1-8), 3=37/9-1-5, (min. 0-1-8), 4=654/9-1-5, (min. 0-1-8)		
	Max Horiz	1=84 (LC 7)		
	Max Uplift	1=-18 (LC 22), 3=-18 (LC 21), 4=-112 (LC 10)		
	Max Grav	1=73 (LC 21), 3=73 (LC 22), 4=654 (LC 1)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.			
TOP CHORD	1-2=-83/281, 2-3=-83/281			
WEBS	2-4=-493/195			

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 1, 18 lb uplift at joint 3 and 112 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.

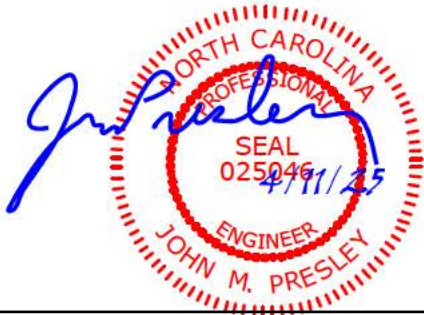

Job 72509811	Truss V4	Truss Type Truss	Qty 1	Ply 1	PBS\SELMA FRENCH COUNTRY RH RF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:18

Page: 1

ID:grwCZb8b?iaKpheQg777mysXDR-dL7ROXIJBAPrWMDgPuKT9FTwyDn2WoOuwI2x7hzRtWV

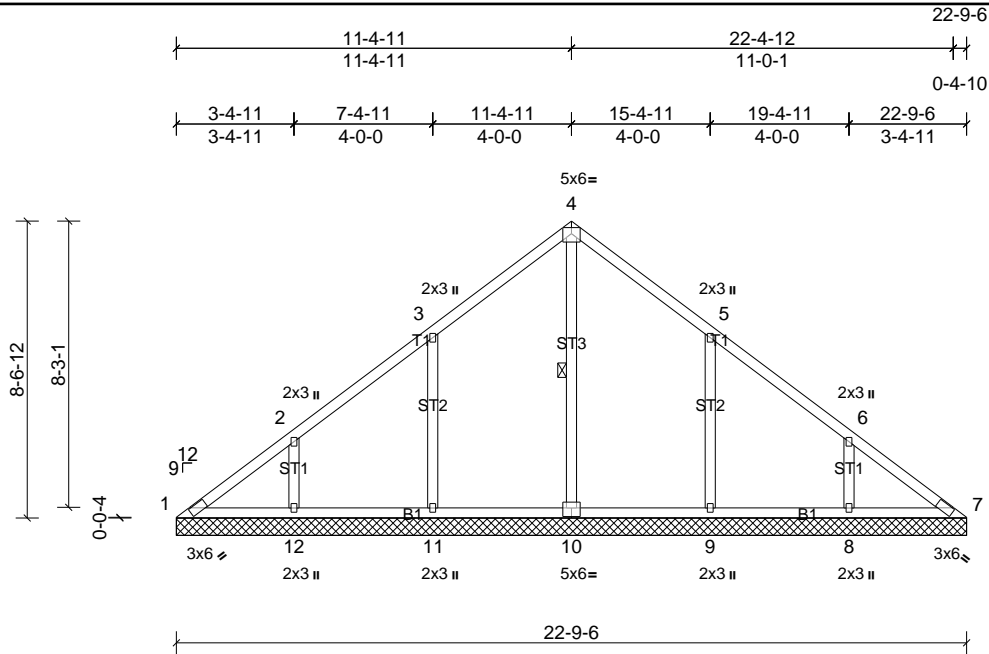


Plate Offsets (X, Y): [10:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.16	Horiz(TL)	0.01	7	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 107 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 4-10

REACTIONS

All bearings 22-9-6.
(lb) - Max Horiz 1=217 (LC 9)
Max Uplift All uplift 100 (lb) or less at joint(s) 1 except 8=136 (LC 11), 9=175 (LC 11), 11=175 (LC 10), 12=140 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 1, 7 except 8=337 (LC 18), 9=427 (LC 18), 10=449 (LC 20), 11=427 (LC 17), 12=341 (LC 17)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-11=298/225, 2-12=255/177, 5-9=298/225, 6-8=255/175

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 11=174, 12=139, 9=175, 8=136.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72509811	Truss V5	Truss Type Truss	Qty 1	Ply 1	PBS\SELMA FRENCH COUNTRY RH RF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:18

Page: 1

ID:ZcAjOzB62w4lJyBvz43lcysXDN-dL7ROXlJBAPrWMDgPuKT9FTwdDn2Wljwv12x7hzRtWV

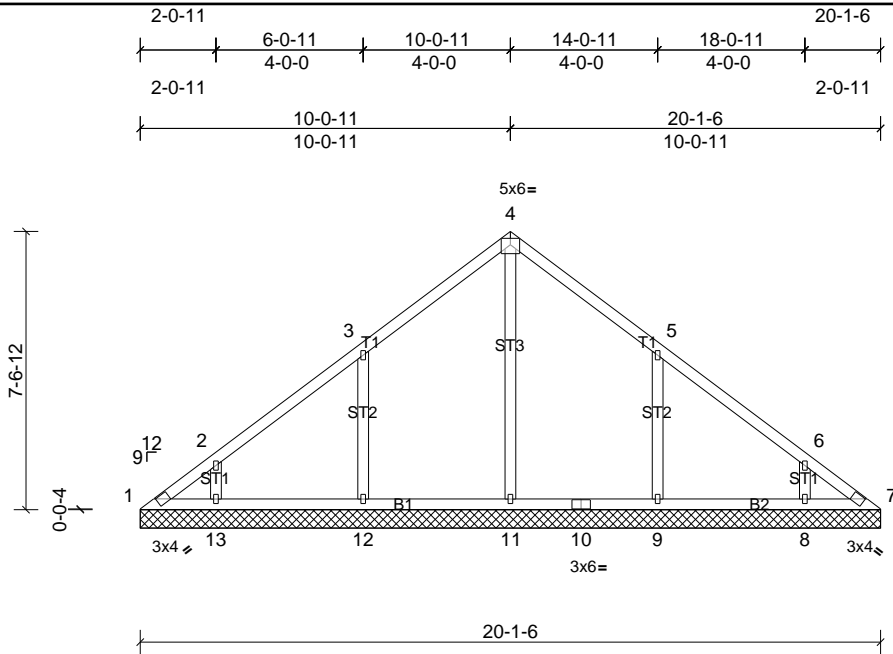

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.33	Horiz(TL)	0.00	7	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 91 lb
											FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

All bearings 20-1-6.
(lb) - Max Horiz 1=191 (LC 7)
Max Uplift All uplift 100 (lb) or less at joint(s) 1, 7, 8 except 9=190 (LC 11), 12=179 (LC 10), 13=114 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 1 except 8=293 (LC 1), 9=433 (LC 18), 11=549 (LC 20), 12=440 (LC 17), 13=265 (LC 17)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=171/267
WEBS 4-11=-331/0, 3-12=-303/226, 5-9=-302/231

NOTES


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 1.5x3 (||) MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 8 except (jt=lb) 12=178, 13=113, 9=190.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:19 Page: 1
ID:zBrr1?E_LrSK9mhma5dmwEysXDK-5XhpbtmxyTXh8WosybriIS?4bd56FFA18PnUf8zRtWU

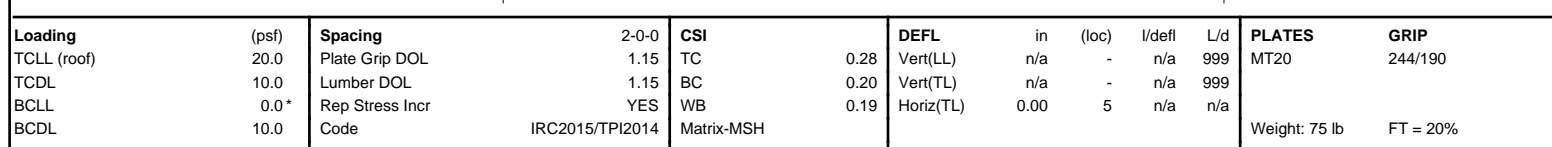

REACTIONS	
	All bearings 17-5-6.
(lb) - Max Horiz	1=165 (LC 7)
Max Uplift	All uplift 100 (lb) or less at joint(s) 1 except 6=201 (LC 11), 9=200 (LC 10)
Max Grav	All reactions 250 (lb) or less at joint(s) 1, 5 except 6=470 (LC 18), 8=444 (LC 17), 9=488 (LC 17)

NOTES

-

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.


Job	Truss	Truss Type	Qty	Ply	PBS/SELMA FRENCH COUNTRY RH RF
72509811	V7	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:19

Page: 1

ID:K9fk4IH7AO5dFXZkNeDxdlysXDF-5XhpbtxyTXh8WosybriiS?5id7XFF618PnUf8zRtWU

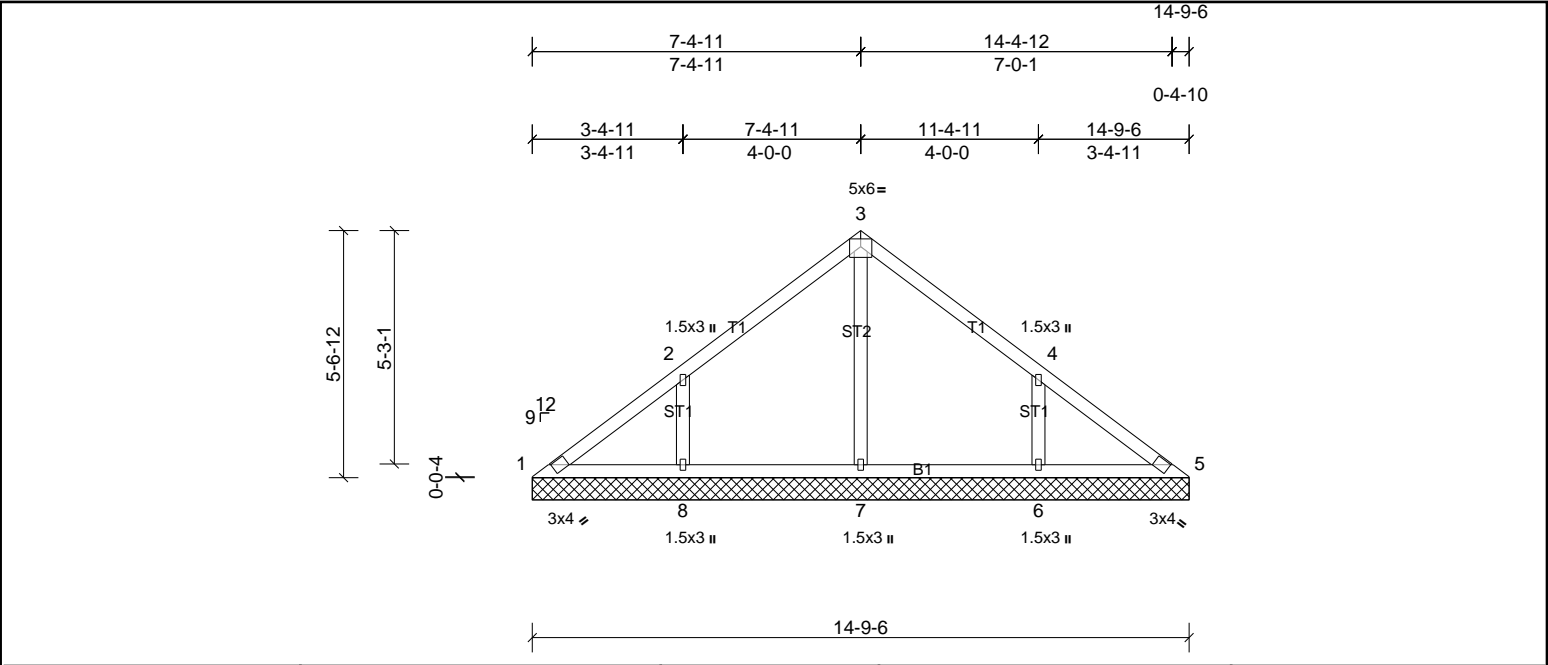


Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 61 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS	All bearings 14-9-6.
(lb) - Max Horiz	1=-139 (LC 8)
Max Uplift	All uplift 100 (lb) or less at joint(s) 1 except 6=-164 (LC 11), 8=-167 (LC 10)
Max Grav	All reactions 250 (lb) or less at joint(s) 1, 5 except 6=373 (LC 18), 7=310 (LC 1), 8=376 (LC 17)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS	2-8=-284/203, 4-6=-284/202

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=166, 6=164.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

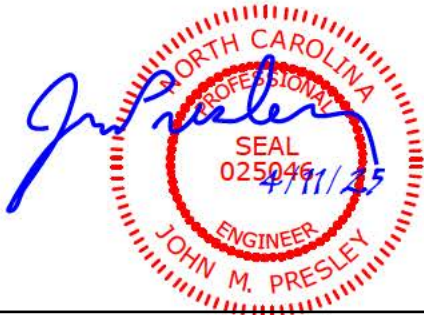


Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	V8	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:19

Page: 1

ID:g6Sd7PLG_wjvLIshABp6JLysXDA-5XhpbtmxyTXh8WosybriiS?69d7NFHC18PnUf8zRtWU

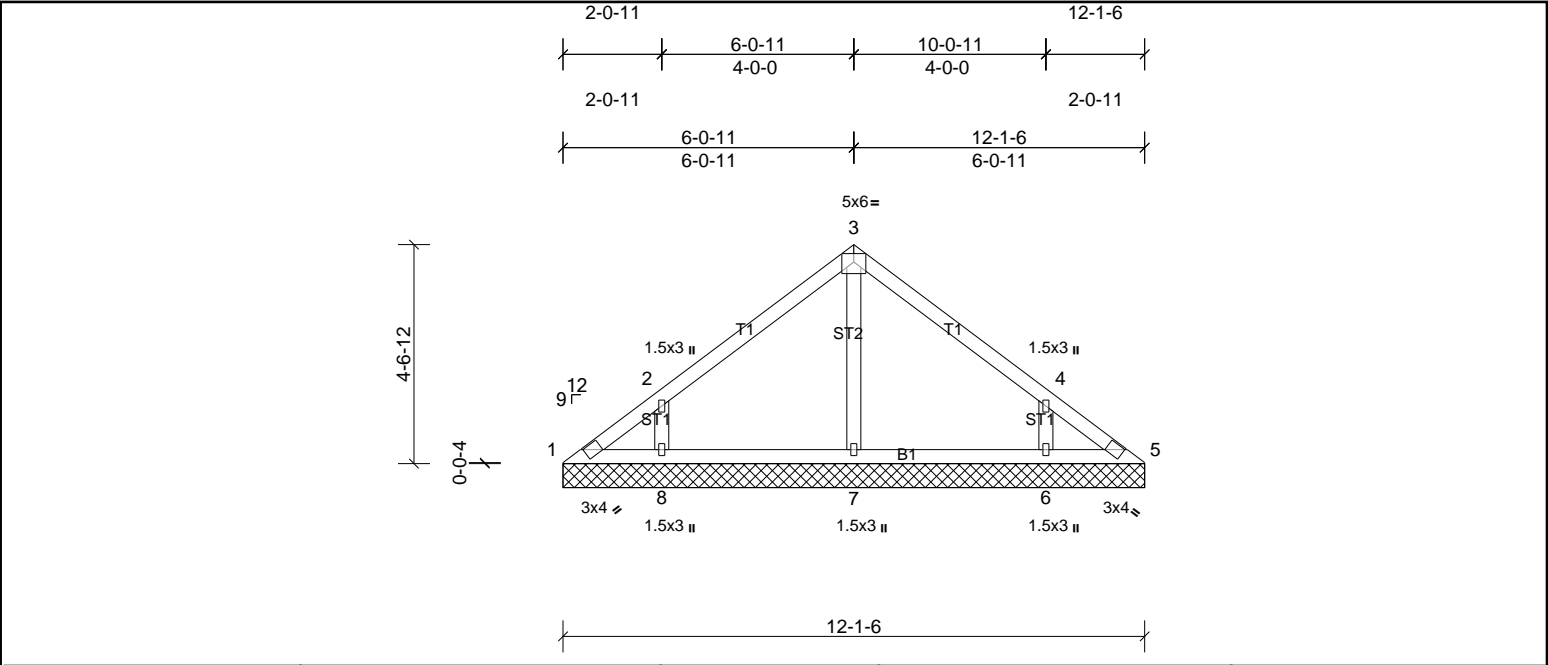


Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 48 lb
											FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3		

REACTIONS	All bearings 12-1-6.
(lb) - Max Horiz	1=113 (LC 7)
Max Uplift	All uplift 100 (lb) or less at joint(s) 1, 5 except 6=142 (LC 11), 8=145 (LC 10)
Max Grav	All reactions 250 (lb) or less at joint(s) 1, 5 except 6=325 (LC 18), 7=253 (LC 1), 8=328 (LC 17)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS	2-8=275/203, 4-6=275/202

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=145, 6=142.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

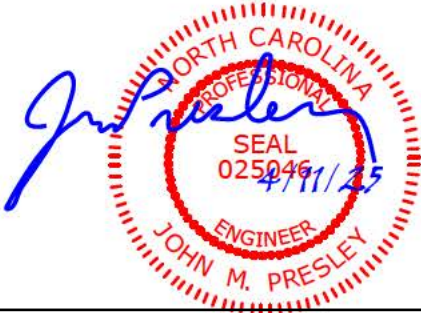


Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	V9	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:20

Page: 1

ID:Zuh8znOm29DLqwlSP1t2UBysXD6-ZjFBoDnZjnfYlgN3WJMxEgYEY0Qy_hQBN3X2BazRtWT

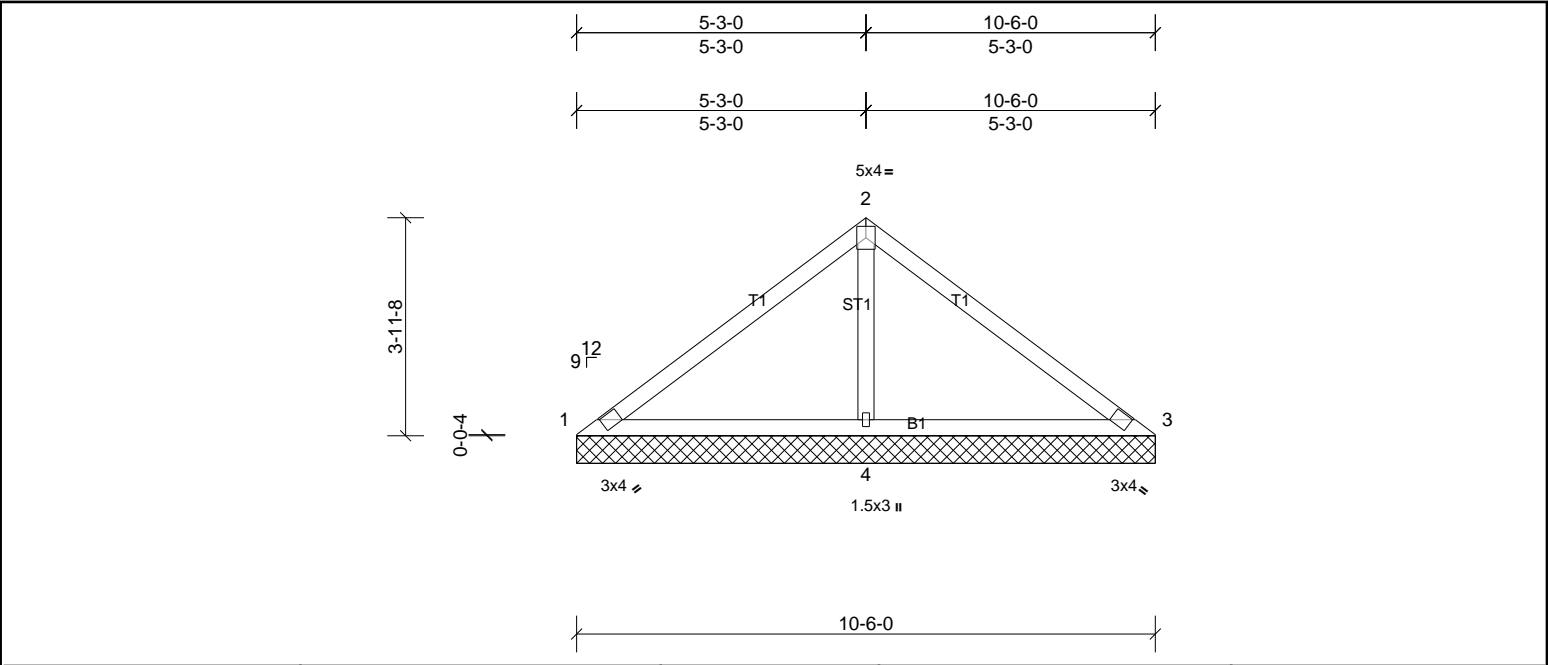

Loading	(psf)	Spacing	2'-0"	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.29	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.19	Horiz(TL)	0.00	3	n/a	n/a	Weight: 39 lb
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 10'-0"-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6'-0"-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS	(lb/size)	1=19/10'-6"-0, (min. 0'-1'-8), 3=19/10'-6"-0, (min. 0'-1'-8), 4=802/10'-6"-0, (min. 0'-1'-8)
	Max Horiz	1=98 (LC 6)
	Max Uplift	1=39 (LC 22), 3=39 (LC 21), 4=145 (LC 10)
	Max Grav	1=66 (LC 21), 3=66 (LC 22), 4=802 (LC 1)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-116/366, 2-3=-116/366
BOT CHORD	1-4=-301/167, 3-4=-301/167
WEBS	2-4=-622/247

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0"-0 tall by 2'-0"-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 39 lb uplift at joint 1, 39 lb uplift at joint 3 and 145 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	V10	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.83 S Mar 20 2025 Print: 8.830 S Mar 20 2025 MiTek Industries, Inc. Fri Apr 11 07:09:20

Page: 1

ID:zTNGbpRfL4bwhNU149Rl6qysXD3-ZjFBoDnZjnfYlgN3WJMxEgYlr0Sp_jwBN3X2BazRtWT

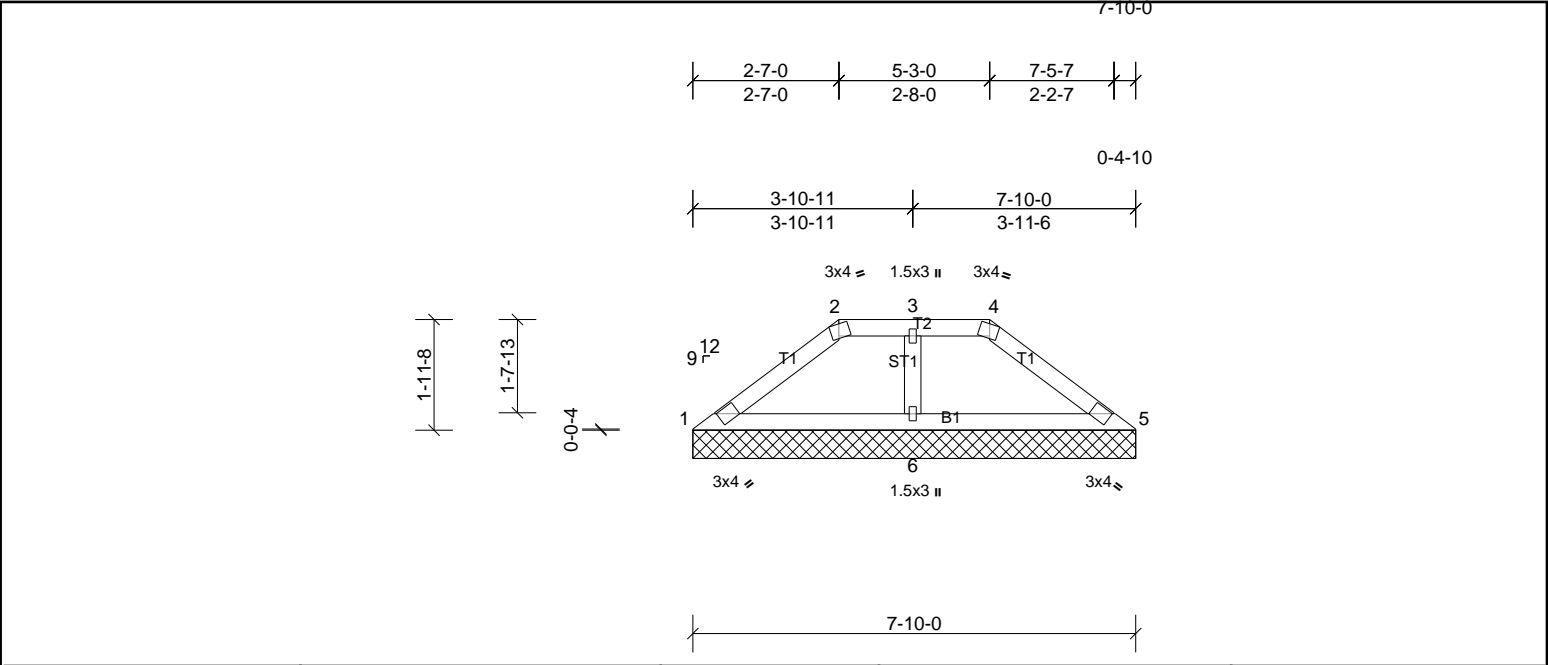

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 26 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except
BOT CHORD 2x4 SP No.2	2-0-0 oc purlins (6-0-0 max.): 2-4.
OTHERS 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(lb/size)	1=167/7-10-0, (min. 0-1-8), 5=169/7-10-0, (min. 0-1-8), 6=292/7-10-0, (min. 0-1-8)
	Max Horiz	1=-47 (LC 6)
	Max Uplift	1=-30 (LC 10), 5=-35 (LC 11), 6=-3 (LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 4-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 1, 35 lb uplift at joint 5 and 3 lb uplift at joint 6.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job	Truss	Truss Type	Qty	Ply	PBS/SELMA FRENCH COUNTRY RH RF
72509811	V11	Truss	1	1	Job Reference (optional)

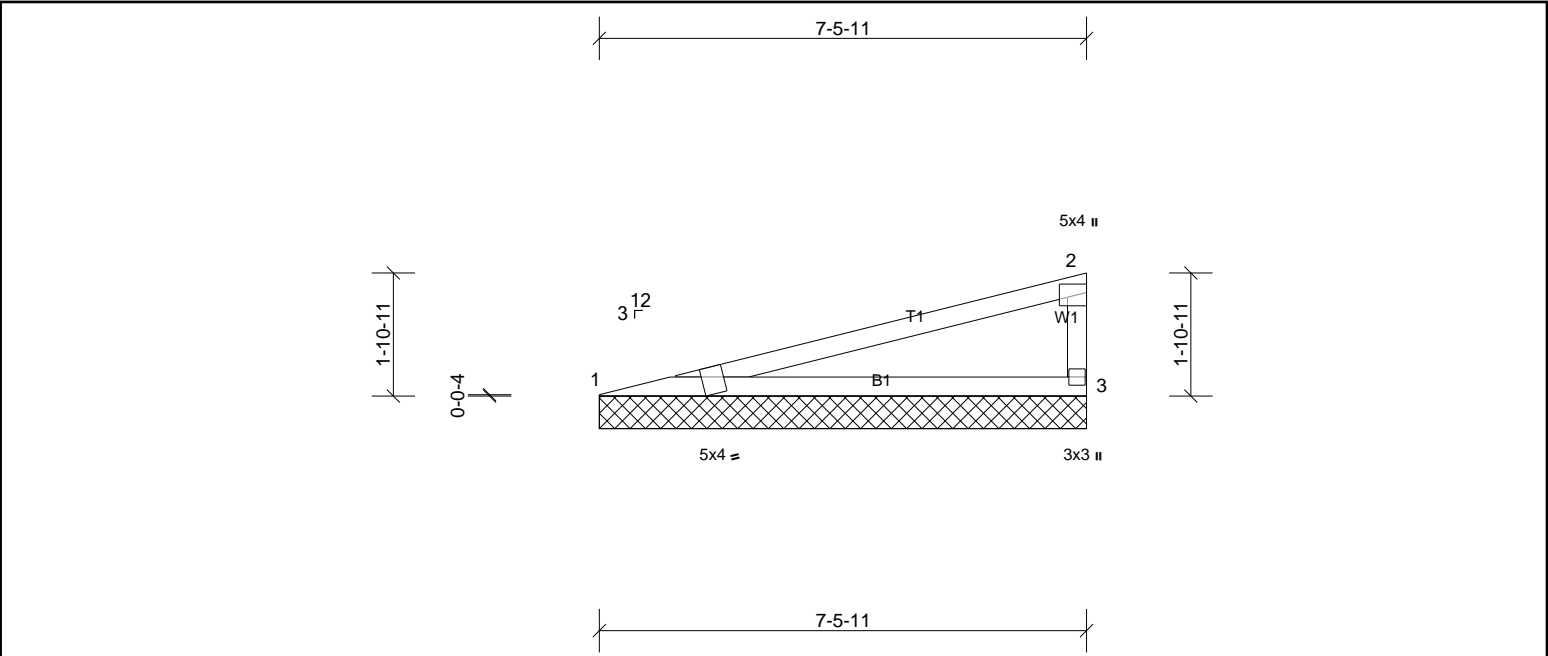


Plate Offsets (X, Y):		[1:0-4-9,Edge]										
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.75	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.02	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 23 lb	FT = 20%

LUMBER			BRACING		
TOP CHORD	2x4 SP No.2		TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD	2x4 SP No.2		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS	2x4 SP No.3				


REACTIONS	(lb/size)	1=293/7-5-11, (min. 0-1-8), 3=293/7-5-11, (min. 0-1-8)
	Max Horiz	1=70 (LC 7)
	Max Uplift	1=56 (LC 6), 3=64 (LC 10)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-882/342
BOT CHORD	1-3=-354/849

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 3 and 56 lb uplift at joint 1.
 - 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	PBS\SELMA FRENCH COUNTRY RH RF
72509811	V12	Truss	1	1	Job Reference (optional)

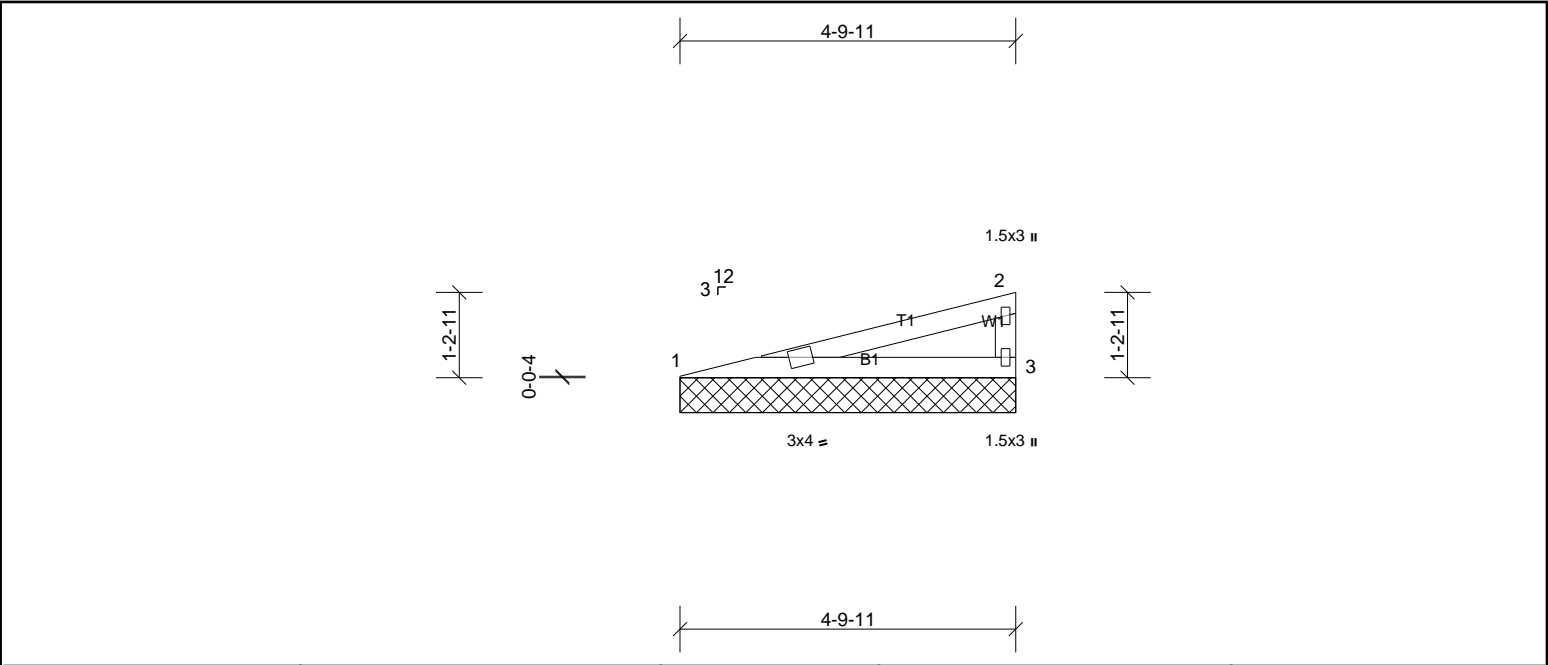

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.30	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							
										Weight: 14 lb	FT = 20%

LUMBER			BRACING		
TOP CHORD	2x4 SP No.2		TOP CHORD	Structural wood sheathing directly applied or 4-9-11 oc purlins, except end verticals.	
BOT CHORD	2x4 SP No.2		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS	2x4 SP No.3				
REACTIONS	(lb/size)	1=186/4-9-11, (min. 0-1-8), 3=186/4-9-11, (min. 0-1-8)			
	Max Horiz	1=42 (LC 7)			
	Max Uplift	1=36 (LC 6), 3=41 (LC 10)			
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.				
TOP CHORD	1-2=-464/202				
BOT CHORD	1-3=-210/444				

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 41 lb uplift at joint 3 and 36 lb uplift at joint 1.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.

