


Job 72436773	Truss F200	Truss Type Truss	Qty 4	Ply 1	MUNGO HOMES - MCDOWELL C 2ND FLR 31 LDP Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:19

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-mhhi?8BFmMfgZygkxlujeiQJSJ7_DsTH9rOwJyKyFgMg

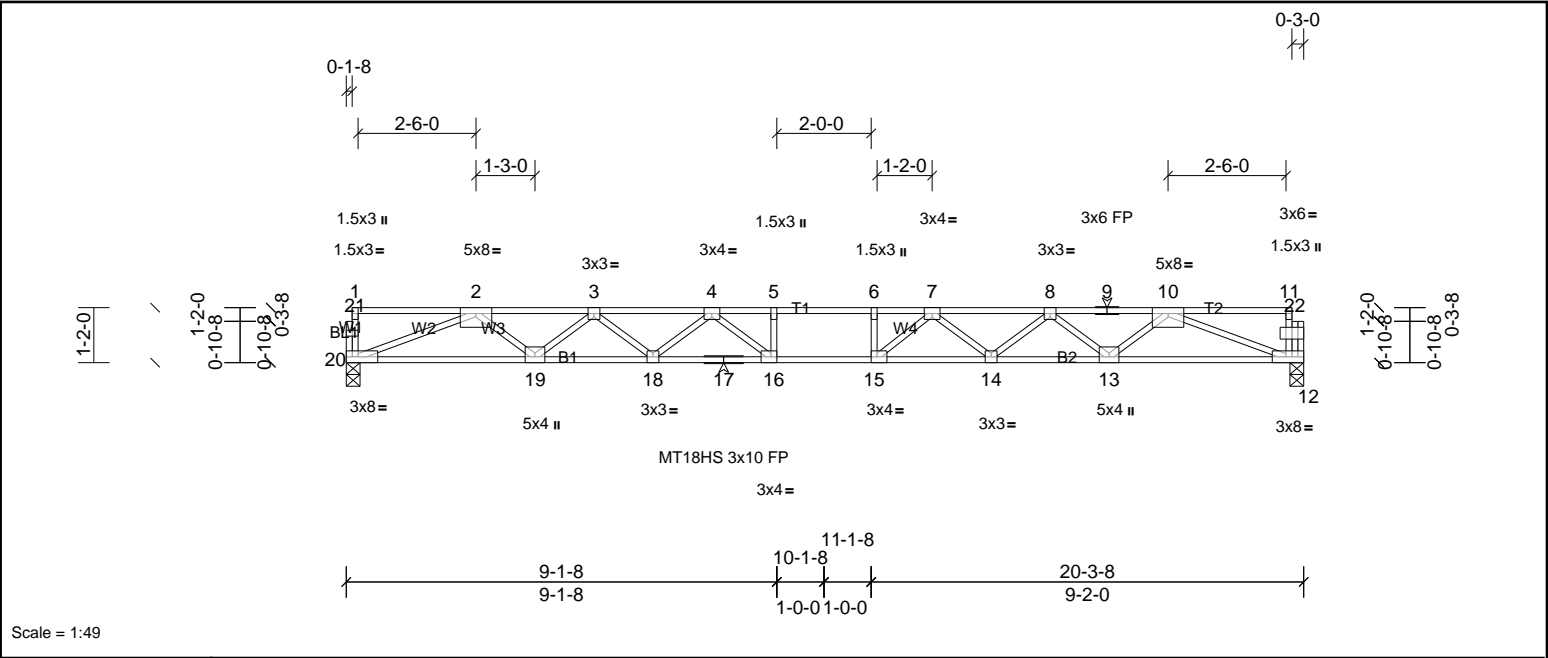

Scale = 1:49


Plate Offsets (X, Y): [12:0-3-8,Edge], [15:0-1-8,Edge], [16:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.46	15-16	>527	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.63	15-16	>383	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.10	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 99 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	12=1086/0-3-8, (min. 0-1-8), 20=1093/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3267/0, 3-4=-4529/0, 4-5=-5213/0, 5-6=-5213/0, 6-7=-5213/0, 7-8=-4551/0, 8-9=-3307/0, 9-10=-3307/0	
BOT CHORD	19-20=0/2442, 18-19=0/4050, 17-18=0/4980, 16-17=0/4980, 15-16=0/5213, 14-15=0/4996, 13-14=0/4081, 12-13=0/2489	
WEBS	5-16=-309/11, 6-15=-319/20, 2-20=-2620/0, 2-19=0/1074, 3-19=-1019/0, 3-18=0/624, 4-18=-588/0, 4-16=-151/704, 10-12=-2656/0, 10-13=0/1064, 8-13=-1008/0, 8-14=0/612, 7-14=-579/0, 7-15=-161/695	

- NOTES
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

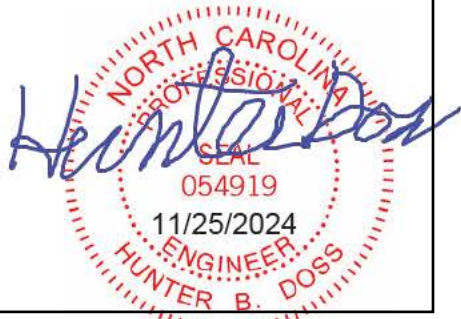


Job 72436773	Truss F201	Truss Type Truss	Qty 5	Ply 1	MUNGO HOMES - MCDOWELL C 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:19

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-mhhi?8BFmMfgZygkxlujeiQSt7yssRx9rOwJyKyFgMg

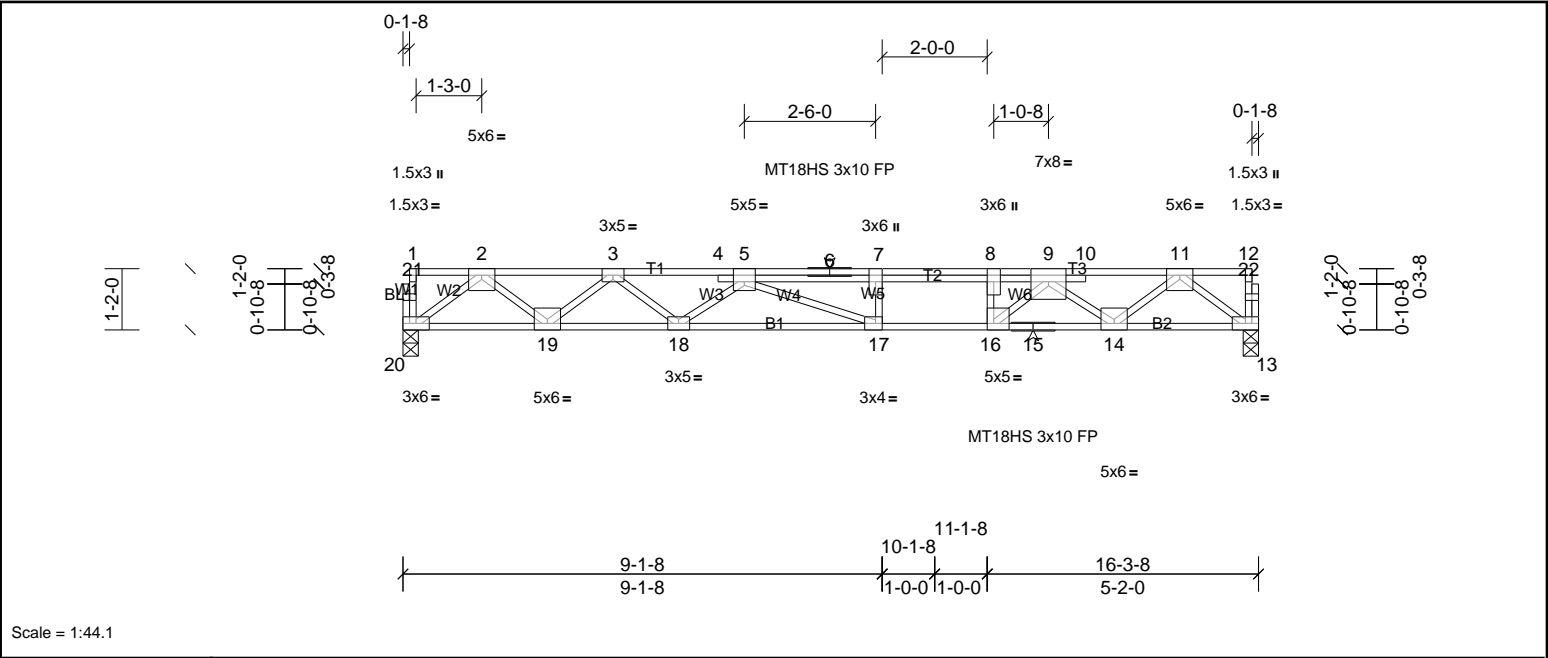

Scale = 1:44.1

Plate Offsets (X, Y):	[5:0-2-8,Edge], [8:0-3-0,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]
-----------------------	--


Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.72	Vert(LL)	-0.21	17-18	>923	480	MT18HS	244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.81	Vert(CT)	-0.46	17-18	>422	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.88	Horz(CT)	0.07	13	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 90 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP SS(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-7-14 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	13=1322/0-3-8, (min. 0-1-8), 20=1294/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2720/0, 3-4=-4533/0, 4-5=-4531/0, 5-6=-5301/0, 6-7=-5301/0, 7-8=-5301/0, 8-9=-5301/0, 9-10=-2814/0, 10-11=-2807/0	
BOT CHORD	19-20=0/1631, 18-19=0/3789, 17-18=0/5255, 16-17=0/5301, 15-16=0/4057, 14-15=0/4057, 13-14=0/1644	
WEBS	8-16=-1106/0, 2-20=-2042/0, 2-19=0/1418, 3-19=-1392/0, 3-18=0/969, 5-18=-916/0, 5-17=-199/508, 11-13=-2058/0, 11-14=0/1513, 9-14=-1588/0, 9-16=0/1840	

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 4) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.


LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 13-20=-10, 1-4=-140, 4-9=-176, 9-12=-140

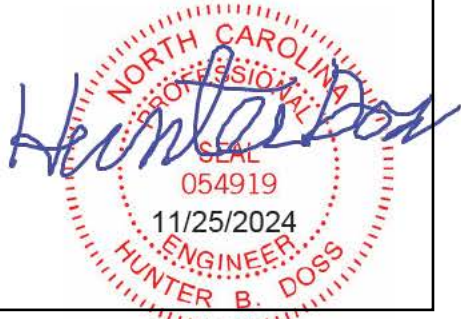

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:19 Page: 1
ID:g6xmDaGgGpr4T8wcGw4bQWzKH9V-mhhi?8BFmMfgZygkxlujeiQOx7_AsT59rOwJyKyfGmQ



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-9-4 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size) 12=1000/ Mechanical, (min. 0-1-8), 18=973/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2055/0, 3-4=-3470/0, 4-5=-3477/0, 5-6=-3974/0, 6-7=-3974/0, 7-8=-3974/0, 8-9=-2140/0, 9-10=-2136/0
BOT CHORD	17-18=0/1227, 16-17=0/2864, 15-16=0/4043, 14-15=0/3974, 13-14=0/3110, 12-13=0/1241
WEBS	7-14=-1071/0, 2-18=-1537/0, 2-17=0/1078, 3-17=-1053/0, 3-16=0/789, 5-16=-728/0, 5-15=-296/415, 10-12=-1553/0, 10-13=0/1166, 8-13=-1237/0, 8-14=0/1550

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 3) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.


LOAD CASE(S) Standard

1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (lb/ft)
Vert: 12-18=-10, 1-4=-100, 4-8=-140, 8-11=-100



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:19 Page: 1
ID:g6xmDaGgPr4T8wcGw4bQWzKH9V-mhhi?8BFmMfgZygkxlujeiQSK7_FsTa9rOwJyKyGfMg



LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-0-15 oc purlins, except end verticals. Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD	2x4 SP SS(flat)		
WEBS	2x4 SP No.3(flat)	BOT CHORD	
OTHERS	2x4 SP No.3(flat)		

NOTES

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL C 2ND FLR
72436773	F204	Truss	4	1	Job Reference (optional)

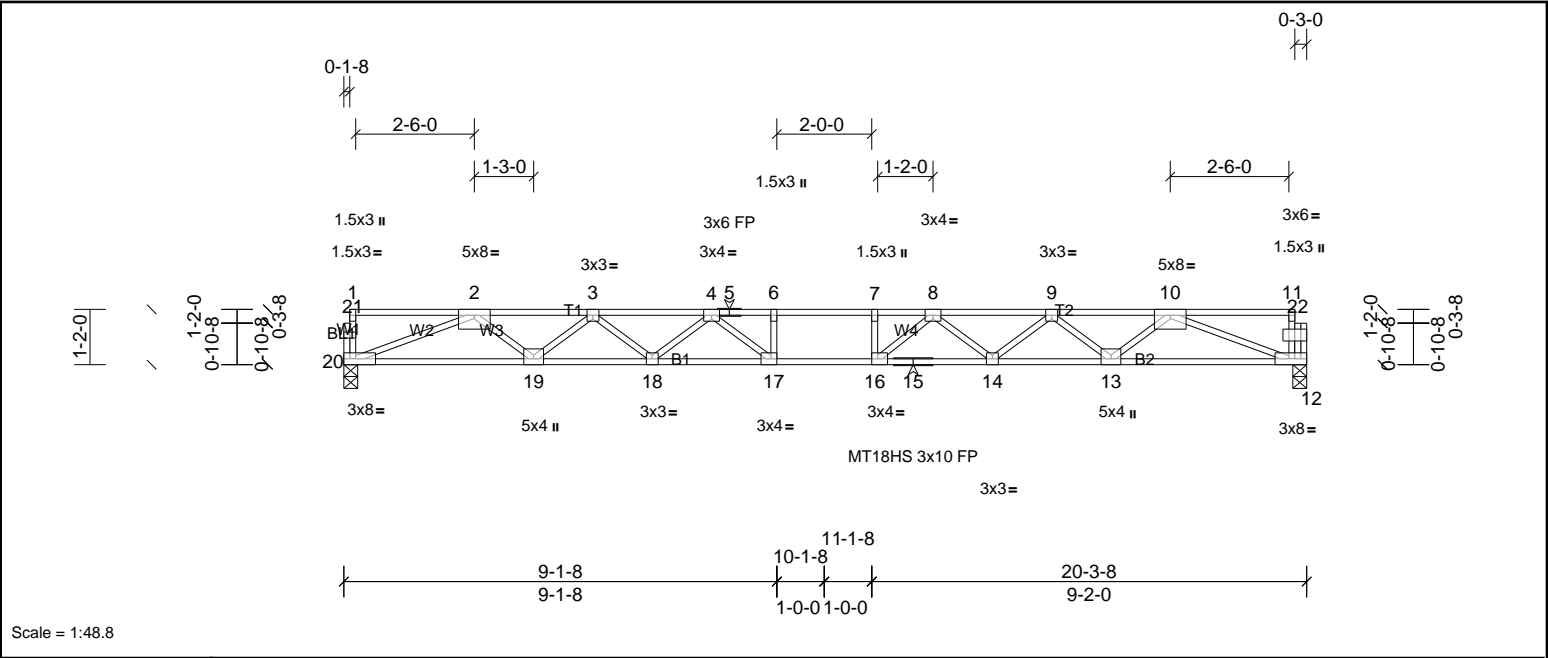



Plate Offsets (X, Y): [12:0-3-8,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.46	16-17	>527	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.63	16-17	>383	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.10	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 99 lb	FT = 20%F, 12%E


LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	12=1086/0-3-8, (min. 0-1-8), 20=1093/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3267/0, 3-4=-4529/0, 4-5=-5213/0, 5-6=-5213/0, 6-7=-5213/0, 7-8=-5213/0, 8-9=-4551/0, 9-10=-3307/0	
BOT CHORD	19-20=0/2442, 18-19=0/4050, 17-18=0/4980, 16-17=0/5213, 15-16=0/4996, 14-15=0/4996, 13-14=0/4081, 12-13=0/2489	
WEBS	6-17=-309/11, 7-16=-319/20, 2-20=-2620/0, 2-19=0/1074, 3-19=-1019/0, 3-18=0/624, 4-18=-588/0, 4-17=-151/704, 10-12=-2656/0, 10-13=0/1064, 9-13=-1008/0, 9-14=0/612, 8-14=-579/0, 8-16=-161/695	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

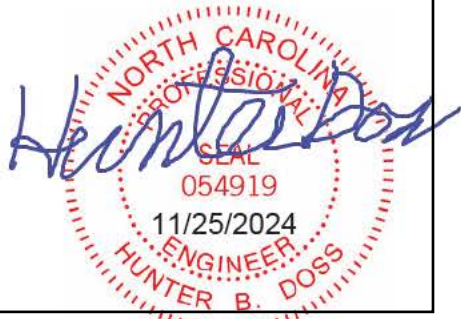


UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:20 Page: 1
ID:g6xmDaGgGpr4T8wcGw4bQWzKH9V-EtF5DUCtXgnXA6Fv?PyAvzn7XT5b5xl42fsUnyFgM



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-3-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		
REACTIONS	(lb/size)	5=216/0-3-8, (min. 0-1-8), 8=216/0-3-8, (min. 0-1-8)	
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
WEBS	3-5=-258/0, 2-8=-258/0		

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

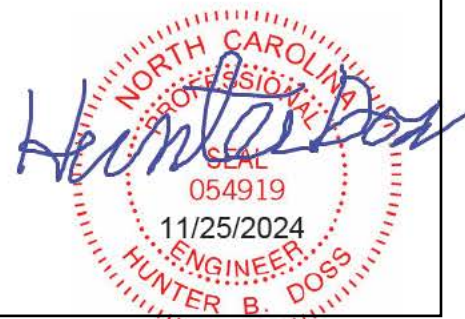

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72436773	Truss F206	Truss Type Truss	Qty 16	Ply 1	MUNGO HOMES - MCDOWELL C 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	-----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:20

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-EtF5DUCtXgnXA6FxFV?PyAvzcsXIgbu?I42fsUnyFgMf

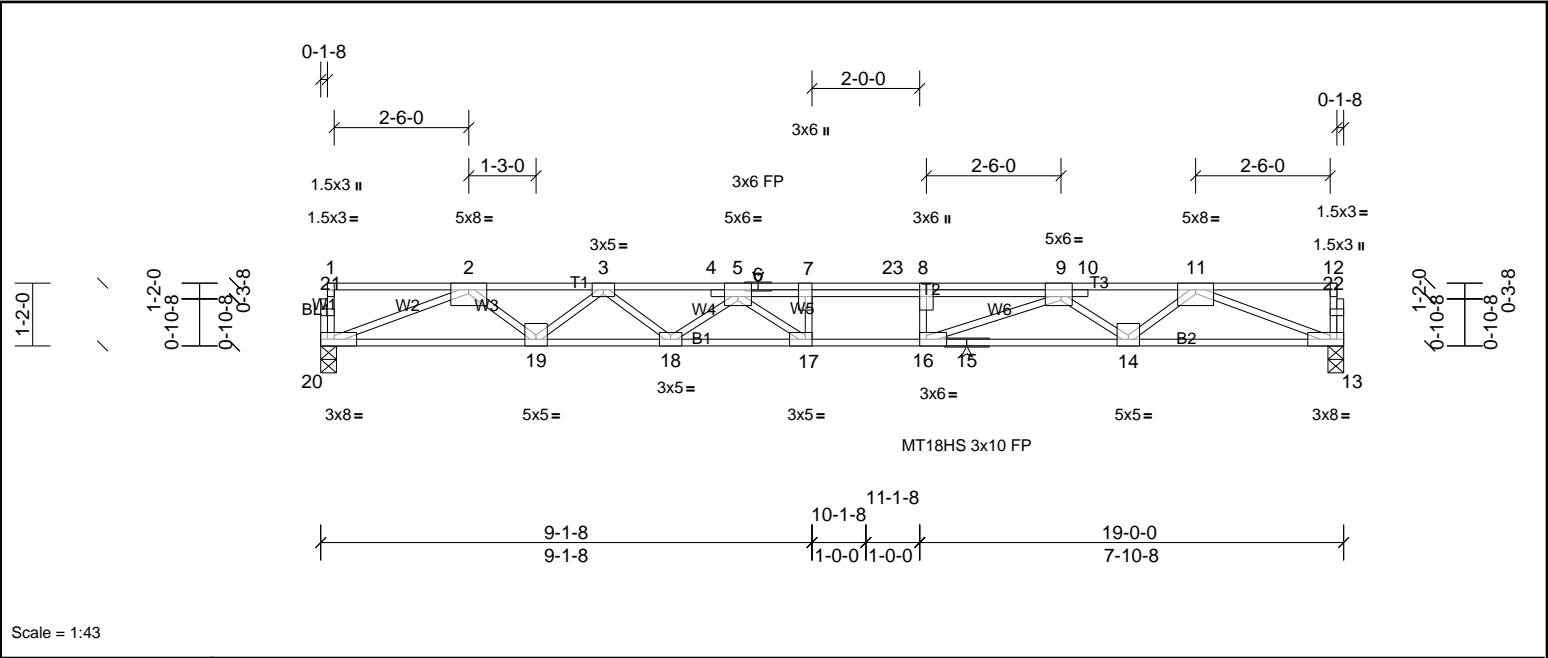


Scale = 1:43	
Plate Offsets (X, Y):	[5:0-3-0,Edge], [8:0-3-0,Edge], [9:0-2-8,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.77	Vert(LL)	-0.33	17-18	>678	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.79	Vert(CT)	-0.58	17	>388	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.89	Horz(CT)	0.10	13	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 101 lb	FT = 20%F, 12%E


LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	13=1374/0-3-8, (min. 0-1-8), 20=1194/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3633/0, 3-4=-5182/0, 4-5=-5163/0, 5-6=-6394/0, 6-7=-6394/0, 7-23=-6394/0, 8-23=-6394/0, 8-9=-6394/0, 9-10=-4049/0, 10-11=-4055/0	
BOT CHORD	19-20=0/2701, 18-19=0/4524, 17-18=0/5850, 16-17=0/6394, 15-16=0/5096, 14-15=0/5096, 13-14=0/3030	
WEBS	7-17=-598/0, 8-16=-498/0, 2-20=-2899/0, 2-19=0/1214, 3-19=-1160/0, 3-18=0/857, 5-18=-848/0, 5-17=0/1092, 11-13=-3250/0, 11-14=0/1334, 9-14=-1323/0, 9-16=0/1576	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- LOAD CASE(S)** Standard
- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (lb/ft)
- Vert: 13-20=-10, 1-6=-100, 6-23=-176, 12-23=-140

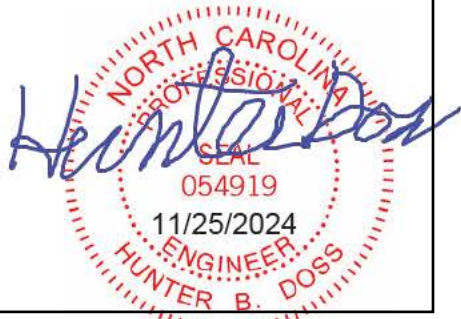

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:20 Page: 1
ID:g6xmDaGgGpr4T8wcGw4bQWzKH9V-EtF5DUCtXgnXA6Fv?PyAvzBLXK8bxel42fsUnyFgMf



LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)		
WEBS	2x4 SP No.3(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3(flat)		

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2957/0, 3-4=-4024/0, 4-5=-4024/0, 5-6=-4436/0, 6-7=-4436/0, 7-8=-4436/0, 8-9=-2958/0
BOT CHORD	17-18=0/2233, 16-17=0/3640, 15-16=0/4368, 14-15=0/4436, 13-14=0/3636, 12-13=0/3636, 11-12=0/2234
WEBS	6-15=-281/87, 7-14=-281/0, 2-18=-2395/0, 2-17=0/942, 3-17=-890/0, 3-16=0/500, 5-16=-481/0, 5-15=-278/548, 9-11=-2397/0, 9-12=0/941, 8-12=-883/0, 8-14=0/1097

NOTES


- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:20 Page: 1
ID:g6xmDaGgGpr4T8wcGw4bQWzKH9V-EtF5DUCtXgnXA6FxV?PyAvzd2XIIdbyO142fsUnyFgm




LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size) 5=3197/0-7-0, (min. 0-1-10), 7=3999/0-7-0, (min. 0-2-0)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	7-8=-1034/0, 1-8=-993/0, 5-9=-439/0, 4-9=-422/0, 2-11=-4389/0, 11-12=-4389/0, 3-12=-4389/0
BOT CHORD	6-7=0/4585, 5-6=0/4224
WEBS	2-7=-5381/0, 2-6=-269/0, 3-5=-4998/0

NOTES

- 1) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 2) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 3) Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 1-7-3 oc max. starting at 1-9-13 from the left end to 4-5-0 to connect truss(es) to front face of top chord.
- 4) Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent at 0-8-12 from the left end to connect truss(es) to back face of top chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- 5) Use Simpson Strong-Tie THAC422 (6-16d Girder, 6-16d Truss) or equivalent spaced at 1-1-4 oc max. starting at 2-3-12 from the left end to 3-5-0 to connect truss(es) to back face of top chord.
- 6) Fill all nail holes where hanger is in contact with lumber.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)		Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00	
	Uniform Loads (lb/ft)	
	Vert: 5-7=-10, 1-4=-100	
	Concentrated Loads (lb)	
	Vert: 2=-909 (F), 3=-980 (B), 10=-1969 (B), 11=-980 (B), 12=-909 (F), 13=-934 (F)	

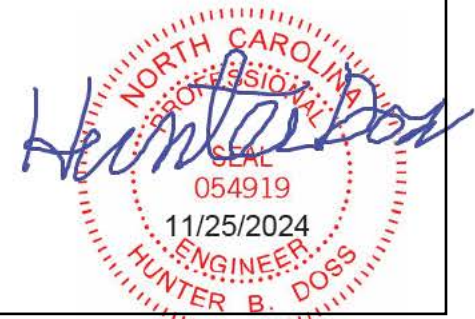

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL C 2ND FLR
72436773	FG2	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:20

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-EtF5DUCtXgnXA6FxV?PyAvzc2XKtbvVI42fsUnyFgMf

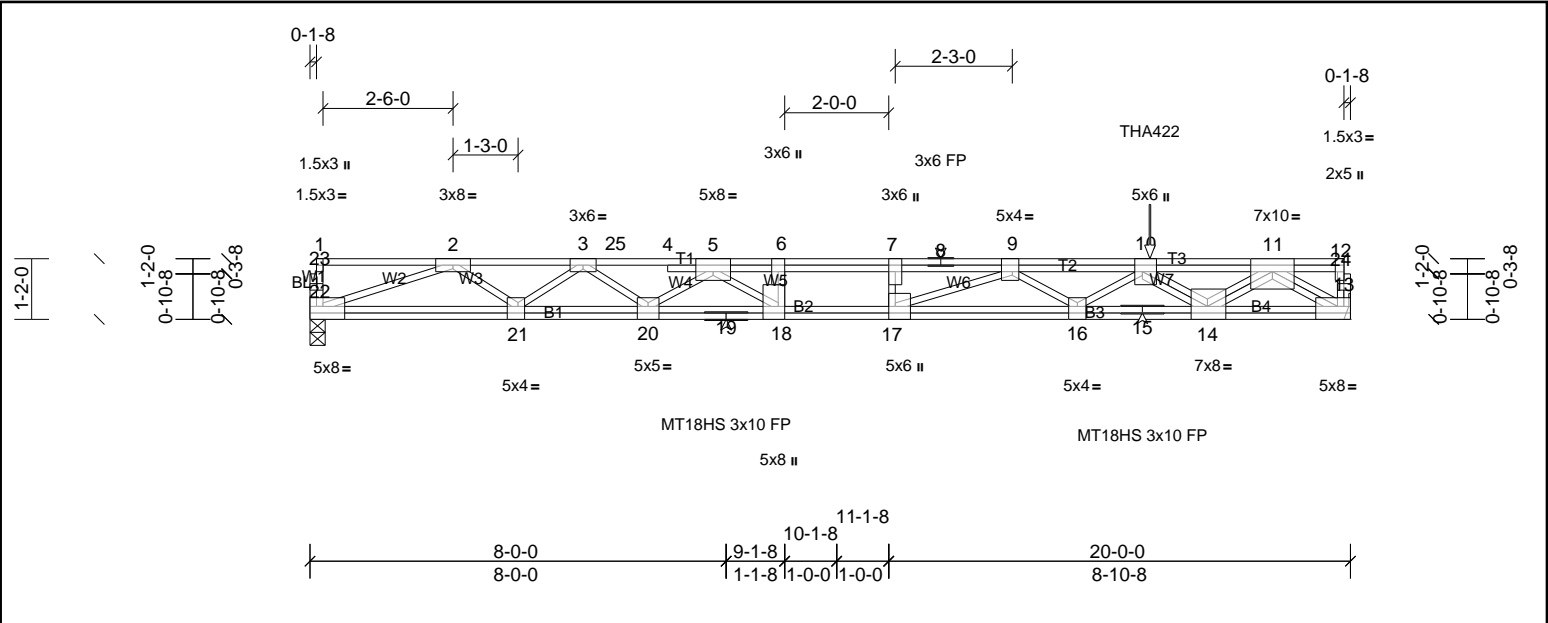

Scale = 1:44.5	
Plate Offsets (X, Y):	[5:0-4-0,Edge], [7:0-3-0,Edge], [9:0-1-8,Edge], [10:0-3-0,Edge], [12:0-3-0,Edge], [13:Edge,0-3-0], [14:0-3-12,Edge], [16:0-2-0,Edge], [17:0-3-0,Edge], [18:0-3-0,Edge], [20:0-2-8,Edge], [21:0-1-8,Edge], [22:Edge,0-3-0]


Loading	(psf)	Spacing	1-4-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.82	Vert(LL)	-0.36	16-17	>654	480	MT20 244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.69	Vert(CT)	-0.58	16-17	>406	360	MT18HS 244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.79	Horz(CT)	0.06	13	n/a	n/a	
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 149 lb FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-7-7 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	13=2027/ Mechanical, (min. 0-1-8), 22=1110/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3703/0, 3-25=-5587/0, 4-25=-5587/0, 4-5=-5586/0, 5-6=-7707/0, 6-7=-7707/0, 7-8=-7707/0, 8-9=-7707/0, 9-10=-8005/0, 10-11=-5410/0	
BOT CHORD	21-22=0/2776, 20-21=0/4714, 19-20=0/6607, 18-19=0/6607, 17-18=0/7707, 16-17=0/8134, 15-16=0/7767, 14-15=0/7767, 13-14=0/2941	
WEBS	6-18=-651/0, 2-22=-2924/0, 2-21=0/1179, 3-21=-1285/0, 3-20=0/1110, 5-20=-1264/0, 5-18=0/1630, 10-16=0/397, 9-16=-356/56, 9-17=-902/485, 11-14=0/3062, 10-14=-2982/0, 11-13=-3531/0	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent at 16-1-12 from the left end to connect truss(es) to front face of top chord.
 - Fill all nail holes where hanger is in contact with lumber.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 13-22=-7, 1-25=-67, 8-25=-93, 8-12=-67
	Concentrated Loads (lb)
	Vert: 10=-1530 (F)

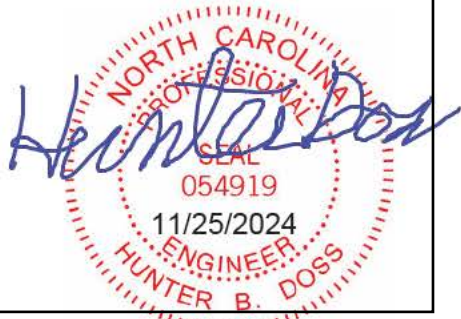

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL C 2ND FLR
72436773	FG3	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:20

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-EtF5DUCTXgnXA6FxV?PyAvzcHXG?b__l42fsUnyFgMf

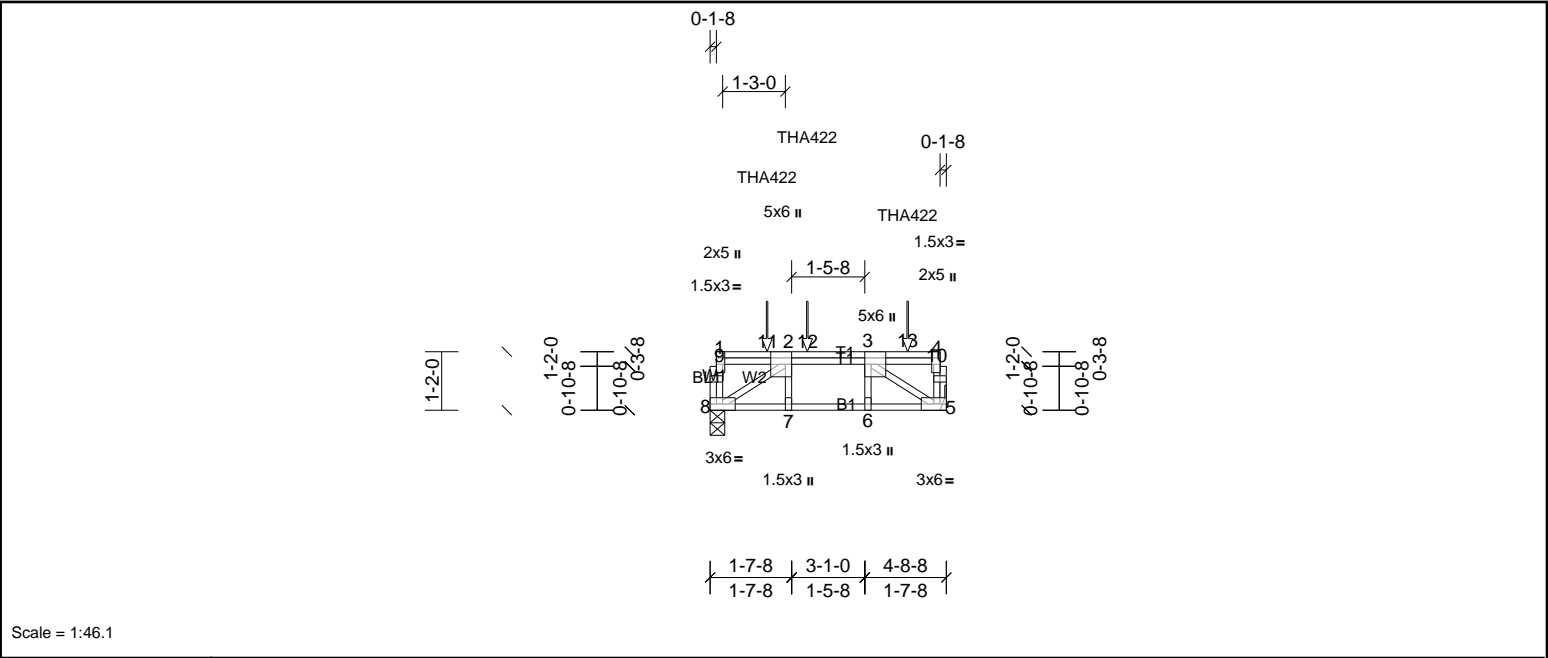


Plate Offsets (X, Y): [2:0-3-0,Edge], [3:0-3-0,Edge], [4:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.81	Vert(LL)	-0.04	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.94	Vert(CT)	-0.05	7-8	>999	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.51	Horz(CT)	0.01	5	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 32 lb	FT = 20%F, 12%E


LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-8-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	5=1597/ Mechanical, (min. 0-1-8), 8=1605/0-3-8, (min. 0-1-8)
	Max Grav	5=1597 (LC 1), 8=1612 (LC 3)


FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	8-9=-446/0, 1-9=-445/0, 5-10=-502/28, 4-10=-501/28, 2-12=-1804/0, 3-12=-1804/0
BOT CHORD	7-8=0/1804, 6-7=0/1804, 5-6=0/1804
WEBS	3-5=-2153/0, 2-8=-2156/0

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-1-10 from the left end to 3-11-4 to connect truss(es) to back face of top chord.
 - Fill all nail holes where hanger is in contact with lumber.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 5-8=-10, 1-4=-100
	Concentrated Loads (lb)
	Vert: 11=-903 (B), 12=-900 (B), 13=-921 (B)

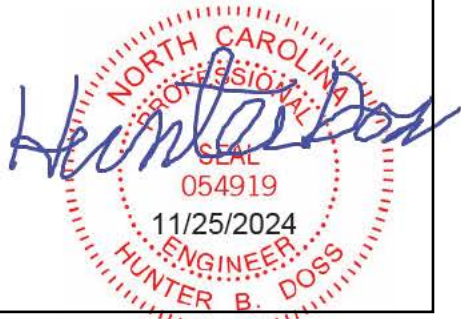


Job 72436773	Truss K200	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL C 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

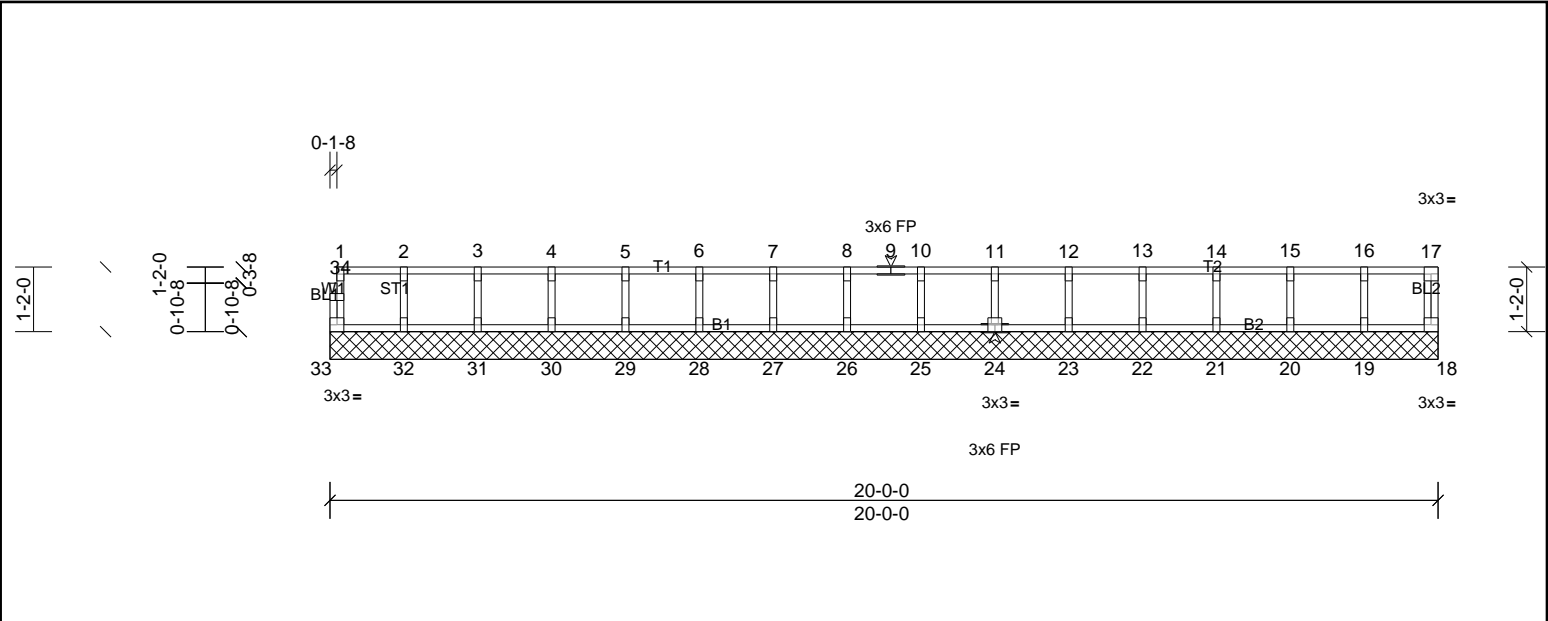

Scale = 1:41.8

Loading	(psf)	Spacing	2'-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	18	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 84 lb	FT = 20%F, 12%E

LUMBER TOP CHORD 2x4 SP No.2(flat) BOT CHORD 2x4 SP No.2(flat) WEBS 2x4 SP No.3(flat) OTHERS 2x4 SP No.3(flat)	BRACING TOP CHORD Structural wood sheathing directly applied or 6'-0" 0 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10'-0" 0 oc bracing.
REACTIONS All bearings 20'-0" 0. (lb) - Max Grav All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33	
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
NOTES 1) All plates are 1.5x3 MT20 unless otherwise indicated. 2) Gable requires continuous bottom chord bearing. 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web). 4) Gable studs spaced at 1'-4" 0 oc. 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1. 6) Recommend 2x6 strongbacks, on edge, spaced at 10'-0" 0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.	

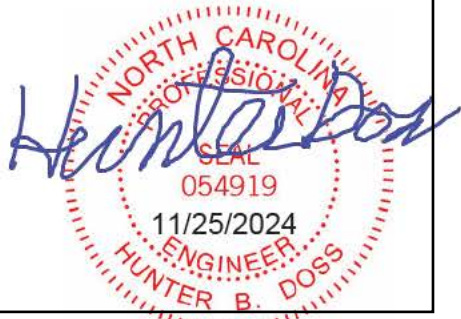


Job 72436773	Truss K201	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL C 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Nov 25 11:16:21

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-i4pTQpDVI_vOoGq72iwBj7WYkXqZKYcRJIpQ0DyFgMe

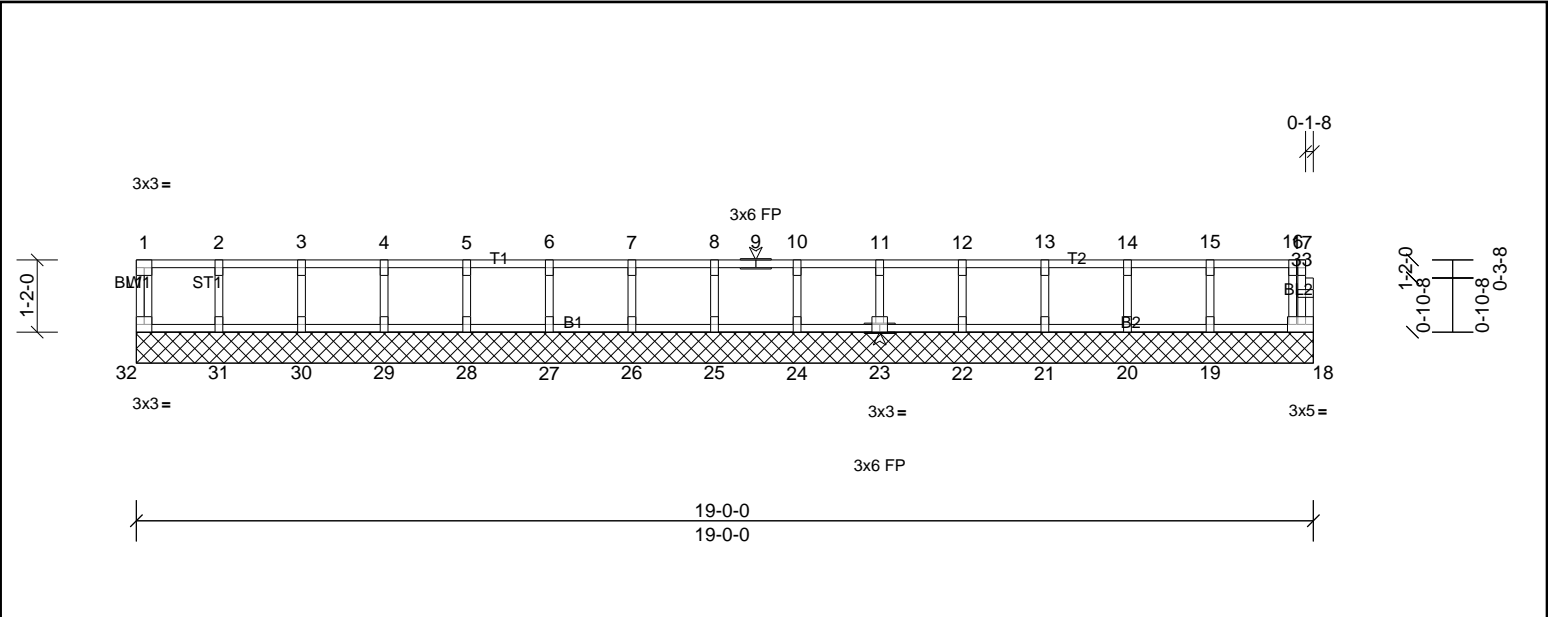

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	18	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 81 lb	FT = 20%F, 12%E


LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS All bearings 19-0-0.


(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

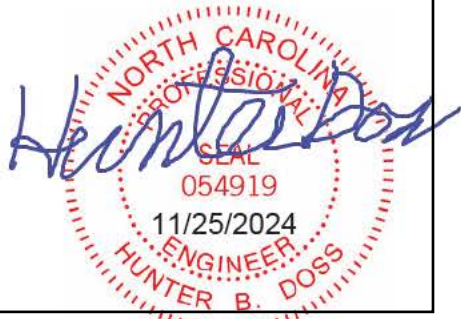

Job 72436773	Truss K202	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES - MCDOWELL C 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

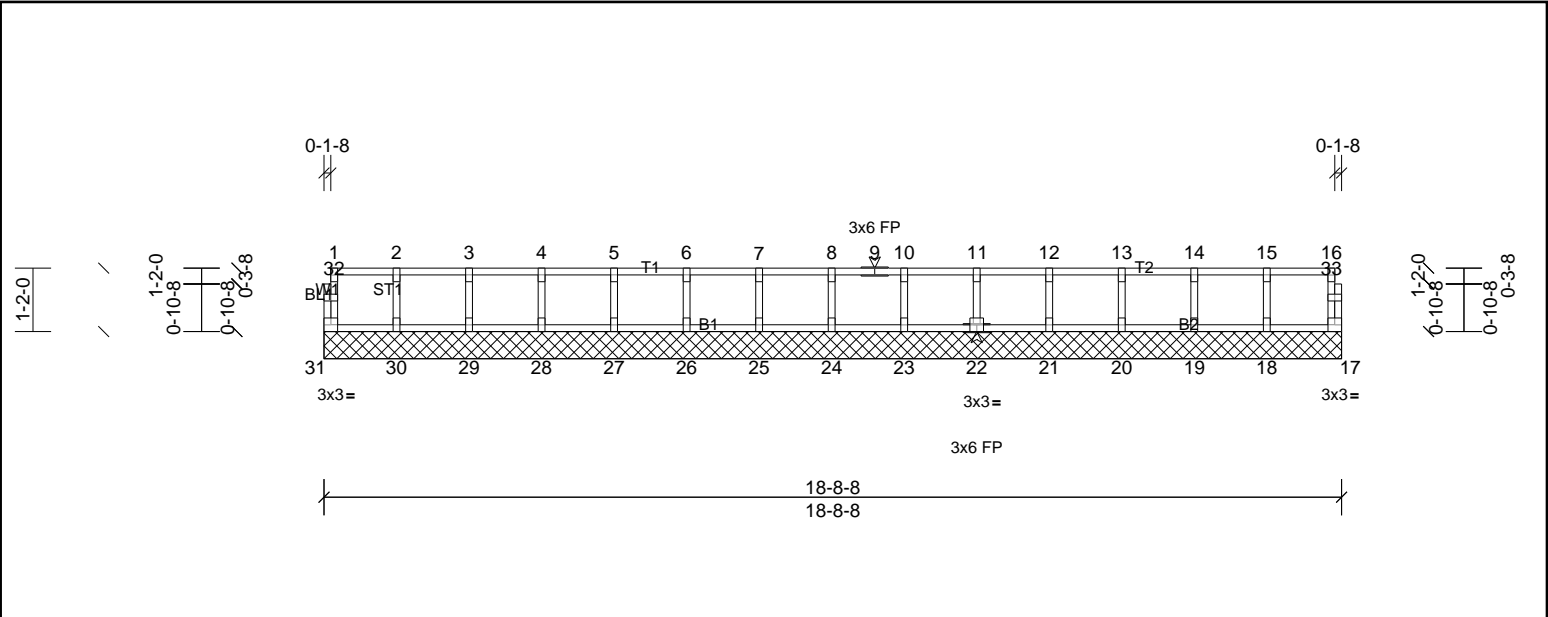

Scale = 1:42.5

Loading	(psf)	Spacing	2'-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	17	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 78 lb	FT = 20%F, 12%E

LUMBER TOP CHORD 2x4 SP No.2(flat) BOT CHORD 2x4 SP No.2(flat) WEBS 2x4 SP No.3(flat) OTHERS 2x4 SP No.3(flat)	BRACING TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.
REACTIONS All bearings 18'-8". (lb) - Max Grav All reactions 250 (lb) or less at joint(s) 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31	
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
NOTES 1) All plates are 1.5x3 MT20 unless otherwise indicated. 2) Gable requires continuous bottom chord bearing. 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web). 4) Gable studs spaced at 1'-4" oc. 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1. 6) Recommend 2x6 strongbacks, on edge, spaced at 10'-0" oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.	

