

27 PENEVISTA Way

15724-145045

Harnett County Department of Public Health

PERMIT # SPD 2504-0089

Operation Permit

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ Expansion

PROPERTY LOCATION: 51 Rosser Pottman RD

Name: (owner) Smith Douglas Homes

SUBDIVISION BRIANWOOD BLUFF LOT # 17

System Installer: Artic Enterprises

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms _____


Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feet

System Type: 25% REDUCTION Chamber Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal and all conditions of the Improvement Permit and Construction Authorization.

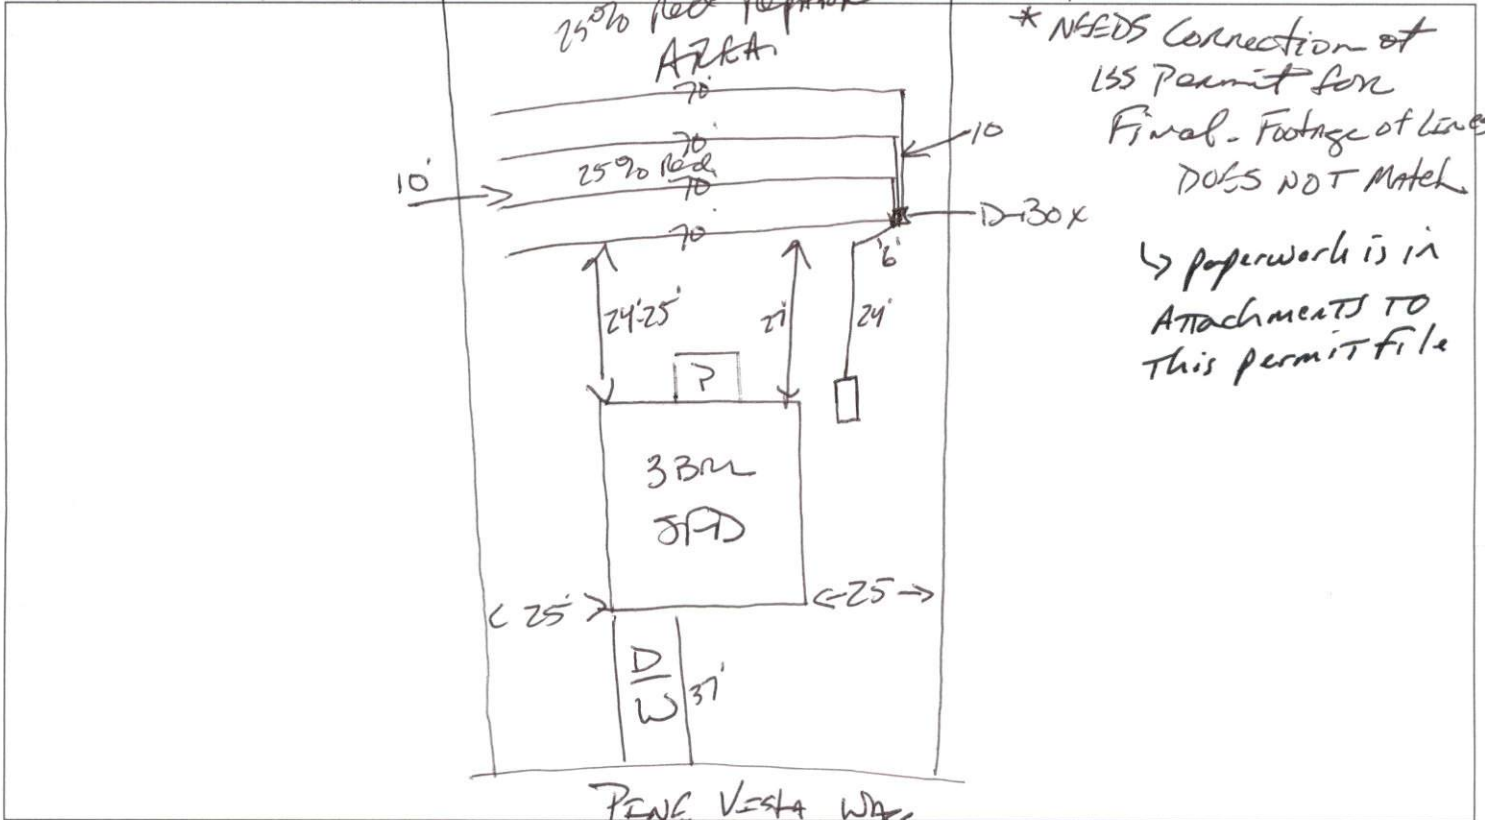

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes ☐ No ☐
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other 25% REDUCTION Septic Tank: 1000 gallons Pump Tank: _____ gallons
Subsurface No. of exact length 280' total width of depth of
Drainage Field ditches 4 of each ditch 70 feet ditches 3 feet ditches 24 inches
French Drain Required: _____ Linear feet

Authorized State Agent

[Signature]

Date 7-18-25