

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	A1	Truss	2	1	Job Reference (optional)

33 LDP

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:11 Page: 1
ID:ugPbpkT9Jw2gQG6kWr_KC9yDyn0-SfSvcV_ylg?4KpFNjct55_7fYbhX3oFaylN9KzuWel

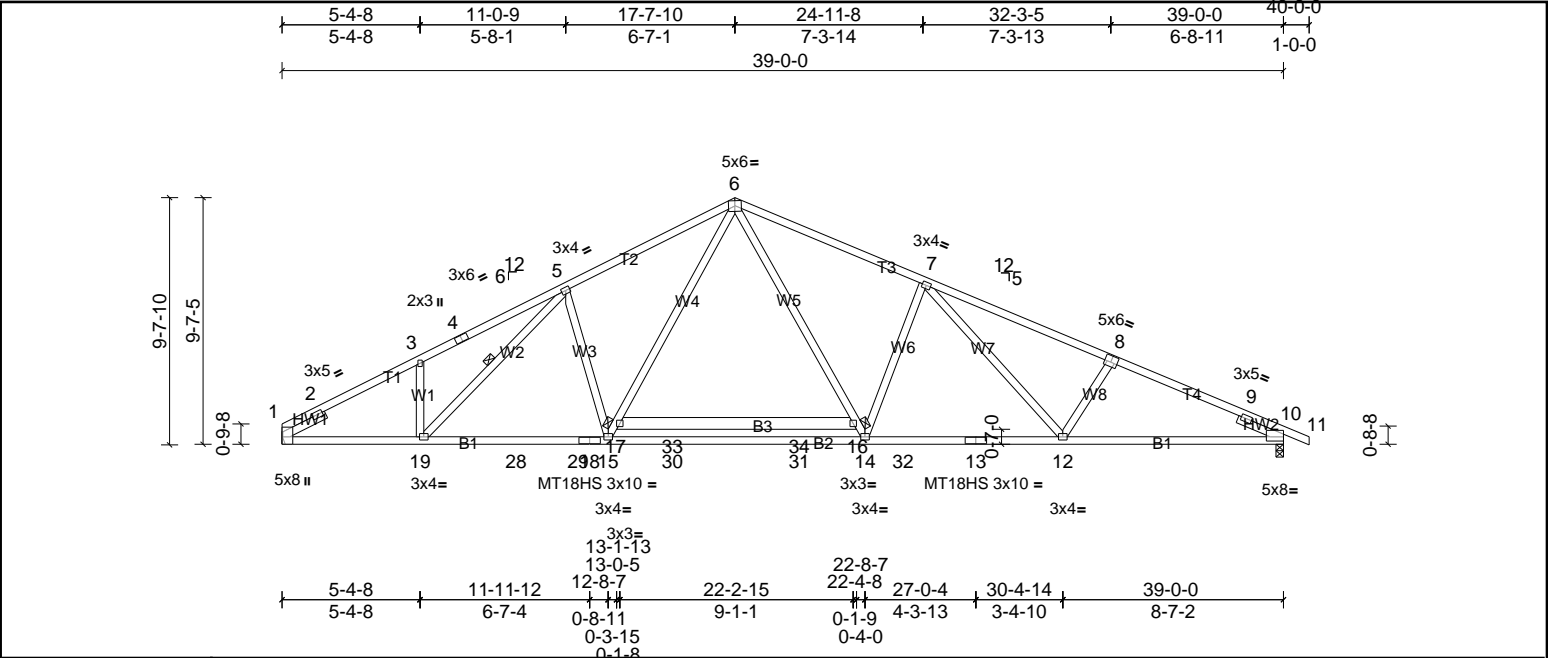


Plate Offsets (X, Y): [1:0-3-8,Edge], [8:0-3-0,0-3-0], [10:Edge,0-3-3]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	1.00	Vert(LL)	-0.38	14-15	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.89	Vert(CT)	-0.73	14-15	>644	180	MT18HS	244/190
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.70	Horz(CT)	0.15	10	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 233 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2 *Except* T1:2x4 SP No.1, T4:2x4 SP SS	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP SS *Except* B2:2x4 SP No.1, B3:2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt
SLIDER	Left 2x4 SP No.3 -- 1-11-0, Right 2x4 SP No.3 -- 1-11-0		5-19
REACTIONS	(lb/size) 1=1662/ Mechanical, (min. 0-1-8), 10=1706/0-3-8, (min. 0-2-0)		
	Max Horiz 1=172 (LC 11)		
	Max Uplift 1=136 (LC 10), 10=202 (LC 11)		
	Max Grav 1=1712 (LC 2), 10=1711 (LC 2)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-2=-643/50, 2-3=-2927/581, 3-4=-2860/679, 4-5=-2832/701, 5-6=-2735/647, 6-7=-2752/649, 7-8=-3166/710, 8-9=-3307/710, 9-10=-976/0		
BOT CHORD	1-19=-404/2533, 19-28=-292/2472, 28-29=-292/2472, 18-29=-292/2472, 15-18=-292/2472, 15-30=-116/2038, 30-31=-116/2038, 14-31=-116/2038, 14-32=-342/2657, 13-32=-342/2657, 12-13=-342/2657, 10-12=-540/2981		
WEBS	15-17=-224/809, 6-17=-169/1018, 6-16=-195/1185, 14-16=-250/975, 5-15=-494/327, 5-19=-179/257, 7-14=-670/356, 7-12=-123/447, 8-12=-278/227		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 136 lb uplift at joint 1 and 202 lb uplift at joint 10.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	A1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:12

Page: 1

ID:5n?JT3lr4DexPAU7Qf7093yBNTJ-xs0Hqr_aW_7hiUOSxR76elWVfy7LGfeOpcVwhmzuWeH


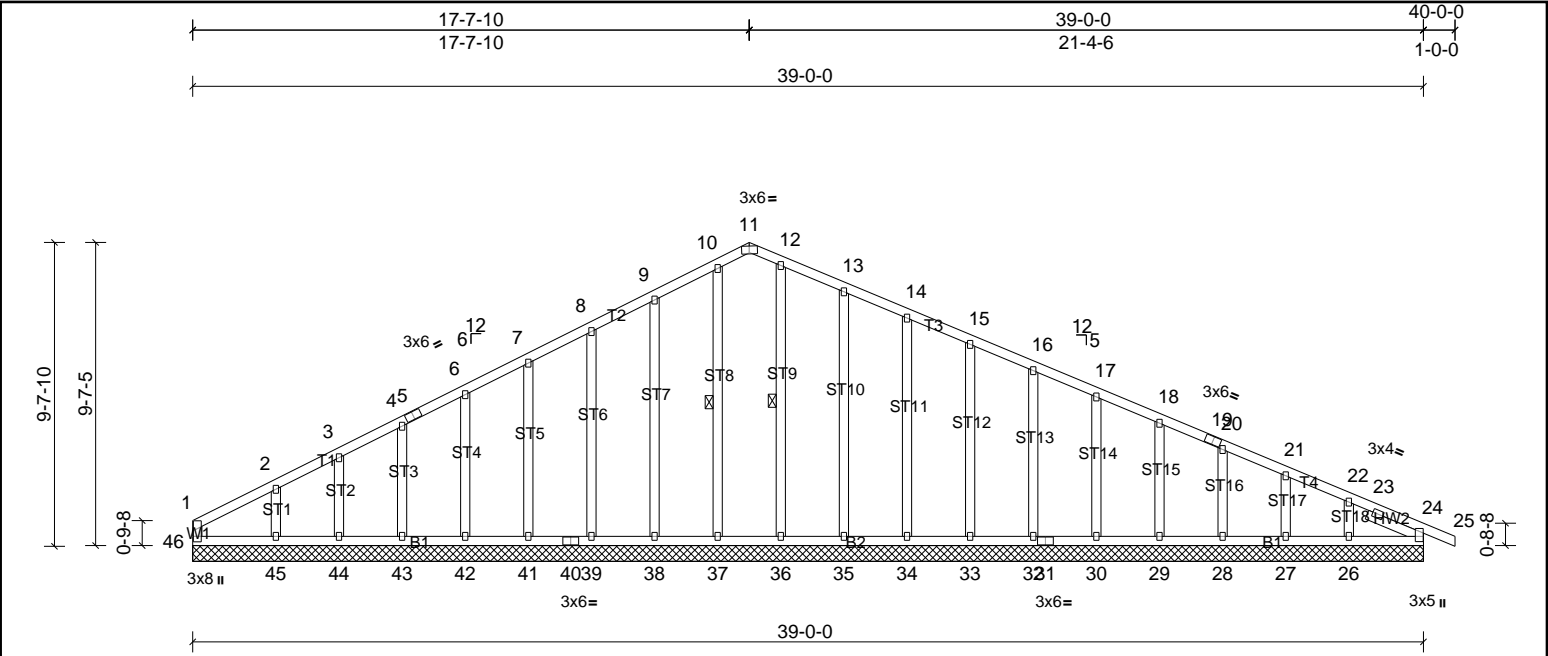


Plate Offsets (X, Y): [11:0-2-14,Edge], [24:0-3-3,0-0-2]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.01	24	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 260 lb
											FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt
OTHERS	2x4 SP No.3		10-37, 12-36
SLIDER	Right 2x4 SP No.3 -- 1-11-0		
REACTIONS	All bearings 39-0-0.		
	(lb) - Max Horiz 46=-167 (LC 15)		
	Max Uplift All uplift 100 (lb) or less at joint(s) 24, 26, 27, 28, 29, 30, 32, 33, 34, 35, 38, 39, 41, 42, 43, 44, 46, 47 except 45=-131 (LC 10)		
	Max Grav All reactions 250 (lb) or less at joint(s) 24, 26, 27, 28, 29, 30, 32, 33, 34, 35, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46, 47		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	9-10=-117/286, 10-11=-108/261, 11-12=-106/259, 12-13=-115/284		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 46, 38, 39, 41, 42, 43, 44, 35, 34, 33, 32, 30, 29, 28, 27, 26, 24, 24 except (jt=lb) 45=130.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.

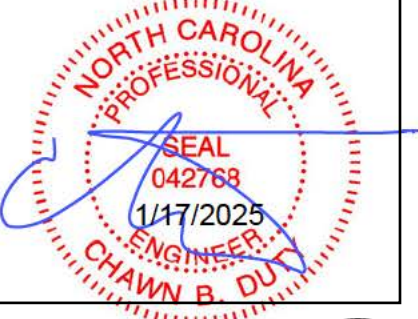

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	A1T	Truss	7	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:12

Page: 1

ID:ugPbpkT9Jw2gQG6kWr_KC9yDyn0-xs0Hqr_aW_7hiUOSxR76elWJ5yvXGTaOpcVwhmzuWeH

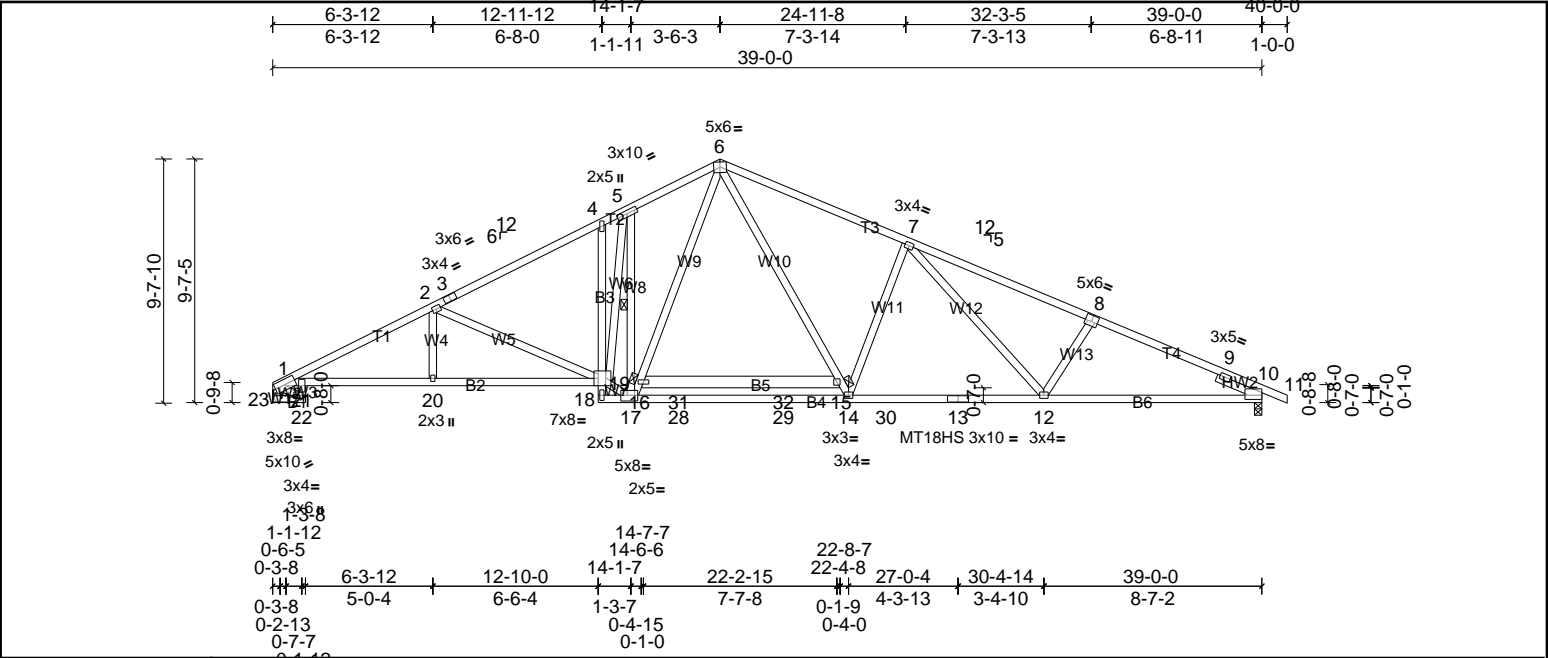


Plate Offsets (X, Y): [1:0-4-11,0-2-8], [8:0-3-0,0-3-0], [10:Edge,0-3-3], [17:0-3-0,0-2-12], [19:0-2-0,Edge], [23:0-4-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.29	12-14	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.98	Vert(CT)	-0.58	15-16	>803	180	MT18HS	244/190
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.93	Horz(CT)	0.27	10	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 251 lb	FT = 20%

LUMBER	BRACING
TOP CHORD	2x4 SP No.2 *Except* T4:2x4 SP SS
BOT CHORD	2x4 SP No.1 *Except* B1:2x4 SP No.2, B2:2x4 SP SS, B3:2x4 SP No.3, B5:2x6 SP No.2
WEBS	2x4 SP No.3
SLIDER	Right 2x4 SP No.3 -- 1-11-0

REACTIONS	(lb/size)	10=1690/0-3-8, (min. 0-2-0), 23=1621/ Mechanical, (min. 0-1-8)
Max Horiz	23=-167 (LC 15)	
Max Uplift	10=-208 (LC 11), 23=-134 (LC 10)	

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-3408/712, 2-3=-2729/568, 3-4=-2649/600, 4-5=-2640/696, 5-6=-2389/651, 6-7=-2606/664, 7-8=-3046/720, 8-9=-3186/720, 9-10=-936/0, 1-23=-1728/393
BOT CHORD	22-23=-210/644, 1-21=-525/3033, 20-21=-522/3012, 19-20=-522/3012, 17-18=-125/255, 17-28=-104/1843, 28-29=-104/1843, 14-29=-104/1843, 14-30=-356/2527, 13-30=-356/2527, 12-13=-356/2527, 10-12=-549/2869
WEBS	16-17=-236/762, 6-16=-183/881, 6-15=-216/1107, 14-15=-269/956, 2-19=-772/275, 7-14=-673/357, 7-12=-117/459, 8-12=-276/225, 21-22=-200/649, 1-22=-897/292, 5-17=-1513/390, 17-19=-93/2237, 5-19=-406/1567, 2-20=0/343

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 208 lb uplift at joint 10 and 134 lb uplift at joint 23.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	A2	Truss	3	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:12

Page: 1

ID: ?jInGo1eEMz0ZUCmmDKLc3yDymH-xs0Hqr_aW_7hiUOSxR76eIWJ9yxGGvtOpcVwhmzuWeH

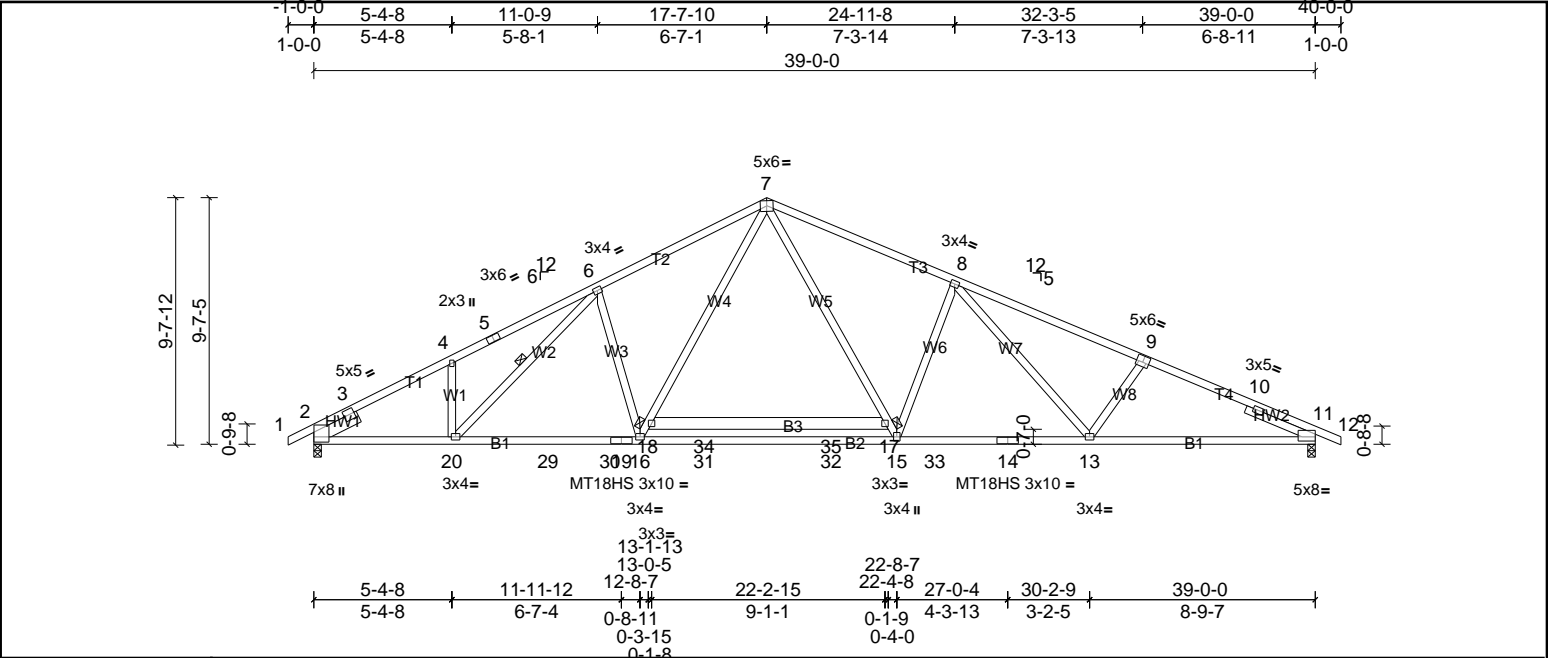


Plate Offsets (X, Y): [2:0-4-9,0-0-1], [9:0-3-0,0-3-0], [11:Edge,0-3-3]


Loading	(psf)	Spacing	2-3-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.37	15-16	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.86	Vert(CT)	-0.72	15-16	>648	180	MT18HS	244/190
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.78	Horz(CT)	0.15	11	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 238 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP SS *Except* T2:2x4 SP No.1	TOP CHORD 2-0-0 oc purlins
BOT CHORD 2x4 SP SS *Except* B3:2x6 SP No.2	(Switched from sheeted: Spacing > 2-0-0).
WEBS 2x4 SP No.3	Rigid ceiling directly applied or 6-0-0 oc bracing.
SLIDER Left 2x6 SP No.2 -- 1-11-0, Right 2x4 SP No.3 -- 2-11-0	1 Row at midpt 6-20
REACTIONS (lb/size) 2=1938/0-3-8, (min. 0-2-5), 11=1919/0-3-8, (min. 0-2-4)	
Max Horiz 2=184 (LC 14)	
Max Uplift 2=179 (LC 10), 11=227 (LC 11)	
Max Grav 2=1983 (LC 2), 11=1924 (LC 2)	
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=-1285/144, 3-4=-3292/648, 4-5=-3214/755, 5-6=-3182/780, 6-7=-3073/725, 7-8=-3094/730, 8-9=-3552/790, 9-10=-3697/800, 10-11=-1139/48	
BOT CHORD 2-20=-447/2846, 20-29=-326/2778, 29-30=-326/2778, 19-30=-326/2778, 16-19=-326/2778, 16-31=-129/2295, 31-32=-129/2295, 15-32=-129/2295, 15-33=-382/2985, 14-33=-382/2985, 13-14=-382/2985, 11-13=-608/3346	
WEBS 16-18=-251/906, 7-18=-189/1144, 7-17=-222/1335, 15-17=-283/1097, 6-16=-554/367, 6-20=-199/285, 8-15=-760/401, 8-13=-132/498, 9-13=-305/254	

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 179 lb uplift at joint 2 and 227 lb uplift at joint 11.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:13 Page: 1
ID: ?jIngo1eEMz0ZUCmmdKLc3yDymH-P2af1B?CHHFYKezeV8eLBW3UGMG5?zfX2GETDduWeG



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2 *Except* T4:2x4 SP SS	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP SS *Except* B2:2x4 SP No.1, B3:2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.3		9-0-4 oc bracing: 20-44
OTHERS	2x4 SP No.3		6-0-0 oc bracing: 23-24.
SLIDER	Left 2x4 SP No.3 -- 1-11-0, Right 2x4 SP No.3 -- 1-11-0	JOINTS	1 Brace at Jt(s): 24, 23, 33, 34, 35, 37.

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) All plates are 2x3 MT20 unless otherwise indicated.
- 6) Gable studs spaced at 2'-0" oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 159 lb uplift at joint 2 and 202 lb uplift at joint 18.
- 10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	A3	Truss	6	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:13

Page: 1

ID: ?jINgo1eEMz0ZUCmmDKLc3yDymH-P2af1B?CHHFYKezeV8eLBW3XLMFP?22X2GETDDzuWeG

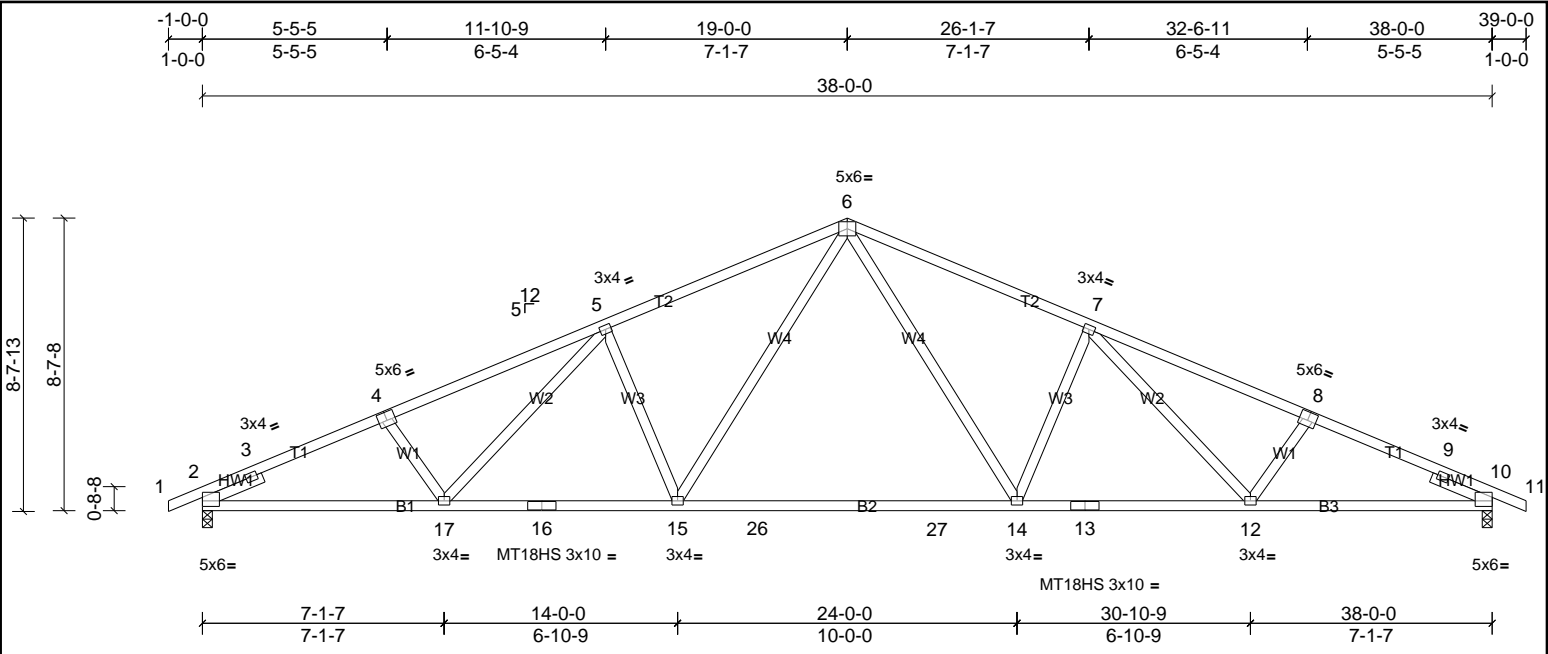


Plate Offsets (X, Y): [2:Edge,0-2-0], [4:0-3-0,0-3-0], [8:0-3-0,0-3-0], [10:Edge,0-3-3]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.41	14-15	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.93	Vert(CT)	-0.75	14-15	>607	180	244/190
BCLL	0.0*	Rep Stress Incr	NO	WB	0.40	Horz(CT)	0.13	10	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 201 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP SS *Except* T2:2x4 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 3-1-2 oc purlins.
BOT CHORD	2x4 SP No.1	BOT CHORD	Rigid ceiling directly applied or 7-10-7 oc bracing.
WEBS	2x4 SP No.3		
SLIDER	Left 2x4 SP No.3 -- 1-11-0, Right 2x4 SP No.3 -- 1-11-0		
REACTIONS	(lb/size) 2=1580/0-3-8, (min. 0-1-14), 10=1580/0-3-8, (min. 0-1-14)		
	Max Horiz 2=145 (LC 11)		
	Max Uplift 2=235 (LC 10), 10=235 (LC 11)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-870/61, 3-4=-2926/795, 4-5=-2793/794, 5-6=-2435/774, 6-7=-2435/774, 7-8=-2793/794, 8-9=-2926/795, 9-10=-752/61		
BOT CHORD	2-17=-628/2628, 16-17=-494/2367, 15-16=-494/2367, 15-26=-265/1736, 26-27=-265/1736, 14-27=-265/1736, 13-14=-494/2367, 12-13=-494/2367, 10-12=-628/2628		
WEBS	7-14=-578/314, 7-12=-76/303, 5-15=-578/314, 5-17=-75/303, 6-15=-219/852, 6-14=-219/852		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 235 lb uplift at joint 2 and 235 lb uplift at joint 10.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	A3G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:13

Page: 1

ID:wUPqskExfWgGCKYpm3rPnVyBNSh-P2af1B?CHHFYKezeV8eLBW3h3MTO?62X2GETDDzuWeG

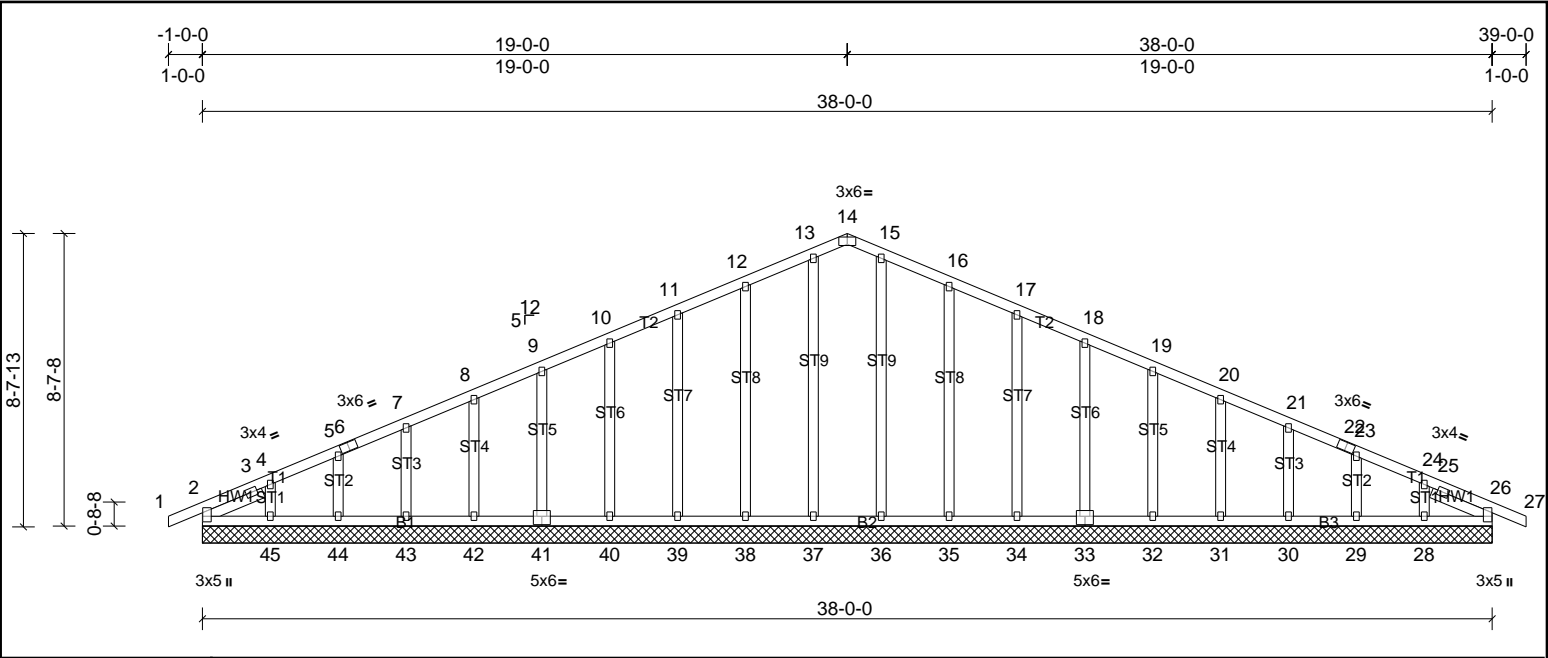


Plate Offsets (X, Y): [2:0-3-3,0-0-2], [14:0-3-0,Edge], [26:0-3-3,0-0-2], [33:0-3-0,0-3-0], [41:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.01	26	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 243 lb
											FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.
OTHERS 2x4 SP No.3	
SLIDER Left 2x4 SP No.3 -- 1-11-0, Right 2x4 SP No.3 -- 1-11-0	

REACTIONS All bearings 38'-0-0.

(lb) - Max Horiz 2=145 (LC 10), 46=145 (LC 10)

Max Uplift All uplift 100 (lb) or less at joint(s) 2, 28, 29, 30, 31, 32, 33, 34, 35, 38, 39, 40, 41, 42, 43, 44, 45, 46

Max Grav All reactions 250 (lb) or less at joint(s) 2, 26, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 50

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2'-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 38, 39, 40, 41, 42, 43, 44, 45, 35, 34, 33, 32, 31, 30, 29, 28, 2.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	B1G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:13

Page: 1

ID:Fhwvlm3_APWcDLw4XS182qzFIQG-P2af1B?CHHFYKezeV8eLBW3hmMTM?8sX2GETDDzuWeG

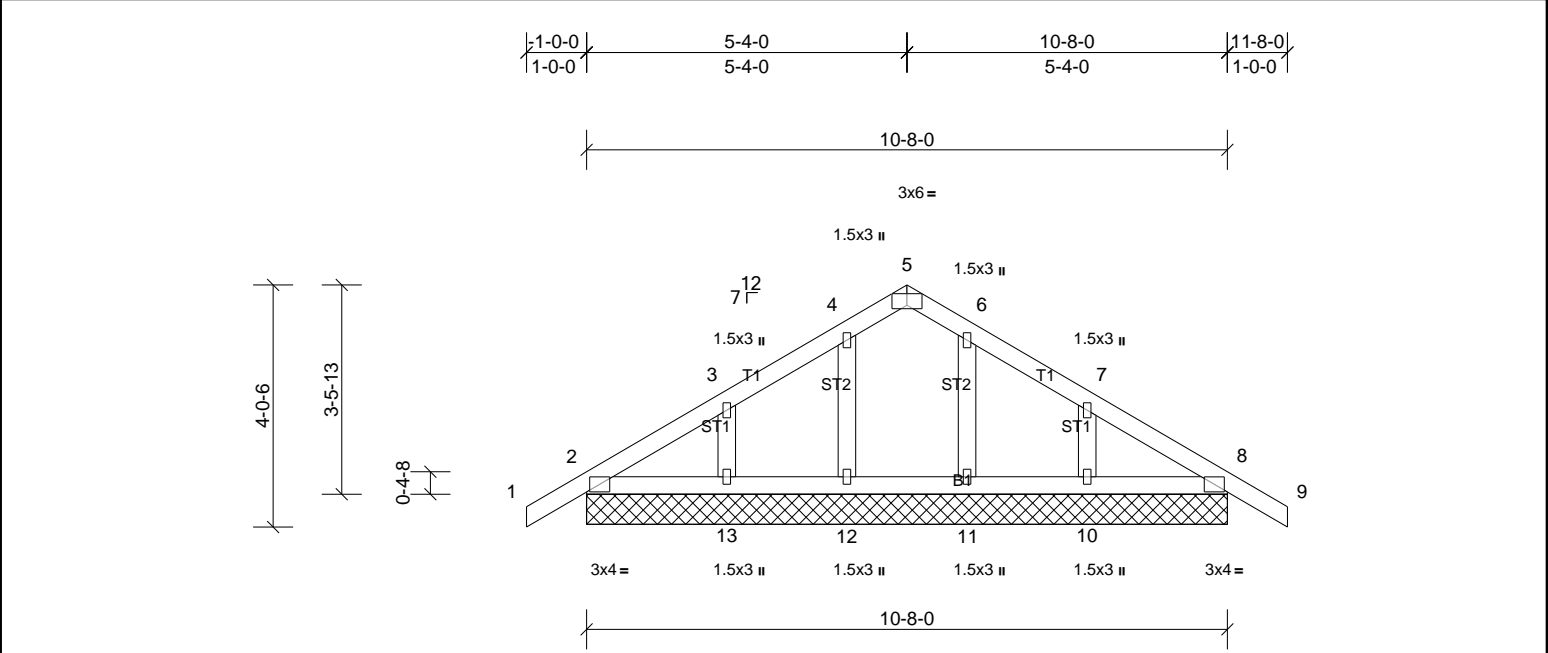


Plate Offsets (X, Y): [5:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	8	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 49 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS	All bearings 10'-8-0.
(lb) - Max Horiz	2=95 (LC 9), 14=95 (LC 9)
Max Uplift	All uplift 100 (lb) or less at joint(s) 2, 8, 10, 11, 12, 13, 14, 18
Max Grav	All reactions 250 (lb) or less at joint(s) 2, 8, 10, 11, 12, 13, 14, 18
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2'-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06-00 tall by 2'-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 12, 11, 13, 10, 2, 8.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job 72501548	Truss C1G	Truss Type Truss	Qty 1	Ply 1	MUNGO HOMES-RUSSELL C ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:14

Page: 1

ID:dYQnn9ZmzV805OPvoVFD4_zFIOK-tE81FX0q2bNPxnYq2sAajcn2miEkaShGw_1mfzuWeF

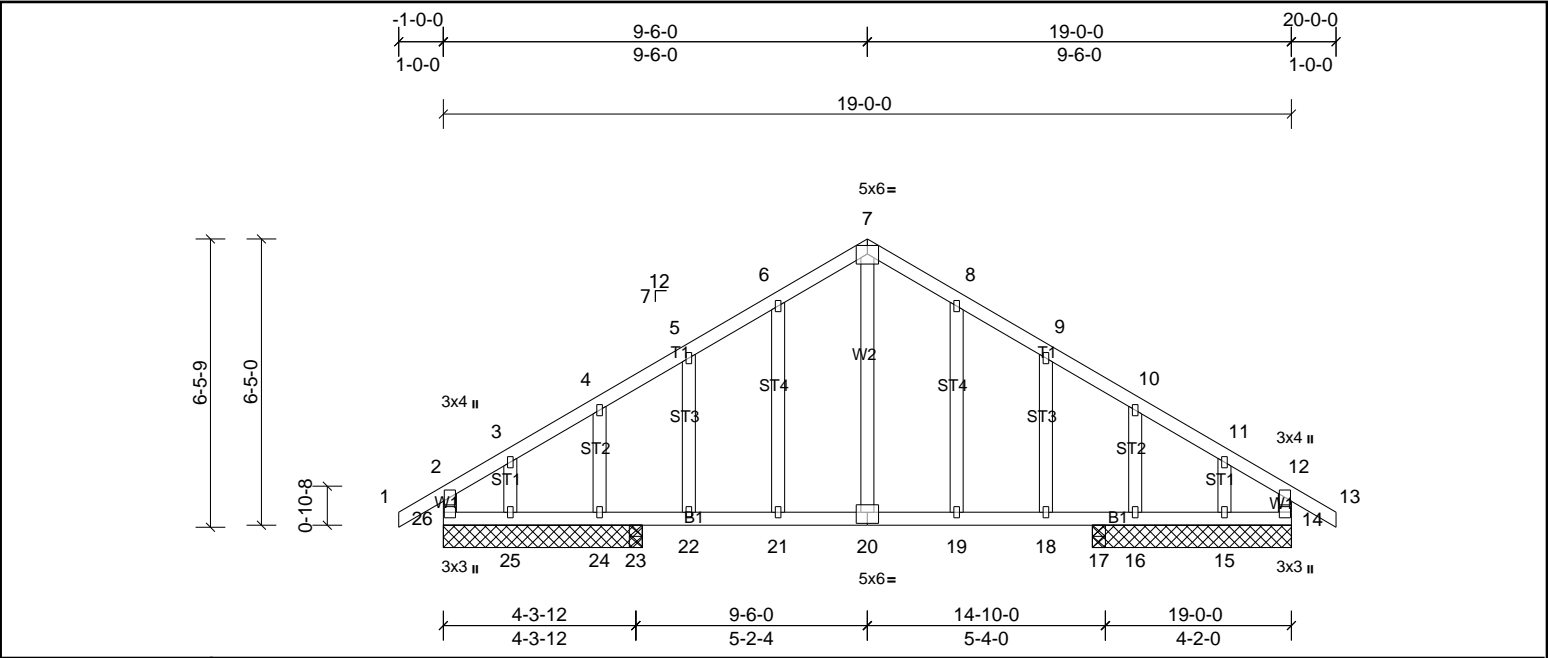


Plate Offsets (X, Y): [20:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	-0.03	19	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.06	19	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.01	14	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 110 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10'-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS All bearings 4-5-8, except 23=0-3-8, 17=0-3-8
(lb) - Max Horiz 26=-183 (LC 8)
Max Uplift All uplift 100 (lb) or less at joint(s) 16, 24 except 15=-153 (LC 20), 17=-133 (LC 11), 23=-137 (LC 10), 25=-154 (LC 19)
Max Grav All reactions 250 (lb) or less at joint(s) 15, 16, 24, 25 except 14=525 (LC 1), 17=462 (LC 18), 23=469 (LC 17), 26=525 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-475/0, 3-4=-390/8, 4-5=-422/39, 5-6=-431/85, 6-7=-382/127, 7-8=-382/127, 8-9=-431/85, 9-10=-422/38, 10-11=-387/6, 11-12=-471/0, 12-14=-431/23, 2-26=-431/23
BOT CHORD 25-26=0/354, 24-25=0/354, 23-24=0/354, 22-23=0/354, 21-22=0/354, 20-21=0/354, 19-20=0/354, 18-19=0/354, 17-18=0/354, 16-17=0/354, 15-16=0/354, 14-15=0/354

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2'-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06-00 tall by 2'-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 24, 16 except (jt=lb) 25=154, 15=153, 23=137, 17=133.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	C2	Truss	1	3	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:14

Page: 1

ID:WPggTms73SM9mYi84eXujwzFHba-tE81FX0q2bNPxnYq2sAajcgHmf8kSphGw_1mfzuWeF

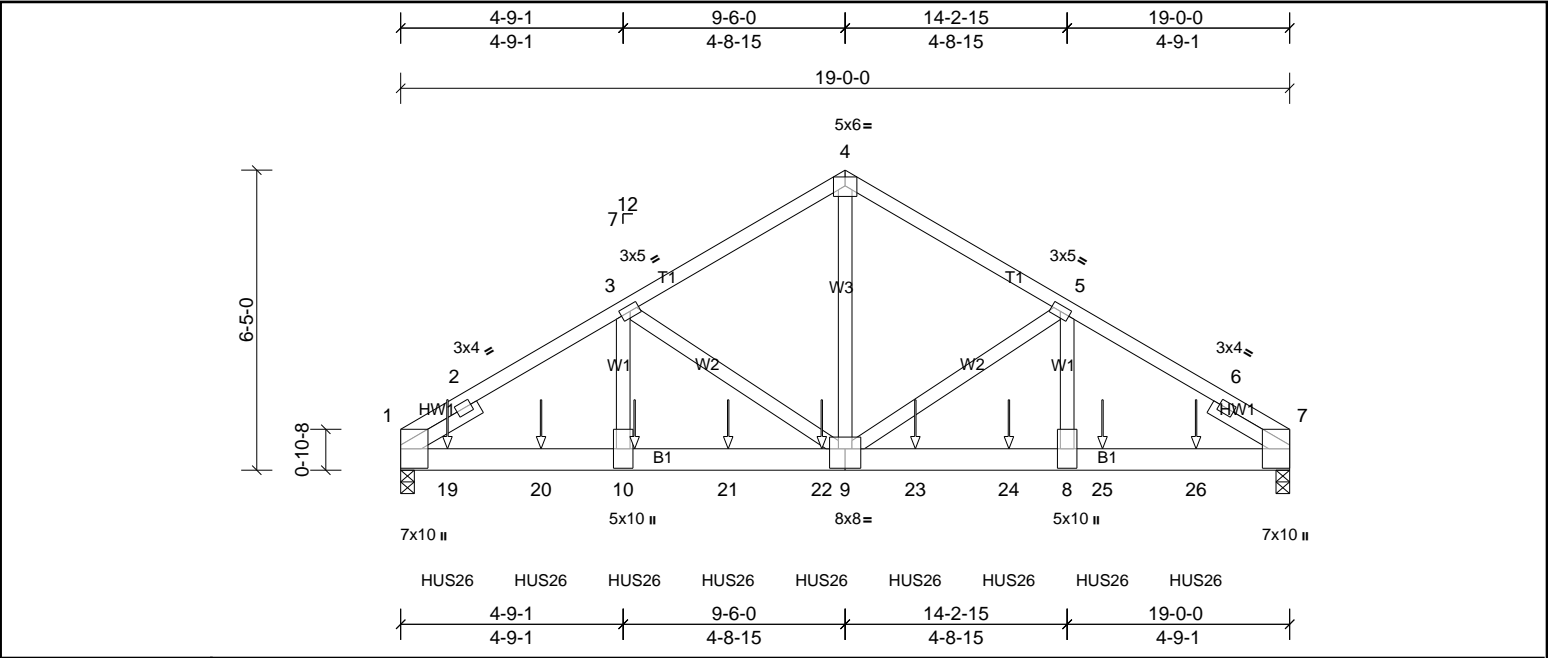


Plate Offsets (X, Y): [3:0-0-0,0-0-0], [7:0-0-0,0-0-0], [9:0-4-0,0-5-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.10	8-9	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.21	8-9	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.62	Horz(CT)	0.05	7	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							
										Weight: 349 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-10-14 oc purlins.
BOT CHORD	2x6 SP SS	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3 *Except* W3:2x4 SP No.2		
SLIDER	Left 2x4 SP No.3 -- 1-11-0, Right 2x4 SP No.3 -- 1-11-0		
REACTIONS			
(lb/size)	1=8406/0-3-8, (min. 0-3-5), 7=7603/0-3-8, (min. 0-3-0)		
Max Horiz	1=143 (LC 7)		
Max Uplift	1=795 (LC 8), 7=722 (LC 9)		
FORCES			
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.			
TOP CHORD	1-2=-7780/650, 2-3=-10841/1046, 3-4=-8022/816, 4-5=-8020/816, 5-6=-10748/1037, 6-7=-7090/624		
BOT CHORD	1-19=-923/9237, 19-20=-923/9237, 10-20=-923/9237, 10-21=-923/9237, 21-22=-923/9237, 9-22=-923/9237, 9-23=-818/9147, 23-24=-818/9147, 8-24=-818/9147, 8-25=-818/9147, 25-26=-818/9147, 7-26=-818/9147		
WEBS	4-9=-702/7626, 5-9=-2740/381, 5-8=-232/2906, 3-9=-2849/391, 3-10=-239/2992		

- NOTES**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-4-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc, Except member 3-10 2x4 - 2 rows staggered at 0-6-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 795 lb uplift at joint 1 and 722 lb uplift at joint 7.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Use Simpson Strong-Tie HUS26 (14-16d Girder, 4-16d Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-0-0 from the left end to 17-0-0 to connect truss(es) to front face of bottom chord.
 - Fill all nail holes where hanger is in contact with lumber.
- LOAD CASE(S)** Standard
- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-4=-60, 4-7=-60, 11-15=-20
Concentrated Loads (lb)
Vert: 10=-1601 (F), 19=-1642 (F), 20=-1601 (F), 21=-1601 (F), 22=-1601 (F), 23=-1601 (F), 24=-1601 (F), 25=-1601 (F), 26=-1642 (F)



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	P1	Truss	6	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:14

Page: 1

ID: ?U0N4ptCIVKm7v4p2qiEsTzFILK-tE81FX0q2bNPxnYq2sAajcp1mmgkbYhGw_1mfzuWeF


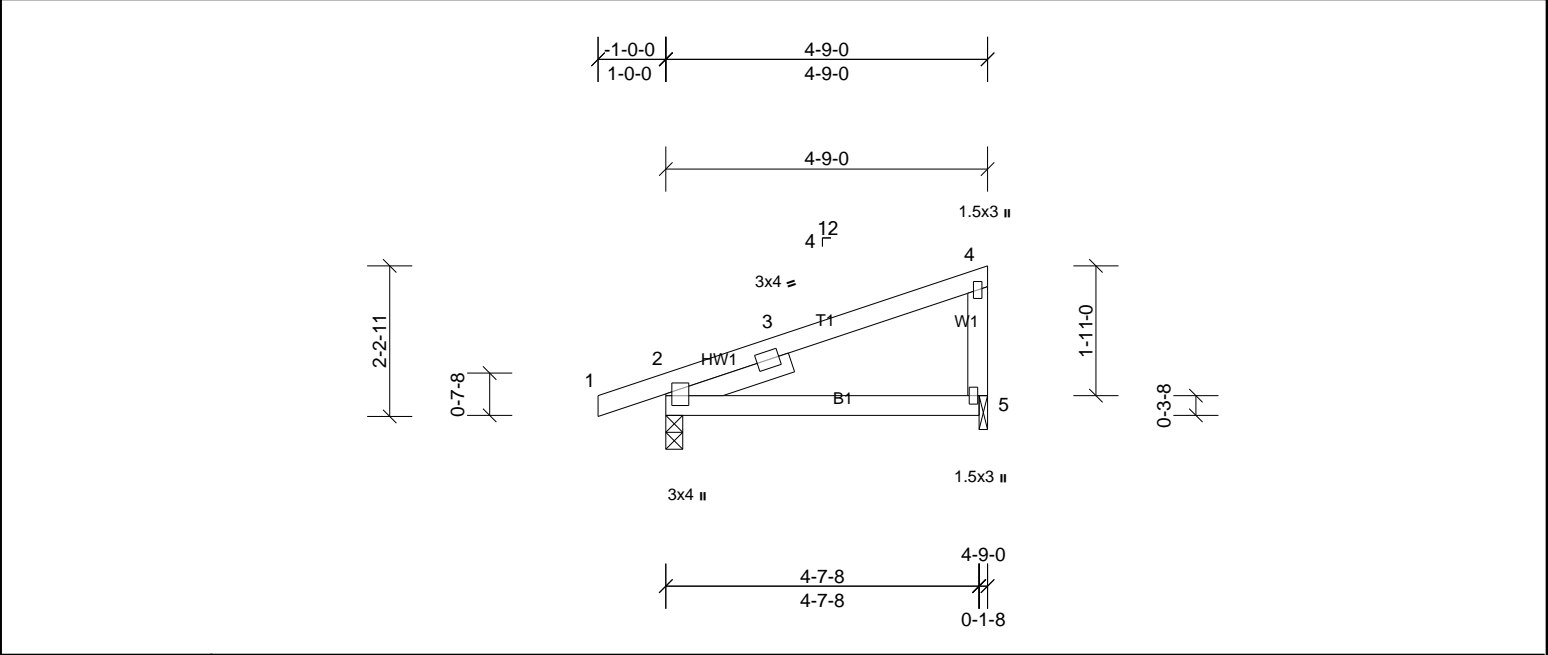


Plate Offsets (X, Y): [2:0-2-1,0-1-1]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	0.05	5-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.04	5-8	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 21 lb	FT = 20%

LUMBER				BRACING	
TOP CHORD	2x4 SP No.2			TOP CHORD	Structural wood sheathing directly applied or 4-9-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2			BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3				
SLIDER	Left 2x4 SP No.3 -- 1-11-0				
REACTIONS	(lb/size)	2=251/0-3-0, (min. 0-1-8), 5=178/0-1-8, (min. 0-1-8)			
	Max Horiz	2=84 (LC 9)			
	Max Uplift	2=121 (LC 6), 5=85 (LC 6)			
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.				

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 2 and 85 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

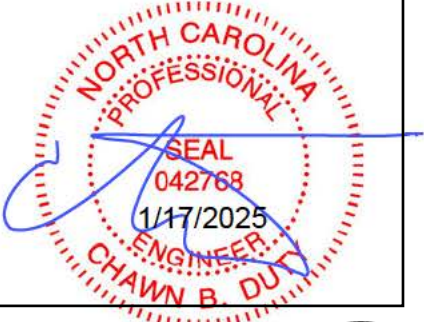

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	P1G	Truss	1	1	Job Reference (optional)

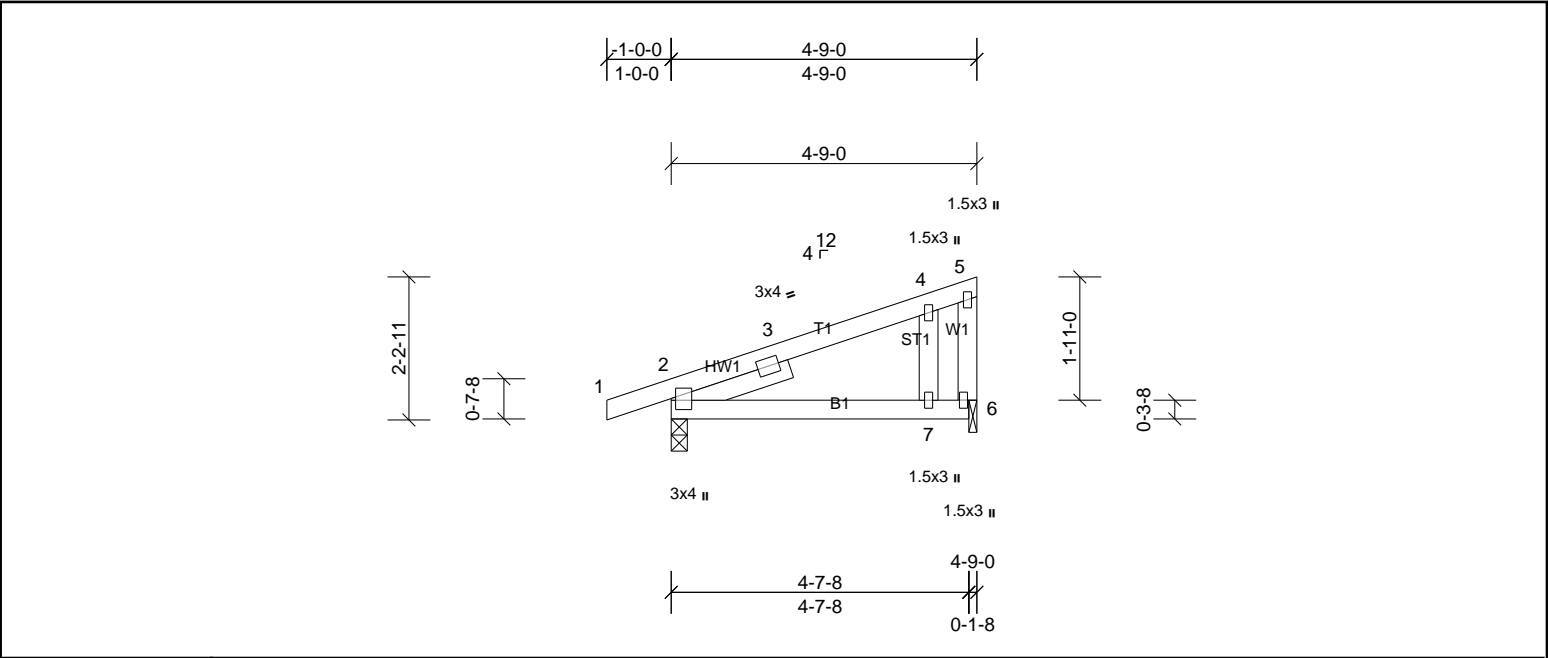


Plate Offsets (X, Y): [2:0-2-1,0-0-13]


Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	0.05	7-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.25	Vert(CT)	-0.05	7-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 23 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-9-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		
SLIDER	Left 2x4 SP No.3 -- 1-11-0		

REACTIONS	(lb/size)	2=251/0-3-0, (min. 0-1-8), 6=178/0-1-8, (min. 0-1-8)
	Max Horiz	2=84 (LC 9)
	Max Uplift	2=-121 (LC 6), 6=85 (LC 6)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-195/273

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 2 and 85 lb uplift at joint 6.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

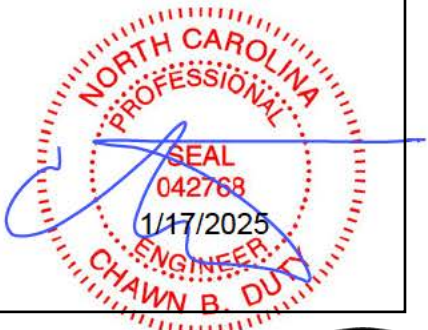

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	P2	Truss	5	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:14

Page: 1

ID:ZG9LhPZ3?TvkTa5y?v0e6SzFHWo-tE81FX0q2bNPxnYq2sAaijcgXmjekPDhGw_1mfzuWeF

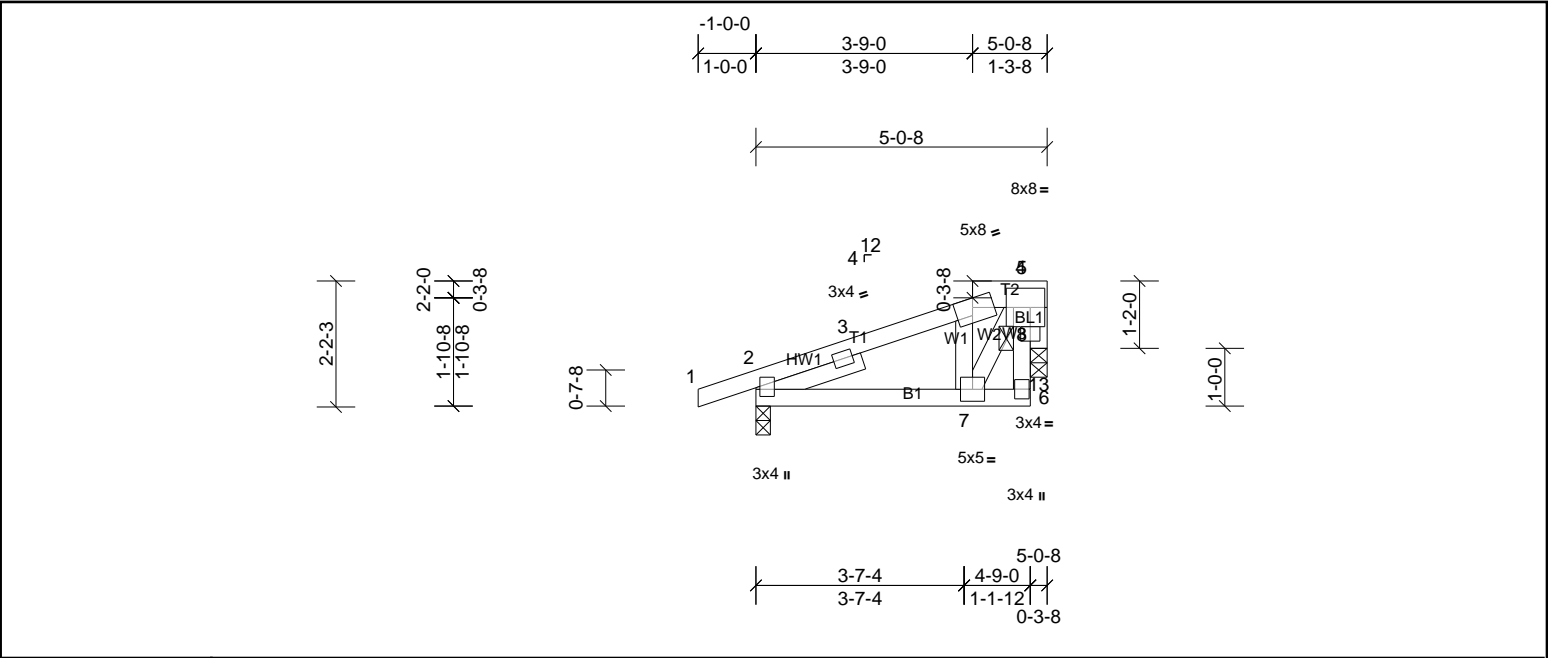


Plate Offsets (X, Y): [2:0-1-13,0-0-13], [5:0-1-8,0-4-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	0.03	7-11	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	0.02	7-11	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.79	Horz(CT)	-0.02	13	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 28 lb	FT = 20%


LUMBER		BRACING	
TOP CHORD	2x4 SP No.2 *Except* T2:2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-5.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 5-1-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		
SLIDER	Left 2x4 SP No.3 -- 1-11-0		

REACTIONS	(lb/size)	2=735/0-3-0, (min. 0-1-8), 13=1744/0-3-8, (min. 0-1-8)
	Max Horiz	2=77 (LC 6)
	Max Uplift	2=-316 (LC 6), 13=-704 (LC 6)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-655/733, 3-4=-1190/1365, 4-5=-1297/1496
BOT CHORD	2-7=-1301/1118, 6-7=-394/349
WEBS	5-7=-2239/1907, 4-7=-1828/2080, 5-13=-1835/2058

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 316 lb uplift at joint 2 and 704 lb uplift at joint 13.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1983 lb down and 2350 lb up at 3-9-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S)	Standard
1)	Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
	Uniform Loads (lb/ft)
	Vert: 1-4=-60, 4-5=-140, 6-9=-20
	Concentrated Loads (lb)
	Vert: 4=-1983

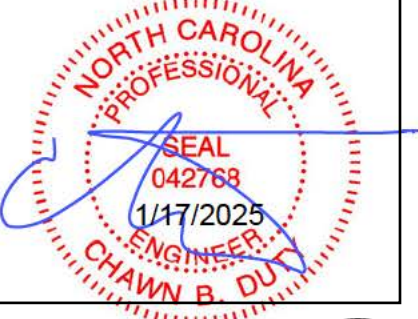

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	P2G	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:14

Page: 1

ID:ZG9LhPZ3?TvkTa5y?v0e6SzFHWo-tE81FX0q2bNPxnYq2sAajjchomipkPEhGw_1mfzuWeF

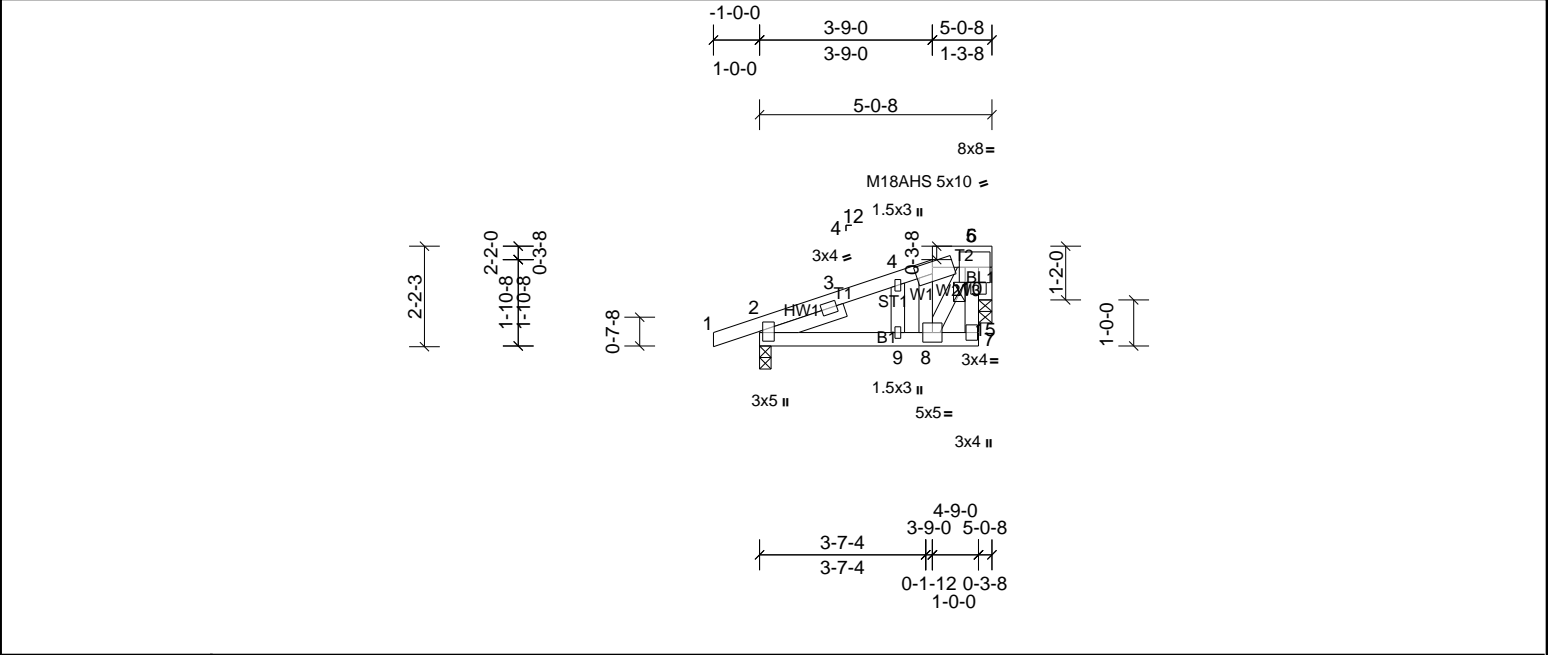


Plate Offsets (X, Y): [2:0-2-9,0-0-13], [5:0-5-0,0-0-8], [6:0-1-8,0-4-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	0.04	9-13	>999	240	M18AHS	186/179
TCDL	10.0	Lumber DOL	1.15	BC	0.48	Vert(CT)	0.03	9-13	>999	180	MT20	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.79	Horz(CT)	-0.02	15	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 30 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2 *Except* T2:2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins, except end
BOT CHORD	2x4 SP No.2		verticals, and 2-0-0 oc purlins: 5-6.
WEBS	2x4 SP No.3	BOT CHORD	Rigid ceiling directly applied or 4-11-7 oc bracing.
OTHERS	2x4 SP No.3		
SLIDER	Left 2x4 SP No.3 -- 1-11-0		

REACTIONS	(lb/size)	2=735/0-3-0, (min. 0-1-8), 15=1744/0-3-8, (min. 0-1-8)
	Max Horiz	2=77 (LC 6)
	Max Uplift	2=-316 (LC 6), 15=-704 (LC 6)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-686/791, 3-4=-1198/1359, 4-5=-1258/1434, 5-6=-1282/1480
BOT CHORD	2-9=-1313/1128, 8-9=-1313/1128, 7-8=-388/344
WEBS	6-8=-2237/1905, 5-8=-1633/1873, 6-15=-1834/2058

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - Gable studs spaced at 1-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 15 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 2.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 316 lb uplift at joint 2 and 704 lb uplift at joint 15.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1983 lb down and 2350 lb up at 3-9-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S)	Standard
1)	Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
	Uniform Loads (lb/ft)
	Vert: 1-5=-60, 5-6=-140, 7-11=-20
	Concentrated Loads (lb)
	Vert: 5=-1983



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	V2	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:15

Page: 1

ID:Qp6CyNmrVRUaDI1HI2HFPuyBNdd-LRiPSt1SpvVGZx71cZhpGx8?BA8gT1mqVajal5zuWeE

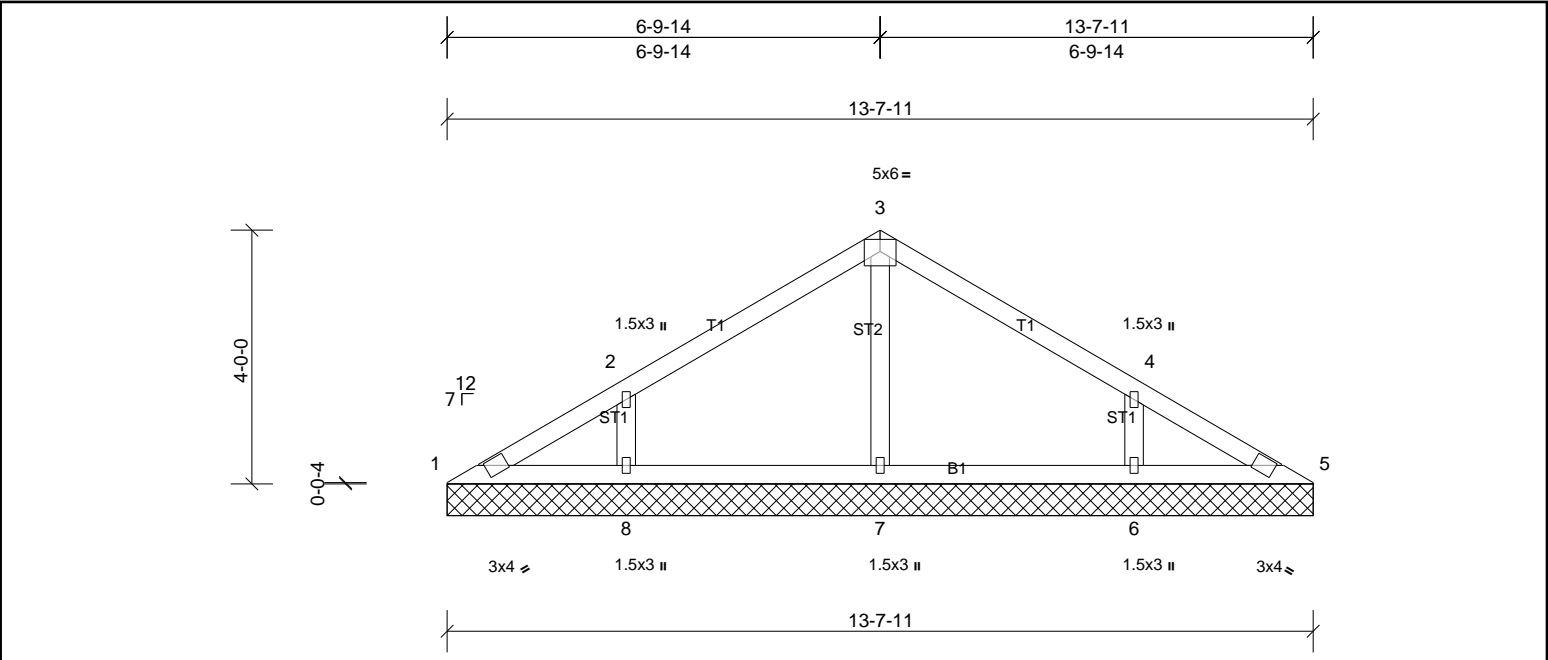


Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 50 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS	2x4 SP No.3		
REACTIONS			
	All bearings 13-7-11.		
(lb) - Max Horiz	1=99 (LC 6)		
Max Uplift	All uplift 100 (lb) or less at joint(s) 1 except 6=121 (LC 11), 8=122 (LC 10)		
Max Grav	All reactions 250 (lb) or less at joint(s) 1, 5 except 6=337 (LC 18), 7=298 (LC 1), 8=339 (LC 17)		
FORCES			
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
WEBS	2-8=261/164, 4-6=260/163		
NOTES			
1)	Unbalanced roof live loads have been considered for this design.		
2)	Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60		
3)	Gable requires continuous bottom chord bearing.		
4)	This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.		
5)	* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.		
6)	Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=122, 6=120.		
7)	This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.		



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	V3	Truss	1	1	Job Reference (optional)

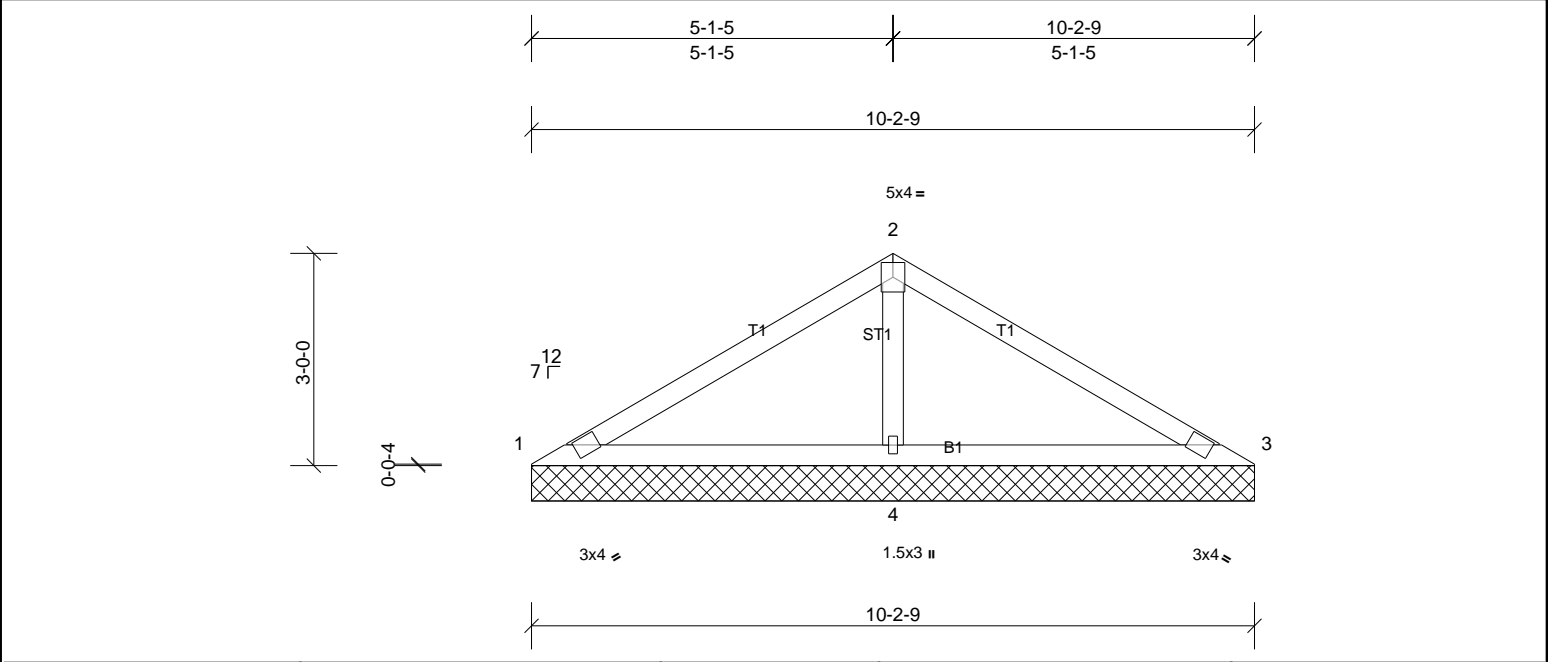

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 35 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS	(lb/size)	1=34/10-2-9, (min. 0-1-8), 3=34/10-2-9, (min. 0-1-8), 4=748/10-2-9, (min. 0-1-8)
	Max Horiz	1=73 (LC 7)
	Max Uplift	1=25 (LC 22), 3=25 (LC 21), 4=104 (LC 10)
	Max Grav	1=77 (LC 21), 3=77 (LC 22), 4=748 (LC 1)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-92/367, 2-3=-92/367
BOT CHORD	1-4=-299/136, 3-4=-299/136
WEBS	2-4=-573/201

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1, 25 lb uplift at joint 3 and 104 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	V4	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Fri Jan 17 08:28:15

Page: 1

ID:bf1xhKh4wbjRVqa7PnArAdyBNdj-LRiPSt1SpvVGZx71cZhpGx8zHA6ZT2oqVajal5zuWeE

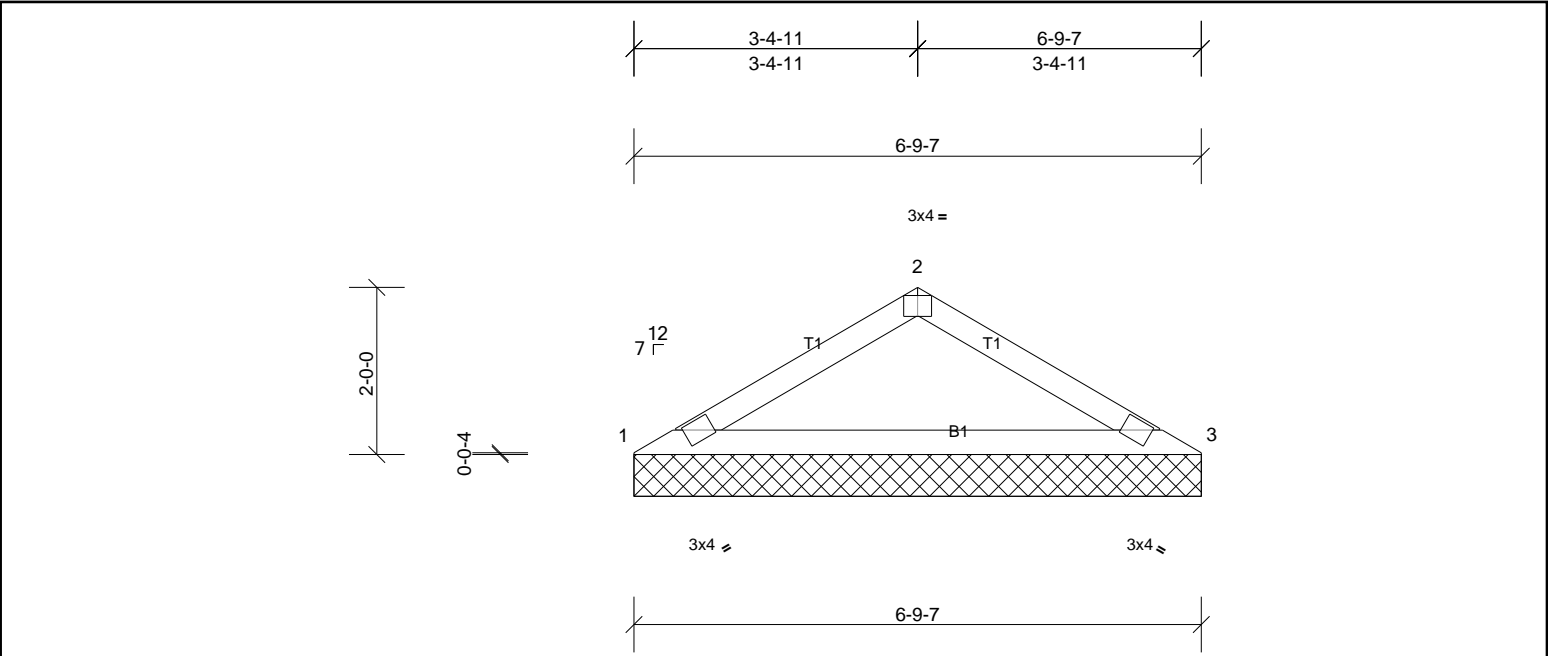


Plate Offsets (X, Y): [2:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.32	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.25	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 20 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS	(lb/size)		
	1=271/6-9-7, (min. 0-1-8), 3=271/6-9-7, (min. 0-1-8)		
	Max Horiz 1=47 (LC 8)		
	Max Uplift 1=36 (LC 10), 3=36 (LC 11)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-2=-478/112, 2-3=-310/101		
BOT CHORD	1-3=-87/399		

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 1 and 36 lb uplift at joint 3.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/ TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES-RUSSELL C ROOF
72501548	V5	Truss	1	1	Job Reference (optional)

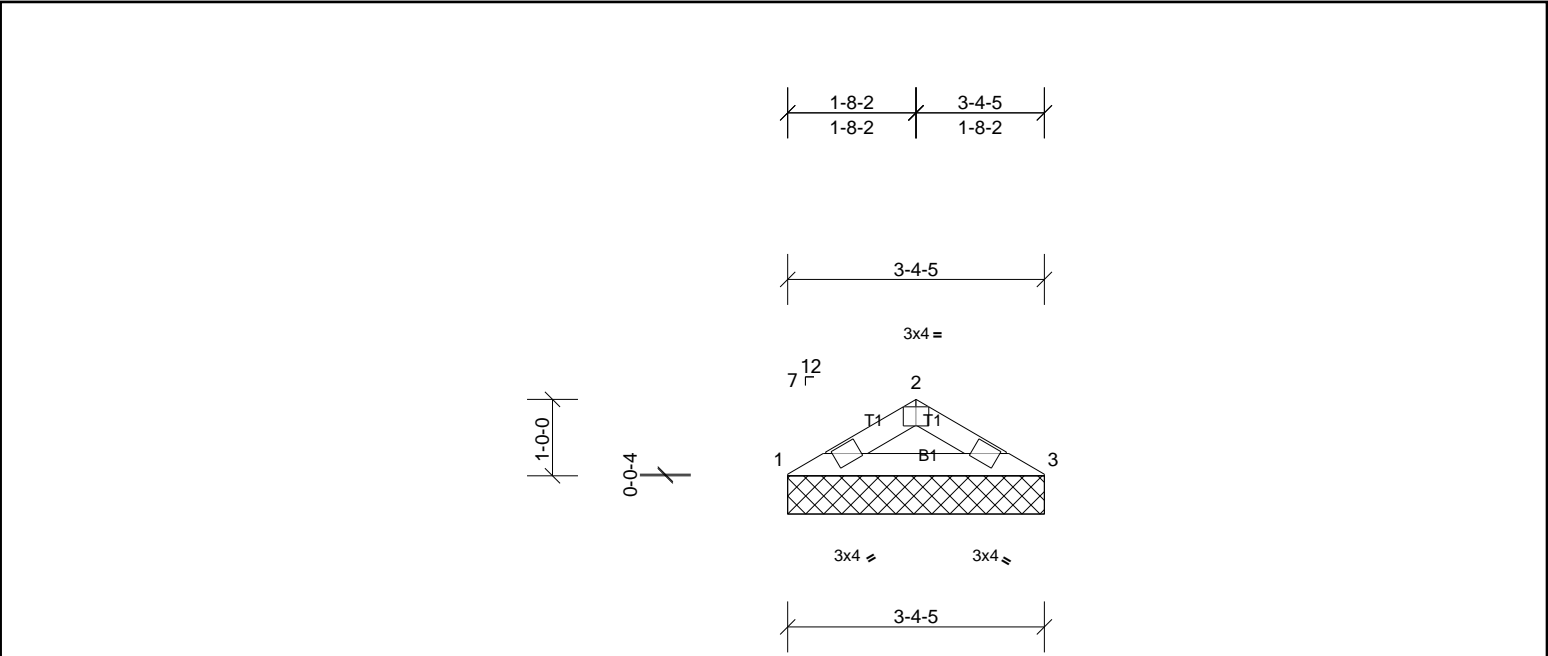


Plate Offsets (X, Y):		[2:0-2-0,Edge]										
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 9 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-4-5 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS			
(lb/size)	1=134/3-4-5, (min. 0-1-8), 3=134/3-4-5, (min. 0-1-8)		
Max Horiz	1=21 (LC 6)		
Max Uplift	1=18 (LC 10), 3=18 (LC 11)		

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 1 and 18 lb uplift at joint 3.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

