

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 58495

JOB: 25-3337-F01

JOB NAME: LOT 0.0020 HONEYCUTT HILLS

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

23 Truss Design(s)

Trusses:

F101, F102, F103, F103A, F103B, F104, F105, F106, F107, F108, F109, F110, F111, F111A, F112, F114, F115, F115A, F115B, F115C, F115D, F116, F117



4/14/2025

Mark Morris

My license renewal date for the state of North Carolina is 12/31/2025

Warning !—Verify design parameters and read notes before use.

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F101	Floor Supported Gable	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:50 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-YiXOZ5Q93NrWbnKCSuUot9aLf3WkbScCvYj pzQWrl

0-1-8

Scale = 1:32.7

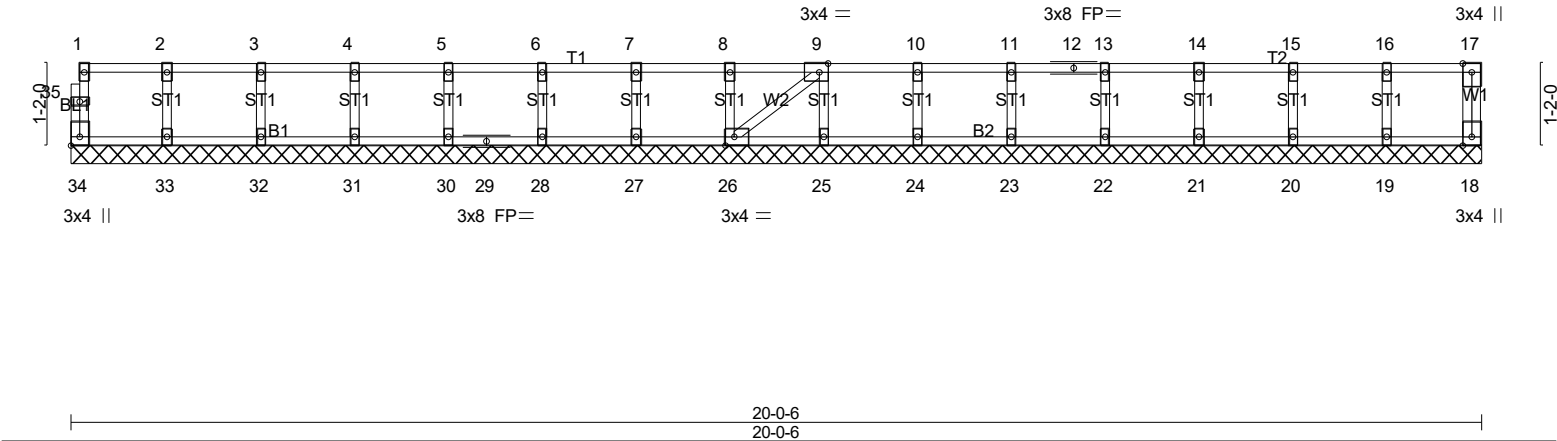


Plate Offsets (X,Y)-- [9:0-1-8,Edge], [26:0-1-8,Edge], [34:Edge,0-1-8]		20-0-6 20-0-6	
LOADING (psf)	SPACING- 1-7-3	CSL	DEFL. in (loc) l/defl L/d
TCLL 40.0	Plate Grip DOL 1.00	TC 0.05	Vert(LL) n/a - n/a 999
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 18 n/a n/a
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH	
		PLATES MT20	GRIP 244/190
		Weight: 86 lb FT = 20%F, 11%E	


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 20-0-6.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 18, 34, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 30, 31, 32, 33

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES- (7-8)
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard





4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F102	Floor	7	1	
					# 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:51 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-0u5mmRRnqhzNCxvO0KPjL5igd2LRTxUIR9K6GzQWrk

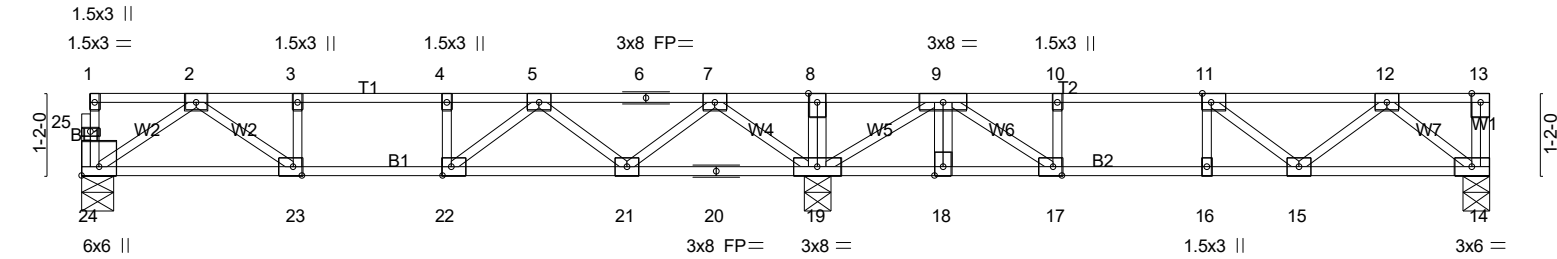

1-7-9	3-1-10	4-1-10	5-1-10	10-5-10	12-3-2	13-11-6	14-11-6	15-11-6	20-0-6
1-7-9	1-6-1	1-0-0	1-0-0	5-4-0	1-9-8	1-8-4	1-0-0	1-0-0	4-1-0
Plate Offsets (X,Y)-- [11:0-1-8,Edge], [17:0-1-8,Edge], [22:0-1-8,Edge], [23:0-1-8,Edge], [24:Edge,0-3-0]									

LOADING (psf)		SPACING- 1-7-3		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.33	Vert(LL)	-0.06	15-16	>999	480	MT20	244/190	
TCDL	10.0	Lumber DOL	1.00	BC	0.28	Vert(CT)	-0.05	16	>999	360			
BCLL	0.0	Rep Stress Incr	YES	WB	0.49	Horz(CT)	0.01	14	n/a	n/a			
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH							Weight: 102 lb	FT = 20%F, 11%E	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (lb/size) 24=336/0-5-6 (min. 0-1-8), 14=425/0-4-8 (min. 0-1-8), 19=1694/0-4-8 (min. 0-1-8)
Max Grav24=352(LC 10), 14=466(LC 4), 19=1694(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-668/8, 3-4=-668/8, 4-5=-668/8, 5-6=-124/340, 6-7=-124/340, 7-8=0/1220, 8-9=0/1221, 9-10=-1158/0, 10-11=-1158/0, 11-12=-848/0
BOT CHORD 23-24=0/425, 22-23=-8/668, 21-22=-177/489, 20-21=-507/0, 19-20=-507/0, 18-19=0/955, 17-18=0/955, 16-17=0/1158, 15-16=0/1158, 14-15=0/544
WEBS 5-22=0/394, 5-21=-528/0, 7-21=0/540, 7-19=-877/0, 11-15=-396/0, 12-15=0/396, 12-14=-690/0, 9-19=-2022/0, 9-17=0/397, 2-24=-513/0, 2-23=-55/300

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-24=-8, 1-13=-80
Concentrated Loads (lb)
Vert: 9=-720




4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F103	FLOOR	3	1	
Job Reference (optional)					# 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:51 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-0u5mmRRnqhzNCxvO0KPjL5ieK2E2TxhIR9K6GzQWrk



Scale = 1:17.4

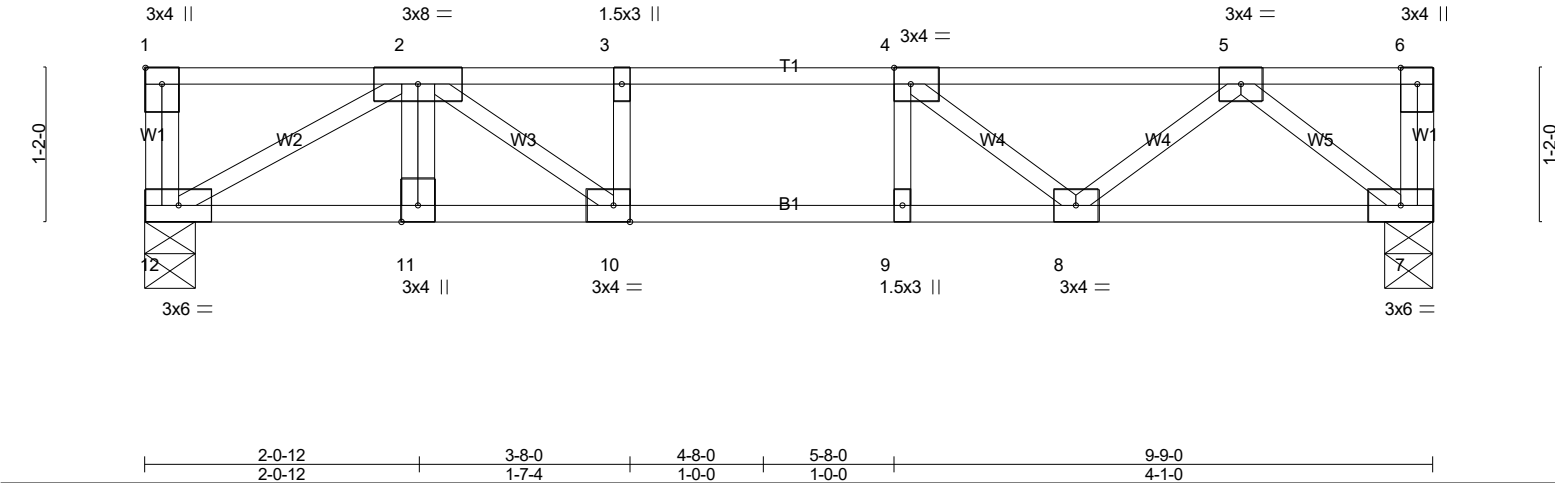


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [4:0-1-8,Edge], [10:0-1-8,Edge]		2-0-12 2-0-12		3-8-0 1-7-4		4-8-0 1-0-0		5-8-0 1-0-0		9-9-0 4-1-0	
LOADING (psf)		SPACING- 1-7-3		CSI.		DEFL. in (loc) l/defl L/d		PLATES		GRIP	
TCLL 40.0		Plate Grip DOL 1.00		TC 0.48		Vert(LL) -0.05 9 >999 480		MT20		244/190	
TCDL 10.0		Lumber DOL 1.00		BC 0.75		Vert(CT) -0.13 10-11 >905 360					
BCLL 0.0		Rep Stress Incr YES		WB 0.47		Horz(CT) 0.02 7 n/a n/a					
BCDL 5.0		Code IRC2021/TPI2014		Matrix-SH				Weight: 52 lb		FT = 20%F, 11%E	

LUMBER-		BRACING-	
TOP CHORD 2x4 SP No.1(flat)		TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 SP No.1(flat)		BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS 2x4 SP No.3(flat)			

REACTIONS. (lb/size) 12=992/0-4-8 (min. 0-1-8), 7=564/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1619/0, 3-4=-1619/0, 4-5=-1095/0
BOT CHORD 11-12=0/1710, 10-11=0/1711, 9-10=0/1619, 8-9=0/1619, 7-8=0/651
WEBS 4-8=-703/0, 5-8=0/578, 5-7=-826/0, 2-10=-290/0, 2-12=-1944/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 3) CAUTION, Do not erect truss backwards.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 7-12=-8, 1-6=-80
Concentrated Loads (lb)
Vert: 2=-720



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F103A	Floor	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:52 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-U5f8_nSPb75Eq5UbZ1wytlEt1Sh_CSVvfp4foizQWjr



Scale = 1:18.0

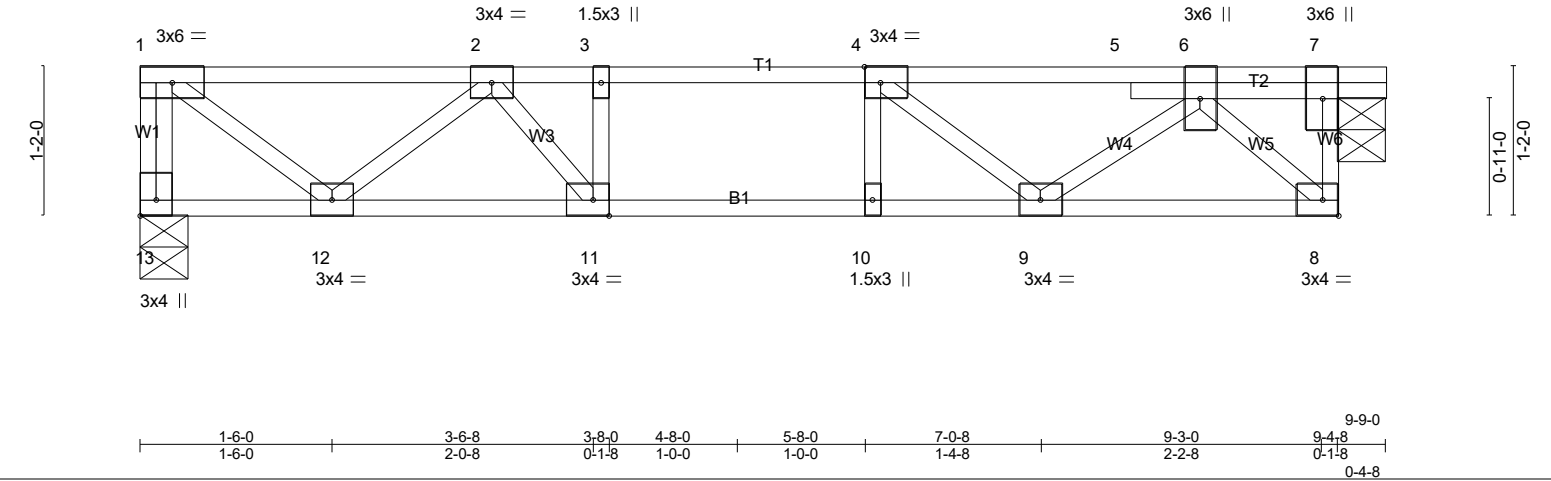


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [11:0-1-8,Edge], [13:Edge,0-1-8]

LOADING (psf)	SPACING-	1-7-3	CSL	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.23	Vert(LL)	-0.03	10	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.26	Vert(CT)	-0.04	10	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.25	Horz(CT)	-0.01	7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 51 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 13=404/0-4-8 (min. 0-1-8), 7=404/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-13=-397/0, 7-8=0/389, 1-2=-410/0, 2-3=-865/0, 3-4=-865/0, 4-5=-649/0, 5-6=-658/0
BOT CHORD 11-12=0/773, 10-11=0/865, 9-10=0/865, 8-9=0/398
WEBS 1-12=0/515, 2-12=-472/0, 2-11=0/291, 4-9=-312/0, 6-9=0/319, 6-8=-552/0

- NOTES- (5-6)
- Unbalanced floor live loads have been considered for this design.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

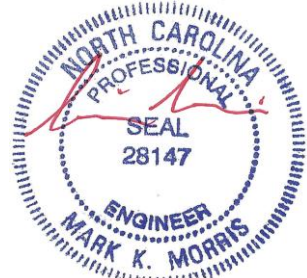


4/14/2025


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F103B	Floor	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:52 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-U5f8_nSPb75Eq5UbZ1wytlEtsSg1CSNvfp4foizQWjr



Scale = 1:17.4

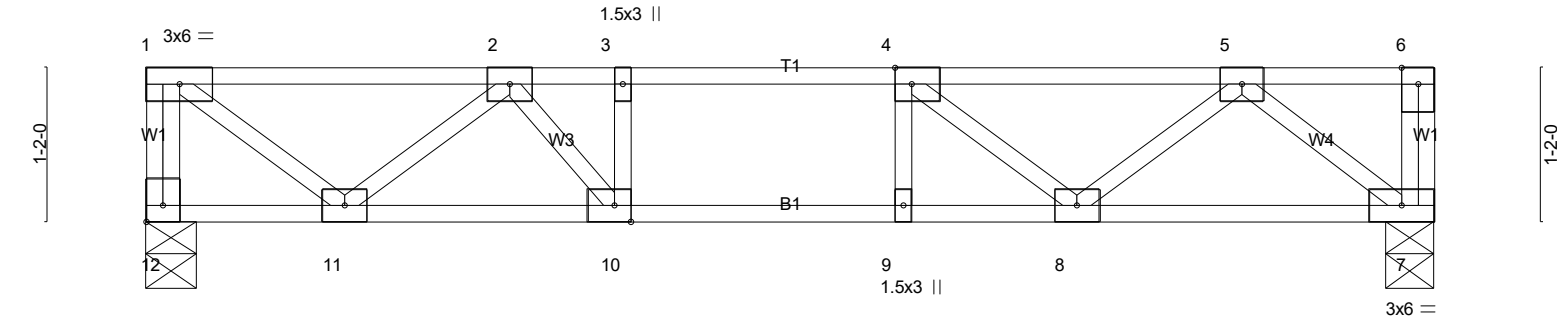

	1-6-0	3-6-8	3-8-0	4-8-0	5-8-0	7-0-8	9-6-0	9-9-0
	1-6-0	2-0-8	0-1-8	1-0-0	1-0-0	1-4-8	2-5-8	0-3-0

Plate Offsets (X,Y)-- [4:0-1-8,Edge], [10:0-1-8,Edge], [12:Edge,0-1-8]

LOADING (psf)	SPACING-	1-7-3	CSL	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.24	Vert(LL)	-0.04	9	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.32	Vert(CT)	-0.05	9	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.25	Horz(CT)	0.01	7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
										Weight: 50 lb FT = 20%F, 11%E

LUMBER-			BRACING-		
TOP CHORD	2x4 SP No.1(flat)		TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD	2x4 SP No.1(flat)		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS	2x4 SP No.3(flat)				

REACTIONS. (lb/size) 12=418/0-4-8 (min. 0-1-8), 7=418/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-12=-409/0, 1-2=-425/0, 2-3=-928/0, 3-4=-928/0, 4-5=-727/0
BOT CHORD 10-11=0/811, 9-10=0/928, 8-9=0/928, 7-8=0/492
WEBS 1-11=0/533, 2-11=-502/0, 2-10=0/327, 4-8=-288/0, 5-8=0/306, 5-7=-624/0

- NOTES- (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F104	FLOOR SUPPORTED GABL	1	1	Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:52 2025 Page 1
ID:UMCU2t6gUxCLqMlKo_q9qxyaVB1-U5f8_nSPb?5Eq5UbZ1wytIEwySI_CVyvp4foizQWjr

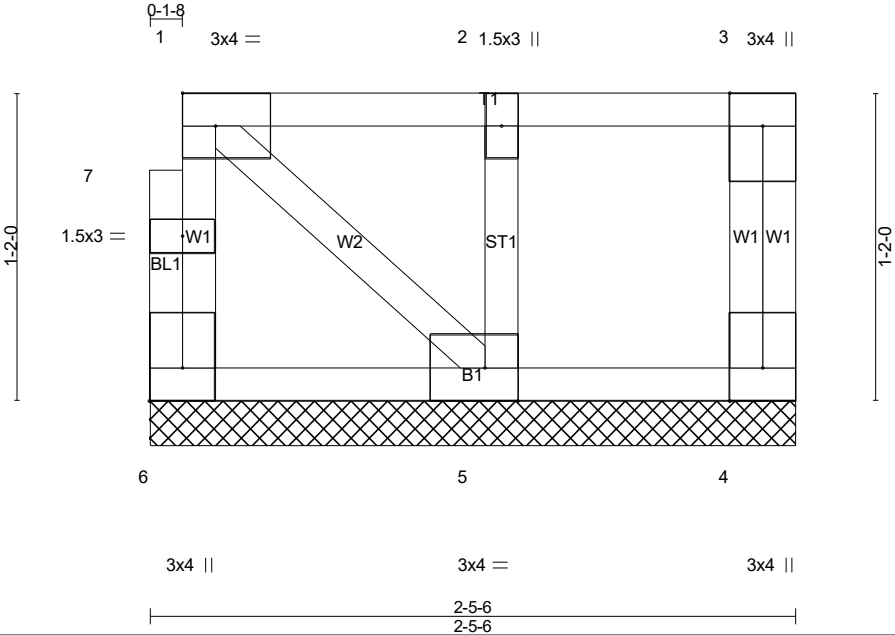


Plate Offsets (X,Y)--		[5:0-1-8,Edge], [6:Edge,0-1-8]	
LOADING (psf)	SPACING-	1-7-3	CSI.
TCLL 40.0	Plate Grip DOL	1.00	TC 0.04
TCDL 10.0	Lumber DOL	1.00	BC 0.01
BCLL 0.0	Rep Stress Incr	YES	WB 0.02
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P
DEFL.	in (loc)	l/defl	L/d
Vert(LL)	n/a	-	n/a 999
Vert(CT)	n/a	-	n/a 999
Horz(CT)	0.00	4	n/a
PLATES	GRIP		
MT20	244/190		
Weight: 16 lb		FT = 20%F, 11%E	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 2-5-6 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 6=38/2-5-6 (min. 0-1-8), 4=31/2-5-6 (min. 0-1-8), 5=119/2-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES- (6-7)
- 1) Gable requires continuous bottom chord bearing.
 - 2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 3) Gable studs spaced at 1-4-0 oc.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard





4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F105	Floor	4	1	
					# 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:53 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9xyaVB1-yHDWB7T2MID5SF3n7IRBQWn0ks_FxsV2uTpCK8zQWri

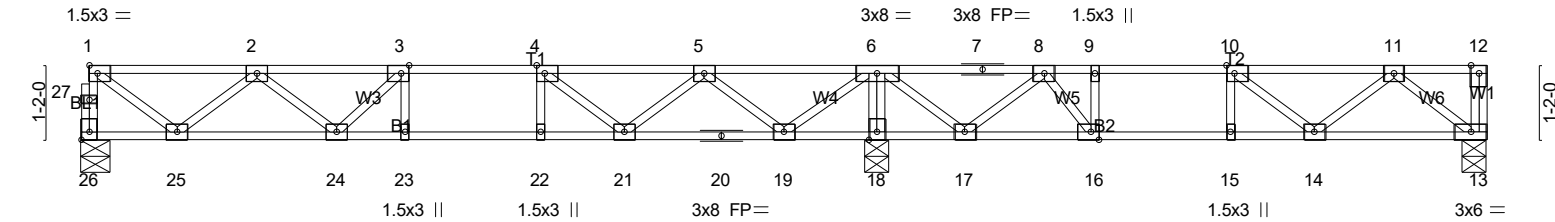

1-6-0	4-0-0	5-1-10	6-1-10	7-1-10	8-6-2	11-0-2	12-5-10	13-10-2	15-9-14	15-11-6	16-11-6	17-11-6	19-3-14	21-9-6	22-0-6
1-6-0	2-6-0	1-1-10	1-0-0	1-0-0	1-4-8	2-6-0	1-5-8	1-4-8	1-11-12	0-1-8	1-0-0	1-0-0	1-4-8	2-5-8	0-3-0
Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [10:0-1-8,Edge], [16:0-1-8,Edge], [26:Edge,0-1-8]															

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.36	Vert(LL)	-0.07	23	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.45	Vert(CT)	-0.09	23	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.39	Horz(CT)	0.02	13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
										Weight: 110 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 26=488/0-5-6 (min. 0-1-8), 18=1073/0-4-8 (min. 0-1-8), 13=349/0-4-8 (min. 0-1-8)
Max Grav 26=501(LC 10), 18=1073(LC 1), 13=388(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 26-27=-497/0, 1-27=-496/0, 1-2=-551/0, 2-3=-1228/0, 3-4=-1369/0, 4-5=-1080/0, 5-6=-253/25, 6-7=-220/324, 7-8=-220/324, 8-9=-792/18, 9-10=-792/18, 10-11=-653/0
BOT CHORD 24-25=0/1028, 23-24=0/1369, 22-23=0/1369, 21-22=0/1369, 20-21=0/796, 19-20=0/796, 18-19=-654/0, 17-18=-657/0, 16-17=-162/625, 15-16=-18/792, 14-15=-18/792, 13-14=0/460
WEBS 9-16=-272/0, 6-18=-1032/0, 1-25=0/665, 2-25=-621/0, 2-24=0/260, 4-21=-440/0, 5-21=0/416, 5-19=-726/0, 6-19=0/817, 6-17=0/565, 8-17=-599/0, 8-16=0/487, 11-14=-11/252, 11-13=-584/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:54 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_g9qxyaVB1-QTnuPTUg7cLy3PezhSyQyikBYGKQgKdB77ZmsazQWrh

0-1-8



A horizontal timeline representing the 2010-2011 season. The timeline is a horizontal line with vertical tick marks. Above the line, dates are listed: 5-1-10, 6-1-10, 7-1-10, 12-1-10, 12-5-10, 15-11-6, 16-11-6, 17-11-6, and 22-0-6. Below the line, corresponding scores are listed: 5-1-10, 1-0-0, 1-0-0, 5-0-0, 0-4-0, 3-5-12, 1-0-0, 1-0-0, and 4-1-0. The timeline shows a sequence of events over time, with the final event occurring on 22-0-6.

Date	Score
5-1-10	5-1-10
6-1-10	1-0-0
7-1-10	1-0-0
12-1-10	5-0-0
12-5-10	0-4-0
15-11-6	3-5-12
16-11-6	1-0-0
17-11-6	1-0-0
22-0-6	4-1-0

LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.35	Vert(LL) -0.07 24-25	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.46	Vert(CT) -0.09 24	>999	360		
BCLL 0.0	Rep Stress Incr YES	WB 0.33	Horz(CT) 0.02 14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH				Weight: 113 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 27=484/0-5-6 (min. 0-1-8), 19=1715/0-4-8 (min. 0-1-8), 14=352/0-4-8 (min. 0-1-8)
Max Grav 27=498(LC 10), 19=1715(LC 1), 14=388(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 27-28=-494/0, 1-28=-493/0, 1-2=-548/0, 2-3=-1218/0, 3-4=-1355/0, 4-5=-1056/0,
6-7=0/723, 7-8=-224/330, 8-9=-224/330, 9-10=-791/20, 10-11=-791/20, 11-12=-653/0

BOT CHORD 25-26=0/1022, 24-25=0/1355, 23-24=0/1355, 22-23=0/1355, 21-22=0/765, 20-21=0/765,
19-20=-537/0, 18-19=-643/0, 17-18=-155/618, 16-17=-20791, 15-16=-20791, 14-15=0/460


WEBS 6-19=-1266/0, 10-17=-261/0, 7-19=-576/0, 1-26=0/661, 2-26=-618/0, 2-25=0/255,
12-15=-11/251, 12-14=-584/0, 4-22=-452/0, 5-22=0/423, 5-20=-724/0, 6-20=0/701,
7-18=0/573, 9-18=-596/0, 9-17=0/472

NOTES- (5-6)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0" o.c. and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 4) CAUTION, Do not erect truss backwards.
- 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-27=-8, 1-13=-80
Concentrated Loads (lb)
Vert: 6=-640

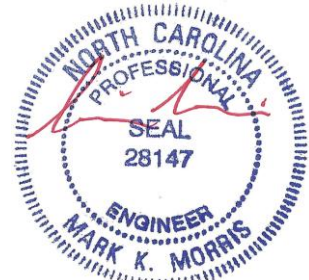


4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:55 2025 Page 1
ID:UMCU2t6gUxCLgMIKo q9qxyaVB1-ugLGcpUluwTohYD9F9TFvxsHvgdkPnLLnJP1zQWrg

Scale = 1:36.1



LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.70	Vert(LL) -0.07 24-25	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.58	Vert(CT) -0.12 15-16	>969	360		
BCLL 0.0	Rep Stress Incr YES	WB 0.37	Horz(CT) 0.02 14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH				Weight: 114 lb	FT = 20%F, 11%E

BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 19-20,18-19.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD
27-28=-506/0, 1-28=-505/0, 13-14=-554/0, 1-2=-562/0, 2-3=-1261/0, 3-4=-1421/0,
4-5=-1148/0, 5-6=-354/0, 6-7=0/543, 7-8=-467/56, 8-9=-467/56, 9-10=-1283/0,
10-11=-1283/0, 11-12=-1283/0, 12-13=-621/0
25-26=0/1049, 24-25=0/1421, 23-24=0/1421, 22-23=0/1421, 21-22=0/872, 20-21=0/872,
19-20=-362/0, 18-19=-450/0, 17-18=0/973, 16-17=0/1283, 15-16=0/1117

BOT CHORD
6-19=-1225/0, 10-17=-413/0, 7-19=-675/0, 1-26=0/679, 2-26=-634/0, 2-25=0/276,
3-25=-269/0, 13-15=0/779, 12-15=-646/0, 4-22=-409/0, 5-22=0/396, 5-20=-704/0,
6-20=0/675, 7-18=0/690, 9-18=-741/0, 9-17=0/700

WEBS

NOTES- (5-6)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Recommend 2x6 strongbacks, on edge, spaced at 10'-0" o.c. and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 4) CAUTION, Do not erect truss backwards.
- 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.


A circular professional engineer seal for the State of North Carolina. The outer ring contains the text "NORTH CAROLINA" at the top and "ENGINEER" at the bottom. Inside this ring, the word "PROFESSIONAL" is at the top and "SEAL" is at the bottom. The center of the seal features the license number "28147" and the name "MARK K. MORRIS" in a stylized font. A red ink signature is written across the seal, overlapping the "PROFESSIONAL" and "SEAL" text.

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F108	FLOOR	1	1	Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:55 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-ugLGcpUluwTohYD9F9TfVxsNCgdmPnQLLnJP1zQWrg

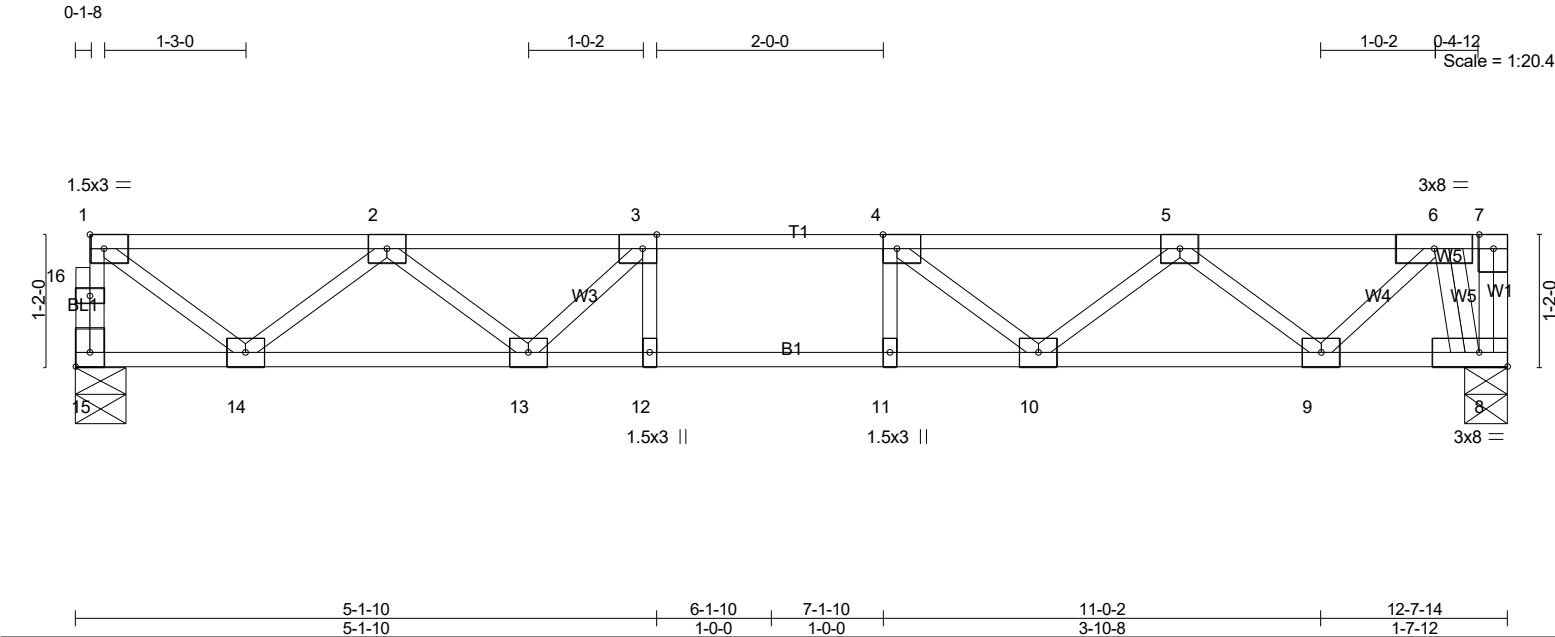

LOADING (psf)	SPACING-	1-7-3	CS.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.30	Vert(LL)	-0.08 10-11	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.58	Vert(CT)	-0.12 10-11	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.36	Horz(CT)	0.02 8	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 66 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 15=561/0-5-6 (min. 0-1-8), 8=1165/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 15-16=-559/0, 1-16=-558/0, 1-2=-630/0, 2-3=-1458/0, 3-4=-1720/0, 4-5=-1562/0, 5-6=-896/0
BOT CHORD 13-14=0/1173, 12-13=0/1720, 11-12=0/1720, 10-11=0/1720, 9-10=0/1360, 8-9=0/468
WEBS 1-14=0/761, 2-14=-707/0, 2-13=0/395, 3-13=-463/0, 4-10=-304/0, 5-10=0/281, 5-9=-603/0, 6-9=0/586, 6-8=-1291/0

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION. Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

- LOAD CASE(S)** Standard
- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-15=-8, 1-7=-80
Concentrated Loads (lb)
Vert: 6=-640
 - 2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-15=-8, 1-7=-80
Concentrated Loads (lb)
Vert: 6=-640
 - 3) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-15=-8, 1-4=-80, 4-7=-16



Continued on page 2

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F108	FLOOR	1	1	Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:55 2025 Page 2
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-ugLGcpUluwTohYD9F9TfVxsNCgdmPnQLLnJP1zQWrg

- LOAD CASE(S)** Standard
Concentrated Loads (lb)
Vert: 6=-640
- 4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-15=-8, 1-3=-16, 3-7=-80
Concentrated Loads (lb)
Vert: 6=-640
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-15=-8, 1-4=-80, 4-7=-16
Concentrated Loads (lb)
Vert: 6=-640
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-15=-8, 1-3=-16, 3-7=-80
Concentrated Loads (lb)
Vert: 6=-640




4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F109	FLOOR	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:56 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-Nsvfq9VwDbfJioMot?u28PWF3wq8C3UaR2sxTzQWrf

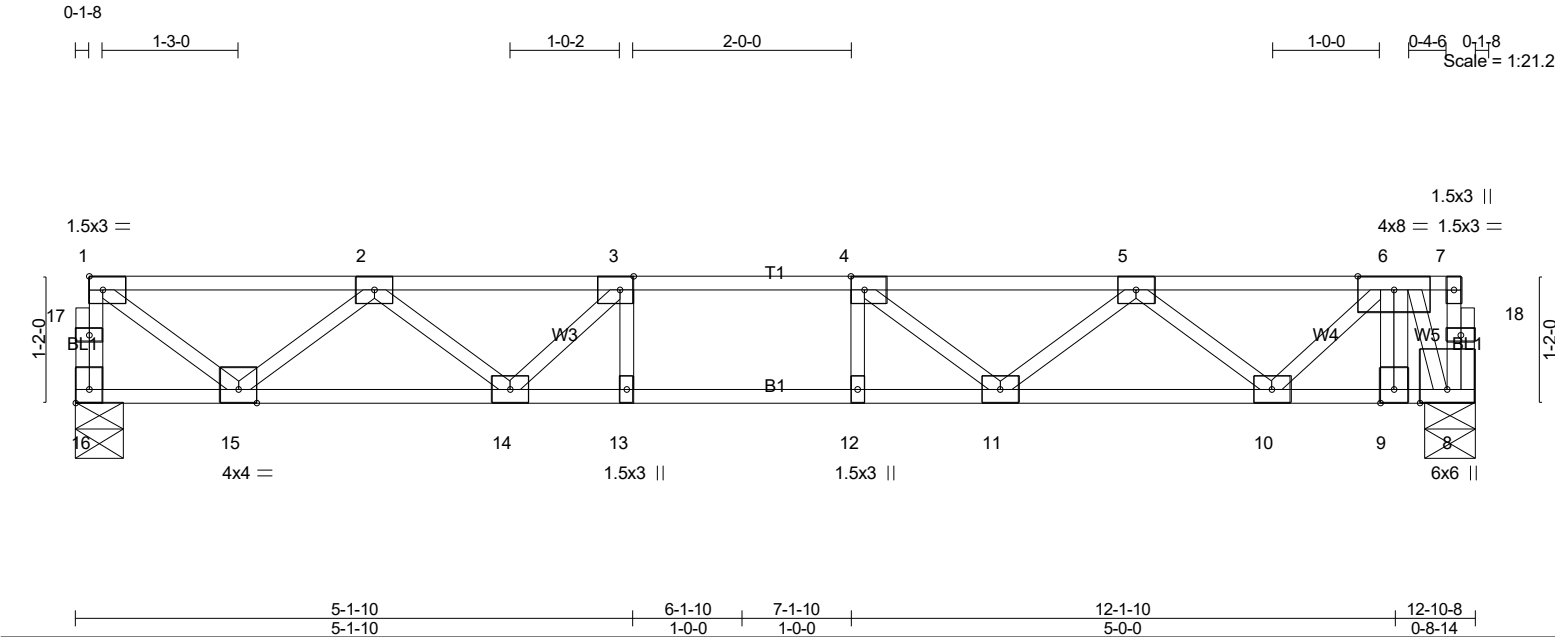

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.41	Vert(LL)	-0.11 11-12	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.78	Vert(CT)	-0.17 11-12	>894	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.47	Horz(CT)	0.03 8	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 68 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 16=718/0-5-6 (min. 0-1-8), 8=1298/0-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 16-17=-715/0, 1-17=-714/0, 1-2=-809/0, 2-3=-1884/0, 3-4=-2244/0, 4-5=-2082/0, 5-6=-1287/0
BOT CHORD 14-15=0/1505, 13-14=0/2244, 12-13=0/2244, 11-12=0/2244, 10-11=0/1853, 9-10=0/747, 8-9=0/747
WEBS 1-15=0/977, 2-15=-907/0, 2-14=0/521, 3-14=-620/0, 4-11=-352/20, 5-11=0/332, 5-10=-737/0, 6-10=0/730, 6-8=-1507/0

- NOTES- (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION. Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

- LOAD CASE(S) Standard
- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-16=-10, 1-7=-100
Concentrated Loads (lb)
Vert: 6=-640
 - 2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-16=-10, 1-7=-100
Concentrated Loads (lb)
Vert: 6=-640
 - 3) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-16=-10, 1-4=-100, 4-7=-20

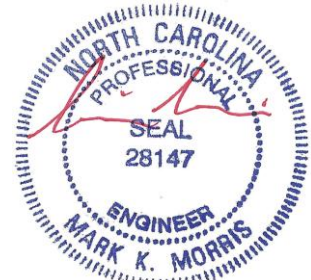

Continued on page 2

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F109	FLOOR	1	1	Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:56 2025 Page 2
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-Nsvfq9VwfDbfJioMot?u28PWF3wq8C3UaR2sxTzQWrf

- LOAD CASE(S)** Standard
Concentrated Loads (lb)
Vert: 6=-640
- 4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-16=-10, 1-3=-20, 3-7=-100
Concentrated Loads (lb)
Vert: 6=-640
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-16=-10, 1-4=-100, 4-7=-20
Concentrated Loads (lb)
Vert: 6=-640
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-16=-10, 1-3=-20, 3-7=-100
Concentrated Loads (lb)
Vert: 6=-640



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:56 2025 Page 1
ID:UMCU2t6qUXLqMlKo q9gxvaVB1-Nsvfq9VwFdbfJioMot?u28Pcm36w8l3UaR2sxTzQWrf

0-1-8

[illegible]

12-10-8
12-10-8

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 10-13--729/0

NOTES- (7-8)

- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
- 2) Gable requires continuous bottom chord bearing.
- 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 4) Gable studs spaced at 1-4-0 oc.
- 5) Load case(s) 1, 2 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-22=-8, 1-11=-80
Concentrated Loads (lb)
Vert: 10=-640

2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-22=-8, 1-11=-80
Concentrated Loads (lb)
Vert: 10=-640



4/14/2025


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F111	FLOOR	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:56 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-Nsvfq9VwfDbfJioMot?u28PZ436X8JZUaR2sxTzQWrf



Scale = 1:17.2

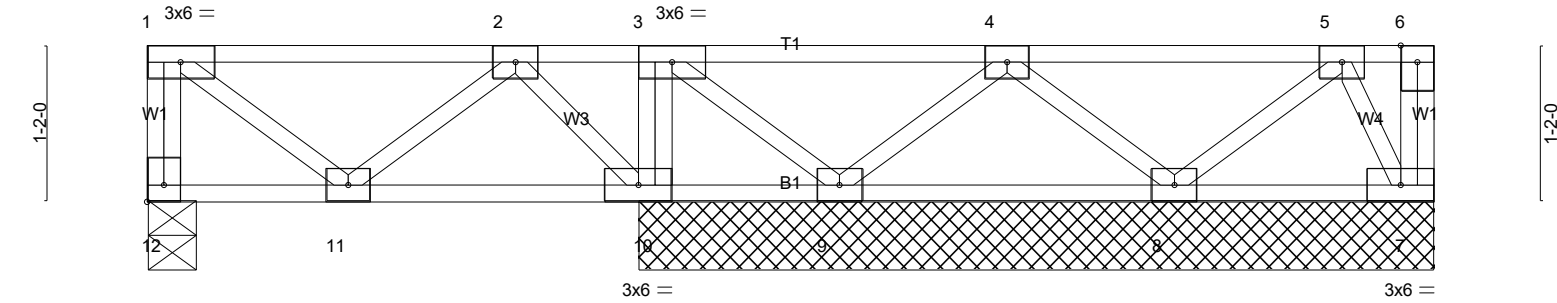

1-6-0	3-8-0	3-9-8	5-2-0	7-8-0	9-4-4	9-7-4
1-6-0	2-2-0	0-1-8	1-4-8	2-6-0	1-8-4	0-3-0

Plate Offsets (X,Y)-- [12:Edge,0-1-8]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.22	Vert(LL)	-0.00	11	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.03	Vert(CT)	-0.00	11	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 54 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 9-10.
WEBS 2x4 SP No.3(flat)	

REACTIONS. All bearings 5-11-4 except (jt=length) 12=0-4-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 12, 7, 9, 8 except 10=513(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-10=-347/0

- NOTES-** (5-6)
- 1) All plates are 3x4 MT20 unless otherwise indicated.
 - 2) Load case(s) 1, 2 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

- LOAD CASE(S)**
- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 7-12=-8, 1-6=-80
Concentrated Loads (lb)
Vert: 3=-240
 - 2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 7-12=-8, 1-6=-80
Concentrated Loads (lb)
Vert: 3=-240

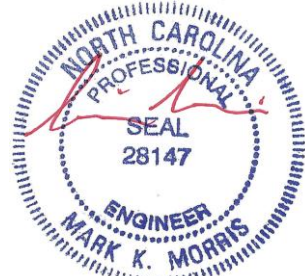

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F111A	Floor	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:56 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-Nsvfq9VwfDbfJioMot?u28PZK3698JSUaR2sxTzQWrf

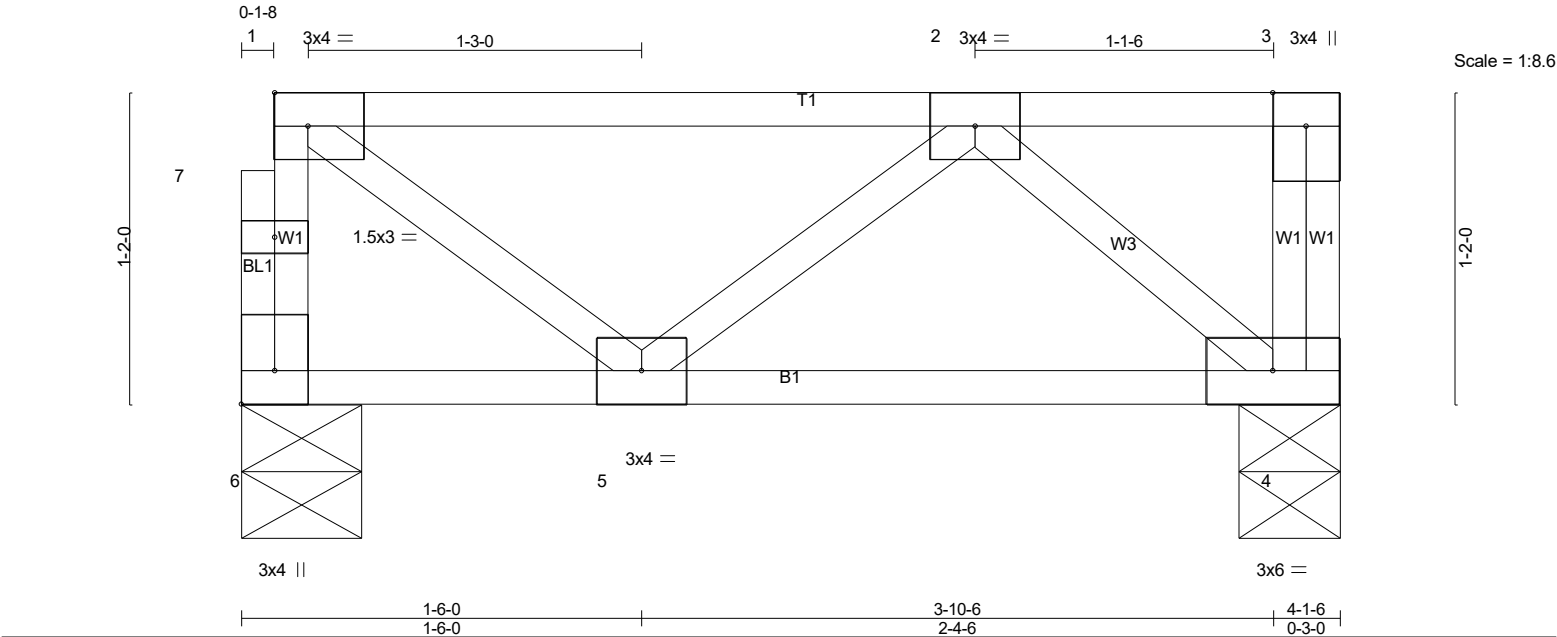


Plate Offsets (X,Y)-- [6:Edge,0-1-8]							
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 40.0	Plate Grip DOL	1.00	TC 0.21	Vert(LL)	-0.00	5	>999
TCDL 10.0	Lumber DOL	1.00	BC 0.05	Vert(CT)	-0.00	4-5	>999
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	4	n/a
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P				
				PLATES	GRIP		
				MT20	244/190		
				Weight: 24 lb		FT = 20%F, 11%E	


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-1-6 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (lb/size) 6=401/0-5-6 (min. 0-1-8), 4=174/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 6-7=-399/0, 1-7=-398/0

- NOTES- (4-5)
- Load case(s) 1, 2 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

- LOAD CASE(S) Standard
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 4-6=-8, 1-3=-80
Concentrated Loads (lb)
Vert: 1=-240
 - Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 4-6=-8, 1-3=-80
Concentrated Loads (lb)
Vert: 1=-240

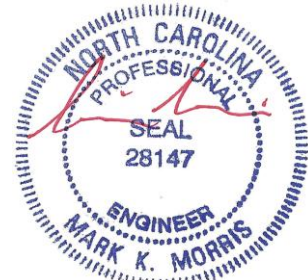

4/14/2025


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F112	Floor Supported Gable	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:57 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-r2S11VWYPXjWwsMYMaW7aMyncTS7tkSep5nQTvzQWre

0-1-8

Scale = 1:21.6

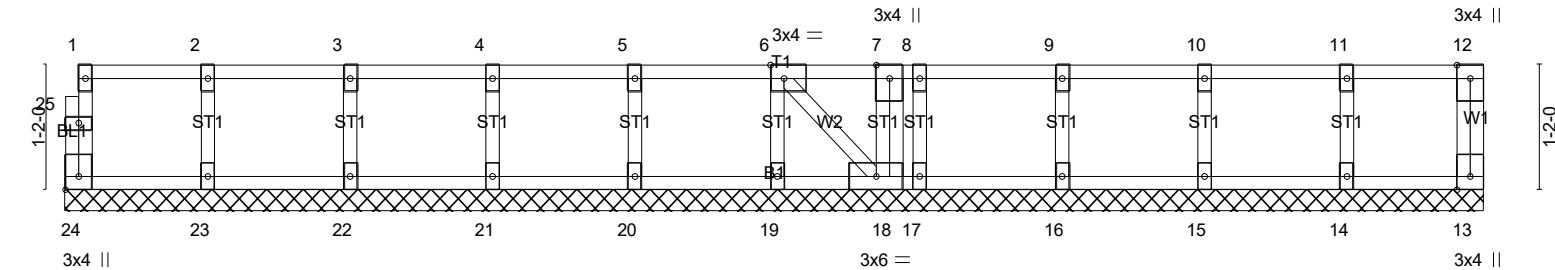

7-8-10		13-3-6
7-8-10		5-6-12

Plate Offsets (X,Y)-- [6:0-1-8,Edge], [24:Edge,0-1-8]									
LOADING (psf)		SPACING- 1-7-3		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL 40.0		Plate Grip DOL 1.00		TC 0.05		Vert(LL) n/a - n/a	999	MT20	244/190
TCDL 10.0		Lumber DOL 1.00		BC 0.01		Vert(CT) n/a - n/a	999		
BCLL 0.0		Rep Stress Incr YES		WB 0.07		Horz(CT) 0.00 13 n/a	n/a		
BCDL 5.0		Code IRC2021/TPI2014		Matrix-SH				Weight: 61 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 13-3-6.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 13, 23, 22, 21, 20, 19, 17, 16, 15, 14 except 24=279(LC 1), 18=654(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 24-25=-275/0, 1-25=-275/0
WEBS 7-18=-635/0

- NOTES-** (8-9)
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Load case(s) 1, 2 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.
 - 8) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 9) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard	
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00	
Uniform Loads (plf)	
Vert: 13-24=-8, 1-12=-80	
Concentrated Loads (lb)	
Vert: 1=-240 7=-640	
2) Dead: Lumber Increase=1.00, Plate Increase=1.00	
Uniform Loads (plf)	
Vert: 13-24=-8, 1-12=-80	
Concentrated Loads (lb)	
Vert: 1=-240 7=-640	



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F114	FLOOR SUPPORTED GABL	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:57 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-r2S11VWYPXjWwsMYMaW7aMynNTS8tl7ep5nQTvzQWre

0-1-8

Scale = 1:37.5

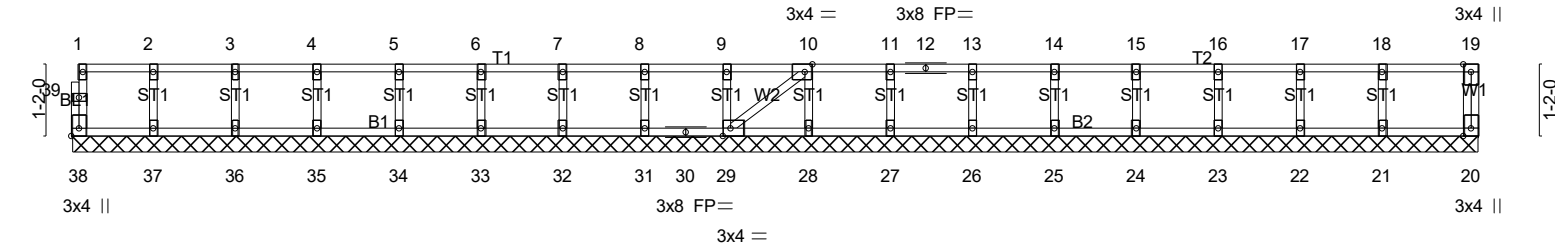


Plate Offsets (X,Y)--	[10:0-1-8,Edge], [29:0-1-8,Edge], [38:Edge,0-1-8]
-----------------------	---

LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL)	n/a -	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT)	n/a -	n/a	999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00 20	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH					Weight: 97 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 22-10-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 38, 20, 37, 36, 35, 34, 33, 32, 31, 29, 28, 27, 26, 25, 24, 23, 22, 21

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES- (7-8)
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:57 2025 Page 1
D:UMCU2t6gUxCLqMIKo_g9qxyaVB1-r2S11VWYPXjWwsMYMaW7aMydgTITtdLep5nQTvzQWre

Plate Offsets (X,Y)-- [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [25:0-1-8,Edge], [28:Edge,0-1-8]									
LOADING (psf)		SPACING- 1-7-3		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.68	Vert(LL)	-0.09 25-26 >999 480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.69	Vert(CT)	-0.19 16-17 >603 360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.53	Horz(CT)	0.03 14 n/a n/a		
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH				Weight: 117 lb	FT = 20%F, 11%E

REACTIONS. (lb/size) 28=576/0-5-6 (min. 0-1-8), 14=698/0-4-8 (min. 0-1-8), 20=1793/0-4-8 (min. 0-1-8)
Max Grav 28=586(LC 10), 14=748(LC 4), 20=1793(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 28-29=582/0, 1-29=581/0, 13-14=735/0, 1-2=665/0, 2-3=1539/0, 3-4=1878/0,
4-5=1878/0, 5-30=1636/0, 6-30=1636/0, 6-7=686/0, 7-8=686/0, 8-9=0/837,
9-10=604/135, 10-11=1554/0, 11-12=1547/0, 12-31=594/0, 13-31=594/0


BOT CHORD 26-27=0/1244, 25-26=0/1816, 24-25=0/1878, 23-24=0/1878, 22-23=0/1380, 21-22=0/1380,
20-21=311/23, 19-20=837/0, 18-19=0/1554, 17-18=0/1554, 16-17=0/1554, 15-16=0/1361

WEBS 10-18=0/363, 11-17=320/0, 9-20=842/0, 1-27=0/804, 2-27=754/0, 2-26=0/385,
3-26=360/0, 3-25=48/344, 5-23=374/0, 6-23=0/375, 6-21=940/0, 8-21=0/949,
8-20=1096/0, 9-19=0/1106, 10-19=1374/0, 12-15=998/0, 13-15=0/868

NOTES- (6-7)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 5) CAUTION, Do not erect truss backwards.
- 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-30=-80, 30-31=-160, 13-31=-80
 2) Dead: Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-30=-80, 30-31=-160, 13-31=-80

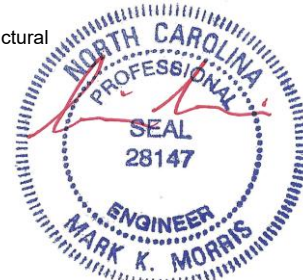

Continued on page 2

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F115	FLOOR	2	1	Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:57 2025 Page 2
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-r2S11VWYPXjWwsMYMaW7aMydgTITtdLep5nQTvzQWre

LOAD CASE(S) Standard

- 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-31=-96, 13-31=-16
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-31=-96, 13-31=-16
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 7) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-5=-80, 5-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-4=-16, 4-30=-80, 30-31=-160, 13-31=-80
- 9) 3rd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 11-30=-160, 11-31=-96, 13-31=-16
- 10) 4th chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-10=-96, 10-31=-160, 13-31=-80
- 11) 5th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-5=-80, 5-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 12) 6th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-4=-16, 4-30=-80, 30-31=-160, 13-31=-80
- 13) 7th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 11-30=-160, 11-31=-96, 13-31=-16
- 14) 8th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-10=-96, 10-31=-160, 13-31=-80



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:58 2025 Page 1
ID:UMCU2t6gUXcLqMlko g9qxyaVB1-JF0PEqXAArrNY0xkw1M7ZUsBtfmc77n2IXz?MzQWrd

[illegible]

LUMBER-	
TOP CHORD	2x4 SP No.1(flat)
BOT CHORD	2x4 SP No.1(flat)
WEBS	2x4 SP No.3(flat)
BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 28-29=-553/0, 1-29=-552/0, 13-14=-403/0, 1-2=-626/0, 2-3=-1436/0, 3-4=-1692/0,
4-5=-1692/0, 5-6=-1384/0, 6-7=-541/0, 7-8=-541/0, 8-9=0/694, 9-10=-352/379,
10-11=-836/113, 11-12=-826/0, 12-13=-319/0

BOT CHORD 26-27=0/1172, 25-26=0/1669, 24-25=0/1692, 23-24=0/1692, 22-23=0/1083, 21-22=0/1083,
20-21=-322/5, 19-20=-694/0, 18-19=-113/836, 17-18=-113/836, 16-17=-113/836,
15-16=0/720

WEBS 9-20=-452/0, 1-27=0/757, 2-27=-711/0, 2-26=0/344, 3-26=-303/0, 3-25=-134/262,
5-23=-460/0, 6-23=0/435, 6-21=-742/0, 8-21=0/766, 8-20=-794/0, 9-19=0/619,
10-19=-767/0, 12-15=-522/0, 13-15=0/466

NOTES- (5-6)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Recommend 2x6 strongbacks, on edge, spaced at 10'-0" oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 4) CAUTION, Do not erect truss backwards.
- 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:58 2025 Page 1
ID:UMCU2t6gUxCLqMlKo q9gxyaVB1-JF0PEqXAArrNY0xkw11M7ZUpitdmc5Kn2lXz?MzQWrd

[illegible]


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.3(flat)		6-0-0 oc bracing: 20-21,19-20.
REACTIONS. (lb/size) 28=564/0-5-6 (min. 0-1-8), 14=431/0-4-8 (min. 0-1-8), 20=1749/0-4-8 (min. 0-1-8) Max Grav28=574(LC 10), 14=479(LC 4), 20=1749(LC 1)			
FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.			
TOP CHORD	28-29=-571/0, 1-29=-570/0, 13-14=-472/0, 1-2=-649/0, 2-3=-1498/0, 3-4=-1803/0, 4-5=-1803/0, 5-30=-1535/0, 6-30=-1535/0, 6-7=-547/0, 7-8=-547/0, 8-9=0/1014, 9-10=-340/390, 10-11=-1139/0, 11-31=-1062/0, 12-31=-1062/0, 12-13=-385/0		
BOT CHORD	26-27=0/1215, 25-26=0/1757, 24-25=0/1803, 23-24=0/1803, 22-23=0/1262, 21-22=0/1262, 20-21=-484/0, 19-20=-1014/0, 18-19=0/1139, 17-18=0/1139, 16-17=0/1139, 15-16=0/872		
WEBS	10-18=0/256, 9-20=-806/0, 1-27=0/785, 2-27=-737/0, 2-26=0/368, 3-26=-337/0, 3-25=-85/311, 5-23=-409/0, 6-23=0/399, 6-21=-967/0, 8-21=0/984, 8-20=-1105/0, 9-19=0/1007, 10-19=-1173/0, 12-15=-635/0, 13-15=0/561		

LOAD CASE(S) Standard

1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 30-31=-160, 13-31=-80

2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-30=-80, 30-31=-160, 13-31=-80

3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

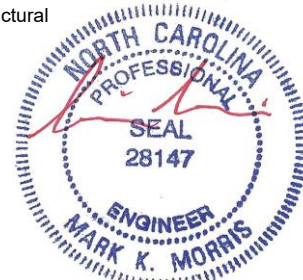

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F115B	FLOOR	2	1	Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:58 2025 Page 2
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-JF0PEqXAArrNY0xkwI1M7ZUpitdmc5Kn2IXz?MzQWrd

- LOAD CASE(S)** Standard
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-31=-96, 13-31=-16
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-31=-96, 13-31=-16
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 7) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-5=-80, 5-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-4=-16, 4-30=-80, 30-31=-160, 13-31=-80
- 9) 3rd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-80, 11-30=-160, 11-31=-96, 13-31=-16
- 10) 4th chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-10=-96, 10-31=-160, 13-31=-80
- 11) 5th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-5=-80, 5-30=-16, 9-30=-96, 9-31=-160, 13-31=-80
- 12) 6th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-4=-16, 4-30=-80, 30-31=-160, 13-31=-80
- 13) 7th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-80, 11-30=-160, 11-31=-96, 13-31=-16
- 14) 8th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (plf)
- Vert: 14-28=-8, 1-30=-80, 9-30=-160, 9-10=-96, 10-31=-160, 13-31=-80



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F115C	FLOOR	1	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:59 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-nRanSAXox8zEAAWxU?Ybfn114H?DLaNxGPGXYozQWrc

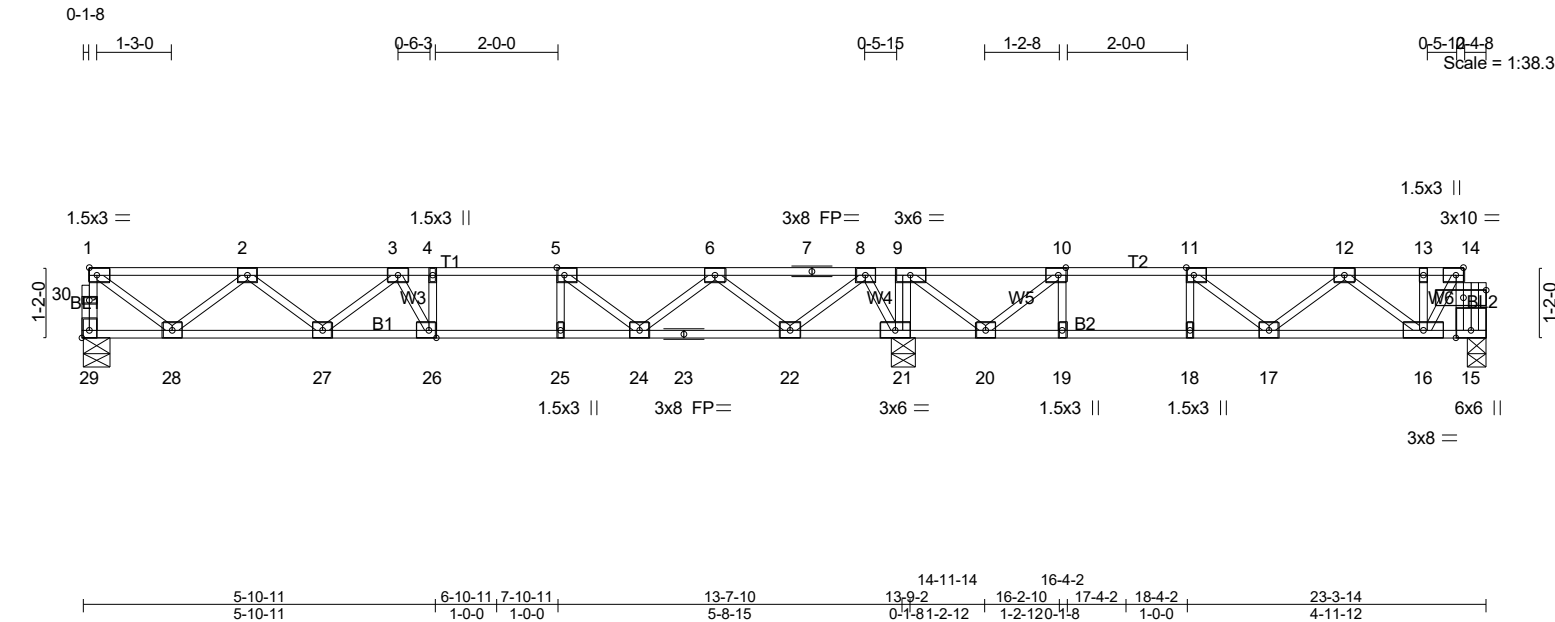


Plate Offsets (X,Y)--		[5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [14:0-1-8,Edge], [14:0-4-8,0-1-8], [26:0-1-8,Edge], [29:Edge,0-1-8]	
LOADING (psf)	SPACING-	1-7-3	CSI.
TCLL 40.0	Plate Grip DOL	1.00	TC 0.43
TCDL 10.0	Lumber DOL	1.00	BC 0.61
BCLL 0.0	Rep Stress Incr	YES	WB 0.36
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH
			DEFL. in (loc) l/defl L/d
			Vert(LL) -0.09 26-27 >999 480
			Vert(CT) -0.12 26-27 >999 360
			Horz(CT) 0.03 15 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 120 lb FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 29=547/0-5-6 (min. 0-1-8), 15=355/0-3-8 (min. 0-1-8), 21=1111/0-4-8 (min. 0-1-8)
Max Grav29=558(LC 10), 15=403(LC 4), 21=1111(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 29-30=-553/0, 1-30=-552/0, 14-15=-398/0, 1-2=-626/0, 2-3=-1438/0, 3-4=-1693/0, 4-5=-1693/0, 5-6=-1386/0, 6-7=-544/0, 7-8=-544/0, 8-9=0/692, 9-10=-346/378, 10-11=-819/114, 11-12=-792/0, 12-13=-276/0, 13-14=-279/0
BOT CHORD 27-28=0/1173, 26-27=0/1671, 25-26=0/1693, 24-25=0/1693, 23-24=0/1086, 22-23=0/1086, 21-22=-321/7, 20-21=-692/0, 19-20=-114/819, 18-19=-114/819, 17-18=-114/819, 16-17=0/674
WEBS 9-21=-449/0, 1-28=0/757, 2-28=-712/0, 2-27=0/344, 3-27=-304/0, 3-26=-133/263, 5-24=-460/0, 6-24=0/435, 6-22=-742/0, 8-22=0/766, 8-21=-792/0, 9-20=0/610, 10-20=-753/0, 12-16=-508/0, 14-16=0/439

NOTES- (5-6)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.
5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

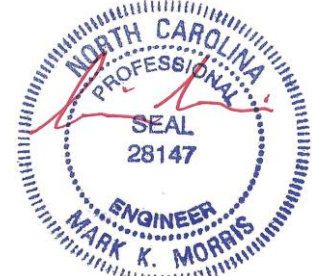

4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 National Design Standard for Metal Plate Connected Wood Truss Construction and BCSI 1-03 Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:59 2025 Page 1
ID:UMCU2t6qUxCLqMIKo q9gxvaVB1-nRanSAXox8zEAAWxU?Ybfn1v9HwJLY5xGPGXYozQWrc

[illegible]

LUMBER- TOP CHORD 2x4 SP No.1(flat) BOT CHORD 2x4 SP No.1(flat) *Except* B2: 2x4 SP SS(flat) WEBS 2x4 SP No.3(flat)	BRACING- TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 20-21 2-2-0 oc bracing: 18-19.
REACTIONS. (lb/size) 29=571/0-5-6 (min. 0-1-8), 21=1315/0-4-8 (min. 0-1-8), 15=778/0-4-8 (min. 0-1-8) Max Grav 29=581(LC 10), 21=1315(LC 1), 15=829(LC 4)	

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 29-30=-578/0, 1-30=-577/0, 1-2=-658/0, 2-3=-1522/0, 3-4=-1848/0, 4-5=-1848/0, 5-6=-1592/0, 6-7=-807/0, 7-8=-807/0, 8-9=-252/336, 9-10=-988/0, 10-11=-1934/0, 11-12=-2510/0, 12-13=-1680/0


BOT CHORD 27-28=0/1232, 26-27=0/1792, 25-26=0/1848, 24-25=0/1848, 23-24=0/1323, 22-23=0/1323, 21-22=0/341, 20-21=-336/252, 19-20=0/1934, 18-19=0/1934, 17-18=0/1934, 16-17=0/2510, 15-16=0/935

WEBS 12-17=-462/0, 10-19=0/460, 11-18=-506/0, 9-21=-592/0, 1-28=0/796, 2-28=-747/0, 2-27=0/378, 3-27=-352/0, 3-26=-57/333, 5-24=-379/0, 6-24=0/383, 6-22=-701/0, 8-22=0/710, 8-21=-821/0, 9-20=0/1011, 10-20=-1369/0, 11-17=0/1073, 12-16=-1041/0, 13-16=0/969, 13-15=-1226/0

NOTES- (5-6)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Recommend 2x6 strongbacks, on edge, spaced at 10'-0" o.c. and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 4) CAUTION, Do not erect truss backwards.
- 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 15-29=-8, 1-14=-80
 Concentrated Loads (lb)
 Vert: 12=-640


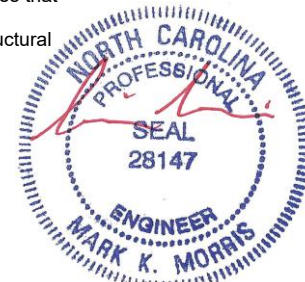


4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0020 HONEYCUTT HILLS 380 SHELBY MEADOW LANE ANGIER, NC
25-3337-F01	F116	Floor	13	1	
					Job Reference (optional) # 58495

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:45:59 2025 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-nRanSAXox8zEAAWxU?Ybfn13MH2QLZ2xGPgXYozQWrc

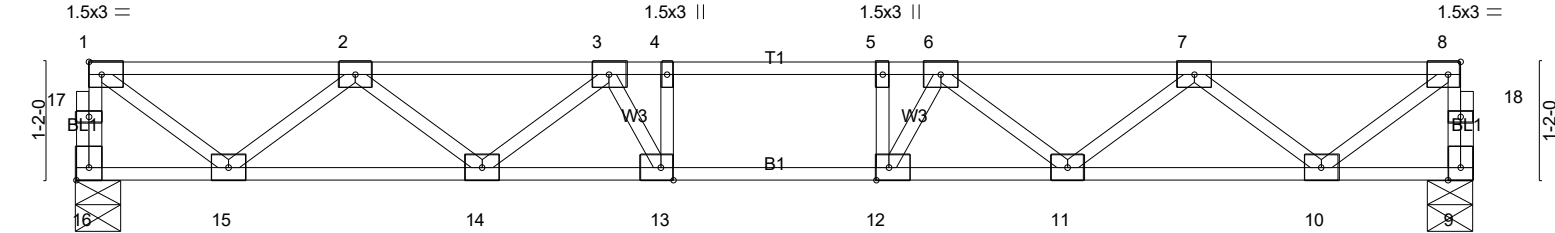

5-10-10	6-10-10	7-10-10	13-9-4
5-10-10	1-0-0	1-0-0	5-10-10

Plate Offsets (X,Y)-- [8:0-1-8,Edge], [12:0-1-8,Edge], [13:0-1-8,Edge], [16:Edge,0-1-8]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.29	Vert(LL)	-0.08 12-13	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.40	Vert(CT)	-0.11 12-13	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.39	Horz(CT)	0.02 9	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 70 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 16=590/0-5-6 (min. 0-1-8), 9=590/0-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 16-17=-586/0, 1-17=-585/0, 9-18=-586/0, 8-18=-585/0, 1-2=-669/0, 2-3=-1553/0, 3-4=-1897/0, 4-5=-1897/0, 5-6=-1897/0, 6-7=-1553/0, 7-8=-669/0

BOT CHORD 14-15=0/1253, 13-14=0/1831, 12-13=0/1897, 11-12=0/1831, 10-11=0/1253

WEBS 4-13=-268/39, 5-12=-269/39, 1-15=0/810, 2-15=-760/0, 2-14=0/390, 3-14=-363/0, 3-13=-84/379, 8-10=0/810, 7-10=-760/0, 7-11=0/390, 6-11=-363/0, 6-12=-84/380

- NOTES- (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Run: 87.630 s 3 Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Tue Apr 15 09:46:00 2025 Page 1
ID:UMCU2t6gUxCLqMlKo q9qxyaVB1-Fd89fWYRiS55nK571j3qC ZlqhUs46w4V3044EzQWrb

0-1-8



LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (6-7)

- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
- 2) Gable requires continuous bottom chord bearing.
- 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 4) Gable studs spaced at 1-4-0 oc.
- 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



4/14/2025

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.