




Carter Sanford Component Plant
298 Harvey Faulk Rd
Sanford, NC 27332

Phone #:919-775-1450

Builder: DR Horton Inc
Model: 17 Eagle Creek -
Hartwell - C

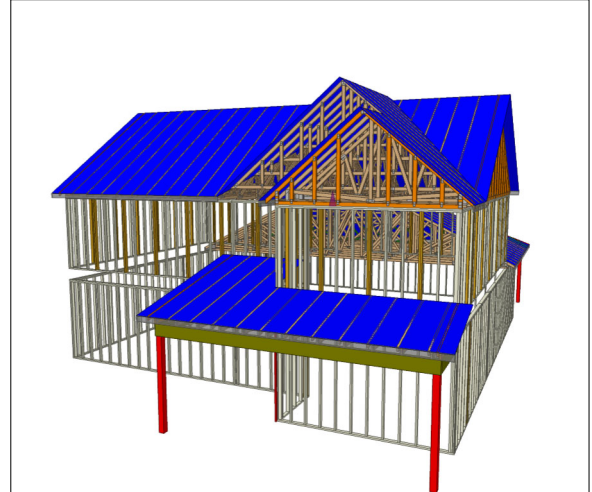

THE PLACEMENT PLAN NOTES:

1. The Placement Plan is a diagram for truss installation. It is not an engineered drawing and has not been reviewed by an engineer. The Owner/Building Designer is responsible for obtaining an engineer's review if one is required by the local jurisdiction.
2. The responsibilities of the Owner, Contractor, Building Designer, Component Designer and Component Manufacturer shall be as set forth in ANSI/TPI 1. Capitalized terms shall be as defined in ANSI/TP 1 unless otherwise indicated.
3. Each Component is designed as an individual component utilizing information provided by others. The Owner/Building Designer is responsible for reviewing all Component Submittal Packages and individual Component Design Drawings for compliance with the Construction Documents and compatibility with the overall Building design.
4. Contractor will not proceed with component installation until the Owner/Building Designer has reviewed the Component Submittal Package. Questions on the suitability of any Component will be resolved by the Building Designer.
5. The Building Designer and Contractor are responsible for all temporary and permanent bracing.
6. The Placement Plan assumes the building is dimensionally correct, structurally sound, and in a suitable condition to support each Component during installation and thereafter, including but not limited to installation of all bearing points. Proper design and construction of all structural components, including foundations, headers, beams, walls and columns are the responsibility of the Owner, Building Designer and Contractor.
7. Do not cut, drill, or modify any Component without first consulting the Component Manufacturer or Building Designer. Damaged Components shall not be installed unless directed by the Building Designer or approved by the Component Manufacturer.
8. Components must be handled and installed following all applicable safety standards and best practices, including but not limited to BCSI, OSHA, TPI and local codes. Failure to properly handle, brace or otherwise install Component can result in serious injury or death.
9. All uplift connectors shown within these documents are recommendations only. Per ANSI/TPI 1, all uplift connectors are the responsibility of the building designer and or contractor.

Approved By: _____

Date: _____

REFER TO FINAL TRUSS ENGINEERING SHEETS FOR PLY TO PLY CONNECTIONS

**** FRAMER MUST REFER TO PLANS WHILE SETTING COMPONENTS**



DAMAGED COMPONENTS SHOULD NOT BE INSTALLED UNLESS TOLD TO BY THE COMPONENT PLANT.

TRUSS TO TRUSS CONNECTIONS ARE TOE-NAILED, UNLESS NOTED OTHERWISE

General Notes:

CUTTING OR DRILLING OF COMPONENTS SHOULD NOT BE DONE WITHOUT CONTACTING COMPONENT SUPPLIER FIRST. CUSTOMER TAKES FULL RESPONSIBILITY FOR COMPONENTS IF CUT BEFORE AUTHORIZATION

*** ALL BEARING POINTS MUST BE INSTALLED PRIOR TO SETTING ANY COMPONENTS

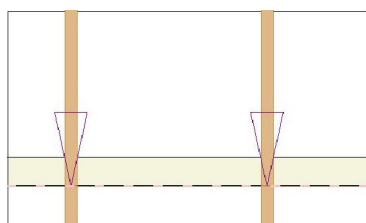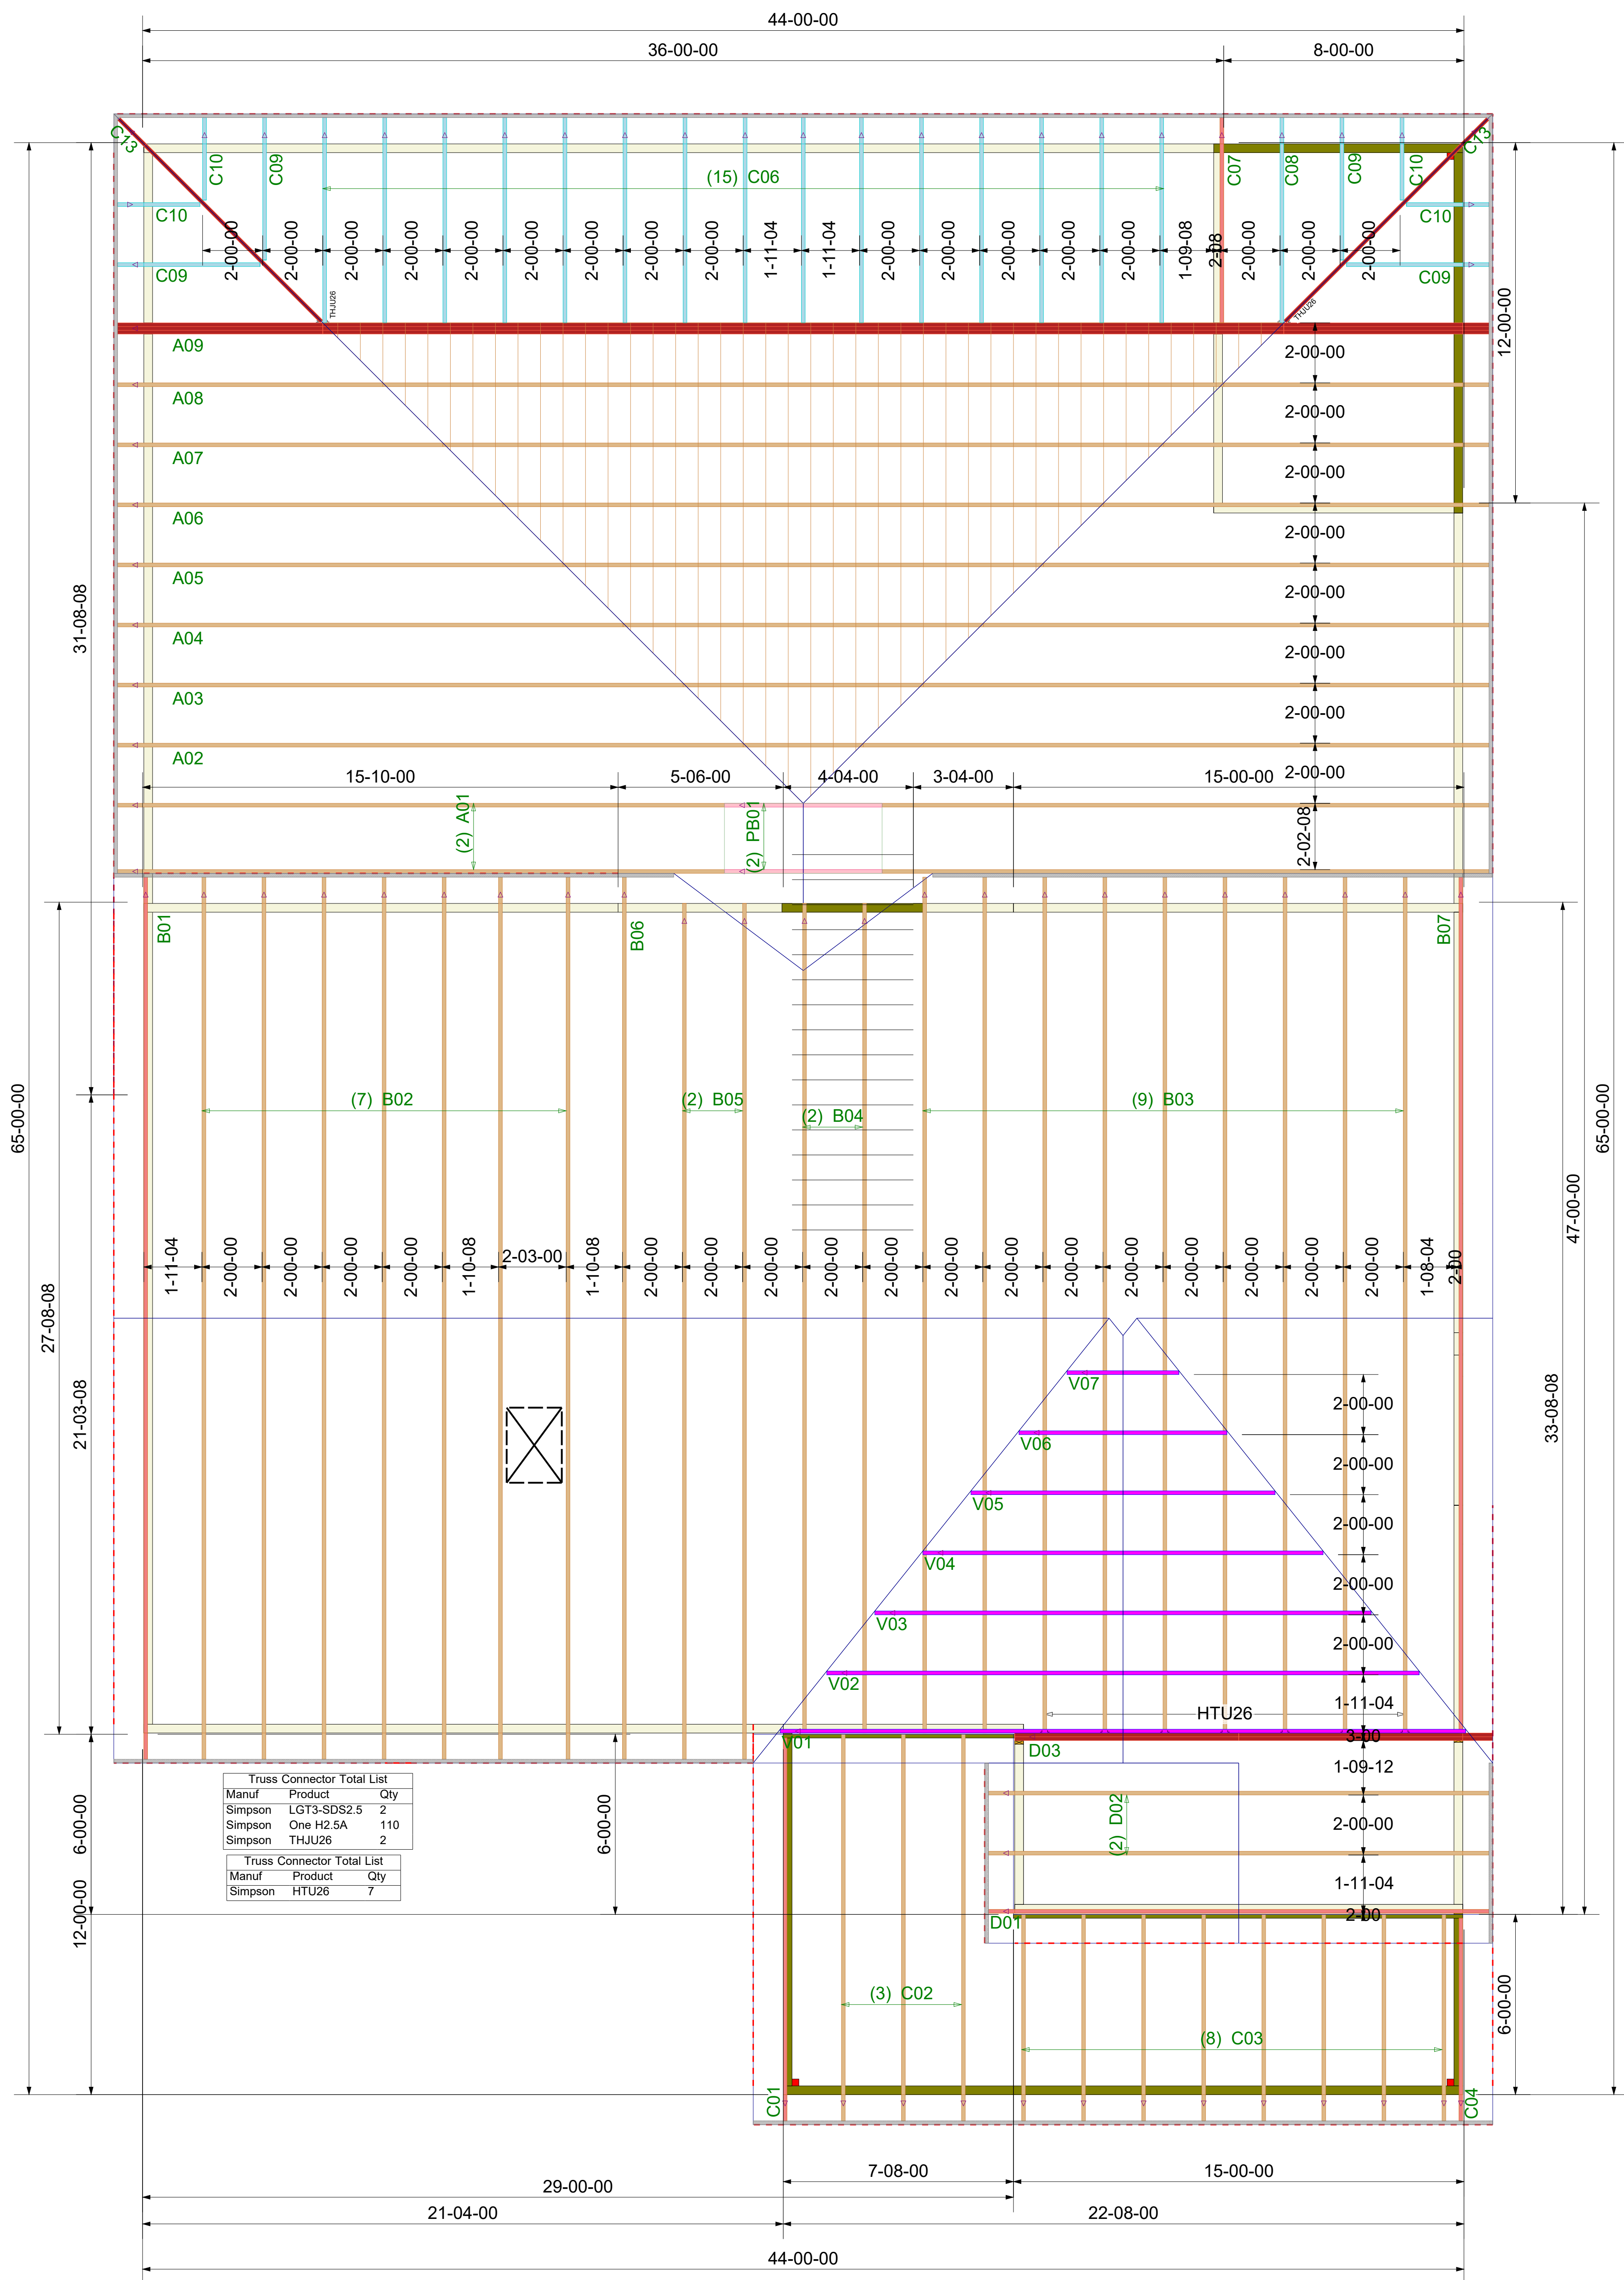

*** GIRDERS MUST BE FULLY CONNECTED TOGETHER PRIOR TO ADDING ANY LOADS.

**
DIMENSIONS ARE READ AS: FOOT-INCH-SIXTEENTH.

1. all uplift connectors are the responsibility of the bldg designer and or contractor.

Scale:	<i>MTS</i>
Date:	4/30/2025
Designer:	Nate Donaldson
Project Number:	25040186-B
Sheet Number:	1/1

DR Horton Inc
17 Eagle Creek - Hartwell - C
ROOF PLACEMENT PLAN



THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor systems and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding the bracing, consult "Bracing of Wood Trusses" available from the Truss Plate Institute, 583 D'Onofrio Drive: Madison, WI 53179

Revisions	
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name

RE: 25040186
17 Eagle Creek - Hartwell C - Roof

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Customer: DR Horton Inc Project Name: 25040186
Lot/Block: 17 Model: Hartwell C
Address: Subdivision: Eagle Creek
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2021/TPI2014 Design Program: MiTek 20/20 8.7
Wind Code: ASCE 7-16 Wind Speed: 130 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 37 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I73039209	A01	4/29/2025	21	I73039229	C06	4/29/2025
2	I73039210	A02	4/29/2025	22	I73039230	C07	4/29/2025
3	I73039211	A03	4/29/2025	23	I73039231	C08	4/29/2025
4	I73039212	A04	4/29/2025	24	I73039232	C09	4/29/2025
5	I73039213	A05	4/29/2025	25	I73039233	C10	4/29/2025
6	I73039214	A06	4/29/2025	26	I73039234	C13	4/29/2025
7	I73039215	A07	4/29/2025	27	I73039235	D01	4/29/2025
8	I73039216	A08	4/29/2025	28	I73039236	D02	4/29/2025
9	I73039217	A09	4/29/2025	29	I73039237	D03	4/29/2025
10	I73039218	B01	4/29/2025	30	I73039238	PB01	4/29/2025
11	I73039219	B02	4/29/2025	31	I73039239	V01	4/29/2025
12	I73039220	B03	4/29/2025	32	I73039240	V02	4/29/2025
13	I73039221	B04	4/29/2025	33	I73039241	V03	4/29/2025
14	I73039222	B05	4/29/2025	34	I73039242	V04	4/29/2025
15	I73039223	B06	4/29/2025	35	I73039243	V05	4/29/2025
16	I73039224	B07	4/29/2025	36	I73039244	V06	4/29/2025
17	I73039225	C01	4/29/2025	37	I73039245	V07	4/29/2025
18	I73039226	C02	4/29/2025				
19	I73039227	C03	4/29/2025				
20	I73039228	C04	4/29/2025				


The truss drawing(s) referenced above have been prepared by
Truss Engineering Co. under my direct supervision
based on the parameters provided by Carter Components (Sanford, NC)).

Truss Design Engineer's Name: Sevier, Scott

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

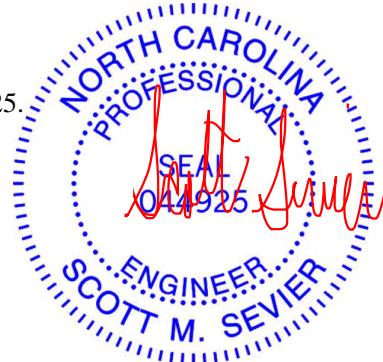

April 29, 2025


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	A01	Piggyback Base	2	1	Job Reference (optional)
					I73039209

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:35

Page: 1

ID:ybxccQ5SPAuGgEKRMj6ibhZzuPcy-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWRCDoi7J4zJC?f

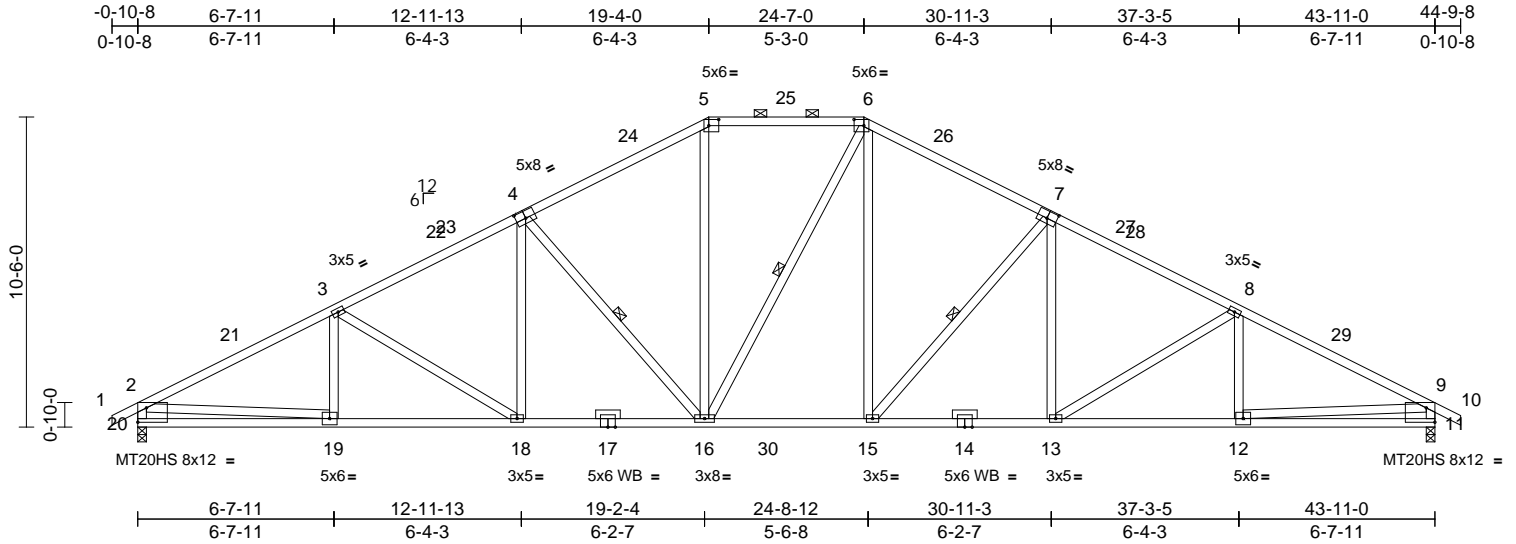

Scale = 1:78

Plate Offsets (X, Y): [4:0-4-0,0-3-0], [5:0-4-0,0-2-8], [6:0-4-0,0-2-8], [7:0-4-0,0-3-0], [11:Edge,0-5-13], [20:Edge,0-5-13]

Loading	(psf)	Spacing	2-4-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.23	13-15	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.47	Vert(CT)	-0.40	13-15	>999	180	MT20HS	187/143
TCDL	10.0	Rep Stress Incr	NO	WB	0.70	Horz(CT)	0.12	11	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 287 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
16-6-20,2,19-2,11-9,12-9:2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or
3-8-5 oc purlins, except end verticals, and
2-0-0 oc purlins (4-9-10 max.): 5-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

WEBS 1 Row at midpt 4-16, 6-16, 7-15

REACTIONS

(size) 11=0-3-8, 20=0-3-8
Max Horiz 20=-166 (LC 15)
Max Uplift 11=-223 (LC 15), 20=-223 (LC 14)
Max Grav 11=2452 (LC 47), 20=2449 (LC 47)

FORCES


(lb) - Maximum Compression/Maximum
Tension
TOP CHORD 1-2=0/32, 2-3=-4510/358, 3-5=-4139/428,
5-6=-2958/424, 6-8=-4145/428,
8-9=-4513/361, 9-10=0/32, 2-20=-2566/300,
9-11=-2569/300
BOT CHORD 19-20=-293/837, 18-19=-373/3946,
16-18=-235/3585, 15-16=-14/2861,
13-15=-113/3591, 12-13=-207/3949,
11-12=-138/824
WEBS 4-16=-1087/245, 5-16=-55/1100,
6-16=-284/290, 6-15=-104/1113,
7-15=-1090/245, 2-19=-116/3122,
9-12=-100/3138, 3-19=-110/136,
3-18=-446/161, 4-18=0/534, 7-13=0/535,
8-13=-443/161, 8-12=-111/136

NOTES

1) Unbalanced roof live loads have been considered for
this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat.
II; Exp B; Enclosed; MWFRS (envelope) exterior zone
and C-C Exterior(2E) -0-10-8 to 3-6-3, Interior (1) 3-6-3
to 13-0-14, Exterior(2R) 13-0-14 to 30-10-2, Interior (1)
30-10-2 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone;
cantilever left and right exposed ; end vertical left and
right exposed;C-C for members and forces & MWFRS
for reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15
Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate
DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9;
Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this
design.
- 5) This truss has been designed for greater of min roof live
load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on
overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) All plates are MT20 plates unless otherwise indicated.
- 8) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members, with BCDL = 10.0psf.
- 10) One H2.5A Simpson Strong-Tie connectors
recommended to connect truss to bearing walls due to
UPLIFT at jt(s) 20 and 11. This connection is for uplift
only and does not consider lateral forces.
- 11) Graphical purlin representation does not depict the size
or the orientation of the purlin along the top and/or
bottom chord.

LOAD CASE(S) Standard

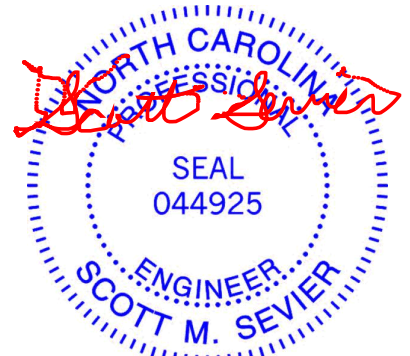

April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	A02	Hip	1	1	Job Reference (optional)
					I73039210

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:36
ID:uz3MmUghVWOUEblqXn3m_zuPcw-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCD0i7J4zJC?f

Page: 1

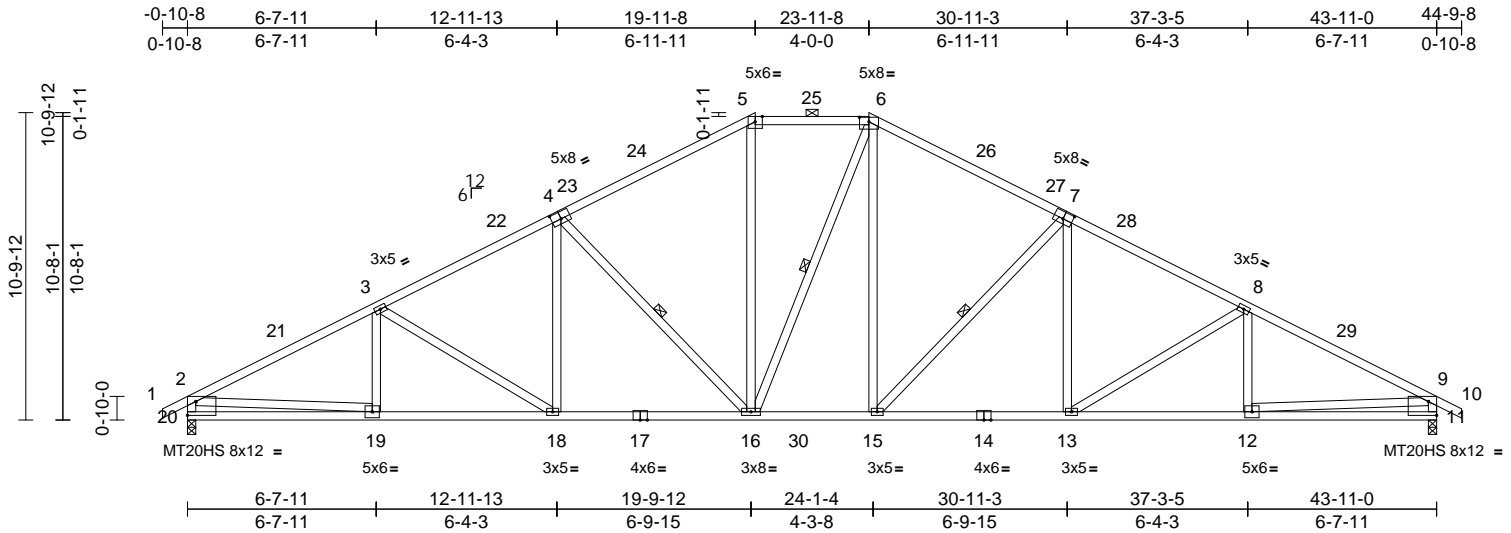

Scale = 1:81

Plate Offsets (X, Y): [4:0-4-0,0-3-0], [6:0-4-0,0-1-15], [7:0-4-0,0-3-0], [11:Edge,0-5-13], [20:Edge,0-5-13]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	-0.22	13-15	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.37	13-15	>999	180	MT20HS	187/143
TCDL	10.0	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.11	11	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 287 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
16-5,16-6,15-6,20-2,19-2,11-9,12-9:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-8 oc purlins, except end verticals, and 2-0-0 oc purlins (5-2-0 max.): 5-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 4-16, 6-16, 7-15

REACTIONS

(size) 11=0-3-8, 20=0-3-8
Max Horiz 20=146 (LC 14)
Max Uplift 11=191 (LC 15), 20=191 (LC 14)
Max Grav 11=2112 (LC 47), 20=2111 (LC 47)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/27, 2-3=-3883/300, 3-5=-3579/357, 5-6=-2527/358, 6-8=-3583/357, 8-9=-3884/302, 9-10=0/27, 2-20=-2210/254, 9-11=-2212/253
BOT CHORD 19-20=-256/730, 18-19=-321/3397, 16-18=-205/3106, 15-16=-14/2439, 13-15=-91/3109, 12-13=-175/3397, 11-12=-120/720
WEBS 4-16=-949/216, 5-16=-56/903, 6-16=-251/259, 6-15=-91/911, 7-15=-953/216, 2-19=-91/2678, 9-12=-78/2689, 3-19=-99/112, 3-18=-369/136, 4-18=0/471, 7-13=0/473, 8-13=-366/136, 8-12=-100/111

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 3-6-3, Interior (1) 3-6-3 to 13-9-0, Exterior(2R) 13-9-0 to 30-2-0, Interior (1) 30-2-0 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 20 and 11. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	A03	Hip	1	1	Job Reference (optional)
					I73039211

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:36

Page: 1

ID:qMB7GTWwD7m6jyl7yxqRzPuPcu-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDci7J4zJC?f

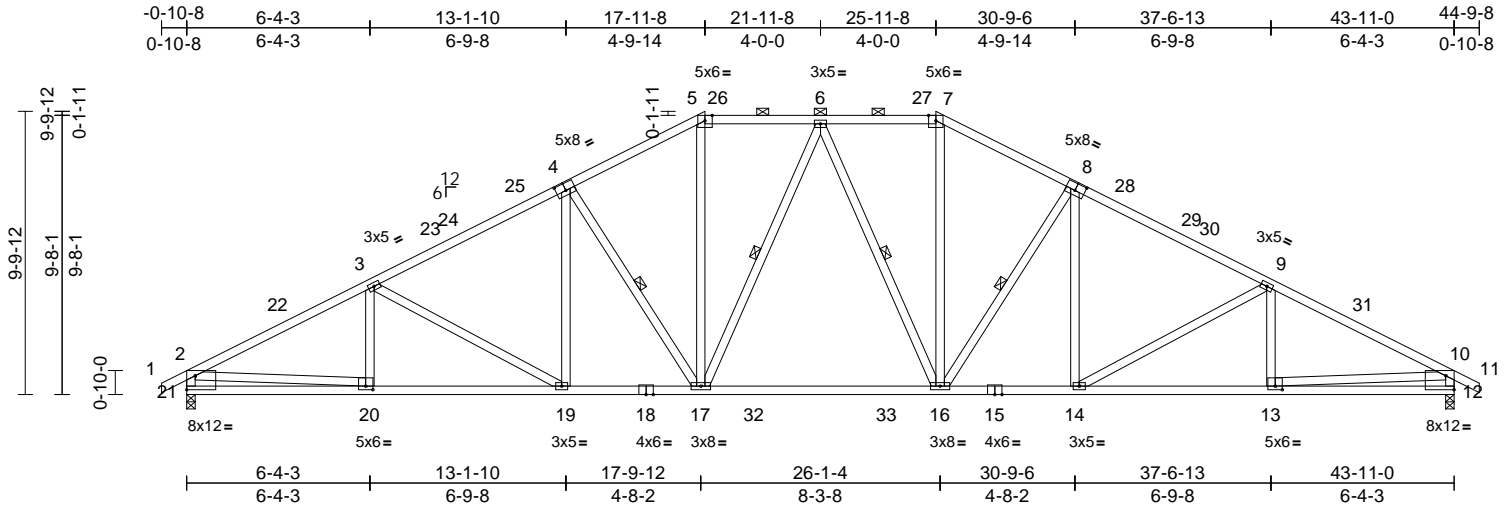

Scale = 1:79.8

Plate Offsets (X, Y): [4:0-4-0,0-3-0], [8:0-4-0,0-3-0], [12:Edge,0-5-13], [13:0-3-0,0-1-8], [20:0-3-0,0-1-8], [21:Edge,0-5-13]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.87	Vert(LL)	-0.27	16-17	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.44	Vert(CT)	-0.47	16-17	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	1.00	Horz(CT)	0.10	12	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 293 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 2400F 2.0E
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-1-12 oc purlins, except end verticals, and 2-0-0 oc purlins (5-2-8 max.): 5-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 4-17, 8-16, 6-17, 6-16
REACTIONS (size) 12=0-3-8, 21=0-3-8
Max Horiz 21=-129 (LC 15)
Max Uplift 12=-194 (LC 15), 21=-194 (LC 14)
Max Grav 12=2037 (LC 47), 21=2037 (LC 47)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/27, 2-3=-3760/320, 3-5=-3398/383, 5-6=-2568/367, 6-7=-2568/367, 7-9=-3397/383, 9-10=-3758/323, 10-11=0/27, 2-21=-2147/261, 10-12=-2147/261
BOT CHORD 20-21=-221/643, 19-20=-317/3295, 17-19=-192/2936, 16-17=-61/2534, 14-16=-109/2936, 13-14=-188/3294, 12-13=-101/632
WEBS 4-17=-773/195, 5-17=-78/1034, 7-16=-78/1034, 8-16=-773/195, 2-20=-128/2664, 10-13=-114/2674, 4-19=-9/365, 8-14=-9/365, 6-17=-338/138, 6-16=-338/138, 3-19=-414/143, 3-20=-99/122, 9-14=-413/142, 9-13=-99/122

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 3-6-3, Interior (1) 3-6-3 to 11-9-0, Exterior(2R) 11-9-0 to 32-2-0, Interior (1) 32-2-0 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 21 and 12. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	A04	Hip	1	1	Job Reference (optional)
					I73039212

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:36

Page: 1

ID:nkJth8XAlk0pyFuW3Ms?xqzuPcs-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

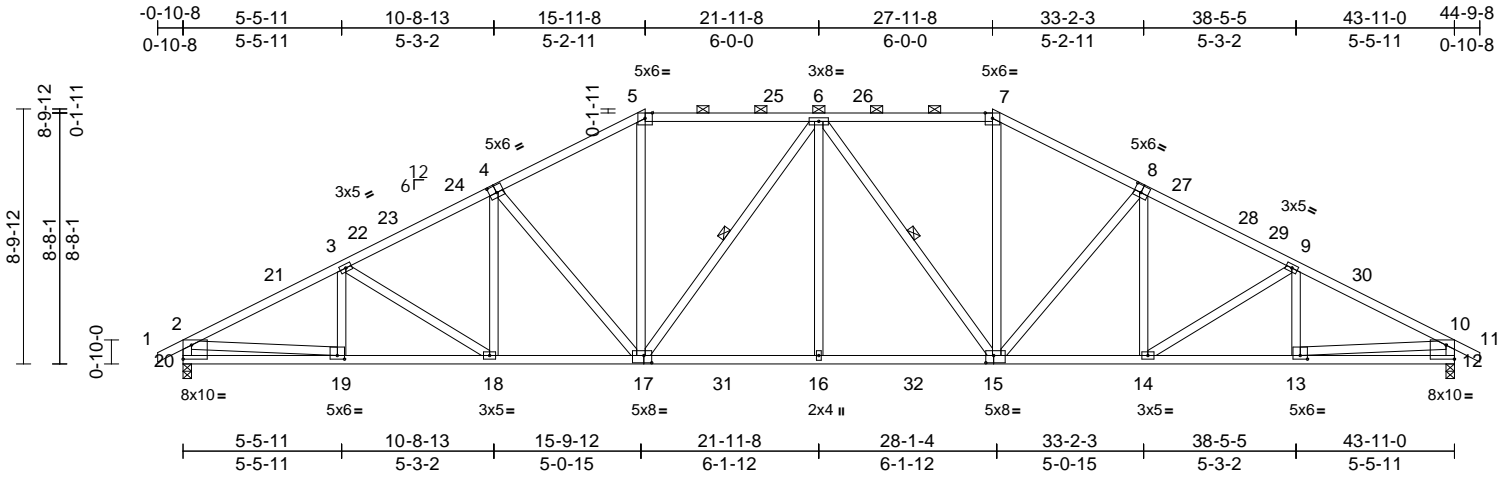

Scale = 1:79.6

Plate Offsets (X, Y): [4:0-3-0,0-3-0], [8:0-3-0,0-3-0], [12:Edge,0-5-13], [13:0-3-0,0-1-8], [15:0-3-4,0-3-0], [17:0-3-4,0-3-0], [19:0-3-0,0-1-8], [20:Edge,0-5-13]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.18	15-16	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.34	Vert(CT)	-0.33	15-16	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.99	Horz(CT)	0.11	12	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 287 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
 BOT CHORD 2x4 SP 2400F 2.0E
 WEBS 2x4 SP No.3 *Except* 20-2:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-2-13 oc purlins, except end verticals, and 2-0-0 oc purlins (4-11-14 max.): 5-7.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 6-17, 6-15

REACTIONS

(size) 12=0-3-8, 20=0-3-8
 Max Horiz 20=-117 (LC 12)
 Max Uplift 12=-198 (LC 15), 20=-198 (LC 14)
 Max Grav 12=2009 (LC 47), 20=2009 (LC 47)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/27, 2-3=-3645/334, 3-5=-3486/396, 5-6=-2659/384, 6-7=-2659/385, 7-9=-3485/396, 9-10=-3643/337, 10-11=0/27, 2-20=-2123/269, 10-12=-2124/269
 BOT CHORD 19-20=-189/586, 18-19=-311/3198, 16-18=-225/3037, 14-16=-153/3036, 13-14=-198/3196, 12-13=-82/569
 WEBS 5-17=-57/1010, 6-17=-553/121, 6-16=0/353, 6-15=-554/121, 7-15=-57/1010, 2-19=-160/2629, 10-13=-148/2644, 4-17=-671/163, 3-19=-163/89, 3-18=-199/101, 4-18=0/280, 8-15=-670/163, 8-14=0/280, 9-14=-199/101, 9-13=-163/88

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 3-6-3, Interior (1) 3-6-3 to 9-9-0, Exterior(2R) 9-9-0 to 34-2-0, Interior (1) 34-2-0 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 20 and 12. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 29, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:37 Page: 1
ID:j7Qe6qZQHMGXCZ2uBnuT0FzuPcq-RfC?PsB70Hg3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?#

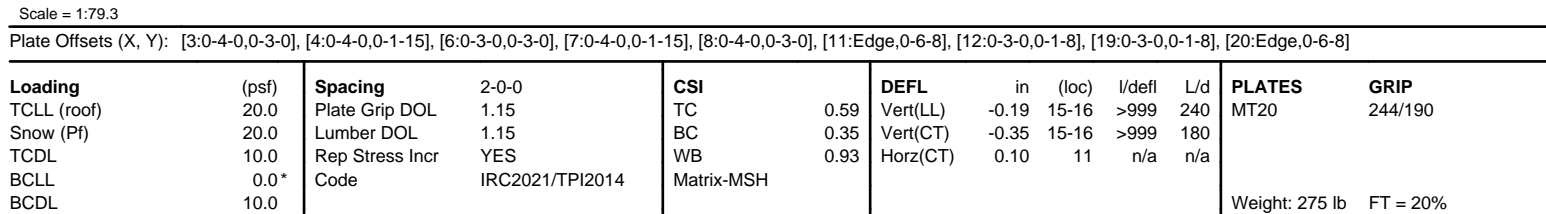

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-10-8 to 3-6-3, Interior (1) 3-6-3 to 7-9-0, Exterior(2R) 7-9-0 to 20-2-0, Interior (1) 20-2-0 to 23-9-0, Exterior(2R) 23-9-0 to 36-2-0, Interior (1) 36-2-0 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 20 and 11. This connection is for uplift only and does not consider lateral forces.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI 1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

ENGINEERING BY
TRENCO
A Mi Tek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039214
25040186	A06	Hip	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:37

Page: 1

ID:ysT1?vg497PFnxEdCAZat9zuPch-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

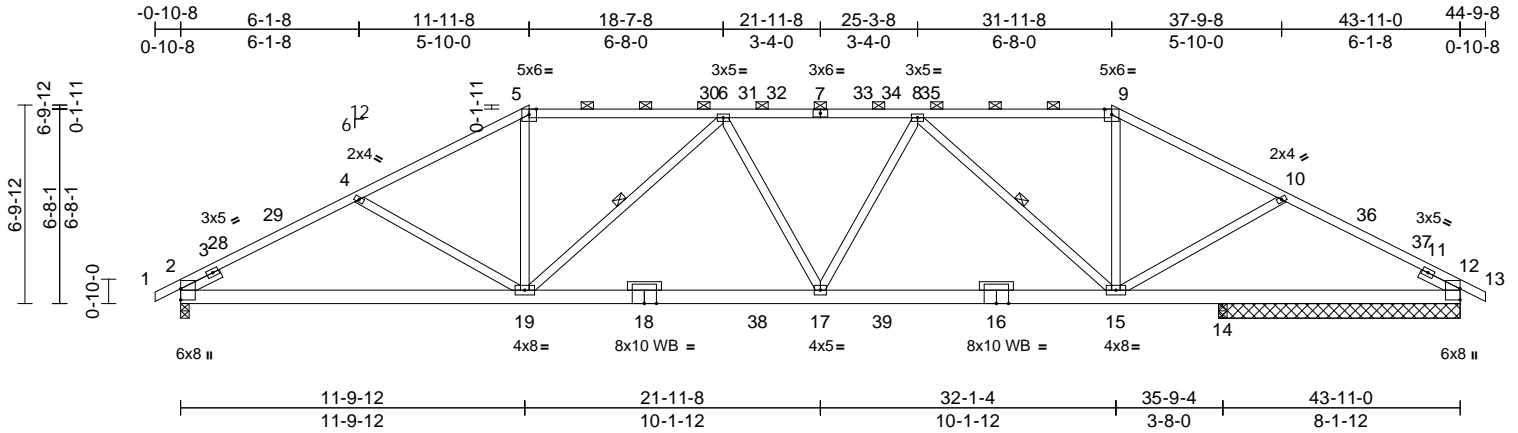

Scale = 1:79.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	-0.28	15-17	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.40	Vert(CT)	-0.50	15-17	>864	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.11	12	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 267 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-9-12 oc purlins, except 2-0-0 oc purlins (4-1-2 max.): 5-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-19, 8-15


REACTIONS (size) 2=0-3-8, 12=8-3-8, 14=0-3-8
Max Horiz 2=100 (LC 15)
Max Uplift 2=208 (LC 14), 12=222 (LC 15)
Max Grav 2=1906 (LC 5), 12=1631 (LC 6), 14=438 (LC 46)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/23, 2-4=3538/418, 4-5=3353/362, 5-6=2987/361, 6-8=3847/424, 8-9=2637/374, 9-10=2953/378, 10-12=3115/434, 12-13=0/23
BOT CHORD 2-19=356/3082, 17-19=280/3704, 15-17=265/3587, 14-15=290/2687, 12-14=290/2687
WEBS 4-19=524/196, 5-19=16/1093, 6-19=1059/224, 6-17=43/266, 8-17=26/473, 8-15=1377/199, 9-15=23/905, 10-15=491/199

NOTES
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 3-6-3, Interior (1) 3-6-3 to 5-9-0, Exterior(2R) 5-9-0 to 18-2-0, Interior (1) 18-2-0 to 25-9-0, Exterior(2R) 25-9-0 to 37-11-5, Interior (1) 37-11-5 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 12. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

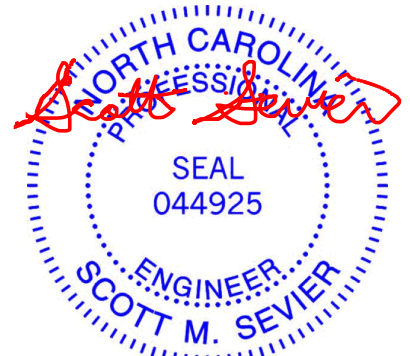

April 29,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932




Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:37 Page: 1
ID:JpGw2ckD_f1Ytj7b?l8aCzuPcc-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDOI7J4zJC?f



LUMBER		Wind: ASCE 7-16; Vult=130mph (3-second gust)
TOP CHORD	2x4 SP 2400F 2.0E	Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat.
BOT CHORD	2x6 SP 2400F 2.0E	II; Exp B; Enclosed; MWFRS (envelope) exterior zone
WEBS	2x4 SP No.3	and C-C Exterior(2E) -0-10-8 to 3-6-3, Exterior(2R) 3-6-3
SLIDER	Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0	to 16-2-0, Interior (1) 16-2-0 to 27-9-0, Exterior(2R) 27-9-0 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone;
BRACING		cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
TOP CHORD	Structural wood sheathing directly applied or 4-8-4 oc purlins, except 2-0-0 oc purlins (4-3-8 max.): 5-9.	3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.	4) Unbalanced snow loads have been considered for this design.
WEBS	1 Row at midpt 6-20	5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
WEBS	2 Rows at 1/3 pts 8-16	6) Provide adequate drainage to prevent water ponding.
REACTIONS		7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
(size)	2=0-3-8, 13=0-3-8, 15=0-3-8	8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
Max Horiz	2=84 (LC 14)	9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2, 13, and 15. This connection is for uplift only and does not consider lateral forces.
Max Uplift	2=-182 (LC 14), 13=-213 (LC 58), 15=-220 (LC 10)	10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
Max Grav	2=1575 (LC 37), 13=317 (LC 45), 15=2547 (LC 46)	
FORCES		
	(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/37, 2-4=-2724/321, 4-5=-2633/266, 5-6=-2360/273, 6-8=-2713/243, 8-9=-32/110, 9-10=-54/168, 10-11=-132/876, 11-13=-188/752, 13-14=0/37	
BOT CHORD	2-20=-292/2359, 18-20=-278/2864, 16-18=-198/2068, 15-16=-820/185, 13-15=-637/153	
WEBS	4-20=-400/151, 5-20=0/717, 6-20=-662/206, 6-18=-416/227, 8-18=-39/990, 8-16=-2557/341, 9-16=-528/136, 10-16=-191/2110, 10-15=-2283/181, 11-15=-412/131	

1) Unbalanced roof live loads have been considered for this design.

April 29, 2025

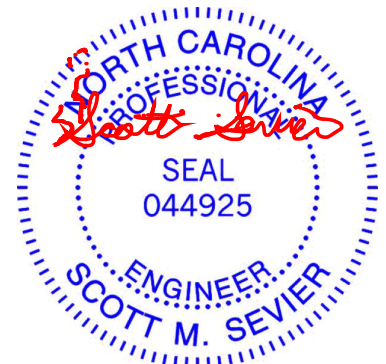


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	A08	Hip	1	1	Job Reference (optional)
					I73039216

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:37
ID:BbWRu_nj2uX_MKQMEZDhl2zuPcY-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

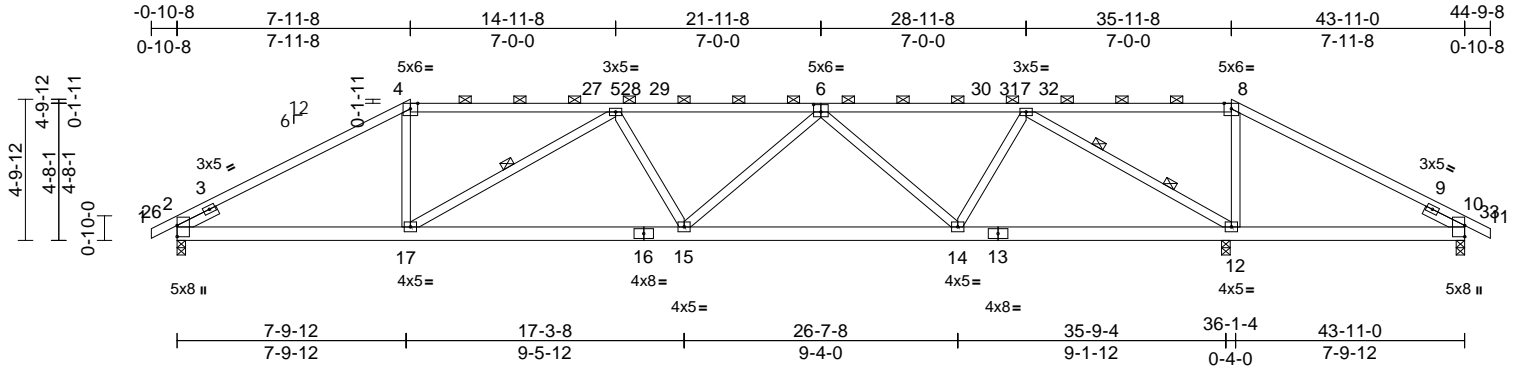

Scale = 1:78.6

Plate Offsets (X, Y): [6:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.15	15-17	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.33	Vert(CT)	-0.29	15-17	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.06	12	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 246 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-7-12 oc purlins, except 2-0-0 oc purlins (4-6-7 max.): 4-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 10-12.
WEBS 1 Row at midpt 5-17
WEBS 2 Rows at 1/3 pts 7-12

REACTIONS

(size) 2=0-3-8, 10=0-3-8, 12=0-3-8
Max Horiz 2=-68 (LC 19)
Max Uplift 2=-195 (LC 14), 10=-429 (LC 40), 12=-279 (LC 11)
Max Grav 2=1408 (LC 43), 10=377 (LC 45), 12=2715 (LC 40)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/38, 2-4=-2281/304, 4-5=-2000/316, 5-7=-2848/349, 7-8=-152/1049, 8-10=-381/1278, 10-11=0/38
BOT CHORD 2-17=-227/2000, 15-17=-349/2895, 14-15=-322/2513, 12-14=-168/1320, 10-12=-1079/209
WEBS 4-17=-4/628, 5-17=-1069/248, 5-15=-98/165, 6-15=-30/456, 6-14=-1021/212, 7-14=-29/946, 7-12=-2762/415, 8-12=-961/162

NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 3-6-3, Exterior(2R) 3-6-3 to 14-2-0, Interior (1) 14-2-0 to 29-9-0, Exterior(2R) 29-9-0 to 40-4-13, Exterior(2E) 40-4-13 to 44-9-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 12. This connection is for uplift only and does not consider lateral forces.
- 10) H10A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 10. This connection is for uplift only and does not consider lateral forces.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	I73039217
25040186	A09	Hip Girder	1	3	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:39

Page: 1

ID:Y5NB3JFBstSSXJvs0FQrghzuPbx-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

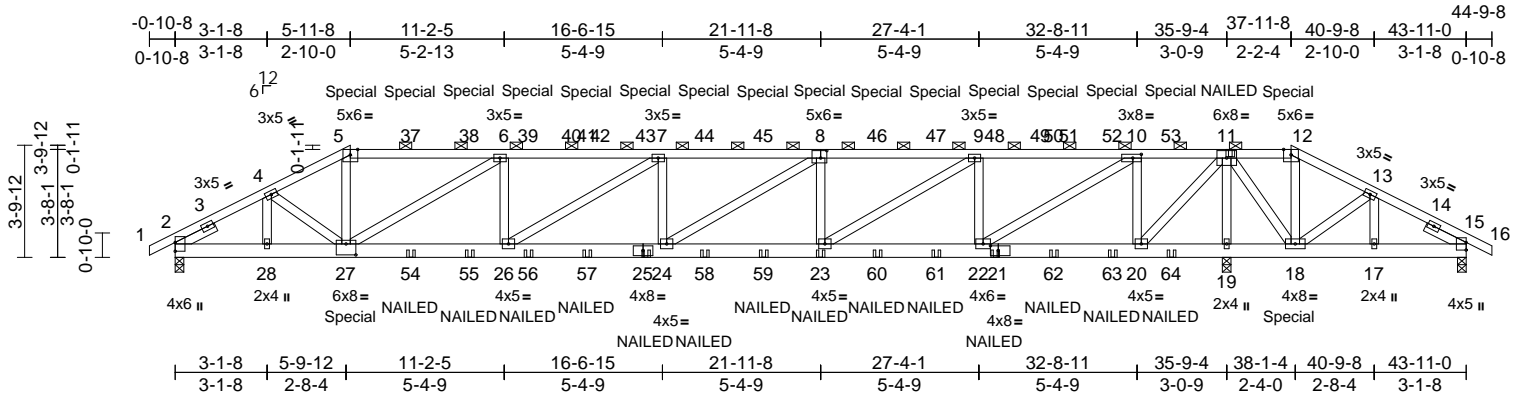

FASTEN TRUSS TO BEARING FOR THE UPLIFT REACTION SHOWN WHILE PERMITTING NO UPWARD MOVEMENT OF THE BEARING.

Scale = 1:78.4		Plate Offsets (X, Y): [8:0-2-8,0-3-0], [10:0-3-8,0-1-8], [21:0-3-3,0-2-0], [27:0-4-0,0-4-8]	
Loading	(psf)	Spacing	2-0-0
TCLL (roof)	20.0	Plate Grip DOL	1.15
Snow (Pf)	20.0	Lumber DOL	1.15
TCDL	10.0	Rep Stress Incr	NO
BCLL	0.0*	Code	IRC2021/TPI2014
BCDL	10.0		
		CSI	
		TC	0.20
		BC	0.19
		WB	0.82
		Matrix-MSH	
		DEFL	
		Vert(LL)	-0.17
		Vert(CT)	-0.27
		Horz(CT)	0.03
		PLATES	
		MT20	
		GRIP	
		244/190	
		Weight: 844 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-12.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 15=0-3-8, 19=0-3-8
Max Horiz 2=-52 (LC 17)
Max Uplift 2=-496 (LC 12), 15=-1870 (LC 36), 19=-1127 (LC 8)
Max Grav 2=3056 (LC 39), 15=350 (LC 9), 19=7354 (LC 36)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/38, 2-4=-4574/774, 4-5=-5380/908, 5-6=-4825/839, 6-7=-7189/1176, 7-9=-7605/1239, 9-10=-3061/534, 10-11=-281/2028, 11-12=-568/3724, 12-13=-655/4202, 13-15=-547/3170, 15-16=0/38
BOT CHORD 2-28=-675/3968, 27-28=-675/3968, 26-27=-1126/7189, 24-26=-1200/7605, 23-24=-986/6213, 22-23=-486/3061, 20-22=-2028/348, 19-20=-5375/848, 18-19=-5375/848, 17-18=-2741/493, 15-17=-2741/493

WEBS
4-28=-751/135, 4-27=-214/1193, 5-27=-181/1699, 12-18=-2016/359, 13-18=-1398/231, 13-17=-100/870, 6-26=0/532, 6-27=-2778/459, 7-26=-550/104, 7-24=-571/278, 8-24=-298/1633, 8-23=-1677/438, 9-23=-595/3696, 9-22=-2793/617, 10-22=-943/5934, 10-20=-3803/739, 11-20=-780/4973, 11-19=-6284/992, 11-18=-434/2903

NOTES
1) 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
3) Unbalanced roof live loads have been considered for this design.
4) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
5) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
6) Unbalanced snow loads have been considered for this design.

- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- LGT3-SDS2.5 Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 15 and 19. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 29, 2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	A09	Hip Girder	1	3	I73039217
Job Reference (optional)					

- 14) This truss has large uplift reaction(s) from gravity load case(s). Proper connection is required to secure truss against upward movement at the bearings. Building designer must provide for uplift reactions indicated.
- 15) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 16) LGT3 Hurricane ties must have three studs in line below the truss.
- 17) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 214 lb down and 83 lb up at 5-11-8, 214 lb down and 83 lb up at 8-0-4, 214 lb down and 83 lb up at 10-0-4, 214 lb down and 83 lb up at 12-0-4, 214 lb down and 83 lb up at 14-0-4, 214 lb down and 83 lb up at 16-0-4, 214 lb down and 83 lb up at 18-0-4, 214 lb down and 83 lb up at 20-0-4, 214 lb down and 82 lb up at 21-11-8, 214 lb down and 83 lb up at 23-10-12, 214 lb down and 83 lb up at 25-10-12, 214 lb down and 83 lb up at 27-10-12, 214 lb down and 83 lb up at 29-10-12, 214 lb down and 83 lb up at 31-10-12, and 214 lb down and 83 lb up at 33-10-12, and 214 lb down and 83 lb up at 37-11-8 on top chord, and 515 lb down and 81 lb up at 5-11-8, and 515 lb down and 81 lb up at 37-10-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (lb/ft)
- Vert: 1-5=-60, 5-12=-60, 12-16=-60, 29-33=-20
- Concentrated Loads (lb)
- Vert: 5=-186 (B), 25=-60 (B), 27=-515 (B), 18=-515 (B), 12=-186 (B), 21=-60 (B), 8=-186 (B), 23=-60 (B), 37=-186 (B), 38=-186 (B), 39=-186 (B), 41=-186 (B), 43=-186 (B), 44=-186 (B), 45=-186 (B), 46=-186 (B), 47=-186 (B), 48=-186 (B), 50=-186 (B), 52=-186 (B), 53=-186 (B), 54=-60 (B), 55=-60 (B), 56=-60 (B), 57=-60 (B), 58=-60 (B), 59=-60 (B), 60=-60 (B), 61=-60 (B), 62=-60 (B), 63=-60 (B), 64=-60 (B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039218
25040186	B01	Common Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:40

Page: 1

ID:fn4p5KnLpBfr_U?YoHkwHGzuPcX-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

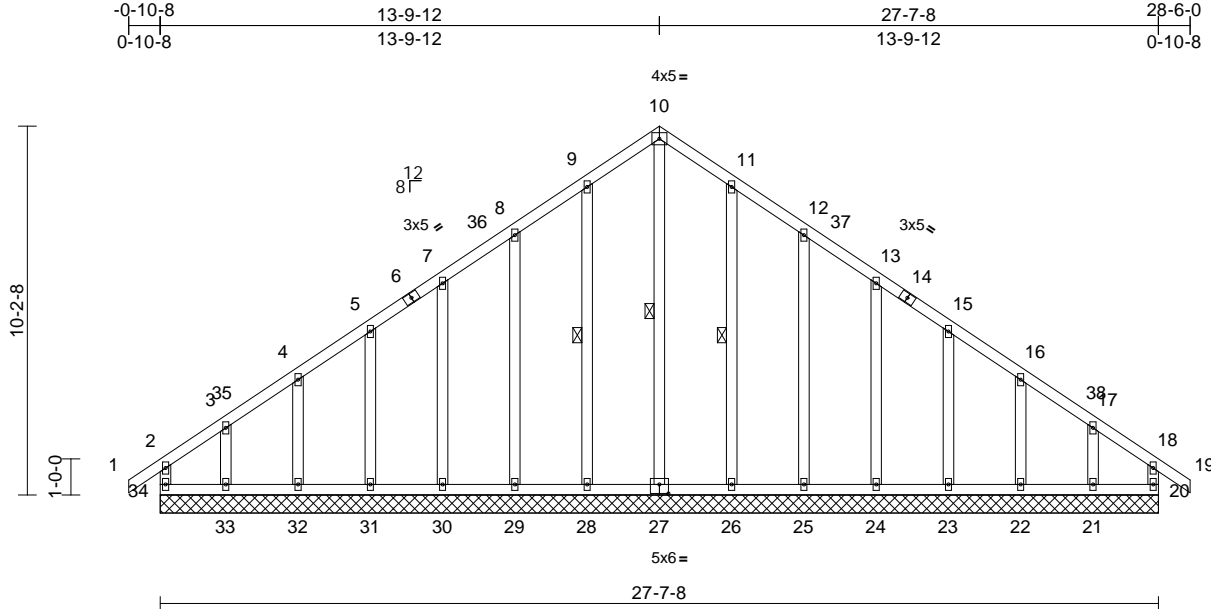

Scale = 1:63.8

Plate Offsets (X, Y): [27:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	-	n/a	999	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	n/a	-	n/a	999	
TCDL	10.0	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.01	20	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR							
BCDL	10.0										
Weight: 199 lb FT = 20%											

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

WEBS	1 Row at midpt	10-27, 9-28, 11-26
REACTIONS	(size)	20=27-7-8, 21=27-7-8, 22=27-7-8, 23=27-7-8, 24=27-7-8, 25=27-7-8, 26=27-7-8, 27=27-7-8, 28=27-7-8, 29=27-7-8, 30=27-7-8, 31=27-7-8, 32=27-7-8, 33=27-7-8, 34=27-7-8

Max Horiz	34=257 (LC 12)
Max Uplift	20=74 (LC 11), 21=129 (LC 15), 22=43 (LC 15), 23=62 (LC 15), 24=56 (LC 15), 25=64 (LC 15), 26=48 (LC 15), 28=49 (LC 14), 29=63 (LC 14), 30=56 (LC 14), 31=62 (LC 14), 32=41 (LC 14), 33=142 (LC 14), 34=118 (LC 10)
Max Grav	20=178 (LC 25), 21=198 (LC 26), 22=166 (LC 22), 23=170 (LC 26), 24=168 (LC 26), 25=222 (LC 22), 26=259 (LC 22), 27=252 (LC 15), 28=259 (LC 21), 29=222 (LC 21), 30=168 (LC 25), 31=171 (LC 25), 32=166 (LC 21), 33=217 (LC 25), 34=213 (LC 26)


FORCES	(lb) - Maximum Compression/Maximum Tension
--------	--

TOP CHORD	2-34=-171/96, 1-2=0/34, 2-3=-185/173, 3-4=-137/131, 4-5=-126/131, 5-7=-108/162, 7-8=-103/195, 8-9=-137/253, 9-10=-166/302, 10-11=-166/302, 11-12=-137/253, 12-13=-103/195, 13-15=-73/141, 15-16=-80/105, 16-17=-93/89, 17-18=-136/122, 18-19=0/34, 18-20=-144/61
BOT CHORD	33-34=-113/129, 32-33=-113/129, 31-32=-113/129, 30-31=-113/129, 29-30=-113/129, 28-29=-113/129, 26-28=-113/129, 25-26=-113/129, 24-25=-113/129, 23-24=-113/129, 22-23=-113/129, 21-22=-113/129, 20-21=-113/129
WEBS	10-27=-271/90, 9-28=-219/73, 8-29=-182/87, 7-30=-143/81, 5-31=-143/84, 4-32=-144/75, 3-33=-147/123, 11-26=-219/72, 12-25=-182/88, 13-24=-143/81, 15-23=-143/84, 16-22=-145/76, 17-21=-136/116

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) 0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 10-9-12, Corner(3R) 10-9-12 to 16-9-12, Exterior(2N) 16-9-12 to 25-6-0, Corner(3E) 25-6-0 to 28-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

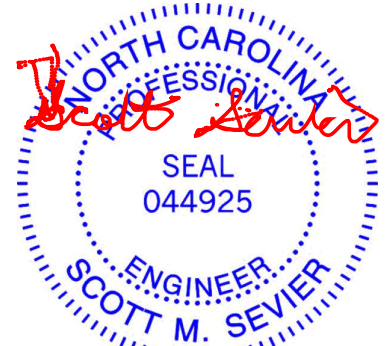

April 29, 2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	B01	Common Supported Gable	1	1	I73039218
					Job Reference (optional)

- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 118 lb uplift at joint 34, 74 lb uplift at joint 20, 49 lb uplift at joint 28, 63 lb uplift at joint 29, 56 lb uplift at joint 30, 62 lb uplift at joint 31, 41 lb uplift at joint 32, 142 lb uplift at joint 33, 48 lb uplift at joint 26, 64 lb uplift at joint 25, 56 lb uplift at joint 24, 62 lb uplift at joint 23, 43 lb uplift at joint 22 and 129 lb uplift at joint 21.

LOAD CASE(S) Standard

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	B02	Common	7	1	Job Reference (optional)

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 E May 9 2024 Print: 8.730 E May 9 2024 MiTek Industries, Inc. Mon Apr 28 16:46:37

Page: 1

ID:7zeClgozaVnibeakM_F9qTzuPcW-jl2wqvTZS8FZSON?vQztvQJfyCqTZdQpy0pGC8zM8TH

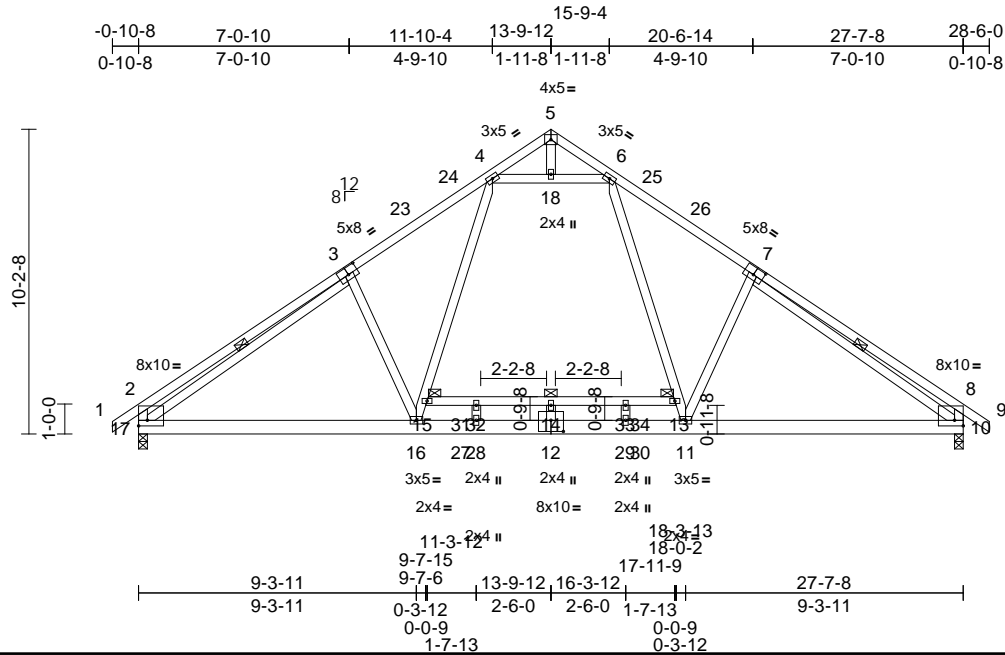

Scale = 1:77.2

Plate Offsets (X, Y): [2:Edge,0-2-4], [3:0-4-0,0-3-0], [7:0-4-0,0-3-0], [8:Edge,0-2-4], [12:0-5-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	-0.21	16-17	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.90	Vert(CT)	-0.35	13-14	>931	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.59	Horz(CT)	0.04	10	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 207 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2 *Except* 15-13:2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-6-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 3-17, 7-10

REACTIONS

(lb/size) 10=1341/0-3-8, 17=1341/0-3-8
Max Horiz 17=-254 (LC 12)
Max Grav 10=1604 (LC 26), 17=1604 (LC 25)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/34, 2-4=-2240/259, 4-5=-311/51, 5-6=-311/51, 6-8=-2239/259, 8-9=0/34, 2-17=-692/228, 8-10=-685/228
BOT CHORD 16-17=0/1831, 11-16=0/1518, 10-11=0/1830, 14-15=-79/0, 13-14=-79/0
WEBS 6-13=0/977, 11-13=0/857, 7-11=-306/278, 15-16=0/859, 4-15=0/978, 3-16=-306/278, 3-17=-1557/0, 7-10=-1557/0, 4-18=-1334/37, 6-18=-1334/37, 5-18=-7/249, 12-14=-229/0

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 10-9-12, Exterior(2R) 10-9-12 to 16-9-12, Interior (1) 16-9-12 to 25-6-0, Exterior(2E) 25-6-0 to 28-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 200.0lb AC unit load placed on the bottom chord, 13-9-12 from left end, supported at two points, 5-0-0 apart.
- All plates are 2x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	B03	Common	9	1	Job Reference (optional)
					I73039220

Carter Components (Sanford, NC), Sanford, NC - 27332,
Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:40
ID:J5oMcQxt_tA8QKwsVoykmozuPcL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC7f
Page: 1

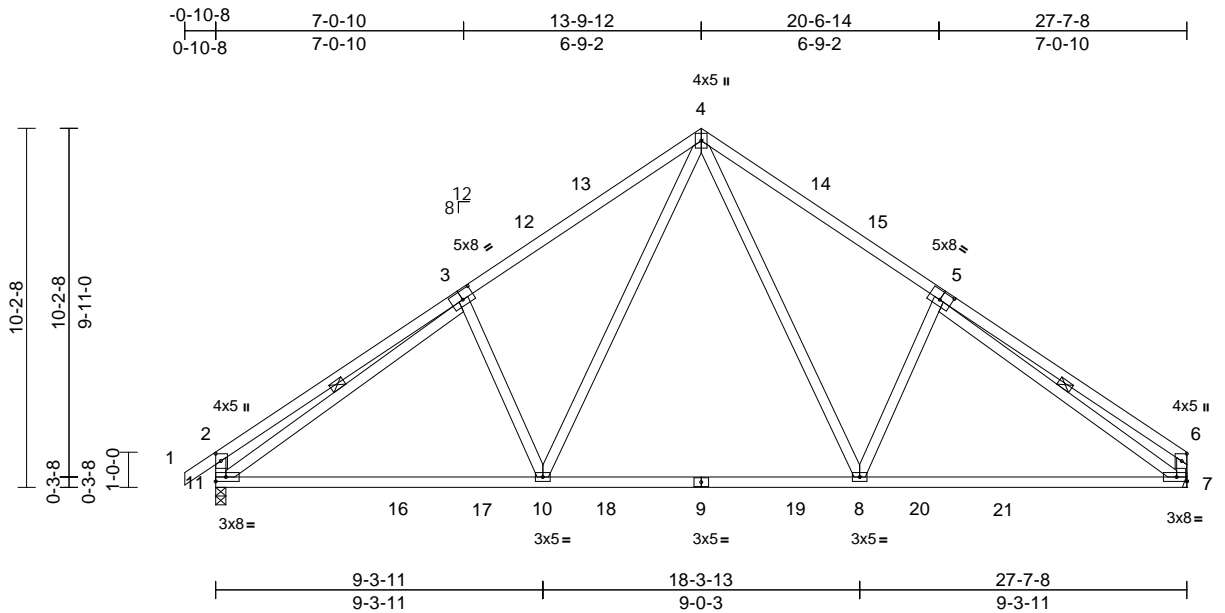

Scale = 1:65.5									
Plate Offsets (X, Y): [2:0-2-8,0-1-12], [3:0-4-0,0-3-0], [5:0-4-0,0-3-0]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.69	Vert(LL)	-0.13	10-11	>999
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.26	10-11	>999
TCDL	10.0	Rep Stress Incr	YES	WB	0.50	Horz(CT)	0.03	7	n/a
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH					
BCDL	10.0								
Weight: 167 lb FT = 20%									

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E

BOT CHORD 2x4 SP 2400F 2.0E

WEBS 2x4 SP No.3 *Except* 8-4,10-4:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 3-11, 5-7

REACTIONS

(size) 7= Mechanical, 11=0-3-8

Max Horiz 11=251 (LC 11)

Max Uplift 7=-91 (LC 15), 11=-111 (LC 14)

Max Grav 7=1281 (LC 26), 11=1340 (LC 25)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/34, 2-4=-1769/245, 4-6=-1774/248, 2-11=-614/194, 6-7=-484/135

BOT CHORD 10-11=-161/1438, 8-10=0/968, 7-8=-42/1443

WEBS 4-8=-147/797, 5-8=-373/272, 4-10=-144/791, 3-10=-365/269, 3-11=-1163/27, 5-7=-1307/59

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 91 lb uplift at joint 7.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 11. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY

TRENCO

A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	I73039221
25040186	B04	Common	2	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:40
ID:Bs2sSo_O26gZvxDdke1gxazuPcH-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

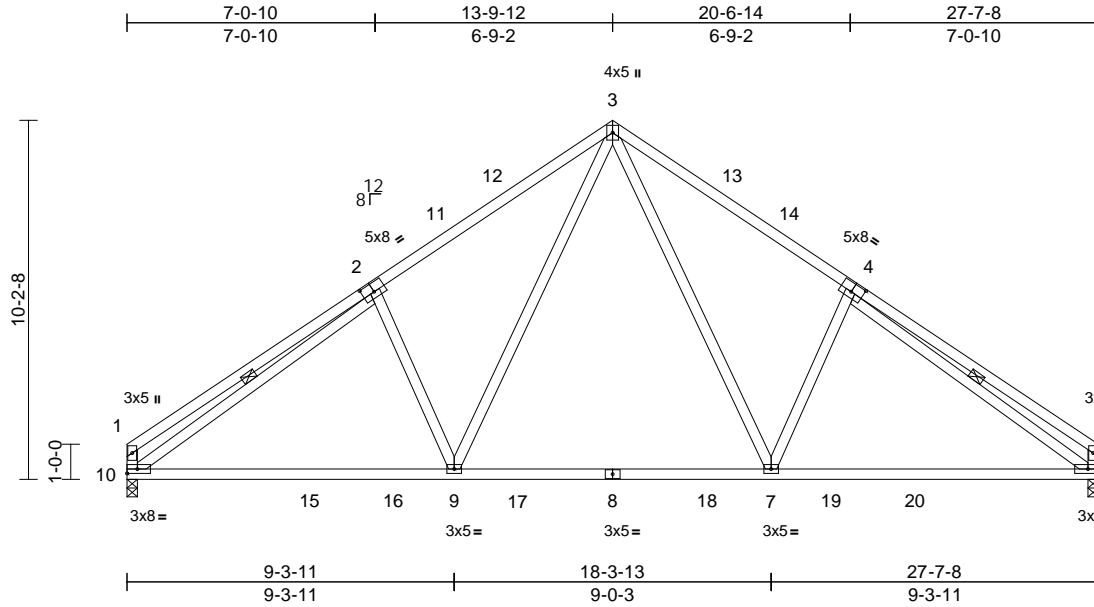

Scale = 1:65.5

Plate Offsets (X, Y): [2:0-4-0,0-3-0], [4:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	-0.13	9-10	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.26	6-7	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.50	Horz(CT)	0.03	6	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
Weight: 165 lb											FT = 20%	

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except* 7-3,9-3:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 2-10, 4-6

REACTIONS

(size) 6=0-3-8, 10=0-3-8
Max Horiz 10=-241 (LC 10)
Max Uplift 6=-91 (LC 15), 10=-91 (LC 14)
Max Grav 6=1282 (LC 25), 10=1282 (LC 24)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-3=-1776/247, 3-5=-1775/249,
1-10=-494/135, 5-6=-484/135
BOT CHORD 9-10=-163/1446, 7-9=0/969, 6-7=-42/1444
WEBS 3-7=-147/798, 4-7=-374/272, 3-9=-147/800,
2-9=-374/272, 2-10=-1291/75, 4-6=-1309/59

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior (1) 3-1-12 to 10-9-12, Exterior(2R) 10-9-12 to 16-9-12, Interior (1) 16-9-12 to 24-5-12, Exterior(2E) 24-5-12 to 27-5-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 10 and 6. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	
25040186	B05	Common	2	1	Job Reference (optional)	I73039222

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:40
ID:4MlyjMqE562Prxk7TPldvuzuPcU-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?i

Page: 1

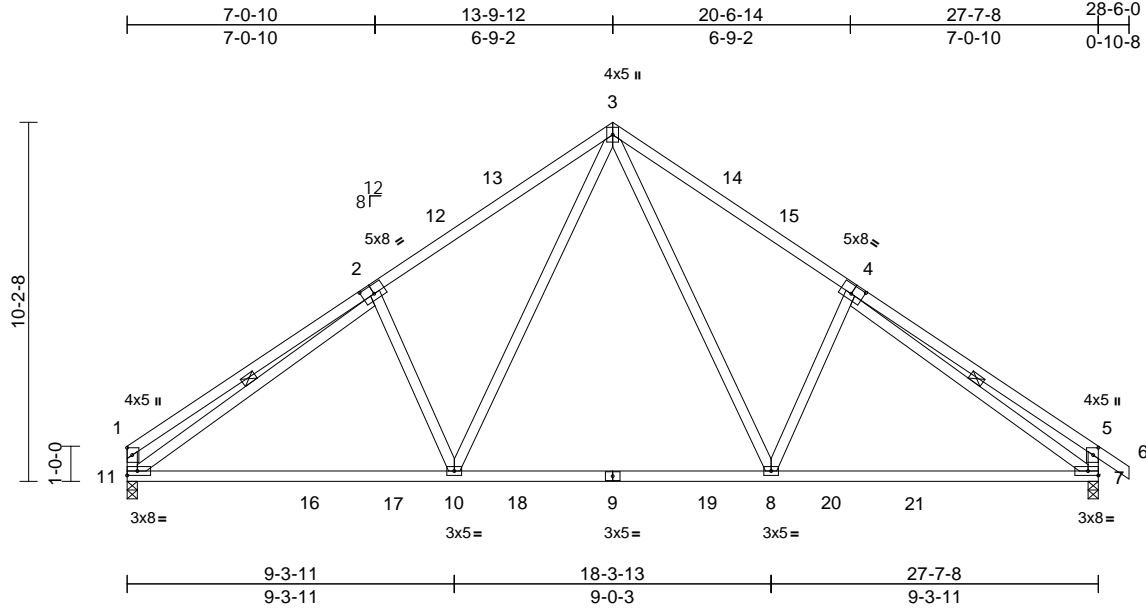

Scale = 1:65.5

Plate Offsets (X, Y): [2:0-4-0,0-3-0], [4:0-4-0,0-3-0], [5:0-2-8,0-1-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.69	Vert(LL)	-0.13	7-8	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.26	7-8	>999	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.50	Horz(CT)	0.03	7	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
Weight: 167 lb FT = 20%											

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except* 8-3,10-3:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 2-11, 4-7

REACTIONS

(size) 7=0-3-8, 11=0-3-8
Max Horiz 11=251 (LC 10)
Max Uplift 7=111 (LC 15), 11=91 (LC 14)
Max Grav 7=1340 (LC 26), 11=1281 (LC 25)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-3=-1775/247, 3-5=-1768/247, 5-6=0/34, 1-11=-494/135, 5-7=-604/194
BOT CHORD 10-11=-152/1452, 8-10=0/976, 7-8=-19/1444
WEBS 3-8=-144/789, 4-8=-365/269, 3-10=-146/799, 2-10=-373/272, 2-11=-1289/74, 4-7=-1181/25

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior (1) 3-1-12 to 10-9-12, Exterior(2R) 10-9-12 to 16-9-12, Interior (1) 16-9-12 to 25-6-0, Exterior(2E) 25-6-0 to 28-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 11 and 7. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	I73039223
25040186	B06	Common	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:40
ID:79iMI2w2l68PpE6UtRVbBwzKxHH-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

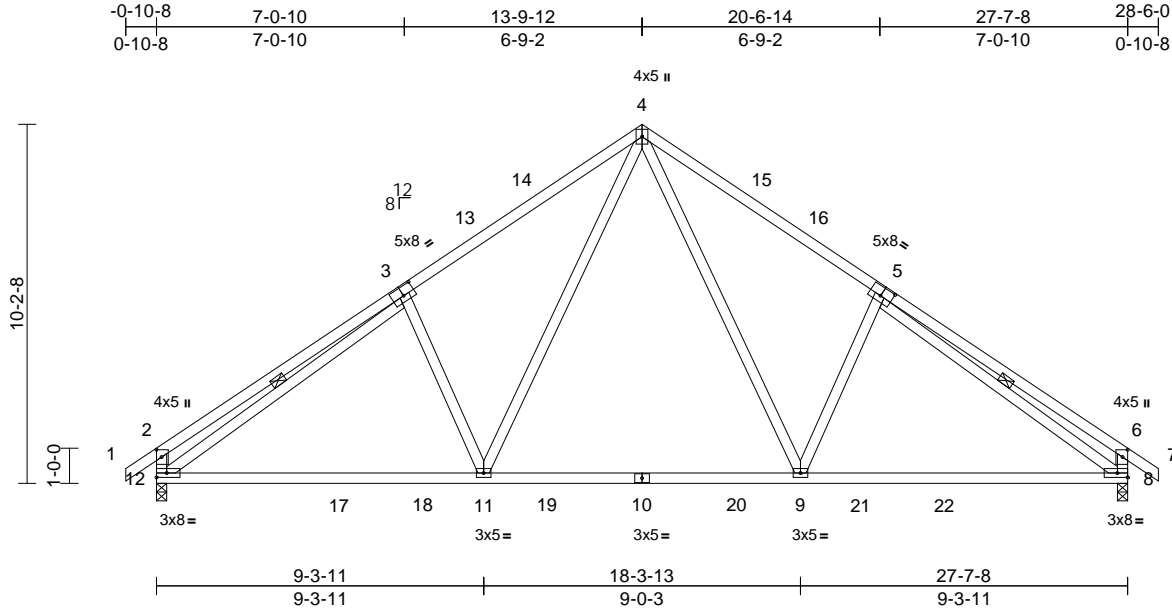

Scale = 1:65.5

Plate Offsets (X, Y): [2:0-2-8,0-1-12], [3:0-4-0,0-3-0], [5:0-4-0,0-3-0], [6:0-2-8,0-1-12]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.69	Vert(LL)	-0.13	11-12	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.26	8-9	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.45	Horz(CT)	0.03	8	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 168 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except* 9-4,11-4:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-12, 5-8

REACTIONS

(size) 8=0-3-8, 12=0-3-8
Max Horiz 12=-257 (LC 12)
Max Uplift 8=-111 (LC 15), 12=-111 (LC 14)
Max Grav 8=1339 (LC 26), 12=1339 (LC 25)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/34, 2-4=-1767/245, 4-6=-1766/246, 6-7=0/34, 2-12=-614/194, 6-8=-605/194
BOT CHORD 11-12=-150/1444, 9-11=0/975, 8-9=-19/1443
WEBS 4-9=-144/789, 5-9=-365/269, 4-11=-144/791, 3-11=-365/269, 3-12=-1161/26, 5-8=-1178/24

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 10-9-12, Exterior(2R) 10-9-12 to 16-9-12, Interior (1) 16-9-12 to 25-6-0, Exterior(2E) 25-6-0 to 28-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 12 and 8. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039224
25040186	B07	Common Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,
Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:41
ID:8F9dtU?eZjwH8FN0r33803zuPcF-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCdoi7J4zJC?f
Page: 1

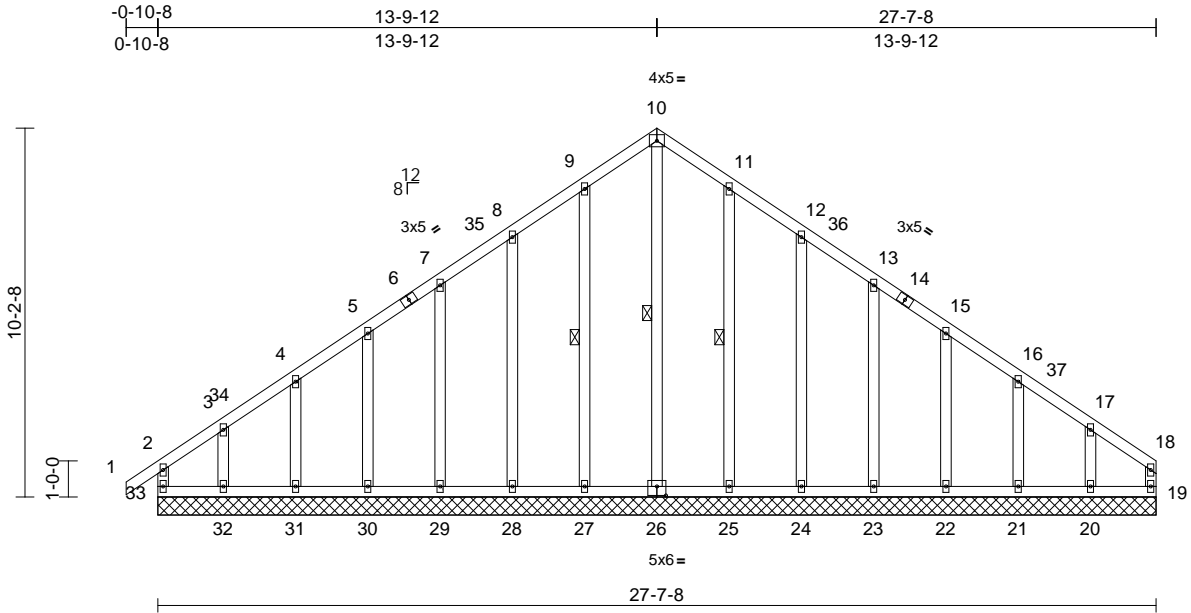

Scale = 1:63.8									
Plate Offsets (X, Y): [6:0-0-0,0-0-0], [26:0-3-0,0-3-0]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	-	999
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	n/a	-	999
TCDL	10.0	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.01	19	n/a
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR					
BCDL	10.0								
Weight: 198 lb FT = 20%									
PLATES MT20 GRIP 244/190									

LUMBER		TOP CHORD		2-33=-179/99, 1-2=0/34, 2-3=-194/175, 3-4=-144/134, 4-5=-133/135, 5-7=-116/163, 7-8=-109/195, 8-9=-143/251, 9-10=-172/298, 10-11=-172/298, 11-12=-143/251, 12-13=-109/191, 13-15=-82/137, 15-16=-83/101, 16-17=-93/82, 17-18=-129/115, 18-19=-91/55	4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
TOP CHORD	2x4 SP No.2	BOT CHORD		32-33=-101/115, 31-32=-101/115, 30-31=-101/115, 29-30=-101/115, 28-29=-101/115, 27-28=-101/115, 25-27=-101/115, 24-25=-101/115, 23-24=-101/115, 22-23=-101/115, 21-22=-101/115, 20-21=-101/115, 19-20=-101/115	5) Unbalanced snow loads have been considered for this design.
BOT CHORD	2x4 SP No.2				6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
WEBS	2x4 SP No.3	WEBS		10-26=-267/96, 9-27=-219/74, 8-28=-182/87, 7-29=-143/81, 5-30=-143/84, 4-31=-144/75, 3-32=-146/125, 11-25=-218/72, 12-24=-182/88, 13-23=-143/81, 15-22=-143/84, 16-21=-143/76, 17-20=-149/114	7) All plates are 2x4 MT20 unless otherwise indicated.
OTHERS	2x4 SP No.3				8) Gable requires continuous bottom chord bearing.
BRACING		NOTES		3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.	9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.				10) Gable studs spaced at 2-0-0 oc.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.	REACTIONS (size)		19=27-7-8, 20=27-7-8, 21=27-7-8, 22=27-7-8, 23=27-7-8, 24=27-7-8, 25=27-7-8, 26=27-7-8, 27=27-7-8, 28=27-7-8, 29=27-7-8, 30=27-7-8, 31=27-7-8, 32=27-7-8, 33=27-7-8	11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
WEBS	1 Row at midpt 10-26, 9-27, 11-25				12) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
FORCES		FORCES		(lb) - Maximum Compression/Maximum Tension	

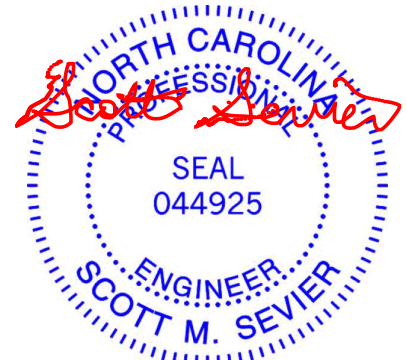

April 29,2025

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	B07	Common Supported Gable	1	1	I73039224
					Job Reference (optional)

13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 122 lb uplift at joint 33, 71 lb uplift at joint 19, 50 lb uplift at joint 27, 63 lb uplift at joint 28, 56 lb uplift at joint 29, 63 lb uplift at joint 30, 40 lb uplift at joint 31, 145 lb uplift at joint 32, 48 lb uplift at joint 25, 64 lb uplift at joint 24, 56 lb uplift at joint 23, 62 lb uplift at joint 22, 43 lb uplift at joint 21 and 129 lb uplift at joint 20.

LOAD CASE(S) Standard

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039225
25040186	C01	Monopitch Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:41

Page: 1

ID:4MlyjMqE562Prxk7TPIdvuzuPcU-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

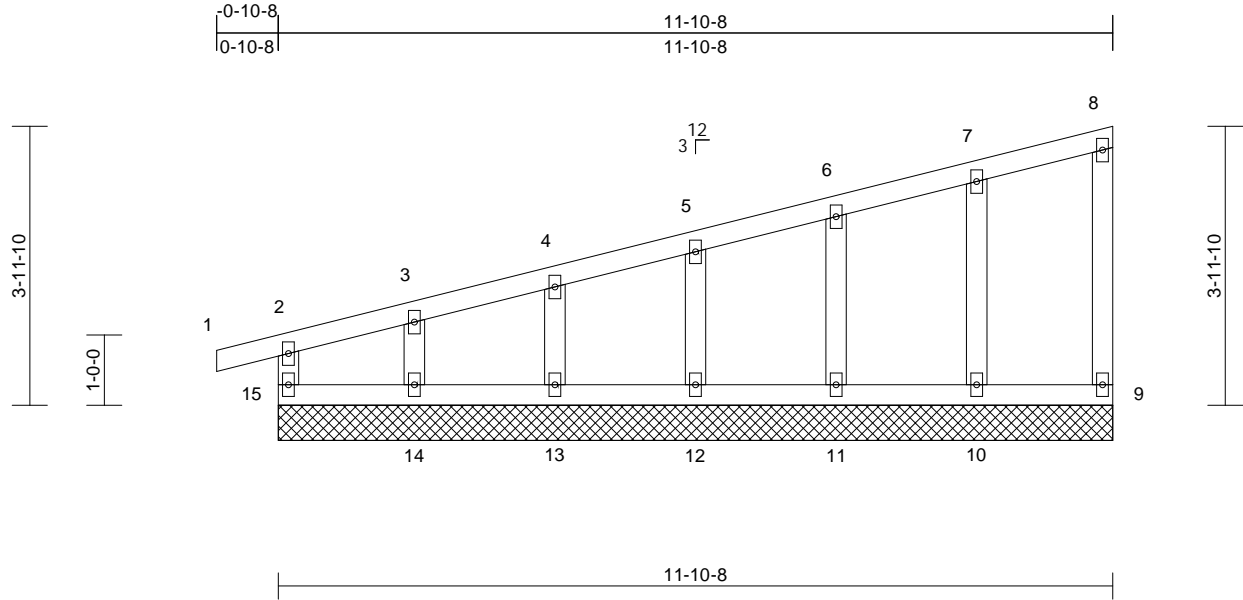

Scale = 1:32.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.08	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00	9	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR							
BCDL	10.0									Weight: 57 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	9=11-10-8, 10=11-10-8, 11=11-10-8, 12=11-10-8, 13=11-10-8, 14=11-10-8, 15=11-10-8
Max Horiz	15=142 (LC 11)
Max Uplift	9=12 (LC 11), 10=27 (LC 10), 11=30 (LC 14), 12=32 (LC 14), 13=23 (LC 10), 14=70 (LC 14), 15=6 (LC 10)
Max Grav	9=77 (LC 21), 10=217 (LC 21), 11=209 (LC 21), 12=212 (LC 21), 13=189 (LC 21), 14=143 (LC 1), 15=142 (LC 26)


FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	2-15=-123/78, 1-2=0/15, 2-3=-101/127, 3-4=-81/107, 4-5=-75/100, 5-6=-67/90, 6-7=-61/82, 7-8=-52/75, 8-9=-62/40
BOT CHORD	14-15=-48/82, 13-14=-48/82, 12-13=-48/82, 11-12=-48/82, 10-11=-48/82, 9-10=-48/82
WEBS	5-12=-172/114, 4-13=-149/111, 3-14=-153/133, 6-11=-169/119, 7-10=-175/94

NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) 0-10-8 to 1-11-4, Exterior(2N) 1-11-4 to 8-8-12, Corner(3E) 8-8-12 to 11-8-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) All plates are 2x4 MT20 unless otherwise indicated.
- 7) Gable requires continuous bottom chord bearing.
- 8) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 9) Gable studs spaced at 2-0-0 oc.
- 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 6 lb uplift at joint 15, 12 lb uplift at joint 9, 32 lb uplift at joint 12, 23 lb uplift at joint 13, 70 lb uplift at joint 14, 30 lb uplift at joint 11 and 27 lb uplift at joint 10.

LOAD CASE(S) Standard

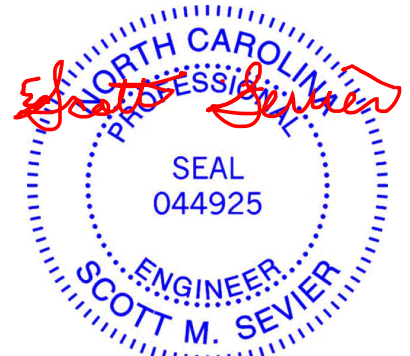

April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039226
25040186	C02	Monopitch	3	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:41

Page: 1

ID:4MlyjMqE562Prxk7TPIdvuzuPcU-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

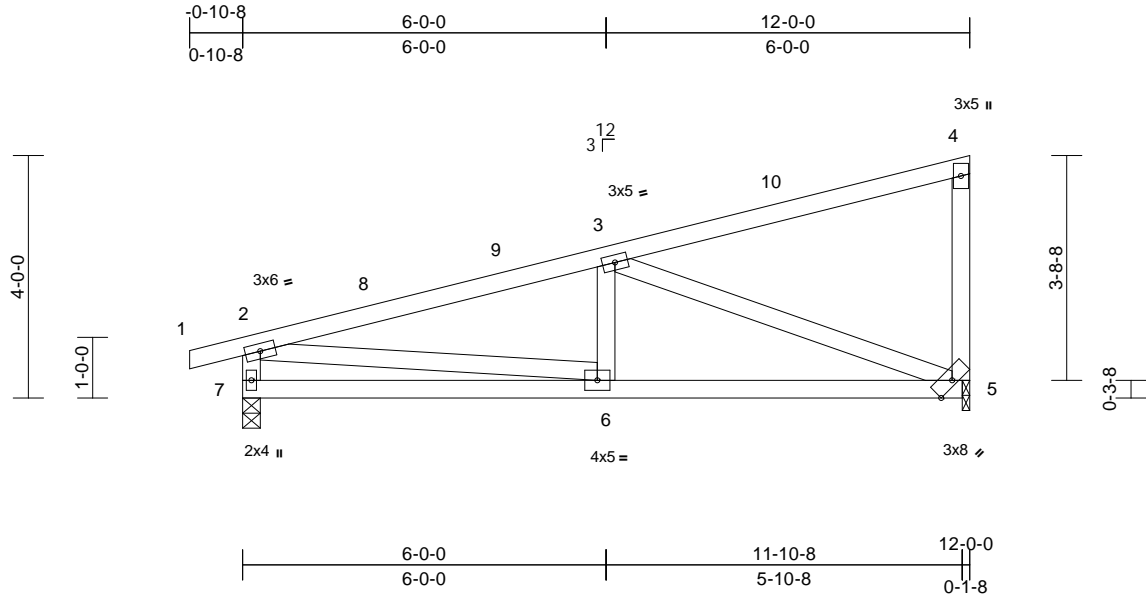

Scale = 1:38

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.56	Vert(LL)	-0.03	5-6	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.38	Vert(CT)	-0.07	5-6	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.01	5	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 63 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-8-12 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	5=0-1-8, 7=0-3-8
Max Horiz	7=143 (LC 13)
Max Uplift	5=-83 (LC 14), 7=-104 (LC 10)
Max Grav	5=594 (LC 21), 7=593 (LC 21)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/15, 2-3=-963/233, 3-4=-101/56, 4-5=-213/114, 2-7=-536/257
BOT CHORD	6-7=-135/342, 5-6=-196/896
WEBS	3-6=0/212, 3-5=-922/270, 2-6=-104/695

NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 8-10-4, Exterior(2E) 8-10-4 to 11-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 7 and 5. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	C03	Monopitch	8	1	Job Reference (optional)
					I73039227

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:41

Page: 1

ID:Aw3hNv5HKDtMR6XYBKLTqzuBPC-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

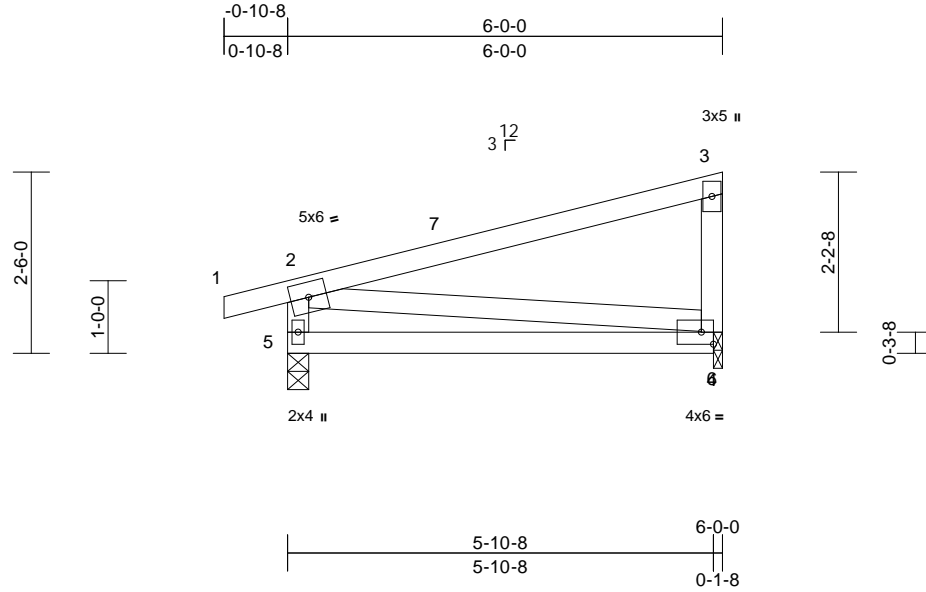

Scale = 1:31.8

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.03	4-5	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.28	Vert(CT)	-0.07	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.17	Horz(CT)	0.00	4	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 31 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	4=0-1-8, 5=0-3-8
Max Horiz	5=85 (LC 11)
Max Uplift	4=-41 (LC 14), 5=-71 (LC 10)
Max Grav	4=292 (LC 21), 5=395 (LC 21)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/21, 2-3=-104/41, 2-5=-344/255, 4-6=-229/152, 3-6=-210/137
BOT CHORD	4-5=-153/315
WEBS	2-6=-266/190

NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 5-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5 and 4. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	C04	Monopitch Supported Gable	1	1	Job Reference (optional)
					I73039228

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:41

Page: 1

ID:YYJKXhrssQAGS5JJ16psR6zuPcT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

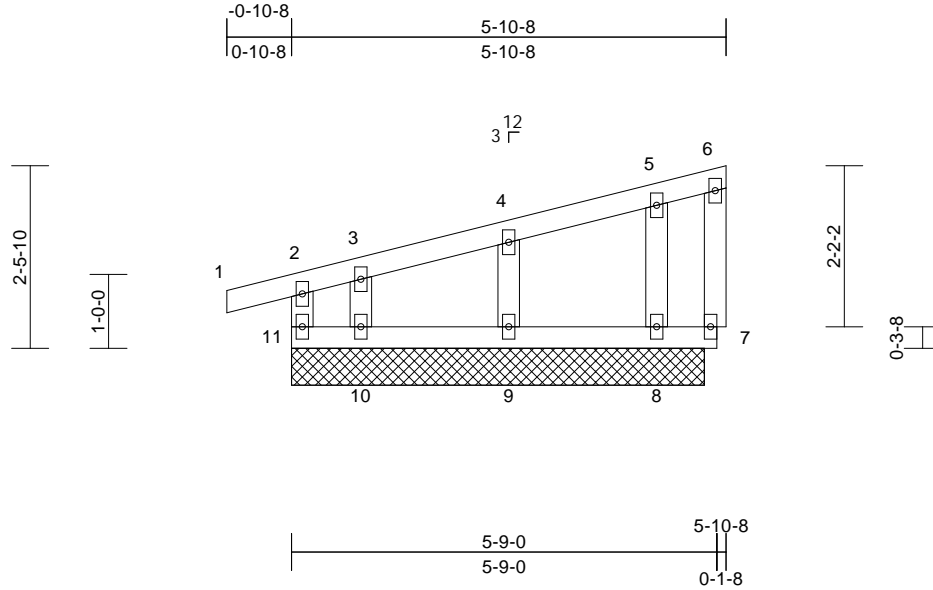

Scale = 1:31.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.15	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.05	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00	7	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR							
BCDL	10.0										
										Weight: 28 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-10-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS	(size)	7=5-7-0, 8=5-7-0, 9=5-7-0, 10=5-7-0, 11=5-7-0
	Max Horiz	11=84 (LC 11)
	Max Uplift	7=-14 (LC 11), 8=-18 (LC 10), 9=-32 (LC 10), 10=-60 (LC 11), 11=-23 (LC 10)
REACTIONS	Max Grav	7=10 (LC 21), 8=170 (LC 21), 9=230 (LC 21), 10=107 (LC 21), 11=158 (LC 21)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	2-11=-147/113, 1-2=0/21, 2-3=-69/83, 3-4=-41/64, 4-5=-36/50, 5-6=-28/48, 6-7=-13/17
BOT CHORD	10-11=-30/45, 9-10=-30/45, 8-9=-30/45, 7-8=-30/45
WEBS	4-9=-186/183, 3-10=-124/120, 5-8=-135/112

NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 2-8-12, Corner(3E) 2-8-12 to 5-8-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) All plates are 2x4 MT20 unless otherwise indicated.
- 7) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 8) Gable studs spaced at 2-0-0 oc.
- 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 11) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 11, 7, 9, 10, and 8. This connection is for uplift only and does not consider lateral forces.
- 12) Non Standard bearing condition. Review required.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	C06	Jack-Open	15	1	Job Reference (optional)
					I73039229

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:41

Page: 1

ID:YYJKXhrssQAGS5JJ16psR6zuPcT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

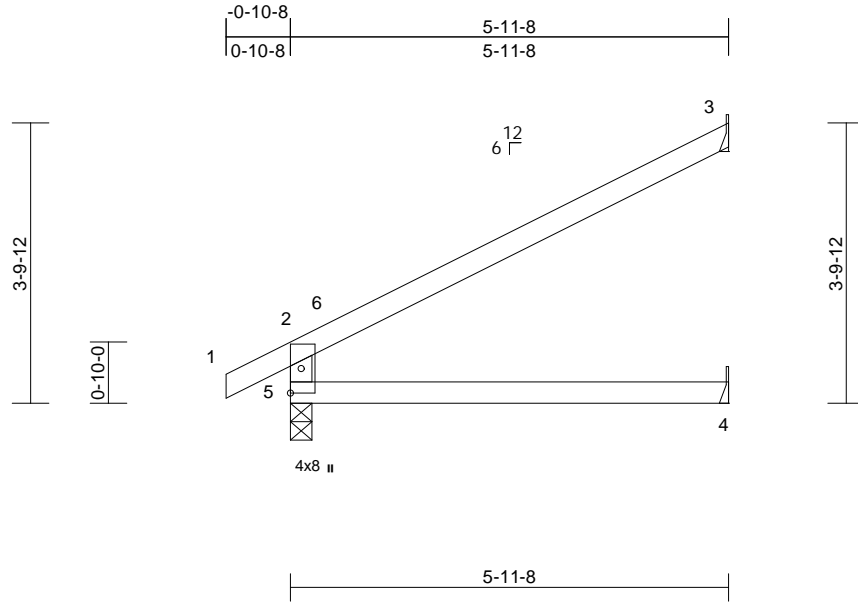

Scale = 1:31.3

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	0.07	4-5	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.13	4-5	>537	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.06	3	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR								
BCDL	10.0											
											Weight: 21 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	3= Mechanical, 4= Mechanical,
		5=0-3-8
	Max Horiz	5=114 (LC 14)
	Max Uplift	3=-87 (LC 14), 5=-20 (LC 14)
	Max Grav	3=246 (LC 21), 4=109 (LC 7), 5=385 (LC 21)

FORCES	(lb) - Maximum Compression/Maximum Tension
--------	--

TOP CHORD	2-5=-350/180, 1-2=0/27, 2-3=-129/85
BOT CHORD	4-5=0/0

NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be User Defined .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 3.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	C07	Jack-Open Supported Gable	1	1	Job Reference (optional)
					173039230

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 E May 9 2024 Print: 8.730 E May 9 2024 MiTek Industries, Inc. Mon Apr 28 16:48:07

Page: 1

ID:YYJKxhrrsQAGS5JJ16psR6zuPcT-Zo2Jw0Ze15itNEUk16C5caLMu3jOv5CthMbtNzM8Rs

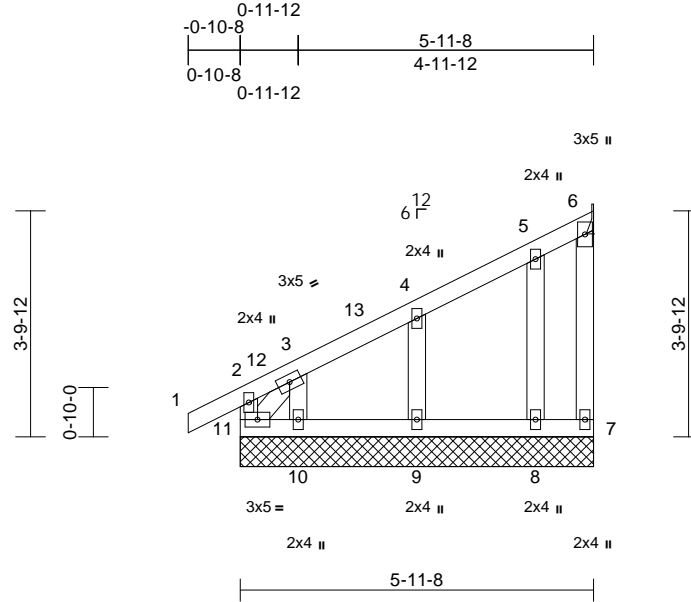

Scale = 1:38.8

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	0.00	9-10	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.13	Vert(CT)	0.00	9-10	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.01	6	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 35 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-11-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size)	6=7/ Mechanical, 7=-3/5-11-8, 8=152/5-11-8, 9=99/5-11-8, 10=260/5-11-8
Max Horiz	10=135 (LC 11)
Max Uplift	6=-25 (LC 13), 7=-5 (LC 31), 8=-20 (LC 14), 9=-87 (LC 14), 10=-4 (LC 10)
Max Grav	6=17 (LC 10), 7=3 (LC 7), 8=207 (LC 21), 9=179 (LC 21), 10=308 (LC 21)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	2-11=-91/240, 1-2=0/27, 2-3=-33/110, 3-4=-109/149, 4-5=-67/97, 5-6=-58/80, 6-7=0/0
BOT CHORD	10-11=-143/205, 9-10=-44/80, 8-9=-44/80, 7-8=-44/80
WEBS	4-9=-177/220, 3-10=-185/189, 5-8=-159/149, 3-11=-335/208

NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 2-9-12, Corner(3E) 2-9-12 to 5-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 7.
- One RT3A MiTek connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 6 and 8. This connection is for uplift only and does not consider lateral forces.

13) N/A

14) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	
25040186	C08	Jack-Open	1	1	Job Reference (optional)	I73039231

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:41

Page: 1

ID: yPXu7X4P9ZhRsAr9CJAYFKzuPc9-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

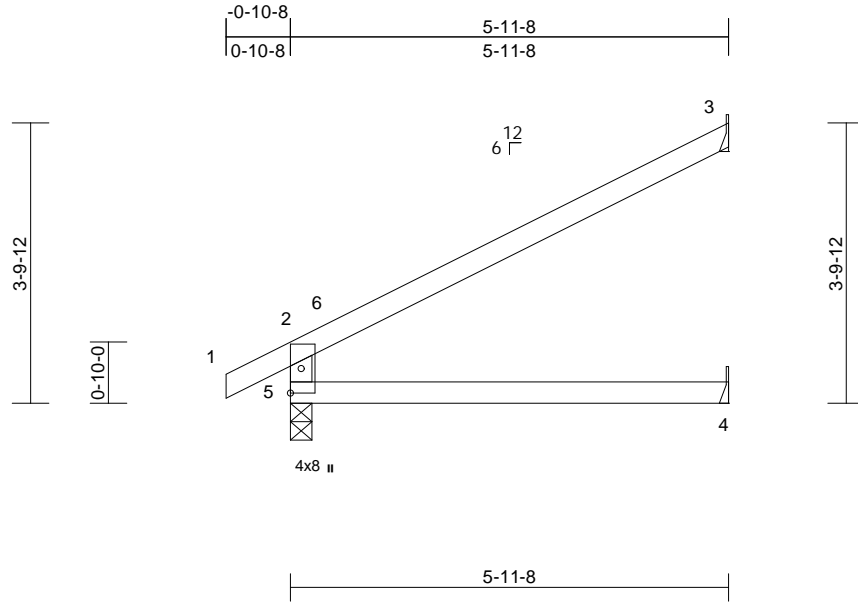

Scale = 1:31.3

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	0.07	4-5	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.13	4-5	>537	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.06	3	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR								
BCDL	10.0										Weight: 21 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical,
5=0-3-8
Max Horiz 5=114 (LC 14)
Max Uplift 3=-87 (LC 14), 5=-20 (LC 14)
Max Grav 3=246 (LC 21), 4=109 (LC 7),
5=385 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-350/180, 1-2=0/27, 2-3=-129/85
BOT CHORD 4-5=0/0

NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be User Defined.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 3.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	C09	Jack-Open	4	1	Job Reference (optional)
					I73039232

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42

Page: 1

ID:YYJKhrssQAGS5JJ16psR6zuPcT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?fi

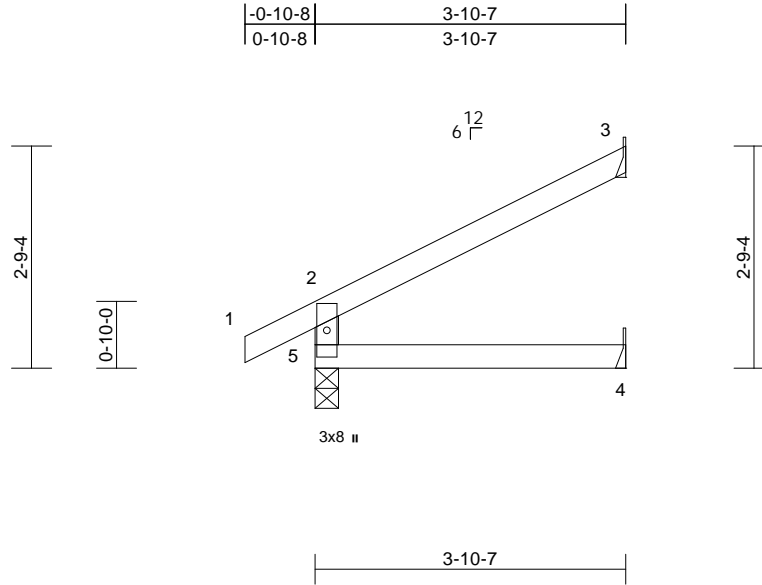

Scale = 1:28.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	0.01	4-5	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.16	Vert(CT)	-0.02	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR								
BCDL	10.0											
											Weight: 14 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 3-10-7 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	3= Mechanical, 4= Mechanical,
		5=0-3-8
	Max Horiz	5=76 (LC 14)
	Max Uplift	3=-57 (LC 14), 5=-17 (LC 14)
	Max Grav	3=151 (LC 21), 4=69 (LC 7), 5=320 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD	2-5=-292/139, 1-2=0/43, 2-3=-88/52
BOT CHORD	4-5=0/0

NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be User Defined.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 57 lb uplift at joint 3.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	C10	Jack-Open	4	1	Job Reference (optional)


I73039233

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42

Page: 1

ID:YYJKxhrrsQAGS5JJ16psR6zuPcT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?fi

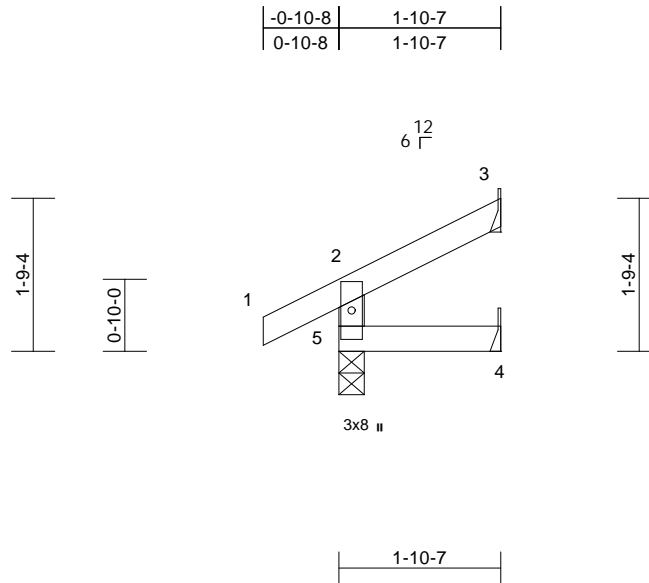

Scale = 1:26.6

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.00	4-5	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	0.00	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR								
BCDL	10.0											
											Weight: 8 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or
 1-10-7 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
 bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical,
 5=0-3-8
 Max Horiz 5=40 (LC 14)
 Max Uplift 3=-28 (LC 14), 5=-16 (LC 14)
 Max Grav 3=52 (LC 21), 4=31 (LC 7), 5=206
 (LC 21)

FORCES (lb) - Maximum Compression/Maximum
 Tension

TOP CHORD 2-5=-184/101, 1-2=0/39, 2-3=-43/21
 BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust)
 Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat.
 II; Exp B; Enclosed; MWFRS (envelope) exterior zone
 and C-C Exterior(2E) zone; cantilever left and right
 exposed; end vertical left and right exposed; C-C for
 members and forces & MWFRS for reactions shown;
 Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15
 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate
 DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9;
 Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this
 design.
- 4) This truss has been designed for greater of min roof live
 load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on
 overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom
 chord live load nonconcurrent with any other live loads.

- 6) * This truss has been designed for a live load of 20.0psf
 on the bottom chord in all areas where a rectangle
 3-06-00 tall by 2-00-00 wide will fit between the bottom
 chord and any other members.
- 7) All bearings are assumed to be User Defined .
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to
 bearing plate capable of withstanding 28 lb uplift at joint
 3.
- 10) One H2.5A Simpson Strong-Tie connectors
 recommended to connect truss to bearing walls due to
 UPLIFT at jt(s) 5. This connection is for uplift only and
 does not consider lateral forces.

LOAD CASE(S) Standard

April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	C13	Diagonal Hip Girder	2	1	Job Reference (optional)


I73039234

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42

Page: 1

ID:FTw6t16y7WVQsfid4EcD_CrDzuPcJ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f

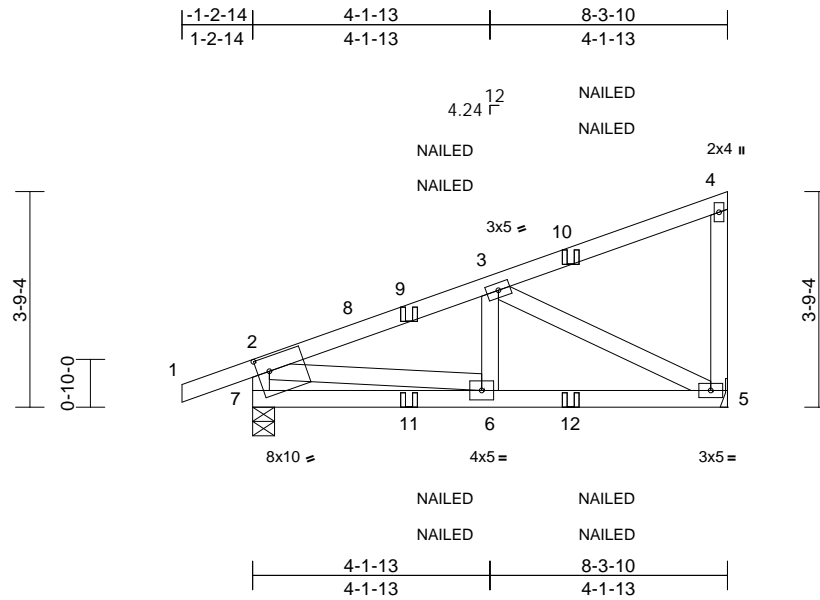

Scale = 1:40.3

Plate Offsets (X, Y): [7:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.46	Vert(LL)	-0.01	5-6	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	-0.03	5-6	>999	180	
TCDL	10.0	Rep Stress Incr	NO	WB	0.26	Horz(CT)	0.00	5	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 47 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS

(size) 5= Mechanical, 7=0-4-9
 Max Horiz 7=144 (LC 9)
 Max Uplift 5=-86 (LC 12), 7=-105 (LC 8)
 Max Grav 5=483 (LC 19), 7=512 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-7=-481/122, 1-2=0/28, 2-3=-641/80,
 3-4=-108/40, 4-5=-156/54
 BOT CHORD 6-7=-142/12, 5-6=-118/568
 WEBS 2-6=-38/574, 3-6=0/169, 3-5=-635/133


NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust)
 Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0"-0" tall by 2'-0"-0" wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 86 lb uplift at joint 5.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 7. This connection is for uplift only and does not consider lateral forces.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-60, 2-4=-60, 5-7=-20
 Concentrated Loads (lb)
 Vert: 10=-132 (F=-66, B=-66), 11=1 (F=0, B=0), 12=-35 (F=-17, B=-17)

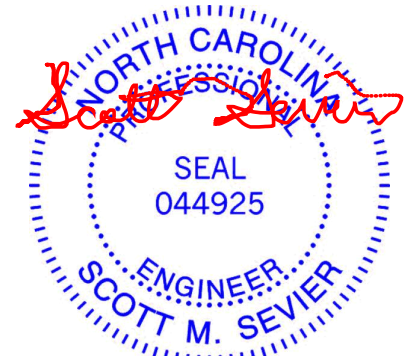

April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039235
25040186	D01	Common Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42

Page: 1

ID:0lti81rUdkI74FuWbqK5_JzuPcS-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC7f

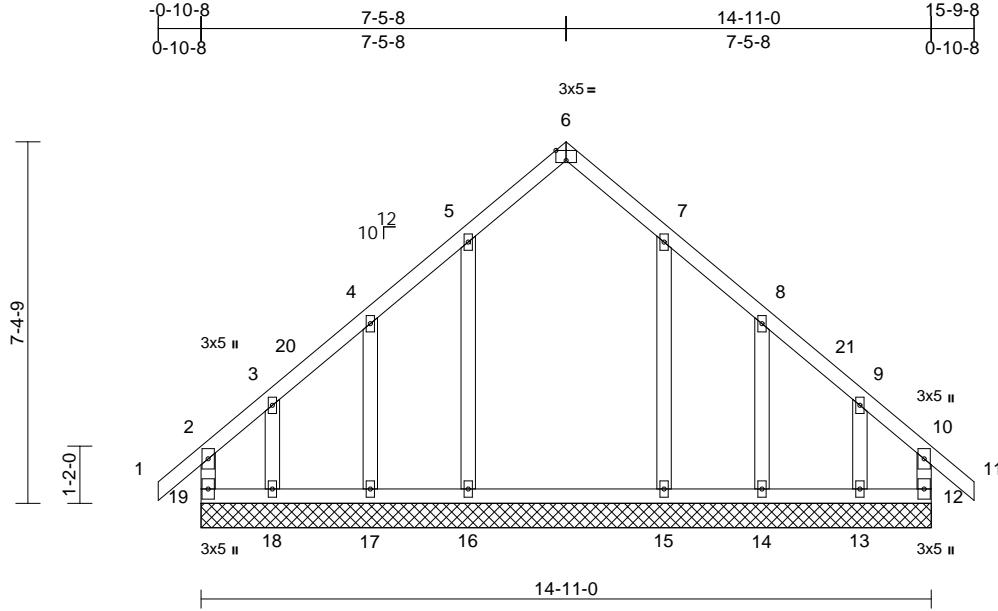

Scale = 1:47.1

Plate Offsets (X, Y): [6'-0-2-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	n/a	-	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.00	12	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR							
BCDL	10.0										
										Weight: 89 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS	(size)	12=14-11-0, 13=14-11-0, 14=14-11-0, 15=14-11-0, 16=14-11-0, 17=14-11-0, 18=14-11-0, 19=14-11-0
	Max Horiz	19=196 (LC 12)
	Max Uplift	12=44 (LC 13), 13=202 (LC 15), 14=88 (LC 15), 15=16 (LC 15), 16=19 (LC 14), 17=86 (LC 14), 18=204 (LC 14), 19=52 (LC 12)
	Max Grav	12=257 (LC 28), 13=198 (LC 26), 14=193 (LC 22), 15=368 (LC 6), 16=368 (LC 5), 17=193 (LC 21), 18=202 (LC 25), 19=260 (LC 27)

FORCES

TOP CHORD	(lb) - Maximum Compression/Maximum Tension	2-19=-193/44, 1-2=0/39, 2-3=-212/101, 3-4=-126/59, 4-5=-128/57, 5-6=-158/104, 6-7=-158/104, 7-8=-128/57, 8-9=-124/54, 9-10=-209/94, 10-11=0/39, 10-12=-191/38
		18-19=-89/253, 17-18=-89/253, 16-17=-89/253, 15-16=-89/253, 14-15=-89/253, 13-14=-89/253, 12-13=-89/253
BOT CHORD		18-19=-89/253, 17-18=-89/253, 16-17=-89/253, 15-16=-89/253, 14-15=-89/253, 13-14=-89/253, 12-13=-89/253
		12-13=-89/253
WEBS		5-16=-259/58, 4-17=-160/161, 3-18=-135/179, 7-15=-259/56, 8-14=-160/159, 9-13=-124/194

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 4-5-8, Corner(3R) 4-5-8 to 10-5-8, Exterior(2N) 10-5-8 to 12-9-8, Corner(3E) 12-9-8 to 15-9-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2'-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 19, 44 lb uplift at joint 12, 19 lb uplift at joint 16, 86 lb uplift at joint 17, 204 lb uplift at joint 18, 16 lb uplift at joint 15, 88 lb uplift at joint 14 and 202 lb uplift at joint 13.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	
25040186	D02	Common	2	1	Job Reference (optional)	I73039236

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42

Page: 1

ID:JDjFhD4SkalqUUm6L11D9uzuAV6-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

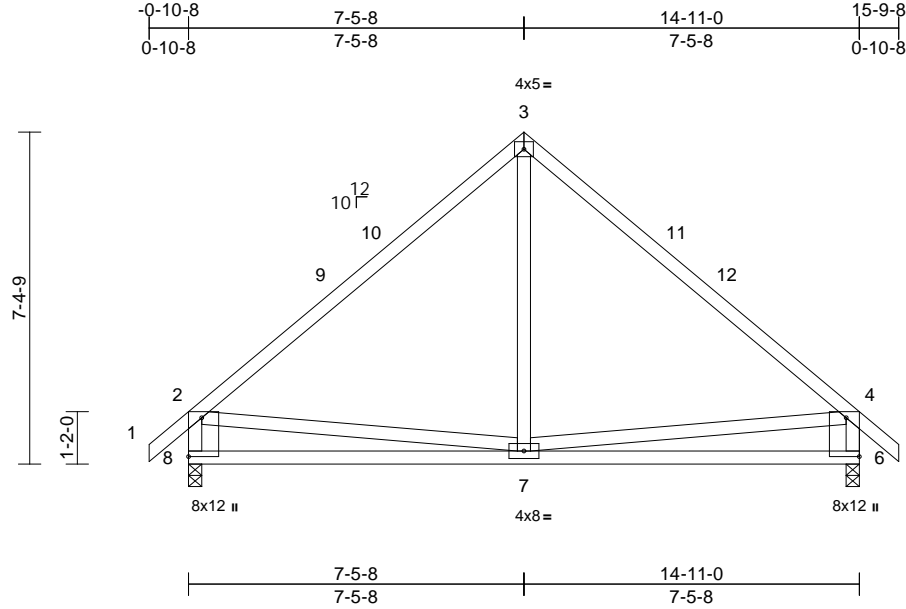

Scale = 1:51.2

Plate Offsets (X, Y): [6:Edge,0-3-8], [8:Edge,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.99	Vert(LL)	-0.06	6-7	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.48	Vert(CT)	-0.12	6-7	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.17	Horz(CT)	0.01	6	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 88 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except* 8-2,6-4:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 6=0-3-8, 8=0-3-8
Max Horiz 8=196 (LC 12)
Max Uplift 6=58 (LC 15), 8=58 (LC 14)
Max Grav 6=717 (LC 22), 8=717 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/39, 2-3=-659/126, 3-4=-659/126, 4-5=0/39, 2-8=-653/159, 4-6=-653/155
BOT CHORD 7-8=-290/487, 6-7=-211/449
WEBS 3-7=0/308, 2-7=-161/328, 4-7=-167/331

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-10-8 to 2-1-8, Interior (1) 2-1-8 to 4-5-8, Exterior(2R) 4-5-8 to 10-5-8, Interior (1) 10-5-8 to 12-9-8, Exterior(2E) 12-9-8 to 15-9-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 8 and 6. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	
25040186	D03	Common Girder	1	2	Job Reference (optional)	I73039237

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42
ID:yPXu7X4P9ZhRsAr9CJAYFKzuPc9-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

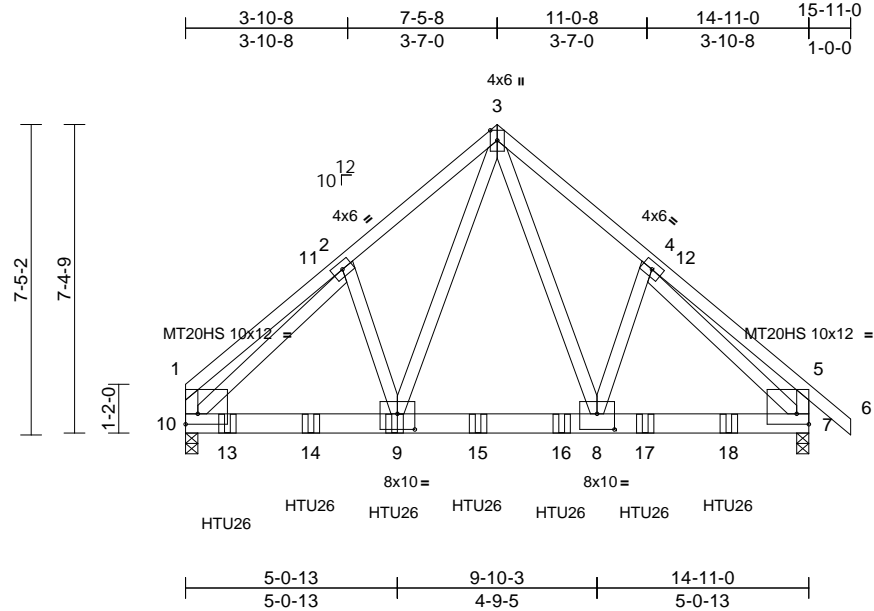

Scale = 1:55.1

Plate Offsets (X, Y): [1:Edge,0-3-0], [5:Edge,0-3-0], [8:0-5-0,0-4-8], [9:0-5-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	-0.05	8-9	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.09	8-9	>999	180	MT20HS	187/143
TCDL	10.0	Rep Stress Incr	NO	WB	0.63	Horz(CT)	0.02	7	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
Weight: 229 lb											FT = 20%	

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except* 10-1,7-5:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-6-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 7=0-3-8, 10=0-3-8
Max Horiz 10=188 (LC 8)
Max Uplift 7=401 (LC 13), 10=423 (LC 12)
Max Grav 7=4769 (LC 23), 10=5248 (LC 22)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-1230/167, 2-3=-4794/500,
3-4=-4764/497, 4-5=-1260/191, 5-6=0/44,
1-10=-880/136, 5-7=-982/178
BOT CHORD 9-10=-312/3611, 8-9=-189/2709,
7-8=-244/3508
WEBS 3-8=-337/3101, 4-8=-95/561, 3-9=-342/3164,
2-9=-96/543, 2-10=-3918/299, 4-7=-3871/280

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 10 and 7. This connection is for uplift only and does not consider lateral forces.
- Use Simpson Strong-Tie HTU26 (10-16d Girder, 14-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-0-0 from the left end to 13-0-0 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-60, 3-5=-60, 5-6=-60, 7-10=-20
Concentrated Loads (lb)

Vert: 9=-1088 (B), 13=-1089 (B), 14=-1088 (B), 15=-1088 (B), 16=-1088 (B), 17=-1088 (B), 18=-1088 (B)



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039238
25040186	PB01	Piggyback	2	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42
ID:02DJWNN4Om_2XaKzYr?dpfzuAW0-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

-0-11-1	1-7-15	3-3-14	4-2-15
0-11-1	1-7-15	1-7-15	0-11-1

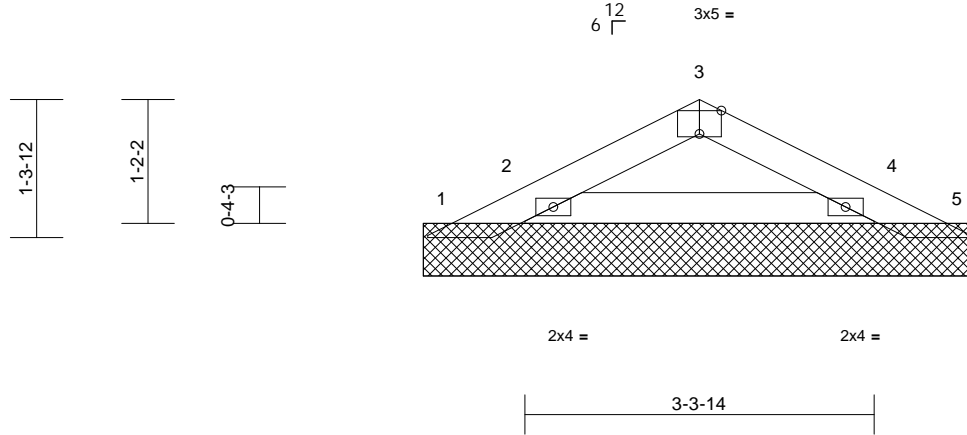

Scale = 1:21.9

Plate Offsets (X, Y): [3:0-2-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999	
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	9	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 14 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-3-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=5-3-0, 2=5-3-0, 4=5-3-0, 5=5-3-0
Max Horiz 1=18 (LC 14)
Max Uplift 1=30 (LC 7), 2=21 (LC 14), 4=19 (LC 15), 5=28 (LC 7)
Max Grav 1=6 (LC 14), 2=255 (LC 21), 4=242 (LC 22), 5=1 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-18/43, 2-3=-112/66, 3-4=-113/66, 4-5=-2/39
BOT CHORD 2-4=-2/83

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 2, 19 lb uplift at joint 4, 30 lb uplift at joint 1, 28 lb uplift at joint 5, 21 lb uplift at joint 2 and 19 lb uplift at joint 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039239
25040186	V01	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42

Page: 1

ID:dSe_?JVksdORLhCGs9s8GvzuPgn-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCDoi7J4zJC?f

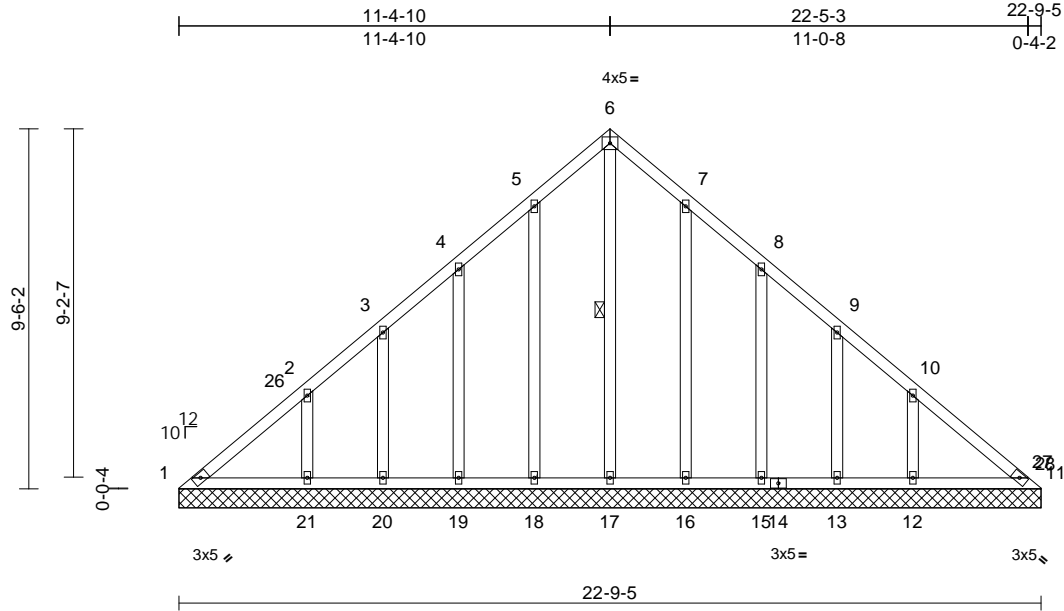

Scale = 1:60.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.12	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.25	Horiz(TL)	0.01	11	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
										Weight: 147 lb FT = 20%	

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

WEBS	1 Row at midpt	6-17
------	----------------	------

REACTIONS	(size)	1=22-9-5, 11=22-9-5, 12=22-9-5, 13=22-9-5, 15=22-9-5, 16=22-9-5, 17=22-9-5, 18=22-9-5, 19=22-9-5, 20=22-9-5, 21=22-9-5
	Max Horiz	1=218 (LC 11)
	Max Uplift	1=44 (LC 10), 12=96 (LC 15), 13=69 (LC 15), 15=82 (LC 15), 16=71 (LC 15), 18=74 (LC 14), 19=81 (LC 14), 20=67 (LC 14), 21=103 (LC 14)
	Max Grav	1=147 (LC 25), 11=108 (LC 27), 12=281 (LC 25), 13=133 (LC 25), 15=214 (LC 21), 16=270 (LC 21), 17=234 (LC 27), 18=270 (LC 20), 19=214 (LC 20), 20=130 (LC 24), 21=290 (LC 24)

FORCES	
	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-225/201, 2-3=-137/147, 3-4=-94/129, 4-5=-75/144, 5-6=-95/190, 6-7=-95/190, 7-8=-52/116, 8-9=-31/76, 9-10=-80/85, 10-11=-177/142
BOT CHORD	1-21=-102/177, 20-21=-102/177, 19-20=-102/177, 18-19=-102/177, 17-18=-102/177, 16-17=-102/177, 15-16=-102/177, 13-15=-102/177, 12-13=-102/177, 11-12=-102/177

WEBS	
6-17=-193/34, 5-18=-231/98, 4-19=-168/105, 3-20=-129/93, 2-21=-214/133, 7-16=-231/95, 8-15=-168/106, 9-13=-129/94, 10-12=-213/135	

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) 0-0-5 to 3-0-5, Exterior(2N) 3-0-5 to 8-4-15, Corner(3R) 8-4-15 to 14-4-15, Exterior(2N) 14-4-15 to 19-4-15, Corner(3E) 19-4-15 to 22-5-1 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 44 lb uplift at joint 1, 74 lb uplift at joint 18, 81 lb uplift at joint 19, 67 lb uplift at joint 20, 103 lb uplift at joint 21, 71 lb uplift at joint 16, 82 lb uplift at joint 15, 69 lb uplift at joint 13 and 96 lb uplift at joint 12.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:42 Page: 1
ID:dSe ?JVksdORLhCGs9s8GvzuPan-RfC?PsB70Hg3NSaPanL8w3uITXbGKWRCd0i7J4zJC?f



LUMBER		Wind=ASCE 7-16; Vult=130mph (3-second gust)
TOP CHORD	2x4 SP No.2	Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat.
BOT CHORD	2x4 SP No.2	II; Exp B; Enclosed; MWFRS (envelope) exterior zone
OTHERS	2x4 SP No.3	and C-C Exterior(2E) 0-0-5 to 3-0-5, Interior (1) 3-0-5 to 6-10-6, Exterior(2R) 6-10-6 to 12-10-6, Interior (1) 12-10-6 to 16-8-6, Exterior(2E) 16-8-6 to 19-8-6 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.	
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
REACTIONS		
(size)	1=19-8-2, 7=19-8-2, 8=19-8-2, 10=19-8-2, 11=19-8-2, 12=19-8-2, 13=19-8-2	3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
Max Horiz	1=188 (LC 11)	4) TCELL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
Max Uplift	1=99 (LC 10), 8=67 (LC 15), 10=191 (LC 15), 12=174 (LC 14), 13=105 (LC 14)	5) Unbalanced snow loads have been considered for this design.
Max Grav	1=129 (LC 13), 7=0 (LC 13), 8=316 (LC 25), 10=474 (LC 6), 11=498 (LC 27), 12=480 (LC 5), 13=318 (LC 24)	6) All plates are 2x4 MT20 unless otherwise indicated.
FORCES		7) Gable requires continuous bottom chord bearing.
(lb) - Maximum Compression/Maximum Tension		8) Gable studs spaced at 4-0-0 oc.
TOP CHORD	1-2=-215/220, 2-3=-198/200, 3-4=-186/281, 4-5=-186/255, 5-6=-104/88, 6-7=-58/60	9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
BOT CHORD	1-13=-45/60, 12-13=-25/51, 11-12=-25/51, 10-11=-25/51, 8-10=-25/51, 7-8=-25/51	10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
WEBS	4-11=-290/52, 3-12=-379/222, 2-13=-254/166, 5-10=-376/229, 6-8=-251/151	11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 99 lb uplift at joint 1, 174 lb uplift at joint 12, 105 lb uplift at joint 13, 191 lb uplift at joint 10 and 67 lb uplift at joint 8.
NOTES		
1) Unbalanced roof live loads have been considered for this design.		
LOAD CASE(S)		Standard



April 29, 2025


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039241
25040186	V03	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:43

Page: 1

ID:ITeoCYiu?YKcBf7FWN7peHzuPdx-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

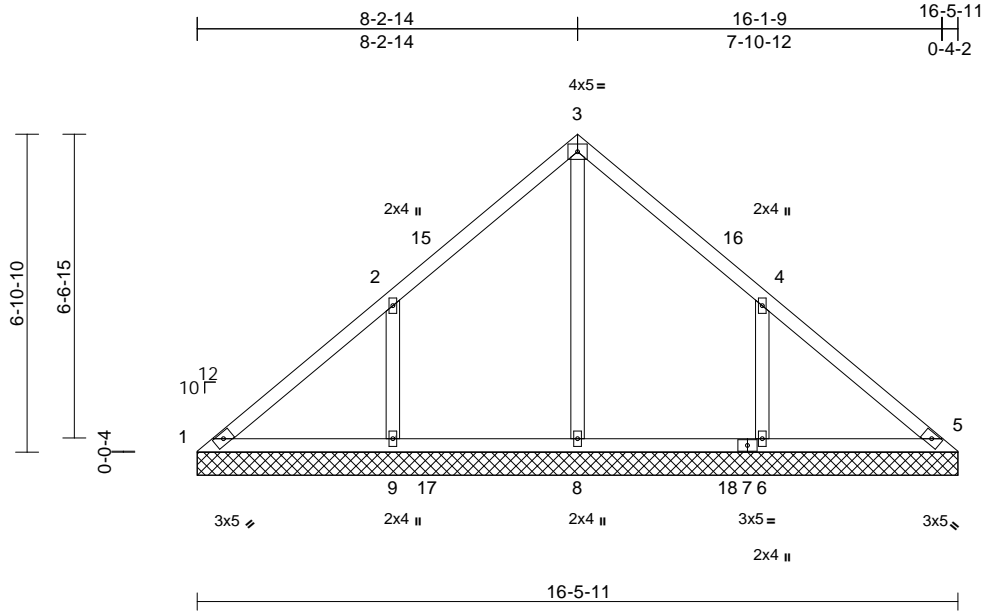

Scale = 1:49.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.37	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.17	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.38	Horiz(TL)	0.00	5	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0									Weight: 73 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size)	1=16-5-11, 5=16-5-11, 6=16-5-11, 8=16-5-11, 9=16-5-11
Max Horiz	1=157 (LC 11)
Max Uplift	1=-59 (LC 10), 6=-178 (LC 15), 9=-184 (LC 14)
Max Grav	1=80 (LC 13), 5=0 (LC 25), 6=498 (LC 6), 8=644 (LC 24), 9=498 (LC 5)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-105/356, 2-3=-32/309, 3-4=-6/288, 4-5=-125/286
BOT CHORD	1-9=-186/73, 8-9=-186/70, 6-8=-186/70, 5-6=-186/70
WEBS	3-8=-457/0, 2-9=-388/216, 4-6=-388/214

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Interior (1) 3-0-5 to 5-3-2, Exterior(2R) 5-3-2 to 11-3-2, Interior (1) 11-3-2 to 13-6-0, Exterior(2E) 13-6-0 to 16-6-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 59 lb uplift at joint 1, 184 lb uplift at joint 9 and 178 lb uplift at joint 6.

LOAD CASE(S) Standard

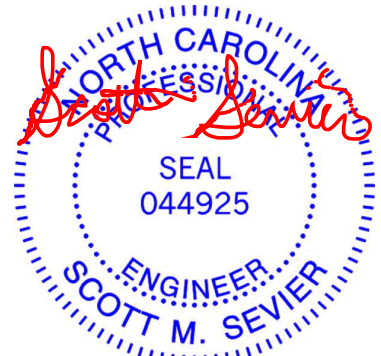

April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof	173039242
25040186	V04	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:43

Page: 1

ID:ITeoCYiu?YKcBf7FWN7peHzuPdx-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

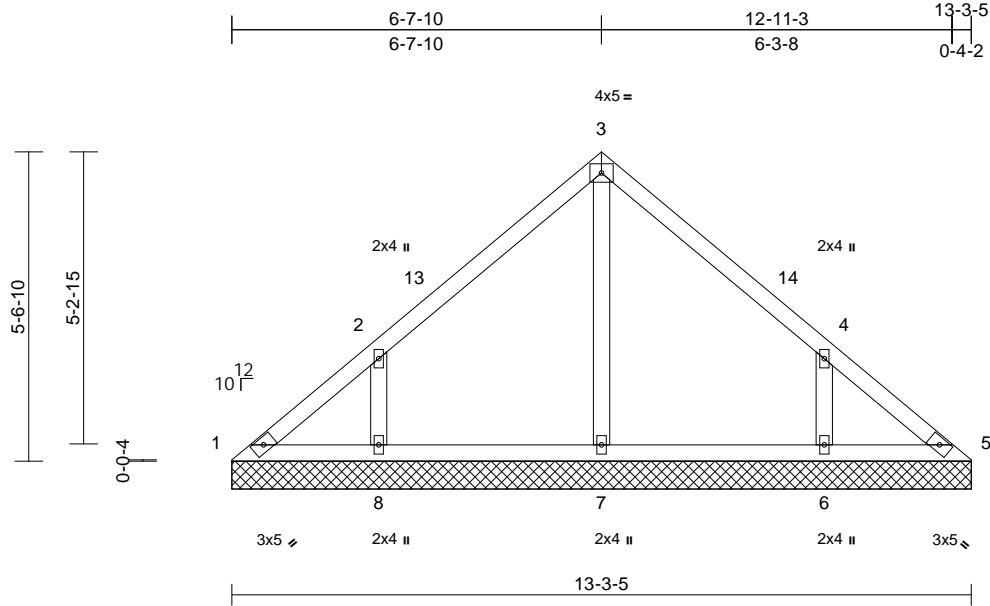

Scale = 1:41.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.32	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	5	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0									Weight: 56 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	1=13-3-5, 5=13-3-5, 6=13-3-5, 7=13-3-5, 8=13-3-5
Max Horiz	1=-126 (LC 10)
Max Uplift	1=-27 (LC 10), 6=-144 (LC 15), 8=-147 (LC 14)
Max Grav	1=110 (LC 30), 5=87 (LC 24), 6=439 (LC 21), 7=279 (LC 21), 8=439 (LC 20)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-138/113, 2-3=-199/115, 3-4=-199/115, 4-5=-109/72
BOT CHORD	1-8=-44/105, 7-8=-44/85, 6-7=-44/85, 5-6=-44/85
WEBS	3-7=-195/0, 2-8=-377/195, 4-6=-377/195

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Interior (1) 3-0-5 to 3-7-15, Exterior(2R) 3-7-15 to 9-7-15, Interior (1) 9-7-15 to 10-3-10, Exterior(2E) 10-3-10 to 13-3-10 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 1, 147 lb uplift at joint 8 and 144 lb uplift at joint 6.

LOAD CASE(S) Standard

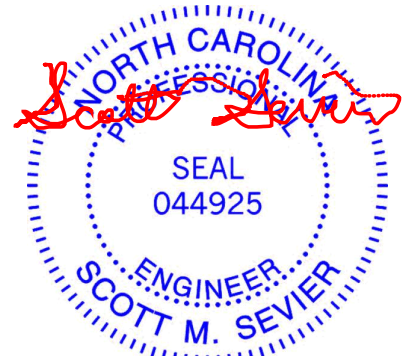

April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	V05	Valley	1	1	Job Reference (optional)
					I73039243

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:43

Page: 1

ID:ITeoCYiu?YKcBf7FWN7peHzuPdx-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

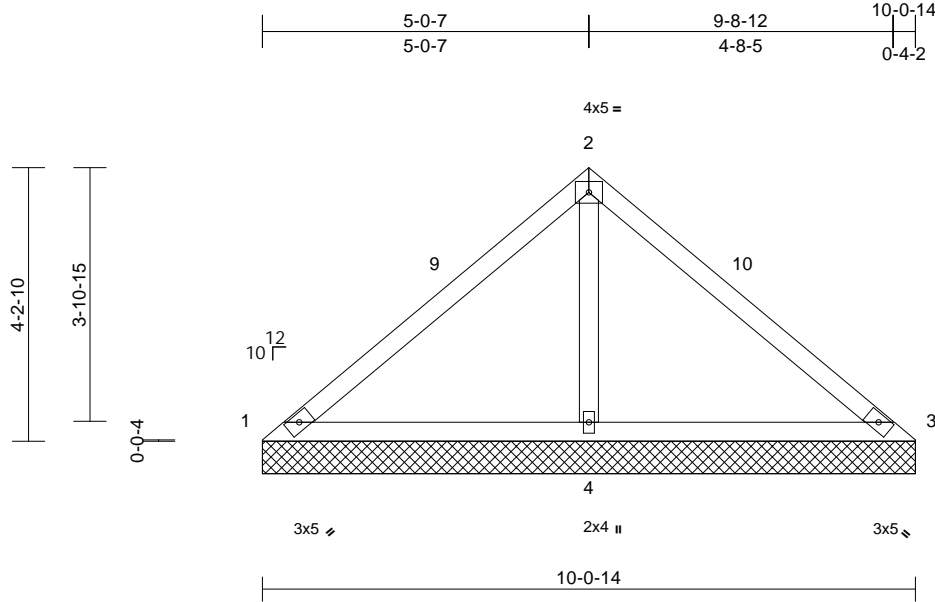

Scale = 1:35.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.50	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.47	Vert(TL)	n/a	-	n/a	999	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.21	Horiz(TL)	0.01	4	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
Weight: 38 lb FT = 20%											

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 10'-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6'-0-0 oc bracing.

REACTIONS

(size)	1=10-0-14, 3=10-0-14, 4=10-0-14
Max Horiz	1=-95 (LC 10)
Max Uplift	1=-60 (LC 20), 3=-60 (LC 20), 4=-119 (LC 14)
Max Grav	1=92 (LC 20), 3=92 (LC 21), 4=828 (LC 20)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-125/406, 2-3=-125/406
BOT CHORD	1-4=-265/182, 3-4=-265/182
WEBS	2-4=-685/286

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Exterior(2R) 3-0-5 to 7-1-3, Exterior(2E) 7-1-3 to 10-1-3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4'-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06-00 tall by 2'-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 1, 60 lb uplift at joint 3 and 119 lb uplift at joint 4.

LOAD CASE(S) Standard



April 29,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	17 Eagle Creek - Hartwell C - Roof
25040186	V06	Valley	1	1	Job Reference (optional)
					I73039244

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Feb 19 2025 Print: 8.730 S Feb 19 2025 MiTek Industries, Inc. Fri Apr 25 13:32:43

Page: 1

ID:mfCAQuiWmrSToiR44e2AVzuPdw-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?f

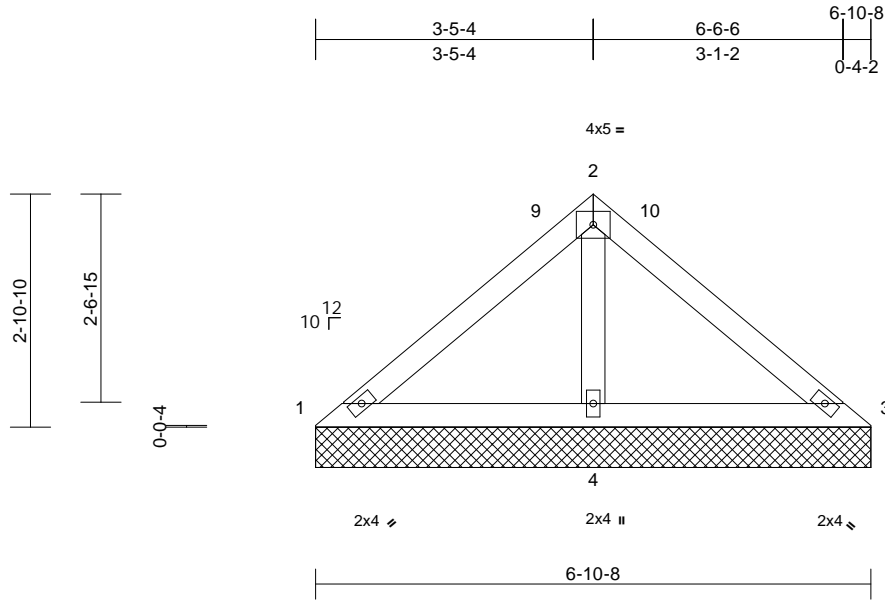

Scale = 1:28.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.24	Vert(TL)	n/a	-	n/a	999	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	4	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0										
Weight: 25 lb FT = 20%											

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-10-8 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size)	1=6-10-8, 3=6-10-8, 4=6-10-8
Max Horiz	1=-63 (LC 10)
Max Uplift	1=-10 (LC 21), 3=-10 (LC 20), 4=-66 (LC 14)
Max Grav	1=104 (LC 20), 3=104 (LC 21), 4=492 (LC 21)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-86/207, 2-3=-86/207
BOT CHORD	1-4=-163/142, 3-4=-163/142
WEBS	2-4=-386/184

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Exterior(2R) 3-0-5 to 3-10-13, Exterior(2E) 3-10-13 to 6-10-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 10 lb uplift at joint 1, 10 lb uplift at joint 3 and 66 lb uplift at joint 4.

LOAD CASE(S) Standard



April 29, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

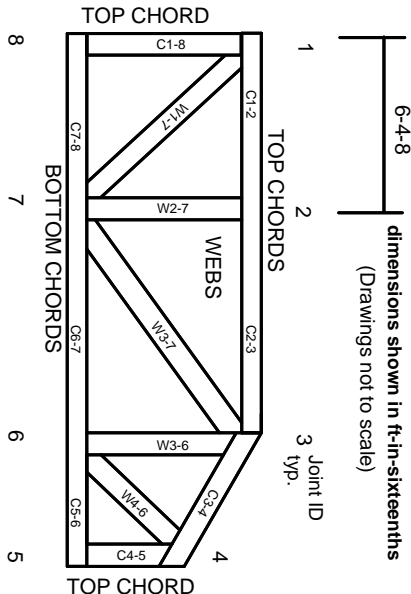

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek®

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023