


Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A 2ND FLR
72500979	F200	Truss	4	1	Job Reference (optional) 19 CBR

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:14

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-licWhfzAwHzpDHJAviOMQBMBs8uGs\_cASL?vHBzvo1x

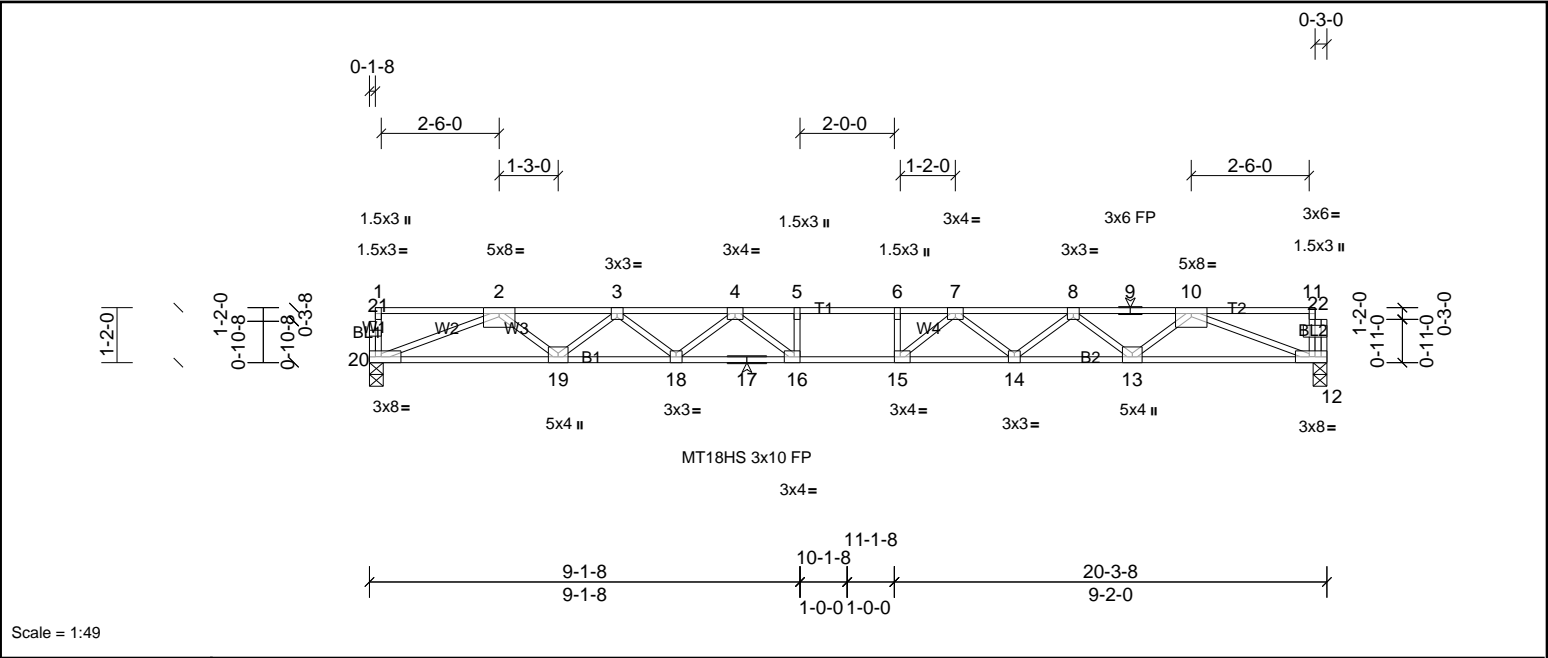

Scale = 1:49


Plate Offsets (X, Y): [12:0-3-8,Edge], [15:0-1-8,Edge], [16:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.46	15-16	>527	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.63	15-16	>383	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.10	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 100 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	12=1086/0-3-8, (min. 0-1-8), 20=1093/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3267/0, 3-4=-4529/0, 4-5=-5213/0, 5-6=-5213/0, 6-7=-5213/0, 7-8=-4551/0, 8-9=-3307/0, 9-10=-3307/0	
BOT CHORD	19-20=0/2442, 18-19=0/4050, 17-18=0/4980, 16-17=0/4980, 15-16=0/5213, 14-15=0/4996, 13-14=0/4081, 12-13=0/2489	
WEBS	5-16=-309/11, 6-15=-319/20, 2-20=-2620/0, 2-19=0/1074, 3-19=-1019/0, 3-18=0/624, 4-18=-588/0, 4-16=-151/704, 10-12=-2656/0, 10-13=0/1064, 8-13=-1008/0, 8-14=0/612, 7-14=-579/0, 7-15=-161/695	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

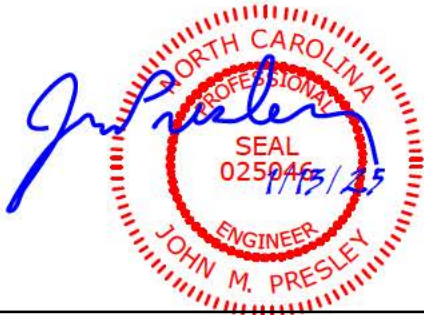



Job 72500979	Truss F202	Truss Type Truss	Qty 3	Ply 1	MUNGO HOMES - MCDOWELL A 2ND FLR Job Reference (optional)
-----------------	---------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:14

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-licWhfzAwHzpDHJAviOMQBMXU8uDs\_QASL?vHBzvo1x

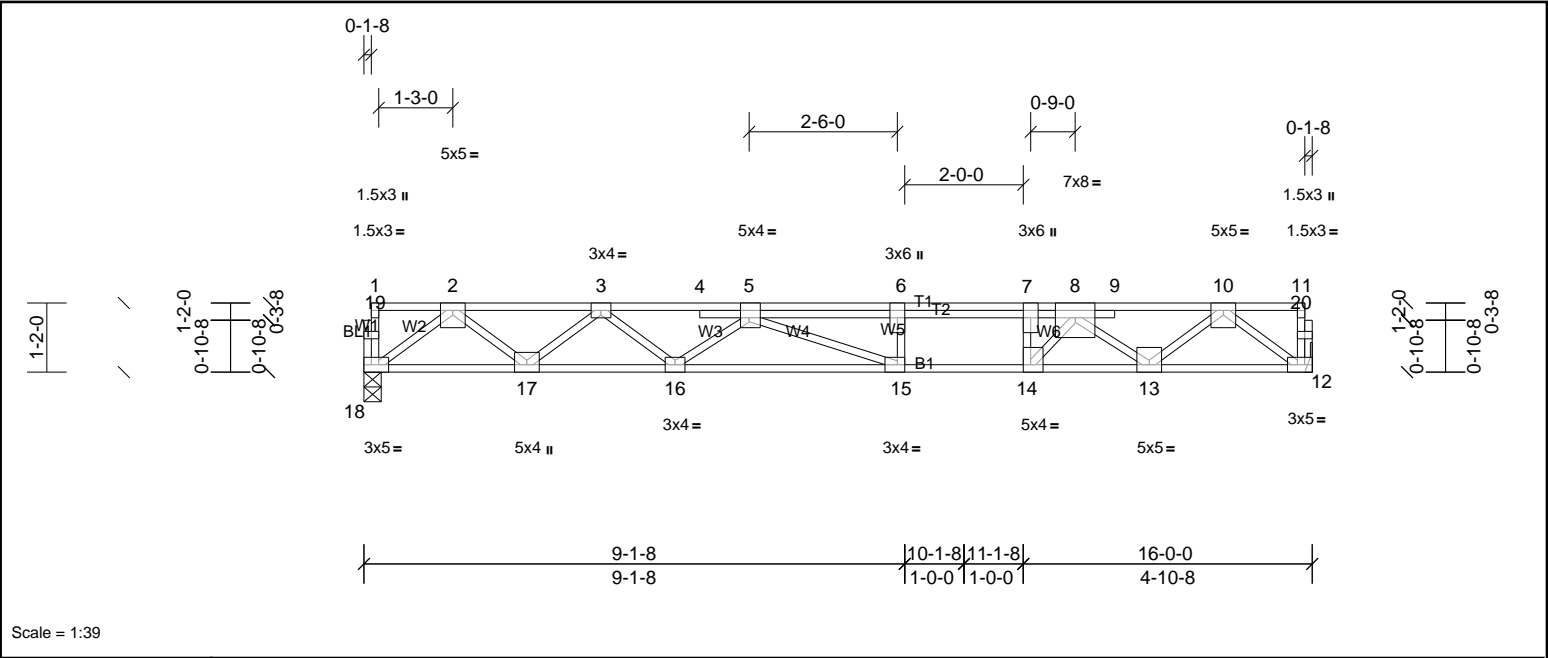


Plate Offsets (X, Y): [5:0-1-12,Edge], [7:0-3-0,Edge], [12:0-2-0,Edge], [14:0-1-8,Edge], [15:0-1-8,Edge], [18:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.97	Vert(LL)	-0.22	15-16	>844	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.66	Vert(CT)	-0.39	15-16	>488	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.74	Horz(CT)	0.06	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 89 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-9-4 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		


REACTIONS	(lb/size)	12=1000/ Mechanical, (min. 0-1-8), 18=973/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2055/0, 3-4=-3470/0, 4-5=-3477/0, 5-6=-3974/0, 6-7=-3974/0, 7-8=-3974/0, 8-9=-2140/0, 9-10=-2136/0	
BOT CHORD	17-18=0/1227, 16-17=0/2864, 15-16=0/4043, 14-15=0/3974, 13-14=0/3110, 12-13=0/1241	
WEBS	7-14=-1071/0, 2-18=-1537/0, 2-17=0/1078, 3-17=-1053/0, 3-16=0/789, 5-16=-728/0, 5-15=-296/415, 10-12=-1553/0, 10-13=0/1166, 8-13=-1237/0, 8-14=0/1550	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S)	Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00	
Uniform Loads (lb/ft)	
Vert: 12-18=-10, 1-4=-100, 4-8=-140, 8-11=-100	



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:15 Page: 1  
ID:q6xmDaGgGr4T8wcGw4bQWzKH9V-licWhfzAwHzpDHJAviOMQBMBt8uls\_vASL?vHBz01x



<b>LUMBER</b>		<b>BRACING</b>	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-0-15 oc purlins, except end verticals. Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD	2x4 SP SS(flat)		
WEBS	2x4 SP No.3(flat)	BOT CHORD	
OTHERS	2x4 SP No.3(flat)		

**NOTES**

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A 2ND FLR
72500979	F204	Truss	4	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:15

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-mvAuv?zohb5ggRuNTPvbzOvmcXEVbRsKh?kSqdzvo1w

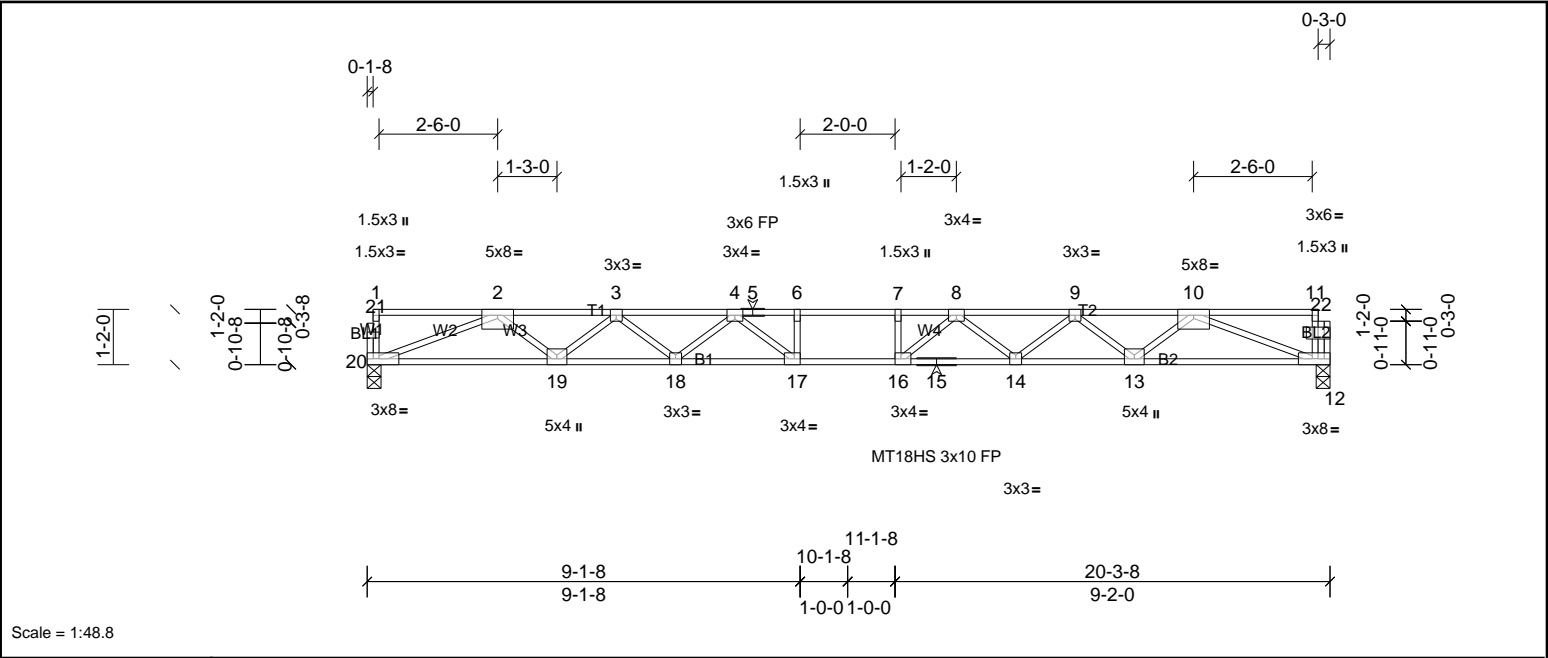


Plate Offsets (X, Y): [12:0-3-8,Edge], [16:0-1-8,Edge], [17:0-1-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.76	Vert(LL)	-0.46	16-17	>527	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.65	Vert(CT)	-0.63	16-17	>383	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.10	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 100 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-11-5 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	12=1086/0-3-8, (min. 0-1-8), 20=1093/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD		2-3=-3267/0, 3-4=-4529/0, 4-5=-5213/0, 5-6=-5213/0, 6-7=-5213/0, 7-8=-5213/0, 8-9=-4551/0, 9-10=-3307/0
BOT CHORD		19-20=0/2442, 18-19=0/4050, 17-18=0/4980, 16-17=0/5213, 15-16=0/4996, 14-15=0/4996, 13-14=0/4081, 12-13=0/2489
WEBS		6-17=-309/11, 7-16=-319/20, 2-20=-2620/0, 2-19=0/1074, 3-19=-1019/0, 3-18=0/624, 4-18=-588/0, 4-17=-151/704, 10-12=-2656/0, 10-13=0/1064, 9-13=-1008/0, 9-14=0/612, 8-14=-579/0, 8-16=-161/695

- NOTES
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A 2ND FLR
72500979	F205	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:15

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-mvAuv?zohb5ggRuNTPvbzOvwgXN8bcGKh?kSqdzvo1w

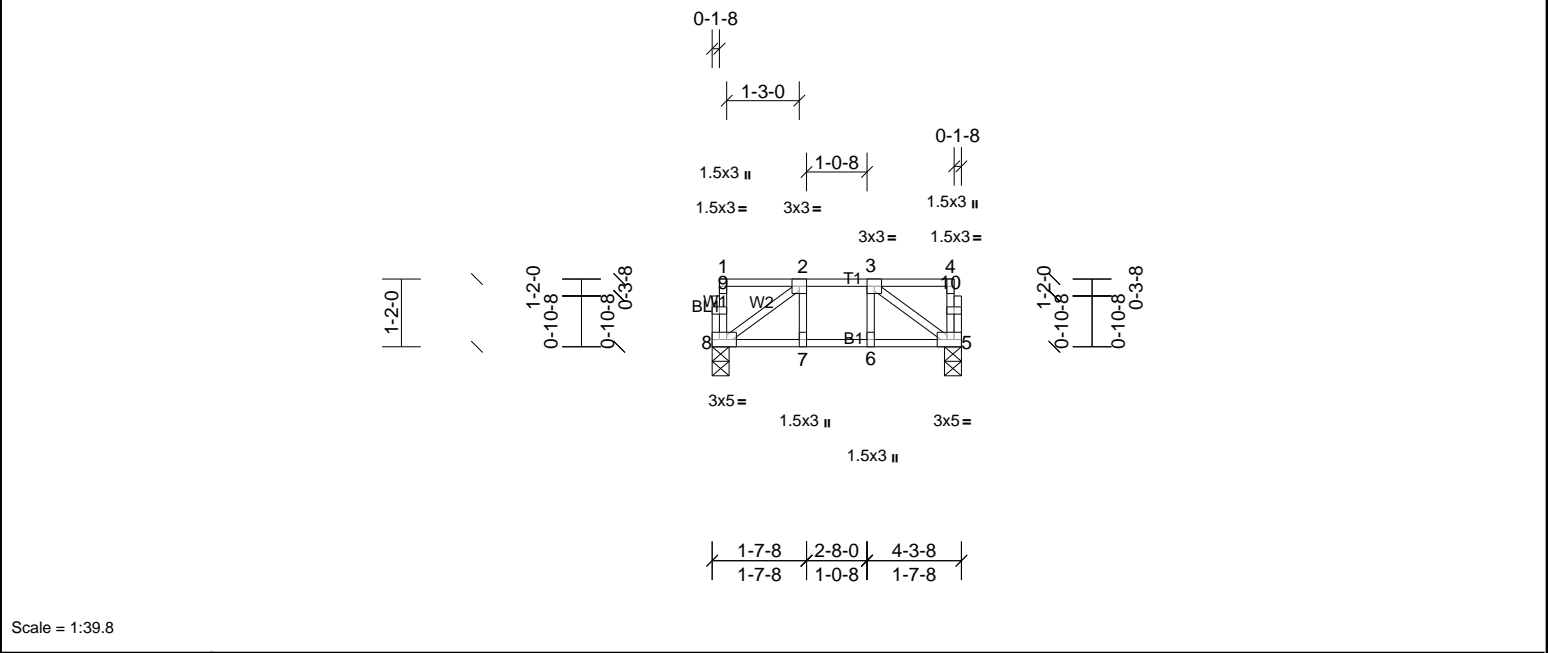


Plate Offsets (X, Y): [5:0-2-0,Edge], [8:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.11	Vert(LL)	0.00	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.10	Vert(CT)	-0.01	7-8	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.00	5	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 25 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-3-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

**REACTIONS** (lb/size) 5=216/0-3-8, (min. 0-1-8), 8=216/0-3-8, (min. 0-1-8)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**WEBS** 3-5=-258/0, 2-8=-258/0

**NOTES**

- Unbalanced floor live loads have been considered for this design.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.





Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A 2ND FLR
72500979	F206	Truss	15	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:15

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-mvAuv?zohb5gqRuNTPvzbOvIBXEnbQ?Kh?kSqdzvo1w

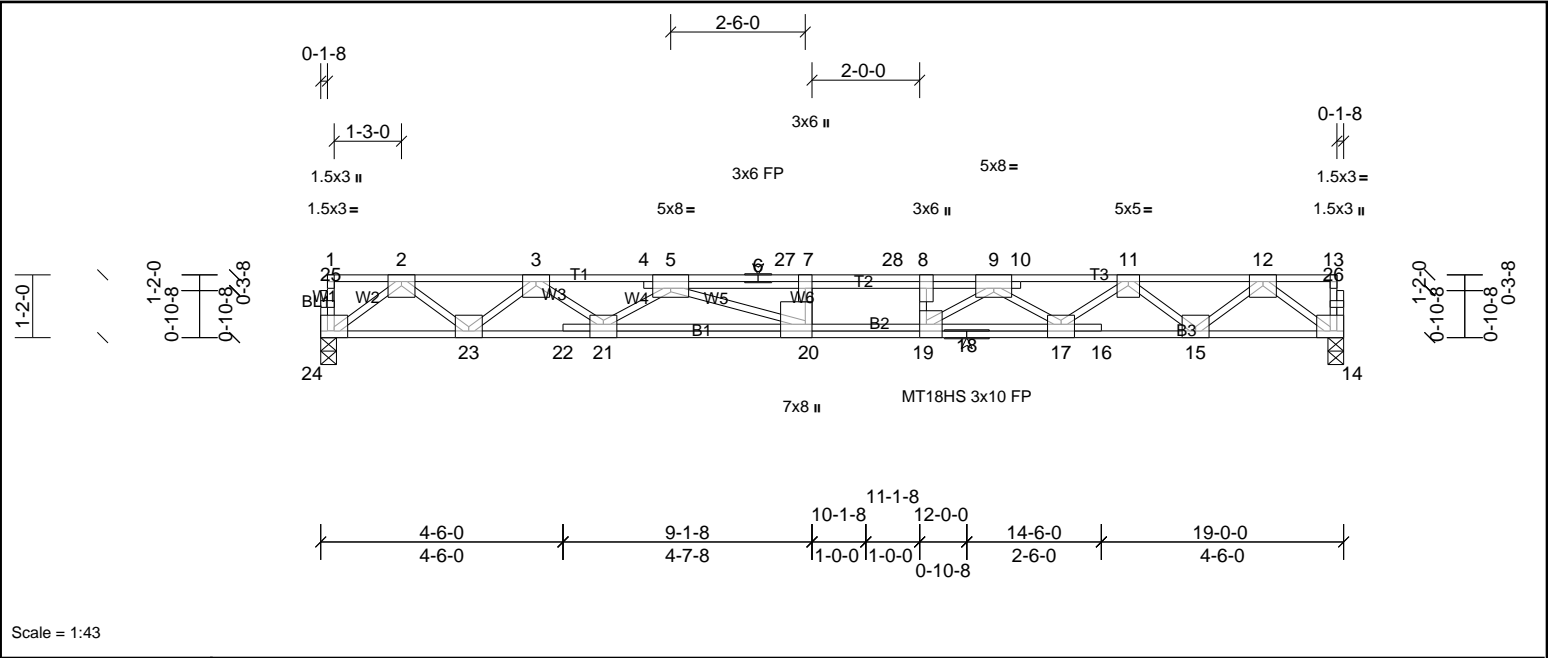


Plate Offsets (X, Y): [5:0-4-0,Edge], [8:0-3-0,Edge], [9:0-4-0,Edge], [14:Edge,0-1-8], [17:0-3-0,Edge], [19:0-3-0,Edge], [20:0-3-0,Edge], [21:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.79	Vert(LL)	-0.26	20-21	>865	480	MT18HS	244/190
TCDL	30.0	Lumber DOL	1.00	BC	0.70	Vert(CT)	-0.51	20-21	>440	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.78	Horz(CT)	0.08	14	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 117 lb	FT = 20%F, 12%E

LUMBER		BRACING	
TOP CHORD	2x4 SP SS(flat)	TOP CHORD	Structural wood sheathing directly applied or 5-0-13 oc purlins, except end verticals.
BOT CHORD	2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		


REACTIONS	(lb/size)	14=1434/0-3-8, (min. 0-1-8), 24=1433/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3048/0, 3-4=-5393/0, 4-5=-5382/0, 5-6=-7407/0, 6-27=-7407/0, 7-27=-7407/0, 7-28=-7407/0, 8-28=-7407/0, 8-9=-7407/0, 9-10=-5314/0, 10-11=-5329/0, 11-12=-3065/0	
BOT CHORD	23-24=0/1803, 22-23=0/4349, 21-22=0/4340, 20-21=0/6405, 19-20=0/7407, 18-19=0/6408, 17-18=0/6408, 16-17=0/4341, 15-16=0/4351, 14-15=0/1804	
WEBS	7-20=-382/0, 8-19=-606/0, 2-24=-2259/0, 2-23=0/1620, 3-23=-1694/0, 3-21=0/1326, 5-21=-1255/0, 5-20=0/1372, 12-14=-2260/0, 12-15=0/1641, 11-15=-1675/0, 11-17=0/1242, 9-17=-1338/0, 9-19=0/1465	

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 5x6 MT20 unless otherwise indicated.
  - 4) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 5) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S)	Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00	
Uniform Loads (lb/ft)	
Vert: 14-24=-10, 1-27=-140, 27-28=-176, 13-28=-140	



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:15 Page: 1  
ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-mvAuv?zohb5ggRuNTPvbzOvkuXEBbSzKh?kSgdzotw

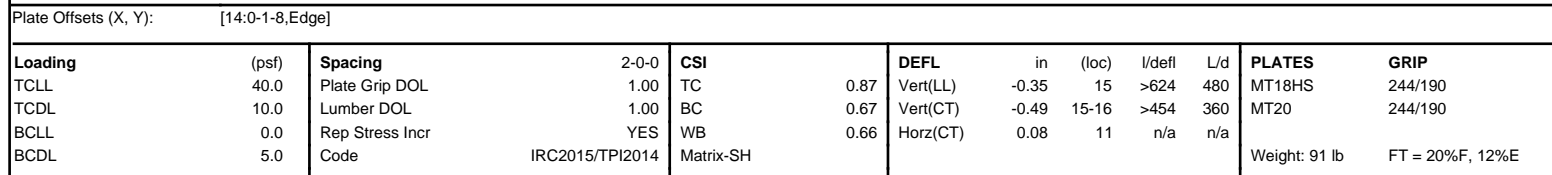

**NOTES**


- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

\_\_\_\_\_

\_\_\_\_\_ NORTH CAROLINA \_\_\_\_\_

PROFESSIONAL

Chapters



025046 1/5/25

Country	Percentage of population aged 65 and over in 2000
Australia	14.5%
Canada	13.5%
France	13.5%
Germany	13.5%
Italy	13.5%
Japan	13.5%
Korea	13.5%
Sweden	13.5%
Switzerland	13.5%
Taiwan	13.5%
United Kingdom	13.5%
United States	13.5%

\_\_\_\_\_



\_\_\_\_\_

M. PRES

---

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing

is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is

fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI)

for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.


A red circular professional engineer seal for John M. Presley, North Carolina. The seal contains the text "NORTH CAROLINA", "PROFESSIONAL", "SEAL", "025046", "11/15/25", "ENGINEER", and "JOHN M. PRESLEY". A blue ink signature, "John M. Presley", is written across the seal.







UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:16 Page: 1  
ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-mvAuv?zohb5ggRuNTPvbzOvI7XDPbRnKh?kSgczw1w

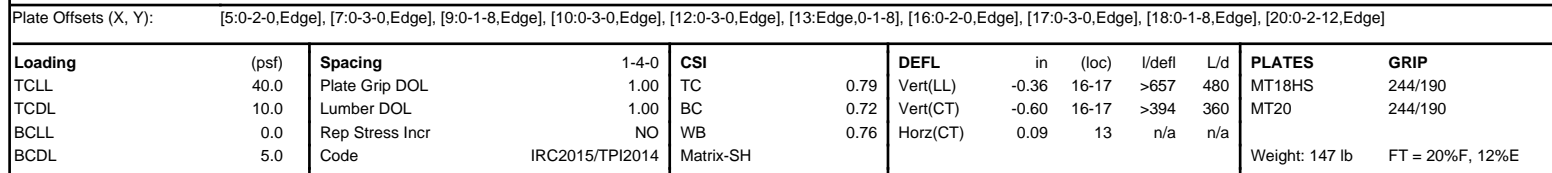

<b>REACTIONS</b>	(lb/size)	13=2068/ Mechanical, (min. 0-1-8), 23=1154/0-3-8, (min. 0-1-8)
<b>FORCES</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2623/0, 3-4=-4931/0, 4-5=-4930/0, 5-6=-8106/0, 6-7=-8106/0, 8-9=-8106/0, 9-10=-8255/0, 10-11=-5440/0	
BOT CHORD	22-23=0/1475, 21-22=0/3810, 20-21=0/3804, 19-20=0/6294, 18-19=0/6294, 17-18=0/8106, 16-17=0/8430, 15-16=0/7907, 14-15=0/2880, 13-14=0/2885	
WEBS	6-18=-528/0, 10-16=0/490, 9-16=-425/5, 9-17=-819/627, 10-15=-3121/0, 2-23=-1849/0, 2-22=0/1494, 3-22=-1544/0, 3-20=0/1425, 5-20=-1619/0, 5-18=0/2211, 11-15=0/3183, 11-13=-3524/0	

- NOTES**

  - 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 4) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent at 16-1-12 from the left end to connect truss(es) to back face of top chord, skewed 0.0 deg.to the right, sloping 0.0 deg. down.
  - 7) Fill all nail holes where hanger is in contact with lumber.
  - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)		Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00 Uniform Loads (lb/ft) Vert: 13-23=-7, 1-4=-67, 4-8=-107, 8-12=-67 Concentrated Loads (lb) Vert: 10=-1530 (B)	
2)	Dead: Lumber Increase=1.00, Plate Increase=1.00 Uniform Loads (lb/ft) Vert: 13-23=-7, 1-4=-67, 4-8=-107, 8-12=-67 Concentrated Loads (lb) Vert: 10=-1530 (B)	
3)	1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00 Uniform Loads (lb/ft) Vert: 13-23=-7, 1-4=-67, 4-7=-107, 7-8=-54, 8-12=-13 Concentrated Loads (lb) Vert: 10=-584 (B)	
4)	2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00 Uniform Loads (lb/ft)	

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A 2ND FLR
72500979	FG2	Truss	1	1	Job Reference (optional)

- Vert: 13-23=-7, 1-4=-13, 4-6=-54, 6-8=-107, 8-12=-67
- Concentrated Loads (lb)
- Vert: 10=-1584 (B)
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (lb/ft)
- Vert: 13-23=-7, 1-4=-67, 4-7=-107, 7-8=-54, 8-12=-13
- Concentrated Loads (lb)
- Vert: 10=-584 (B)
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
- Uniform Loads (lb/ft)
- Vert: 13-23=-7, 1-4=-13, 4-6=-54, 6-8=-107, 8-12=-67
- Concentrated Loads (lb)
- Vert: 10=-1584 (B)



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - MCDOWELL A 2ND FLR
72500979	FG3	Truss	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:16

Page: 1

ID:q6xmDaGgGpr4T8wcGw4bQWzKH9V-E5jH6L\_QSvDXSbTZ06QqWcRwaxWHKyZTfU?M3zvo1v

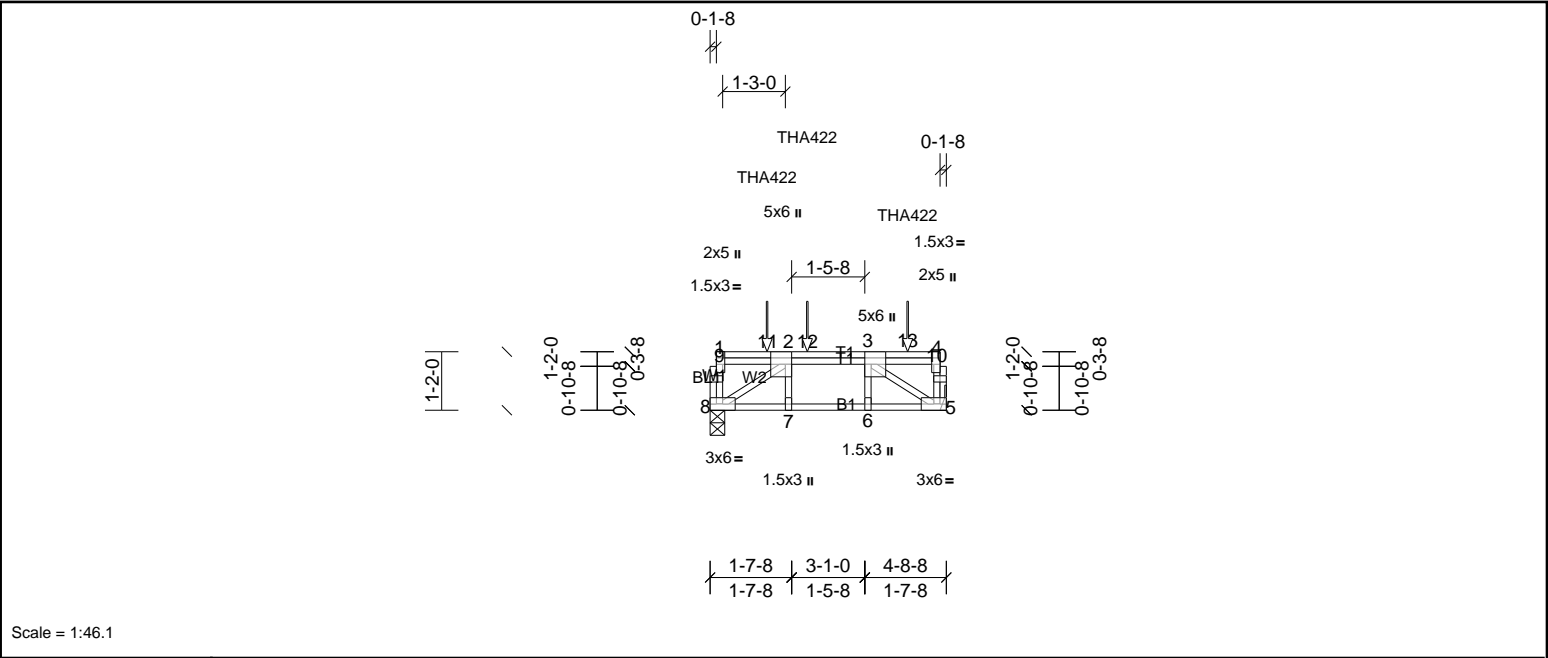

Scale = 1:46.1

Plate Offsets (X, Y): [2:0-3-0,Edge], [3:0-3-0,Edge], [4:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.81	Vert(LL)	-0.04	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.94	Vert(CT)	-0.05	7-8	>999	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.51	Horz(CT)	0.01	5	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 32 lb	FT = 20%F, 12%E


LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 4-8-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	5=1597/ Mechanical, (min. 0-1-8), 8=1605/0-3-8, (min. 0-1-8)
	Max Grav	5=1597 (LC 1), 8=1612 (LC 3)


FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	8-9=-446/0, 1-9=-445/0, 5-10=-502/28, 4-10=-501/28, 2-12=-1804/0, 3-12=-1804/0
BOT CHORD	7-8=0/1804, 6-7=0/1804, 5-6=0/1804
WEBS	3-5=-2153/0, 2-8=-2156/0

- NOTES**
- Unbalanced floor live loads have been considered for this design.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-1-10 from the left end to 3-11-4 to connect truss(es) to front face of top chord.
  - Fill all nail holes where hanger is in contact with lumber.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1)	Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
	Uniform Loads (lb/ft)
	Vert: 5-8=-10, 1-4=-100
	Concentrated Loads (lb)
	Vert: 11=-903 (F), 12=-900 (F), 13=-921 (F)

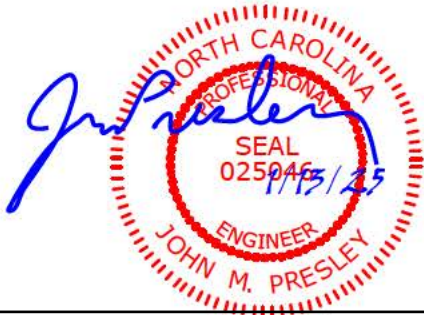


UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:16 Page: 1  
ID:g6xmDaGgGpr4T8wcGw4bQWzKH9V-E5jH6L\_QSvDXSbTZ06QgWcR51xkoK3\_TwfU?M3zvo1v

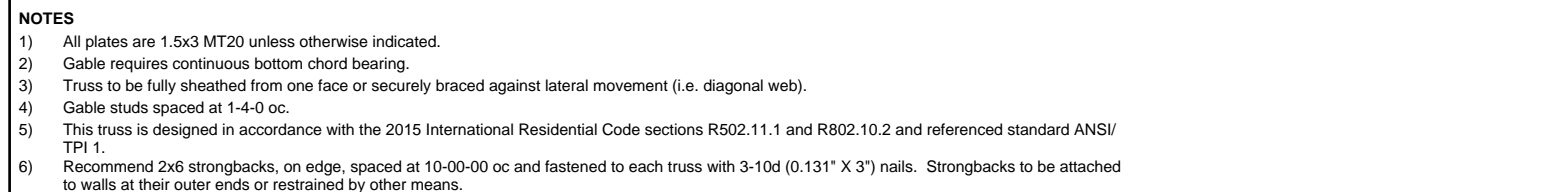

This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.81 S Sep 13 2024 Print: 8.810 S Sep 13 2024 MiTek Industries, Inc. Mon Jan 13 11:51:16 Page: 1  
ID:g6xmDaGgGpr4T8wcGw4bQWzKH9V-E5jH6L\_QSvDXSbTZ06QvWcR5txkcK3yTwfU?M3z01v



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

**REACTIONS** All bearings 19-0-0.

(lb) - Max Grav All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

## NOTES

- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
- 2) Gable requires continuous bottom chord bearing.
- 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

