

SOUTHEASTERN SOIL & ENVIRONMENTAL ASSOC., INC.

PROPOSED SUBSURFACE WASTE DISPOSAL SYSTEM DETAIL SHEET

SUBDIVISION: BRAYDEN PRESERVE

GRAV
INITIAL SYSTEM: Approved 25% Reduction

DISTRIBUTION: SERIAL

BENCHMARK: 100.0

NO. BEDROOMS: 4

SEPTIC TANK SIZE 1000

LOT 5A

GRAV
REPAIR: Approved 25% Reduction

DISTRIBUTION SERIAL

LOCATION BC TOS 55/56

LTAR I/0.3 gpd/ft² R/0.4 gpd/ft²

PUMP TANK SIZE

LINE	FLAG COLOR	ELEVATION	LENGTH
1	G	96.75	90
2	L	96.17	90
3	G	95.59	90
4	L	95.00	80
5A	G	94.59	50
			400
5b	G	94.59	35
6	L	94.41	90
7	G	93.50	95
8	L	93.08	100
			320

BY B.C. RAYNOR

TYPICAL PROFILE

0-12 LS VFR GR

12-36 SCLAY F. SBK

Pm 30' m.L Top Line back

DATE 01/25/2024

THERE SHALL BE NO GRADING,

CUTTING, LOGGING OR OTHER SOIL


DISTURBANCE IN SEPTIC AREA

HEALTH DEPARTMENT USE ONLY.

DESIGNS DO NOT GUARANTEE FUNCTIONALITY

Southeastern Soil & Environmental Associates, Inc.

P.O. Box 9321
Fayetteville, NC 28311
Phone/Fax (910) 822-4540
Email mike@southeasternsoil.com

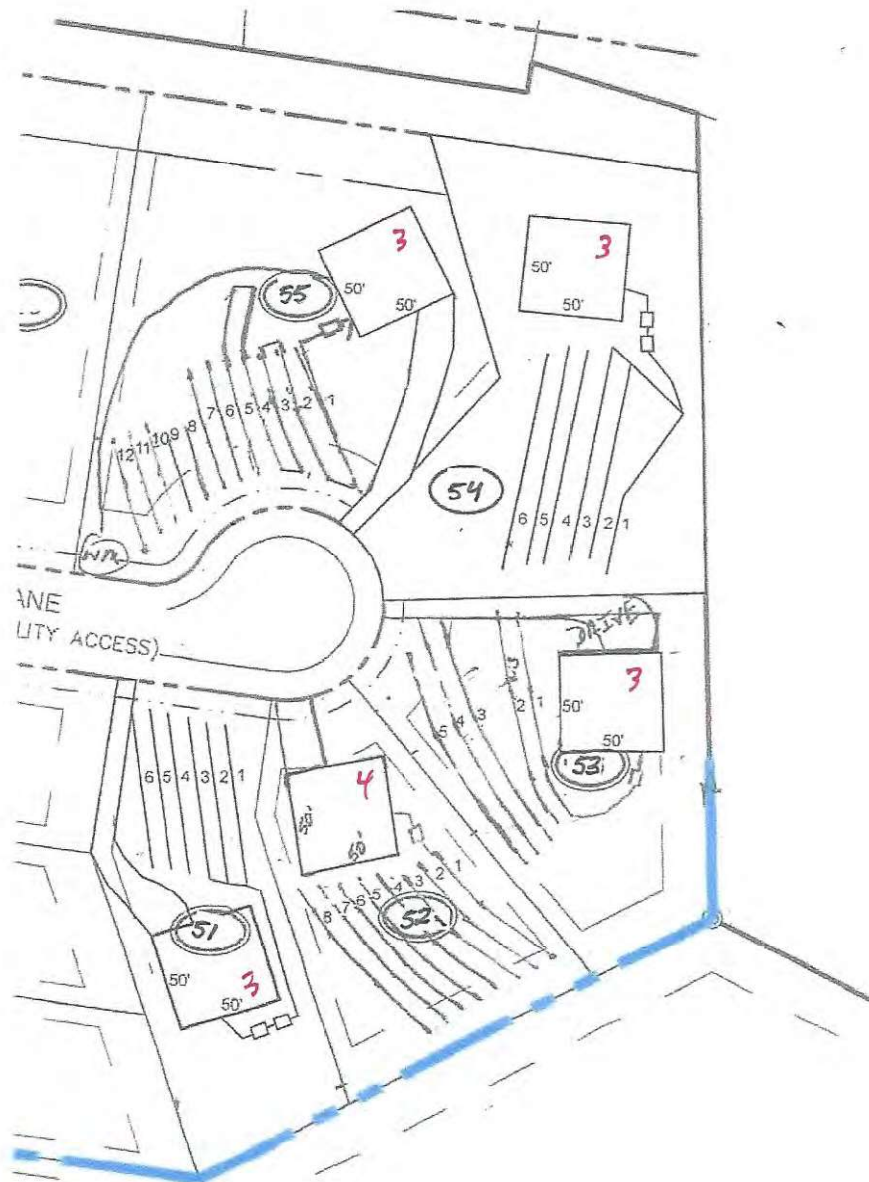

1" = 100'