

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: 250109-A
74 Ducks Landing

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I75459233 thru I75459247

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844



August 7, 2025

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459233
250109-A	A01GE	COMMON SUPPORTED GAB	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:43
ID:m8kUpdOI7jlt0kTnJZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

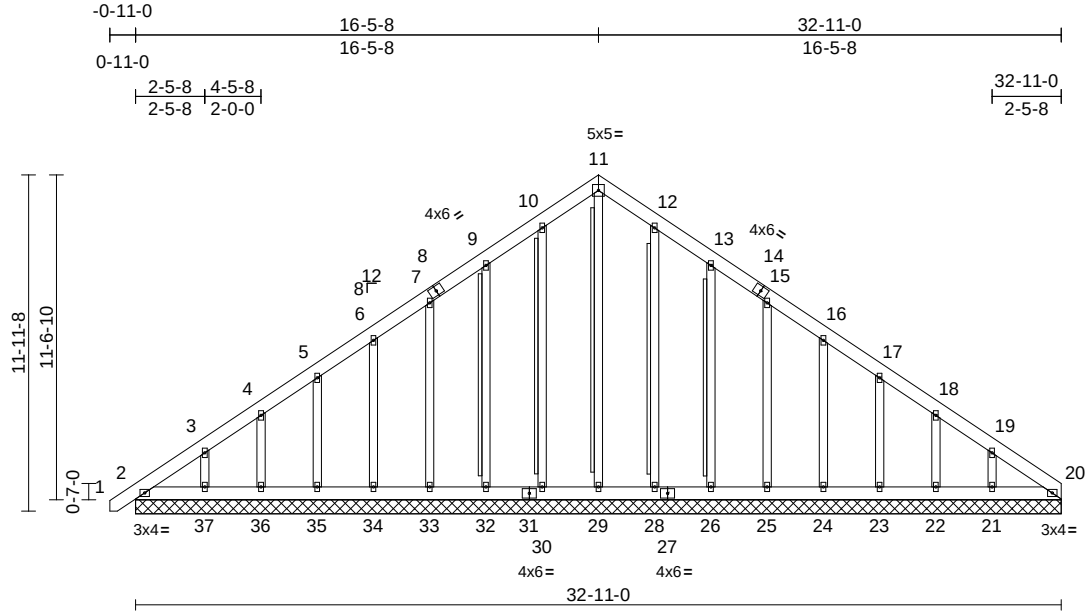

Scale = 1:81.9									
Plate Offsets (X, Y): [14:0-0-0,0-0-0]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	PLATES
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	GRIP
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horz(CT)	0.01	20	244/190
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S					Weight: 299 lb FT = 25%

LUMBER		Max Grav	2=208 (LC 20), 20=146 (LC 22), 21=232 (LC 20), 22=162 (LC 20), 23=179 (LC 20), 24=176 (LC 20), 25=177 (LC 20), 26=182 (LC 20), 28=169 (LC 20), 29=225 (LC 13), 30=182 (LC 19), 32=178 (LC 19), 33=176 (LC 19), 34=176 (LC 19), 35=179 (LC 19), 36=165 (LC 19), 37=221 (LC 19)	2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-9-7 to 3-7-6, Exterior(2N) 3-7-6 to 16-5-8, Corner(3R) 16-5-8 to 20-10-5, Exterior(2N) 20-10-5 to 32-11-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
TOP CHORD	2x6 SP No.1			3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
BOT CHORD	2x6 SP No.1			4) All plates are 2x4 () MT20 unless otherwise indicated.
OTHERS	2x4 SP No.2 *Except* 0-0,0-0,0-0,0-0,0-0,0-0:2x4 SPF No.2(flat)			5) Gable requires continuous bottom chord bearing.
BRACING		FORCES	(lb) - Maximum Compression/Maximum Tension	6) Gable studs spaced at 2-0-0 oc.
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.	TOP CHORD	1-2=0/23, 2-3=-350/256, 3-4=-256/216, 4-5=-214/191, 5-6=-185/169, 6-7=-164/169, 7-9=-144/212, 9-10=-160/261, 10-11=-183/285, 11-12=-183/285, 12-13=-160/239, 13-15=-114/161, 15-16=-77/94, 16-17=-93/58, 17-18=-112/80, 18-19=-180/104, 19-20=-277/147	7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	BOT CHORD	2-37=-120/258, 36-37=-120/258, 35-36=-120/258, 34-35=-120/258, 33-34=-120/258, 32-33=-120/258, 30-32=-120/258, 29-30=-120/258, 28-29=-120/258, 26-28=-120/258, 25-26=-120/258, 24-25=-120/258, 23-24=-120/258, 22-23=-120/258, 21-22=-120/258, 20-21=-120/258	8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
WEBS	T-Brace: 2x4 SPF No.2 - 11-29, 10-30, 9-32, 12-28, 13-26	WEBS	11-29=-201/77, 10-30=-142/77, 9-32=-138/123, 7-33=-136/112, 6-34=-136/111, 5-35=-137/112, 4-36=-131/108, 3-37=-164/137, 12-28=-129/65, 13-26=-142/127, 15-25=-136/112, 16-24=-136/111, 17-23=-138/112, 18-22=-128/105, 19-21=-172/143	
REACTIONS	(size) 2=32-11-0, 20=32-11-0, 21=32-11-0, 22=32-11-0, 23=32-11-0, 24=32-11-0, 25=32-11-0, 26=32-11-0, 28=32-11-0, 29=32-11-0, 30=32-11-0, 32=32-11-0, 33=32-11-0, 34=32-11-0, 35=32-11-0, 36=32-11-0, 37=32-11-0			
	Max Horiz 2=340 (LC 9)			
	Max Uplift 2=-78 (LC 8), 20=-19 (LC 11), 21=-121 (LC 13), 22=-81 (LC 13), 23=-88 (LC 13), 24=-87 (LC 13), 25=-88 (LC 13), 26=-103 (LC 13), 28=-41 (LC 13), 30=-53 (LC 12), 32=-99 (LC 12), 33=-88 (LC 12), 34=-87 (LC 12), 35=-88 (LC 12), 36=-83 (LC 12), 37=-115 (LC 12)			

NOTES

- 1) Unbalanced roof live loads have been considered for this design.



August 7,2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459233
250109-A	A01GE	COMMON SUPPORTED GAB	1	1	Job Reference (optional)	

- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 2, 53 lb uplift at joint 30, 99 lb uplift at joint 32, 88 lb uplift at joint 33, 87 lb uplift at joint 34, 88 lb uplift at joint 35, 83 lb uplift at joint 36, 115 lb uplift at joint 37, 41 lb uplift at joint 28, 103 lb uplift at joint 26, 88 lb uplift at joint 25, 87 lb uplift at joint 24, 88 lb uplift at joint 23, 81 lb uplift at joint 22, 121 lb uplift at joint 21 and 19 lb uplift at joint 20.
- 10) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 20.
- 11) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

LOAD CASE(S) Standard




August 7,2025

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459234
250109-A	A02	COMMON	6	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:44
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

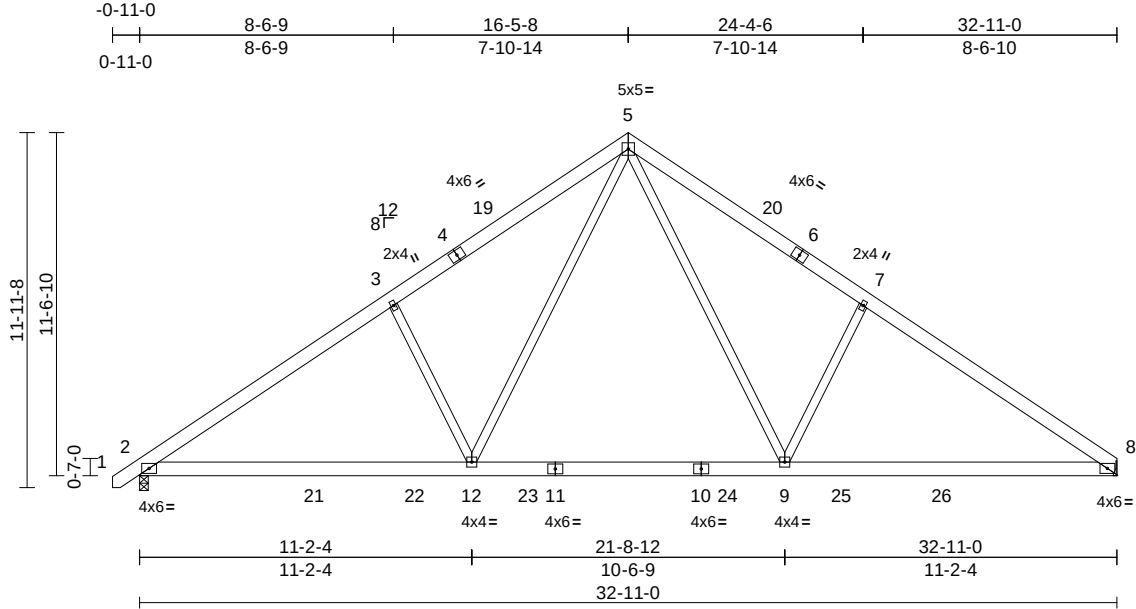

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.16	9-12	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.24	9-18	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.45	Horz(CT)	0.04	8	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-AS		Wind(LL)	0.06	12-15	>999	240	Weight: 226 lb	FT = 25%

LUMBER

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-3-8, 8= Mechanical
Max Horiz 2=271 (LC 11)
Max Uplift 2=-81 (LC 12), 8=-70 (LC 13)
Max Grav 2=1719 (LC 19), 8=1674 (LC 20)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/26, 2-3=-2355/392, 3-5=-2235/486,
5-7=-2237/489, 7-8=-2357/394
BOT CHORD 2-12=-215/2087, 9-12=-7/1349,
8-9=-203/1900
WEBS 5-9=-174/1184, 7-9=-532/310,
5-12=-172/1180, 3-12=-530/309

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-7 to 3-7-6, Interior (1) 3-7-6 to 16-5-8, Exterior(2R) 16-5-8 to 20-10-5, Interior (1) 20-10-5 to 32-11-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 2 and 70 lb uplift at joint 8.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

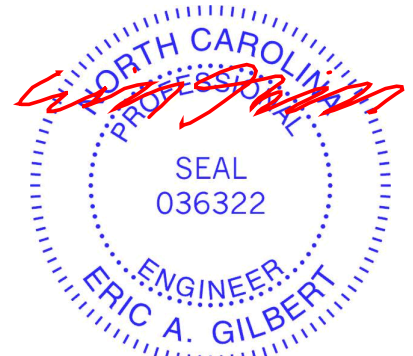

August 7, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Comtech, Inc, Fayetteville, NC - 28314, Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:44 Page: 1
ID:m8kUpd0I7ljL0kTnjZgdHzDyvE-RfC?PsB70qH3NSgPqnL8w3ulTXbGKWRCdoi7J4zJC?f



LUMBER		6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 2 and 70 lb uplift at joint 8. 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
TOP CHORD	2x6 SP No.1	
BOT CHORD	2x6 SP No.1	
WEBS	2x4 SP No.2	
BRACING		LOAD CASE(S) Standard
TOP CHORD	Structural wood sheathing directly applied.	
BOT CHORD	Rigid ceiling directly applied.	
REACTIONS	(size) 2=0-3-8, 8= Mechanical Max Horiz 2=271 (LC 11) Max Uplift 2=-81 (LC 12), 8=-70 (LC 13) Max Grav 2=1712 (LC 19), 8=1667 (LC 20)	
FORCES		
	(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/26, 2-3=-2339/394, 3-5=-2219/488, 5-7=-2220/491, 7-8=-2340/397	
BOT CHORD	2-14=-217/2074, 9-14=-16/1340, 8-9=-204/1887	
WEBS	5-9=-175/1174, 7-9=-534/309, 5-14=-174/1171, 3-14=-532/308	

- ## NOTES
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
 Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; H=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-9-7 to 3-7-6, Interior (1) 3-7-6 to 16-5-8, Exterior(2R) 16-5-8 to 20-10-5, Interior (1) 20-10-5 to 32-11-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Refer to girder(s) for truss to truss connections.




Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	175459236
250109-A	A05	COMMON	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:44
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

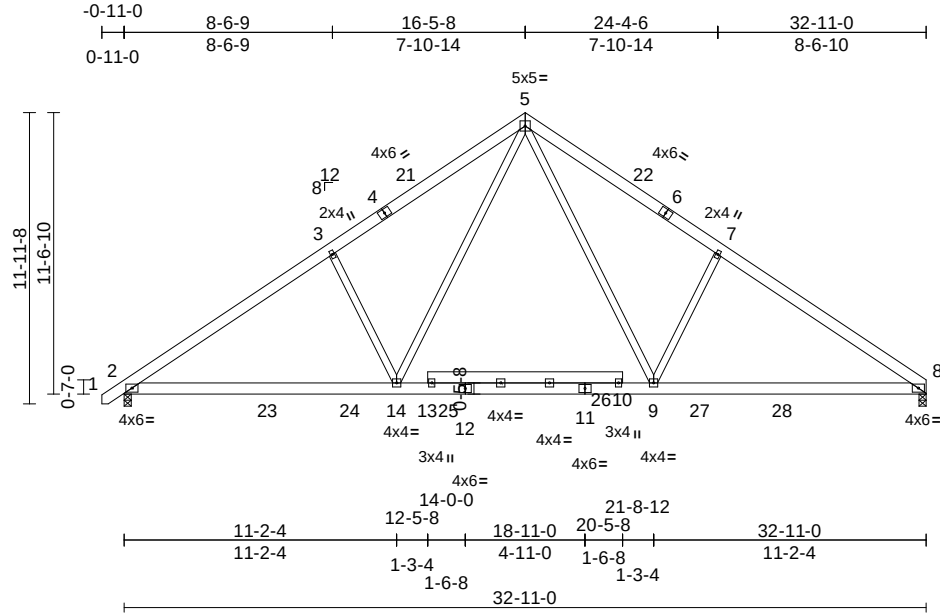

Scale = 1:94.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.14	9-20	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.63	Vert(CT)	-0.25	9-20	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.46	Horz(CT)	0.05	8	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-AS		Wind(LL)	0.05	9-20	>999	240	Weight: 244 lb	FT = 25%

LUMBER

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-3-8, 8=0-3-8
Max Horiz 2=271 (LC 11)
Max Uplift 2=-81 (LC 12), 8=-70 (LC 13)
Max Grav 2=1712 (LC 19), 8=1667 (LC 20)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/26, 2-3=-2339/394, 3-5=-2219/488,
5-7=-2220/491, 7-8=-2340/397
BOT CHORD 2-14=-217/2074, 9-14=-16/1340,
8-9=-204/1887
WEBS 5-9=-175/1174, 7-9=-534/309,
5-14=-174/1171, 3-14=-532/308

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-7 to 3-7-6, Interior (1) 3-7-6 to 16-5-8, Exterior(2R) 16-5-8 to 20-10-5, Interior (1) 20-10-5 to 32-11-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 2 and 70 lb uplift at joint 8.

- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

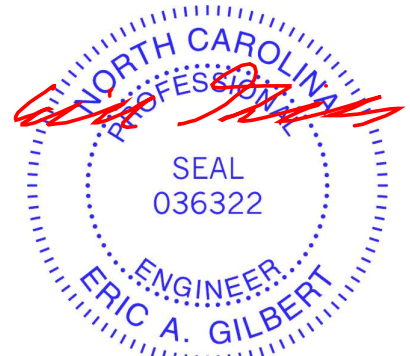

August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459237
250109-A	A06	COMMON	3	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:44
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

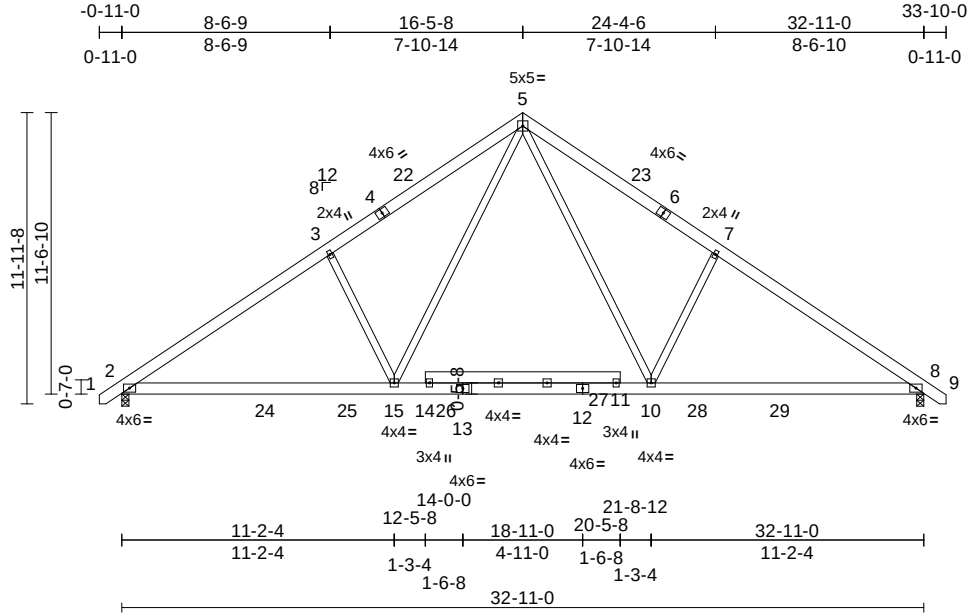

Scale = 1:94.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.14	10-21	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(CT)	-0.25	10-21	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.45	Horz(CT)	0.05	8	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-AS		Wind(LL)	0.05	15-18	>999	240	Weight: 247 lb	FT = 25%

LUMBER

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 8=0-3-8
Max Horiz 2=-276 (LC 10)
Max Uplift 2=-81 (LC 12), 8=-81 (LC 13)
Max Grav 2=1711 (LC 19), 8=1711 (LC 20)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/26, 2-3=-2338/394, 3-5=-2218/488,
5-7=-2218/488, 7-8=-2338/394, 8-9=0/26

BOT CHORD 2-15=-185/2080, 10-15=0/1345,
8-10=-178/1892

WEBS 5-10=-174/1171, 7-10=-532/308,
5-15=-174/1172, 3-15=-532/308

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-7 to 3-7-6, Interior (1) 3-7-6 to 16-5-8, Exterior(2R) 16-5-8 to 20-10-5, Interior (1) 20-10-5 to 33-8-7 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 2 and 81 lb uplift at joint 8.

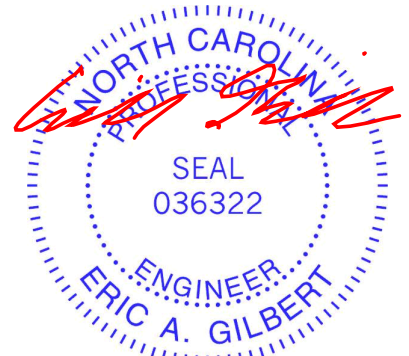

August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459238
250109-A	A07GE	COMMON SUPPORTED GAB	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:44

Page: 1

ID:m8kUpdOI7jlt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRCDoi7J4zJC?r

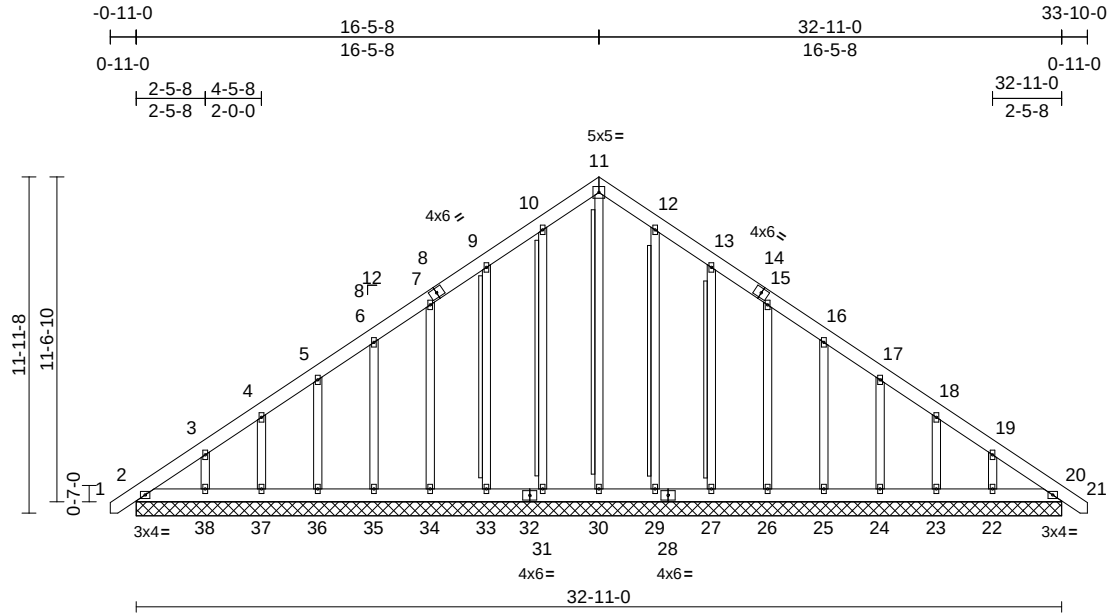

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.01	20	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							Weight: 302 lb FT = 25%

LUMBER
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2 *Except* 0-0,0-0,0-0,0-0,0-0,0-0:2x4
SPF No.2(flat)

BRACING
TOP CHORD Structural wood sheathing directly applied or
6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.
WEBS T-Brace: 2x4 SPF No.2 - 11-30,
10-31, 9-33, 12-29, 13-27
Fasten (2X) T and I braces to narrow edge of
web with 10d (0.131"x3") nails, 6in o.c.,with
3in minimum end distance.
Brace must cover 90% of web length.

REACTIONS (size) 2=32-11-0, 20=32-11-0,
22=32-11-0, 23=32-11-0,
24=32-11-0, 25=32-11-0,
26=32-11-0, 27=32-11-0,
29=32-11-0, 30=32-11-0,
31=32-11-0, 33=32-11-0,
34=32-11-0, 35=32-11-0,
36=32-11-0, 37=32-11-0,
38=32-11-0
Max Horiz 2=-344 (LC 10)
Max Uplift 2=-80 (LC 8), 20=-15 (LC 9),
22=-112 (LC 13), 23=-83 (LC 13),
24=-88 (LC 13), 25=-87 (LC 13),
26=-88 (LC 13), 27=-103 (LC 13),
29=-41 (LC 13), 31=-53 (LC 12),
33=-100 (LC 12), 34=-88 (LC 12),
35=-87 (LC 12), 36=-88 (LC 12),
37=-83 (LC 12), 38=-114 (LC 12)

FORCES (lb) - Maximum Compression/Maximum
Tension
TOP CHORD 1-2=0/23, 2-3=-347/259, 3-4=-254/219,
4-5=-212/194, 5-6=-187/172, 6-7=-166/175,
7-9=-145/218, 9-10=-163/267,
10-11=-185/294, 11-12=-185/294,
12-13=-163/249, 13-15=-116/171,
15-16=-75/100, 16-17=-91/60,
17-18=-107/79, 18-19=-175/104,
19-20=-268/143, 20-21=0/23
BOT CHORD 2-38=-123/271, 37-38=-123/271,
36-37=-123/271, 35-36=-123/271,
34-35=-123/271, 33-34=-123/271,
31-33=-123/271, 30-31=-123/271,
29-30=-123/271, 27-29=-123/271,
26-27=-123/271, 25-26=-123/271,
24-25=-123/271, 23-24=-123/271,
22-23=-123/271, 20-22=-123/271
11-30=-207/79, 10-31=-142/77,
9-33=-138/124, 7-34=-136/112,
6-35=-136/111, 5-36=-137/112,
4-37=-131/108, 3-38=-164/136,
12-29=-128/65, 13-27=-142/127,
15-26=-136/112, 16-25=-136/111,
17-24=-137/112, 18-23=-131/107,
19-22=-162/135
WEBS

NOTES
1) Unbalanced roof live loads have been considered for
this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat.
II; Exp C; Enclosed; MWFRS (envelope) exterior zone
and C-C Corner(3E) -0-9-7 to 3-7-6, Exterior(2N) 3-7-6
to 16-5-8, Corner(3R) 16-5-8 to 20-10-5, Exterior(2N)
20-10-5 to 33-8-7 zone;C-C for members and forces &
MWFRS for reactions shown; Lumber DOL=1.60 plate
grip DOL=1.60
- Truss designed for wind loads in the plane of the truss
only. For studs exposed to wind (normal to the face),
see Standard Industry Gable End Details as applicable,
or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 (||) MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.



August 7, 2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing
250109-A	A07GE	COMMON SUPPORTED GAB	1	1	I75459238
					Job Reference (optional)


Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:44
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDdi7J4zJC?f

Page: 2

- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 80 lb uplift at joint 2, 53 lb uplift at joint 31, 100 lb uplift at joint 33, 88 lb uplift at joint 34, 87 lb uplift at joint 35, 88 lb uplift at joint 36, 83 lb uplift at joint 37, 114 lb uplift at joint 38, 41 lb uplift at joint 29, 103 lb uplift at joint 27, 88 lb uplift at joint 26, 87 lb uplift at joint 25, 88 lb uplift at joint 24, 83 lb uplift at joint 23, 112 lb uplift at joint 22 and 15 lb uplift at joint 20.
- 10) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 20.
- 11) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

LOAD CASE(S) Standard

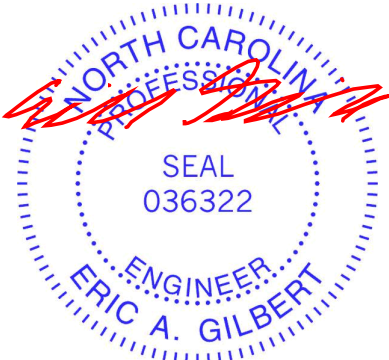

August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	
250109-A	B01GE	GABLE	1	1	Job Reference (optional)	I75459239

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

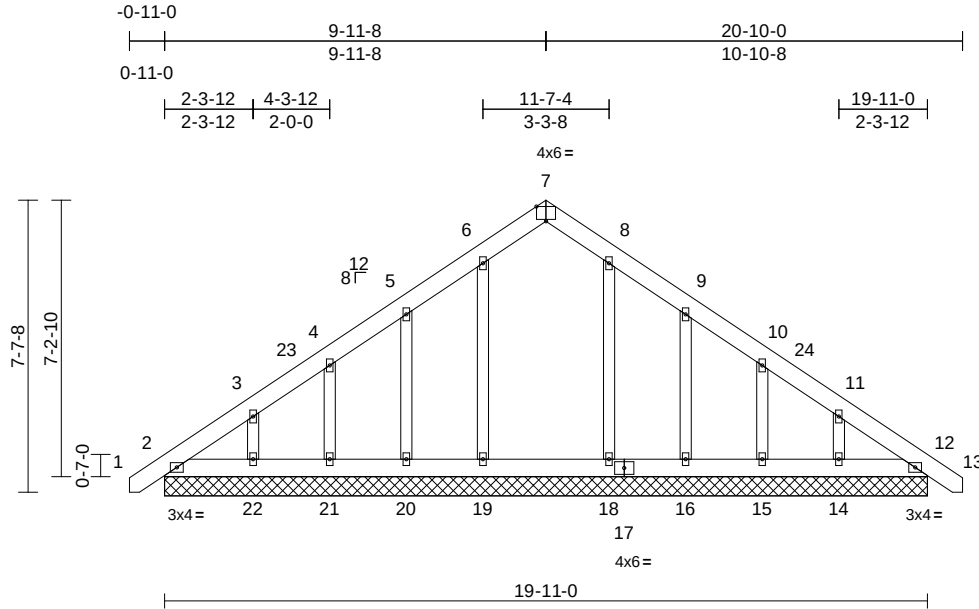

Scale = 1:60.1

Plate Offsets (X, Y): [7:0-3:0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.04	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.00	12	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							Weight: 147 lb FT = 25%

LUMBER

TOP CHORD	2x6 SP No.1
BOT CHORD	2x6 SP No.1
OTHERS	2x4 SP No.2

WEBS

6-19=-149/60, 5-20=-134/144,
4-21=-132/120, 3-22=-156/157,
8-18=-127/41, 9-16=-140/143,
10-15=-132/120, 11-14=-155/157


NOTES

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	2=19-11-0, 12=19-11-0, 14=19-11-0, 15=19-11-0, 16=19-11-0, 18=19-11-0, 19=19-11-0, 20=19-11-0, 21=19-11-0, 22=19-11-0
Max Horiz		2=-215 (LC 10)
Max Uplift		2=-18 (LC 8), 14=-106 (LC 13), 15=-82 (LC 13), 16=-113 (LC 13), 18=-6 (LC 13), 19=-25 (LC 12), 20=-108 (LC 12), 21=-82 (LC 12), 22=-107 (LC 12)
Max Grav		2=185 (LC 20), 12=169 (LC 19), 14=243 (LC 20), 15=203 (LC 20), 16=184 (LC 20), 18=291 (LC 20), 19=313 (LC 19), 20=178 (LC 19), 21=204 (LC 19), 22=244 (LC 19)

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/23, 2-3=-231/128, 3-4=-156/92, 4-5=-134/69, 5-6=-118/96, 6-7=-100/124, 7-8=-97/124, 8-9=-93/93, 9-10=-106/33, 10-11=-137/54, 11-12=-206/90, 12-13=0/23
BOT CHORD	2-22=-84/239, 21-22=-84/239, 20-21=-84/239, 19-20=-84/239, 18-19=-84/239, 16-18=-84/239, 15-16=-84/239, 14-15=-84/239, 12-14=-84/239

LOAD CASE(S) Standard

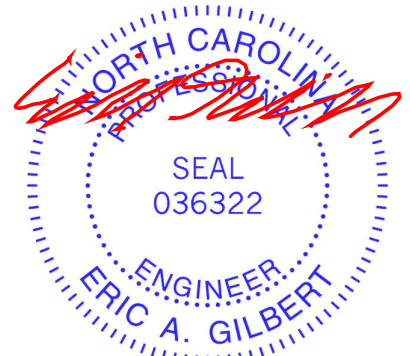

August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459240
250109-A	B02	COMMON	4	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

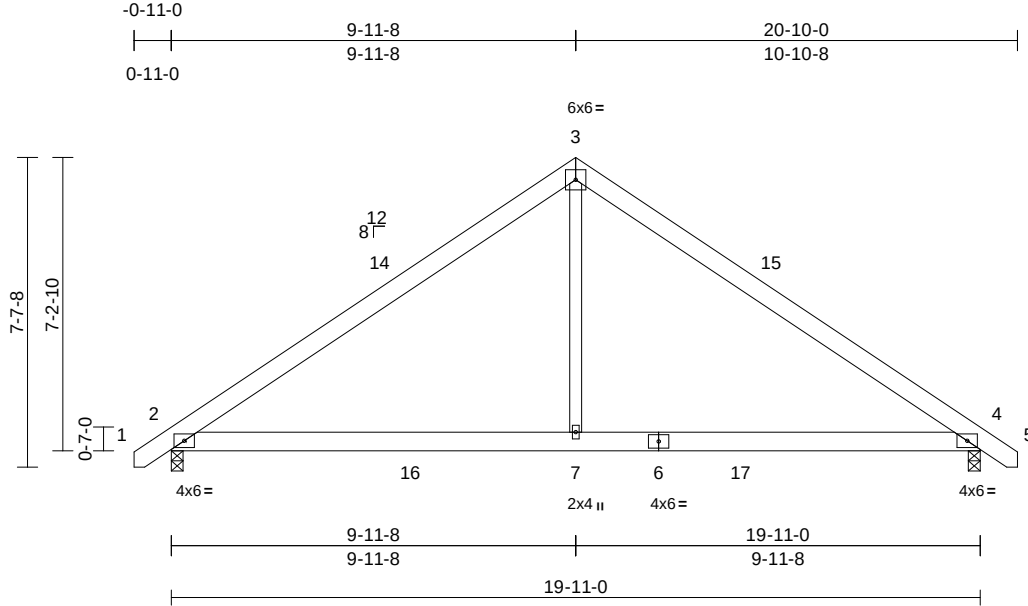

Scale = 1:56.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	-0.10	7-10	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.16	7-10	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.17	Horz(CT)	0.01	4	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-AS		Wind(LL)	0.06	7-10	>999	240	Weight: 118 lb	FT = 25%

LUMBER

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

BRACING


TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 4=0-3-8
Max Horiz 2=-172 (LC 10)
Max Uplift 2=-53 (LC 12), 4=-53 (LC 13)
Max Grav 2=1057 (LC 19), 4=1057 (LC 20)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/26, 2-3=-1233/228, 3-4=-1233/228, 4-5=0/26
BOT CHORD 2-7=-42/994, 4-7=-38/994
WEBS 3-7=0/747

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-7 to 3-7-6, Interior (1) 3-7-6 to 9-11-8, Exterior(2R) 9-11-8 to 14-4-5, Interior (1) 14-4-5 to 20-8-7 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 2 and 53 lb uplift at joint 4.

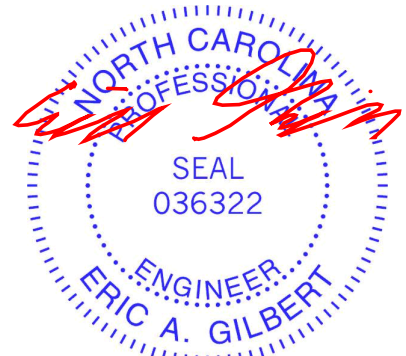

August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459241
250109-A	B03-GR	Common Girder	1	2	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 E Jun 11 2025 Print: 25.2.0 E Jun 11 2025 MiTek Industries, Inc. Thu Aug 07 11:36:50
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-fngp1jGJWtj?1RgmxA5863ZjsrOiuVDNqPkVvdyqFTR

Page: 1

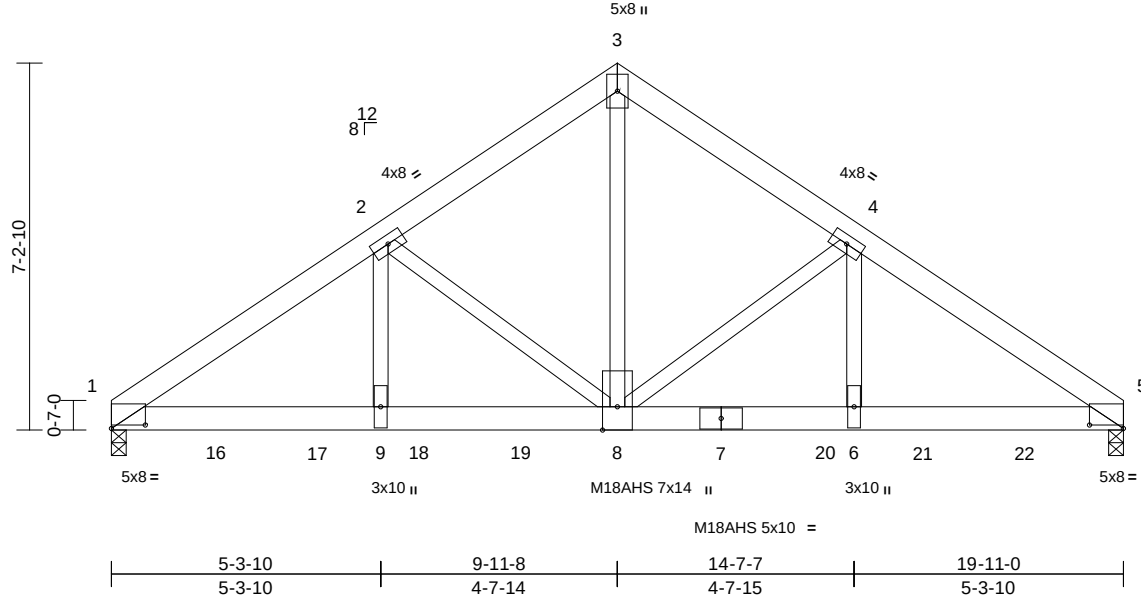

Scale = 1:45.3

Plate Offsets (X, Y): [1:0-8-0,0-0-13], [5:0-8-0,0-0-13]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.46	Vert(LL)	-0.12	8-9	>999	360	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.64	Vert(CT)	-0.20	8-9	>999	240	M18AHS 186/179
BCLL	0.0*	Rep Stress Incr	NO	WB	0.70	Horz(CT)	0.06	5	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS		Wind(LL)	0.06	8-9	>999	240	Weight: 278 lb FT = 25%

LUMBER

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2 *Except* 8-3:2x4 SP No.1

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-5-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 1=6590/0-3-8, 5=6668/0-3-8
Max Horiz 1=-159 (LC 6)
Max Uplift 1=-408 (LC 8), 5=-412 (LC 9)
Max Grav 1=8129 (LC 15), 5=8217 (LC 16)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-11992/617, 2-3=-8306/484, 3-4=-8308/484, 4-5=-11990/618

BOT CHORD 1-16=-523/10083, 16-17=-523/10083, 9-17=-523/10083, 9-18=-523/10083, 18-19=-523/10083, 8-19=-523/10083, 7-8=-450/9977, 7-20=-450/9977, 6-20=-450/9977, 6-21=-450/9977, 21-22=-450/9977, 5-22=-450/9977

WEBS 3-8=-448/8827, 4-8=-3992/303, 4-6=-156/4164, 2-8=-3986/301, 2-9=-155/4174

NOTES

1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-5-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.

3) Unbalanced roof live loads have been considered for this design.

4) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60

5) All plates are MT20 plates unless otherwise indicated.

6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 408 lb uplift at joint 1 and 412 lb uplift at joint 5.

9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1654 lb down and 82 lb up at 2-0-12, 1654 lb down and 82 lb up at 4-0-12, 1654 lb down and 82 lb up at 6-0-12, 1654 lb down and 82 lb up at 8-0-12, 1654 lb down and 82 lb up at 10-0-12, 1654 lb down and 82 lb up at 12-0-12, 1647 lb down and 82 lb up at 14-0-12, and 1647 lb down and 82 lb up at 15-11-12, and 1647 lb down and 82 lb up at 17-11-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (lb/ft)

Vert: 1-3=-60, 3-5=-60, 10-13=-20

Concentrated Loads (lb)

Vert: 7=-1296 (B), 8=-1296 (B), 16=-1296 (B), 17=-1296 (B), 18=-1296 (B), 19=-1296 (B), 20=-1296 (B), 21=-1296 (B), 22=-1296 (B)



August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459242
250109-A	M01GE	GABLE	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

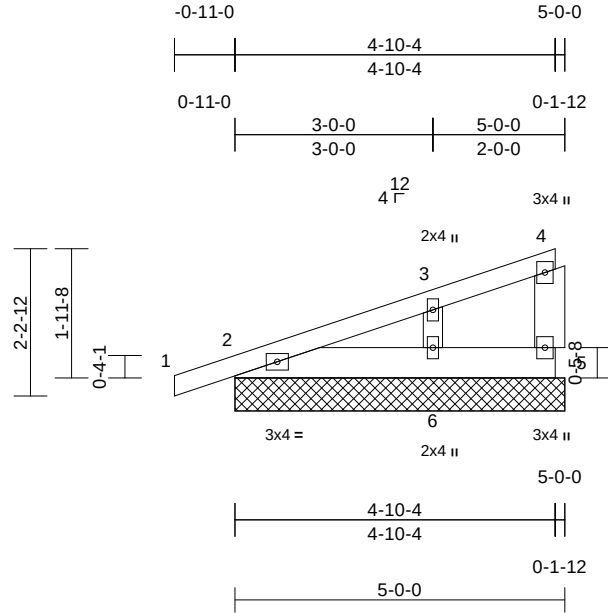

Scale = 1:34.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horz(CT)	n/a	-	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-P							Weight: 24 lb FT = 25%

LUMBER

TOP CHORD	2x4 SP No.1
BOT CHORD	2x6 SP No.1
WEBS	2x6 SP No.1
OTHERS	2x4 SP No.2

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 5, 68 lb uplift at joint 2 and 78 lb uplift at joint 6.

LOAD CASE(S) Standard

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5'-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS

(size)	2=5-0-0, 5=5-0-0, 6=5-0-0
Max Horiz	2=94 (LC 8)
Max Uplift	2=-68 (LC 8), 5=-16 (LC 8), 6=-78 (LC 12)
Max Grav	2=164 (LC 1), 5=37 (LC 1), 6=236 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/20, 2-3=-143/51, 3-4=-26/7, 4-5=-29/62
BOT CHORD	2-6=0/0, 5-6=0/0
WEBS	3-6=-179/344

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 3-5-13, Exterior(2N) 3-5-13 to 4-9-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.



August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459243
250109-A	M02	Monopitch	3	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

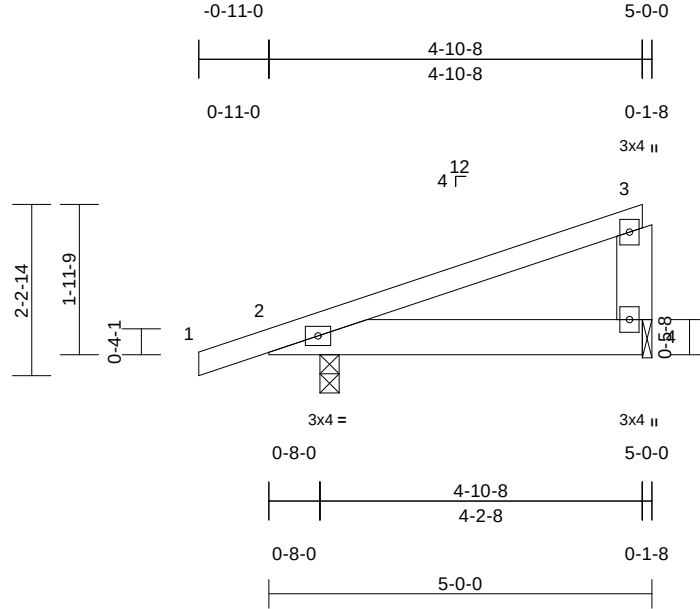

Scale = 1:30.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.01	4-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	-0.01	4-8	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-AS							Weight: 24 lb	FT = 25%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-3-0, 4=0-1-8
Max Horiz 2=68 (LC 8)
Max Uplift 2=-122 (LC 8), 4=-58 (LC 8)
Max Grav 2=301 (LC 1), 4=136 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/17, 2-3=-185/121, 3-4=-86/116
BOT CHORD 2-4=-110/190

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-11-0 to 3-5-13, Interior (1) 3-5-13 to 4-9-4 zone; cantilever left exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 122 lb uplift at joint 2 and 58 lb uplift at joint 4.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

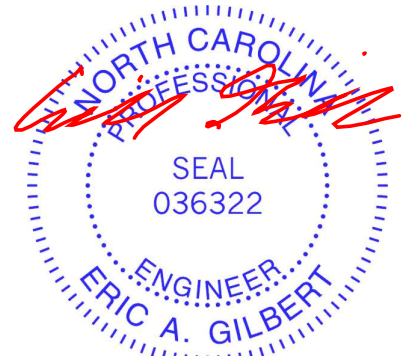

August 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459244
250109-A	V1	Valley	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45
ID:m8kUpdOI7jJLtkTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

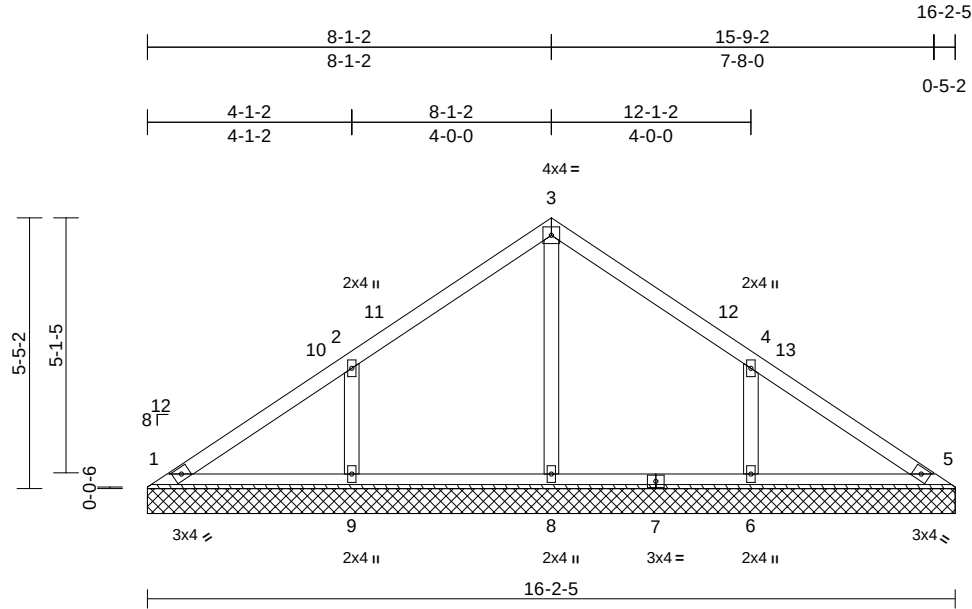

Scale = 1:46.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.16	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.09	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S						Weight: 65 lb	FT = 25%

LUMBER

TOP CHORD	2x4 SP No.1
BOT CHORD	2x4 SP No.1
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=16-2-5, 5=16-2-5, 6=16-2-5, 8=16-2-5, 9=16-2-5
	Max Horiz	1=122 (LC 9)
	Max Uplift	1=-3 (LC 13), 6=-109 (LC 13), 9=-109 (LC 12)
	Max Grav	1=139 (LC 20), 5=132 (LC 1), 6=388 (LC 20), 8=244 (LC 1), 9=388 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-122/95, 2-3=-128/130, 3-4=-114/124, 4-5=-90/59
BOT CHORD	1-9=-36/73, 8-9=-36/73, 6-8=-36/73, 5-6=-36/73
WEBS	3-8=-169/0, 2-9=-296/220, 4-6=-296/220

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-5-15 to 4-10-12, Interior (1) 4-10-12 to 8-1-11, Exterior(2R) 8-1-11 to 12-6-8, Interior (1) 12-6-8 to 15-9-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 4-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 3 lb uplift at joint 1, 109 lb uplift at joint 9 and 109 lb uplift at joint 6.
- LOAD CASE(S)** Standard



August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	
250109-A	V2	Valley	1	1	Job Reference (optional)	I75459245

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

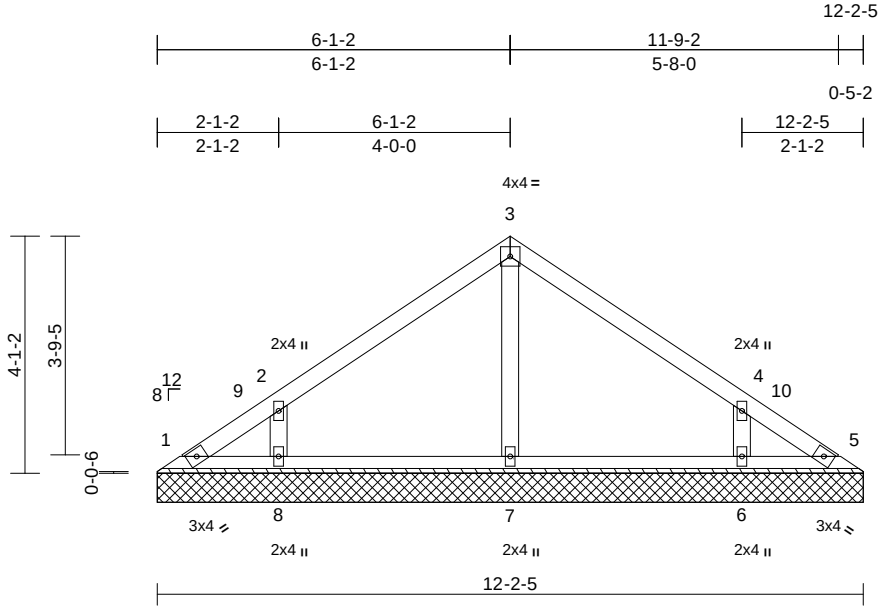

Scale = 1:39.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							Weight: 46 lb FT = 25%

LUMBER

TOP CHORD	2x4 SP No.1
BOT CHORD	2x4 SP No.1
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)	1=12-2-5, 5=12-2-5, 6=12-2-5, 7=12-2-5, 8=12-2-5
Max Horiz	1=-90 (LC 8)
Max Uplift	1=-28 (LC 10), 5=-10 (LC 11), 6=-93 (LC 13), 8=-93 (LC 12)
Max Grav	1=58 (LC 20), 5=45 (LC 19), 6=313 (LC 20), 7=264 (LC 1), 8=314 (LC 19)

FORCES


	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-92/78, 2-3=-122/106, 3-4=-114/103, 4-5=-63/46
BOT CHORD	1-8=-22/52, 7-8=-22/52, 6-7=-22/52, 5-6=-22/52
WEBS	3-7=-178/43, 2-8=-252/229, 4-6=-252/229

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-5-15 to 4-10-12, Interior (1) 4-10-12 to 6-1-11, Exterior(2R) 6-1-11 to 10-6-8, Interior (1) 10-6-8 to 11-9-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 1, 10 lb uplift at joint 5, 93 lb uplift at joint 8 and 93 lb uplift at joint 6.

LOAD CASE(S) Standard

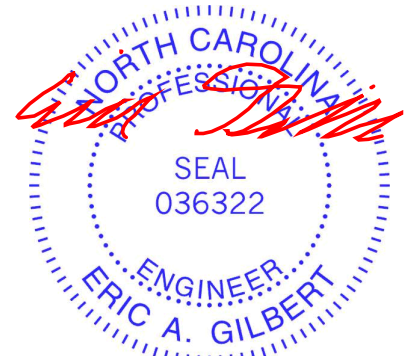

August 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459246
250109-A	V3	Valley	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45

Page: 1

ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

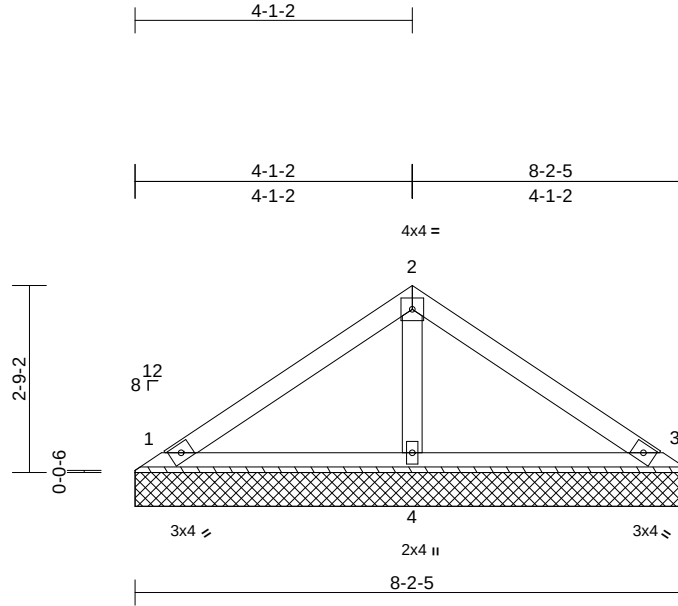

Scale = 1:34

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-P							Weight: 28 lb FT = 25%

LUMBER

TOP CHORD	2x4 SP No.1
BOT CHORD	2x4 SP No.1
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	1=8-2-5, 3=8-2-5, 4=8-2-5
Max Horiz	1=-59 (LC 8)
Max Uplift	1=-25 (LC 12), 3=-31 (LC 13)
Max Grav	1=159 (LC 1), 3=159 (LC 1), 4=266 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD	1-2=-96/68, 2-3=-88/68
BOT CHORD	1-4=-11/42, 3-4=-11/42
WEBS	2-4=-175/114

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1 and 31 lb uplift at joint 3.

LOAD CASE(S) Standard

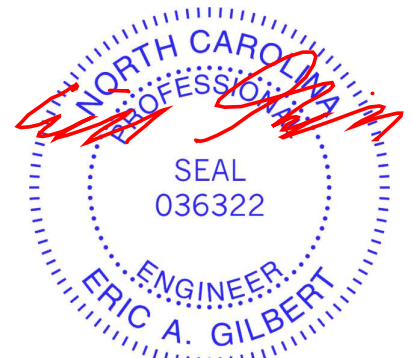

August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	74 Ducks Landing	I75459247
250109-A	V4	Valley	1	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

Run: 25.20 S Jul 24 2025 Print: 25.2.0 S Jul 24 2025 MiTek Industries, Inc. Wed Aug 06 15:45:45
ID:m8kUpdOI7jLt0kTnjZgdHzDyvE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

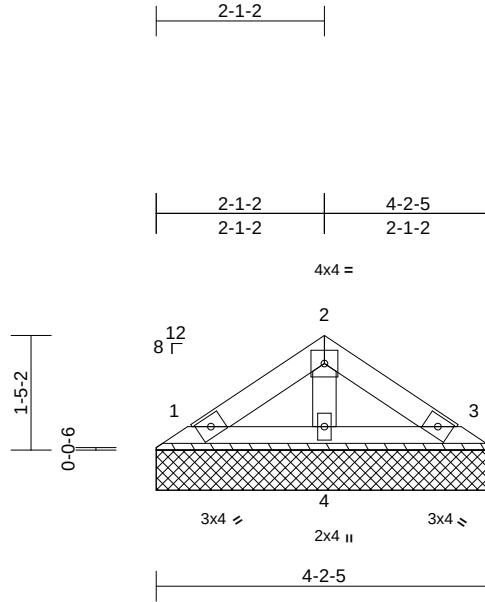

Scale = 1:28.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.04	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.01	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-P							Weight: 13 lb FT = 25%

LUMBER

TOP CHORD	2x4 SP No.1
BOT CHORD	2x4 SP No.1
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-3-7 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	1=4-2-5, 3=4-2-5, 4=4-2-5
Max Horiz	1=27 (LC 11)
Max Uplift	1=-11 (LC 12), 3=-14 (LC 13)
Max Grav	1=72 (LC 1), 3=72 (LC 1), 4=120 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-44/37, 2-3=-40/37
BOT CHORD	1-4=-5/19, 3-4=-5/19
WEBS	2-4=-79/66

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 1 and 14 lb uplift at joint 3.

LOAD CASE(S) Standard



August 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

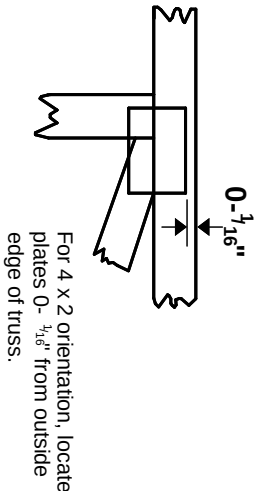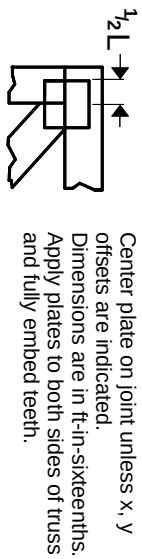


* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

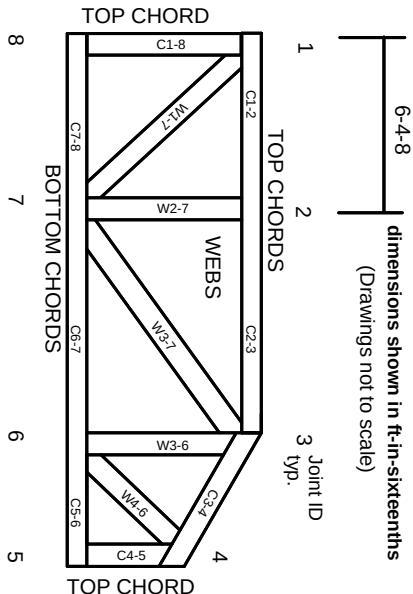

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023