

## **LETTER OF TRANSMITTAL**

September 23, 2025

Caviness & Cates

Fayetteville, NC 28305

ATTN: Rico Allende

RE: Ducks Landing - Lot 119

ECS Job # 33:7513-H

Permits:

Location: 32 Black Duck Lane

Lillington, NC 27546

 $\underline{X}$  Field Reports  $\underline{X}$  For your use  $\underline{X}$  As requested

CC:

ENCL: Field Report # 1 9/22/2025

**SEP 23 2025** 

Jack Cowsert, P.E. Office Manager

Aaron Kyle Adair

**CMT Senior Project Coordinator** 

#### Disclaimer

<sup>1.</sup> This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.

<sup>2.</sup> The information in this report relates only to the activities performed on the report date.

<sup>3.</sup> Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.

<sup>4.</sup> Incomplete or non-conforming work will be reported for future resolution.

<sup>5.</sup> The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.



ECS Southeast, LLC 6151 Raeford Road, Suite A Fayetteville, NC 28304 T 910.401.3288 F 910.323.0539

Project **Ducks Landing - Lot 119** 

Location Lillington, NC

Client Caviness & Cates

Contractor Caviness & Cates

## FIELD REPORT

Project No. 33:7513-H

Report No. 1

Day & Date **Monday 9/22/2025** 

Weather 84 °/ Sunny

On-Site Time 1.00

Lab Time 0.00

Travel Time\* 0.00

Total 1.00

Re Obs Time 0.00

Remarks

Trip Charges\* Tolls/Parking\* Mileage\* Time of Arrival Departure
Chargeable Items 3:15P 4:15P

\* Travel time and mileage will be billed in accordance with the contract.


Summary of Services Performed (field test data, locations, elevations & depths are estimates) & Individuals Contacted.

ECS arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP method (ASTM STP-399) for the monolithic slab foundation footings. Please see the attached sketch and data sheet for details.

A total of 4 hand auger/DCP evaluations were performed to a depth of approximately 4 feet below the current footing sub grade elevation. The test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity of 2000 psf.

ECS will return upon request to provide additional services.

By Andrew N Gomez 1800

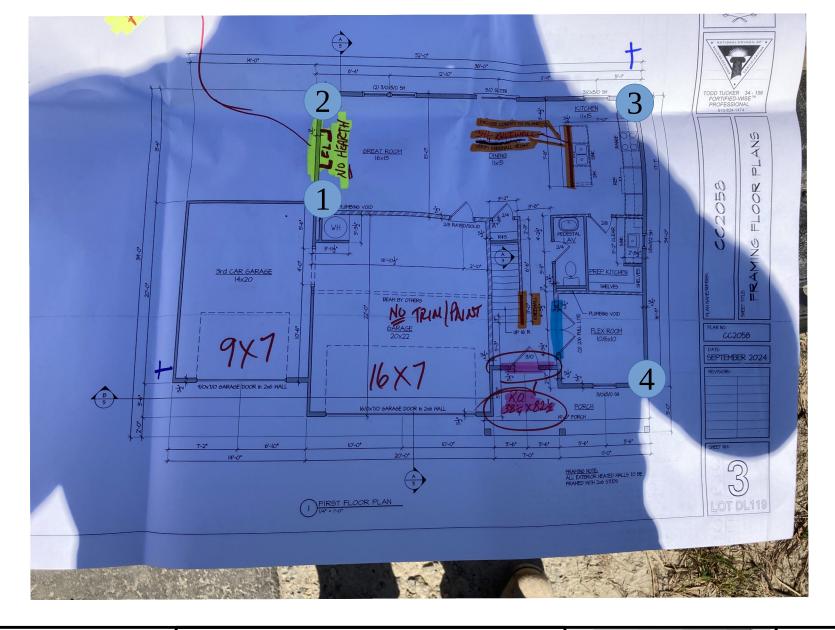

Andrew Gomez 9/22/2025 32 Black Duck Lane, Lillington, NC 27546

Proj #: 7153-H W/O # 87357 Key (NTS) DCP

Inpection

**Test Location:** 



**NORTH** 





Andrew Gomez 9/22/2025 32 Black Duck Lane, Lillington, NC 27546

Proj #: 7153-H W/O # 87357

# Key (NTS) DCP

DCP Inpection

Test Location:





NORTH



### NC Registered Firm # F-1519



## **Report of Foundation Observations**

Project: Ducks Landing - Lot 119

Location: 32 Black Duck Lane

<u>Lillington - Harnett - NC - 27546</u>

ECS Project No.: 33:7513-H

Date: 9/22/2025

General Location: 32 Black Duck Lane, Lillington, NC 27546

Footing Type: Continuous

Design Bearing Pressure: 2000

Test	Location	Size			Footing Bottom Elevation		Depth of	Description of Steel	Description of Foundation	Depth of Test*	Number of
No.			Design	Actual	Design	Actual**	Undercut	Placed	Subgrade Material	Deptil of Test	Blows
1	south west corner	W	0' 0"	0' 0"	-		0' 0"		brown soil	0	15+
		D	0' 0"	0' 0"						-1 brown soil	15+
		L	0' 0"	0' 0"						-2 brown soil	10,10,15+
										-3 brown soil	15+
2	north west corner	W	0' 0"	0' 0"			0' 0"		brown soil	0	12,15+
		D	0' 0"	0' 0"						-1 brown soil	15+
		L	0' 0"	0' 0"						-2 brown soil	8,10,15+
										-3 brown soil	15+
3	north east corner	W	0' 0"	0' 0"			0' 0"		brown soil	0	13,15+
		D	0' 0"	0' 0"						-1 brown soil	15+
		L	0' 0"	0' 0"						-2 brown soil	9,10,14
										-3 brown soil	15+
4	south east corner	W	0' 0"	0' 0"			0' 0"		brown soil	0	15+
		D	0' 0"	0' 0"						-1 brown soil	15+
		L	0' 0"	0' 0"						-2 brown soil	12,15+
										-3 brown soil	15+

* Depth of DCP.	or other methods	of determina	the soil	stiffness
- Dopair o. Do. ,	or ourse moundad	or accommig		0

By: Andrew N Gomez

ECS Southeast, LLC

WO: 87357

<sup>\*\*</sup> Subgrade elevation reported by any means the contractor provided