


SCALE: 1/4" = 1'



Dimension Notes
1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
2. All interior wall dimensions are to face of stud unless noted otherwise
3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

Connector Information					Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
	THF25140	USP	1	NA	10d/3"	10d/3"

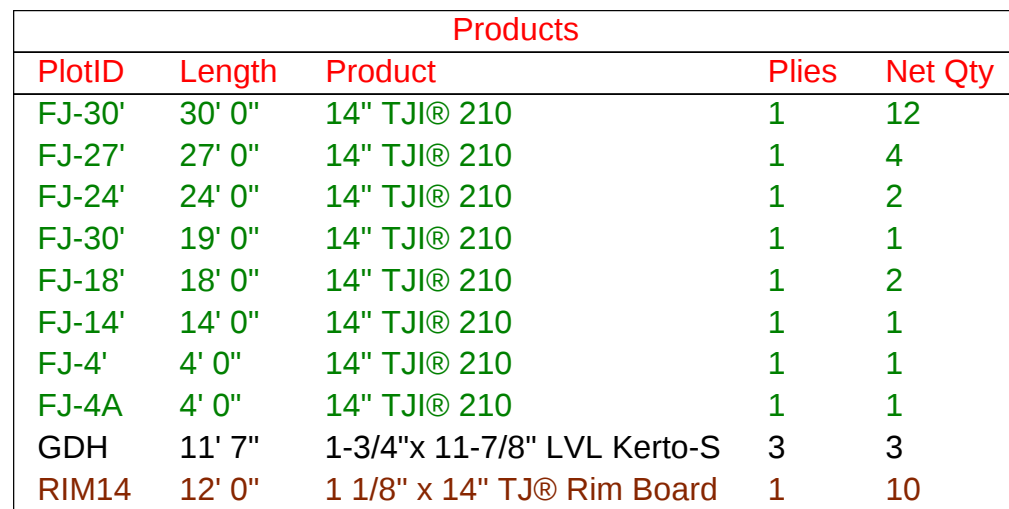

Dimension Notes
1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
2. All interior wall dimensions are to face of stud unless noted otherwise
3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

Roof Area	= 1310.89 sq.ft.
Ridge Line	= 37 ft.
Hip Line	= 0 ft.
Horiz. OH	= 81.29 ft.
Raked OH	= 112.66 ft.
Decking	= 45 sheets

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY

These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com



**ROOF & FLOOR
TRUSSES & BEAMS**

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

CUSTOMER (ACCOUNT)	Caviness & Cates Building & Development	STREET	339 Hookbill Ln
BUILDER		CITY	Lillington, NC
JOB NAME & LEVEL	24 Ducks Landing Roof	TAX AUTH.	NC - Cumberland
PLAN NAME	CC-1644 ROOF F / No RP	SALES REP.	Scot Duncan ()
PLAN SEAL DATE (EOR)	7/28/2025	DESIGNER (& ASST.)	Joseph Horrocks ()
JOB # (OT REF)	250117 - A & C	DESIGN REV. DATE	7/30/2025

[illegible]

PLEASE NOTE:

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.