



Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reactions that exceed the specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Marshall Naylor


(BASED ON TABLES R502.5(1) & (b))

Y	OR	R	Y	OR	R	Y	OR	R
---	----	---	---	----	---	---	----	---

--	--	--	--	--	--

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY

 = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

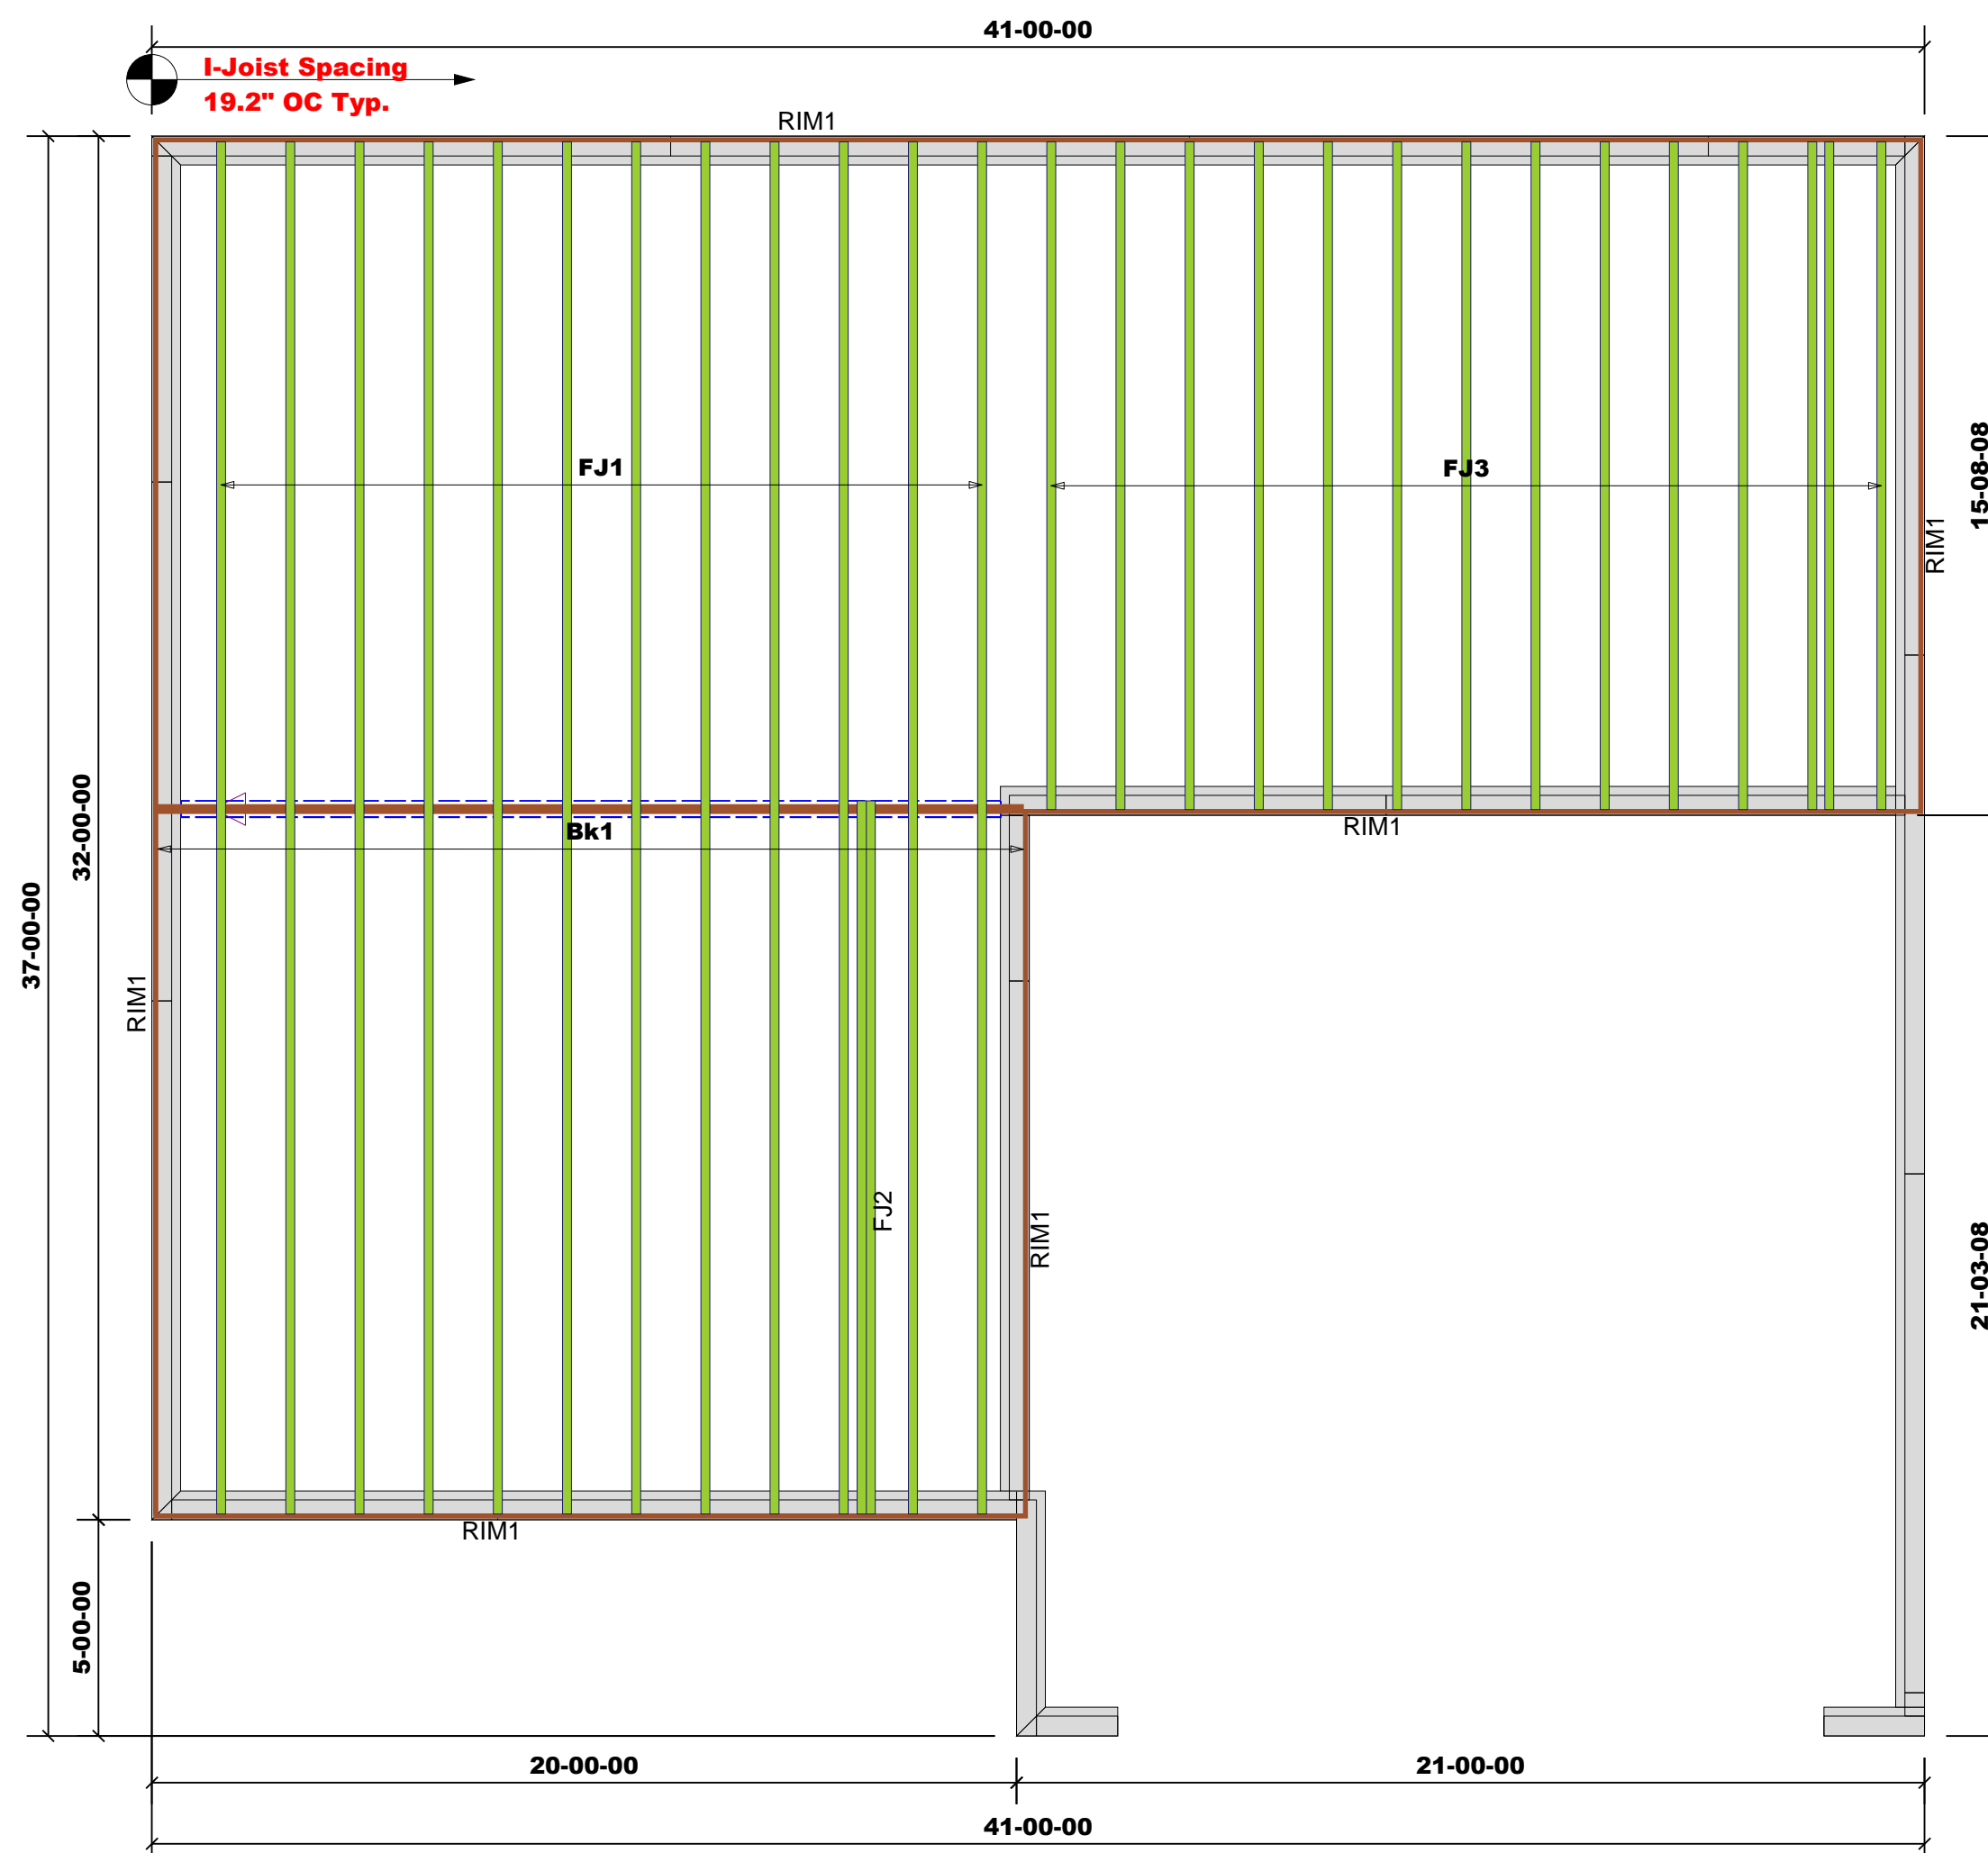

Products				
PlotID	Length	Product	Plies	Net Qty
FJ1	31-08-13	11 7/8" NI-40x	1	12
FJ2	16-06-00	11 7/8" NI-40x	2	2
FJ3	15-05-04	11 7/8" NI-40x	1	14
RIM1	12-00-00	1 1/8" x 11 7/8" Rim Board	1	13
Bk1	2-00-00	11 7/8" NI-40x	1	14

Truss Placement Plan
SCALE: 1/4"=1'