

RE: 4600402  
 LONGLEAF A - LOT 9 - ILA'S WAY

Trenco  
 818 Soundside Rd  
 Edenton, NC 27932

**Site Information:**

Customer: Project Name: 4600402  
 Lot/Block: Model:  
 Address: Subdivision:  
 City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**


Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.6  
 Wind Code: ASCE 7 - 16[Low Rise] Wind Speed: 130 mph  
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 12 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	I70431949	A01	12/27/2024
2	I70431950	A02	12/27/2024
3	I70431951	A03	12/27/2024
4	I70431952	A04	12/27/2024
5	I70431953	A05	12/27/2024
6	I70431954	A06	12/27/2024
7	I70431955	B01G	12/27/2024
8	I70431956	B02	12/27/2024
9	I70431957	M01	12/27/2024
10	I70431958	M02	12/27/2024
11	I70431959	M03	12/27/2024
12	I70431960	V01	12/27/2024

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource (Albermarle,NC).  
 Truss Design Engineer's Name: Gilbert, Eric  
 My license renewal date for the state of North Carolina is December 31, 2025.  
 North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

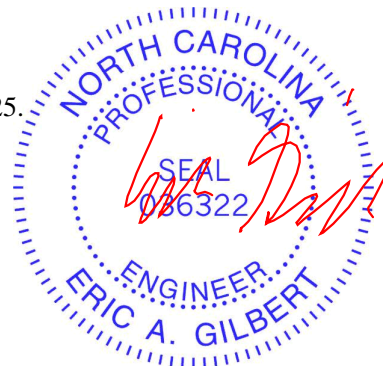


December 27, 2024

Job 4600402	Truss A01	Truss Type Common Supported Gable	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431949
----------------	--------------	--------------------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:31  
ID:QoOnpU5Aaic4YwNiThnLXUz46FF-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCdoi7J4zJC?F


Page: 1

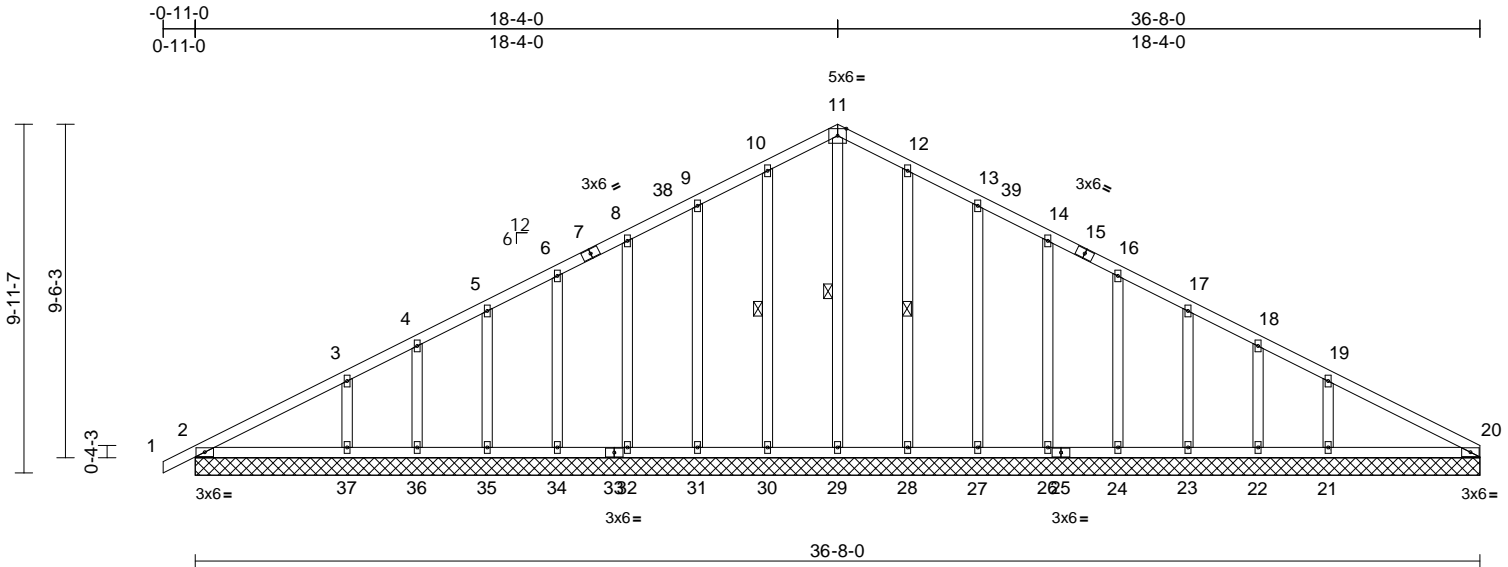

Scale = 1:65.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.14	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.01	20	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 234 lb	FT = 20%

LUMBER	TOP CHORD	2x4 SP No.2	BOT CHORD	2x4 SP No.2	OTHERS	2x4 SP No.3
<b>BRACING</b>	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.				
	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.				
<b>WEBS</b>		1 Row at midpt 11-29, 10-30, 12-28				
<b>REACTIONS</b>	(size)	2=36-8-0, 20=36-8-0, 21=36-8-0, 22=36-8-0, 23=36-8-0, 24=36-8-0, 26=36-8-0, 27=36-8-0, 28=36-8-0, 29=36-8-0, 30=36-8-0, 31=36-8-0, 32=36-8-0, 34=36-8-0, 35=36-8-0, 36=36-8-0, 37=36-8-0				
	Max Horiz	2=168 (LC 12)				
	Max Uplift	2=-17 (LC 13), 21=-109 (LC 13), 22=-22 (LC 13), 23=-54 (LC 13), 24=-48 (LC 13), 26=-48 (LC 13), 27=-52 (LC 13), 28=-43 (LC 13), 30=-46 (LC 12), 31=-51 (LC 12), 32=-48 (LC 12), 34=-48 (LC 12), 35=-54 (LC 12), 36=-26 (LC 12), 37=-104 (LC 12)				
	Max Grav	2=209 (LC 2), 20=147 (LC 2), 21=357 (LC 33), 22=72 (LC 33), 23=189 (LC 3), 24=200 (LC 35), 26=200 (LC 3), 27=219 (LC 6), 28=239 (LC 6), 29=252 (LC 29), 30=239 (LC 5), 31=219 (LC 5), 32=200 (LC 3), 34=200 (LC 34), 35=187 (LC 3), 36=79 (LC 32), 37=343 (LC 32)				
<b>FORCES</b>	(lb) - Maximum Compression/Maximum Tension					
<b>TOP CHORD</b>		1-2=0/31, 2-3=-191/92, 3-4=-117/87, 4-5=-84/107, 5-6=-65/133, 6-8=-54/157, 8-9=-44/181, 9-10=-45/206, 10-11=-51/228, 11-12=-51/220, 12-13=-46/179, 13-14=-39/134, 14-16=-39/92, 16-17=-40/68, 17-18=-32/42, 18-19=-69/23, 19-20=-128/59				
<b>BOT CHORD</b>		2-37=-14/143, 36-37=-14/143, 35-36=-14/143, 34-35=-14/143, 32-34=-14/143, 31-32=-14/143, 30-31=-14/143, 29-30=-14/143, 28-29=-14/143, 27-28=-14/143, 26-27=-14/143, 24-26=-14/143, 23-24=-14/143, 22-23=-14/143, 21-22=-14/143, 20-21=-14/143				
<b>WEBS</b>		11-29=-152/0, 10-30=-172/70, 9-31=-146/75, 8-32=-121/72, 6-34=-117/71, 5-35=-132/79, 4-36=-67/44, 3-37=-243/143, 12-28=-172/67, 13-27=-146/76, 14-26=-121/72, 16-24=-117/71, 17-23=-134/80, 18-22=-61/39, 19-21=-255/151				
<b>NOTES</b>		<p>1) Unbalanced roof live loads have been considered for this design.</p> <p>2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60</p> <p>3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.</p> <p>4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL); Lum DOL=1.15 Plate DOL=1.15; Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10</p> <p>5) Unbalanced snow loads have been considered for this design.</p> <p>6) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.</p> <p>7) All plates are 2x4 MT20 unless otherwise indicated.</p> <p>8) Gable requires continuous bottom chord bearing.</p> <p>9) Gable studs spaced at 2-0-0 oc.</p> <p>10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.</p> <p>11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.</p> <p>12) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.</p> <p>13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 2, 46 lb uplift at joint 30, 51 lb uplift at joint 31, 48 lb uplift at joint 32, 48 lb uplift at joint 34, 54 lb uplift at joint 35, 26 lb uplift at joint 36, 104 lb uplift at joint 37, 43 lb uplift at joint 28, 52 lb uplift at joint 27, 48 lb uplift at joint 26, 48 lb uplift at joint 24, 54 lb uplift at joint 23, 22 lb uplift at joint 22 and 109 lb uplift at joint 21.</p>				

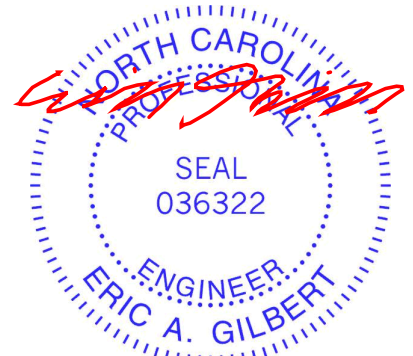

December 27, 2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss A01	Truss Type Common Supported Gable	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY I70431949 Job Reference (optional)
----------------	--------------	--------------------------------------	----------	----------	---

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:31  
ID:QoOnpU5Aaic4YwNiThnLXUz46FF-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 2

14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss A02	Truss Type Common	Qty 5	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431950
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:32  
ID:k1?QGZcD1QUcGh?wr82ue3z46DH-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

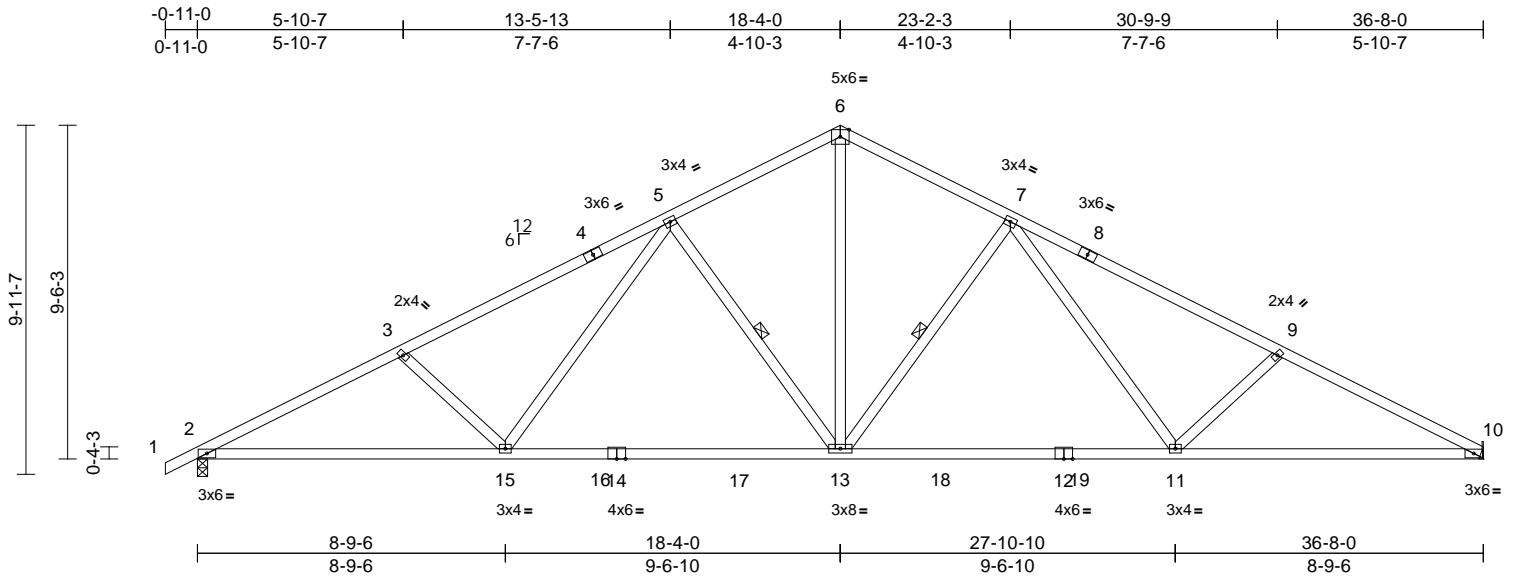

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	-0.28	11-13	>999	240	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	-0.51	13-15	>853	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.54	Horz(CT)	0.11	10	n/a	n/a	
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S							
BCDL	10.0										
										Weight: 190 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied or 9-8-12 oc bracing.  
WEBS 1 Row at midpt 5-13, 7-13


**REACTIONS** (size) 2=0-3-8, 10= Mechanical  
Max Horiz 2=168 (LC 12)  
Max Uplift 2=-194 (LC 12), 10=-172 (LC 13)  
Max Grav 2=1523 (LC 2), 10=1457 (LC 2)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/32, 2-3=-2779/355, 3-5=-2516/317,  
5-6=-1720/262, 6-7=-1719/260,  
7-9=-2540/323, 9-10=-2812/364  
BOT CHORD 2-15=-406/2429, 13-15=-195/1840,  
11-13=-82/1847, 10-11=-263/2467  
WEBS 6-13=-159/1301, 3-15=-384/242,  
5-15=-64/578, 5-13=-655/264,  
7-13=-665/265, 7-11=-69/594, 9-11=-406/250

- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearings are assumed to be: Joint 2 SP No.1 crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 194 lb uplift at joint 2 and 172 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.

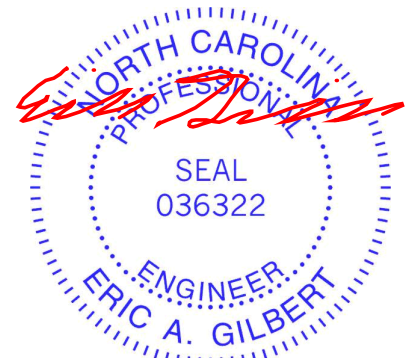

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss A03	Truss Type Common	Qty 5	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431951
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:32  
ID:D?1nVn1fDGF?FkWnuSYA7qz465?-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

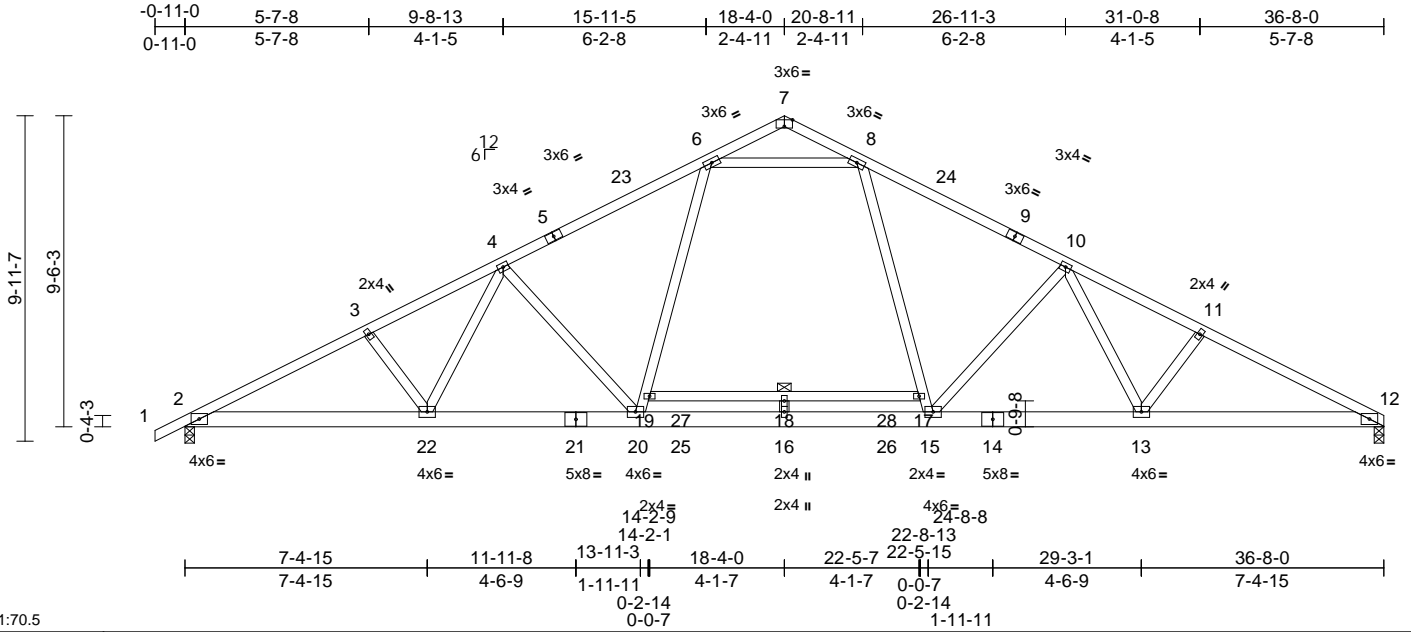


Plate Offsets (X, Y): [7:0-3:0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.35	13-15	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.95	Vert(CT)	-0.48	17-18	>901	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.09	12	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 233 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2 \*Except\* 19-17:2x4 SP No.2  
WEBS 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 2-3-3 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing. Except: 6-0-0 oc bracing: 17-19

**REACTIONS**

(size) 2=0-3-8, 12=0-3-8  
Max Horiz 2=169 (LC 12)  
Max Uplift 2=-143 (LC 12), 12=-120 (LC 13)  
Max Grav 2=1605 (LC 2), 12=1547 (LC 3)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/37, 2-3=-3033/232, 3-4=-2885/237, 4-6=-2490/145, 6-7=-88/34, 7-8=-88/35, 8-10=-2491/144, 10-11=-2893/242, 11-12=-3042/239  
BOT CHORD 2-22=-291/2653, 20-22=-174/2434, 16-20=0/1948, 15-16=0/1948, 13-15=-23/2436, 12-13=-149/2664, 18-19=-6/12, 17-18=-6/12  
WEBS 8-17=0/836, 15-17=0/757, 19-20=0/757, 6-19=0/835, 6-8=-1946/211, 16-18=-232/0, 3-22=-232/132, 4-22=-97/428, 4-20=-635/276, 10-15=-637/276, 10-13=-103/438, 11-13=-245/143

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 120 lb uplift at joint 12 and 143 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss A04	Truss Type Common	Qty 2	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	I70431952
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:32  
ID:8yRFT?Fpz4M4pF?McCyQjz45bk-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRcDoi7J4zJC?f

Page: 1

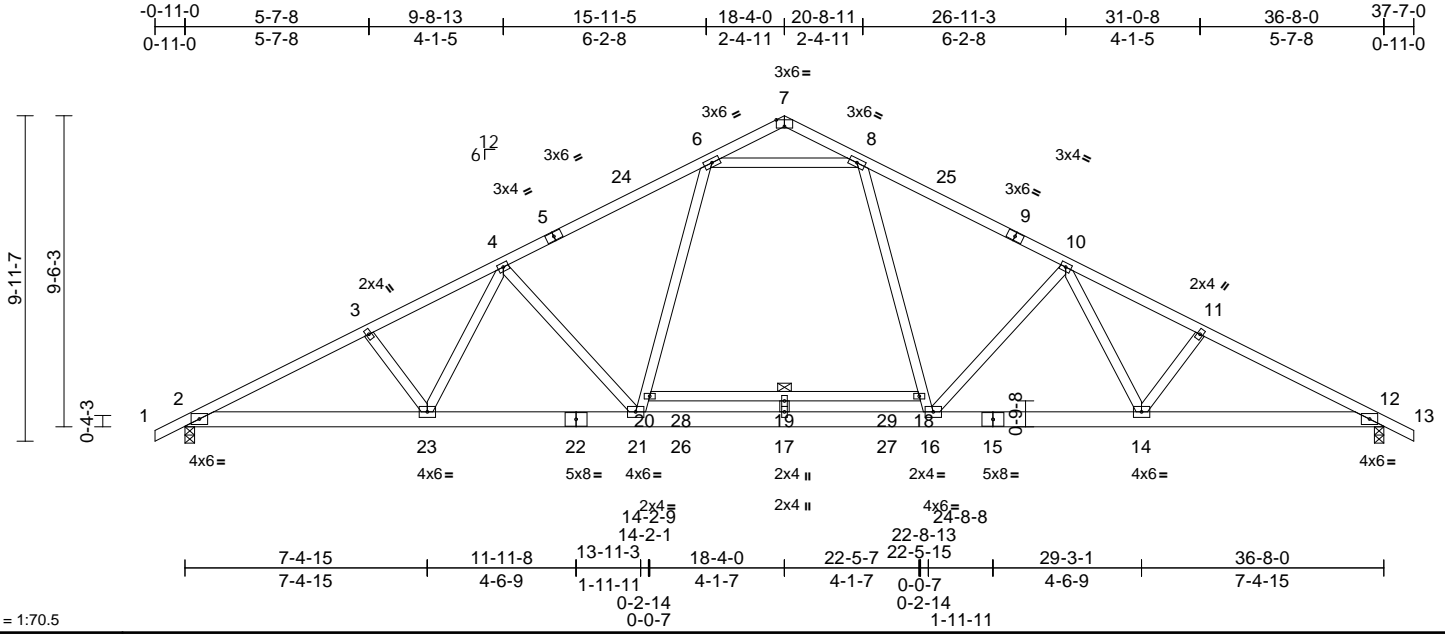

Scale = 1:70.5

Plate Offsets (X, Y): [7:0-3:0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.80	Vert(LL)	-0.34	14-16	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.94	Vert(CT)	-0.48	18-19	>904	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.09	12	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 235 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2 \*Except\* 20-18:2x4 SP No.2  
WEBS 2x4 SP No.3


**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-3-11 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing. Except: 6-0-0 oc bracing: 18-20

**REACTIONS**  
(size) 2=0-3-8, 12=0-3-8  
Max Horiz 2=-161 (LC 13)  
Max Uplift 2=-143 (LC 12), 12=-143 (LC 13)  
Max Grav 2=1604 (LC 2), 12=1604 (LC 2)

**FORCES**  
(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/37, 2-3=-3032/232, 3-4=-2884/237, 4-6=-2488/144, 6-7=-89/34, 7-8=-89/34, 8-10=-2488/144, 10-11=-2884/237, 11-12=-3032/233, 12-13=0/37  
BOT CHORD 2-23=-283/2651, 21-23=-165/2432, 17-21=0/1946, 16-17=0/1946, 14-16=-5/2432, 12-14=-123/2651, 19-20=-6/12, 18-19=-6/12  
WEBS 20-21=0/756, 6-20=0/835, 8-18=0/835, 16-18=0/756, 6-8=-1944/210, 17-19=-232/0, 3-23=-232/132, 4-23=-97/428, 4-21=-635/276, 10-16=-635/276, 10-14=-98/428, 11-14=-232/133

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 143 lb uplift at joint 2 and 143 lb uplift at joint 12.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

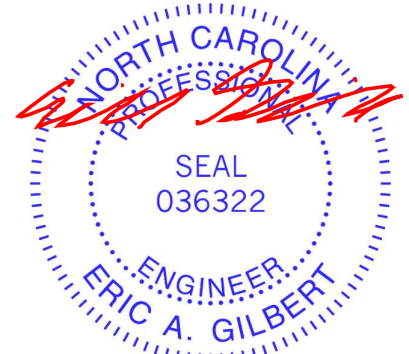

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss A05	Truss Type Common	Qty 5	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431953
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:32  
ID:?immNtpsViXDia22OfkbA?z45X7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

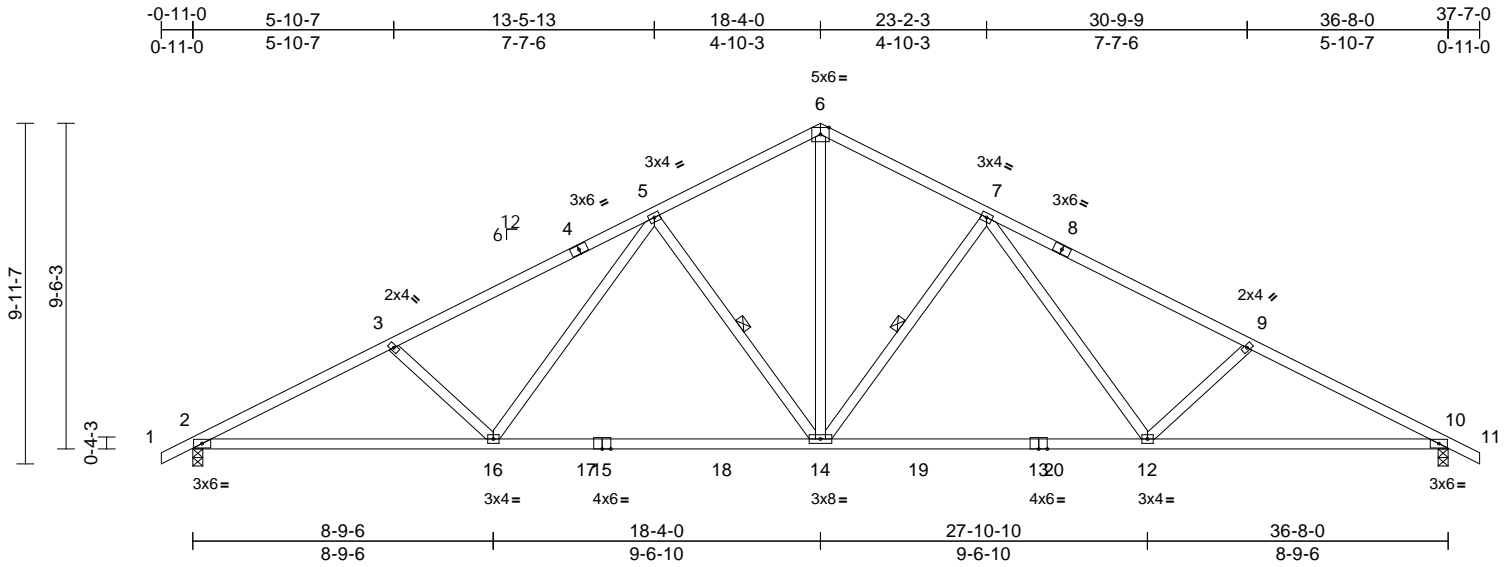

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	-0.29	14-16	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.99	Vert(CT)	-0.52	14-16	>833	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.54	Horz(CT)	0.12	10	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S								
BCDL	10.0											
												Weight: 192 lb FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2 \*Except\* 15-13:2x4 SP No.1  
WEBS 2x4 SP No.3


**BRACING**  
TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.  
WEBS 1 Row at midpt 5-14, 7-14

**REACTIONS** (size) 2=0-3-8, 10=0-3-8  
Max Horiz 2=-161 (LC 13)  
Max Uplift 2=-194 (LC 12), 10=-194 (LC 13)  
Max Grav 2=1519 (LC 2), 10=1519 (LC 2)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/32, 2-3=-2770/355, 3-5=-2507/317, 5-6=-1710/260, 6-7=-1710/260, 7-9=-2507/318, 9-10=-2770/355, 10-11=0/32  
BOT CHORD 2-16=-399/2420, 14-16=-188/1832, 12-14=-75/1832, 10-12=-239/2420  
WEBS 6-14=-158/1294, 3-16=-384/242, 5-16=-64/576, 5-14=-655/264, 7-14=-655/264, 7-12=-65/576, 9-12=-384/242

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.

- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 194 lb uplift at joint 2 and 194 lb uplift at joint 10.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

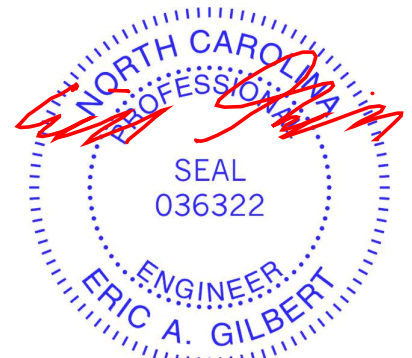

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss A06	Truss Type Common Supported Gable	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431954
----------------	--------------	--------------------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:32  
ID:f5b0Adn2fictt9Q4SAMQtz45Vt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCdoi7J4zJC?f


Page: 1

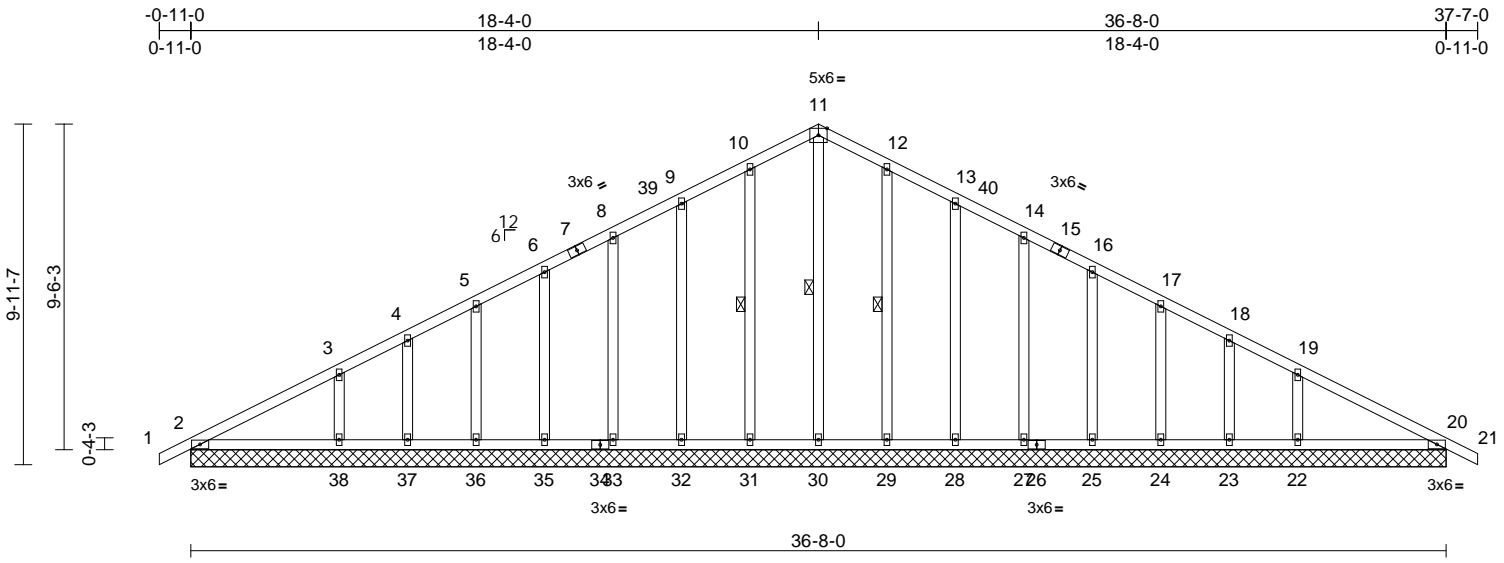

Scale = 1:67.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.14	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.01	20	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S							
BCDL	10.0									Weight: 236 lb	FT = 20%

LUMBER	TOP CHORD	1-2=0/31, 2-3=-188/97, 3-4=-115/93, 4-5=-81/113, 5-6=-64/138, 6-8=-53/163, 8-9=-43/187, 9-10=-45/212, 10-11=-51/233, 11-12=-51/226, 12-13=-45/185, 13-14=-39/140, 14-16=-39/97, 16-17=-40/71, 17-18=-30/45, 18-19=-64/25, 19-20=-120/57, 20-21=0/31	6)
TOP CHORD	2x4 SP No.2		This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
BOT CHORD	2x4 SP No.2		7) All plates are 2x4 MT20 unless otherwise indicated.
OTHERS	2x4 SP No.3		8) Gable requires continuous bottom chord bearing.
BRACING			9) Gable studs spaced at 2-0-0 oc.
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.		10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.		11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
WEBS	1 Row at midpt 11-30, 10-31, 12-29		12) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
REACTIONS	(size) 2=36-8-0, 20=36-8-0, 22=36-8-0, 23=36-8-0, 24=36-8-0, 25=36-8-0, 27=36-8-0, 28=36-8-0, 29=36-8-0, 30=36-8-0, 31=36-8-0, 32=36-8-0, 33=36-8-0, 35=36-8-0, 36=36-8-0, 37=36-8-0, 38=36-8-0		13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 2, 45 lb uplift at joint 31, 51 lb uplift at joint 32, 48 lb uplift at joint 33, 48 lb uplift at joint 35, 54 lb uplift at joint 36, 26 lb uplift at joint 37, 104 lb uplift at joint 38, 42 lb uplift at joint 29, 53 lb uplift at joint 28, 48 lb uplift at joint 27, 48 lb uplift at joint 25, 54 lb uplift at joint 24, 26 lb uplift at joint 23 and 103 lb uplift at joint 22.
Max Horiz	2=-161 (LC 13)		
Max Uplift	2=-19 (LC 13), 22=-103 (LC 13), 23=-26 (LC 13), 24=-54 (LC 13), 25=-48 (LC 13), 27=-48 (LC 13), 28=-53 (LC 13), 29=-42 (LC 13), 31=-45 (LC 12), 32=-51 (LC 12), 33=-48 (LC 12), 35=-48 (LC 12), 36=-54 (LC 12), 37=-26 (LC 12), 38=-104 (LC 12)		
Max Grav	2=209 (LC 2), 20=209 (LC 2), 22=343 (LC 33), 23=79 (LC 33), 24=187 (LC 3), 25=200 (LC 35), 27=200 (LC 3), 28=219 (LC 6), 29=239 (LC 6), 30=256 (LC 29), 31=239 (LC 5), 32=219 (LC 5), 33=200 (LC 3), 35=200 (LC 34), 36=187 (LC 3), 37=79 (LC 32), 38=343 (LC 32)		
FORCES	(lb) - Maximum Compression/Maximum Tension		
NOTES			
1)	Unbalanced roof live loads have been considered for this design.		
2)	Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60		
3)	Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.		
4)	TCLL: ASCE 7-16; Pr=20.0 psf (roof LL); Lum DOL=1.15 Plate DOL=1.15; Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10		
5)	Unbalanced snow loads have been considered for this design.		

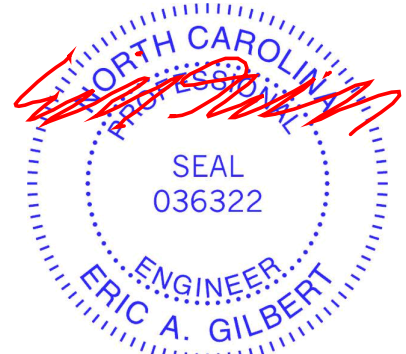

December 27, 2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932



Job 4600402	Truss A06	Truss Type Common Supported Gable	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY I70431954 Job Reference (optional)
----------------	--------------	--------------------------------------	----------	----------	---

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:32  
ID:f5b0ADn2fictt9Q4SAMQtz45Vt-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?f

Page: 2

14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss B01G	Truss Type Common Girder	Qty 1	Ply 2	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431955
----------------	---------------	-----------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:32  
ID:gSE80HpMePj?x9mZpCHMoz45UY-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWRcDoi7J4zJC?f

Page: 1

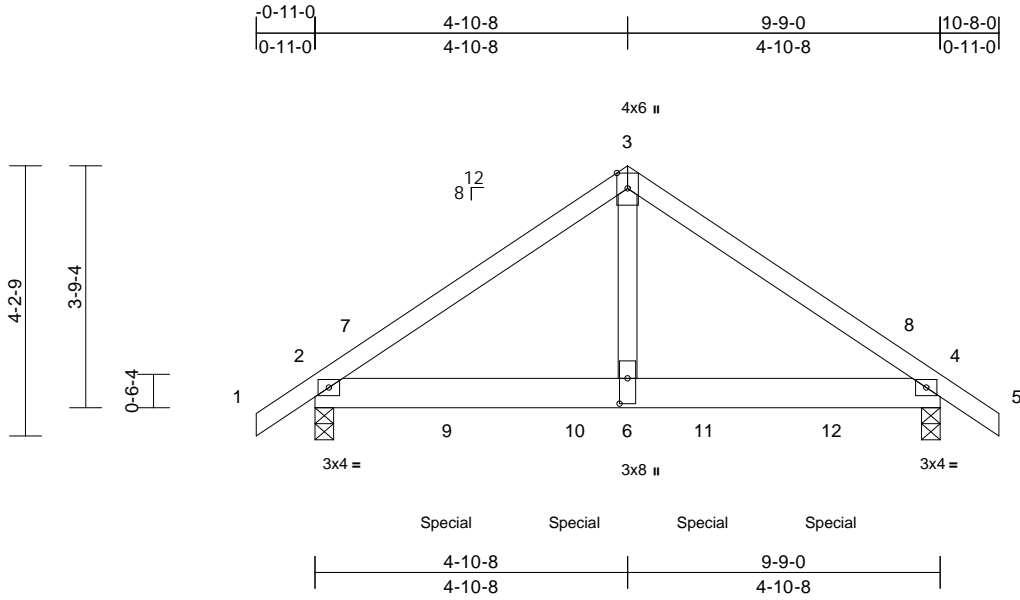

Scale = 1:35.9  
Plate Offsets (X, Y): [6:0-4-12,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.41	Vert(LL)	-0.04	4-6	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.49	Vert(CT)	-0.08	4-6	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.85	Horz(CT)	0.01	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 97 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP 2400F 2.0E or 2x6 SP DSS  
WEBS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 5-11-2 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 2=0-3-8, 4=0-3-8  
Max Horiz 2=95 (LC 11)  
Max Uplift 2=-416 (LC 12), 4=-445 (LC 13)  
Max Grav 2=3259 (LC 26), 4=3494 (LC 27)


**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/37, 2-3=-3982/510, 3-4=-3979/509, 4-5=0/37  
BOT CHORD 2-6=-359/3238, 4-6=-359/3238  
WEBS 3-6=-472/4248

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP 2400F 2.0E or DSS crushing capacity of 660 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 416 lb uplift at joint 2 and 445 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1484 lb down and 184 lb up at 2-0-12, 1484 lb down and 184 lb up at 4-0-12, and 1484 lb down and 184 lb up at 6-0-12, and 1484 lb down and 184 lb up at 8-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

Uniform Loads (lb/ft)  
Vert: 1-3=-51, 3-5=-51, 2-4=-20  
Concentrated Loads (lb)  
Vert: 9=-1270 (B), 10=-1270 (B), 11=-1270 (B), 12=-1270 (B)

- NOTES**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.  
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.

**LOAD CASE(S)** Standard  
1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15

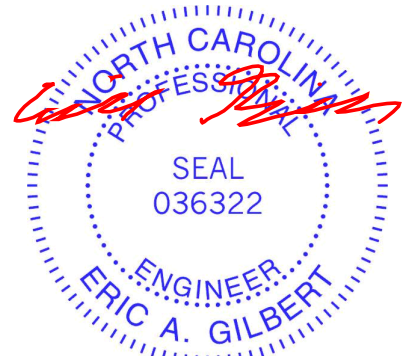

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss B02	Truss Type Common Supported Gable	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431956
----------------	--------------	--------------------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:33  
ID:s?788QMoE0o\_Yg8iHAF8IOz45S\_-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?F

Page: 1

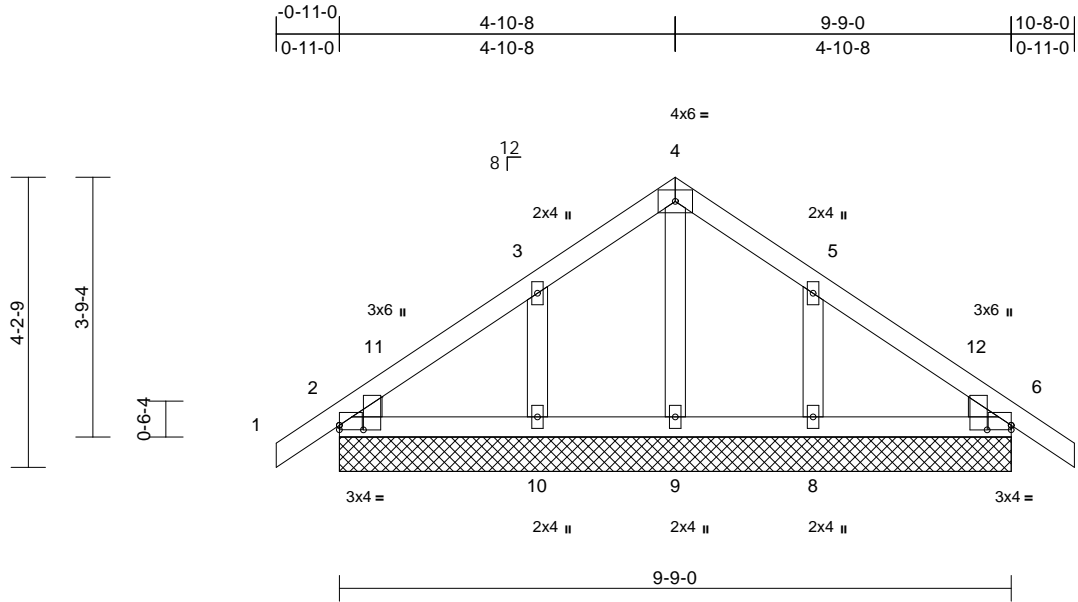

Scale = 1:33.4  
Plate Offsets (X, Y): [2:Edge,0-0-12], [2:0-0-13,0-4-3], [6:Edge,0-0-12], [6:0-0-13,0-4-3]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00	6	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S								
BCDL	10.0											
										Weight: 47 lb	FT = 20%	

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3  
WEDGE Left: 2x4 SP No.2  
Right: 2x4 SP No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 2=9-9-0, 6=9-9-0, 8=9-9-0, 9=9-9-0, 10=9-9-0  
Max Horiz 2=-95 (LC 10)  
Max Uplift 2=-18 (LC 13), 6=-24 (LC 13), 8=-96 (LC 13), 10=-98 (LC 12)  
Max Grav 2=169 (LC 2), 6=169 (LC 2), 8=299 (LC 20), 9=108 (LC 29), 10=299 (LC 19)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/31, 2-3=-94/73, 3-4=-75/83, 4-5=-75/74, 5-6=-69/58, 6-7=0/31  
BOT CHORD 2-10=-30/71, 9-10=-30/71, 8-9=-30/71, 6-8=-30/71  
WEBS 4-9=-81/0, 3-10=-232/125, 5-8=-232/124

**NOTES**  
1) Unbalanced roof live loads have been considered for this design.  
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 2, 24 lb uplift at joint 6, 98 lb uplift at joint 10 and 96 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard




December 27, 2024

Job 4600402	Truss M01	Truss Type Monopitch Supported Gable	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431957
----------------	--------------	---	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:33  
ID:OyuBr1ySihf5ncG97jneHDz45LK-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?#

Page: 1

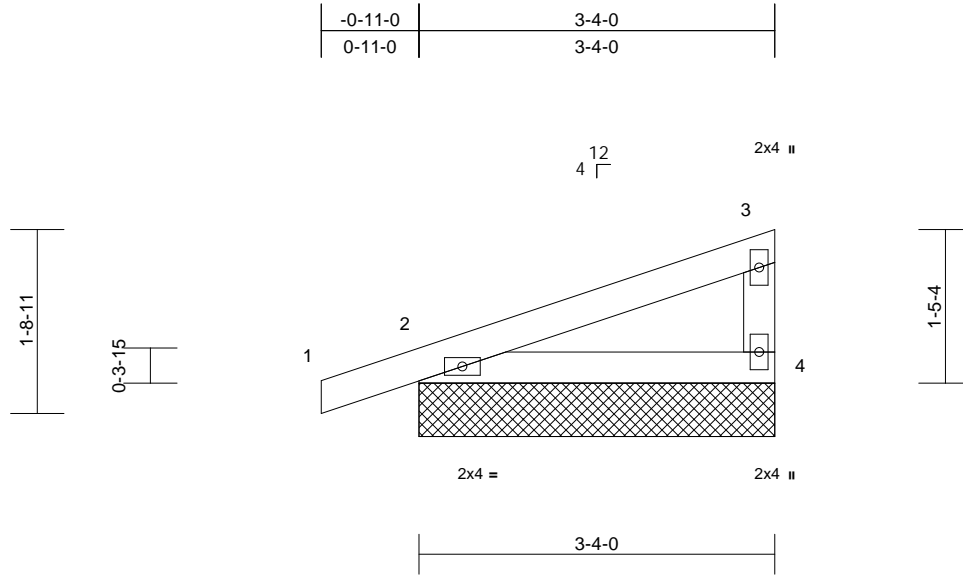

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.12	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-P								
BCDL	10.0											
										Weight: 13 lb	FT = 20%	

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3


**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 3-4-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 2=3-4-0, 4=3-4-0  
Max Horiz 2=56 (LC 8)  
Max Uplift 2=-58 (LC 8), 4=-27 (LC 12)  
Max Grav 2=222 (LC 19), 4=137 (LC 19)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/22, 2-3=-40/27, 3-4=-105/47  
BOT CHORD 2-4=0/0

- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
  - 10) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 4 and 58 lb uplift at joint 2.
  - 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - 6) Gable requires continuous bottom chord bearing.
  - 7) Gable studs spaced at 2-0-0 oc.

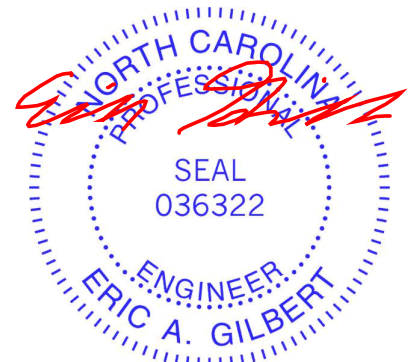

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate


818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss M02	Truss Type Monopitch	Qty 12	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431958
----------------	--------------	-------------------------	-----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:33  
ID:qAetoQinVXDUT12PEfS1k?z45OE-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?F

Page: 1

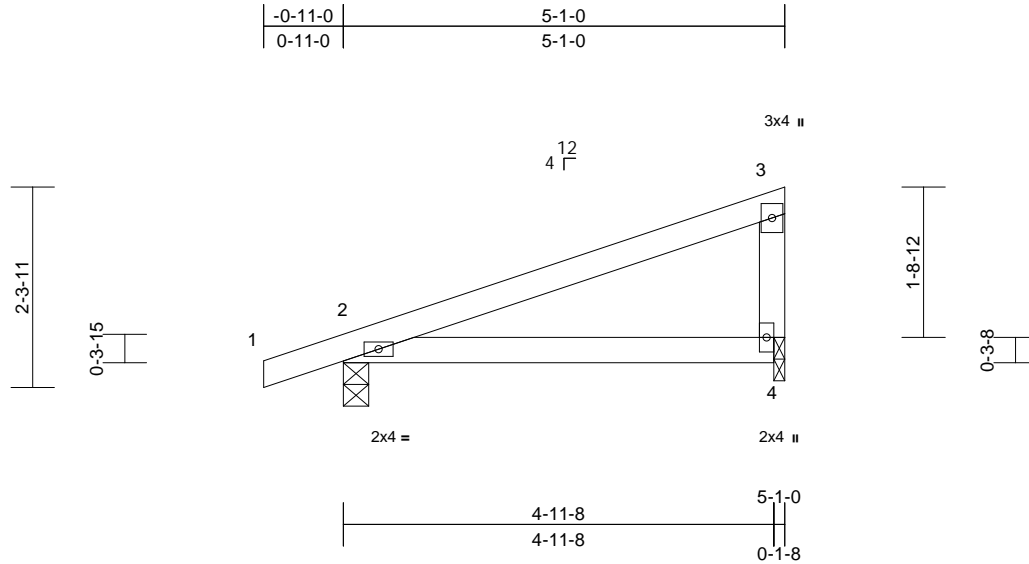

Scale = 1:26.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	-0.01	2-4	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	-0.03	2-4	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-R								
BCDL	10.0											
											Weight: 19 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 5-1-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 2=0-3-8, 4=0-1-8  
Max Horiz 2=79 (LC 8)  
Max Uplift 2=-71 (LC 8), 4=-44 (LC 12)  
Max Grav 2=314 (LC 19), 4=217 (LC 19)

**FORCES**


(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/22, 2-3=-188/3, 3-4=-145/64  
BOT CHORD 2-4=-25/125

**NOTES**

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.

- 7) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - 8) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - 9) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
  - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 2 and 44 lb uplift at joint 4.
  - 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

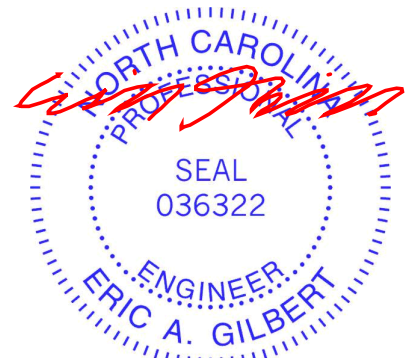

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate


818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss M03	Truss Type Monopitch Supported Gable	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431959
----------------	--------------	---	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:33  
ID:JvG68O7kGldXAPD8nWaEFnz45Nh-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

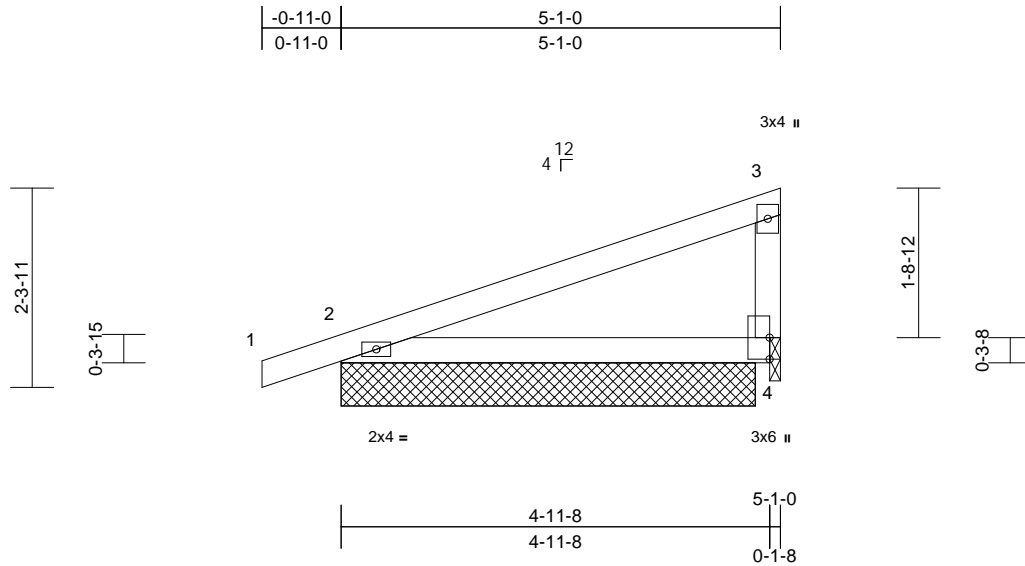

Scale = 1:26.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	-0.01	2-4	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.03	2-4	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-R								
BCDL	10.0										Weight: 19 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 5-1-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 2=4-9-8, 4=0-1-8

Max Horiz 2=79 (LC 8)  
Max Uplift 2=-65 (LC 8), 4=-45 (LC 12)  
Max Grav 2=308 (LC 19), 4=227 (LC 19)

**FORCES** (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/22, 2-3=-199/5, 3-4=-150/66  
BOT CHORD 2-4=-27/136

**NOTES**

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) Gable studs spaced at 2-0-0 oc.

- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- 9) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 10) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 11) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 65 lb uplift at joint 2 and 45 lb uplift at joint 4.
- 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

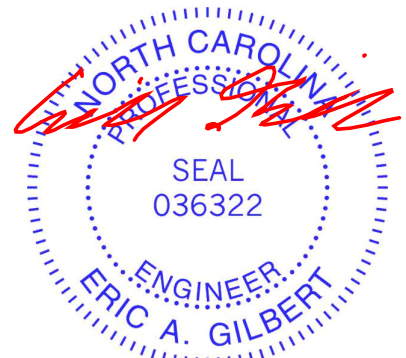

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 4600402	Truss V01	Truss Type Valley	Qty 1	Ply 1	LONGLEAF A - LOT 9 - ILA'S WAY Job Reference (optional)	170431960
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Sep 26 2024 Print: 8.630 S Sep 26 2024 MiTek Industries, Inc. Fri Dec 27 11:54:33  
ID:kIWUUsncYtRseilWxrYurmz45Mr-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrcDoi7J4zJC?f

Page: 1

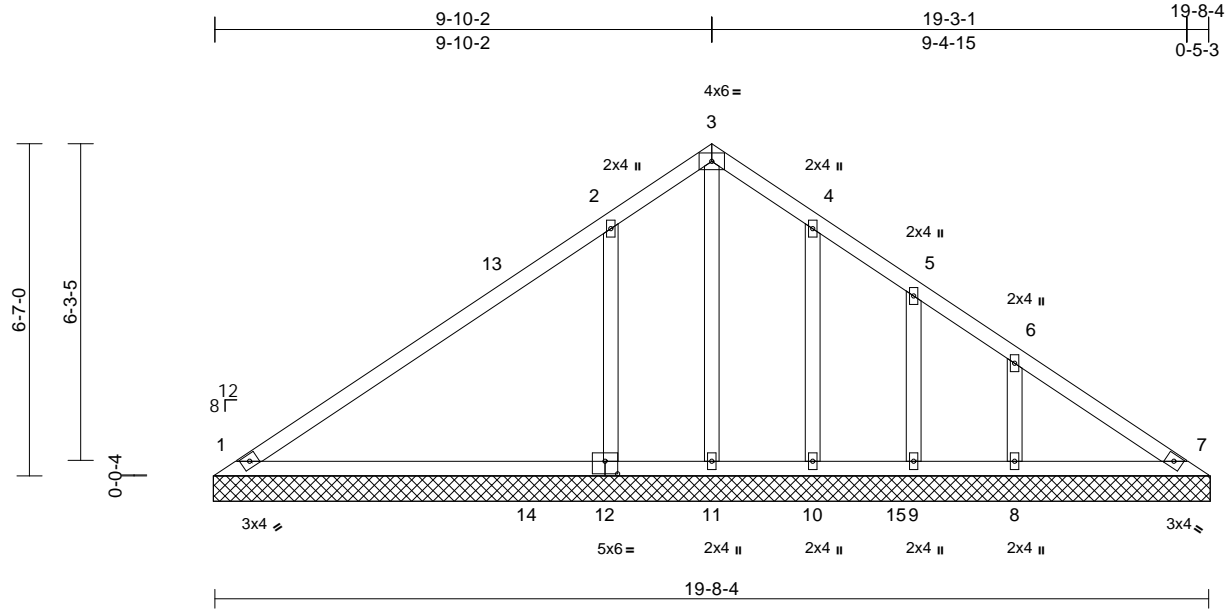

Scale = 1:45.6

Plate Offsets (X, Y): [12:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.45	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.26	Horiz(TL)	0.00	7	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-S								
BCDL	10.0										Weight: 94 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS**

(size) 1=19-9-0, 7=19-9-0, 8=19-9-0, 9=19-9-0, 10=19-9-0, 11=19-9-0, 12=19-9-0  
Max Horiz 1=155 (LC 8)  
Max Uplift 1=-11 (LC 13), 8=-109 (LC 13), 9=-49 (LC 13), 10=-66 (LC 13), 11=-147 (LC 31), 12=-273 (LC 12)  
Max Grav 1=222 (LC 2), 7=112 (LC 32), 8=293 (LC 26), 9=131 (LC 26), 10=298 (LC 6), 11=172 (LC 12), 12=813 (LC 25)

**FORCES**


(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-128/215, 2-3=-128/160, 3-4=-62/126, 4-5=-44/65, 5-6=-49/34, 6-7=-106/96  
BOT CHORD 1-11=-56/123, 10-11=-55/120, 9-10=-55/120, 8-9=-55/120, 7-8=-55/120  
WEBS 3-11=-170/89, 2-12=-533/341, 4-10=-202/100, 5-9=-106/68, 6-8=-216/141

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 1, 147 lb uplift at joint 11, 273 lb uplift at joint 12, 66 lb uplift at joint 10, 49 lb uplift at joint 9 and 109 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

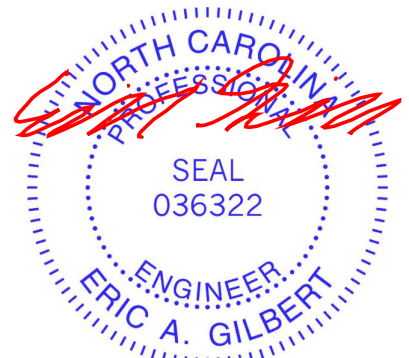

December 27, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

# Symbols


## PLATE LOCATION AND ORIENTATION

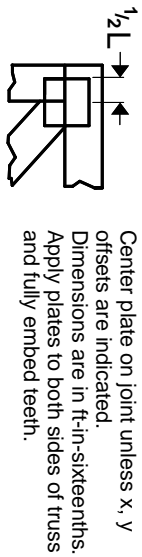

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

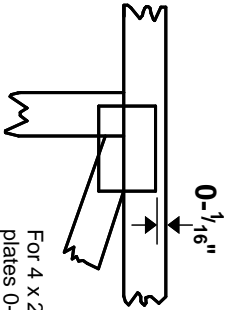

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in MITek software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

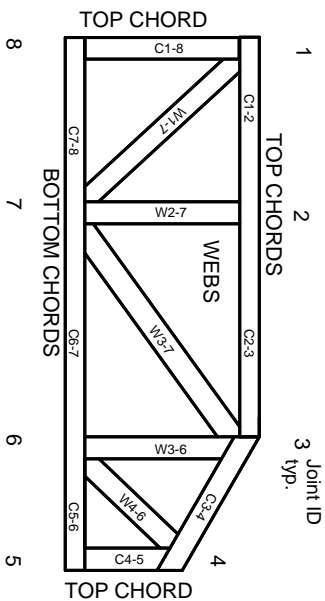

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

**MITek**

ENGINEERING BY  
**TRENGO**  
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.