



BRACKET DETAIL

SCALE: 1" = 1'-0"

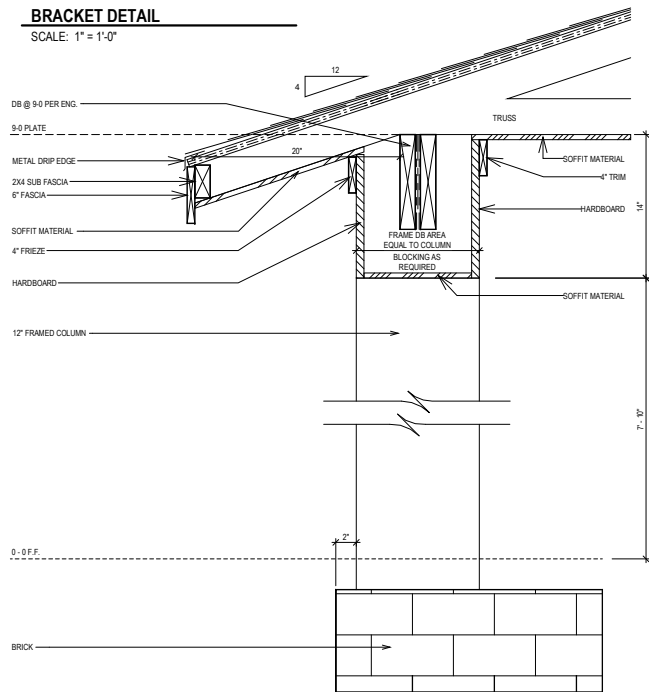

CORNICE DTL.


SCALE: 1" = 1'-0"

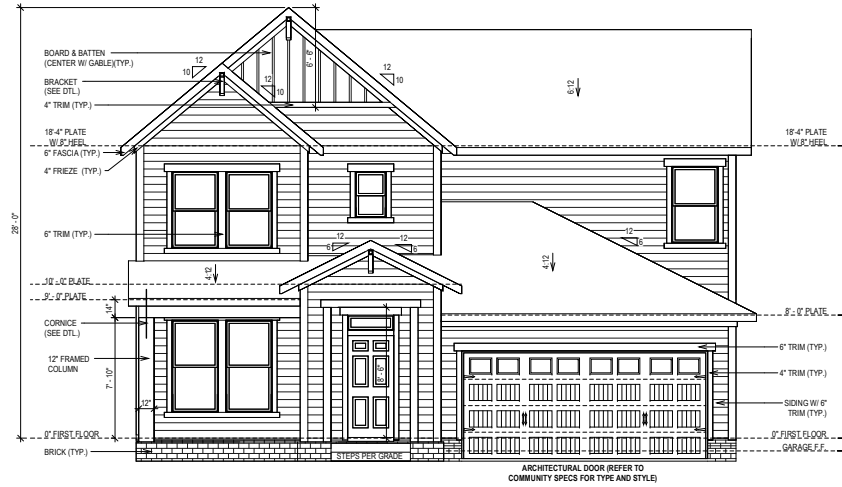


FRONT ELEVATION "B"



REAR ELEVATION "B"

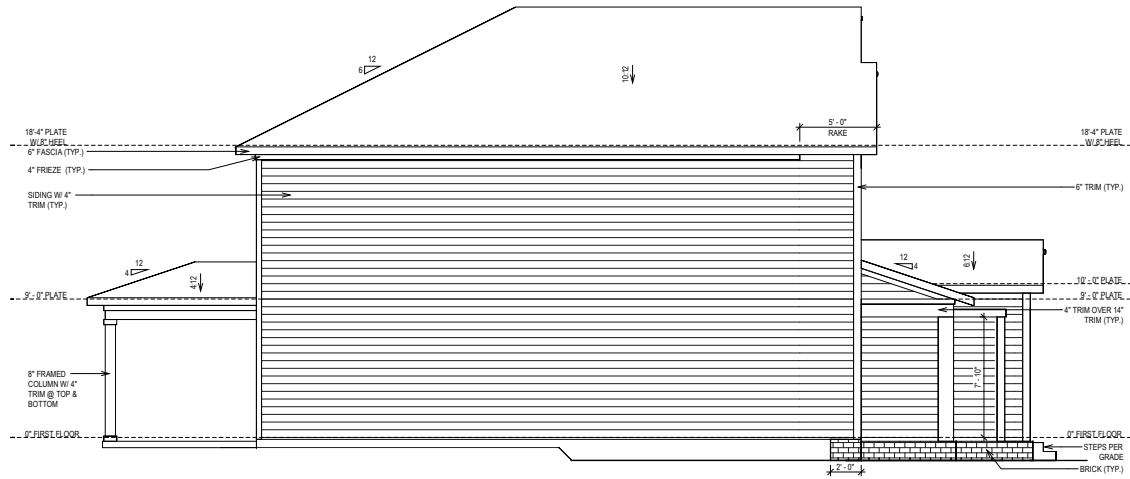

SIDE ELEVATION "B"

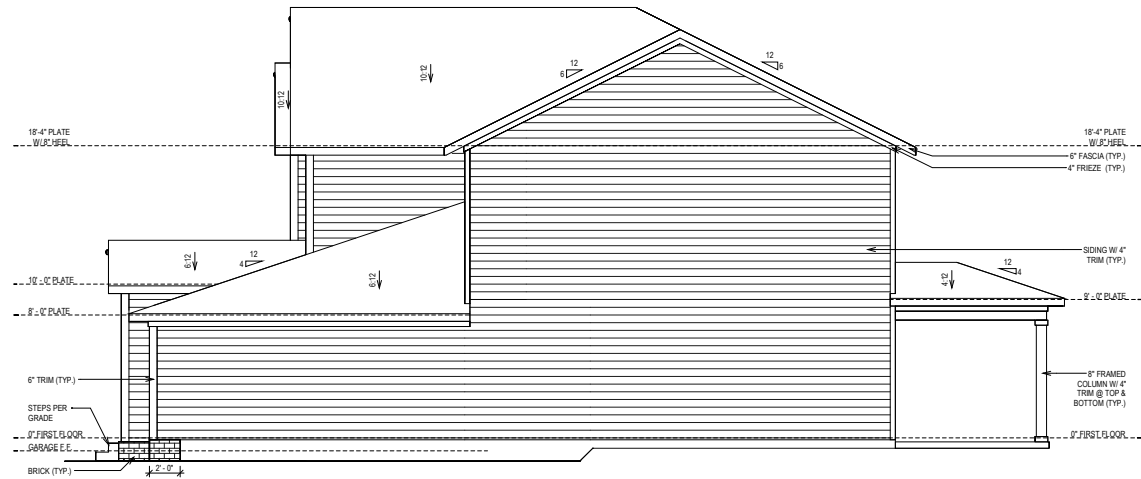

SIDE ELEVATION "B"

© Weekley Homes L.P. 2024
The measurements, dimensions, and other specifications shown on this document are guidelines for construction use only. They are not to be used for legal purposes. The actual construction may vary. This document may not be relied on as a representation of what the completed structure will look like.

David Weekley Homes
P/T/K/S/J/B
Date: 11/25/2024
Scale: 1/8"=1'-0"
Rev: 2/3/25 EB

Proj. No.: 997
Lot: 3294
Job No.: 0997
Block:
Sect:

SERENITY 50'
33 COZY HAVEN
FUQUAY VARINA, NC

NORTH
A669-B
ELV-2
KIPLING
RALEIGH

SHEET INDEX:

S-0	COVER SHEET
S-0.1	GENERAL STRUCTURAL NOTES
S-1	MONOLITHIC SLAB FOUNDATION PLAN
S-2	SECOND FLOOR FRAMING PLAN
S-3	ROOF FRAMING PLAN
SD-1J	BRACED WALL DETAILS
SD-2J	HOLD DOWN DETAILS
SD-3	BRACED WALL NOTES & DETAILS
SD-4	PORTAL FRAME DETAILS
SD-5	MISCELLANEOUS FRAMING DETAILS
SD-6	MISCELLANEOUS FRAMING DETAILS
SD-7	MONOLITHIC SLAB FOUNDATION DETAILS
SD-8	NOT USED
SD-9	NOT USED
SD-10	NOT USED
SD-11	NOT USED
SD-12	ADVANCED FRAMING DETAILS & NOTES



KSE
ENGINEERING

1900 AM DRIVE, SUITE 201, QUAKERTOWN, PA 18951
www.kse-eng.com (215) 804-4449

A669 KIPLING
SERENITY, LOT #997

RALEIGH, NORTH CAROLINA

THESE DRAWINGS ARE TO BE USED IN CONJUNCTION WITH AND COORDINATED WITH THE ARCHITECTURAL, CIVIL, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS. THIS COORDINATION IS NOT THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER OF RECORD (SER). SHOULD ANY DISCREPANCIES BECOME APPARENT, THE CONTRACTOR SHALL NOTIFY KSE ENGINEERING, P.C. BEFORE CONSTRUCTION BEGINS. IT IS THE INTENT OF THE ENGINEER LISTED ON THESE DOCUMENTS THAT THESE DOCUMENTS BE ACCURATE, PROVIDING LICENSED PROFESSIONALS CLEAR INFORMATION. EVERY ATTEMPT HAS BEEN MADE TO PREVENT ERROR. THE BUILDER AND ALL SUBCONTRACTORS ARE REQUIRED TO REVIEW ALL OF THE INFORMATION CONTAINED IN THESE DOCUMENTS PRIOR TO THE COMMENCEMENT OF ANY WORK. THE ENGINEER IS NOT RESPONSIBLE FOR ANY PLAN ERRORS, OMISSIONS, OR MISINTERPRETATIONS UNDETECTED AND NOT REPORTED TO THE ENGINEER PRIOR TO CONSTRUCTION. ALL CONSTRUCTION MUST BE IN ACCORDANCE TO THE INFORMATION FOUND IN THESE DOCUMENTS.

DESIGN SPECIFICATIONS:

DESIGN BUILDING CODE (REFERRED TO HEREIN AS "THE BUILDING CODE"):
• 2018 NORTH CAROLINA RESIDENTIAL CODE. WALL BRACING PER INTERNATIONAL RESIDENTIAL CODE 2015 EDITION.

DESIGN LIVE LOADS:
• ROOF = 20 PSF (LOAD DURATION FACTOR=1.25)
• UNINHABITABLE ATTICS WITH LIMITED STORAGE = 20 PSF (WHERE SPECIFIED ON PLANS)
• HABITABLE ATTICS AND ATTICS SERVED WITH FIXED STAIRS = 30 PSF
• FLOOR = 40 PSF
• FLOOR (SLEEPING AREAS) = 30 PSF
• DECK/BALCONY = 40 PSF
• STAIRS = 40 PSF

DESIGN DEAD LOADS:
• ROOF TRUSS = 17 PSF (TC=7, BC=10)
• FLOOR TRUSS = 15 PSF (TC=10, BC=5)
• FLOOR JOIST = 10 PSF
• STANDARD BRICK = 40 PSF
• QUEEN ANNE BRICK = 25 PSF

NOTE: STRUCTURAL FRAMING HAS NOT BEEN DESIGNED FOR TILE, GRANITE, MARBLE OR OTHER MATERIALS HEAVIER THAN THE ABOVE LOADING UNLESS SPECIFICALLY NOTED ON PLANS.

DESIGN WIND LOADS:
• ULTIMATE WIND SPEED = 115 MPH
• EXPOSURE CATEGORY = B

ASSUMED SOIL BEARING CAPACITY = 2000 PSF

ASSUMED LATERAL SOIL PRESSURE = 45 PCF

FROST DEPTH = 12" MINIMUM

SEISMIC DESIGN CATEGORY = B

ENGINEERED LUMBER SHALL HAVE THE FOLLOWING MINIMUM DESIGN VALUES:
• TJI 210 SERIES (SERIES AND SPACING PER PLANS)
• LSL: E=1,550,000 PSI, F_b=2,325 PSI, F_v=310 PSI, F_c=900 PSI
• LVL: E=2,000,000 PSI, F_b=2,600 PSI, F_v=285 PSI, F_c=750 PSI
• PSL: E=2,100,000 PSI, F_b=2,900 PSI, F_v=290 PSI, F_c=625 PSI



David Weekley Homes
Raleigh, NC

Cover Sheet
Serenity, Lot #997
A669 Kipling Model
115 M.P.H.
Raleigh, North Carolina

Project #: 047-24016
Designed By: LMR
Checked By:
Issue Date: 4/15/25
Re-Issue:
Scale: 1/8"=1'-0" @ 11x17
1/4"=1'-0" @ 22x34

S-0

GENERAL STRUCTURAL NOTES:

- THE DESIGN PROFESSIONAL WHOSE SEAL APPEARS ON THESE DRAWINGS IS THE STRUCTURAL ENGINEER OF RECORD (SER) FOR THIS PROJECT. THE SER BEARS THE RESPONSIBILITY OF THE PRIMARY STRUCTURAL ELEMENTS AND THE PERFORMANCE OF THIS STRUCTURE. NO OTHER PARTY MAY REVISE, ALTER, OR DELETE ANY STRUCTURAL ASPECTS OF THESE CONSTRUCTION DOCUMENTS WITHOUT WRITTEN CONSENT OF KSE ENGINEERING, P.C. OR THE SER. FOR THE PURPOSES OF THESE CONSTRUCTION DOCUMENTS, THE SER AND KSE ENGINEERING SHALL BE CONSIDERED THE SAME ENTITY.
- IF THE STRUCTURE IS ONLY STABLE IN ALL REQUIRED TEMPORARY BRACING DURING CONSTRUCTION TO STABILIZE THE STRUCTURE.
- THE SER IS NOT RESPONSIBLE FOR CONSTRUCTION SEQUENCES, METHODS, OR TECHNIQUES IN CONNECTION WITH THE CONSTRUCTION OF THIS STRUCTURE. THE SER WILL NOT BE HELD RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CONFORM TO THE CONTRACT DOCUMENTS, SHOULD ANY NON-CONFORMITIES OCCUR.
- THE SER DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF GEOMETRY. THE SER ASSUMES NO LIABILITY FOR CHANGES MADE TO THESE PLANS BY OTHERS, OR FOR CONSTRUCTION METHODS, OR FOR ANY DEVIATION FROM THE PLANS. THE SER SHALL BE NOTIFIED PRIOR TO CONSTRUCTION IF ANY DISCREPANCIES ARE NOTED ON THE PLANS.
- ANY STRUCTURAL ELEMENTS OR DETAILS NOT FULLY DEVELOPED ON THE CONSTRUCTION DRAWINGS SHALL BE COMPLETED UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER. THESE SHOP DRAWINGS SHALL BE SUBMITTED TO KSE ENGINEERING FOR REVIEW BEFORE ANY CONSTRUCTION BEGINS. THE SHOP DRAWINGS WILL BE REVIEWED FOR OVERALL COMPLIANCE AS IT RELATES TO THE STRUCTURAL DESIGN OF THIS PROJECT. VERIFICATION OF THE SHOP DRAWINGS FOR DIMENSIONS FOR ACCURACY AND REPORT ANY DISCREPANCIES IS NOT THE RESPONSIBILITY OF THE SER OR KSE ENGINEERING, P.C. VERIFICATION OF ASSUMED FIELD CONDITIONS IS NOT THE RESPONSIBILITY OF THE SER. THE CONTRACTOR SHALL VERIFY THE FIELD CONDITIONS FOR ACCURACY AND REPORT ANY DISCREPANCIES TO KSE ENGINEERING, P.C. BEFORE CONSTRUCTION BEGINS.
- THE SER IS NOT RESPONSIBLE FOR ANY SECONDARY STRUCTURAL ELEMENTS OR NON-STRUCTURAL ELEMENTS, EXCEPT FOR THE ELEMENTS SPECIFICALLY NOTED ON THE STRUCTURAL DRAWINGS. THIS STRUCTURE AND ALL CONSTRUCTION SHALL CONFORM TO ALL APPLICABLE SECTIONS OF THE BUILDING CODE AND ANY LOCAL CODES OR RESTRICTIONS.
- DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS. ALL DIMENSIONS ARE TO FACE OF STUD OR TO FACE OF FRAMING UNLESS OTHERWISE NOTED.
- WATERPROOFING AND FLASHING BY OTHERS.

FOUNDATIONS:

- FOUNDATIONS SHALL BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 4 OF THE BUILDING CODE.
- CONTRACTOR IS SOLELY RESPONSIBLE FOR VERIFYING THE SUITABILITY OF THE SITE SOIL CONDITIONS AT THE TIME OF CONSTRUCTION. THE BUILDER SHALL FURNISH ANY AND ALL REPORTS RECEIVED FROM THE GEOTECHNICAL ENGINEER ON THE STUDY OF THE PROPOSED SITE TO THE DESIGNER, STRUCTURAL ENGINEER, AND GENERAL CONTRACTOR.
- MAXIMUM DEPTH OF UNBALANCED FILL AGAINST MASONRY WALLS TO BE AS SPECIFIED IN THE BUILDING CODE.
- THE SER HAS NOT PERFORMED A SUBSURFACE INVESTIGATION. VERIFICATION OF THE ASSUMED VALUE IS THE RESPONSIBILITY OF THE OWNER OR THE CONTRACTOR. SHOULD ANY ADVERSE SOIL CONDITION BE ENCOUNTERED, THE SER MUST BE CONTACTED BEFORE PROCEEDING.
- THE BOTTOM OF ALL FOOTINGS SHALL EXTEND BELOW THE FROST LINE FOR THE REGION IN WHICH THE STRUCTURE IS TO BE CONSTRUCTED, BUT NOT LESS THAN A MINIMUM OF 12" BELOW GRADE. ALL FOOTINGS TO HAVE A MINIMUM PROJECTION OF 2" ON EACH SIDE OF FOUNDATION WALLS. MAXIMUM FOOTING PROJECTION SHALL NOT EXCEED THE THICKNESS OF THE FOOTING.
- WOOD SILL PLATES SHALL BE ANCHORED TO THE FOUNDATION WITH $\frac{1}{2}$ " ANCHOR BOLTS WITH MINIMUM 7" EMBEDMENT, SPACED A MAXIMUM OF 6'-0" O.C. INSTALL MINIMUM 2 ANCHOR BOLTS PER SECTION, 12" MAXIMUM FROM CORNERS. $\frac{1}{2}$ " DIAMETER x 8' LONG SIMPSON TITEN HD OR USP SCREW-BOLTS+ SCREWS MAY BE SUBSTITUTED ON A 1 FOR 1 BASIS FOR CONCRETE FOUNDATIONS ONLY.
- ANY FILL SHALL BE PLACED UNDER THE DIRECTION OR RECOMMENDATION OF A LICENSED PROFESSIONAL ENGINEER. THE RESULTING SOIL SHALL BE COMPACTED TO A MINIMUM OF 95% MAXIMUM DRY DENSITY.
- EXCAVATIONS OF FOOTINGS SHALL BE LINED TEMPORARILY WITH A 6 MIL POLYETHYLENE MEMBRANE IF PLACEMENT OF CONCRETE DOES NOT OCCUR WITHIN 24 HOURS OF EXCAVATION.
- NO CONCRETE SHALL BE PLACED AGAINST ANY SUBGRADE CONTAINING WATER, ICE, FROST, OR LOOSE MATERIAL.
- PROVIDE FOUNDATION WATERPROOFING AND DRAIN WITH POSITIVE SLOPE TO OUTLET AS REQUIRED BY SITE CONDITIONS (SEE ARCHITECTURAL PLANS AND DETAILS).
- NONE OF THE FOUNDATION DESIGN OR THESE DOCUMENTS ARE SUITABLE FOR INSTALLATION IN SHRINK/SWELL CONDITIONS. REFER TO GEOTECHNICAL ENGINEER FOR APPROPRIATE DESIGN.
- LOTS SHALL BE GRADED TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALL. GRADE SHALL FALL A MINIMUM OF 6 INCHES WITHIN THE FIRST TEN FEET.
- CRAWL SPACE TO BE GRADED LEVEL AND CLEAR OF ALL DEBRIS.
- PROVIDE MINIMUM 6 MIL APPROVED VAPOR BARRIER. ALL JOINTS TO BE LAPPED MINIMUM 12" AND SEALED.

CONCRETE & REINFORCING

- CONCRETE DESIGN BASED ON ACI 318 AND ACI 318.1R OR ACI 332. CONCRETE SHALL HAVE A NORMAL WEIGHT AGGREGATE AND A MINIMUM COMPRESSIVE STRENGTH (f'_c) = 3,000 PSI MINIMUM AT 28 DAYS PER CODE (VARIES w/ WEATHER), UNLESS OTHERWISE NOTED ON THE PLAN.
- CONCRETE SHALL BE PROPORTIONED, MIXED, AND PLACED IN ACCORDANCE WITH THE LATEST EDITIONS OF ACI 318: "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" AND ACI 301: "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS".
- AIR ENTRAINMENT CONCRETE MUST BE USED FOR ALL STRUCTURAL ELEMENTS EXPOSED TO FREEZE/THAW CYCLES AND DEICING CHEMICALS. AIR ENTRAINMENT AMOUNTS (IN PERCENT) SHALL BE WITHIN -1% TO +2% OF 5% FOR FOOTINGS AND EXTERIOR SLABS.
- NO ADMIXTURES SHALL BE ADDED TO ANY STRUCTURAL CONCRETE WITHOUT WRITTEN PERMISSION OF THE SER. WATER ADDED TO CONCRETE ON SITE SHALL NOT EXCEED THAT ALLOWED BY THE MIX DESIGN.
- CONCRETE SLABS-ON-GRADE SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 302.1R: "GUIDE FOR CONCRETE SLAB AND SLAB CONSTRUCTION".
- CONTROL OR SAW CUT JOINTS (OUT OR TOOLED) SHALL BE SPACED IN INTERIOR SLABS-ON-GRADE AT A MAXIMUM OF 15'-0" O.C. AND IN EXTERIOR SLABS-ON-GRADE AT A MAXIMUM OF 10'-0" UNLESS OTHERWISE NOTED. CARE SHALL BE TAKEN TO AVOID RE-ENTRANT CORNERS.
- CONTROL OR SAW CUT JOINTS SHALL BE PRODUCED USING CONVENTIONAL CUT OR TOOLED PROCESSES WITHIN 4 TO 12 HOURS AFTER THE SLAB HAS BEEN FINISHED.
- REINFORCING STEEL MAY EXTEND THROUGH A SAW CUT JOINT.
- ALL WELDED WIRE FABRIC (W.W.F.) FOR CONCRETE SLABS-ON-GRADE SHALL BE PLACED AT MID-DEPTH OF SLAB. THE W.W.F. SHALL BE SECURELY SUPPORTED DURING THE CONCRETE POUR. FIBROUS CONCRETE REINFORCEMENT, OR POLYPROPYLENE FIBERS MAY BE USED IN LIEU OF W.W.F. APPLICATION OF POLYPROPYLENE FIBERS PER CUBIC YARD OF CONCRETE SHALL BE PER MANUFACTURER AND COMPLY WITH ASTM C1116. ANY LOCAL BUILDING CODE REQUIREMENTS AND SHALL MEET OR EXCEED CURRENT INDUSTRY STANDARD.
- POLYPROPYLENE REINFORCING TO BE 100% VIRGIN, CONTAINING NO REPROCESSSED OLEFIN MATERIALS AND SPECIFICALLY MANUFACTURED FOR USE AS CONCRETE SECONDARY REINFORCEMENT.
- STEEL REINFORCING BARS SHALL BE NEW BILLET STEEL CONFORMING TO ASTM A615, GRADE 60.
- DETAILING, FABRICATION, AND PLACEMENT OF REINFORCING STEEL SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF ACI 318: "MANUAL OF STANDARD PRACTICE FOR DETAILING CONCRETE STRUCTURES".
- HORIZONTAL FOOTING AND WALL REINFORCEMENT SHALL BE CONTINUOUS AND SHALL HAVE 90° BENDS, OR CORNER BARS WITH THE SAME SIZE/SPACING AS THE HORIZONTAL REINFORCEMENT.
- PROVIDE REINFORCEMENT LAP AS NOTED BELOW, UNLESS NOTED OTHERWISE:
#4 BARS = 30" LENGTH
#5 BARS = 38" LENGTH
#6 BARS = 45" LENGTH
- WHERE REINFORCING DOWELS ARE REQUIRED, THEY SHALL BE EQUIVALENT IN SIZE AND SPACING TO THE VERTICAL REINFORCEMENT. THE DOWEL SHALL EXTEND 48 BAR DIAMETERS VERTICALLY AND 20 BAR DIAMETERS INTO THE FOOTING. SEE KSE FOUNDATION DETAILS.
- WHERE FOOTING BOTTOMS ARE TO BE STEPPED AT SLOPING GRADE CONDITIONS, PROVIDE CONTINUOUS REINFORCING WITH Z BARS (TO MATCH FOOTING REINFORCING) AS REQUIRED.
- BAR SUPPORT ACCESSORIES SHALL BE PROVIDED IN ACCORDANCE WITH THE LATEST ACI MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES, EXCEPT THAT REINFORCING SHALL BE CHAINED ON THE BOTTOM AND/OR THE SIDES ON BOLSTERS SPACED NOT MORE THAN 4 FEET ON CENTER. NO ROCKS, CMU, CLAY TILE, OR BRICK SHALL BE USED TO SUPPORT REINFORCING.
- FOR GRADE SUPPORTED SLABS, SLAB REINFORCING SHALL BE HELD IN PLACE BY BAR SUPPORTS AND ACCESSORIES AS DESCRIBED IN THE CRSI MANUAL OF STANDARD PRACTICE. BAR SUPPORTS SHALL BE SPACED A MAXIMUM OF 4'-0" O.C. BOTH WAYS IN STRAIGHT LINES ON THE MESH GRID.

MASONRY

- ALL MASONRY SHALL CONFORM TO ASTM C-90, $F_m=1500$ PSI. ALL BRICK SHALL CONFORM TO ASTM C-216, $F_m=1500$ PSI. ALL MORTAR SHALL BE TYPE 'S' (TYPE 'M' BELOW GRADE) AND CONFORM TO ASTM C-270. COARSE GROUT SHALL CONFORM TO ASTM C-476 WITH A MAXIMUM AGGREGATE SIZE OF $\frac{1}{8}$ " AND A MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
- ALL MASONRY WORK SHALL BE IN ACCORDANCE WITH "BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES" ACI 530/ASCE 5/TMS 402 AND "SPECIFICATIONS FOR MASONRY STRUCTURES" ACI 530.1/ ASCE 6/TMS 602.
- THE UNSUPPORTED HEIGHT OF SOLID MASONRY PIERS SHALL NOT EXCEED TEN TIMES THEIR LEAST DIMENSION. UNFILLED HOLLOW PIERS MAY BE USED IF THE UNSUPPORTED HEIGHT IS NOT MORE THAN FOUR TIMES THEIR LEAST DIMENSION.
- EACH CRAWL SPACE PIER SHALL BEAR IN THE MIDDLE THIRD OF ITS RESPECTIVE FOOTING. EACH PIER SHALL BEAR IN THE MIDDLE THIRD OF THE PIERS. PLASTERERS TO BE BONDED TO PERIMETER FOUNDATION WALL.
- TOP COURSE OF MASONRY SHALL BE GROUTED SOLID.
- HORIZONTAL WALLS SHALL BE REINFORCED WITH STANDARD 9 GAGE GALVANIZED LADDER OR TRUSS TYPE SPACED AT 16" O.C., UNLESS SHOWN OTHERWISE ON THE DRAWINGS.
- SPICED WIRE REINFORCEMENT SHALL BE LAPPED AT LEAST 6" AND CONTAIN AT LEAST ONE CROSS WIRE OF EACH PIECE OF REINFORCEMENT WITHIN THE 6" LAP WITH STANDARD 'I' AND 'L' SHAPED PIECES AT INTERSECTIONS AND CORNERS.

WOOD FRAMING:

- SOLID SAWN WOOD FRAMING MEMBERS SHALL CONFORM TO THE SPECIFICATIONS LISTED IN THE LATEST EDITION OF THE "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION" (NDS). UNLESS OTHERWISE NOTED, ALL WOOD FRAMING MEMBERS ARE DESIGNED TO BE: SPRUCE-PINE-FIR (SPF) WITH THE FOLLOWING MINIMUM DESIGN VALUES:
 $E=1,400,000$ PSI, $F_u=875$ PSI, $F_v=135$ PSI
1.1. FRAMING: SPF #2.
1.2. PLATES: SPF #2.
1.3. STUDS: SPF STUD GRADE.
- ALL LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH CONCRETE SHALL BE PRESERVATIVE TREATED SOUTHERN YELLOW PINE #2 OR BETTER.
- ANCHOR SILL PLATES IN ACCORDANCE w/ GENERAL STRUCTURAL NOTES.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY BE SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION.
- NAILS SHALL BE COMMON WIRE NAILS UNLESS OTHERWISE NOTED.
- BOLT HOLES AND LEAD HOLES FOR LAG SCREWS SHALL BE IN ACCORDANCE WITH NDS SPECIFICATIONS.
- INDIVIDUAL STUDS FORMING A COLUMN SHALL BE ATTACHED WITH (2) ROWS 10d NAILS @ 6" O.C. STAGGERED. THE STUD COLUMN SHALL BE FULLY BLOCKED AT ALL FLOOR LEVELS TO ENSURE PROPER LOAD TRANSFER. WALL SHEATHING SHALL BE NAILED TO EDGE OF EACH STUD. FACE NAIL, ALL MULTI-PLY BEAMS AND HEADERS WITH (2) ROWS 16d COMMON NAILS @ 16" O.C. STAGGERED. OR PER MANUFACTURER'S SPECIFICATIONS FOR ENGINEERED LUMBER, APPLY NAILING FROM BOTH FACES FOR (3) OR MORE PLYS.
- FASTEN 4-PLY BEAMS WITH (1) $\frac{1}{2}$ " DIAMETER THROUGH BOLT w/ NUT WASHERS AT 12" O.C. STAGGERED TOP AND BOTTOM, $\frac{1}{2}$ " MINIMUM EDGE SPACING. (UNLESS OTHERWISE NOTED).
- ALL BEAMS AND HEADERS SHALL HAVE (1)2x JACK STUD & (1)2x KING STUD UNLESS OTHERWISE NOTED. THE NUMBER OF STUDS INDICATED ON PLANS ARE THE TOTAL NUMBER OF JACK STUDS REQUIRED, UNLESS OTHERWISE NOTED.
- PROVIDE KING STUDS AT EACH END OF HEADERS AS NOTED BELOW.
16" O.C. STUD SPACING:
(1) STUD UP TO 3' OPENING
(2) STUDS UP TO 4' OPENING
(3) STUDS UP TO 8' OPENING
(4) STUDS UP TO 12' OPENING
(5) STUDS UP TO 16' OPENING
- ALL BEAMS TO BE CONTINUOUSLY SUPPORTED LATERALLY AND SHALL BEAR FULL WIDTH ON THE SUPPORTING WALLS OR COLUMNS INDICATED WITH A MINIMUM OF TWO STUDS, UNLESS OTHERWISE NOTED. ALL BEAM SPICES SHALL OCCUR OVER SUPPORTS.
- SOLID BLOCKING TO BE PROVIDED AT ALL POINT LOADS THROUGH FLOOR LEVELS TO THE FOUNDATION OR TO OTHER STRUCTURAL COMPONENTS.
- ALL LUMBER SPECIFIED ON DRAWINGS IS INTENDED FOR DRY USE ONLY (MOISTURE CONTENT <19%). UNLESS OTHERWISE NOTED.
- ALL WATERPROOFING AND FIRE SAFETY SYSTEMS ARE THE RESPONSIBILITY OF THE CONTRACTOR AND ARE TO BE DESIGNED AND DETAILED BY OTHERS.
- ANY WOOD FRAME INTERIOR BEARING WALL STUDS THAT HAVE HOLES IN THE CENTER OF THE STUD UP TO 1" DIAMETER SHALL HAVE STUD PROTECTION SHIELDS. ALL HOLES OVER 1" IN DIAMETER FOR PLUMBING LINES, ETC. SHALL BE REPAIRED WITH SIMPSON HSS2 OR USP ST1 STUD SHOES, TYPICAL, UNLESS OTHERWISE NOTED.
- BEARING WALLS SHALL BE SHEATHED ON NOT LESS THAN ONE SIDE WITH OSB OR GYPSUM BOARD. BRIDGING SHALL BE INSTALLED NOT GREATER THAN 4 FEET APART MEASURED VERTICALLY FROM EITHER END OF THE STUD IN LIEU OF SHEATHING.

EXTERIOR WOOD FRAMED DECKS:

- DECKS ARE TO BE FRAMED IN ACCORDANCE WITH APPLICABLE BUILDING CODES AND AS REFERENCED ON THE STRUCTURAL PLANS, EITHER THROUGH CODE REFERENCES OR CONSTRUCTION DETAILS.
- PRESERVATIVE TREATED WOOD FRAMING TO BE SOUTHERN YELLOW PINE #2 OR BETTER.
- GUARD RAILS AND LATERAL BRACING IS REQUIRED AT DECKS. DESIGN BY OTHERS.
- PROVIDE DECK LATERAL LOAD CONNECTIONS PER BUILDING CODE.

RAFTER FRAMED ROOF CONSTRUCTION:

- PROVIDE 2x4x4'-0" RAFTER TIES AT 48" O.C.
- RAFTERS SHALL BE SUPPORTED BY PURLINS AND PURLIN BRACES AS SHOWN ON THE PLAN. PURLIN BRACES SHALL NOT BEAR ON ANY CEILING JOIST, STRONGBACK OR HEADER UNLESS SPECIFICALLY SHOWN ON PLAN. RAFTERS MAY BE SPICED AT PURLIN LOCATIONS.
- CEILING JOISTS SHALL HAVE LATERAL SUPPORT w/ 1x4 PLAT BRACING ON TOP EDGE OF JOIST AT LOOSE JOIST ENDS (WHERE JOISTS NOT FASTENED TO RAFTERS) OR FULL DEPTH BLOCKING.
- FASTEN END OF BRACING TO RAFTER OR CABLE END FRAMING.
- FASTEN RAFTER AND CEILING JOIST WITH (6) 12d NAILS UNLESS OTHERWISE NOTED.
- PROVIDE VERTICAL 2x6 STRONGBACKS AT CEILING JOISTS @ 8'-0" O.C. TIE STRONGBACK ENDS TO CABLE STUDS OR RAFTERS WHERE POSSIBLE. PROVIDE BLOCKING BETWEEN TOP PLATES AND STRONGBACKS. PROVIDE 2x4 PLAT FASTENED TO EACH JOIST WITH (2) 12d NAILS. FASTEN STRONGBACK TO 2x4 PLAT WITH 12d NAILS @ 12" O.C. AND FASTENED TO EACH JOIST WITH (1) 12d TONENAIL.
- CEILING JOISTS SHALL BE FASTENED TO RAFTERS WITH (2) 12d NAILS.

WOOD TRUSSES (FLOOR & ROOF):

- THE WOOD TRUSS MANUFACTURER/FABRICATOR IS RESPONSIBLE FOR THE DESIGN OF THE WOOD TRUSSES. SUBMIT SEALED SHOP DRAWINGS AND SUPPORTING CALCULATIONS TO THE SER FOR REVIEW PRIOR TO FABRICATION. THE SER SHALL HAVE A MINIMUM OF (5) DAYS FOR REVIEW. THE REVIEW BY THE SER SHALL BE FOR OVERALL COMPLIANCE OF THE DESIGN DOCUMENTS. THE SER SHALL ASSUME NO RESPONSIBILITY FOR THE CORRECTNESS OF THE STRUCTURAL DESIGN FOR THE WOOD TRUSSES.
- THE WOOD TRUSSES SHALL BE DESIGNED FOR ALL REQUIRED LOADINGS AS SPECIFIED IN THE LOCAL BUILDING CODE, THE ASCE STANDARD "MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES" (ASCE 7), AND THE LOADING REQUIREMENTS SHOWN ON THESE SPECIFICATIONS. THE TRUSS DRAWINGS SHALL BE COORDINATED WITH ALL OTHER CONSTRUCTION DOCUMENTS AND PROVISIONS PROVIDED FOR LOADS SHOWN ON THESE DRAWINGS INCLUDING BUT NOT LIMITED TO HVAC EQUIPMENT, PIPING, AND ARCHITECTURAL FIXTURES ATTACHED TO THE TRUSSES.
- THE TRUSSES SHALL BE DESIGNED, FABRICATED, AND ERECTED IN ACCORDANCE WITH THE LATEST EDITION OF THE ANSI/TPI 1: "NATIONAL DESIGN STANDARD FOR METAL PLATE CONNECTED WOOD TRUSS CONSTRUCTION".
- THE TRUSS MANUFACTURER SHALL PROVIDE ADEQUATE BRACING INFORMATION IN ACCORDANCE WITH "BUILDING COMPONENT SAFETY INFORMATION GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING, RESTRAINING & BRACING OF METAL PLATE CONNECTED WOOD TRUSSES" (BCS). THIS BRACING, BOTH TEMPORARY AND PERMANENT, SHALL BE SHOWN ON THE SHOP DRAWINGS. ALSO, THE SHOP DRAWINGS SHALL SHOW THE REQUIRED ATTACHMENTS FOR THE TRUSSES.
- THE CONTRACTOR IS RESPONSIBLE FOR INSTALLING TEMPORARY BRACING AND SHORING FOR THE FLOOR AND ROOF TRUSSES AS REQUIRED DURING CONSTRUCTION. AT A MINIMUM, CONTRACTOR SHALL FOLLOW THE REQUIREMENTS OF THE LATEST BCSS. THE CONTRACTOR SHALL KEEP A COPY OF THE BCSS SUMMARY SHEETS ON SITE.
- THE CONTRACTOR IS RESPONSIBLE FOR INSTALLING ALL PERMANENT TRUSS BRACING SHOWN IN THE STRUCTURAL DRAWINGS AND IN THE TRUSS DESIGNS. ALL CONTINUOUS LATERAL BRACING OF WEBS REQUIRES BRACES. REFER TO BCSS SUMMARY SHEET B3 FOR TYPES OF DIAGONAL BRACES TO PROVIDE AT EACH CONTINUOUS LATERAL BRACE LINE. SUCH DIAGONAL BRACES SHALL NOT BE SPACED MORE THAN 20 FEET O.C. DIAGONAL BRACES SHALL BE FASTENED TO EACH TRUSS WEB WITH A MINIMUM OF TWO 10d FACE NAILS. WHERE CONTINUOUS LATERAL BRACING CANNOT BE INSTALLED, DUE TO A MINIMUM OF THREE ADJACENT TRUSSES NOT BEING IDENTICAL, THE CONTRACTOR SHALL COORDINATE WITH THE TRUSS SPECIALTY ENGINEER/MANUFACTURER TO DETERMINE WHAT TYPE OF ALTERNATE BRACE (I.E., T OR L BRACE, ETC.) IS REQUIRED.
- ANY CHORDS OR TRUSS WEBS SHOWN ON THESE DRAWINGS HAVE BEEN SHOWN AS A REFERENCE ONLY. THE FINAL DESIGN OF THE TRUSSES SHALL BE THE MANUFACTURER.
- TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO CONCORD WITH THE SUPPORT LOCATIONS SHOWN ON THE SEALED STRUCTURAL DRAWINGS. TRUSS PROFILES TO BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL DRAWINGS.
- THE TRUSS MANUFACTURER TO PROVIDE REQUIRED UPLIFT CONNECTORS FOR ALL TRUSSES.
- PROVIDE SIMPSON H25A, USP RT7 OR EQUIVALENT AT EACH TRUSS TO TOP PLATE CONNECTION, UNLESS OTHERWISE NOTED.

WOOD STRUCTURAL PANELS:

- FABRICATION AND PLACEMENT OF STRUCTURAL WOOD SHEATHING SHALL BE IN ACCORDANCE WITH THE APA DESIGN/CONSTRUCTION GUIDE "RESIDENTIAL AND COMMERCIAL," AND ALL OTHER APPLICABLE APA STANDARDS.
- ALL STRUCTURALLY REQUIRED WOOD SHEATHING SHALL BEAR THE MARK OF THE APA.
- WOOD WALL SHEATHING SHALL COMPLY WITH THE REQUIREMENTS OF LOCAL BUILDING CODES FOR THE APPROPRIATE STATE AS INDICATED ON THESE DRAWINGS. REFER TO WALL BRACING NOTES IN PLAN SET FOR MORE INFORMATION. EXTERIOR WALLS TO BE FULLY SHEATHED USING $\frac{1}{4}$ " OSB MINIMUM. AT BRACED WALL PANELS, PROVIDE BLOCKING AT ALL SHEET EDGES NOT FALLING ON STUDS OR PLATES.
- ROOF SHEATHING SHALL BE APA RATED SHEATHING EXPOSURE 1 OR 2. ROOF SHEATHING SHALL BE CONTINUOUS OVER TWO SUPPORTS MINIMUM AND ATTACHED TO ITS SUPPORTING ROOF FRAMING WITH 8d NAIL AT 6" O.C. AT PANEL EDGES AND AT 12" O.C. IN PANEL FIELD UNLESS OTHERWISE NOTED ON THE PLANS. SHEATHING SHALL BE APPLIED WITH THE LONG DIRECTION PERPENDICULAR TO FRAMING. SHEATHING SHALL HAVE A SPAN RATING CONSISTENT WITH THE FRAMING SPACING. PROVIDE SUITABLE EDGE SUPPORT BY USE OF PLYWOOD CLIPS OR LUMBER BLOCKING UNLESS OTHERWISE NOTED. PANEL END JOINTS SHALL OCCUR OVER FRAMING. ROOF SHEATHING TO BE $\frac{1}{4}$ " OSB MINIMUM.
- WOOD FLOOR SHEATHING SHALL BE APA RATED SHEATHING EXPOSURE 1 OR 2. ATTACH SHEATHING TO ITS SUPPORTING FRAMING WITH (1) 10d NAIL AT 6" O.C. AT PANEL EDGES AND AT 12" O.C. IN PANEL FIELD UNLESS OTHERWISE NOTED ON THE PLANS. SHEATHING SHALL BE APPLIED PERPENDICULAR TO FRAMING. SHEATHING SHALL HAVE A SPAN RATING CONSISTENT WITH THE FRAMING SPACING. PROVIDE SUITABLE EDGE SUPPORT BY USE OF T&G PLYWOOD OR LUMBER BLOCKING UNLESS OTHERWISE NOTED. PANEL END JOINTS SHALL OCCUR OVER FRAMING.
- SHEATHING SHALL HAVE A $\frac{1}{8}$ " GAP AT PANEL ENDS AND EDGES AS RECOMMENDED IN ACCORDANCE WITH THE APA.

STRUCTURAL FIBERBOARD PANELS:


- STRUCTURAL FIBERBOARD SHEATHING SHALL ONLY BE USED WHERE SPECIFICALLY NOTED ON THE STRUCTURAL PLANS.
- FABRICATION AND PLACEMENT OF STRUCTURAL FIBERBOARD SHEATHING SHALL BE IN ACCORDANCE WITH THE APPLICABLE AFA STANDARDS.
- FIBERBOARD WALL SHEATHING SHALL COMPLY WITH THE REQUIREMENTS OF LOCAL BUILDING CODES FOR THE APPROPRIATE STATE AS INDICATED ON THESE DRAWINGS. REFER TO WALL BRACING NOTES IN PLAN SET FOR MORE INFORMATION.
- SHEATHING SHALL HAVE A $\frac{1}{8}$ " GAP AT PANEL ENDS AND EDGES AS RECOMMENDED IN ACCORDANCE WITH THE AFA.

STRUCTURAL STEEL:

- STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDANCE WITH THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION "CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES" AND OF THE MANUAL OF STEEL CONSTRUCTION "LOAD RESISTANCE FACTOR DESIGN" LATEST EDITIONS.
- ALL STEEL SHALL HAVE A MINIMUM YIELD STRESS (F_y) OF 50 KSI UNLESS OTHERWISE NOTED.
- WELDING SHALL CONFORM TO THE LATEST EDITION OF THE AMERICAN WELDING SOCIETY'S STRUCTURAL WELDING CODE AWS D1.1. ELECTRODES FOR SHOP AND FIELDING WELDING SHALL BE CLASS E70XX. ALL WELDING SHALL BE PERFORMED BY A CERTIFIED WELDER PER THE AISC STANDARD.
- ALL STEEL BEAMS TO BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF $3\frac{1}{2}$ " AND FULL FLANGE WIDTH UNLESS OTHERWISE NOTED. BEAMS MUST BE ATTACHED AT EACH END WITH A MINIMUM OF FOUR 16d NAILS OR (2) $\frac{1}{2}$ " x 4" LAG SCREWS UNLESS OTHERWISE NOTED.
- INSTALL 2x WOOD PLATE ON TOP OF STEEL BEAMS, RIPPED TO MATCH BEAM WIDTH. FASTEN PLATE TO BEAM w/ HILTI X-DIM 52 P8 PINS AT 12" O.C. STAGGERED OR $\frac{1}{2}$ " DIAMETER BOLTS AT 24" O.C.

MECHANICAL FASTENERS:

- ALL METAL HARDWARE AND FASTENERS TO BE SIMPSON STRONG-TIE OR APPROVED EQUIVALENT.
- ALL HARDWARE AND FASTENERS IN CONTACT WITH PRESERVATIVE TREATED LUMBER SHALL BE HOT DIPPED GALVANIZED IN ACCORDANCE WITH ASTM A 153, G-185.
- MANY OF THE NEW PRESURE TREATED WOODS USE CHEMICALS THAT ARE CORROSIVE TO STEEL. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE TYPE OF WOOD TREATMENT AND SELECT APPROPRIATE CONNECTORS THAT WILL RESIST THE APPLICABLE CORROSIVE CHEMICALS.



BRICK VENEER LINTEL SCHEDULE			
SPAN	LINTEL SIZE	END BEARING	
UP TO 3'-0"	$3\frac{1}{2}$ " x $3\frac{1}{2}$ "	4"	
UP TO 6'-3"	$5\frac{1}{2}$ " x $3\frac{1}{2}$ "	LL.V. 8"	
UP TO 9'-6"	$6\frac{1}{2}$ " x $3\frac{1}{2}$ "	LL.V. 12"	

LINTELS ARE NOT DESIGNED TO BE BOLTED TO HEADERS UNLESS SPECIFIED ON UNIT PLANS.
SPANS OVER 4'-0" SHALL BE SHORED UP UNTIL CURED.

General Structural Notes

Serenity, Lot #997

A669 Kipling Model

115 M.P.H.

Raleigh, North Carolina


Project #: 047-24016
Designed By: LMR
Checked By:
Issue Date: 4/15/25
Re-Issue:

Scale: 1/8"=1'-0" @ 11x17
1/4"=1'-0" @ 22x34



S-0.1

KSE ENGINEERING
David Weekley Homes
Raleigh, NC
1900 AM DRIVE, SUITE 201, QUAKERTOWN, PA 18951
www.kse-eng.com (215) 864-4449

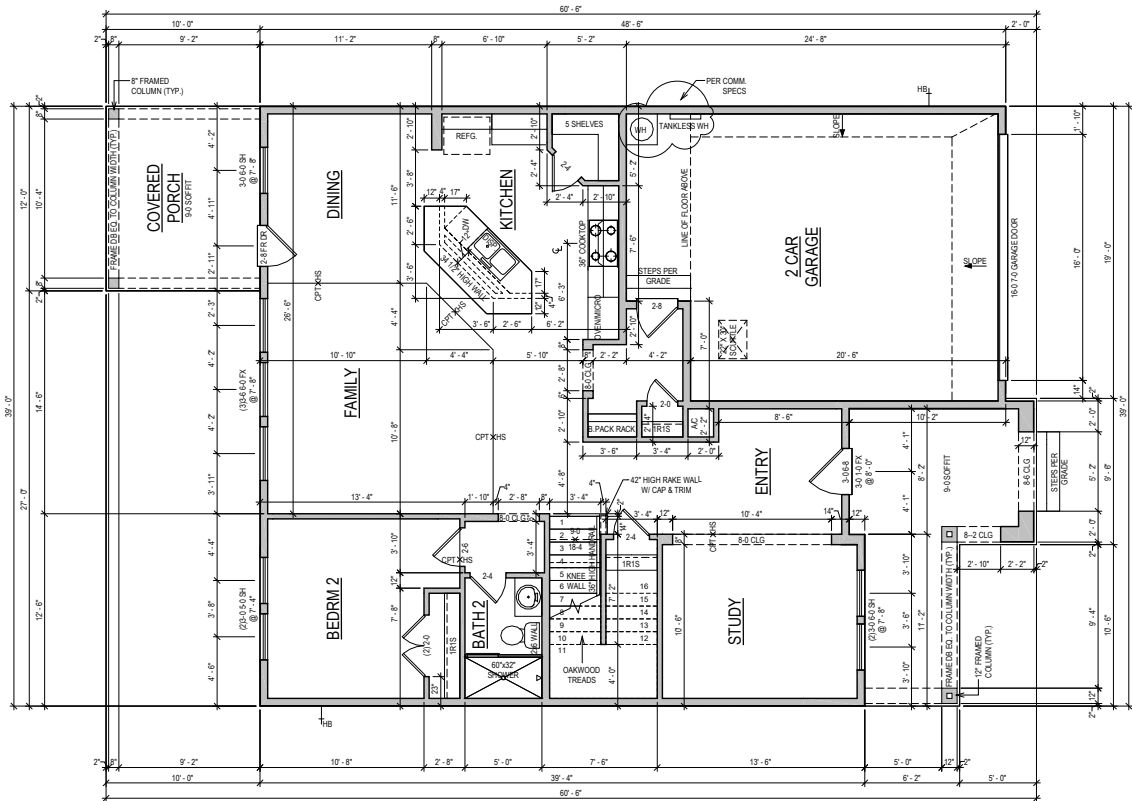

FIRST FLOOR "B"

GENERAL REQUIREMENTS

SLOPED SURFACE REQUIREMENTS

ALL PATIOS TO SLOPE 1/4" PER FOOT

GARAGE FLOOR TO BE SLOPED 1/8" PER FOOT TOWARDS VEHICLE ENTRY DOOR

ROOF DECKS AND BALCONIES TO BE SLOPED 1/4" PER FOOT TOWARDS RELIEF POINTS

RAILING REQUIREMENTS

FINISHED HANDRAIL REQUIRED AT STAIRS WITH 4 OR MORE RISERS

FINISHED HANDRAIL HEIGHT BETWEEN 34" AND 38" MEASURED VERTICALLY ABOVE TREAD NOSING

FINISHED GUARDRAILS REQUIRED AT DECKS, BALCONIES AND WALKWAYS THAT ARE 30" OR GREATER ABOVE GRADE AND BE AT A MINIMUM OF 36" IN HEIGHT

FINISHED GUARDRAIL AND HANDRAIL SPINDLES MUST BE SPACED SO A 4" SPHERE WILL NOT PASS THROUGH

PLAN SQFT "B"	
LIVING	
1ST FLOOR	1255 SF
2ND FLOOR	1308 SF
TOTAL LIVING	2563 SF
SLAB	
1ST FLOOR	1255 SF
COVERED PORCH	120 SF
FRONT PORCH	173 SF
GARAGE	451 SF
TOTAL SLAB	1999 SF
FRAMING	
1ST FLOOR	1255 SF
2ND FLOOR	1245 SF
COVERED PORCH	120 SF
FRONT PORCH	173 SF
GARAGE	451 SF
TOTAL FRAMING	3244 SF

OPTION LIST
COVERED KITCHEN W/ OVERHEAD
CABINETS
SUPER SHOWER @ OWNER'S BATH
HARD SURFACE TREADS
BACKPACK BACK
SHOWER @ BATH 2

NOTE: ALL 1ST FLR. CEILING HEIGHTS
9' - 0" UNLESS NOTED OTHERWISE

ADVANCED FRAMING: 2X6 EXTERIOR
PERIMETER WALLS & ALL INSULATED
WALLS UNLESS NOTED OTHERWISE

Proj. No.: 997
Lot: 3294
Block: 0997
Sect:

SERENITY 50'
33 COZY HAVEN
FUGUAY VARINA, NC

NORTH
A669-B
PLN-1
KIPLING
RALEIGH

David Weekley Homes
PT/KS/JUB
Date: 11/25/2024
Scale: 1/8"=1'-0"
Rev: 2/3/25 EB

© Weekley Homes LP 2024

The measurements, dimensions, and other specifications shown on this document are guidelines to construction and are not to be used as a basis for any other construction. The actual construction may vary. This document may not be relied on as a representation of what the completed structure will look like.



NORTH A669-B PLN-2
KIPLING
RALEIGH


Proj. No.:	997
3294	Lot:
Job No.:	Block:
0997	Sect:

David Weekley Homes

The measurements, dimensions, and other specifications shown on this document are guidelines for construction use only. The actual specifications of the finished structure may vary. This document may not be relied on as a representation of what the completed structure will look like.

NOTE: ALL 2ND FLR. CEILING HEIGHTS
8' - 0" UNLESS NOTED OTHERWISE

ADVANCED FRAMING: 2X6 EXTERIOR PERIMETER WALLS & ALL INSULATED WALLS UNLESS NOTED OTHERWISE.

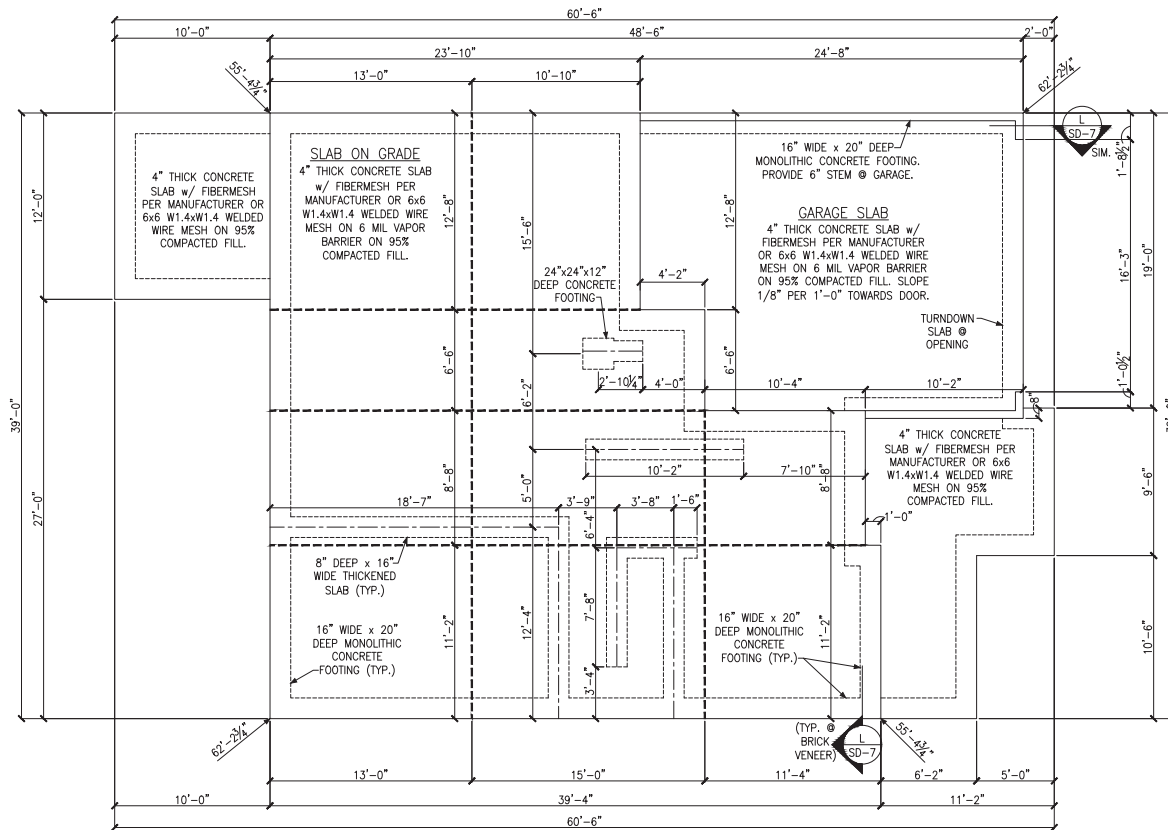

MONOLITHIC SLAB FOUNDATION PLAN

LEGEND

- ★ PROVIDE SOLID BLOCKING WITHIN FLOOR SYSTEM TO MATCH POST SIZE ABOVE.
- BEARING WALL ABOVE
- INTERIOR BEARING WALL
- BRACED WALL PANEL (SEE KSE STRUCTURAL DETAILS SET FOR BRACED WALL PANEL SHEATHING FASTENING & BLOCKING DETAILS)
- CONTROL JOINT

REFER TO KSE STRUCTURAL DETAILS SET FOR GENERAL STRUCTURAL NOTES, TYPICAL DETAILS AND ADVANCED FRAMING NOTES AND DETAILS



Monolithic Slab Foundation Plan


Serenity, Lot #997

A669 Kipling Model

115 M.P.H.

Raleigh, North Carolina

Project #: 047-24016
 Designed By: LMR
 Checked By:
 Issue Date: 4/15/25
 Re-issue:
 Scale: 1/8"=1'-0" @ 11x17
 1/4"=1'-0" @ 22x34

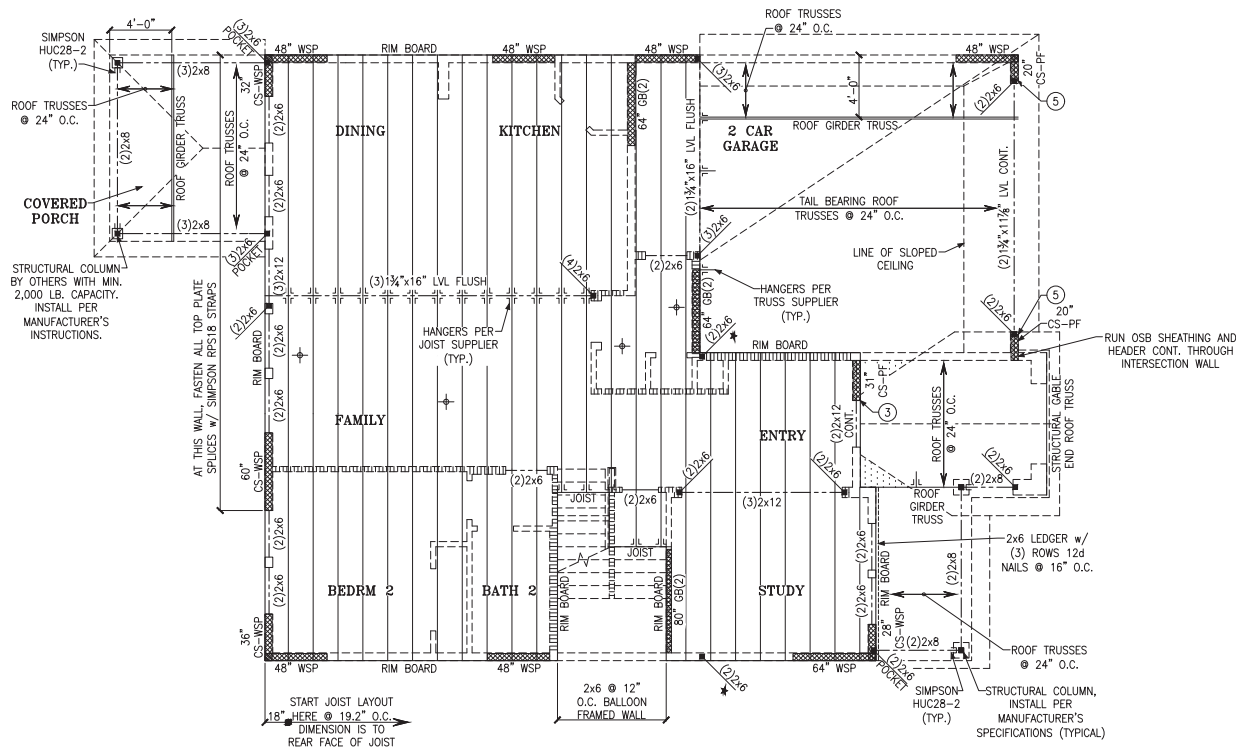

SECOND FLOOR FRAMING PLAN

LEGEND

- ★ PROVIDE SOLID BLOCKING WITHIN FLOOR SYSTEM TO MATCH POST SIZE ABOVE.
- BEARING WALL ABOVE
- INTERIOR BEARING WALL
- BRACED WALL PANEL (SEE KSE STRUCTURAL DETAILS SET FOR BRACED WALL PANEL SHEATHING FASTENING & BLOCKING DETAILS)
- 48" WSP

REFER TO KSE STRUCTURAL DETAILS SET FOR GENERAL STRUCTURAL NOTES, TYPICAL DETAILS AND ADVANCED FRAMING NOTES AND DETAILS

PLAN DESIGNED WITH 9" NOMINAL WALL PLATE HEIGHT

FLOOR FRAMING TO BE 16" DEEP TJI 210 SERIES OR EQUAL, SPACING PER MANUFACTURER.


KEYNOTES:

- ③ INSTALL ONE PANEL CS-PF PORTAL FRAME PER DETAIL A/SD-3.
- ⑤ INSTALL TWO PANEL CS-PF PORTAL FRAME PER DETAIL A OR B/SD-4.

Second Floor Framing Plan
Serenity, Lot #997
A669 Kipling Model
115 M.P.H.
Raleigh, North Carolina

Project #: 047-24016
Designed By: LMR
Checked By:
Issue Date: 4/15/25
Re-Issue:
Scale: 1/8"=1'-0" @ 11x17
1/4"=1'-0" @ 22x34



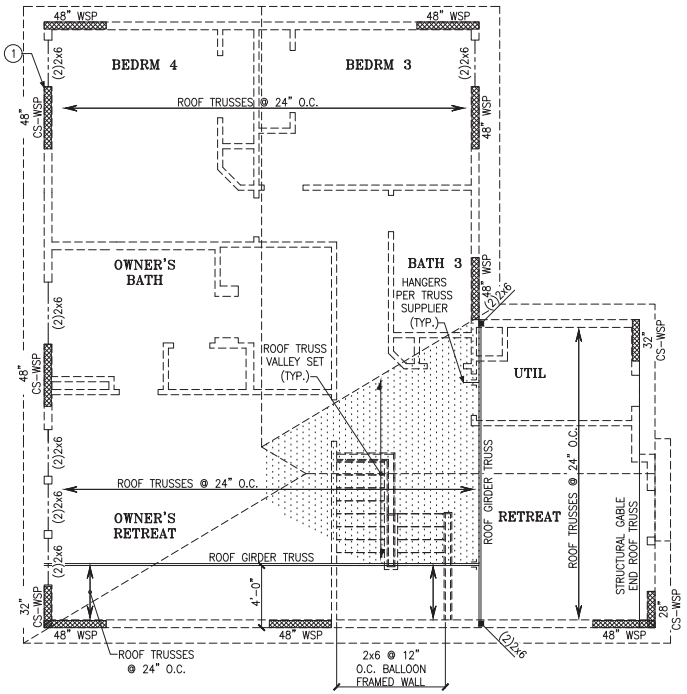

ROOF FRAMING PLAN

LEGEND

★ PROVIDE SOLID BLOCKING WITHIN FLOOR SYSTEM TO MATCH POST SIZE ABOVE.

→ BEARING WALL ABOVE

→ INTERIOR BEARING WALL

→ BRACED WALL PANEL (SEE KSE STRUCTURAL DETAILS SET FOR BRACED WALL PANEL SHEATHING FASTENING & BLOCKING DETAILS)

48" WSP


REFER TO KSE STRUCTURAL DETAILS SET FOR GENERAL STRUCTURAL NOTES, TYPICAL DETAILS AND ADVANCED FRAMING NOTES AND DETAILS

PLAN DESIGNED WITH 8" NOMINAL WALL PLATE HEIGHT


KEYNOTES:

① AT RAISED FLOOR BELOW, CONNECT STUD AT END OF BRACED WALL PANEL TO FRAMING BELOW WITH A 30" LONG SIMPSON CS20 COIL STRAP WITH MIN 8-10d NAILS EACH END. AT SLAB FOUNDATION BELOW, CONNECT STUD TO FOUNDATION w/ SIMPSON DIT11Z w/ SIMPSON 3/8"x6" TITEN HD SCREW ANCHOR AND 3/2" MINIMUM EMBEDMENT.



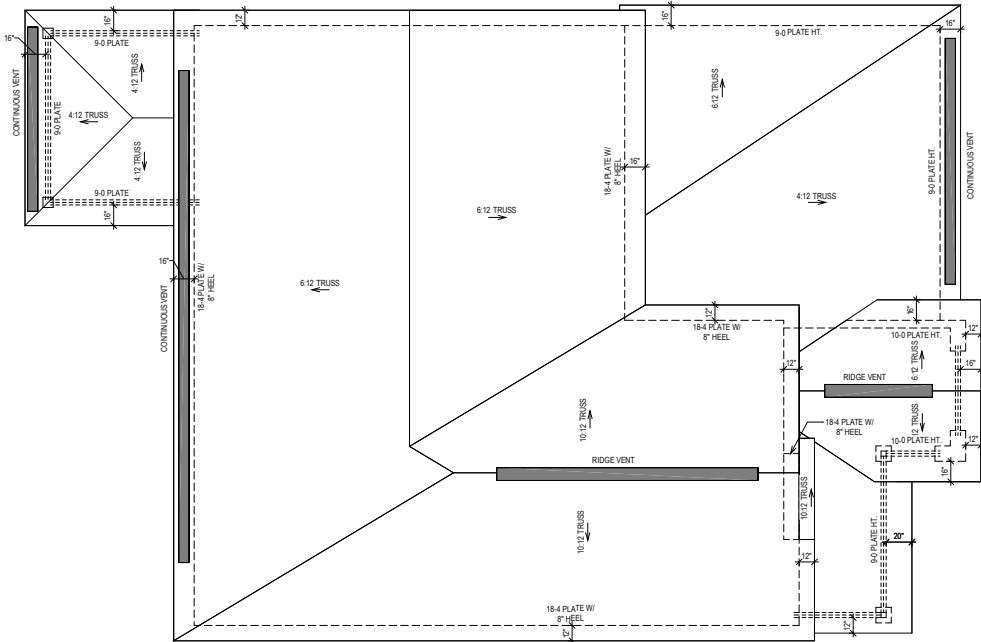

ROOF PLAN "B"

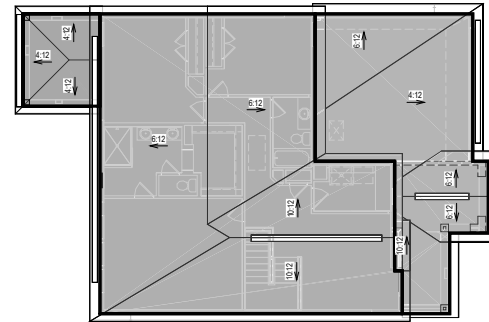

ZONE 3
ATTIC
120 SF

ZONE 2
ATTIC
1303 SF

ZONE 1
ATTIC
576 SF

VENTILATION PLAN "B"

ATTIC VENTILATION W/ COVERED PORCH - B												
NET FREE VENTILATED AREA NFVA=AREA SF X 144 / RATIO				EXHAUST VENTS				PRIMARY INTAKE				ACTUAL VENTILATION % EXHAUST NOT TO EXCEED INTAKE
				INSTALL NO MORE THAN 3' BELOW HIGHEST POINT OF ZONE				INSTALL IN LOWER THIRD OF ZONE				
ZONE	AREA	VENT RATIO	MIN NFVA	REQ	VENTS			VENTS			EXHAUST %	INTAKE %
					SIZE	COUNT	EA OR LF	SIZE	COUNT	EA OR LF		
ZONE 1	576 SF	300	277	Yes	18	7	10	16	44	56		
ZONE 2	1303 SF	300	625	Yes	18	17	10	32	48	51		
ZONE 3	120 SF	150	115	No	0	0	10	12	0	100		

TRUSS ROOF NOTES

ALL OVERHANGS PER PLAN MEASURED FROM OUTSIDE FACE OF FRAME.

GABLE OVERHANGS 12" UNLESS NOTED OTHERWISE.

HIP OVERHANGS 15" UNLESS NOTED OTHERWISE.


ALIGN FASCIA TO MAINTAIN CONSISTENT OVERHANG WITH DIFFERING ROOF PITCH.

THE TRUSS MANUFACTURER SHALL DETERMINE ALL SPANS, WORKING POINTS, BEARING POINTS, AND SIMILAR CONDITIONS. TRUSS SHOP DRAWINGS SHALL SHOW ALL TRUSSES, MEMBERS, AND ALL TRUSS TO TRUSS HANGERS.

ALL OVERFRAMING AND BRACING TO BE NO. 2 GRADE 2X S.Y.P. UNLESS NOTED OTHERWISE.


ROOF SHEATHING AT OVERFRAME SHALL BE REMOVED TO ALLOW FOR VENTILATION BETWEEN ATTIC SPACES ON VENTED ATTICS.

ACTUAL ATTIC VENTILATION MAY VARY. VERIFY IN THE FIELD.

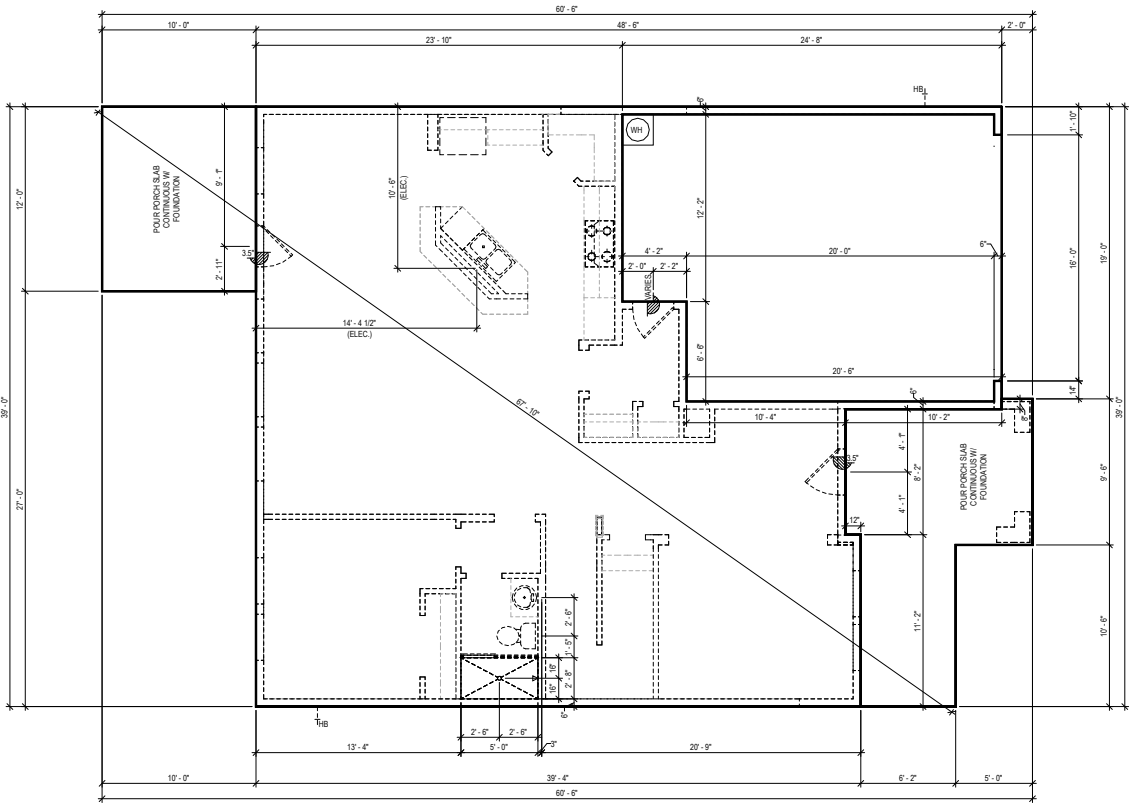

FIRST FLOOR "B"

SEE ENGINEERING FOR ANCHOR BOLT
REQUIREMENTS

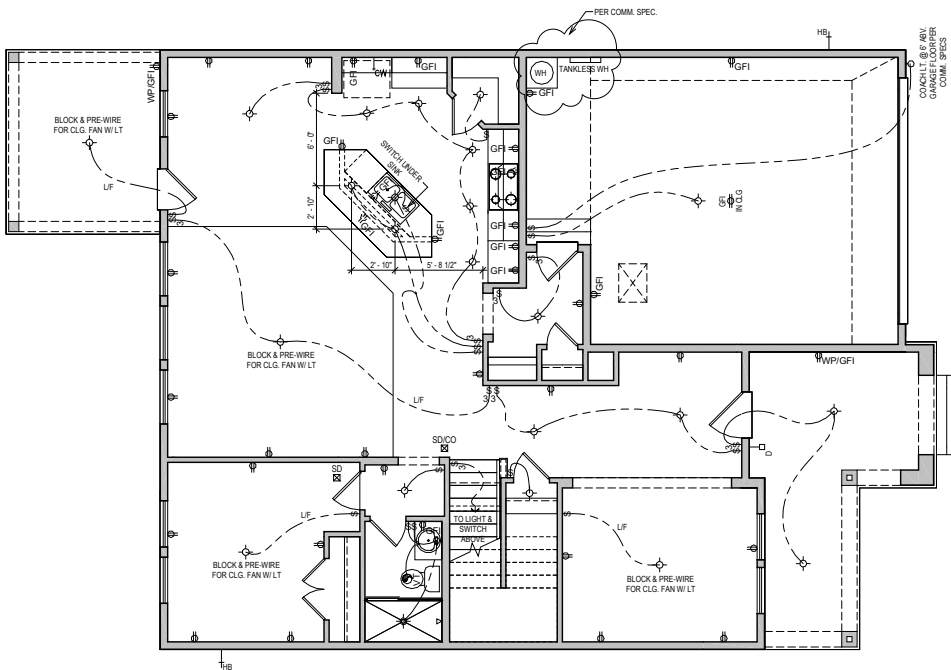

FIRST FLOOR "B"

UTILITY LEGEND

-  110V OUTLET
-  12\" data-bbox="141 161 156 176"/> 12\" data-bbox="141 186 156 201"/> 12\" data-bbox="141 211 156 226"/> 12\" data-bbox="141 236 156 251"/> 12\" data-bbox="141 261 156 276"/> 12\" data-bbox="141 286 156 301"/> 12\" data-bbox="141 311 156 326"/> 12\" data-bbox="141 336 156 351"/> 12\" data-bbox="141 361 156 376"/> 12\" data-bbox="141 386 156 401"/> 12\" data-bbox="141 411 156 426"/> 12\" data-bbox="141 436 156 451"/> 12\" data-bbox="141 461 156 476"/> 12\" data-bbox="141 486 156 501"/> 12\" data-bbox="141 511 156 526"/> 12\" data-bbox="141 536 156 551"/> 12\" data-bbox="141 561 156 576"/> 12\" data-bbox="141 586 156 601"/> 12\" data-bbox="141 611 156 626"/> 12\" data-bbox="141 636 156 651"/> 12\" data-bbox="141 661 156 676"/> 12\" data-bbox="141 686 156 701"/> 12\" data-bbox="141 711 156 726"/> 12\" data-bbox="141 736 156 751"/> 12\" data-bbox="141 761 156 776"/> 12\" data-bbox="141 786 156 801"/> 12\" data-bbox="141 811 156 826"/> 12\" data-bbox="141 836 156 851"/> 12\" data-bbox="141 861 156 876"/> 12\" data-bbox="141 886 156 901"/> 12\" data-bbox="141 911 156 926"/> 12\" data-bbox="141 936 156 951"/> 12\" data-bbox="141 961 156 976"/> 12\" data-bbox="141 986 156 1001"/> 12\" data-bbox="141 1011 156 1026"/> 12\" data-bbox="141 1036 156 1051"/> 12\" data-bbox="141 1061 156 1076"/> 12\" data-bbox="141 1086 156 1101"/> 12\" data-bbox="141 1111 156 1126"/> 12\" data-bbox="141 1136 156 1151"/> 12\" data-bbox="141 1161 156 1176"/> 12\" data-bbox="141 1186 156 1201"/> 12\" data-bbox="141 1211 156 1226"/> 12\" data-bbox="141 1236 156 1251"/> 12\" data-bbox="141 1261 156 1276"/> 12\" data-bbox="141 1286 156 1301"/> 12\" data-bbox="141 1311 156 1326"/> 12\" data-bbox="141 1336 156 1351"/> 12\" data-bbox="141 1361 156 1376"/> 12\" data-bbox="141 1386 156 1401"/> 12\" data-bbox="141 1411 156 1426"/> 12\" data-bbox="141 1436 156 1451"/> 12\" data-bbox="141 1461 156 1476"/> 12\" data-bbox="141 1486 156 1501"/> 12\" data-bbox="141 1511 156 1526"/> 12\" data-bbox="141 1536 156 1551"/> 12\" data-bbox="141 1561 156 1576"/> 12\" data-bbox="141 1586 156 1601"/> 12\" data-bbox="141 1611 156 1626"/> 12\" data-bbox="141 1636 156 1651"/> 12\" data-bbox="141 1661 156 1676"/> 12\" data-bbox="141 1686 156 1701"/> 12\" data-bbox="141 1711 156 1726"/> 12\" data-bbox="141 1736 156 1751"/> 12\" data-bbox="141 1761 156 1776"/> 12\" data-bbox="141 1786 156 1801"/> 12\" data-bbox="141 1811 156 1826"/> 12\" data-bbox="141 1836 156 1851"/> 12\" data-bbox="141 1861 156 1876"/> 12\" data-bbox="141 1886 156 1901"/> 12\" data-bbox="141 1911 156 1926"/> 12\" data-bbox="141 1936 156 1951"/> 12\" data-bbox="141 1961 156 1976"/> 12\" data-bbox="141 1986 156 2001"/> 12\" data-bbox="141 2011 156 2026"/> 12\" data-bbox="141 2036 156 2051"/> 12\" data-bbox="141 2061 156 2076"/> 12\" data-bbox="141 2086 156 2101"/> 12\" data-bbox="141 2111 156 2126"/> 12\" data-bbox="141 2136 156 2151"/> 12\" data-bbox="141 2161 156 2176"/> 12\" data-bbox="141 2186 156 2201"/> 12\" data-bbox="141 2211 156 2226"/> 12\" data-bbox="141 2236 156 2251"/> 12\" data-bbox="141 2261 156 2276"/> 12\" data-bbox="141 2286 156 2301"/> 12\" data-bbox="141 2311 156 2326"/> 12\" data-bbox="141 2336 156 2351"/> 12\" data-bbox="141 2361 156 2376"/> 12\" data-bbox="141 2386 156 2401"/> 12\" data-bbox="141 2411 156 2426"/> 12\" data-bbox="141 2436 156 2451"/> 12\" data-bbox="141 2461 156 2476"/> 12\" data-bbox="141 2486 156 2501"/> 12\" data-bbox="141 2511 156 2526"/> 12\" data-bbox="141 2536 156 2551"/> 12\" data-bbox="141 2561 156 2576"/> 12\" data-bbox="141 2586 156 2601"/> 12\" data-bbox="141 2611 156 2626"/> 12\" data-bbox="141 2636 156 2651"/> 12\" data-bbox="141 2661 156 2676"/> 12\" data-bbox="141 2686 156 2701"/> 12\" data-bbox="141 2711 156 2726"/> 12\" data-bbox="141 2736 156 2751"/> 12\" data-bbox="141 2761 156 2776"/> 12\" data-bbox="141 2786 156 2801"/> 12\" data-bbox="141 2811 156 2826"/> 12\" data-bbox="141 2836 156 2851"/> 12\" data-bbox="141 2861 156 2876"/> 12\" data-bbox="141 2886 156 2901"/> 12\" data-bbox="141 2911 156 2926"/> 12\" data-bbox="141 2936 156 2951"/> 12\" data-bbox="141 2961 156 2976"/> 12\" data-bbox="141 2986 156 3001"/> 12\" data-bbox="141 3011 156 3026"/> 12\" data-bbox="141 3036 156 3051"/> 12\" data-bbox="141 3061 156 3076"/> 12\" data-bbox="141 3086 156 3101"/> 12\" data-bbox="141 3111 156 3126"/> 12\" data-bbox="141 3136 156 3151"/> 12\" data-bbox="141 3161 156 3176"/> 12\" data-bbox="141 3186 156 3201"/> 12\" data-bbox="141 3211 156 3226"/> 12\" data-bbox="141 3236 156 3251"/> 12\" data-bbox="141 3261 156 3276"/> 12\" data-bbox="141 3286 156 3301"/> 12\" data-bbox="141 3311 156 3326"/> 12\" data-bbox="141 3336 156 3351"/> 12\" data-bbox="141 3361 156 3376"/> 12\" data-bbox="141 3386 156 3401"/> 12\" data-bbox="141 3411 156 3426"/> 12\" data-bbox="141 3436 156 3451"/> 12\" data-bbox="141 3461 156 3476"/> 12\" data-bbox="141 3486 156 3501"/> 12\" data-bbox="141 3511 156 3526"/> 12\" data-bbox="141 3536 156 3551"/> 12\" data-bbox="141 3561 156 3576"/> 12\" data-bbox="141 3586 156 3601"/> 12\" data-bbox="141 3611 156 3626"/> 12\" data-bbox="141 3636 156 3651"/> 12\" data-bbox="141 3661 156 3676"/> 12\" data-bbox="141 3686 156 3701"/> 12\" data-bbox="141 3711 156 3726"/> 12\" data-bbox="141 3736 156 3751"/> 12\" data-bbox="141 3761 156 3776"/> 12\" data-bbox="141 3786 156 3801"/> 12\" data-bbox="141 3811 156 3826"/> 12\" data-bbox="141 3836 156 3851"/> 12\" data-bbox="141 3861 156 3876"/> 12\" data-bbox="141 3886 156 3901"/> 12\" data-bbox="141 3911 156 3926"/> 12\" data-bbox="141 3936 156 3951"/> 12\" data-bbox="141 3961 156 3976"/> 12\" data-bbox="141 3986 156 4001"/> 12\" data-bbox="141 4011 156 4026"/> 12\" data-bbox="141 4036 156 4051"/> 12\" data-bbox="141 4061 156 4076"/> 12\" data-bbox="141 4086 156 4101"/> 12\" data-bbox="141 4111 156 4126"/> 12\" data-bbox="141 4136 156 4151"/> 12\" data-bbox="141 4161 156 4176"/> 12\" data-bbox="141 4186 156 4201"/> 12\" data-bbox="141 4211 156 4226"/> 12\" data-bbox="141 4236 156 4251"/> 12\" data-bbox="141 4261 156 4276"/> 12\" data-bbox="141 4286 156 4301"/> 12\" data-bbox="141 4311 156 4326"/> 12\" data-bbox="141 4336 156 4351"/> 12\" data-bbox="141 4361 156 4376"/> 12\" data-bbox="141 4386 156 4401"/> 12\" data-bbox="141 4411 156 4426"/> 12\" data-bbox="141 4436 156 4451"/> 12\" data-bbox="141 4461 156 4476"/> 12\" data-bbox="141 4486 156 4501"/> 12\" data-bbox="141 4511 156 4526"/> 12\" data-bbox="141 4536 156 4551"/> 12\" data-bbox="141 4561 156 4576"/> 12\" data-bbox="141 4586 156 4601"/> 12\" data-bbox="141 4611 156 4626"/> 12\" data-bbox="141 4636 156 4651"/> 12\" data-bbox="141 4661 156 4676"/> 12\" data-bbox="141 4686 156 4701"/> 12\" data-bbox="141 4711 156 4726"/> 12\" data-bbox="141 4736 156 4751"/> 12\" data-bbox="141 4761 156 4776"/> 12\" data-bbox="141 4786 156 4801"/> 12\" data-bbox="141 4811 156 4826"/> 12\" data-bbox="141 4836 156 4851"/> 12\" data-bbox="141 4861 156 4876"/> 12\" data-bbox="141 4886 156 4901"/> 12\" data-bbox="141 4911 156 4926"/> 12\" data-bbox="141 4936 156 4951"/> 12\" data-bbox="141 4961 156 4976"/> 12\" data-bbox="141 4986 156 5001"/> 12\" data-bbox="141 5011 156 5026"/> 12\" data-bbox="141 5036 156 5051"/> 12\" data-bbox="141 5061 156 5076"/> 12\" data-bbox="141 5086 156 5101"/> 12\" data-bbox="141 5111 156 5126"/> 12\" data-bbox="141 5136 156 5151"/> 12\" data-bbox="141 5161 156 5176"/> 12\" data-bbox="141 5186 156 5201"/> 12\" data-bbox="141 5211 156 5226"/> 12\" data-bbox="141 5236 156 5251"/> 12\" data-bbox="141 5261 156 5276"/> 12\" data-bbox="141 5286 156 5301"/> 12\" data-bbox="141 5311 156 5326"/> 12\" data-bbox="141 5336 156 5351"/> 12\" data-bbox="141 5361 156 5376"/> 12\" data-bbox="141 5386 156 5401"/> 12\" data-bbox="141 5411 156 5426"/> 12\" data-bbox="141 5436 156 5451"/> 12\" data-bbox="141 5461 156 5476"/> 12\" data-bbox="141 5486 156 5501"/> 12\" data-bbox="141 5511 156 5526"/> 12\" data-bbox="141 5536 156 5551"/> 12\" data-bbox="141 5561 156 5576"/> 12\" data-bbox="141 5586 156 5601"/> 12\" data-bbox="141 5611 156 5626"/> 12\" data-bbox="141 5636 156 5651"/> 12\" data-bbox="141 5661 156 5676"/> 12\" data-bbox="141 5686 156 5701"/> 12\" data-bbox="141 5711 156 5726"/> 12\" data-bbox="141 5736 156 5751"/> 12\" data-bbox="141 5761 156 5776"/> 12\" data-bbox="141 5786 156 5801"/> 12\" data-bbox="141 5811 156 5826"/> 12\" data-bbox="141 5836 156 5851"/> 12\" data-bbox="141 5861 156 5876"/> 12\" data-bbox="141 5886 156 5901"/> 12\" data-bbox="141 5911 156 5926"/> 12\" data-bbox="141 5936 156 5951"/> 12\" data-bbox="141 5961 156 5976"/> 12\" data-bbox="141 5986 156 6001"/> 12\" data-bbox="141 6011 156 6026"/> 12\" data-bbox="141 6036 156 6051"/> 12\" data-bbox="141 6061 156 6076"/> 12\" data-bbox="141 6086 156 6101"/> 12\" data-bbox="141 6111 156 6126"/> 12\" data-bbox="141 6136 156 6151"/> 12\" data-bbox="141 6161 156 6176"/> 12\" data-bbox="141 6186 156 6201"/> 12\" data-bbox="141 6211 156 6226"/> 12\" data-bbox="141 6236 156 6251"/> 12\" data-bbox="141 6261 156 6276"/> 12\" data-bbox="141 6286 156 6301"/> 12\" data-bbox="141 6311 156 6326"/> 12\" data-bbox="141 6336 156 6351"/> 12\" data-bbox="141 6361 156 6376"/> 12\" data-bbox="141 6386 156 6401"/> 12\" data-bbox="141 6411 156 6426"/> 12\" data-bbox="141 6436 156 6451"/> 12\" data-bbox="141 6461 156 6476"/> 12\" data-bbox="141 6486 156 6501"/> 12\" data-bbox="141 6511 156 6526"/> 12\" data-bbox="141 6536 156 6551"/> 12\" data-bbox="141 6561 156 6576"/> 12\" data-bbox="141 6586 156 6601"/> 12\" data-bbox="141 6611 156 6626"/> 12\" data-bbox="141 6636 156 6651"/> 12\" data-bbox="141 6661 156 6676"/> 12\" data-bbox="141 6686 156 6701"/> 12\" data-bbox="141 6711 156 6726"/> 12\" data-bbox="141 6736 156 6751"/> 12\" data-bbox="141 6761 156 6776"/> 12\" data-bbox="141 6786 156 6801"/> 12\" data-bbox="141 6811 156 6826"/> 12\" data-bbox="141 6836 156 6851"/> 12\" data-bbox="141 6861 156 6876"/> 12\" data-bbox="141 6886 156 6901"/> 12\" data-bbox="141 6911 156 6926"/> 12\" data-bbox="141 6936 156 6951"/> 12\" data-bbox="141 6961 156 6976"/> 12\" data-bbox="141 6986 156 7001"/> 12\" data-bbox="141 7011 156 7026"/> 12\" data-bbox="141 7036 156 7051"/> 12\" data-bbox="141 7061 156 7076"/> 12\" data-bbox="141 7086 156 7101"/> 12\" data-bbox="141 7111 156 7126"/> 12\" data-bbox="141 7136 156 7151"/> 12\" data-bbox="141 7161 156 7176"/> 12\" data-bbox="141 7186 156 7201"/> 12\" data-bbox="141 7211 156 7226"/> 12\" data-bbox="141 7236 156 7251"/> 12\" data-bbox="141 7261 156 7276"/> 12\" data-bbox="141 7286 156 7301"/> 12\" data-bbox="141 7311 156 7326"/> 12\" data-bbox="141 7336 156 7351"/> 12\" data-bbox="141 7361 156 7376"/> 12\" data-bbox="141 7386 156 7401"/> 12\" data-bbox="141 7411 156 7426"/> 12\" data-bbox="141 7436 156 7451"/> 12\" data-bbox="141 7461 156 7476"/> 12\" data-bbox="141 7486 156 7501"/> 12\" data-bbox="141 7511 156 7526"/> 12\" data-bbox="141 7536 156 7551"/> 12\" data-bbox="141 7561 156 7576"/> 12\" data-bbox="141 7586 156 7601"/> 12\" data-bbox="141 7611 156 7626"/> 12\" data-bbox="141 7636 156 7651"/> 12\" data-bbox="141 7661 156 7676"/> 12\" data-bbox="141 7686 156 7701"/> 12\" data-bbox="141 7711 156 7726"/> 12\" data-bbox="141 7736 156 7751"/> 12\" data-bbox="141 7761 156 7776"/> 12\" data-bbox="141 7786 156 7801"/> 12\" data-bbox="141 7811 156 7826"/> 12\" data-bbox="141 7836 156 7851"/> 12\" data-bbox="141 7861 156 7876"/> 12\" data-bbox="141 7886 156 7901"/> 12\" data-bbox="141 7911 156 7926"/> 12\" data-bbox="141 7936 156 7951"/> 12\" data-bbox="141 7961 156 7976"/> 12\" data-bbox="141 7986 156 8001"/> 12\" data-bbox="141 8011 156 8026"/> 12\" data-bbox="141 8036 156 8051"/> 12\" data-bbox="141 8061 156 8076"/> 12\" data-bbox="141 8086 156 8101"/> 12\" data-bbox="141 8111 156 8126"/> 12\" data-bbox="141 8136 156 8151"/> 12\" data-bbox="141 8161 156 8176"/> 12\" data-bbox="141 8186 156 8201"/> 12\" data-bbox="141 8211 156 8226"/> 12\" data-bbox="141 8236 156 8251"/> 12\" data-bbox="141 8261 156 8276"/> 12\" data-bbox="141 8286 156 8301"/> 12\" data-bbox="141 8311 156 8326"/> 12\" data-bbox="141 8336 156 8351"/> 12\" data-bbox="141 8361 156 8376"/> 12\" data-bbox="141 8386 156 8401"/> 12\" data-bbox="141 8411 156 8426"/> 12\" data-bbox="141 8436 156 8451"/> 12\" data-bbox="141 8461 156 8476"/> 12\" data-bbox="141 8486 156 8501"/> 12\" data-bbox="141 8511 156 8526"/> 12\" data-bbox="141 8536 156 8551"/> 12\" data-bbox="141 8561 156 8576"/> 12\" data-bbox="141 8586 156 8601"/> 12\" data-bbox="141 8611 156 8626"/> 12\" data-bbox="141 8636 156 8651"/> 12\" data-bbox="141 8661 156 8676"/> 12\" data-bbox="141 8686 156 8701"/> 12\" data-bbox="141 8711 156 8726"/> 12\" data-bbox="141 8736 156 8751"/> 12\" data-bbox="141 8761 156 8776"/> 12\" data-bbox="141 8786 156 8801"/> 12\" data-bbox="141 8811 156 8826"/> 12\" data-bbox="141 8836 156 8851"/> 12\" data-bbox="141 8861 156 8876"/> 12\" data-bbox="141 8886 156 8901"/> 12\" data-bbox="141 8911 156 8926"/> 12\" data-bbox="141 8936 156 8951"/> 12\" data-bbox="141 8961 156 8976"/> 12\" data-bbox="141 8986 156 9001"/> 12\" data-bbox="141 9011 156 9026"/> 12\" data-bbox="141 9036 156 9051"/> 12\" data-bbox="141 9061 156 9076"/> 12\" data-bbox="141 9086 156 9101"/> 12\" data-bbox="141 9111 156 9126"/> 12\" data-bbox="141 9136 156 9151"/> 12\" data-bbox="141 9161 156 9176"/> 12\" data-bbox="141 9186 156 9201"/> 12\" data-bbox="141 9211 156 9226"/> 12\" data-bbox="141 9236 156 9251"/> 12\" data-bbox="141 9261 156 9276"/> 12\" data-bbox="141 9286 156 9301"/> 12\" data-bbox="141 9311 156 9326"/> 12\" data-bbox="141 9336 156 9351"/> 12\" data-bbox="141 9361 156 9376"/> 12\" data-bbox="141 9386 156 9401"/> 12\" data-bbox="141 9411 156 9426"/> 12\" data-bbox="141 9436 156 9451"/> 12\" data-bbox="141 9461 156 9476"/> 12\" data-bbox="141 9486 156 9501"/> 12\" data-bbox="141 9511 156 9526"/> 12\" data-bbox="141 9536 156 9551"/> 12\" data-bbox="141 9561 156 9576"/> 12\" data-bbox="141 9586 156 9601"/> 12\" data-bbox="141 9611 156 9626"/> 12\" data-bbox="141 9636 156 9651"/> 12\" data-bbox="141 9661 156 9676"/> 12\" data-bbox="141 9686 156 9701"/> 12\" data-bbox="141 9711 156 9726"/> 12\" data-bbox="141 9736 156 9751"/> 12\" data-bbox="141 9761 156 9776"/> 12\" data-bbox="141 9786 156 9801"/> 12\" data-bbox="141 9811 156 9826"/> 12\" data-bbox="141 9836 156 9851"/> 12\" data-bbox="141 9861 156 9876"/> 12\" data-bbox="141 9886 156 9901"/> 12\" data-bbox="141 9911 156 9926"/> 12\" data-bbox="141 9936 156 9951"/> 12\" data-bbox="141 9961 156 9976"/> 12\" data-bbox="141 9986 156 1001"/> 12\" data-bbox="141 10011 156 10026"/> 12\" data-bbox="141 10036 156 10051"/> 12\" data-bbox="141 10061 156 10076"/> 12\" data-bbox="141 10086 156 10101"/> 12\" data-bbox="141 10111 156 10126"/> 12\" data-bbox="141 10136 156 10151"/> 12\" data-bbox="141 10161 156 10176"/> 12\" data-bbox="141 10186 156 10201"/> 12\" data-bbox="141 10211 156 10226"/> 12\" data-bbox="141 10236 156 10251"/> 12\" data-bbox="141 10261 156 10276"/> 12\" data-bbox="141 10286 156 10301"/> 12\" data-bbox="141 10311 156 10326"/> 12\" data-bbox="141 10336 156 10351"/> 12\" data-bbox="141 10361 156 10376"/> 12\" data-bbox="141 10386 156 10401"/> 12\" data-bbox="141 10411 156 10426"/> 12\" data-bbox="141 10436 156 10451"/> 12\" data-bbox="141 10461 156 10476"/> 12\" data-bbox="141 10486 156 10501"/> 12\" data-bbox="141 10511 156 10526"/> 12\" data-bbox="141 10536 156 10551"/> 12\" data-bbox="141 10561 156 10576"/> 12\" data-bbox="141 10586 156 10601"/> 12\" data-bbox="141 10611 156 10626"/> 12\" data-bbox="141 10636 156 10651"/> 12\" data-bbox="141 10661 156 10676"/> 12\" data-bbox="141 10686 156 10701"/> 12\" data-bbox="141 10711 156 10726"/> 12\" data-bbox="141 10736 156 10751"/> 12\" data-bbox="141 10761 156 10776"/> 12\" data-bbox="141 10786 156 10801"/> 12\" data-bbox="141 10811 156 10826"/> 12\" data-bbox="141 10836 156 10851"/> 12\" data-bbox="141 10861 156 10876"/> 12\" data-bbox="141 10886 156 10901"/> 12\" data-bbox="141 10911 156 10926"/> 12\" data-bbox="141 10936 156 10951"/> 12\" data-bbox="141 10961 156 10976"/> 12\" data-bbox="141 10986 156 11001"/> 12\" data-bbox="141 11011 156 11026"/> 12\" data-bbox="141 11036 156 11051"/> 12\" data-bbox="141 11061 156 11076"/> 12\" data-bbox="141 11086 156 11101"/> 12\" data-bbox="141 11111 156 11126"/> 12\" data-bbox="141 11136 156 11151"/> 12\" data-bbox="141 11161 156 11176"/> 12\" data-bbox="141 11186 156 11201"/> 12\" data-bbox="141 11211 156 11226"/> 12\" data-bbox="141 11236 156 11251"/> 12\" data-bbox="141 11261 156 11276"/> 12\" data-bbox="141 11286 156 11301"/> 12\" data-bbox="141 11311 156 11326"/> 12\" data-bbox="141 11336 156 11351"/> 12\" data-bbox="141 11361 156 11376"/> 12\" data-bbox="141 11386 156 11401"/> 12\" data-bbox="141 11411 156 11426"/> 12\" data-bbox="141 11436 156 11451"/> 12\" data-bbox="141 11461 156 11476"/> 12\" data-bbox="141 11486 156 11501"/> 12\" data-bbox="141 11511 156 11526"/> 12\" data-bbox="141 11536 156 11551"/> 12\" data-bbox="141 11561 156 11576"/> 12\" data-bbox="141 11586 156 11601"/> 12\" data-bbox="141 11611 156 11626"/> 12\" data-bbox="141 11636 156 11651"/> 12\" data-bbox="141 11661 156 11676"/> 12\" data-bbox="141 11686 156 11701"/> 12\" data-bbox="141 11711 156 11726"/> 12\" data-bbox="141 11736 156 11751"/> 12\" data-bbox="141 11761 156 11776"/> 12\" data-bbox="141 11786 156 11801"/> 12\" data-bbox="141 11811 156 11826"/> 12\" data-bbox="141 118

MID-ATLANTIC General Notes

1. ALL ELECTRICAL PLUGS TO BE 9" TO TOP FROM FLOOR IN ROOMS WITH WALL MOLDINGS.
2. SWITCH FOR ATTIC LIGHT TO BE LOCATED OUTSIDE OF ATTIC SPACE, 12 INCHES FROM CEILING.
3. DO NOT RUN WIRES ON TOP OF JOISTS IN AREAS LIKELY TO HAVE DECKING IN ATTIC. (near disappearing stairs)
4. PROVIDE SMOKE DETECTORS IN EVERY BEDROOM. SEE SPECS FOR REQUIRED TYPE AND WIRING.
5. PROVIDE GAS AT APPLIANCES PER COMMUNITY REQUIREMENTS.
6. LOCATE ELECTRICAL PANEL IN LOCATION CLOSEST TO SERVICE.

© Weekly Homes L.P. 2024

The measurements, dimensions, and other specifications shown on this document are guidelines for construction use only. They are not to be used for legal or other purposes. The measurements, dimensions, and other specifications shown on this document are guidelines for construction use only. This document may not be relied on as a representation of what the completed structure will look like.

David Weekly Homes

Scale: 1/8"=1'-0"

Date: 11/25/2024 Rev: 2/3/25 EB

Proj. No.: 997

Lot: 3294

Block: 0997

Sect:

SERENITY 50'

33 COZY HAVEN

FUQUAY VARINA, NC


NORTH

A669-B

ELE-1

KIPLING

RALEIGH

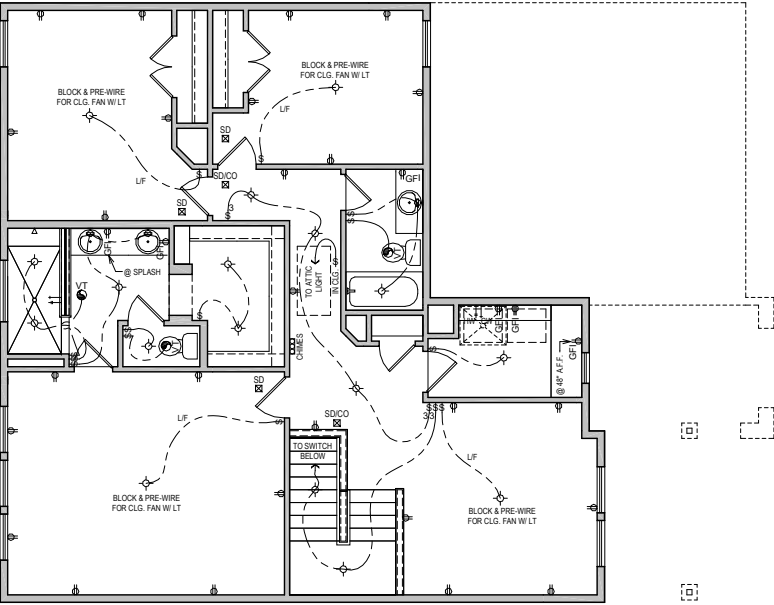

SECOND FLOOR "B"

NOTE: ALL 2ND FLR. CEILING HEIGHTS
8' - 0" UNLESS NOTED OTHERWISE

ADVANCED FRAMING: 2X6 EXTERIOR
PERIMETER WALLS & ALL INSULATED
WALLS UNLESS NOTED OTHERWISE










SERENITY 50'
33 COZY HAVEN
FUQUAY VARINA, NC


NORTH
A669-B
ELE-2
KIPLING
RALEIGH

Proj. No.:
3294
Job No.:
0997
Lot:
Block:
Sect:


David Weekley Homes
P7TKS/JB
Date: 11/25/2024
Scale: 1/8"=1'-0"
Rev: 2/3/25 EB

© Weekley Homes, L.P. 2024
The measurements, dimensions, and other specifications
shown on this document are guidelines for construction use
only. They are not to be used for legal purposes. The
owner is responsible for verifying the accuracy of the
information. This document may not be relied on as a representation
of what the completed structure will look like.

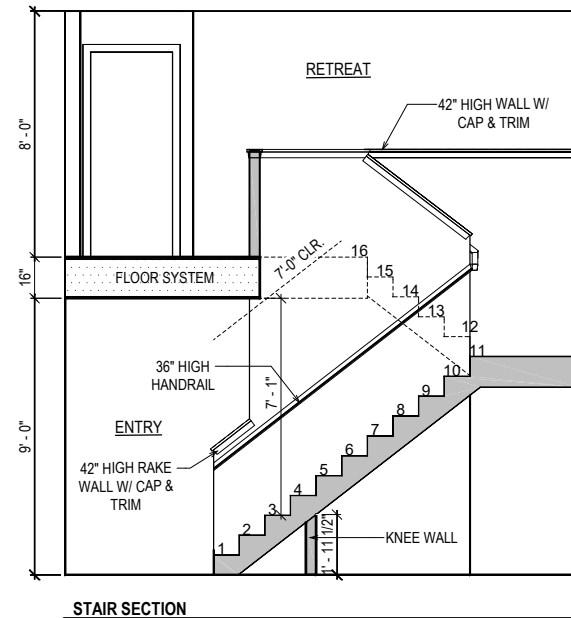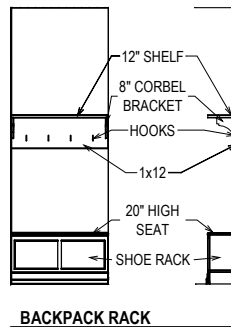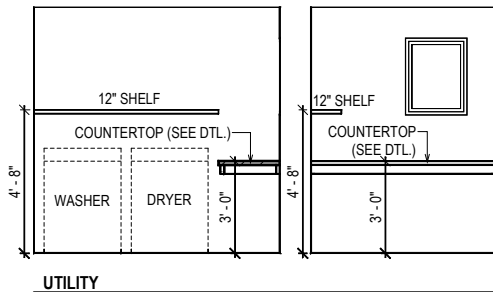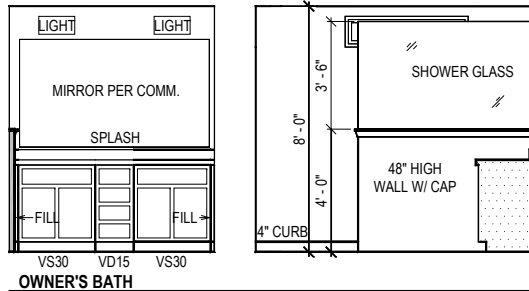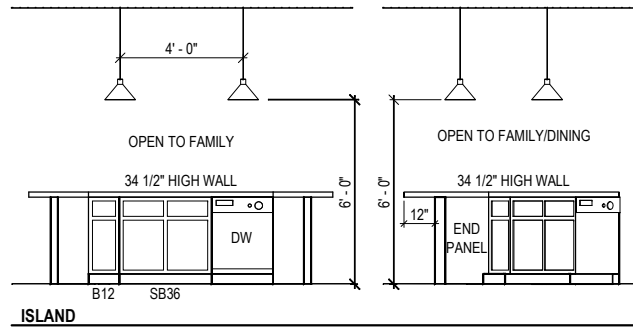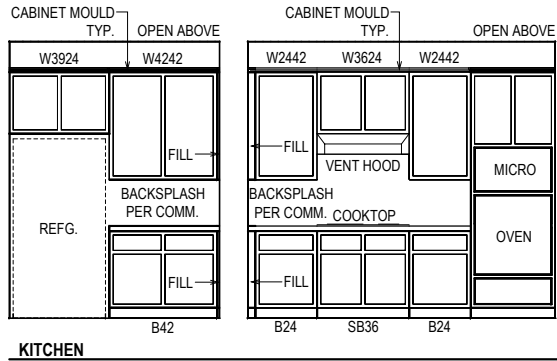


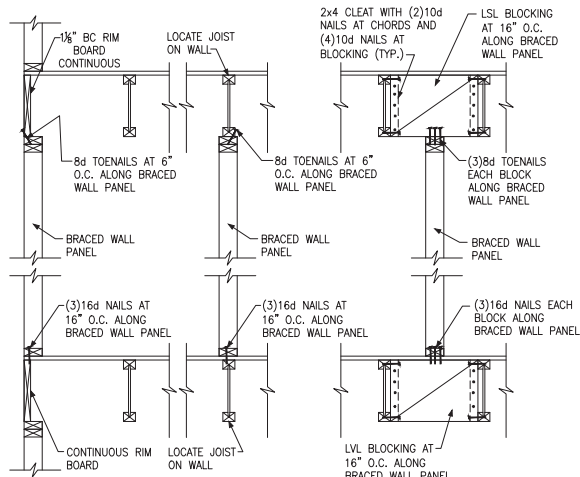

A TYPICAL BRACED WALL PANEL TO FLOOR/CEILING CONNECTION
BRACED WALL PANELS PARALLEL TO I-JOISTS

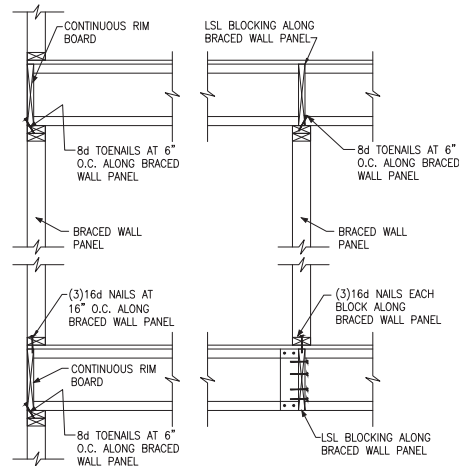


B TYPICAL BRACED WALL PANEL TO FLOOR/CEILING CONNECTION
BRACED WALL PANELS PERPENDICULAR TO I-JOISTS

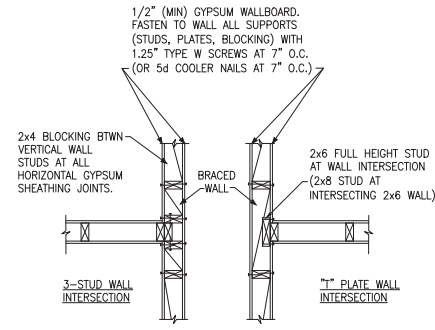


BRACED WALL INTERSECTIONS MAY BE FRAMED USING EITHER THE 3-STUD OR THE T-PLATE METHOD.

C METHOD GB(1) AND GB(2) INTERSECTION DETAILS

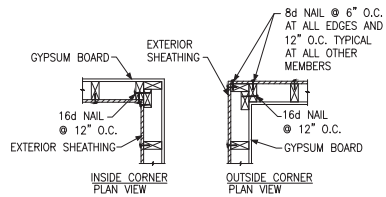


D TYPICAL EXTERIOR CORNER WALL FRAMING

NOTE: A THIRD STUD AND/OR PARTITION INTERSECTION BACKING STUDS SHALL BE PERMITTED TO BE OMITTED THROUGH THE USE OF WOOD BACKUP CLEATS, METAL DRYWALL CLIPS OR OTHER APPROVED DEVICES THAT WILL SERVE AS ADEQUATE BACKING FOR THE FACING MATERIALS.

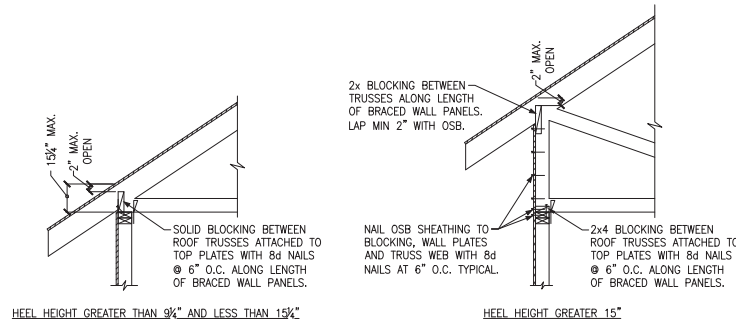


E ROOF TRUSS BEARING/BLOCKING AT BRACED WALL PANELS
ONLY REQUIRED AT BRACED WALL PANELS




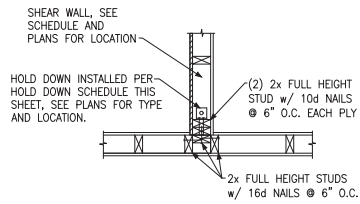


(A) TYPICAL HOLD DOWN DETAIL

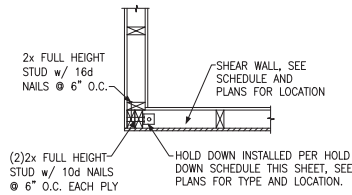


(B) TYPICAL HOLD DOWN DETAIL

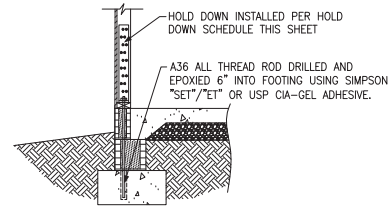


(C) HOLD DOWN AT STEMWALL SLAB

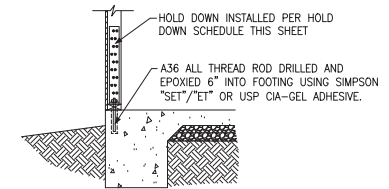


(D) HOLD DOWN AT MONOLITHIC SLAB

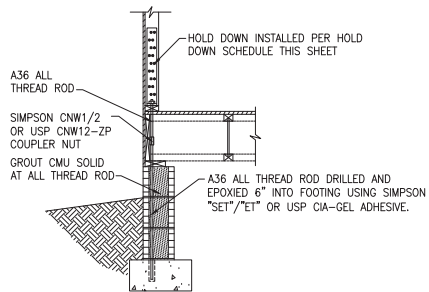

(E) HOLD DOWN AT CRAWL FOUNDATION

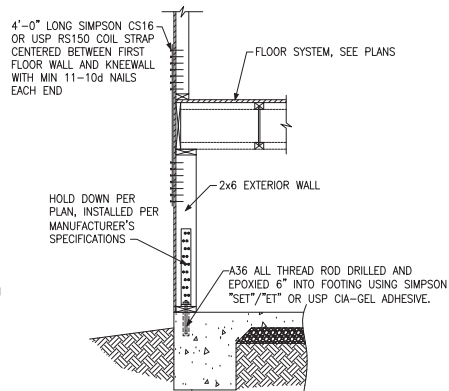

(F) HOLD DOWN AT FOUNDATION MONOLITHIC TURN-DOWN

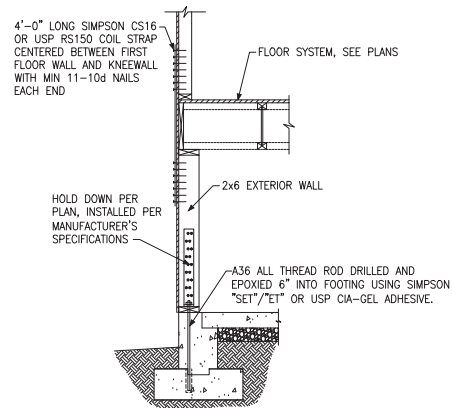

(G) HOLD DOWN AT FOUNDATION STEM WALL


HOLD DOWN SCHEDULE			
HOLD DOWN		ALL TREAD ROD	FASTENERS
SIMPSON	USP		
LTP2	LTS20B	1/2" DIA.	(10)10d NAILS
HTT4	HTT16	3/8" DIA.	(18)16dx2 1/2" LONG NAILS
HTT5	HTT45	3/8" DIA.	(26)16dx2 1/2" LONG NAILS






(C) WINDOW OR DOOR REINFORCEMENT IN ENGINEERED SHEAR WALL
ONLY REQUIRED WHERE SPECIFIED ON PLANS




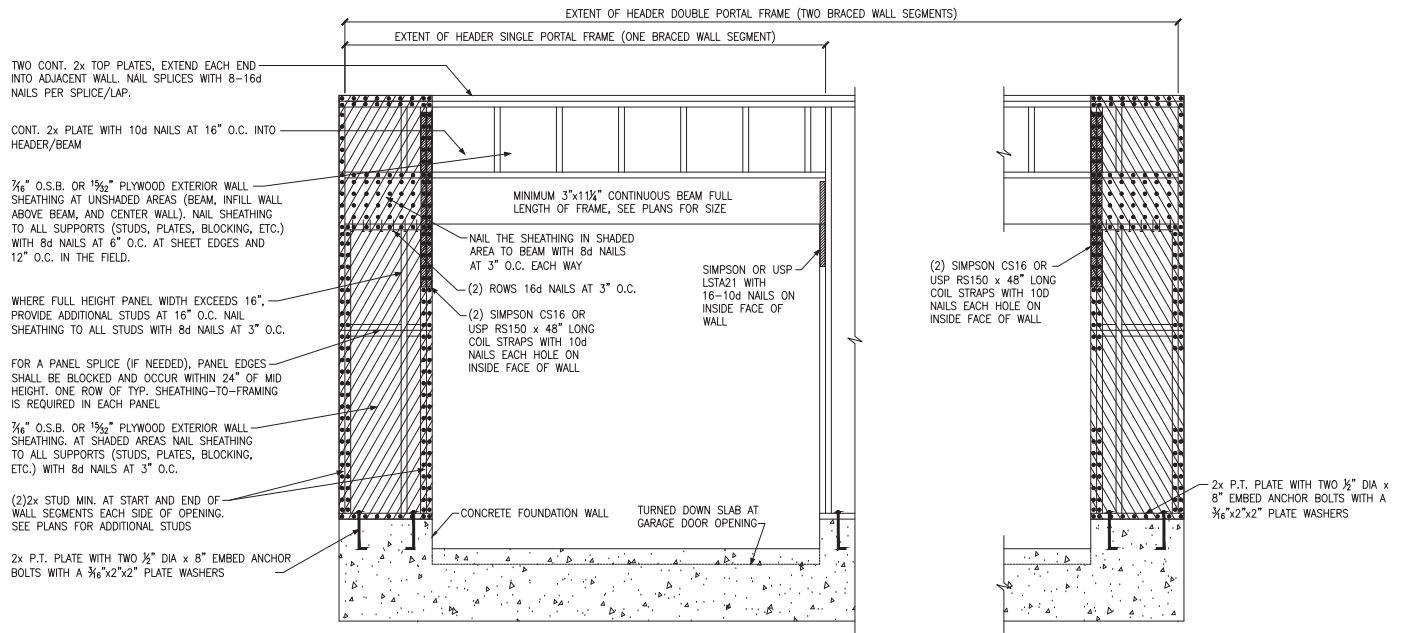

A METHOD CS-PF: CONTINUOUS PORTAL FRAME PANEL CONSTRUCTION
MONOLITHIC SLAB OR BASEMENT FOUNDATION

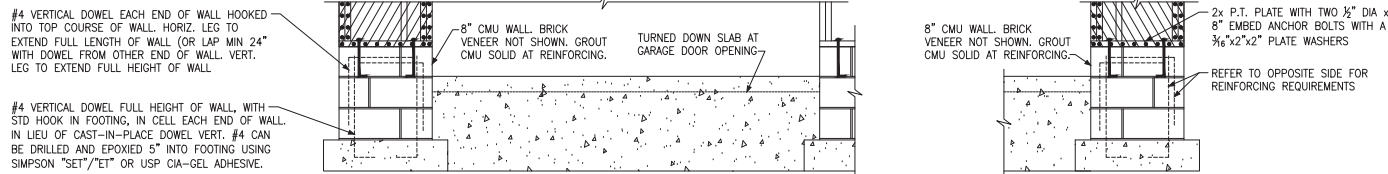

B METHOD CS-PF: CONTINUOUS PORTAL FRAME PANEL CONSTRUCTION
STEMWALL SLAB OR CRAWL SPACE FOUNDATION

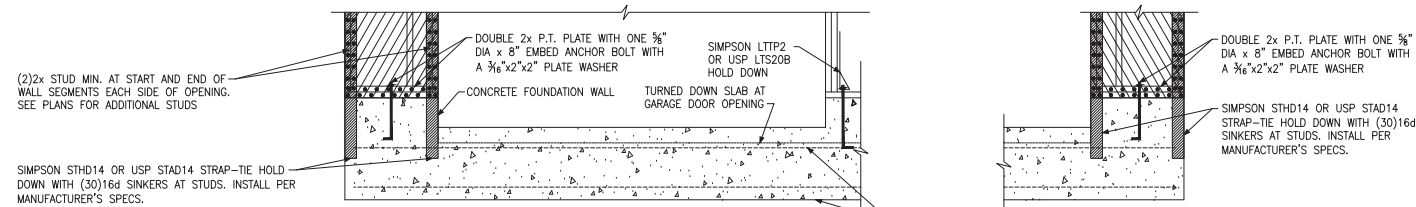


C METHOD CS-EPF: ENGINEERED PORTAL FRAME WITH HOLD-DOWNS

SIMPSON STD14 OR USP STAD14 STRAP-TIE HOLD DOWN WITH (30)16d SINKERS AT STUDS. INSTALL PER MANUFACTURER'S SPECS.


CONTINUOUS #4 HIGH AND LOW. PROVIDE MIN 24" LAPS WHERE SPICED.



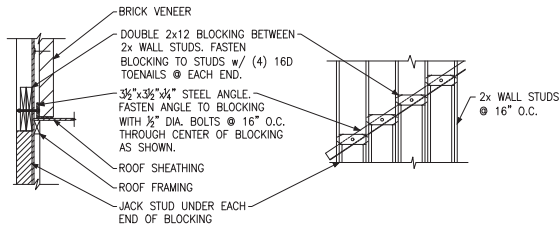


SECTION VIEW ELEVATION VIEW


(A) BRICK LEDGER CONNECTION DETAIL

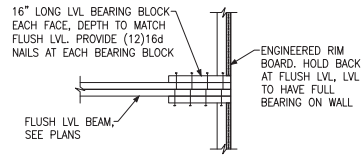

(B) BEARING ENHANCER
FLUSH LVL

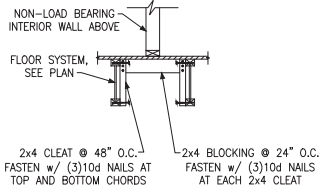


(C) LADDER BLOCKING
AS REQUIRED @ PARALLEL WALLS

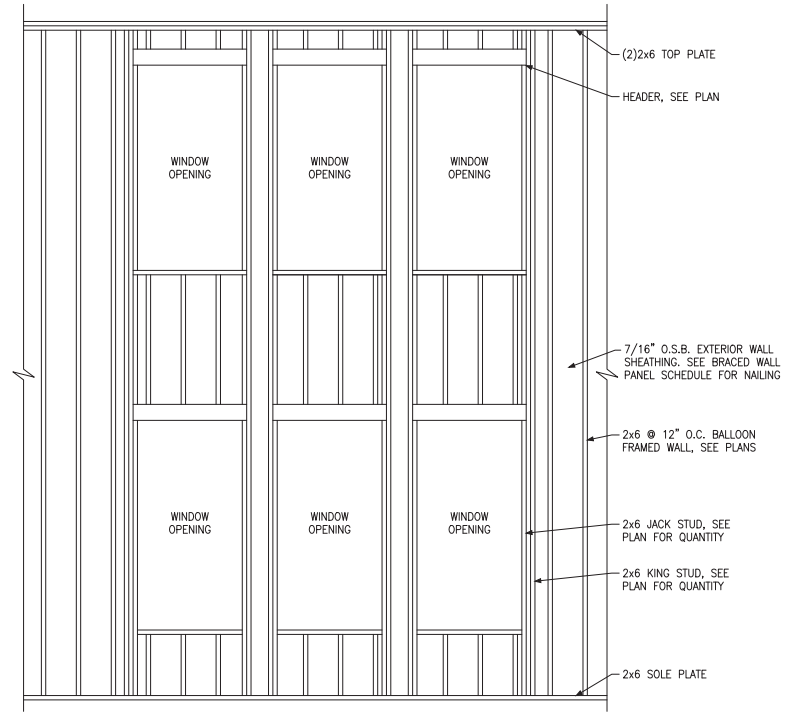


(D) BALLOON FRAMED WALL DETAIL
N.T.S.

WALL STUD SIZE, HEIGHT & SPACING SCHEDULE						
STUD SIZE	BEARING WALLS				NONBEARING WALLS	
	LATERALLY UNSUPPORTED STUD HEIGHT	MAXIMUM SPACING WHEN SUPPORTING A ROOF-CEILING ASSEMBLY OR A HABITABLE ATTIC ASSEMBLY, ONLY	MAXIMUM SPACING WHEN SUPPORTING ONE FLOOR, PLUS A ROOF-CEILING ASSEMBLY OR A HABITABLE ATTIC ASSEMBLY	MAXIMUM SPACING WHEN SUPPORTING TWO FLOORS, PLUS A ROOF-CEILING ASSEMBLY OR A HABITABLE ATTIC ASSEMBLY	LATERALLY UNSUPPORTED STUD HEIGHT	MAXIMUM SPACING
2x4	10'-0"	24"	16"	-	14'-0"	24"
2x6	10'-0"	24"	24"	16"	20'-0"	24"




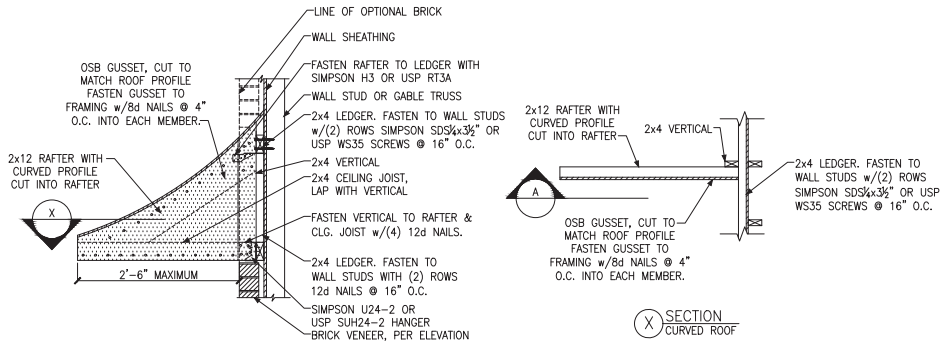


A PENT ROOF DETAIL
CURVED ROOF

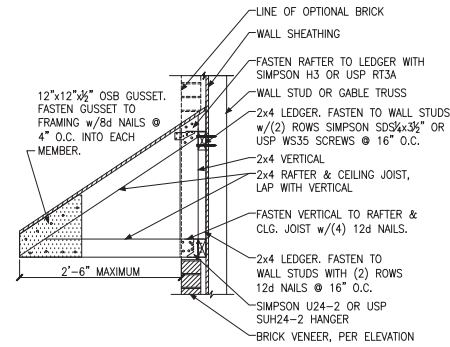


B PENT ROOF DETAIL
STRAIGHT ROOF



C EYEBROW ROOF DETAIL
STRAIGHT ROOF

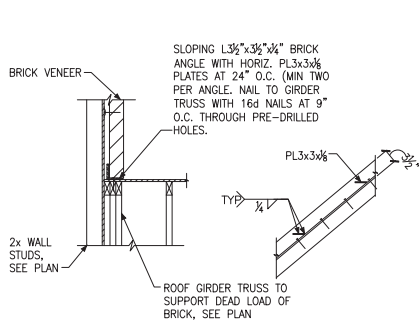

D TRUSS DETAIL

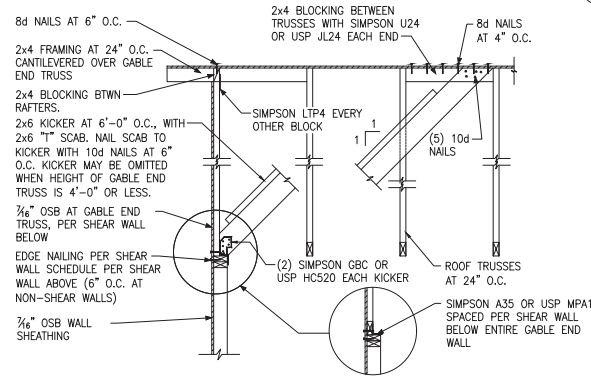

E GABLE END WALL DETAIL



Miscellaneous Framing Details

Serenity, Lot #997

A669 Kipling Model

115 M.P.H.


Raleigh, North Carolina

Project #: 047-24016
Designed By: LMR
Checked By:
Issue Date: 4/15/25
Re-Issue:
Scale: 1/8"=1'-0" @ 11x17
1/4"=1'-0" @ 22x34




David Weekley Homes
Raleigh, NC


SD-6

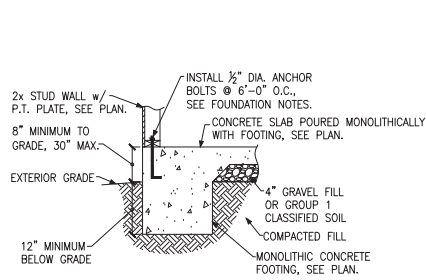


(A) FOUNDATION SECTION
EXTERIOR WALL

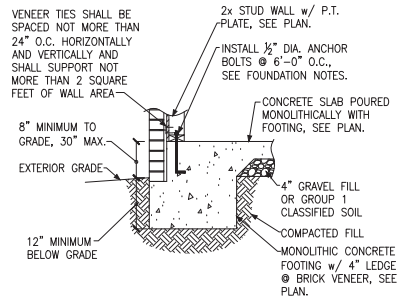


(B) FOUNDATION SECTION
EXTERIOR WALL with BRICK VENEER

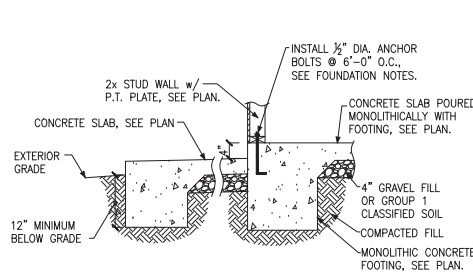


(C) FOUNDATION SECTION
EXTERIOR WALL AT PORCH

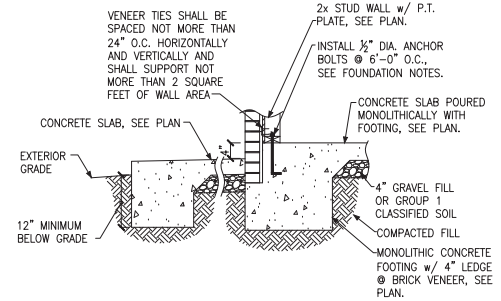


(D) FOUNDATION SECTION
EXTERIOR WALL AT PORCH with BRICK VENEER

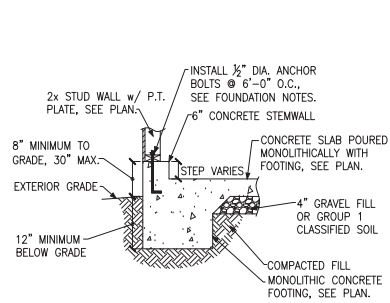


(E) FOUNDATION SECTION
EXTERIOR GARAGE WALL

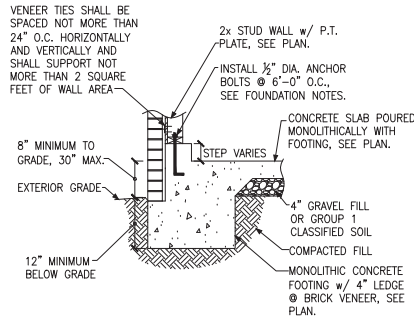


(F) FOUNDATION SECTION
EXTERIOR GARAGE WALL with BRICK VENEER

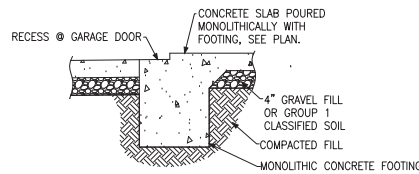


(G) GARAGE DOOR SECTION
GARAGE DOOR

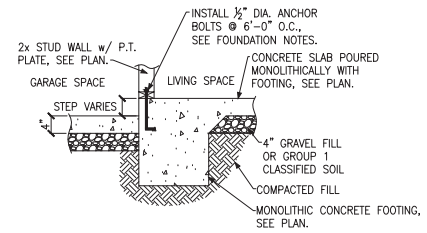


(H) THICKENED SLAB
AT GARAGE

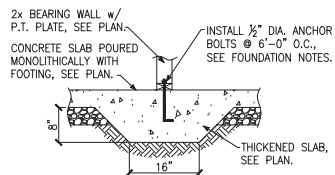


(J) THICKENED SLAB SECTION
INTERIOR BEARING WALL

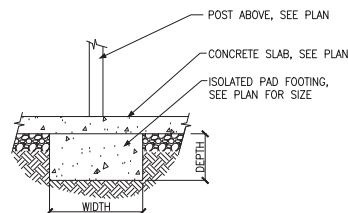

(K) ISOLATED PAD FOOTING
INTERIOR COLUMN

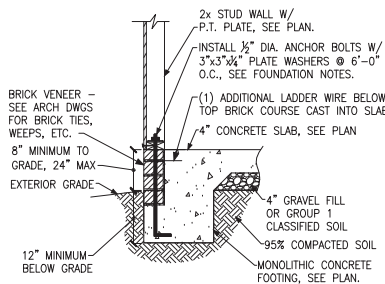

(L) FOUNDATION SECTION
ALTERNATE EXTERIOR WALL

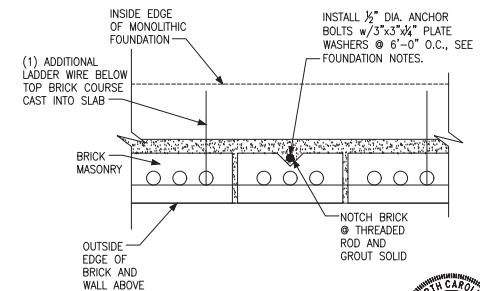

(M) FOUNDATION SECTION
ALTERNATE EXTERIOR WALL



Monolithic Slab Foundation Details

Serenity, Lot #997


A669 Kipling Model

115 M.P.H.


Raleigh, North Carolina

Project #: 047-24016
Designed By: LMR
Checked By:
Issue Date: 4/15/25
Re-Issue:
Scale: 1/8"=1'-0" @ 11x17
1/4"=1'-0" @ 22x34


SD-7

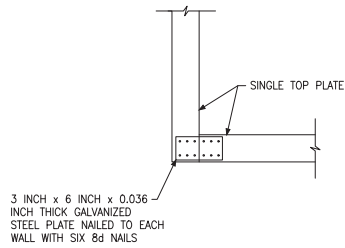


A SINGLE TOP PLATE SPLICE
WALL INTERSECTION

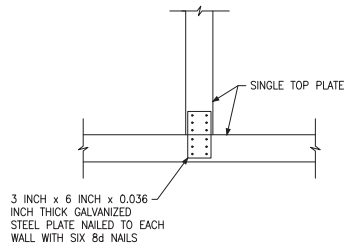


B SINGLE TOP PLATE SPLICE
WALL INTERSECTION

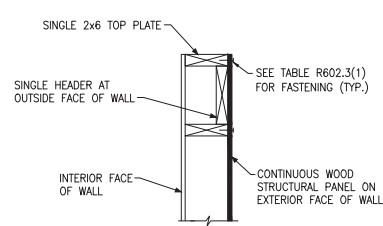


C SINGLE LOAD BEARING HEADER
EXTERIOR WALL

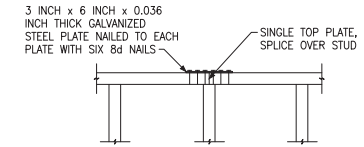


D SINGLE TOP PLATE SPLICE
INTERIOR OR EXTERIOR WALL

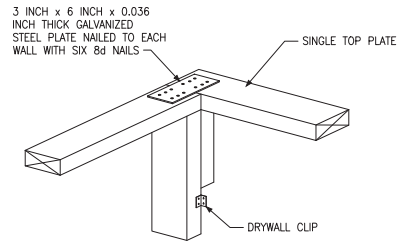


E SINGLE TOP PLATE SPLICE
WALL INTERSECTION

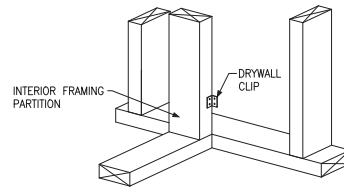


F SINGLE TOP PLATE SPLICE
WALL INTERSECTION

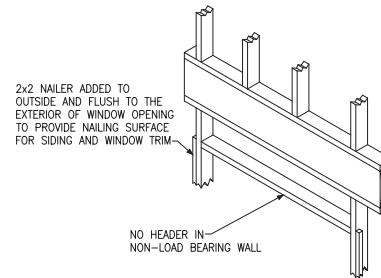


G NON-LOAD BEARING HEADER
EXTERIOR WALL

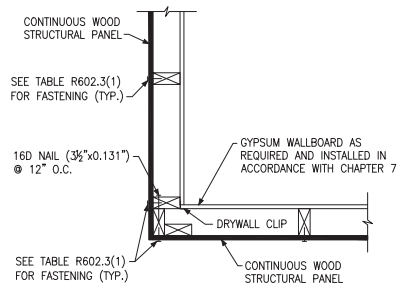

H TYPICAL EXTERIOR CORNER FRAMING
OUTSIDE CORNER DETAIL

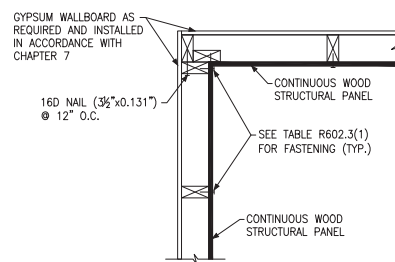

J TYPICAL EXTERIOR CORNER FRAMING
INSIDE CORNER DETAIL

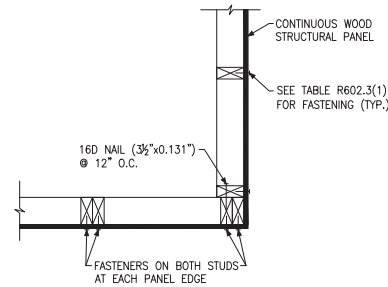

K TYPICAL EXTERIOR CORNER FRAMING
GARAGE DOOR CORNER DETAIL

ADVANCED FRAMING NOTES

- 1.) EXTERIOR WALLS TO BE 2x6 S.P.F. STUDS @ 24" O.C. WITH SINGLE TOP PLATE. TOP PLATE TO BE SPLICED PER NC RESIDENTIAL CODE.
- 2.) INTERIOR BEARING WALLS TO BE PER NC RESIDENTIAL CODE.
- 3.) ROOF TRUSSES AND FLOOR JOISTS ARE TO BE STACKED AND CENTERED OVER STUDS WITH A TOLERANCE OF NO MORE THAN 1 INCH. ADDITIONAL STUDS ARE TO BE ADDED WHERE THE ROOF TRUSSES AND FLOOR JOISTS ARE NOT STACKED OVER STUDS WITHIN 1" TOLERANCE.
- 4.) INTERIOR NON-LOAD BEARING WALLS TO BE 2x4 S.P.F. STUDS @ 24" O.C. WITH SINGLE TOP PLATE. TOP PLATE TO BE SPLICED PER NC RESIDENTIAL CODE.
- 5.) LOAD-BEARING HEADERS ARE NOT REQUIRED IN INTERIOR OR EXTERIOR NONBEARING WALLS. A SINGLE FLAT 2x MEMBER MAY BE USED AS A HEADER IN INTERIOR OR EXTERIOR NONBEARING WALLS FOR OPENINGS UP TO 8 FEET IN WIDTH IF THE VERTICAL DISTANCE TO THE PARALLEL NAILING SURFACE IS NOT MORE THAN 24 INCHES. FOR SUCH NONBEARING HEADERS, NO CRIPPLES OR BLOCKING ARE REQUIRED ABOVE THE HEADER.



Advanced Framing Details & Notes

Serenity, Lot #997

A669 Kipling Model

115 M.P.H.

Raleigh, North Carolina

Project #: 047-24016
Designed By: LMR
Checked By:
Issue Date: 4/15/25
Re-Issue:
Scale: 1/8"=1'-0" @ 11x17
1/4"=1'-0" @ 22x34

KSE ENGINEERING
1900 AM DRIVE, SUITE 201, QUAKERTOWN, PA 18951
www.kse-eng.com
(215) 864-4449

David Weekley Homes
Raleigh, NC