

Plumbing Drop Notes
1. Plumbing drop locations shown are NOT exact.
2. Contractor to verify ALL plumbing drop locations prior to setting Floor Trusses.
3. Adjust spacing as needed not to exceed 19.2"oc U.N.O.

Dimension Notes
1. All exterior wall to wall dimensions are to face of stud unless noted otherwise
2. All interior wall dimensions are to face of stud unless noted otherwise
3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

3401.81 sq.ft. Roof Area
25.1 ft. Ridge Line
25.7 ft. Hip Line
190.62 ft. Horiz. OH
191.35 ft. Raked OH
117 sheets Decking


All Walls Shown Are
Considered Load Bearing

= Indicates Left End of Truss ▲
(Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

WALL SCHEDULE	
1st Floor Walls	
2nd Floor Walls	
Non-Bearing Walls	
Garage Walls Dropped	

Products					
Net Qty	Plies	Product	Length	PlotID	
2	2	1-3/4"x 14" LVL Kerto-S	12' 0"	FB1	
2	2	1-3/4"x 14" LVL Kerto-S	5' 0"	FB2	
1	1	1-3/4"x 14" LVL Kerto-S	4' 0"	FB3	
2	2	1-3/4"x 14" LVL Kerto-S	4' 0"	FB4	
3	3	1-3/4"x 18" LVL Kerto-S	20' 0"	FB5	
2	2	2x10 SPF No.2	20' 0"	BBO	
4	2	2x10 SPF No.2	8' 0"	BBO	
2	2	2x10 SPF No.2	6' 0"	BBO	

Nail Information		Connector Information				
Truss	Header	Supported Member	Qty	Manuf	Product	Sym
16d/3-1/2"	16d/3-1/2"	NA	5	USP	HUS410	

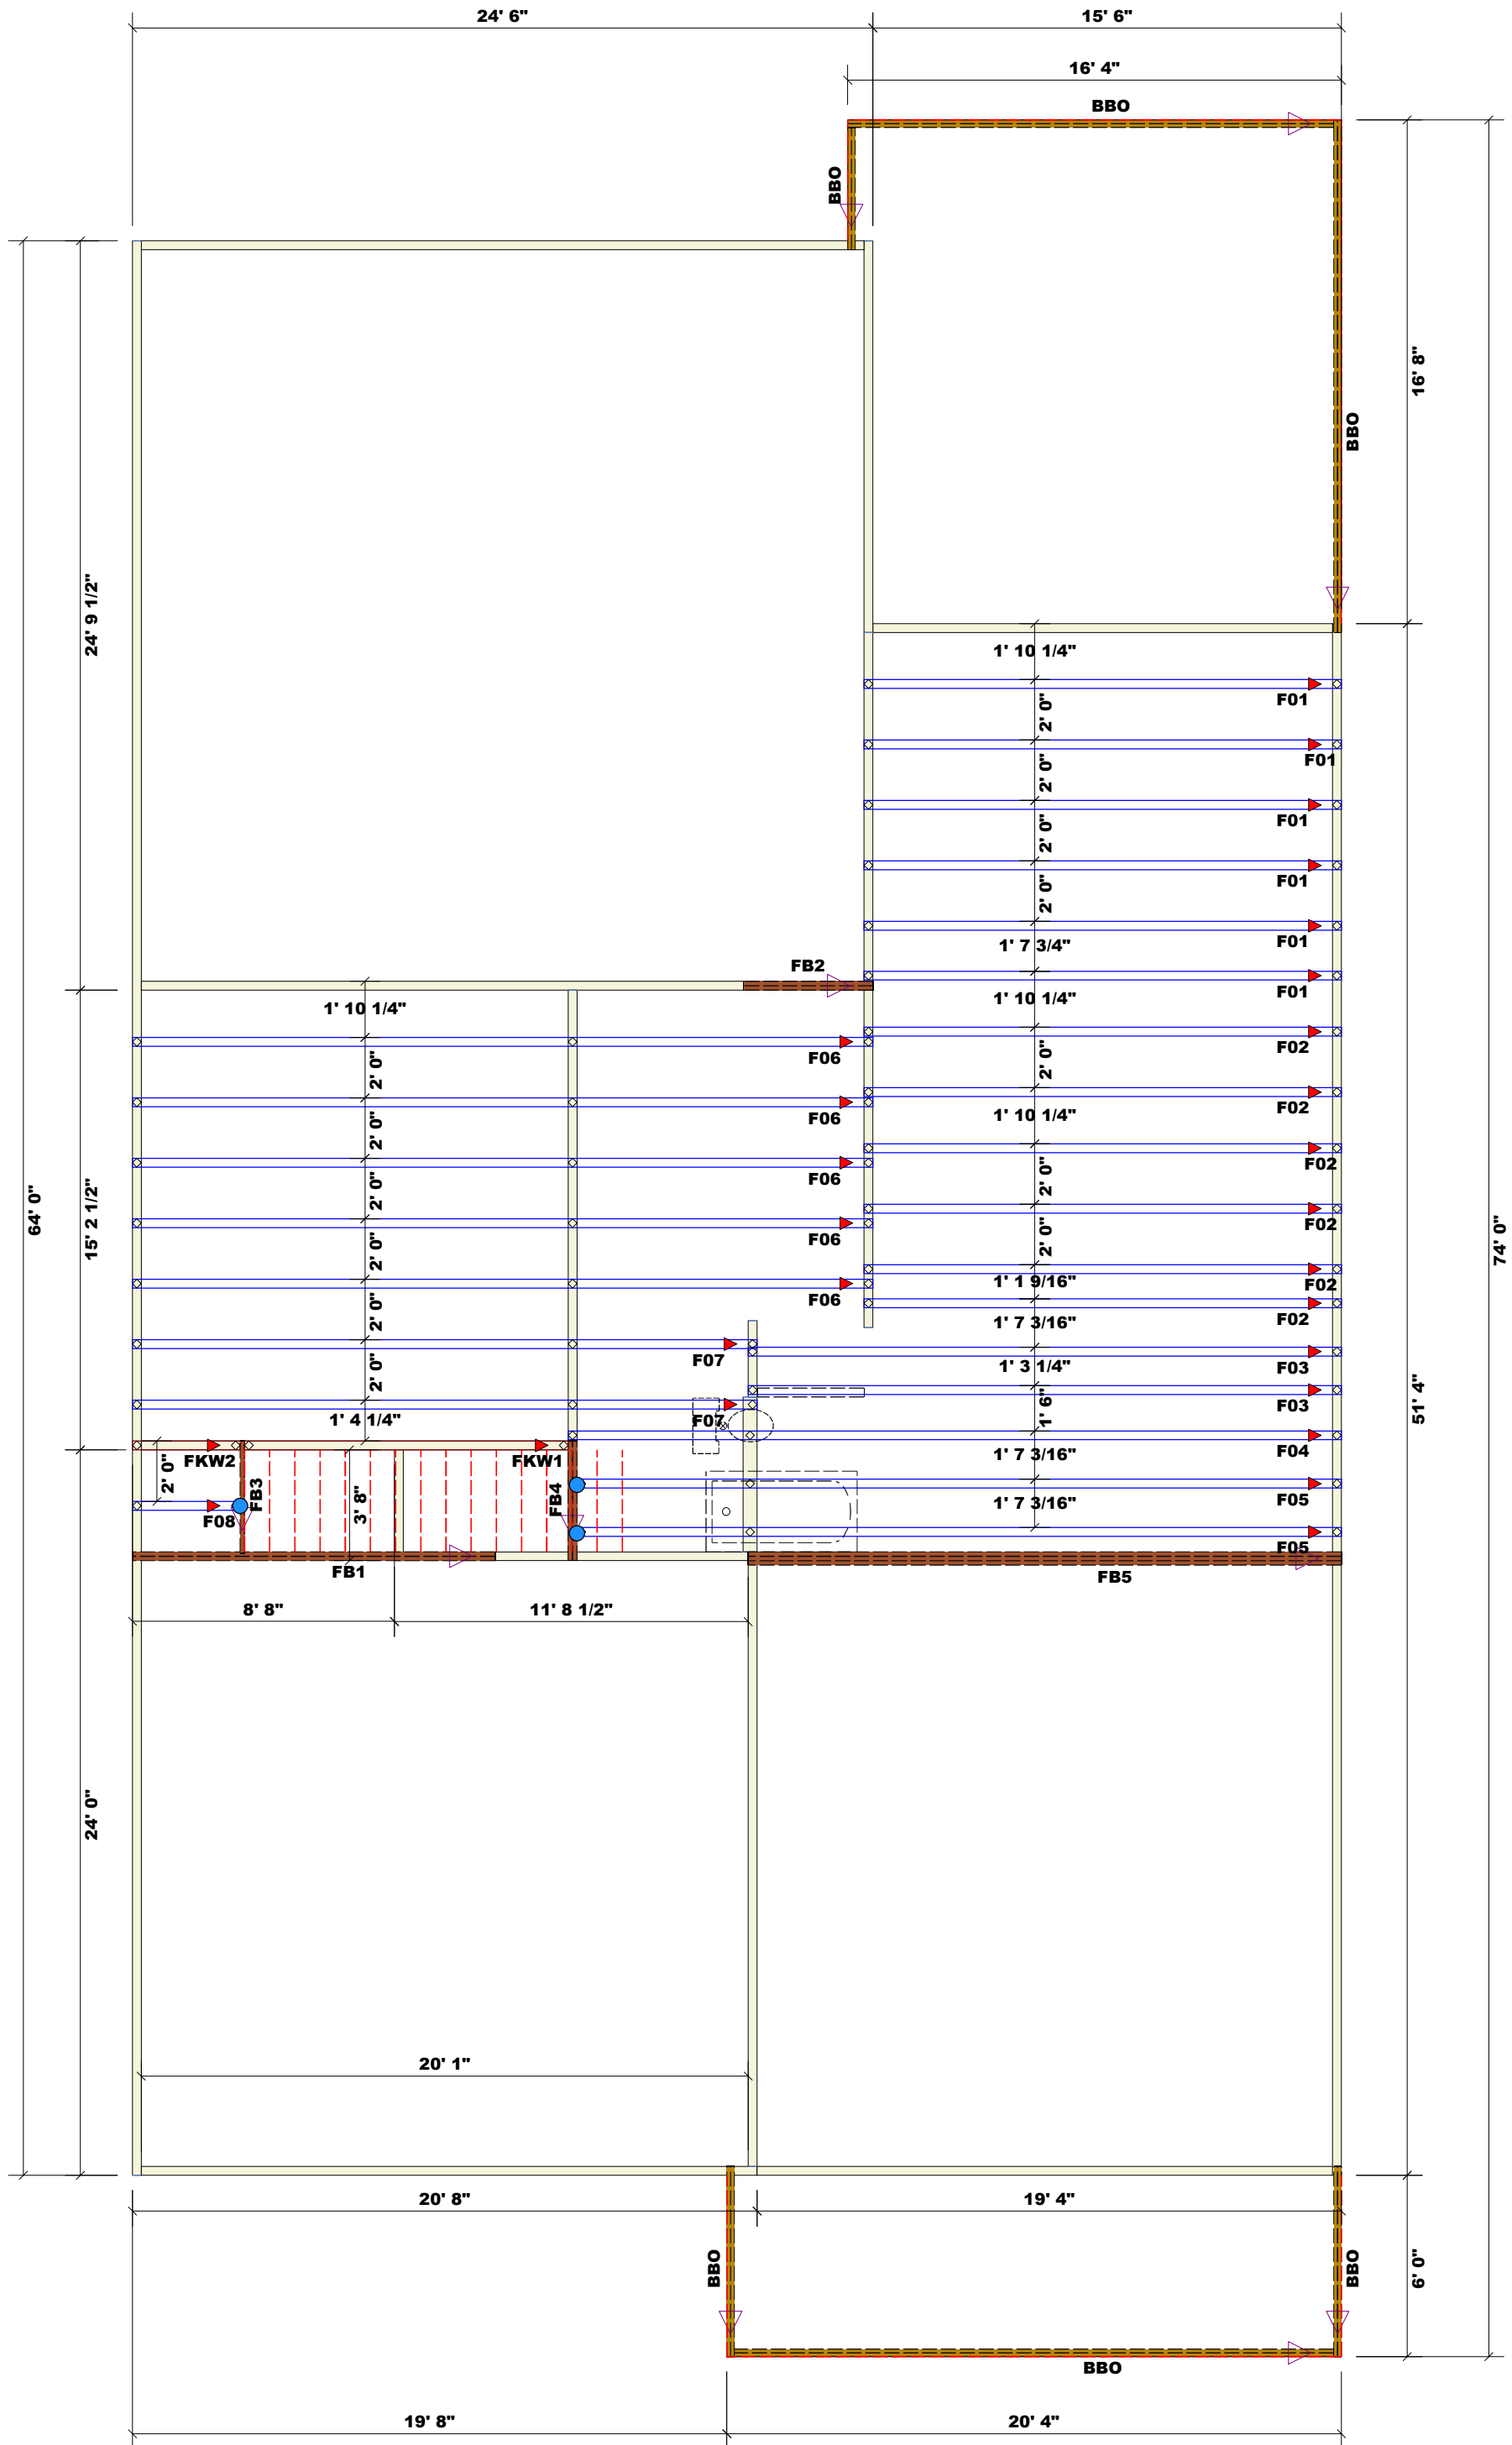

▲ = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

Truss Placement Plan
SCALE: NTS

LOAD CHART FOR JACK STUDS			
(BASED ON TABLES R502.5(1) & (b))			
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADS/GUDES			
END REACTION (UP TO) 1700	END REACTION (UP TO) 2550	END REACTION (UP TO) 3400	END REACTION (UP TO) 4250
1	1	1	1
2	2	2	2
3	3	3	3
4	4	4	4
5	5	5	5
6	6	6	6
7	7	7	7
8	8	8	8
9	9	9	9

BUILDER	New Home Inc.
JOB NAME	Lot 191 Ballard Road
PLAN	The Clayton - Low Country - Face
SEAL DATE	Seal Date
QUOTE #	B0224-1009
JOB #	J0525-2586

CITY / CO.	Fuquay-Varina / Wake
ADDRESS	1865 Ballard Road
MODEL	Floor
DATE REV.	10/28/24
DRAWN BY	Johnnie Baggett
SALES REP.	Johnnie Baggett

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSB-1 and BCSB-3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature Johnnie Baggett
Johnnie Baggett

comtech
ROOF & FLOOR
TRUSSES & BEAMS
Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0525-2586
Lot 191 Ballard Road

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I73627060 thru I73627069

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844



May 21, 2025

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2586	F01	Floor	6	1	173627060
Job Reference (optional)					

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:59 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

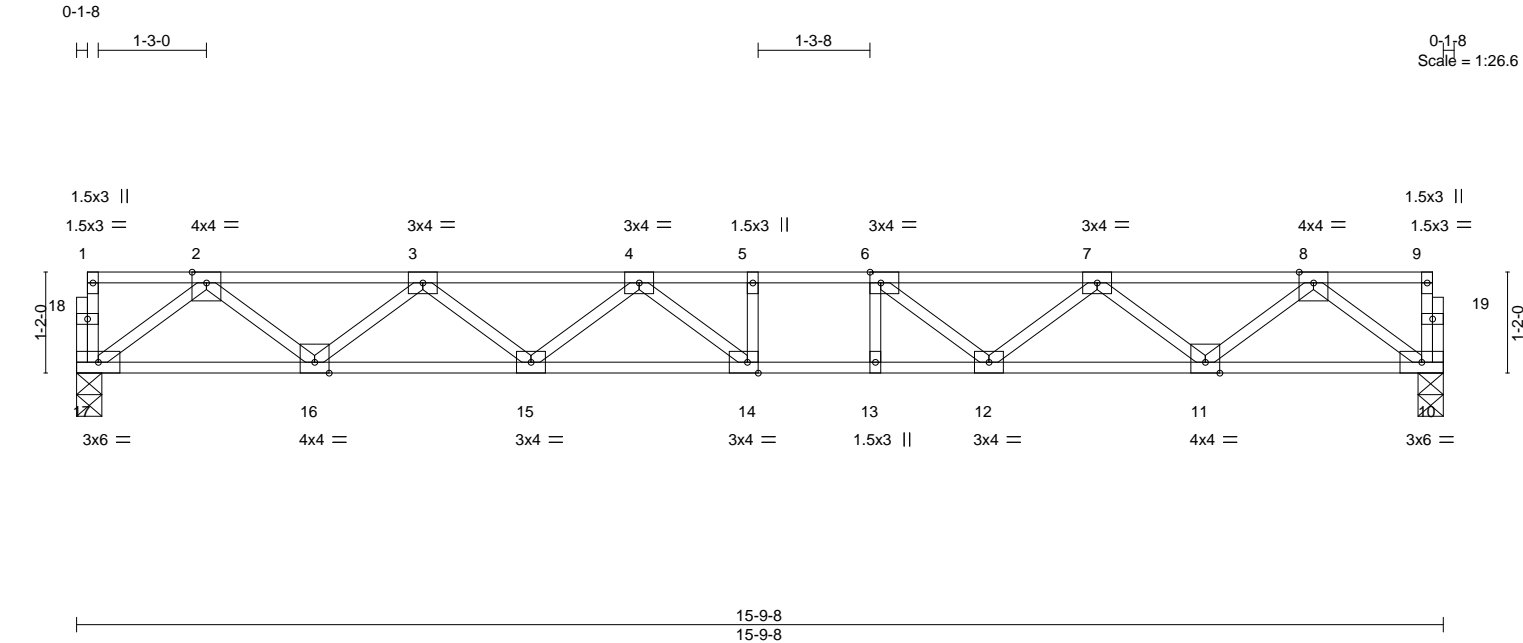



Plate Offsets (X,Y)--		[6:0-1-8,Edge], [14:0-1-8,Edge]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 40.0	Plate Grip DOL	1.00	TC 0.37
TCDL 10.0	Lumber DOL	1.00	BC 0.70
BCLL 0.0	Rep Stress Incr	YES	WB 0.44
BCDL 5.0	Code	IRC2021/TPI2014	Matrix-S
			DEFL. in (loc) l/defl L/d
			Vert(LL) -0.18 14 >999 480
			Vert(CT) -0.25 14-15 >739 360
			Horz(CT) 0.05 10 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 80 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 17=0-3-8, 10=0-3-8
Max Grav 17=849(LC 1), 10=849(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1757/0, 3-4=-2785/0, 4-5=-3148/0, 5-6=-3148/0, 6-7=-2780/0, 7-8=-1759/0
BOT CHORD 16-17=0/1055, 15-16=0/2429, 14-15=0/3102, 13-14=0/3148, 12-13=0/3148, 11-12=0/2425, 10-11=0/1056
WEBS 2-17=-1320/0, 2-16=0/915, 3-16=-875/0, 3-15=0/464, 4-15=-412/0, 4-14=-208/381, 8-10=-1322/0, 8-11=0/915, 7-11=-867/0, 7-12=0/505, 6-12=-599/0

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) Plates checked for a plus or minus 1 degree rotation about its center.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails.
Strongbacks to be attached to walls at their outer ends or restrained by other means.

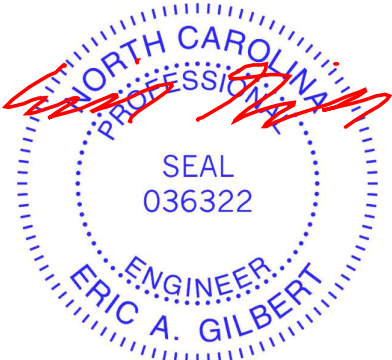


May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2586	F02	FLOOR	6	1	173627061
Job Reference (optional)					

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:59 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

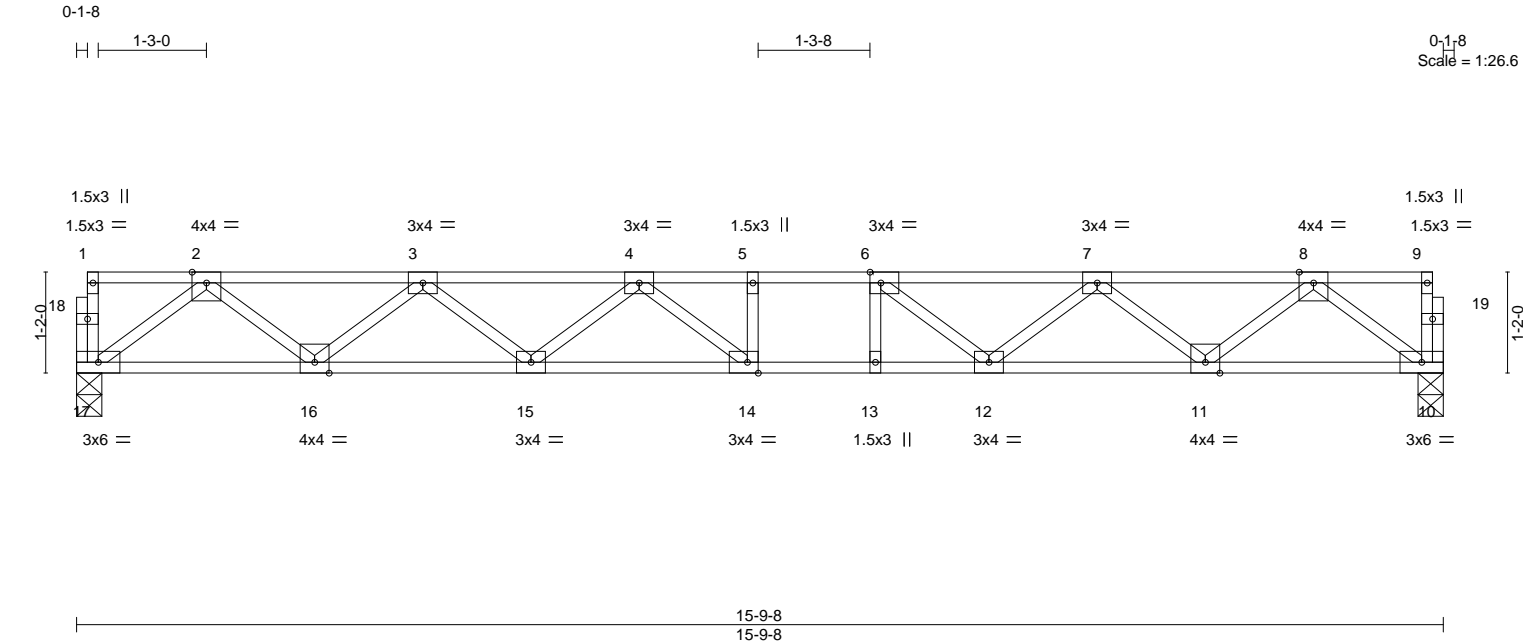

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.37	Vert(LL)	-0.18 14 >999 480	MT20		244/190	
TCDL	10.0	Lumber DOL	1.00	BC	0.70	Vert(CT)	-0.25 14-15 >739 360				
BCLL	0.0	Rep Stress Incr	YES	WB	0.44	Horz(CT)	0.05 10 n/a n/a				
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-S							
								Weight: 80 lb		FT = 20%F, 11%E	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (size) 17=0-3-8, 10=0-3-8
Max Grav 17=849(LC 1), 10=849(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1757/0, 3-4=-2785/0, 4-5=-3148/0, 5-6=-3148/0, 6-7=-2780/0, 7-8=-1759/0
BOT CHORD 16-17=0/1055, 15-16=0/2429, 14-15=0/3102, 13-14=0/3148, 12-13=0/3148, 11-12=0/2425, 10-11=0/1056
WEBS 2-17=-1320/0, 2-16=0/915, 3-16=-875/0, 3-15=0/464, 4-15=-412/0, 4-14=-208/381, 8-10=-1322/0, 8-11=0/915, 7-11=-867/0, 7-12=0/505, 6-12=-599/0

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) Plates checked for a plus or minus 1 degree rotation about its center.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2586	F03	FLOOR	2	1	173627062

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:14:00 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

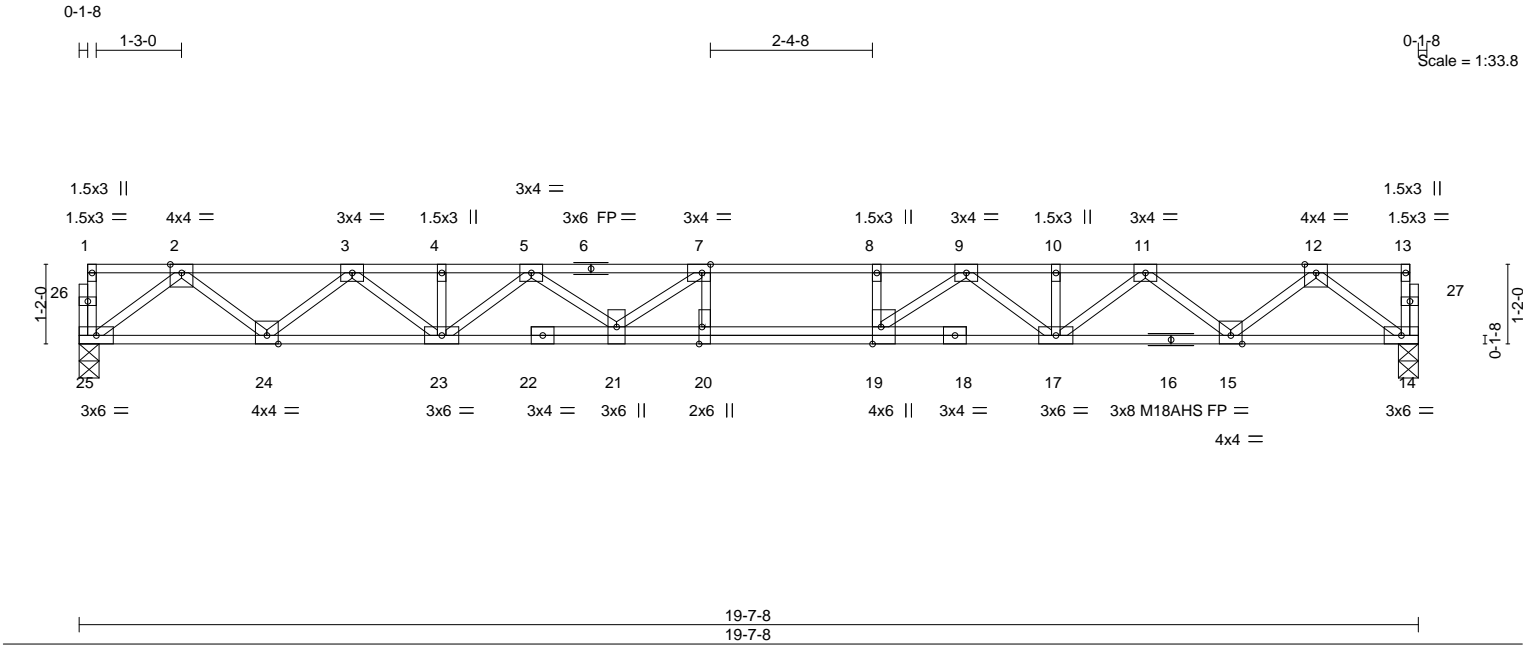



Plate Offsets (X,Y)-- [7:0-1-8,Edge], [19:0-3-0,Edge], [20:0-3-0,Edge]									
LOADING (psf)		SPACING- 1-7-3		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.29	Vert(LL)	-0.26 20 >884 480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.56	Vert(CT)	-0.36 20 >644 360	M18AHS	186/179
BCLL	0.0	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.05 14 n/a n/a	Weight: 107 lb FT = 20%F, 11%E	
BCDL	5.0	Code IRC2021/TPI2014		Matrix-S					

LUMBER-		BRACING-	
TOP CHORD	2x4 SP 2400F 2.0E(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP 2400F 2.0E(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (size) 25=0-3-8, 14=0-3-8
Max Grav 25=847(LC 1), 14=847(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1829/0, 3-4=-3076/0, 4-5=-3076/0, 5-7=-3887/0, 7-8=-4085/0, 8-9=-4085/0,
9-10=-3070/0, 10-11=-3070/0, 11-12=-1832/0
BOT CHORD 24-25=0/1070, 23-24=0/2548, 21-23=0/3601, 20-21=0/4085, 19-20=0/4085, 17-19=0/3601,
15-17=0/2541, 14-15=0/1072
WEBS 2-25=-1340/0, 2-24=0/988, 3-24=-936/0, 3-23=0/673, 12-14=-1343/0, 12-15=0/989,
11-15=-923/0, 11-17=0/675, 9-17=-677/0, 9-19=0/777, 5-23=-671/0, 5-21=0/439,
7-21=-566/114

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) All plates are MT20 plates unless otherwise indicated.
3) Plates checked for a plus or minus 1 degree rotation about its center.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails.
Strongbacks to be attached to walls at their outer ends or restrained by other means.

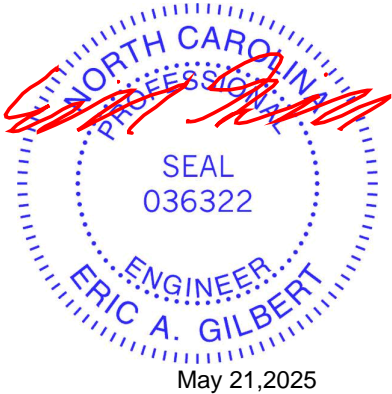

May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2586	F04	FLOOR	1	1	173627063

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:14:00 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

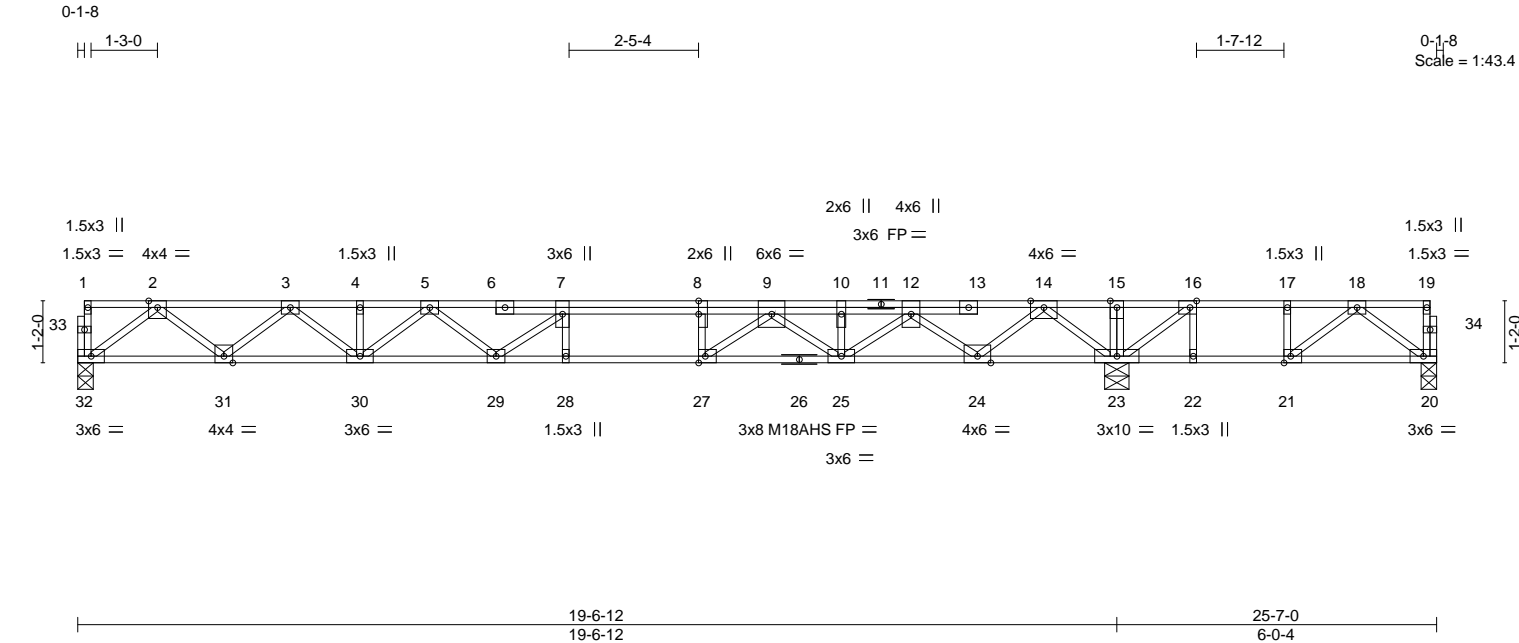


Plate Offsets (X,Y)-- [8:0-3-0,0-0-0], [16:0-1-8,Edge], [21:0-1-8,Edge], [27:0-1-8,Edge]									
LOADING (psf)		SPACING- 1-7-3		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.88	Vert(LL)	-0.27 28 >863 480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.76	Vert(CT)	-0.37 28 >629 360	M18AHS	186/179
BCLL	0.0	Rep Stress Incr	YES	WB	0.54	Horz(CT)	0.06 23 n/a n/a	Weight: 141 lb FT = 20%F, 11%E	
BCDL	5.0	Code IRC2021/TPI2014		Matrix-S					

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (size) 32=0-3-8, 20=0-3-8, 23=0-5-8
Max Uplift 20=-157(LC 3)
Max Grav 32=787(LC 10), 20=208(LC 4), 23=1394(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1675/0, 3-4=-2798/0, 4-5=-2798/0, 5-7=-3346/0, 7-8=-3486/0, 8-9=-3486/0, 9-10=-2399/0, 10-12=-2399/0, 12-14=-843/0, 14-15=0/1329, 15-16=0/1329, 16-17=-182/673, 17-18=-182/673
BOT CHORD 31-32=0/990, 30-31=0/2331, 29-30=0/3164, 28-29=0/3486, 27-28=0/3486, 25-27=0/2879, 24-25=0/1710, 22-23=-673/182, 21-22=-673/182
WEBS 2-32=-1240/0, 2-31=0/892, 3-31=-855/0, 3-30=0/596, 5-30=-467/0, 5-29=0/387, 7-29=-409/58, 14-23=-1485/0, 14-24=0/1127, 12-24=-1118/0, 12-25=0/865, 9-25=-612/0, 9-27=0/977, 8-27=-509/0, 18-20=-254/299, 18-21=-554/0, 16-23=-1050/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 1 degree rotation about its center.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 157 lb uplift at joint 20.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2586	F05	FLOOR	2	1	I73627064

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:14:01 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

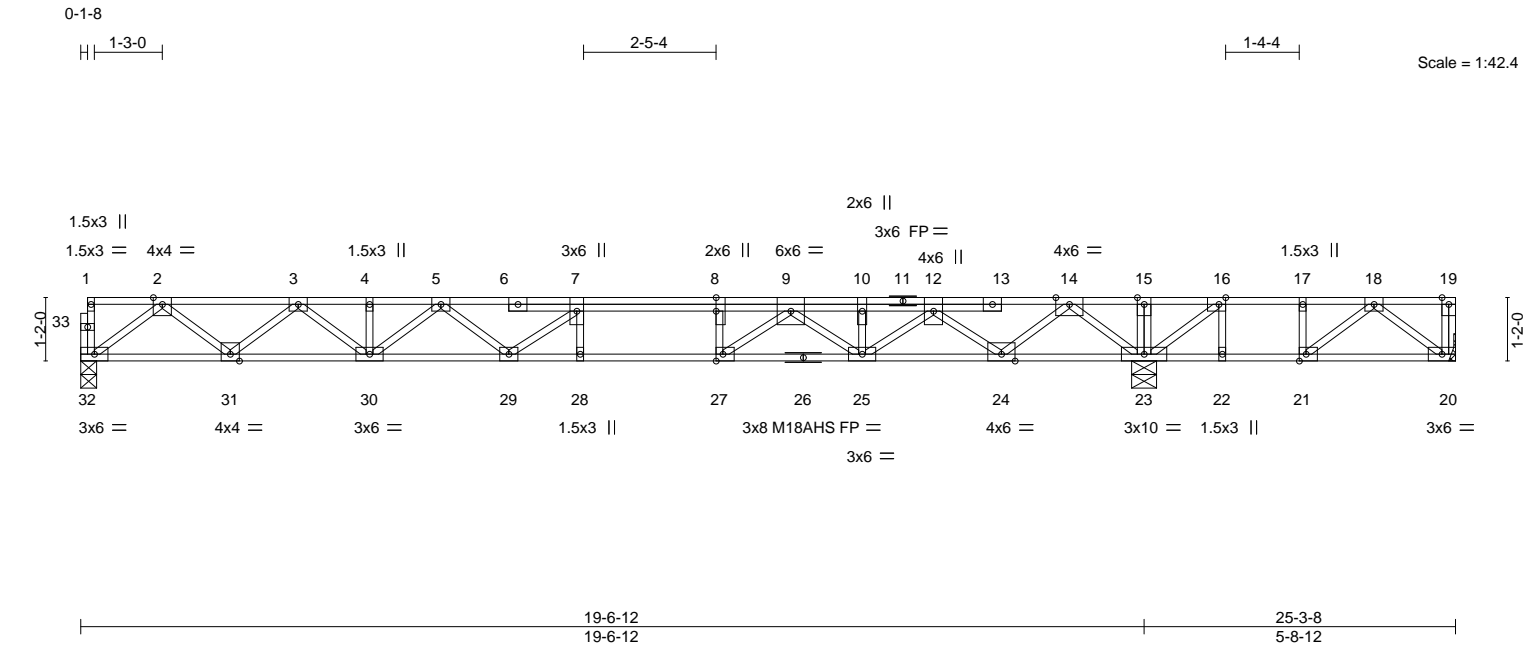


Plate Offsets (X,Y)--		[8:0-3-0,0-0-0], [16:0-1-8,Edge], [21:0-1-8,Edge], [27:0-1-8,Edge]	
LOADING (psf)		SPACING-	
TCLL	40.0	Plate Grip DOL	1.00
TCDL	10.0	Lumber DOL	1.00
BCLL	0.0	Rep Stress Incr	YES
BCDL	5.0	Code	IRC2021/TPI2014
		CSI.	
		TC	0.91
		BC	0.76
		WB	0.54
		Matrix-S	
		DEFL.	
		in (loc)	l/defl L/d
		Vert(LL)	-0.26 28 >884 480
		Vert(CT)	-0.36 28 >645 360
		Horz(CT)	0.06 23 n/a n/a
		PLATES	
		MT20	244/190
		M18AHS	186/179
		GRIP	
		Weight: 140 lb	FT = 20%F, 11%E

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (size) 32=0-3-8, 20=Mechanical, 23=0-5-8
Max Uplift 20=-209(LC 3)
Max Grav 32=775(LC 10), 20=183(LC 4), 23=1446(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1644/0, 3-4=-2736/0, 4-5=-2736/0, 5-7=-3251/0, 7-8=-3361/0, 8-9=-3361/0, 9-10=-2221/0, 10-12=-2221/0, 12-14=-645/0, 14-15=0/1533, 15-16=0/1533, 16-17=-101/811, 17-18=-101/811
BOT CHORD 31-32=0/974, 30-31=0/2286, 29-30=0/3091, 28-29=0/3361, 27-28=0/3361, 25-27=0/2718, 24-25=0/1523, 23-24=-339/0, 22-23=-811/101, 21-22=-811/101, 20-21=-308/166
WEBS 2-32=-1219/0, 2-31=0/873, 3-31=-836/0, 3-30=0/575, 5-30=-453/0, 5-29=0/363, 7-29=-379/83, 14-23=-1504/0, 14-24=0/1140, 12-24=-1131/0, 12-25=0/876, 9-25=-631/0, 9-27=0/1006, 8-27=-524/0, 18-20=-209/387, 16-23=-1111/0, 18-21=-642/0, 17-21=0/266

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 1 degree rotation about its center.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 209 lb uplift at joint 20.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) CAUTION, Do not erect truss backwards.



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Comtech, Inc. Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:14:02 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRcDoi7J4Czf?

Technical drawing of a roof truss (Dachstuhl) showing the internal structure with various beams and supports. The drawing includes dimensions and labels for different parts of the truss.

Dimensions:

- Overall height: 29
- Overall width: 30
- Truss height: 1-2-0

Labels and Components:

- 1.5x3 || (Top left)
- 1.5x3 = (Top left)
- 4x4 = (Top center)
- 3x6 FP = (Top center)
- 1.5x3 = (Top right)
- 1.5x3 || (Bottom left)
- 1.5x3 || (Bottom left)
- 3x6 FP = (Bottom center)
- 4x6 = (Bottom center)
- 4x4 = (Bottom center)
- 1.5x3 || (Bottom right)
- 1.5x3 || (Bottom right)
- 3x6 = (Bottom right)

Truss Structure:

- Top chord: 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14
- Bottom chord: 28, 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15
- Vertical supports: 28, 22, 15
- Diagonal bracing: 1-2, 2-3, 3-4, 4-5, 5-6, 6-7, 7-8, 8-9, 9-10, 10-11, 11-12, 12-13, 13-14

Dimensions and Spacing:


- 9-11-4
- 9-11-4
- 24-6-0
- 14-6-12

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1 (flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1 (flat)	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3 (flat)		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-800/29, 3-4=-962/207, 4-5=-525/536, 5-6=0/1437, 6-7=0/1437, 7-8=-760/44, 8-10=-1818/0, 10-11=-2226/0, 11-12=-2111/0, 12-13=-1421/0
BOT CHORD	27-28=0/576, 26-27=-207/962, 25-26=-207/962, 24-25=-207/962, 22-24=-792/129, 21-22=-344/48, 20-21=0/1444, 19-20=0/2226, 18-19=0/2226, 17-18=0/2226, 16-17=0/1938, 15-16=0/874
WEBS	2-28=-720/0, 2-27=-84/292, 5-22=-981/0, 5-24=0/655, 4-24=-775/0, 7-22=-1371/0, 7-21=0/975, 8-21=-935/0, 8-20=0/541, 13-15=-1093/0, 13-16=0/712, 12-16=-673/0, 12-17=0/260, 11-17=-272/121, 10-20=-644/0

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Plates checked for a plus or minus 1 degree rotation about its center.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10'-0" oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 5) CAUTION, Do not erect truss backwards.



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI 1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

ENGINEERING BY
TRENCO
A MI Tek Affiliate


818 Soundside Road
Edenton, NC 27932

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:14:02 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-rfC?PsB70Hq3NSgPqnL8w3uITXBGKWrcDoi7J4zJC?f

[illegible]

NOTES-

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Plates checked for a plus or minus 1 degree rotation about its center.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 61 lb uplift at joint 25.
- 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 6) CAUTION, Do not erect truss backwards.



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A Mi Tek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2586	FKW1	Floor Supported Gable	1	1	173627068
					Job Reference (optional)

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:14:03 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

0-1-8

Scale = 1:17.7

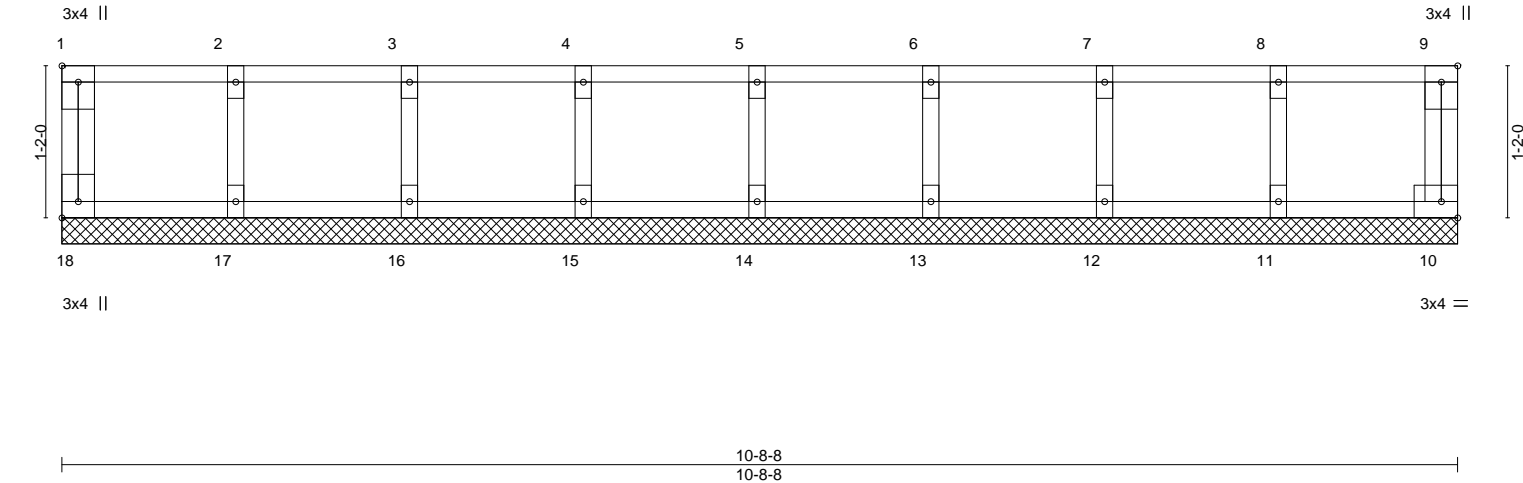



Plate Offsets (X,Y)-- [1:Edge,0-1-8], [18:Edge,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.06	Vert(LL)	n/a - n/a	999	MT20 244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(CT)	n/a - n/a	999	
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00 10 n/a	n/a	
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-R					
								Weight: 47 lb	FT = 20%F, 11%E

LUMBER-				BRACING-	
TOP CHORD	2x4 SP No.1(flat)			TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)			BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)				
OTHERS	2x4 SP No.3(flat)				

REACTIONS. All bearings 10-8-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 18, 10, 17, 16, 15, 14, 13, 12, 11

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.

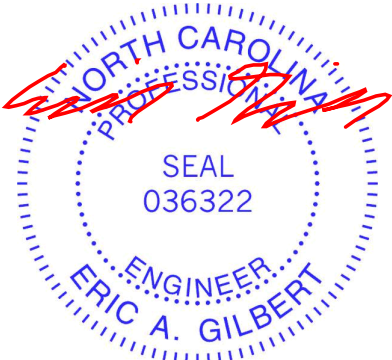

May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627069
J0525-2586	FKW2	Floor Supported Gable	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:14:03 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

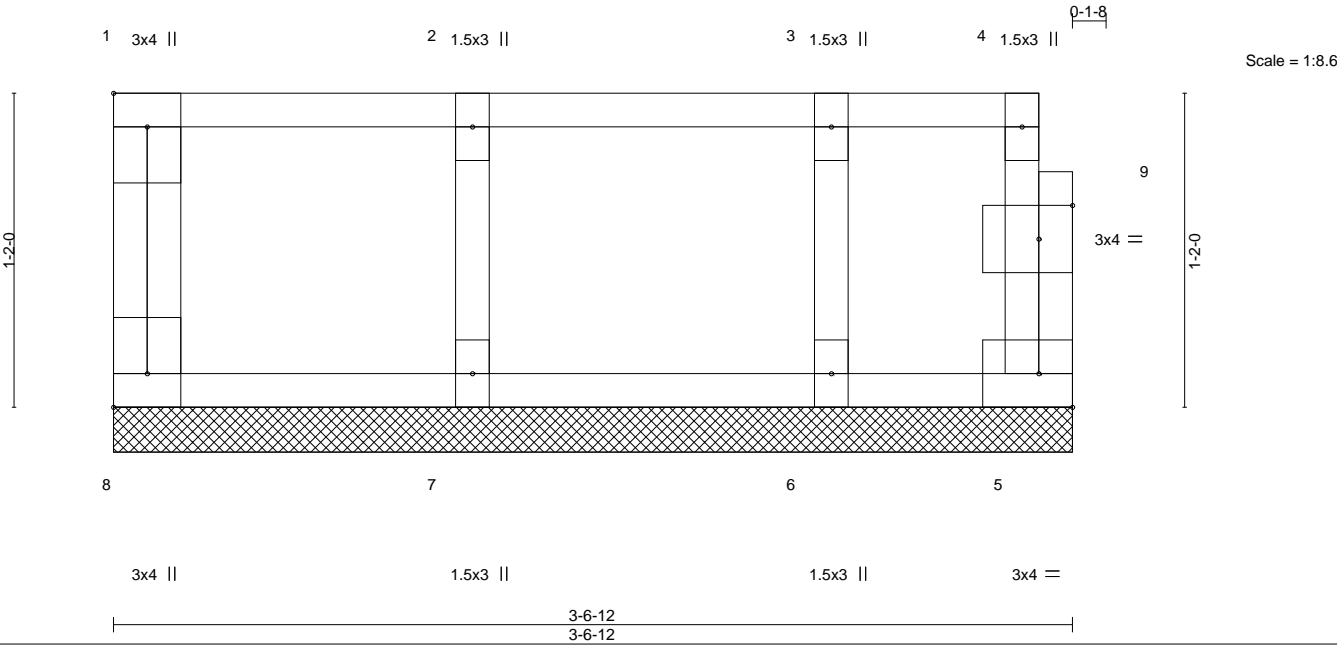


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [8:Edge,0-1-8], [9:0-1-8,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.06	Vert(LL)	n/a - n/a	999	MT20 244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(CT)	n/a - n/a	999	
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00 5 n/a	n/a	
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-R					Weight: 18 lb FT = 20%F, 11%E

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 3-6-12 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS. All bearings 3-6-12.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 8, 5, 7, 6

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Plates checked for a plus or minus 1 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails.
Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.





May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

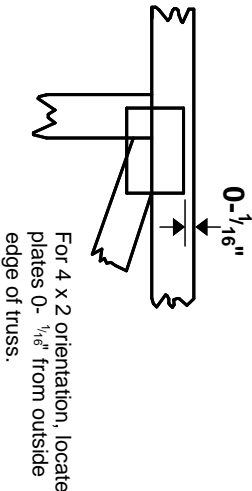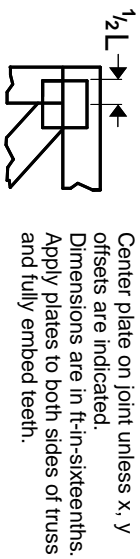

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

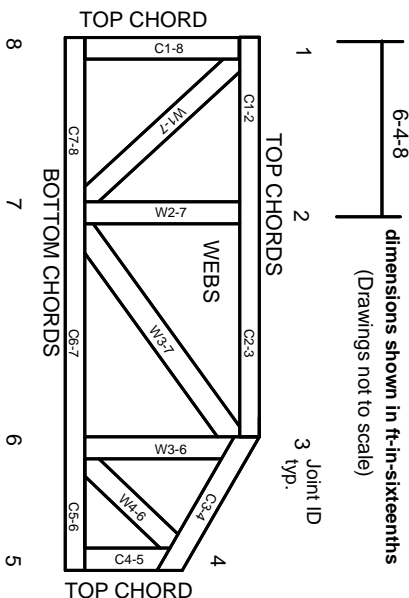

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023

Dimension Notes
1. All exterior wall to wall dimensions are to face of stud unless noted otherwise
2. All interior wall dimensions are to face of stud unless noted otherwise
3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

= 3401.81 sq.ft. Roof Area
= 25.1 ft. Ridge Line
= 25.7 ft. Hip Line
= 190.62 ft. Horiz. OH
= 191.35 ft. Raked OH
= 117 sheets Decking


All Walls Shown Are Considered Load Bearing

= Indicates Left End of Truss ▲
(Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

WALL SCHEDULE	
1st Floor Walls	
2nd Floor Walls	
Non-Bearing Walls	
Garage Walls Dropped	

16d/3-1/2"	16d/3-1/2"	NA	24	USP	HUS26	
------------	------------	----	----	-----	-------	--

Products					
Net Qty	Plies	Product	Length	PlotID	
3	3	1-3/4"x 14" LVL Kerto-S	16' 0"	FB6	

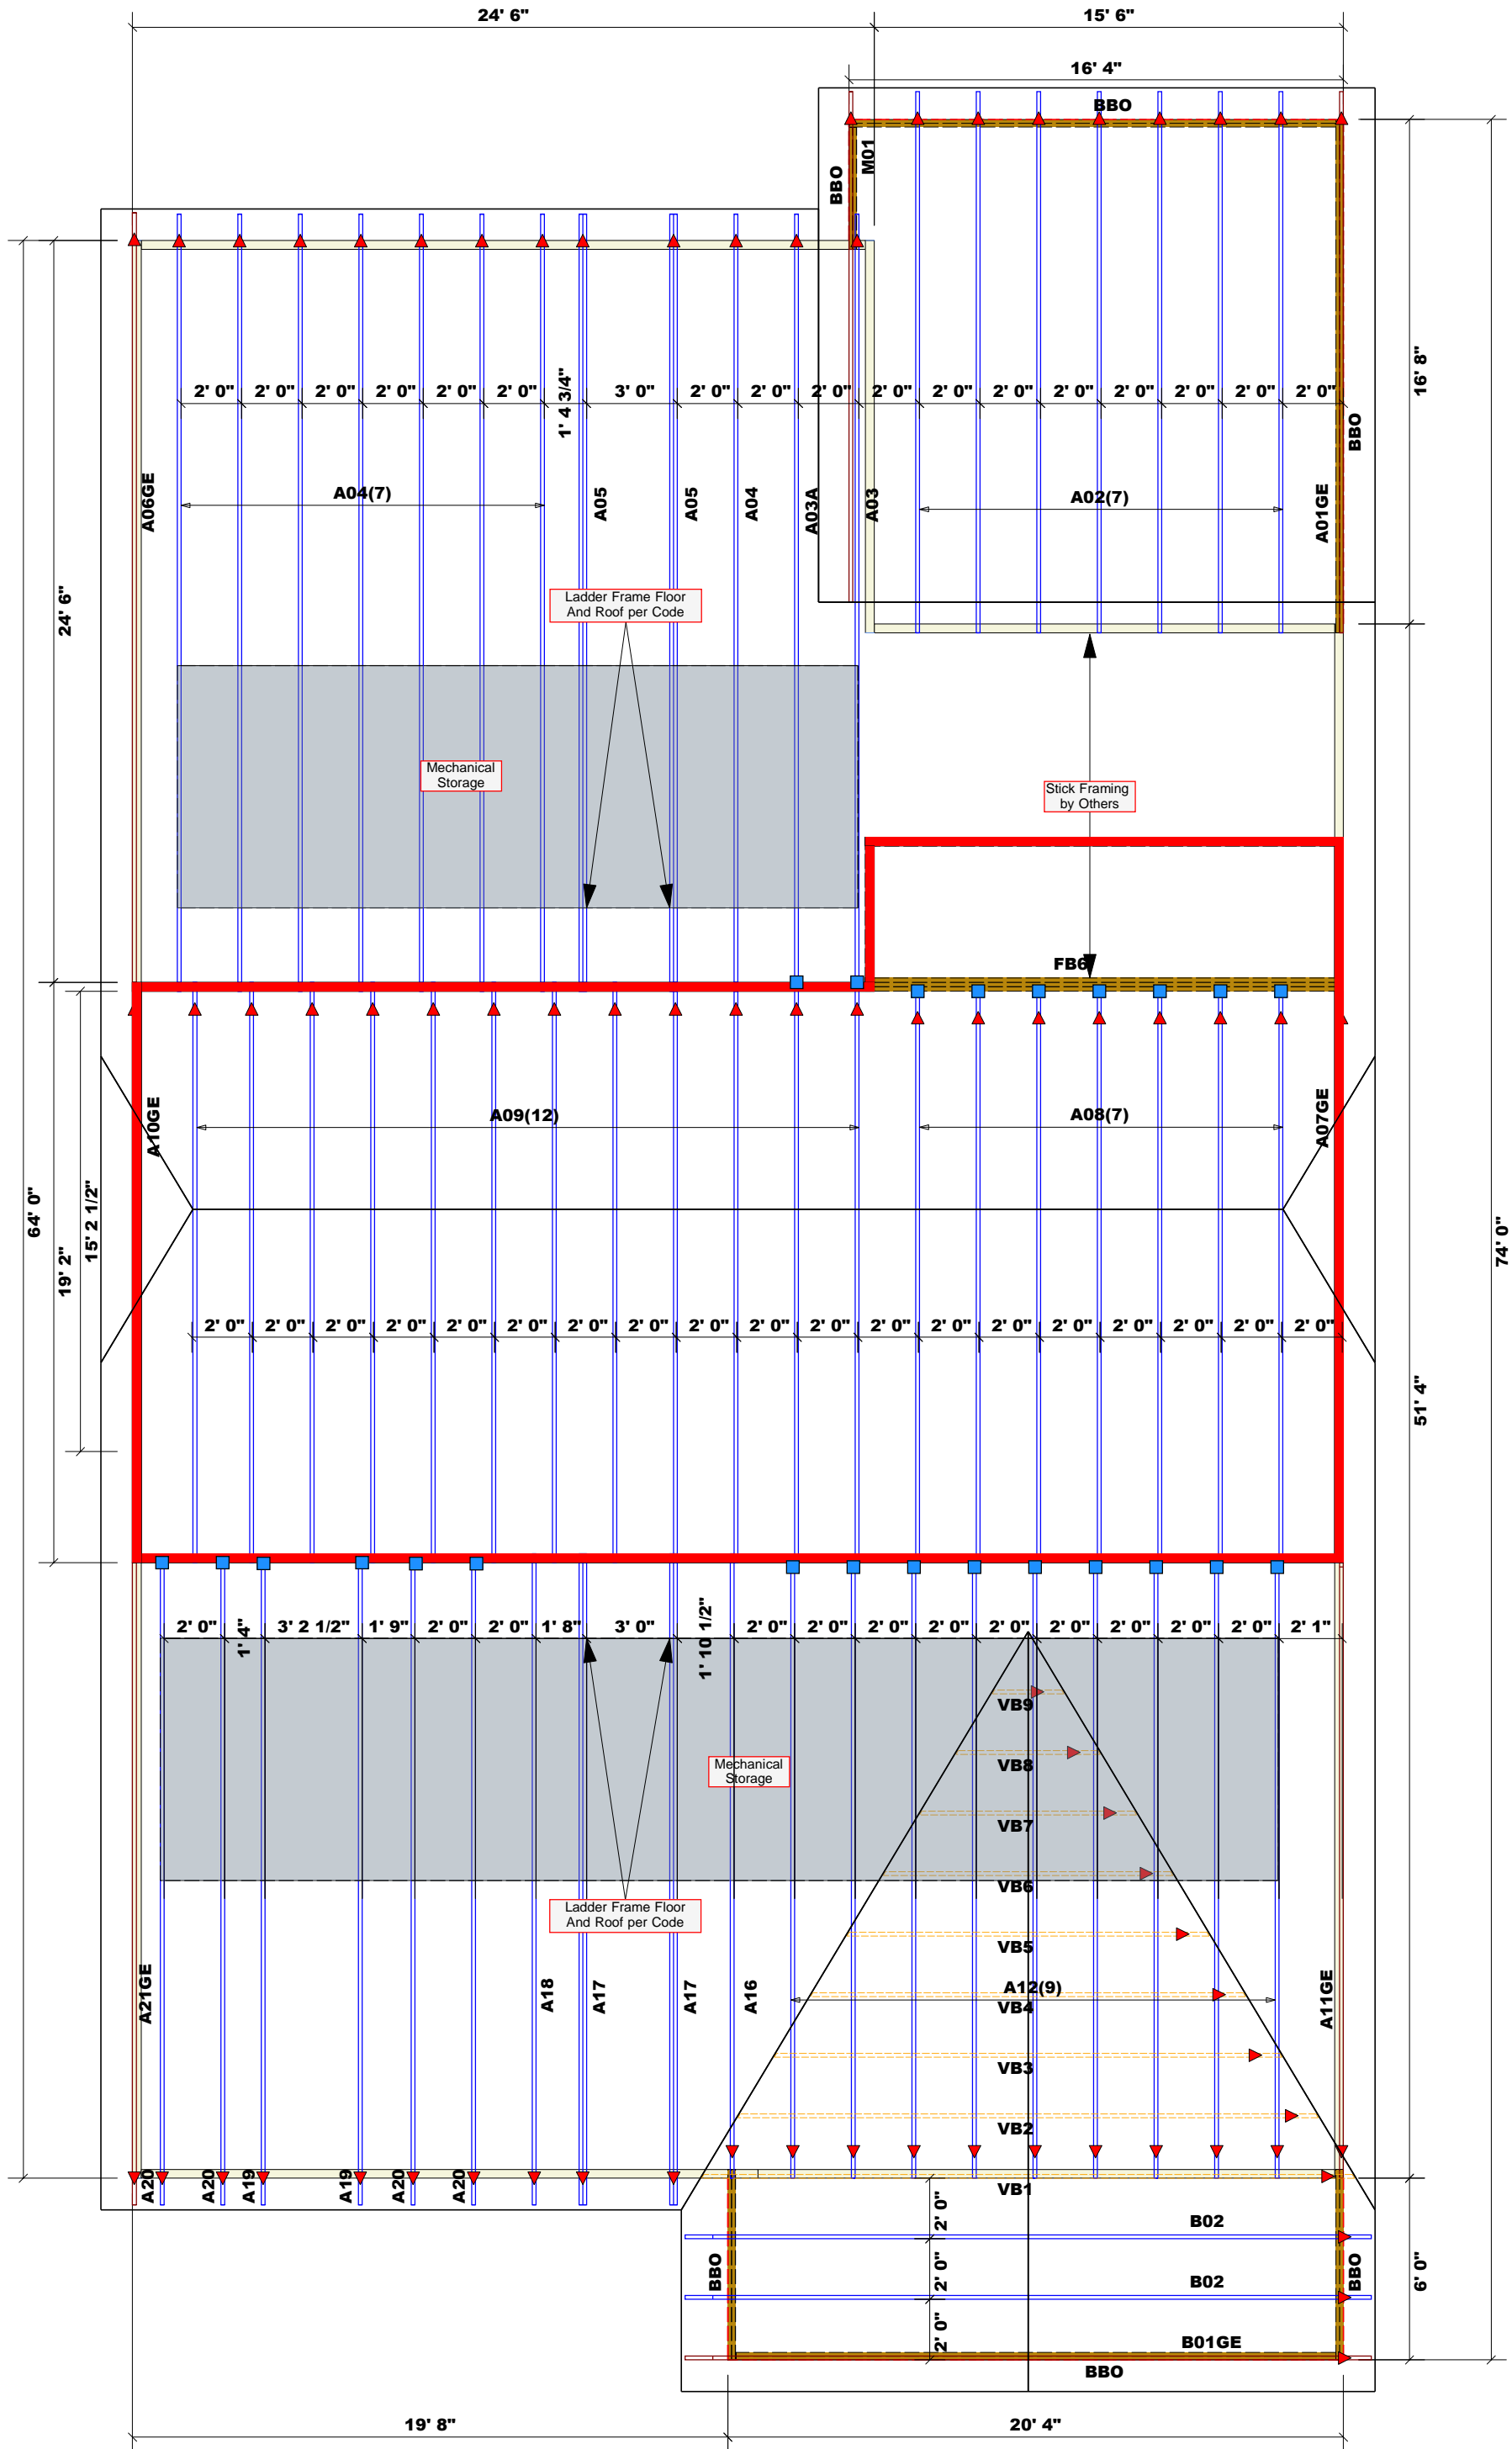

Truss Placement Plan
SCALE: NTS

▲ = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

LOAD CHART FOR JACK STUDS			
(BASED ON TABLES R502.5(1) & (b))			
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADS/GUDES			
END REACTION (UP TO) 1700	END REACTION (UP TO) 2550	END REACTION (UP TO) 3400	
1	1	1	
3400 2	5100 2	6800 2	
5100 3	7650 3	10200 3	
6800 4	10200 4	13600 4	
8500 5	12750 5	17000 5	
10200 6	15300 6		
11900 7			
13600 8			
15300 9			

BUILDER	New Home Inc.
JOB NAME	Lot 191 Ballard Road
PLAN	The Clayton - Low Country - Face
SEAL DATE	Seal Date
QUOTE #	Quote #
JOB #	J0525-2585

CITY / CO.	Fuquay-Varina / Wake
ADDRESS	1865 Ballard Road
MODEL	Roof
DATE REV.	5/20/25
DRAWN BY	Johnnie Baggett
SALES REP.	Johnnie Baggett

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature Johnnie Baggett
Johnnie Baggett

comtech

ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0525-2585
Lot 191 Ballard Road

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I73626998 thru I73627028

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844



May 21, 2025

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A01GE	ROOF SPECIAL SUPPORT	1	1	173626998
Job Reference (optional)					

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:11 2025 Page 1
ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hg3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

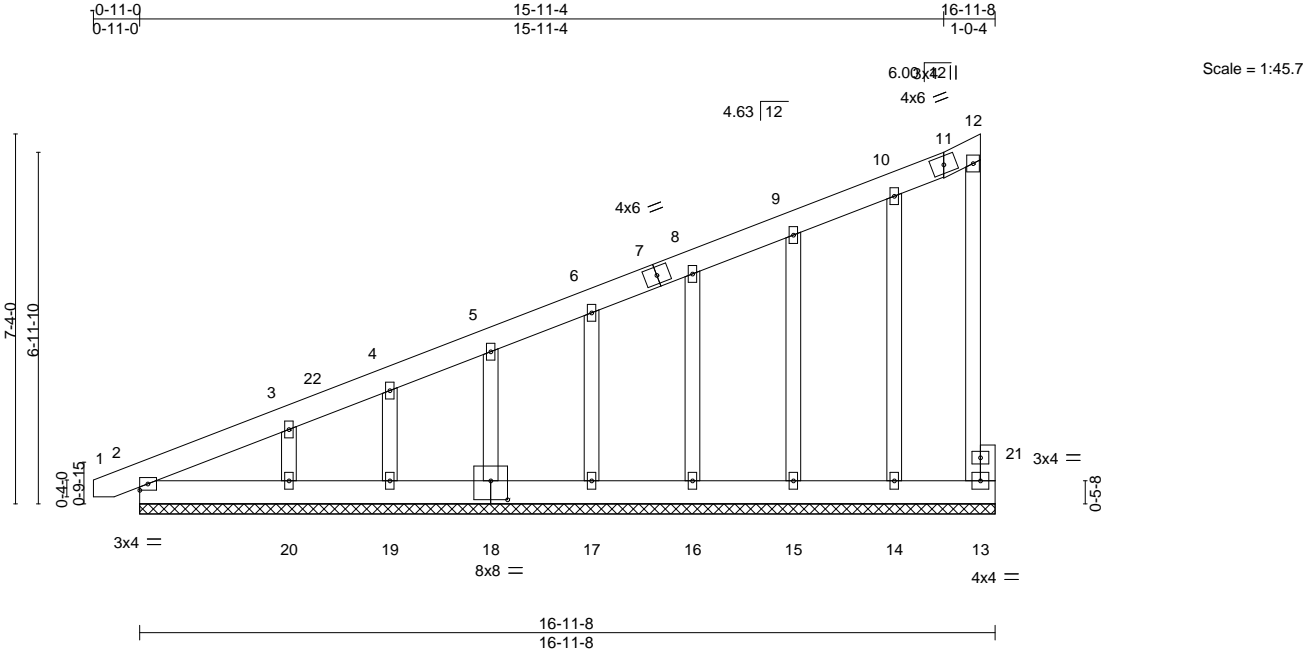


Plate Offsets (X,Y)-- [18:0-4-0,0-4-8]		16-11-8		16-11-8	
LOADING (psf)		SPACING-		CSL	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.04
TCDL	10.0	Lumber DOL	1.15	BC	0.02
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.07
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S	
				DEFL.	
				in (loc)	L/d
				Vert(LL)	-0.00 1 n/r 120
				Vert(CT)	0.00 1 n/r 120
				Horz(CT)	-0.00 13 n/a n/a
				PLATES	
				GRIP	
				MT20 244/190	
				Weight: 130 lb FT = 20%	


LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.1	BOT CHORD	Rigid ceiling directly applied or 10'-0-0 oc bracing.
WEBS	2x4 SP No.2		
OTHERS	2x4 SP No.2 *Except*		
	13-21: 2x4 SP No.1		

REACTIONS. All bearings 16-11-8.
(lb) - Max Horz 2=314(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 14, 15, 16, 17, 18, 19 except 20=123(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 2, 14, 15, 16, 17, 18, 19, 20 except 13=301(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-427/139, 3-4=-317/99, 4-5=-272/88

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-8-9 to 3-8-4, Exterior(2N) 3-8-4 to 16-6-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 2'-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 15, 16, 17, 18, 19 except (jt=lb) 20=123.
 - 9) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
 - 10) Load case(s) 1, 2, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-11=-60, 11-12=-60, 2-13=-20
Concentrated Loads (lb)
Vert: 13=-175

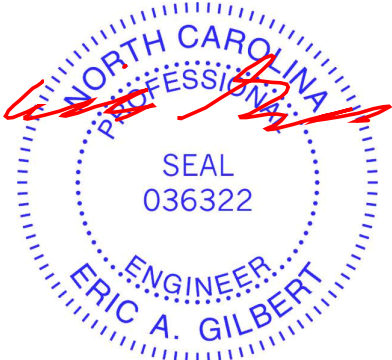

May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A01GE	ROOF SPECIAL SUPPORT	1	1	173626998
					Job Reference (optional)

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:11 2025 Page 2
ID:e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-11=-50, 11-12=-50, 2-13=-20
Concentrated Loads (lb)
Vert: 13=-175
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=74, 2-22=62, 11-22=48, 11-12=48, 2-13=-12
Horz: 1-2=86, 2-22=-74, 11-22=-60, 11-12=-60
Concentrated Loads (lb)
Vert: 13=-105
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=41, 2-11=48, 11-12=62, 2-13=-12
Horz: 1-2=53, 2-11=-60, 11-12=-74
Concentrated Loads (lb)
Vert: 13=-105
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-8, 2-11=-38, 11-12=-38, 2-13=-20
Horz: 1-2=12, 2-11=18, 11-12=18
Concentrated Loads (lb)
Vert: 13=-175
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-32, 2-11=-38, 11-12=-38, 2-13=-20
Horz: 1-2=-12, 2-11=18, 11-12=18
Concentrated Loads (lb)
Vert: 13=-175
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=45, 2-11=29, 11-12=2, 2-13=-12
Horz: 1-2=57, 2-11=-41, 11-12=-14
Concentrated Loads (lb)
Vert: 13=-105
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=13, 2-11=20, 11-12=17, 2-13=-12
Horz: 1-2=25, 2-11=-32, 11-12=-29
Concentrated Loads (lb)
Vert: 13=-105
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=15, 2-11=8, 11-12=-20, 2-13=-20
Horz: 1-2=35, 2-11=-28, 11-12=-0
Concentrated Loads (lb)
Vert: 13=-175
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-11=-2, 11-12=-5, 2-13=-20
Horz: 1-2=25, 2-11=-18, 11-12=-15
Concentrated Loads (lb)
Vert: 13=-175
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=28, 2-11=35, 11-12=35, 2-13=-12
Horz: 1-2=40, 2-11=-47, 11-12=-47
Concentrated Loads (lb)
Vert: 13=-105
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-11=15, 11-12=15, 2-13=-12
Horz: 1-2=20, 2-11=-27, 11-12=-27
Concentrated Loads (lb)
Vert: 13=-105
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=28, 2-11=35, 11-12=35, 2-13=-12
Horz: 1-2=40, 2-11=-47, 11-12=-47
Concentrated Loads (lb)
Vert: 13=-105
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-11=15, 11-12=15, 2-13=-12
Horz: 1-2=20, 2-11=-27, 11-12=-27

Eric A. Gilbert



May 21, 2025

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A01GE	ROOF SPECIAL SUPPORT	1	1	173626998
					Job Reference (optional)

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:11 2025 Page 3
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 13=-105
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=20, 2-11=13, 11-12=13, 2-13=-20
Horz: 1-2=40, 2-11=-33, 11-12=-33
Concentrated Loads (lb)
Vert: 13=-175
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-0, 2-11=-7, 11-12=-7, 2-13=-20
Horz: 1-2=20, 2-11=-13, 11-12=-13
Concentrated Loads (lb)
Vert: 13=-175
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-11=-20, 11-12=-20, 2-13=-20
Concentrated Loads (lb)
Vert: 13=-175
- 19) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-24, 2-11=-29, 11-12=-50, 2-13=-20
Horz: 1-2=26, 2-11=-21, 11-12=-0
Concentrated Loads (lb)
Vert: 13=-175
- 20) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-11=-36, 11-12=-39, 2-13=-20
Horz: 1-2=19, 2-11=-14, 11-12=-11
Concentrated Loads (lb)
Vert: 13=-175
- 21) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-20, 2-11=-25, 11-12=-25, 2-13=-20
Horz: 1-2=30, 2-11=-25, 11-12=-25
Concentrated Loads (lb)
Vert: 13=-175
- 22) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-35, 2-11=-40, 11-12=-40, 2-13=-20
Horz: 1-2=15, 2-11=-10, 11-12=-10
Concentrated Loads (lb)
Vert: 13=-175

win this



May 21, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A02	ROOF SPECIAL	7	1	173626999
					Job Reference (optional)

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:12 2025 Page 2
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 7=-175
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-5=13, 5-6=11, 2-7=-12
Horz: 1-2=18, 2-5=-25, 5-6=-23
Concentrated Loads (lb)
Vert: 7=-105
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-5=-5, 5-6=-23, 2-7=2
Horz: 1-2=22, 2-5=-15, 5-6=3
Concentrated Loads (lb)
Vert: 7=-175
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-2, 2-5=-9, 5-6=-10, 2-7=-20
Horz: 1-2=18, 2-5=-11, 5-6=-10
Concentrated Loads (lb)
Vert: 7=-175
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-5=21, 5-6=21, 2-7=-12
Horz: 1-2=26, 2-5=-33, 5-6=-33
Concentrated Loads (lb)
Vert: 7=-105
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-5=9, 5-6=9, 2-7=-12
Horz: 1-2=14, 2-5=-21, 5-6=-21
Concentrated Loads (lb)
Vert: 7=-105
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-5=21, 5-6=21, 2-7=-12
Horz: 1-2=26, 2-5=-33, 5-6=-33
Concentrated Loads (lb)
Vert: 7=-105
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-5=9, 5-6=9, 2-7=-12
Horz: 1-2=14, 2-5=-21, 5-6=-21
Concentrated Loads (lb)
Vert: 7=-105
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-5=-1, 5-6=-1, 2-7=-20
Horz: 1-2=26, 2-5=-19, 5-6=-19
Concentrated Loads (lb)
Vert: 7=-175
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-6, 2-5=-13, 5-6=-13, 2-7=-20
Horz: 1-2=14, 2-5=-7, 5-6=-7
Concentrated Loads (lb)
Vert: 7=-175
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 5-6=-20, 2-13=-40, 7-13=-80
Concentrated Loads (lb)
Vert: 7=-175
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-33, 2-5=-38, 5-6=-52, 2-13=-18, 7-13=-48
Horz: 1-2=17, 2-5=-12, 5-6=2
Concentrated Loads (lb)
Vert: 7=-175
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-37, 2-5=-42, 5-6=-42, 2-13=-35, 7-13=-65
Horz: 1-2=13, 2-5=-8, 5-6=-8
Concentrated Loads (lb)
Vert: 7=-175



May 21,2025

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A02	ROOF SPECIAL	7	1	173626999
Job Reference (optional)					

- LOAD CASE(S)** Standard
 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-31, 2-5=-36, 5-6=-36, 2-13=-35, 7-13=-65
 Horz: 1-2=19, 2-5=-14, 5-6=-14

 Concentrated Loads (lb)

Vert: 7=-175

 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-40, 2-5=-45, 5-6=-45, 2-13=-35, 7-13=-65
 Horz: 1-2=10, 2-5=-5, 5-6=-5

 Concentrated Loads (lb)

Vert: 7=-175



May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A03	MONOPITCH	1	1	173627000

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:13 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

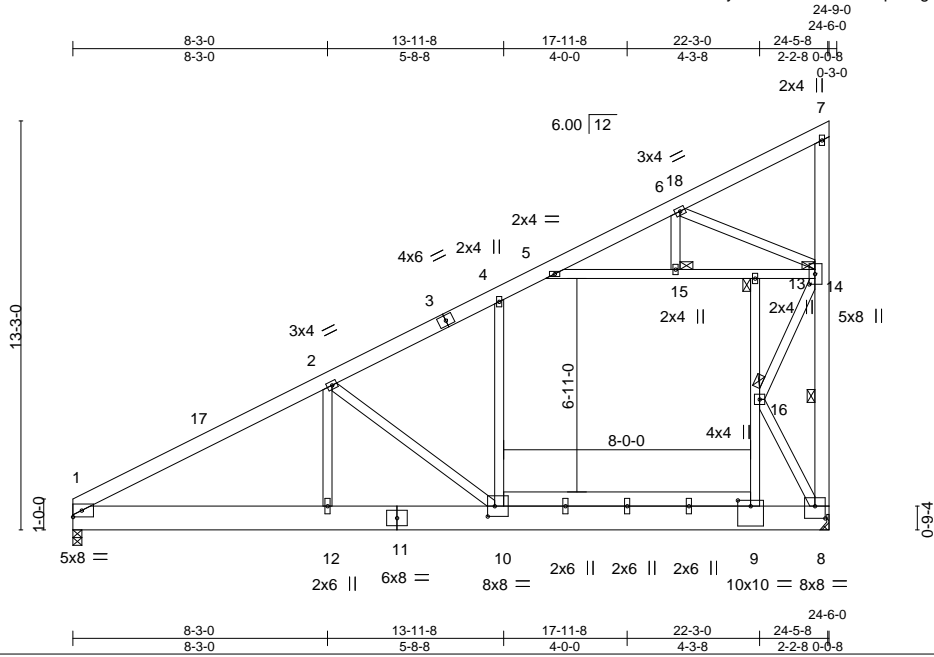



Plate Offsets (X,Y)--		[8:0-4-0,0-4-12], [9:0-5-0,0-2-4], [10:0-2-12,0-4-0], [14:0-4-0,0-2-4]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	-0.20 10-12	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.34 10-12	>855	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.92	Horz(CT)	0.01 8	n/a	n/a		
BCDL	10.0	Code IRC2021/TPI2014		Matrix-S		Wind(LL)	0.15 10-12	>999	240	Weight: 279 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-7-6 oc purlins.
BOT CHORD 2x6 SP No.1 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except*	WEBS 1 Row at midpt 8-14
7-8: 2x6 SP No.1	JOINTS 1 Brace at Jt(s): 13, 14, 15, 16

REACTIONS. (size) 1=0-3-8, 8=Mechanical
Max Horz 1=407(LC 12)
Max Uplift 8=209(LC 12)
Max Grav 1=1110(LC 19), 8=1244(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1829/98, 2-4=-850/0, 4-5=-690/6
BOT CHORD 1-12=-490/1549, 10-12=-490/1549, 9-10=-172/678, 8-9=-173/680
WEBS 2-12=-93/726, 9-16=-484/2114, 13-16=-258/106, 2-10=-1119/409, 5-15=-557/3,
13-15=-557/4, 13-14=-555/3, 6-14=-258/218, 8-16=-1328/331, 14-16=-343/1376,
8-14=-1291/433

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-1-12 to 4-6-9, Interior(1) 4-6-9 to 24-3-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=209.

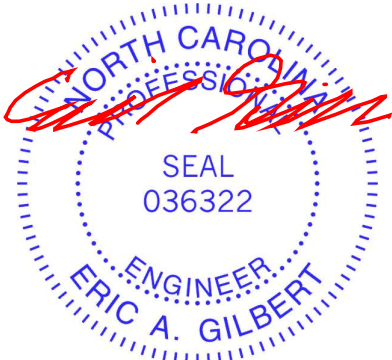

May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627001
J0525-2585	A03A	MONOPITCH	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:13 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

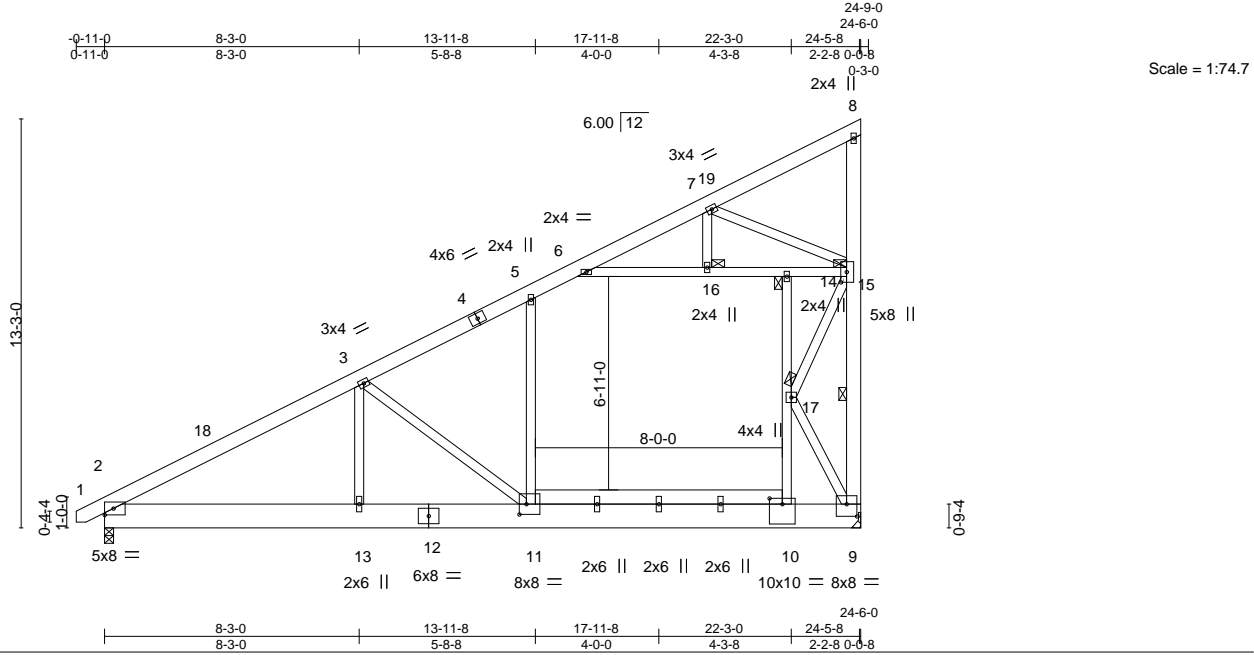


Plate Offsets (X,Y)--		[9:0-4-0,0-4-12], [10:0-5-0,0-2-4], [11:0-2-12,0-4-0], [15:0-4-0,0-2-4]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	-0.20 11-13	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.34 11-13	>856	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.91	Horz(CT)	0.01 9	n/a	n/a		
BCDL	10.0	Code IRC2021/TPI2014		Matrix-S		Wind(LL)	0.15 11-13	>999	240	Weight: 281 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-8-3 oc purlins.
BOT CHORD 2x6 SP No.1 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
2-12: 2x10 SP No.1, 9-12: 2x10 SP 2400F 2.0E	WEBS 1 Row at midpt 9-15
WEBS 2x4 SP No.2 *Except*	JOINTS 1 Brace at Jt(s): 14, 15, 16, 17
8-9: 2x6 SP No.1	

REACTIONS. (size) 2=0-3-8, 9=Mechanical
Max Horz 2=408(LC 12)
Max Uplift 2=-11(LC 12), 9=-209(LC 12)
Max Grav 2=1154(LC 19), 9=1243(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1831/96, 3-5=-847/0, 5-6=-690/5
BOT CHORD 2-13=-482/1544, 11-13=-482/1544, 10-11=-172/677, 9-10=-173/679
WEBS 3-13=-108/740, 10-17=-484/2113, 14-17=-257/106, 3-11=-1114/399, 6-16=-557/3,
14-16=-558/3, 14-15=-556/3, 7-15=-257/217, 9-17=-1327/330, 15-17=-342/1375,
9-15=-1291/432

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 24-3-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 9=209.



May 21,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627002
J0525-2585	A04	MONOPITCH	8	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:14 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

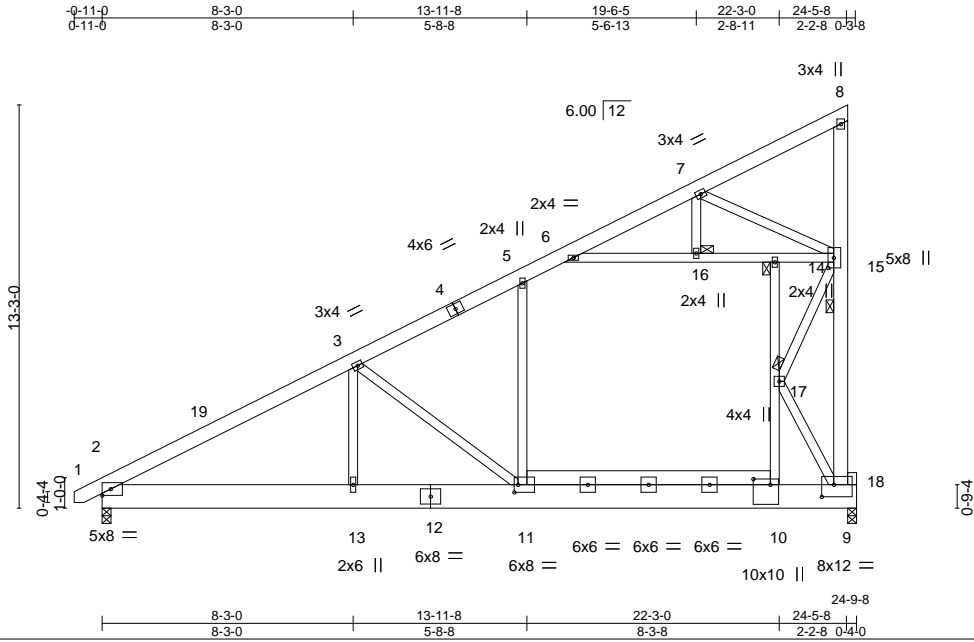

Scale = 1:75.7

Plate Offsets (X,Y)--		[9:0-4-12,0-4-12], [10:0-2-4,0-6-12], [11:0-1-8,0-3-0], [15:0-4-0,0-2-4]										
LOADING	(psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.47	Vert(LL)	-0.18	11-13	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	1.00	Vert(CT)	-0.30	11-13	>961	240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.91	Horz(CT)	0.01	9	n/a	n/a		
BCDL	10.0	Code IRC2021/TPI2014		Matrix-S		Wind(LL)	0.14	11-13	>999	240	Weight: 283 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-7-9 oc purlins, except end verticals.
BOT CHORD 2x10 SP No.1 *Except*	BOT CHORD Rigid ceiling directly applied or 4-8-6 oc bracing.
WEBS 2x4 SP No.2 *Except*	WEBS 1 Row at midpt 8-9
8-9: 2x6 SP No.1, 9-18: 2x4 SP No.1	JOINTS 1 Brace at Jt(s): 14, 16, 17

REACTIONS. (size) 9=0-3-8, 2=0-3-8
Max Horz 2=408(LC 12)
Max Uplift 2=13(LC 12)
Max Grav 9=2821(LC 19), 2=1166(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1863/104, 3-5=-882/0, 5-6=-723/18, 9-15=-1328/434
BOT CHORD 2-13=-488/1572, 11-13=-488/1572, 10-11=-184/711, 9-10=-184/713
WEBS 3-13=-100/743, 3-11=-1106/390, 10-17=-475/2031, 6-16=-576/14, 14-16=-576/14, 14-15=-574/13, 7-15=-278/209, 9-17=-1220/306, 15-17=-346/1378

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 24-3-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
 - 5) Load case(s) 1, 2, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) . The design/selection of such connection device(s) is the responsibility of others.

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-8=-60, 2-9=-20
Concentrated Loads (lb)
Vert: 9=-1650
 - 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-8=-50, 2-11=-35, 10-11=-65, 9-10=-35

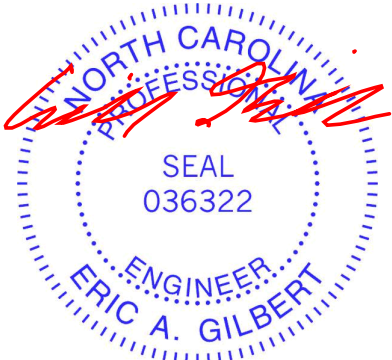

May 21,2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A04	MONOPITCH	8	1	173627002
					Job Reference (optional)

Comtech, Inc, Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:14 2025 Page 2
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?fi

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 9=-1513
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=63, 2-19=32, 8-19=29, 2-9=-12
Horz: 1-2=-75, 2-19=-44, 8-19=-41
Concentrated Loads (lb)
Vert: 9=-52
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=22, 2-8=29, 2-9=-12
Horz: 1-2=-34, 2-8=-41
Concentrated Loads (lb)
Vert: 9=-101
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-9, 2-8=-38, 2-9=-20
Horz: 1-2=-11, 2-8=18
Concentrated Loads (lb)
Vert: 9=-1347
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-8=-38, 2-9=-20
Horz: 1-2=11, 2-8=18
Concentrated Loads (lb)
Vert: 9=-1347
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-8=-2, 2-9=-12
Horz: 1-2=-26, 2-8=-10
Concentrated Loads (lb)
Vert: 9=-516
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-8=11, 2-9=-12
Horz: 1-2=-17, 2-8=-23
Concentrated Loads (lb)
Vert: 9=-337
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-16, 2-8=-23, 2-9=-20
Horz: 1-2=-4, 2-8=3
Concentrated Loads (lb)
Vert: 9=-1193
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-8=-10, 2-9=-20
Horz: 1-2=-17, 2-8=-10
Concentrated Loads (lb)
Vert: 9=-1193
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-8=21, 2-9=-12
Horz: 1-2=-26, 2-8=-33
Concentrated Loads (lb)
Vert: 9=-212
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-8=9, 2-9=-12
Horz: 1-2=-14, 2-8=-21
Concentrated Loads (lb)
Vert: 9=-377
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-8=21, 2-9=-12
Horz: 1-2=-26, 2-8=-33
Concentrated Loads (lb)
Vert: 9=-212
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-8=9, 2-9=-12
Horz: 1-2=-14, 2-8=-21
Concentrated Loads (lb)
Vert: 9=-377
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60

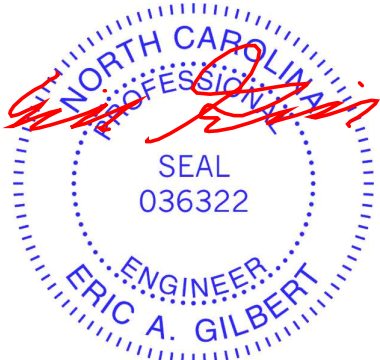

May 21,2025

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A04	MONOPITCH	8	1	173627002

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:14 2025 Page 3
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-2=6, 2-8=-1, 2-9=-20
Horz: 1-2=-26, 2-8=-19
- Concentrated Loads (lb)
Vert: 9=-1193
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-6, 2-8=-13, 2-9=-20
Horz: 1-2=-14, 2-8=-7
Concentrated Loads (lb)
Vert: 9=-1193
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-8=-20, 2-11=-40, 10-11=-80, 9-10=-40
Concentrated Loads (lb)
Vert: 9=-1100
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-47, 2-8=-52, 2-11=-35, 10-11=-65, 9-10=-35
Horz: 1-2=-3, 2-8=2
Concentrated Loads (lb)
Vert: 9=-1582
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-37, 2-8=-42, 2-11=-35, 10-11=-65, 9-10=-35
Horz: 1-2=-13, 2-8=-8
Concentrated Loads (lb)
Vert: 9=-1582
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-8=-36, 2-11=-35, 10-11=-65, 9-10=-35
Horz: 1-2=-19, 2-8=-14
Concentrated Loads (lb)
Vert: 9=-1582
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-8=-45, 2-11=-35, 10-11=-65, 9-10=-35
Horz: 1-2=-10, 2-8=-5
Concentrated Loads (lb)
Vert: 9=-1582



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627003
J0525-2585	A05	MONOPITCH	2	2	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:15 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

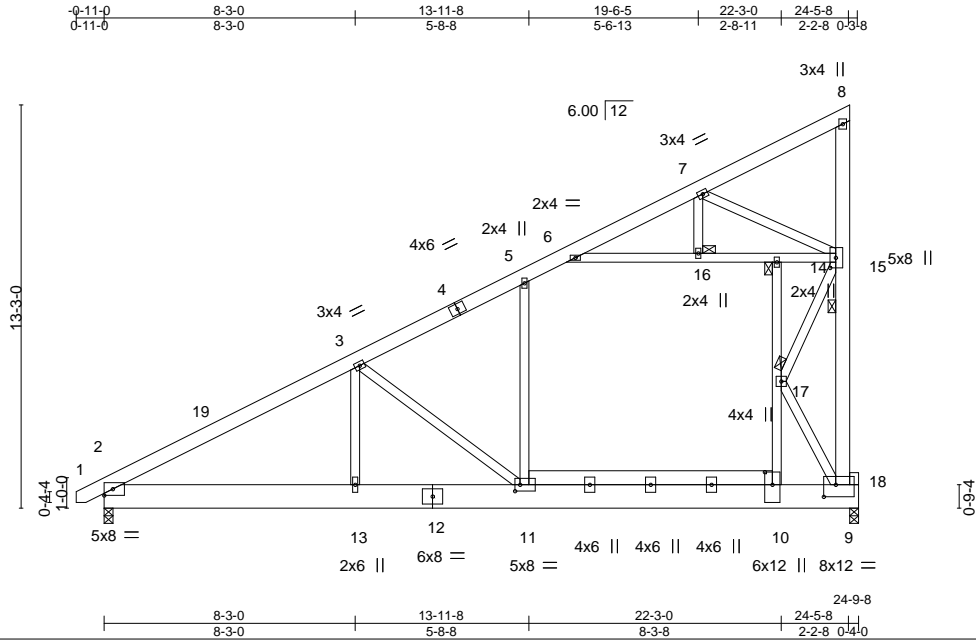


Plate Offsets (X,Y)--		[9:0-4-12,0-4-12], [10:0-5-0,0-3-0], [11:0-2-0,0-2-8], [15:0-4-0,0-2-4]	
LOADING (psf)	SPACING-	2-6-0	CSI.
TCLL 20.0	Plate Grip DOL	1.15	TC 0.22
TCDL 10.0	Lumber DOL	1.15	BC 0.62
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.34
BCDL 10.0	Code	IRC2021/TP12014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.11 11-13 >999 360
			Vert(CT) -0.19 11-13 >999 240
			Horz(CT) 0.01 9 n/a n/a
			Wind(LL) 0.08 11-13 >999 240
			PLATES GRIP
			MT20 244/190
			Weight: 566 lb FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x10 SP No.1 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except*	WEBS 1 Row at midpt 8-9
8-9: 2x6 SP No.1, 9-18: 2x4 SP No.1	JOINTS 1 Brace at Jt(s): 14, 16, 17

REACTIONS. (size) 9=0-3-8, 2=0-3-8
Max Horz 2=510(LC 12)
Max Uplift 2=16(LC 12)
Max Grav 9=2649(LC 19), 2=1457(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2329/130, 3-5=-1102/0, 5-6=-904/22, 6-7=-312/36, 9-15=-1660/543
BOT CHORD 2-13=-609/1965, 11-13=-609/1965, 10-11=-230/889, 9-10=-231/892
WEBS 3-13=-125/928, 3-11=-1382/488, 5-11=-111/283, 10-17=-594/2539, 14-17=-270/111,
6-16=-719/17, 14-16=-720/17, 14-15=-717/16, 7-15=-348/261, 9-17=-1525/383,
15-17=-432/1723

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 24-3-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
 - Load case(s) 1, 2, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-8=-75, 2-9=-25

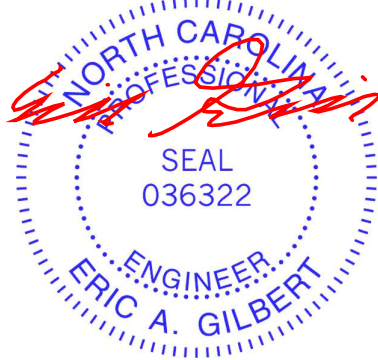

May 21,2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A05	MONOPITCH	2	2	173627003

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:15 2025 Page 2
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

- LOAD CASE(S)** Standard
- Concentrated Loads (lb)
- Vert: 9=-1100
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
- Vert: 1-8=-62, 2-11=-44, 10-11=-81, 9-10=-44
- Concentrated Loads (lb)
- Vert: 9=-1100
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=79, 2-19=40, 8-19=36, 2-9=-15
- Horz: 1-2=-94, 2-19=-55, 8-19=-51
- Concentrated Loads (lb)
- Vert: 9=-660
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=27, 2-8=36, 2-9=-15
- Horz: 1-2=-42, 2-8=-51
- Concentrated Loads (lb)
- Vert: 9=-660
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-11, 2-8=-47, 2-9=-25
- Horz: 1-2=-14, 2-8=22
- Concentrated Loads (lb)
- Vert: 9=-1100
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-39, 2-8=-47, 2-9=-25
- Horz: 1-2=14, 2-8=22
- Concentrated Loads (lb)
- Vert: 9=-1100
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=18, 2-8=-2, 2-9=-15
- Horz: 1-2=-33, 2-8=-13
- Concentrated Loads (lb)
- Vert: 9=-660
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=6, 2-8=14, 2-9=-15
- Horz: 1-2=-21, 2-8=-29
- Concentrated Loads (lb)
- Vert: 9=-660
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-20, 2-8=-29, 2-9=-25
- Horz: 1-2=-5, 2-8=4
- Concentrated Loads (lb)
- Vert: 9=-1100
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-4, 2-8=-12, 2-9=-25
- Horz: 1-2=-21, 2-8=-13
- Concentrated Loads (lb)
- Vert: 9=-1100
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=17, 2-8=26, 2-9=-15
- Horz: 1-2=-32, 2-8=-41
- Concentrated Loads (lb)
- Vert: 9=-660
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=2, 2-8=11, 2-9=-15
- Horz: 1-2=-17, 2-8=-26
- Concentrated Loads (lb)
- Vert: 9=-660
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=17, 2-8=26, 2-9=-15
- Horz: 1-2=-32, 2-8=-41
- Concentrated Loads (lb)
- Vert: 9=-660
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60

Will Triss



May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A05	MONOPITCH	2	2	173627003

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:15 2025 Page 3
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-2=2, 2-8=11, 2-9=-15
Horz: 1-2=-17, 2-8=-26
- Concentrated Loads (lb)
Vert: 9=-660
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=7, 2-8=-1, 2-9=-25
Horz: 1-2=-32, 2-8=-24
Concentrated Loads (lb)
Vert: 9=-1100
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-8, 2-8=-16, 2-9=-25
Horz: 1-2=-17, 2-8=-9
Concentrated Loads (lb)
Vert: 9=-1100
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-8=-25, 2-11=-50, 10-11=-100, 9-10=-50
Concentrated Loads (lb)
Vert: 9=-1100
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-59, 2-8=-65, 2-11=-44, 10-11=-81, 9-10=-44
Horz: 1-2=-3, 2-8=3
Concentrated Loads (lb)
Vert: 9=-1100
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-47, 2-8=-53, 2-11=-44, 10-11=-81, 9-10=-44
Horz: 1-2=-16, 2-8=-9
Concentrated Loads (lb)
Vert: 9=-1100
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-38, 2-8=-45, 2-11=-44, 10-11=-81, 9-10=-44
Horz: 1-2=-24, 2-8=-18
Concentrated Loads (lb)
Vert: 9=-1100
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-50, 2-8=-56, 2-11=-44, 10-11=-81, 9-10=-44
Horz: 1-2=-13, 2-8=-7
Concentrated Loads (lb)
Vert: 9=-1100

Eric Gilbert



May 21, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Comtech, Inc. Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:15 2025 Page 1
 ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcD0i7J4zJC?f
 -0-11-0 24-6-0 24-9-8
 0-11-0 24-6-0 0-3-8



LOAD CASE(S) Standard May 21, 2025



Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A06GE	MONOPITCH SUPPORTED	1	1	173627004
					Job Reference (optional)

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-16=-60, 2-17=-20
Concentrated Loads (lb)
Vert: 17=-150

Eric Gilbert




May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627005
J0525-2585	A07GE	GABLE	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:16 2025 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

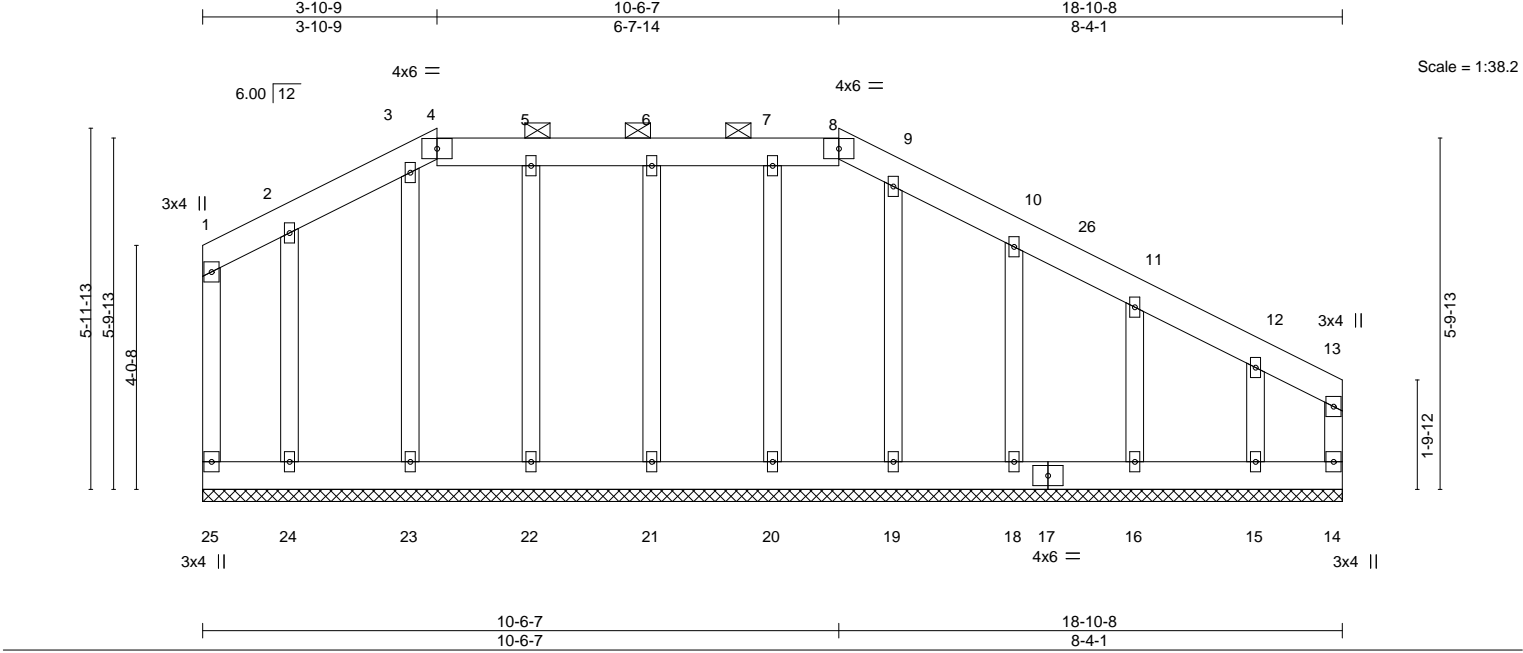


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	14	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014		Matrix-R						Weight: 152 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-8.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 18-10-8.
(lb) - Max Horz 25=-141(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 25, 14, 20, 21, 22, 23, 24, 19, 18, 16 except 15=-241(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 25, 14, 20, 21, 22, 23, 24, 19, 18, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 3-10-9, Corner(3R) 3-10-9 to 8-3-6, Exterior(2N) 8-3-6 to 10-6-7, Corner(3R) 10-6-7 to 14-11-4, Exterior(2N) 14-11-4 to 18-8-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed on one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 25, 14, 20, 21, 22, 23, 24, 19, 18, 16 except (it=lb) 15=241.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

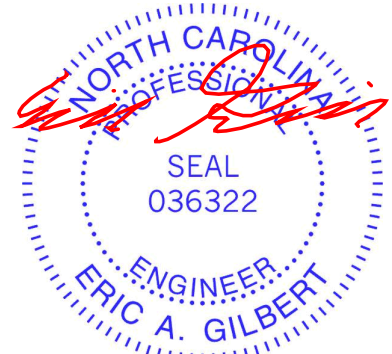


May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627006
J0525-2585	A08	Common	7	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:16 2025 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

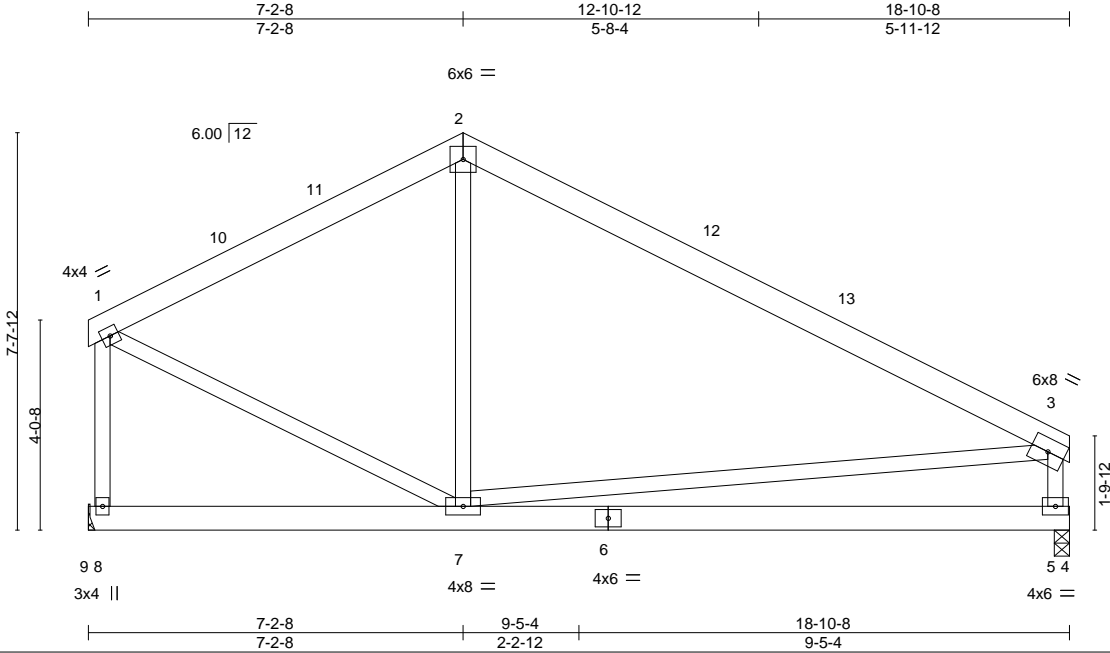

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.72	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(LL) -0.10 5-7 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.16	Vert(CT) -0.19 5-7 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2021/TPI2014		Wind(LL) 0.01 7 >999 240		
				Weight: 138 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 8=Mechanical, 5=0-3-8
Max Horz 8=-114(LC 13)
Max Uplift 8=-31(LC 13), 5=-37(LC 13)
Max Grav 8=739(LC 1), 5=739(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-632/260, 2-3=-729/226, 1-8=-687/280, 3-5=-621/281
BOT CHORD 5-7=-136/330
WEBS 1-7=-153/567


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-3-4 to 4-8-1, Interior(1) 4-8-1 to 7-2-8, Exterior(2R) 7-2-8 to 11-7-5, Interior(1) 11-7-5 to 18-7-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 5.



May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A09	Common	12	1	173627007

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:17 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

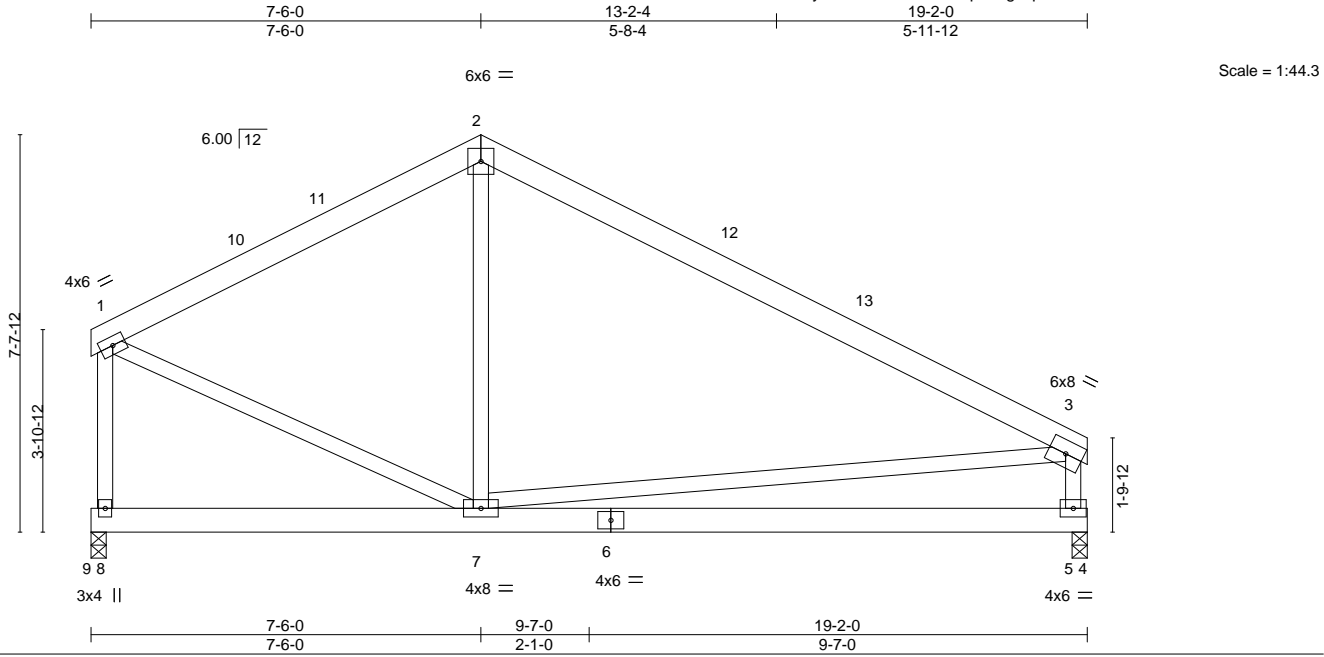

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.72	Vert(LL)	-0.10	5-7	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.19	5-7	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014		Matrix-S	Wind(LL)	0.01	7	>999	240	Weight: 140 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 8=0-3-8, 5=0-3-8
Max Horz 8=-111(LC 13)
Max Uplift 8=-28(LC 13), 5=-38(LC 13)
Max Grav 8=750(LC 1), 5=750(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-658/264, 2-3=-750/232, 1-8=-694/280, 3-5=-633/282
BOT CHORD 5-7=-135/330
WEBS 1-7=-147/574

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-3-4 to 4-8-1, Interior(1) 4-8-1 to 7-6-0, Exterior(2R) 7-6-0 to 11-10-13, Interior(1) 11-10-13 to 18-10-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 5.




May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627008
J0525-2585	A10GE	GABLE	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:17 2025 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

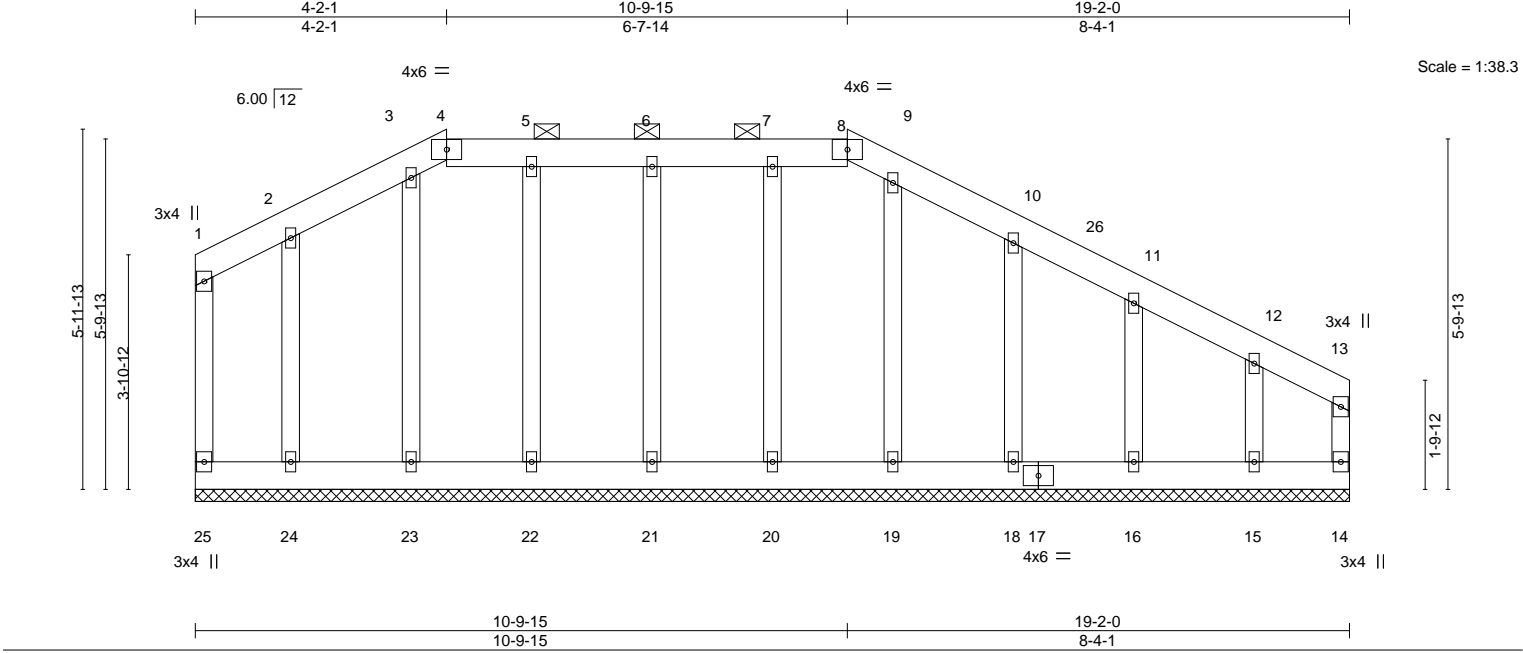

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	14	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014		Matrix-R						Weight: 154 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-8.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 19-2-0.
(lb) - Max Horz 25=-137(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 25, 14, 20, 21, 22, 23, 24, 19, 18, 16 except 15=-226(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 25, 14, 20, 21, 22, 23, 24, 19, 18, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 4-2-1, Corner(3R) 4-2-1 to 8-6-14, Exterior(2N) 8-6-14 to 10-9-15, Corner(3R) 10-9-15 to 15-2-12, Exterior(2N) 15-2-12 to 19-0-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed on one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 25, 14, 20, 21, 22, 23, 24, 19, 18, 16 except (it=lb) 15=226.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 21,2025

Comtech, Inc. Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:19 2025 Page 1
ID:?e2f6D20M8b7TBwF05hPsSyEJ4d-RfC?Psb70Hq3NSgPqnL8w3ulTXbGKWRCd0i7J4zJC?f

4-7-12	4-9-8	9-10-0	10-0-4	13-5-8	17-10-0	20-4-0	20-7-8
4-7-12	0-1-12	5-0-8	0-2-4	3-5-4	4-4-8	2-6-0	0-3-8

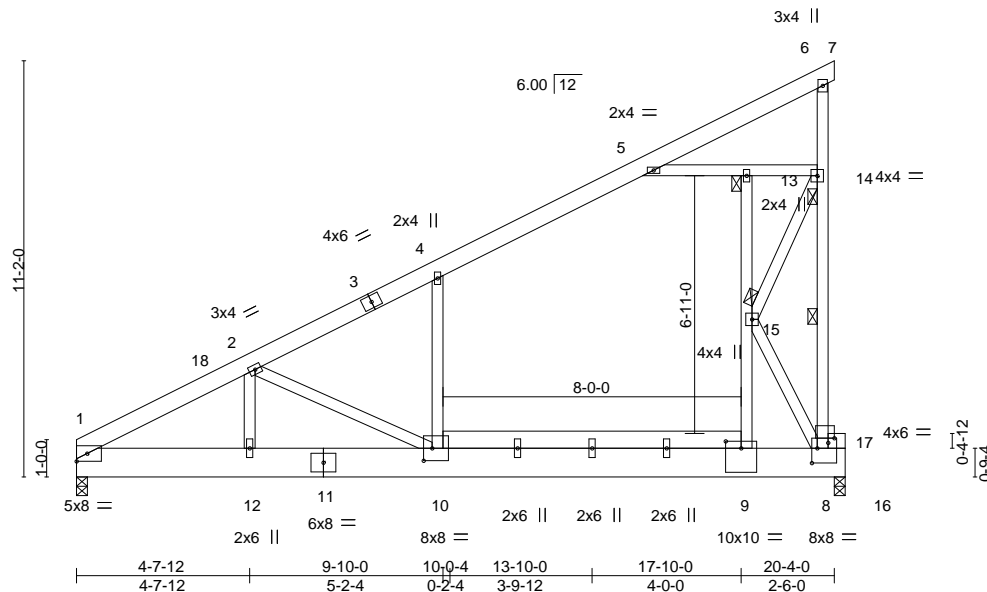

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 5-10-9 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.1 *Except*	BOT CHORD	
	1-11: 2x10 SP No.1, 11-16: 2x10 SP 2400F 2.0E		Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2	WEBS	1 Row at midpt 14-16
		JOINTS	1 Brace at Jt(s): 13, 14, 15
REACTIONS.			
	(size) 1=0-3-8, 8=0-3-8		
	Max Horz 1=342(LC 12)		
	Max Uplift 1=-4(LC 12), 8=-213(LC 12)		
	Max Grav 1=1010(LC 19), 8=2112(LC 19)		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-2=-1813/203, 2-4=-777/0, 4-5=-722/58, 8-14=-1228/460
BOT CHORD	1-12=-582/1539, 10-12=-582/1539, 9-10=-207/626, 8-9=-208/630
WEBS	2-12=-179/719, 2-10=-1034/426, 9-15=-570/2059, 4-10=-354/302, 5-13=-661/222, 13-14=-656/220, 8-15=-1231/393, 14-15=-422/1324

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-1-12 to 4-7-12, Interior(1) 4-7-12 to 20-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=213.
- 5) Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.
- 6) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1100 lb down and 249 lb up at 20-2-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-18=-60, 6-18=-70, 6-7=-70, 1-8=-20
Concentrated Loads (lb)
Vert: 8=-1100

May 21, 2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A17	MONOPITCH	2	2	173627012

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:20 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

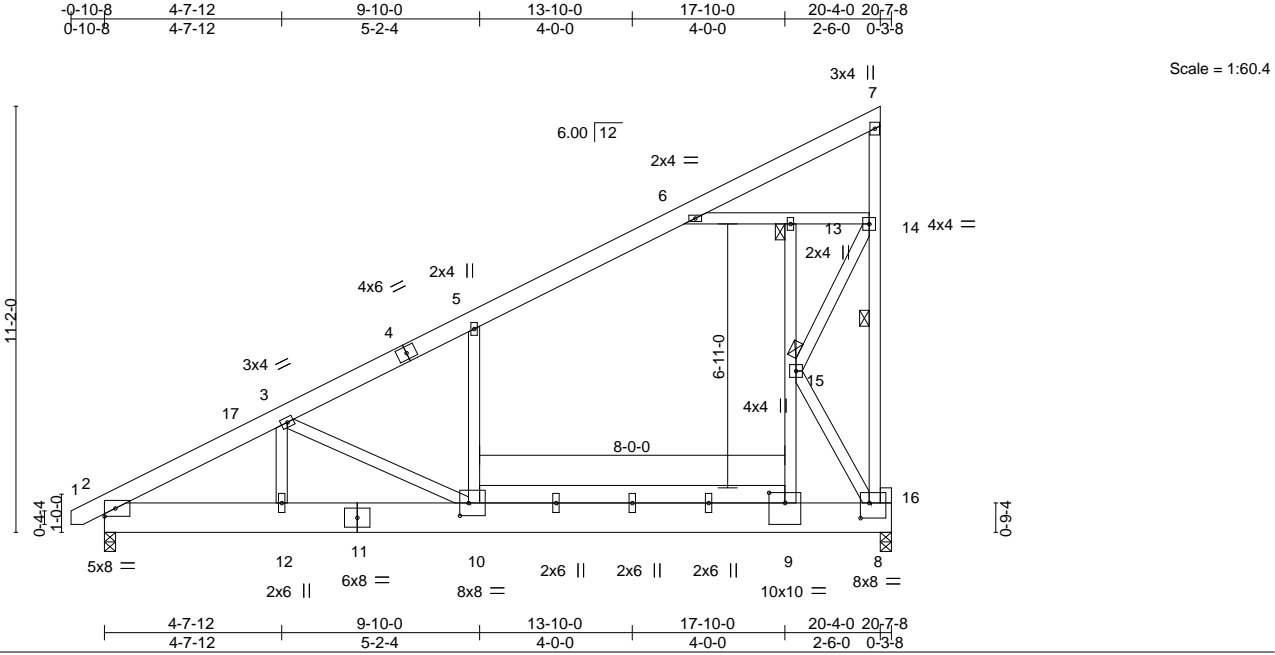


Plate Offsets (X,Y)-- [8:0-2-12,0-4-12], [9:0-5-0,0-3-4], [10:0-2-12,0-4-0]									
LOADING (psf)	SPACING-	2-5-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES
TCLL 20.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.08	10	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.47	Vert(CT)	-0.17	10	>999	240	
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.38	Horz(CT)	0.01	8	n/a	n/a	
BCDL 10.0	Code IRC2021/TPI2014		Matrix-S	Wind(LL)	0.08	10	>999	240	
									GRIP
									244/190
									Weight: 438 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD 2x10 SP No.1 *Except*	BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.
9-10: 2x6 SP No.1	WEBS 1 Row at midpt 7-8
WEBS 2x4 SP No.2 *Except*	JOINTS 1 Brace at Jt(s): 13, 15
8-16: 2x4 SP No.1	

REACTIONS. (size) 8=0-3-8, 2=0-3-8
Max Horz 2=412(LC 12)
Max Uplift 8=326(LC 12), 2=13(LC 12)
Max Grav 8=2064(LC 1), 2=1040(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1738/206, 3-5=-711/0, 5-6=-679/62, 8-14=-1009/460
BOT CHORD 2-12=-651/1427, 10-12=-651/1427, 9-10=-232/551, 8-9=-234/554
WEBS 3-12=-208/652, 3-10=-992/474, 5-10=-332/342, 9-15=-572/1565, 6-13=-589/252, 13-14=-584/250, 8-15=-1010/416, 14-15=-445/1080

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 20-2-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 8=326.
 - Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1100 lb down and 342 lb up at 20-4-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15



May 21,2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A17	MONOPITCH	2	2	173627012

Comtech, Inc, Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:20 2025 Page 2
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

LOAD CASE(S) Standard
Uniform Loads (plf)
Vert: 1-7=-72, 2-8=-24
Concentrated Loads (lb)
Vert: 8=-1100

Livingston



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627013
J0525-2585	A18	MONOPITCH	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:20 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f
0-10-8 4-7-12 4-9-8 9-10-0 10-0-4 13-5-8 17-10-0 20-4-0 20-7-8
0-10-8 4-7-12 0-1-12 5-0-8 0-2-4 3-5-4 4-4-8 2-6-0 0-3-8

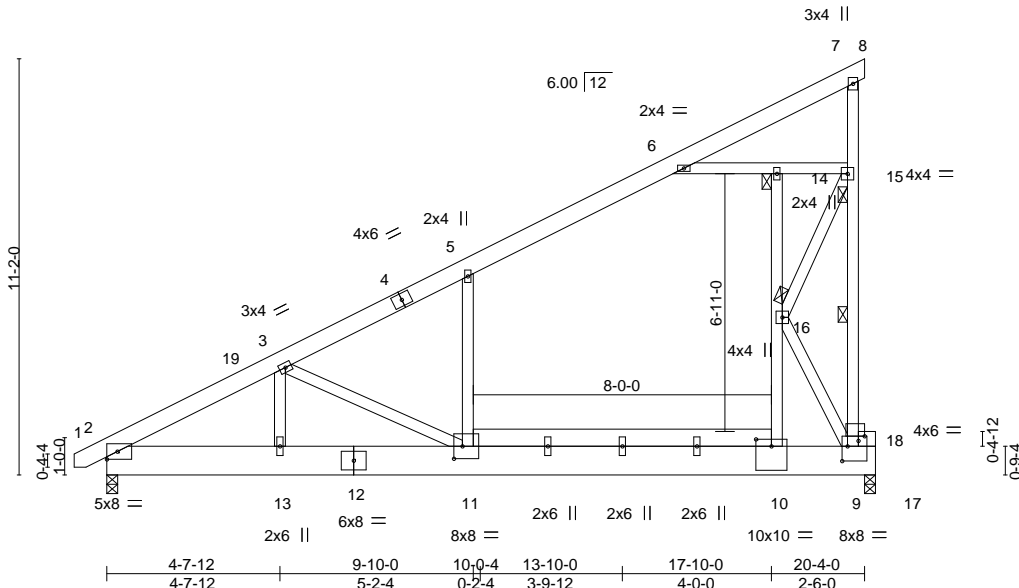


Plate Offsets (X,Y)-- [10:0-5-0,0-2-4], [11:0-2-12,0-4-0], [17:0-1-12,0-4-12], [18:0-2-0,0-1-8]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	-0.19 11 >999 360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.46	Vert(CT)	-0.32 11 >748 240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.67	Horz(CT)	0.01 9 n/a n/a		
BCDL	10.0	Code IRC2021/TP12014		Matrix-S		Wind(LL)	0.13 11 >999 240	Weight: 219 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 5-10-13 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.1 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2	WEBS	1 Row at midpt 15-17
		JOINTS	1 Brace at Jt(s): 14, 15, 16

REACTIONS. (size) 2=0-3-8, 9=0-3-8
Max Horz 2=342(LC 12)
Max Uplift 2=-16(LC 12), 9=-213(LC 12)
Max Grav 2=1051(LC 19), 9=2111(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1808/193, 3-5=-776/0, 5-6=-721/58, 9-15=-1227/457
BOT CHORD 2-13=-566/1533, 11-13=-566/1533, 10-11=-204/625, 9-10=-206/629
WEBS 3-13=-183/720, 3-11=-1028/410, 10-16=-563/2057, 5-11=-357/306, 6-14=-660/220, 14-15=-655/217, 9-16=-1229/389, 15-16=-417/1322

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 20-4-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 9=213.
 - 5) Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.
 - 6) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1100 lb down and 249 lb up at 20-2-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-19=-60, 7-19=-70, 7-8=-70, 2-9=-20
Concentrated Loads (lb)
Vert: 9=-1100



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A19	MONOPITCH	2	1	173627014

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:21 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

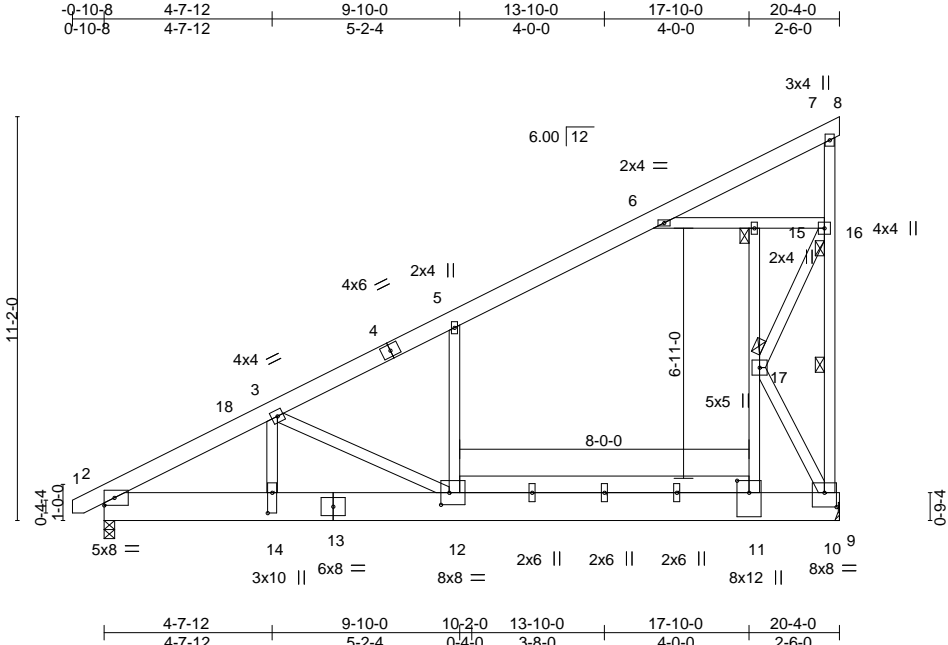


Plate Offsets (X,Y)--		[10:0-4-0,0-4-12], [11:0-4-0,0-4-0], [12:0-2-12,0-4-0], [14:0-6-12,0-1-8]	
LOADING (psf)	SPACING-	2-6-0	CSI.
TCLL 20.0	Plate Grip DOL	1.15	TC 0.52
TCDL 10.0	Lumber DOL	1.15	BC 0.57
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.84
BCDL 10.0	Code	IRC2021/TPI2014	Matrix-S
DEFL.	in (loc)	l/defl	L/d
Vert(LL)	-0.23	12	>999
Vert(CT)	-0.40	12	>604
Horz(CT)	0.01	10	n/a
Wind(LL)	0.16	12	>999
PLATES	GRIP		
MT20	244/190		
Weight: 217 lb		FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-3-15 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
2-13: 2x10 SP No.1, 9-13: 2x10 SP 2400F 2.0E	8-8-5 oc bracing: 11-12.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 10-16
	JOINTS 1 Brace at Jt(s): 15, 16, 17

REACTIONS. (size) 10=Mechanical, 2=0-3-8
Max Horz 2=428(LC 12)
Max Uplift 10=-231(LC 12), 2=-17(LC 12)
Max Grav 10=1417(LC 19), 2=1291(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2209/237, 3-5=-935/0, 5-6=-871/77, 10-16=-1456/529
BOT CHORD 2-14=-692/1872, 12-14=-692/1872, 11-12=-247/755, 10-11=-249/759
WEBS 3-12=-1266/503, 5-12=-439/384, 11-17=-707/2550, 15-17=-270/183, 6-15=-786/259, 15-16=-780/256, 10-17=-1561/499, 16-17=-509/1592, 3-14=-226/890

- NOTES-
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 20-4-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 10=231.
 - Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-18=-75, 7-18=-85, 7-8=-35, 2-9=-25



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	A20	MONOPITCH	4	1	173627015

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:21 2025 Page 1

ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

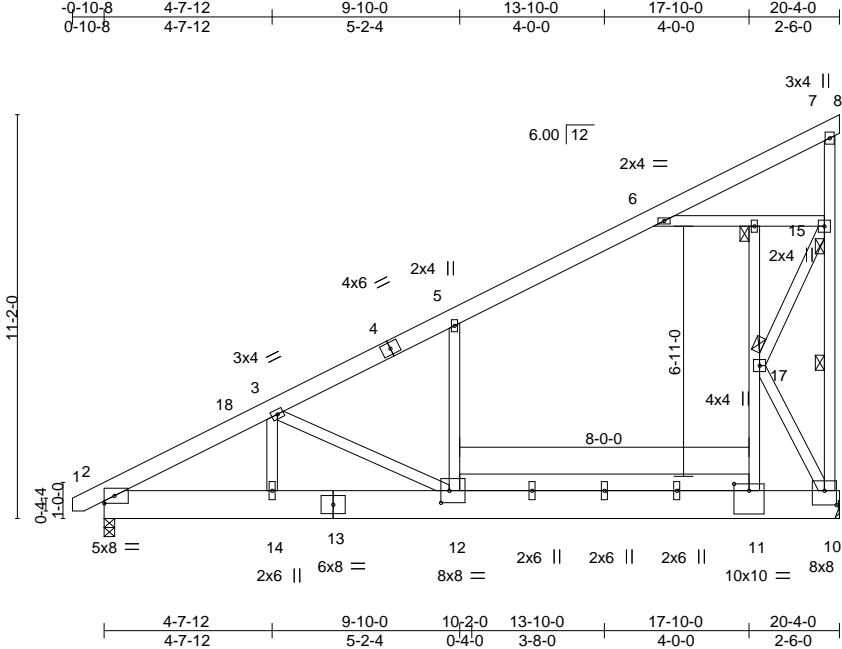

Scale: 3/16"=1'

Plate Offsets (X,Y)-- [10:0-4-0,0-4-12], [11:0-5-0,0-2-4], [12:0-2-12,0-4-0]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.38	Vert(LL)	-0.19	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.46	Vert(CT)	-0.32		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.69	Horz(CT)	0.01		
BCDL	10.0	Code	IRC2021/TP12014	Matrix-S		Wind(LL)	0.13	Weight: 217 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 5-11-0 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.1 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2	WEBS	1 Row at midpt 10-16
		JOINTS	1 Brace at Jt(s): 15, 16, 17

REACTIONS. (size) 10=Mechanical, 2=0-3-8
Max Horz 2=342(LC 12)
Max Uplift 10=-187(LC 12), 2=-15(LC 12)
Max Grav 10=1152(LC 19), 2=1045(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1794/198, 3-5=-761/0, 5-6=-710/65, 10-16=-1186/429
BOT CHORD 2-14=-561/1521, 12-14=-561/1521, 11-12=-201/614, 10-11=-202/617
WEBS 3-12=-1027/408, 5-12=-364/311, 11-17=-576/2069, 6-15=-639/211, 15-16=-634/208, 10-17=-1269/406, 16-17=-414/1294, 3-14=-184/722

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 20-4-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 10=187.
 - 6) Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-18=-60, 7-18=-70, 7-8=-30, 2-9=-20




May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932


Comtech, Inc. Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:22 2025 Page 1
 ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f
 -0-10-8 20-4-0
 0-10-8 20-4-0

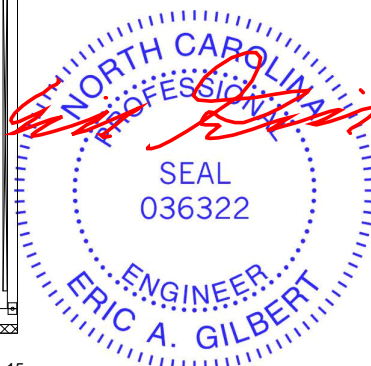

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-8-10 to 3-8-3, Exterior(2N) 3-8-3 to 20-2-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 16, 17, 18, 19, 20, 21, 22, 23 except (jt=lb) 24=225.
- 9) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DS8-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcacomponents.com)



Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	B01GE	GABLE	1	1	173627017

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:22 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hg3NSgPqnL8w3uTXbGKWrcDoi7J4zJC?f

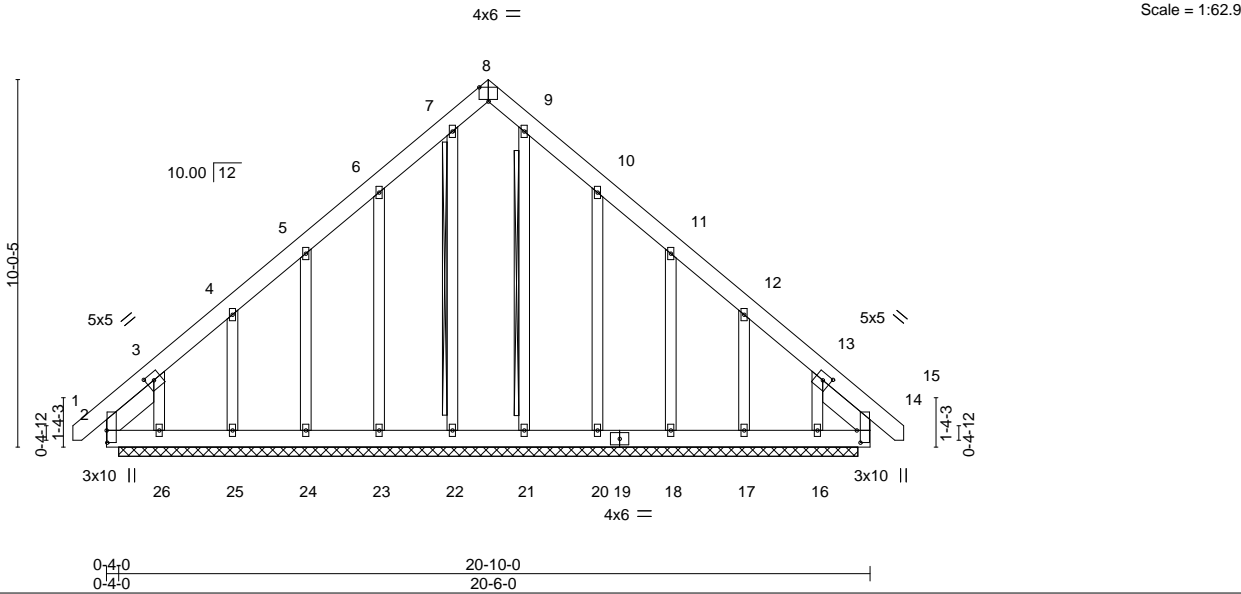


Plate Offsets (X,Y)-- [2:0-4-0,0-0-3], [3:0-2-8,0-2-4], [8:0-3-0,Edge], [13:0-2-8,0-2-4], [14:0-4-0,0-1-3]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	-0.00	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	-0.00		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.01		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S				Weight: 201 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD	2x6 SP No.1	BOT CHORD	Rigid ceiling directly applied or 10'-0" oc bracing.
OTHERS	2x4 SP No.2	WEBS	T-Brace: 2x4 SPF No.2 - 7'-22, 9'-21
SLIDER	Left 2x6 SP No.1 1'-10-7, Right 2x6 SP No.1 1'-10-7		Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
			Brace must cover 90% of web length.

REACTIONS.	
All bearings 20'-2-0.	
(lb) - Max Horz	2=284(LC 9)
Max Uplift	All uplift 100 lb or less at joint(s) 22, 14 except 2=146(LC 10), 23=126(LC 12), 24=112(LC 12), 25=118(LC 12), 26=255(LC 12), 20=129(LC 13), 18=113(LC 13), 17=117(LC 13), 16=238(LC 13)
Max Grav	All reactions 250 lb or less at joint(s) 22, 23, 24, 25, 26, 21, 20, 18, 17, 16 except 2=331(LC 12), 14=288(LC 13)
FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=448/259, 13-14=396/181
BOT CHORD	2-26=125/274, 25-26=125/274, 24-25=125/274, 23-24=125/274, 22-23=125/274, 21-22=125/274, 20-21=125/274, 18-20=125/274, 17-18=125/274, 16-17=125/274, 14-16=125/273
WEBS	3-26=169/266, 13-16=169/265

NOTES-	
1) Unbalanced roof live loads have been considered for this design.	
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-9-9 to 3-5-4, Exterior(2N) 3-5-4 to 10-5-0, Corner(3R) 10-5-0 to 14-9-13, Exterior(2N) 14-9-13 to 21-7-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60	
3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.	
4) All plates are 2x4 MT20 unless otherwise indicated.	
5) Gable studs spaced at 2'-0" oc.	
6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.	
7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.	
8) Solid blocking is required on both sides of the truss at joint(s), 2, 14.	
9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 22, 14 except (jt=lb) 2=146, 23=126, 24=112, 25=118, 26=255, 20=129, 18=113, 17=117, 16=238.	
10) Non Standard bearing condition. Review required.	
11) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.	



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MITEK Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	B02	COMMON	2	1	173627018

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:23 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hg3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

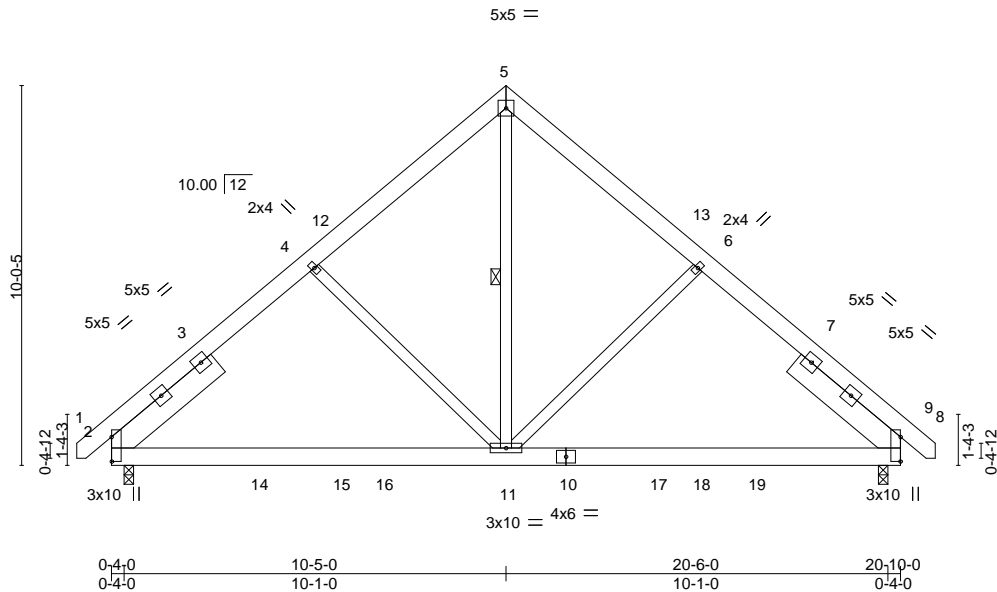



Plate Offsets (X,Y)--		[2:0-7-12,0-0-1], [8:0-7-12,0-0-1]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.15	TC 0.13
TCDL 10.0	Lumber DOL	1.15	BC 0.45
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.34
BCDL 10.0	Code	IRC2021/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.10 8-11 >999 360
			Vert(CT) -0.16 8-11 >999 240
			Horz(CT) 0.01 8 n/a n/a
			Wind(LL) 0.13 2-11 >999 240
			PLATES GRIP
			MT20 244/190
			Weight: 175 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 5-11
SLIDER Left 2x8 SP No.1 3-7-3, Right 2x8 SP No.1 3-7-3	

REACTIONS. (size) 8=0-3-0, 2=0-3-0
Max Horz 2=228(LC 9)
Max Uplift 8=109(LC 8), 2=-109(LC 9)
Max Grav 8=1003(LC 2), 2=1003(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-1036/798, 4-5=-845/820, 5-6=-845/820, 6-8=-1036/798
BOT CHORD 2-11=-506/733, 8-11=-484/694
WEBS 5-11=-866/707

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-9 to 3-7-4, Interior(1) 3-7-4 to 10-5-0, Exterior(2R) 10-5-0 to 14-9-13, Interior(1) 14-9-13 to 21-7-9 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=109, 2=109.

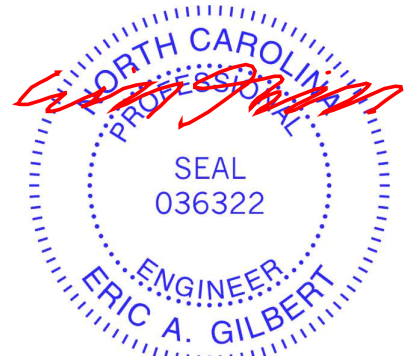

May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	I73627019
J0525-2585	M01	GABLE	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC 28309

8.630 s Feb 9 2023 MiTek Industries, Inc. Wed May 21 11:51:07 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-PoNSrBnlmayQwhn1UjDPmTf05IGzm1RGIVilQWzESD2

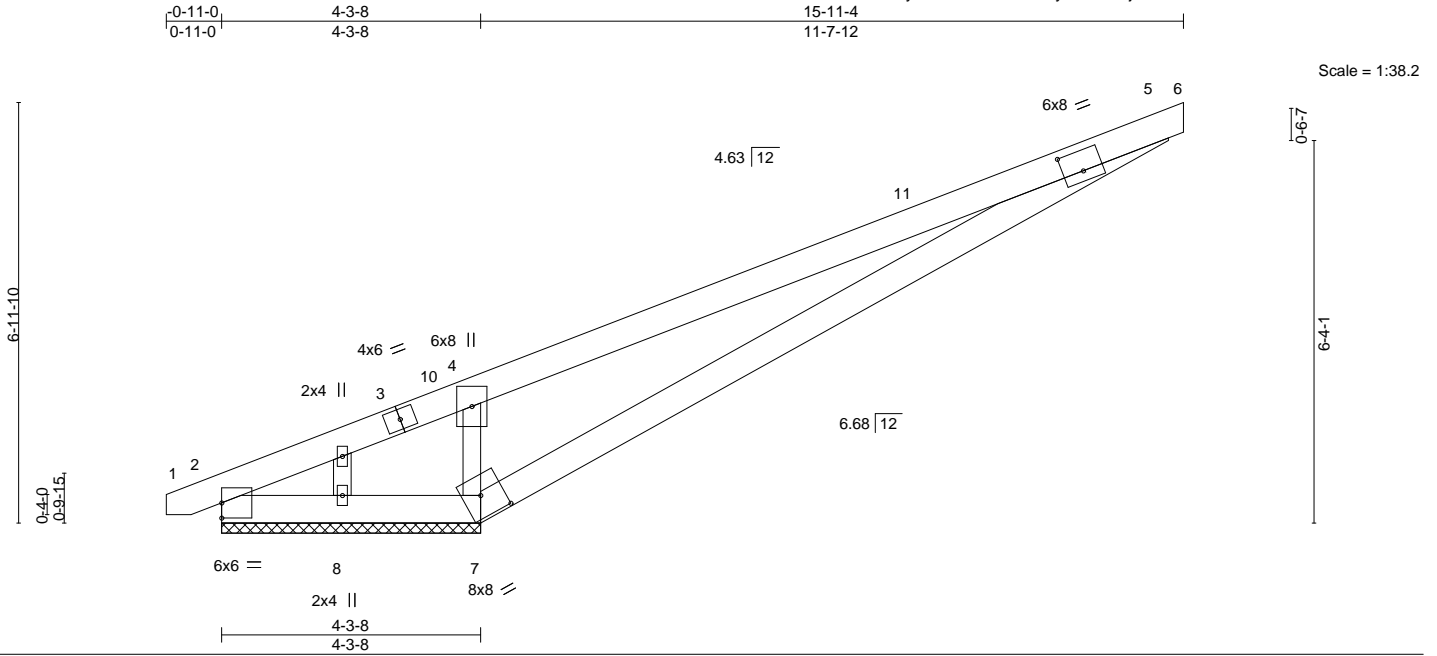


Plate Offsets (X,Y)--		[5:0-4-0,0-4-0], [7:0-4-8,0-4-4]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d
TCLL 20.0		Plate Grip DOL	1.15	TC 0.84		Vert(LL)	0.00 5-6	n/r	120
TCDL 10.0		Lumber DOL	1.15	BC 0.77		Vert(CT)	0.00 5-6	n/r	120
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.00		Horz(CT)	0.01 7	n/a	n/a
BCDL 10.0		Code IRC2021/TPI2014		Matrix-R					
						PLATES		GRIP	
						MT20		244/190	
						Weight: 86 lb		FT = 20%	

LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-4-11 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 4-8-0 oc bracing.

REACTIONS. (size) 7=4-3-8, 2=4-3-8, 8=4-3-8
Max Horz 2=209(LC 12)
Max Uplift 7=-419(LC 12), 2=-861(LC 1), 8=-271(LC 1)
Max Grav 7=2435(LC 1), 2=267(LC 12), 8=5(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-3922/2517, 4-5=-3223/2180, 4-7=-924/1521
BOT CHORD 2-8=-2043/2836, 7-8=-2042/2835, 5-7=-2310/3223

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Corner(3E) -0-8-9 to 3-8-4, Exterior(2N) 3-8-4 to 15-11-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 419 lb uplift at joint 7, 861 lb uplift at joint 2 and 271 lb uplift at joint 8.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 21, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	VB1	Valley	1	1	173627020

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:24 2025 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

Job Reference (optional)

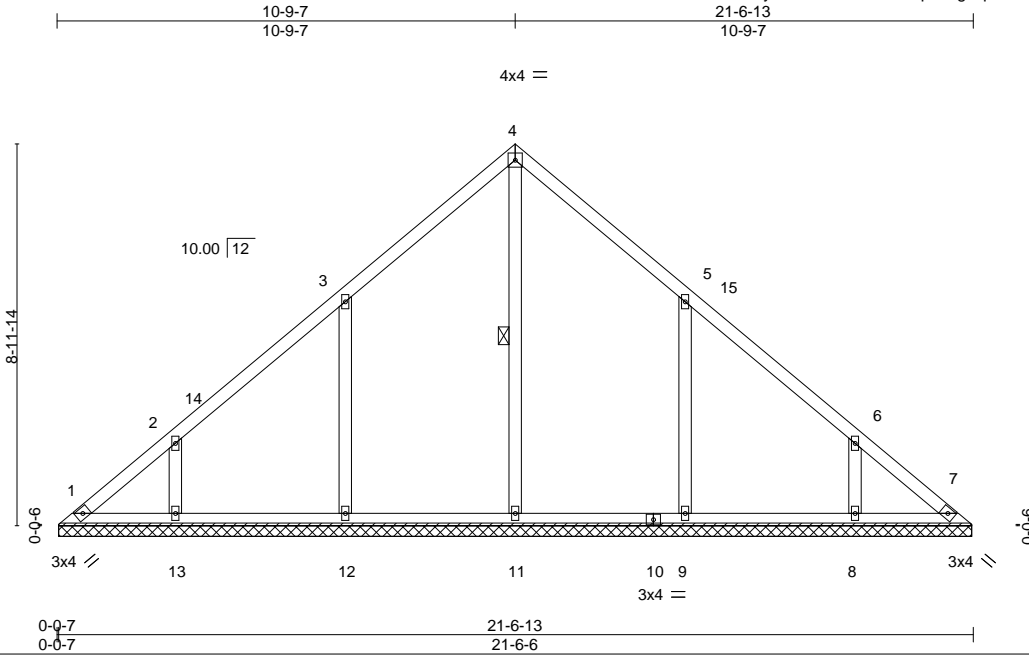

Scale = 1:54.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT)	0.00	7	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014		Matrix-S						Weight: 105 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	WEBS 1 Row at midpt 4-11

REACTIONS. All bearings 21-5-15.
(lb) - Max Horz 1=207(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 1, 7 except 12=140(LC 12), 13=108(LC 12), 9=140(LC 13), 8=108(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 11=437(LC 22), 12=504(LC 19), 13=354(LC 19), 9=504(LC 20), 8=354(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-12=302/253, 5-9=302/252

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 10-9-7, Exterior(2R) 10-9-7 to 15-2-3, Interior(1) 15-2-3 to 21-2-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7 except (jt=lb) 12=140, 13=108, 9=140, 8=108.



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road	173627021
J0525-2585	VB2	Valley	1	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:24 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

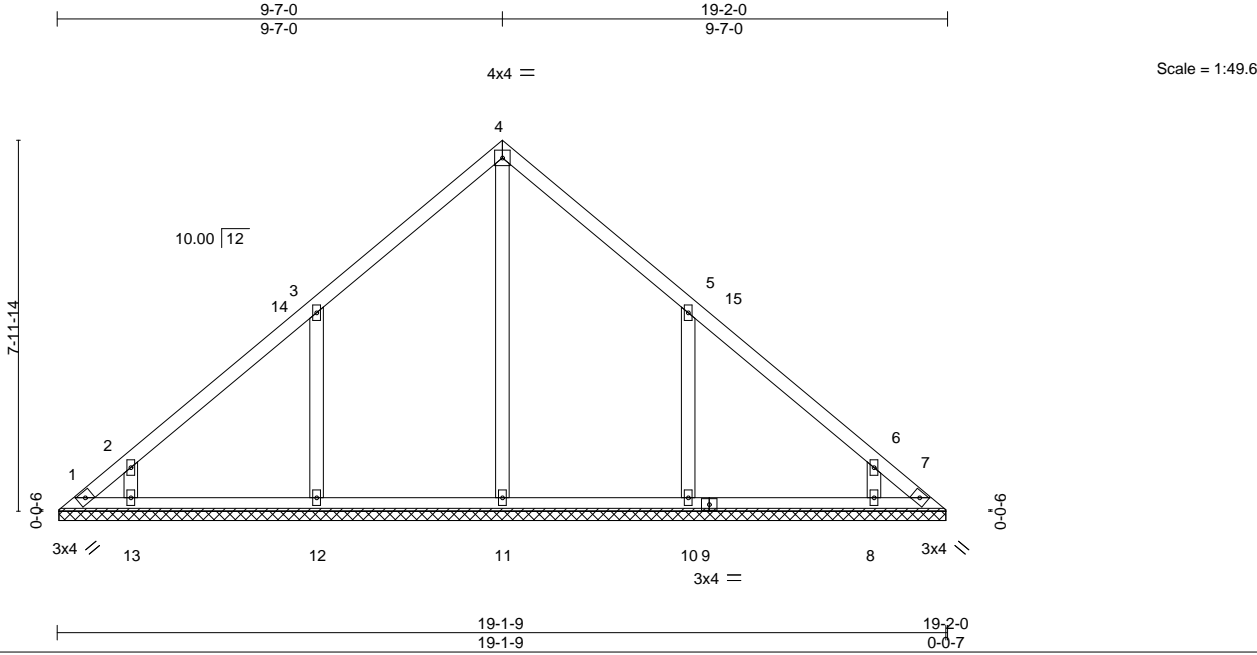

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.00	7	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014		Matrix-S						Weight: 89 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 19-1-2.
(lb) - Max Horz 1=-183(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 7 except 1=-104(LC 10), 12=-141(LC 12), 13=-100(LC 12), 10=-141(LC 13), 8=-100(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 11=427(LC 22), 12=507(LC 19), 13=328(LC 19), 10=507(LC 20), 8=328(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-12=-304/254, 5-10=-303/254

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 9-7-0, Exterior(2R) 9-7-0 to 13-11-13, Interior(1) 13-11-13 to 18-9-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 1=104, 12=141, 13=100, 10=141, 8=100.



May 21, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	VB3	Valley	1	1	173627022

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:25 2025 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

Job Reference (optional)

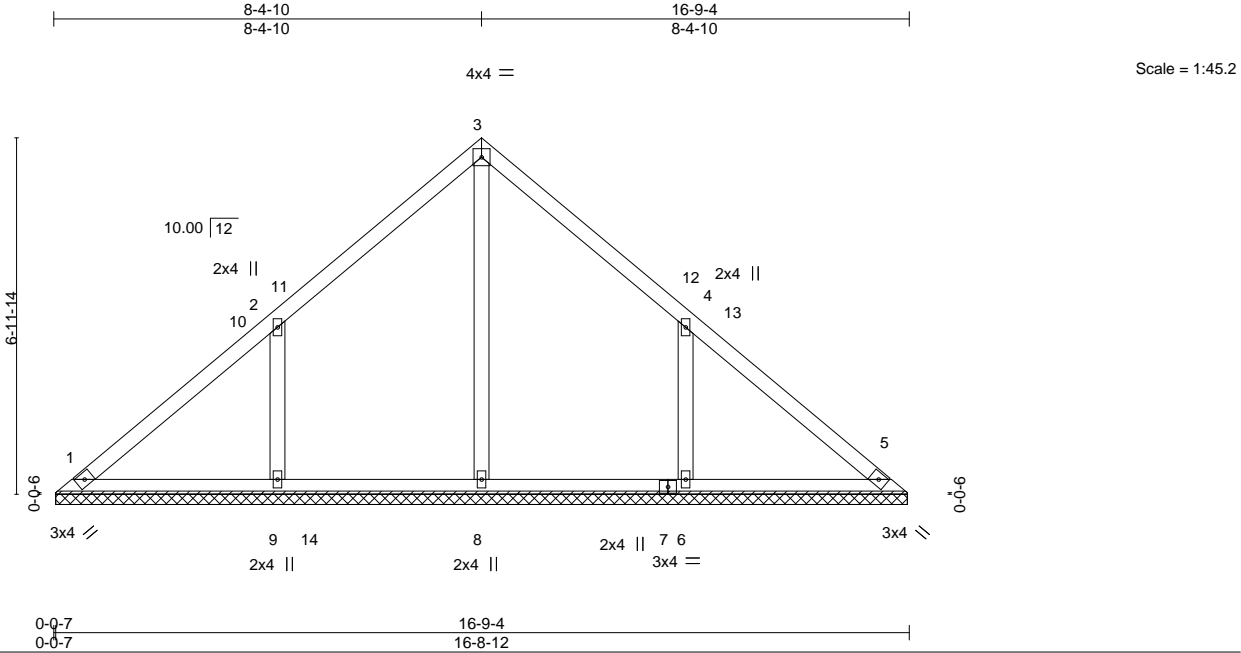

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014		Matrix-S						Weight: 74 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 16-8-5.

(lb) - Max Horz 1=-159(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 1 except 9=-153(LC 12), 6=-153(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 8=406(LC 22), 9=527(LC 19), 6=535(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-9=-322/273, 4-6=-322/273

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 8-4-10, Exterior(2R) 8-4-10 to 12-9-7, Interior(1) 12-9-7 to 16-4-6 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 9=153, 6=153.



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	VB5	Valley	1	1	173627024

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:26 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

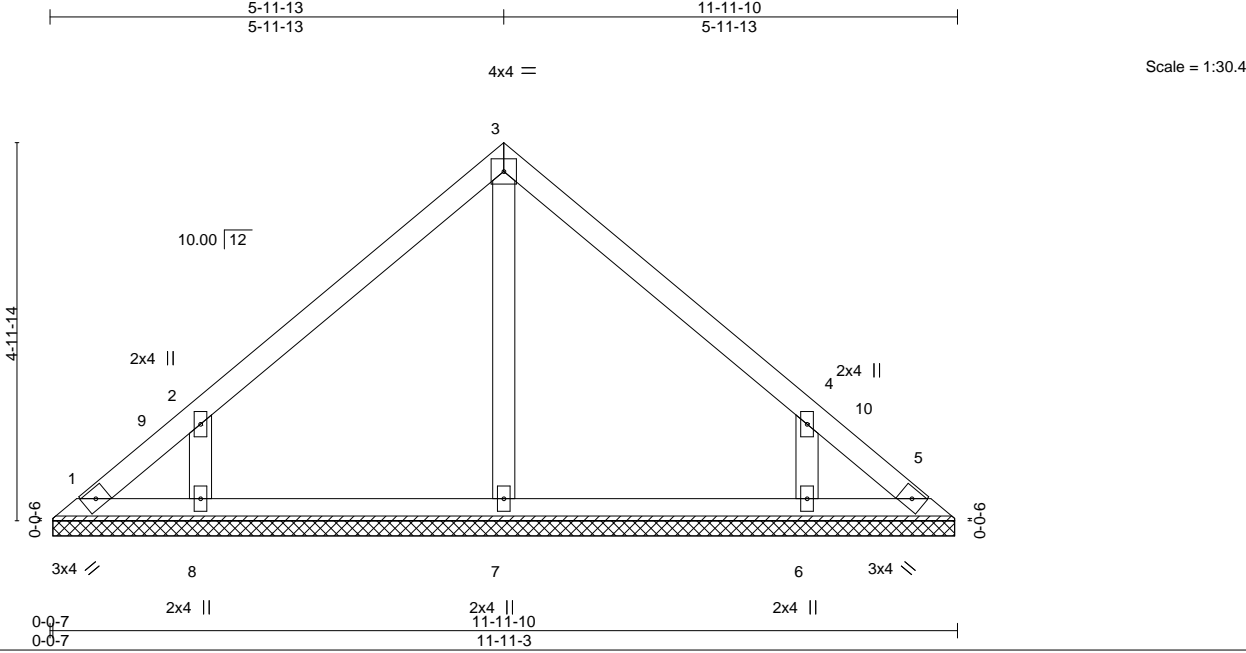

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014		Matrix-S						Weight: 49 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 11-10-12.
(lb) - Max Horz 1=112(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=123(LC 12), 6=123(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=325(LC 19), 6=324(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-266/308, 4-6=-266/308

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 5-11-13, Exterior(2R) 5-11-13 to 10-4-10, Interior(1) 10-4-10 to 11-6-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=123, 6=123.




May 21, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	VB6	Valley	1	1	173627025

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:26 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

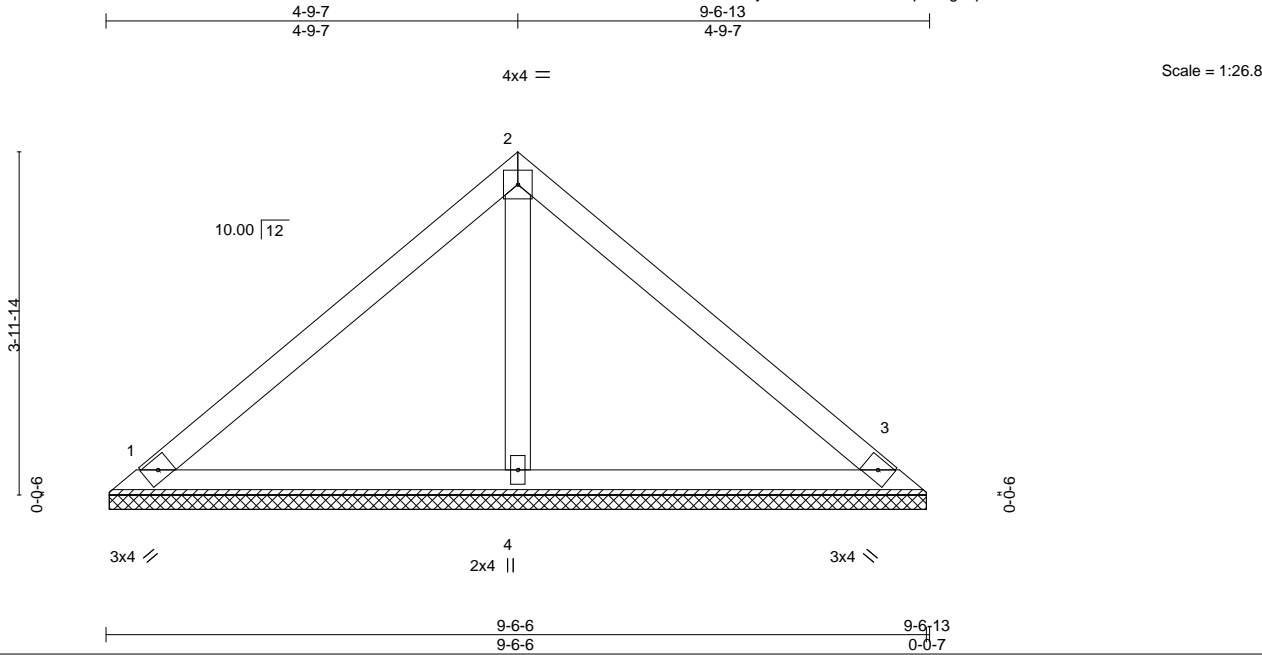

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.21	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.14	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.05	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014	Matrix-S						Weight: 36 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS.	(size) 1=9-5-15, 3=9-5-15, 4=9-5-15
	Max Horz 1=-88(LC 8)
	Max Uplift 1=-21(LC 13), 3=-29(LC 13)
	Max Grav 1=187(LC 1), 3=187(LC 1), 4=327(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.




May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	VB7	Valley	1	1	173627026

Comtech, Inc., Fayetteville, NC - 28314, 8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:27 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hg3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

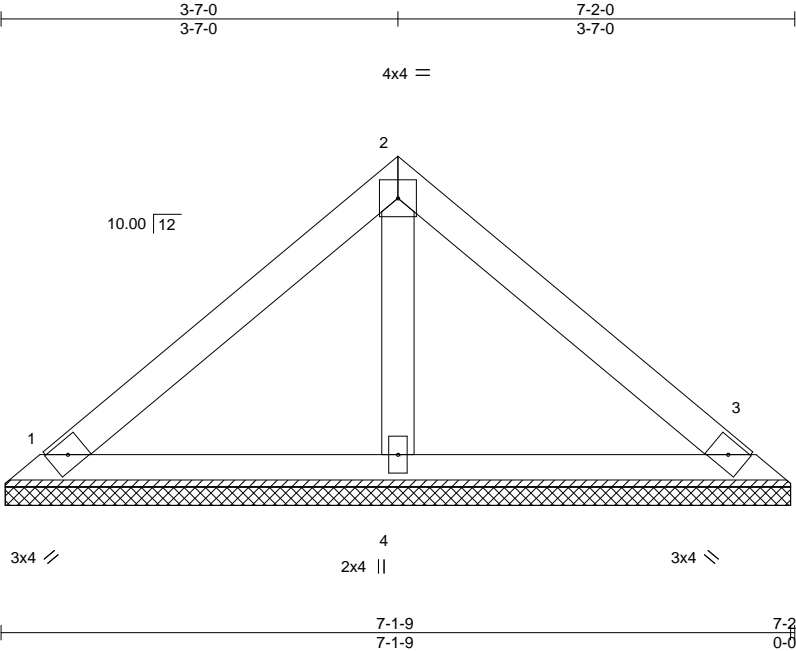

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.19	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.08	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 3 n/a n/a		
	Code IRC2021/TPI2014			Weight: 26 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. (size) 1=7-1-2, 3=7-1-2, 4=7-1-2
Max Horz 1=64(LC 11)
Max Uplift 1=-22(LC 13), 3=-28(LC 13)
Max Grav 1=147(LC 1), 3=147(LC 1), 4=215(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.




May 21,2025

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	VB8	Valley	1	1	173627027

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:27 2025 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

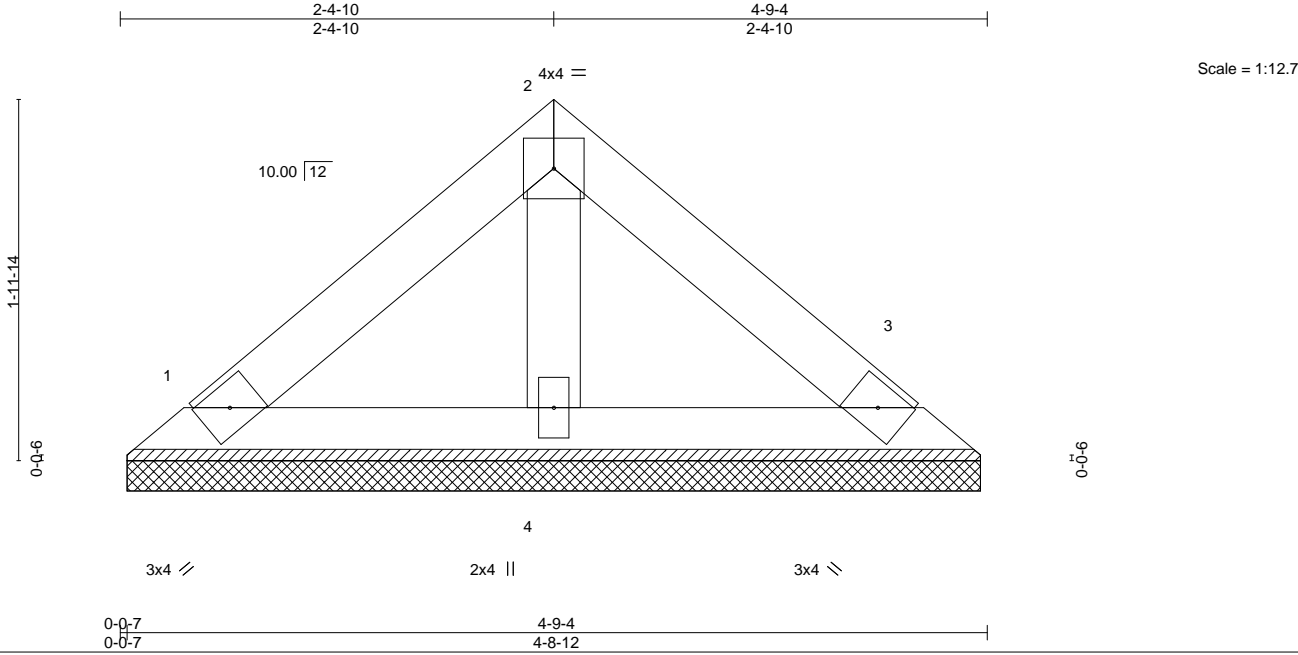

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.01	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2021/TPI2014	Matrix-P						Weight: 17 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-9-4 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. (size) 1=4-8-5, 3=4-8-5, 4=4-8-5
Max Horz 1=-40(LC 8)
Max Uplift 1=-14(LC 13), 3=-17(LC 13)
Max Grav 1=92(LC 1), 3=92(LC 1), 4=134(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



May 21,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 191 Ballard Road
J0525-2585	VB9	Valley	1	1	173627028

Comtech, Inc., Fayetteville, NC - 28314,

8.630 s Sep 26 2024 MiTek Industries, Inc. Tue May 20 11:13:28 2025 Page 1
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

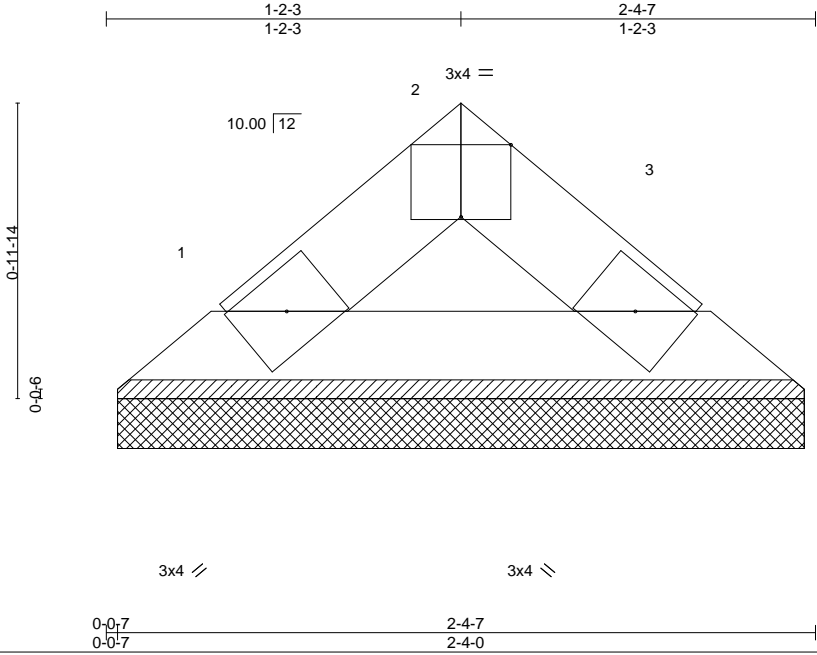


Plate Offsets (X,Y)--		[2:0-2:0,Edge]	
LOADING (psf)		SPACING-	2-0-0
TCLL	20.0	Plate Grip DOL	1.15
TCDL	10.0	Lumber DOL	1.15
BCLL	0.0 *	Rep Stress Incr	YES
BCDL	10.0	Code	IRC2021/TPI2014
		CSI.	
		TC	0.02
		BC	0.02
		WB	0.00
		Matrix-P	
		DEFL.	
		in (loc)	l/defl L/d
		Vert(LL)	n/a - n/a 999
		Vert(CT)	n/a - n/a 999
		Horz(CT)	0.00 3 n/a n/a
		PLATES	GRIP
		MT20	244/190
		Weight: 7 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 2-4-7 oc purlins. Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD	2x4 SP No.1	BOT CHORD	

REACTIONS. (size) 1=2-3-8, 3=2-3-8
Max Horz 1=16(LC 8)
Max Uplift 1=3(LC 12), 3=3(LC 13)
Max Grav 1=63(LC 1), 3=63(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



May 21,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

