


Lot #1 - Dixon Road
3-Bedroom - Septic Proposal
Ferrell & Gilliam
Harnett County



Adams
Soil Consulting
919-414-6761
Job #1623
4-7-25

**1000 Gallon Septic Tank

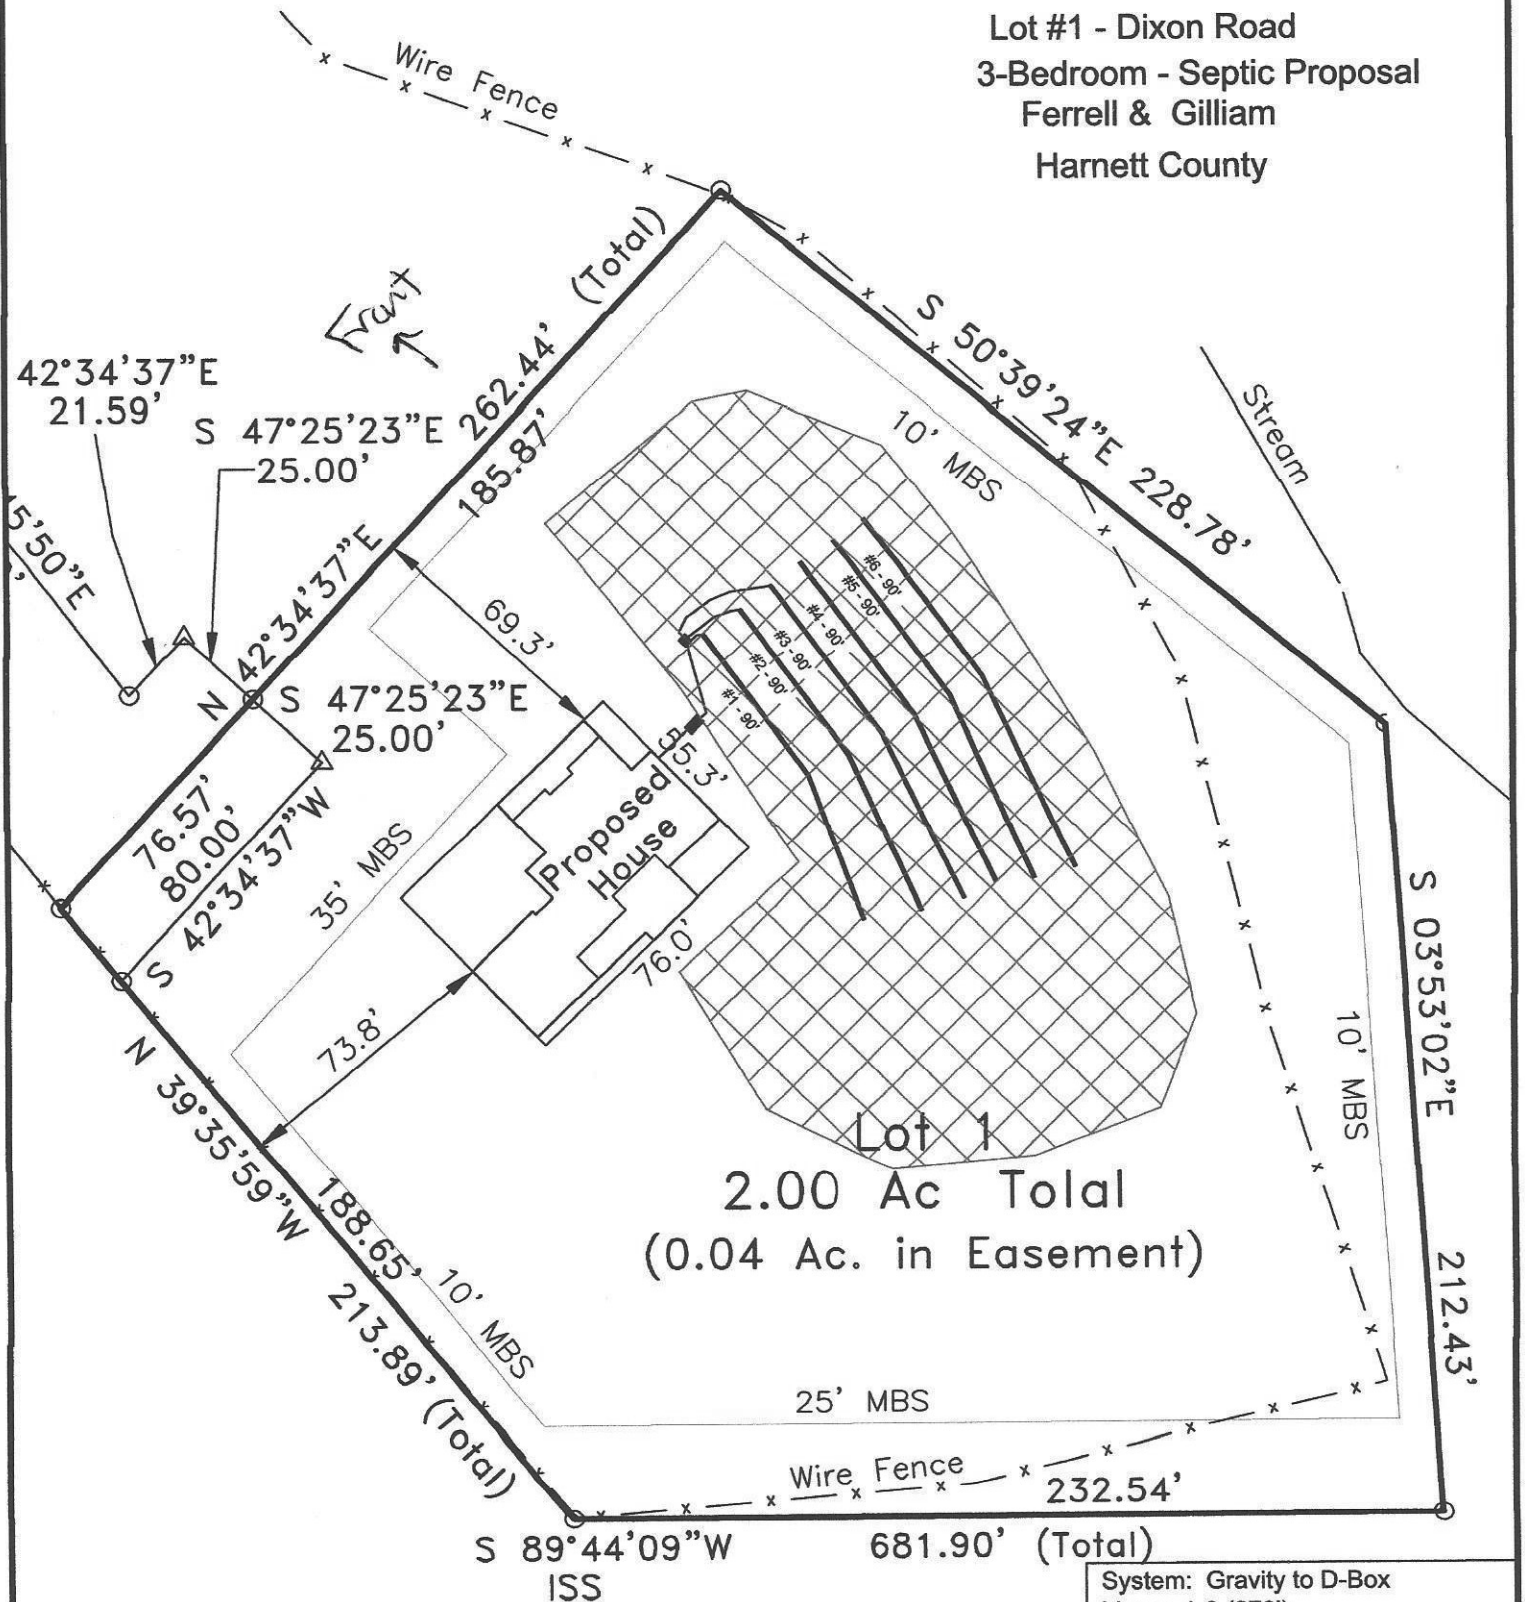

System: Gravity to D-Box
Lines: 1-3 (270')
0.35 LTAR
18" Max Trench Bottom
Accepted Status System
Repair: Gravity to D-Box
Lines: 4-6 (270')
0.35 LTAR
18" Max Trench Bottom
Accepted Status System