

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: 25-3222-A
RVF-LOT #35 ROOF

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Riverside Roof Truss.

Pages or sheets covered by this seal: I73816286 thru I73816304

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844



May 30, 2025

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816286
25-3222-A	HG01	Hip Girder	1	2	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:29 2025 Page 1

ID:Bxl2MwYau_NHkbraGcmHloyOvst-6NnqxUNQw8X5vnnQM02p3nlRdcECQea_YH9V9WzBjMi



Scale = 1:39.4

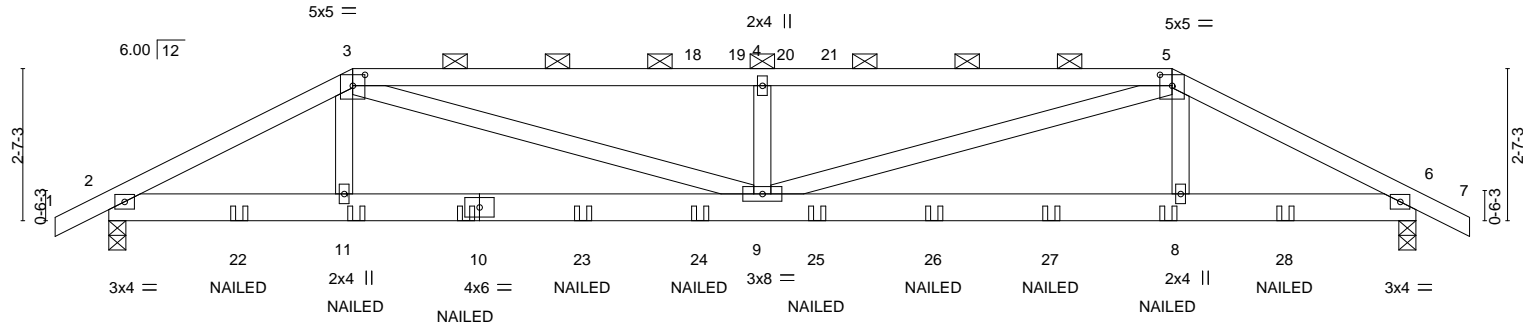


Plate Offsets (X,Y)--	[2:0-0-0,0-0-0], [3:0-2-8,0-2-4], [5:0-2-8,0-2-4], [6:0-0-0,0-0-0]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.78	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 16.5/15.0	Plate Grip DOL 1.15	BC 0.45	Vert(LL) -0.13 9 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.39	Vert(CT) -0.22 9-11 >999 180		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.03 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 239 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except
BOT CHORD 2x6 SP No.2	2-0-0 oc purlins (5-0-2 max.): 3-5.
WEBS 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 6=0-3-8
Max Horz 2=42(LC 10)
Max Uplift 2=241(LC 12), 6=241(LC 12)
Max Grav 2=1481(LC 34), 6=1479(LC 34)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2904/425, 3-4=-4361/626, 4-5=-4361/626, 5-6=-2897/423
BOT CHORD 2-11=-341/2580, 9-11=-340/2552, 8-9=-339/2545, 6-8=-340/2573
WEBS 3-11=-28/473, 3-9=-307/1898, 4-9=-600/158, 5-9=-309/1905, 5-8=-26/468

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=16.5 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0 Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=241, 6=241.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Continued on page 2



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MITEK Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816286
25-3222-A	HG01	Hip Girder	1	2	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,


8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:29 2025 Page 2
ID:Bxl2MwYau_NHkbraGCmHloyOvst-6NnqxUNQw8X5vnnvQMo2p3nlRdcECQea_YH9V9WzBjMi

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-3=-43, 3-5=-53, 5-7=-43, 12-15=-20
 - Concentrated Loads (lb)
 - Vert: 10=-118(B) 11=-118(B) 8=-118(B) 22=-117(B) 23=-118(B) 24=-118(B) 25=-118(B) 26=-118(B) 27=-118(B) 28=-117(B)



May 30,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY

 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816287
25-3222-A	J01	Jack-Open	2	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541, 8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:30 2025 Page 1
ID:Bxl2MwYau_NHkbraGCmHloyOvst-aZLC8qN2hSfyXwUdvVZ2c_Hoa0gq9A_7nxv3hzzBjMh

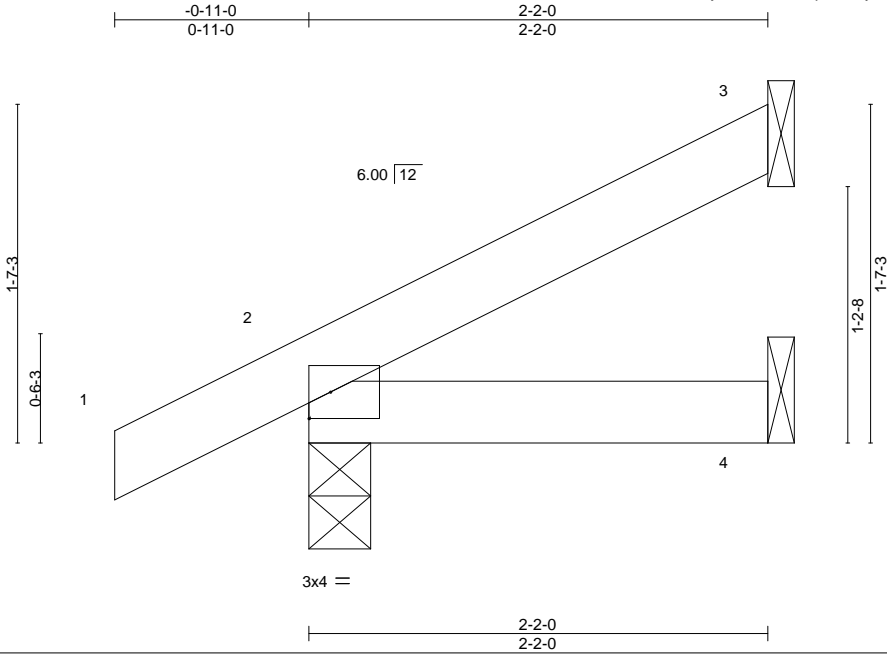

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	-0.00 7 >999 240	MT20		244/190	
Snow (Pf/Pg)	11.6/15.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	-0.00 4-7 >999 180				
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00 3 n/a n/a				
BCLL	0.0 *	Code	IRC2018/TPI2014	Matrix-MP							
BCDL	10.0										
								Weight: 9 lb		FT = 20%	

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=50(LC 16)
Max Uplift 3=-18(LC 16), 2=-30(LC 16)
Max Grav 3=52(LC 21), 2=156(LC 21), 4=37(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) TCDL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - 3) Unbalanced snow loads have been considered for this design.
 - 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
 - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816288
25-3222-A	M01	MONOPITCH	8	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:30 2025 Page 1

ID:Bxl2MwYau_NHkbraGCMHloyOvst-aZLC8qN2hSfyXwUdvVZ2c_Hfp0aw9A_7nxv3hzzBjMh

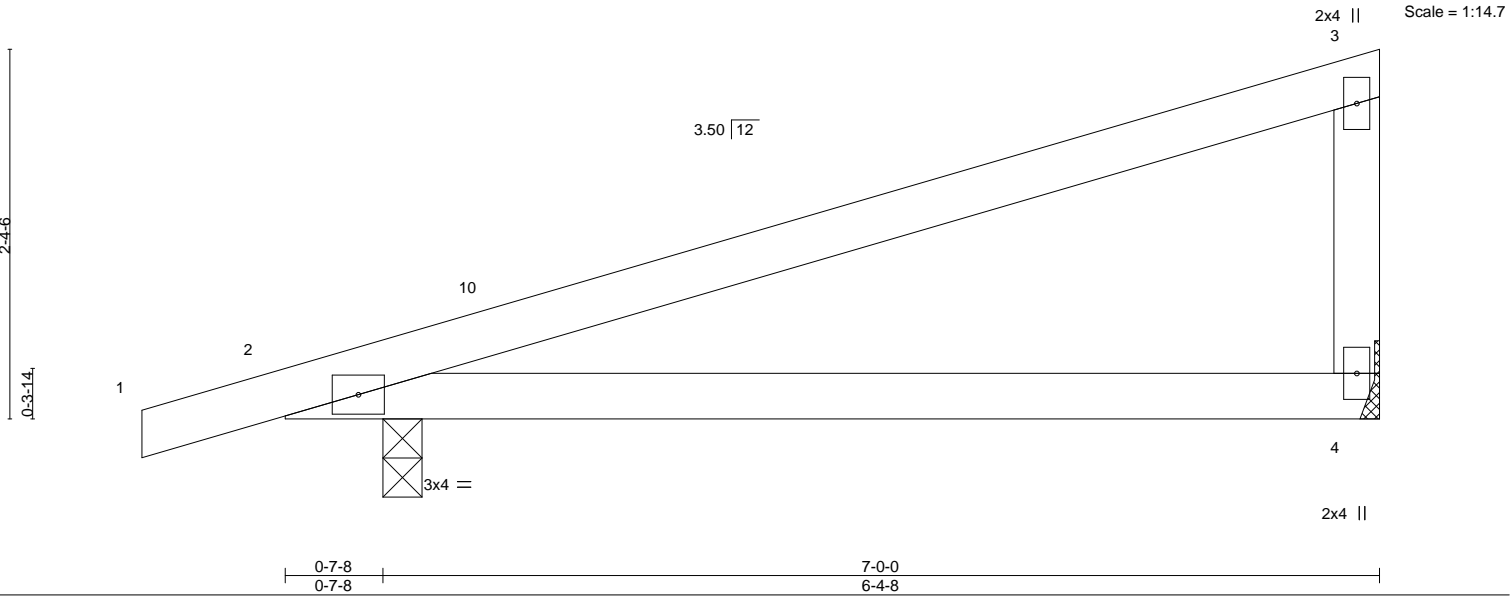

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.62	Vert(LL)	0.07 4-9 >999 240	MT20	244/190		
Snow (Pf/Pg)	11.6/15.0	Lumber DOL	1.15	BC	0.41	Vert(CT)	-0.14 4-9 >574 180				
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00 2 n/a n/a				
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MP							
BCDL	10.0										

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS. (size) 4=Mechanical, 2=0-3-0
Max Horz 2=74(LC 15)
Max Uplift 4=12(LC 12), 2=-50(LC 16)
Max Grav 4=246(LC 21), 2=366(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Refer to girder(s) for truss to truss connections.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.




May 30,2025

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816289
25-3222-A	M01GE	MONOPITCH STRUCTURAL	1	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:30 2025 Page 1

ID:BxI2MwYau_NHkbraGcmHloyOvst-aZLC8qN2hSfyXwUdvVZ2c_Hfp0aw9A_7nxv3hzzBjMh

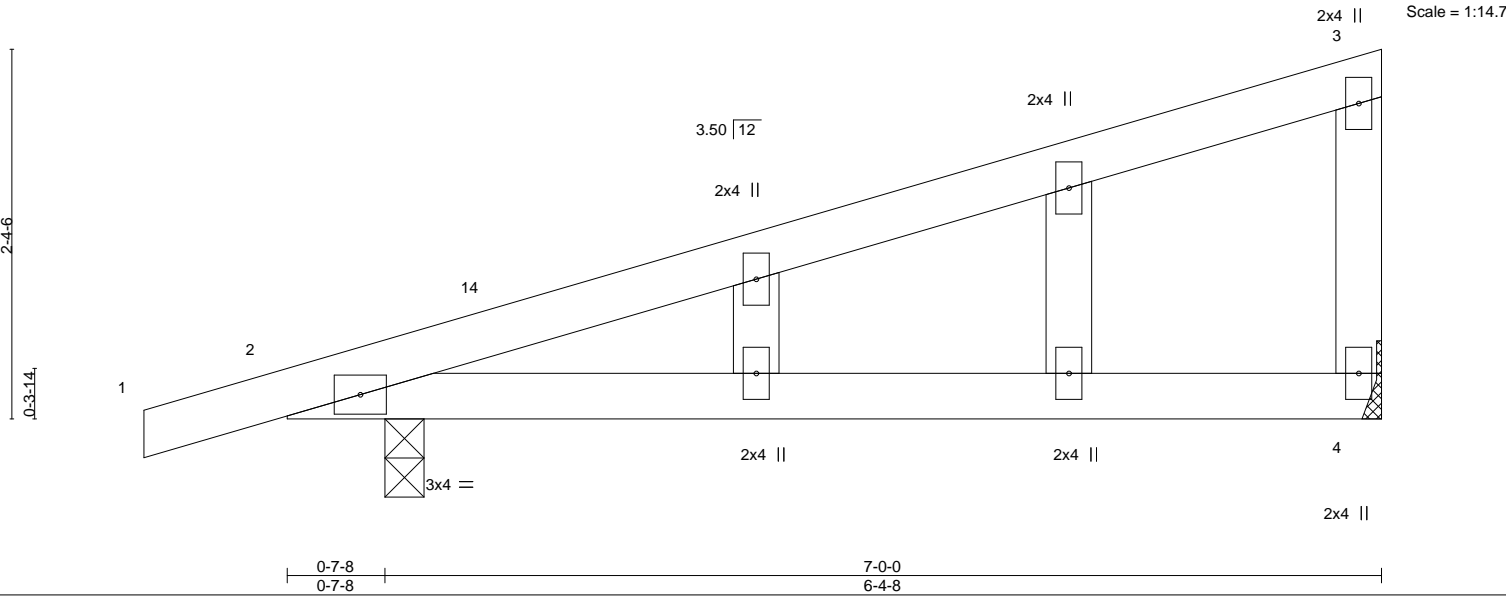

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	0.07	4-13	>999	240	MT20
Snow (Pf/Pg) 11.6/15.0	Lumber DOL	1.15	BC 0.41	Vert(CT)	-0.14	4-13	>574	180	244/190
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a	
BCLL 0.0 *	Code	IRC2018/TPI2014	Matrix-MP						
BCDL 10.0									

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-3-0
Max Horz 2=74(LC 15)
Max Uplift 4=-12(LC 12), 2=-50(LC 16)
Max Grav 4=246(LC 21), 2=366(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MITEK Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816290
25-3222-A	M02	MONOPITCH STRUCTURAL	1	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541, 8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:31 2025 Page 1
ID:Bxl2MwYau_NHkbraGCmHloyOvst-2mnbLAOhSlnp843pTC5H8Cqy4Q_budEH0becDPzBjMg

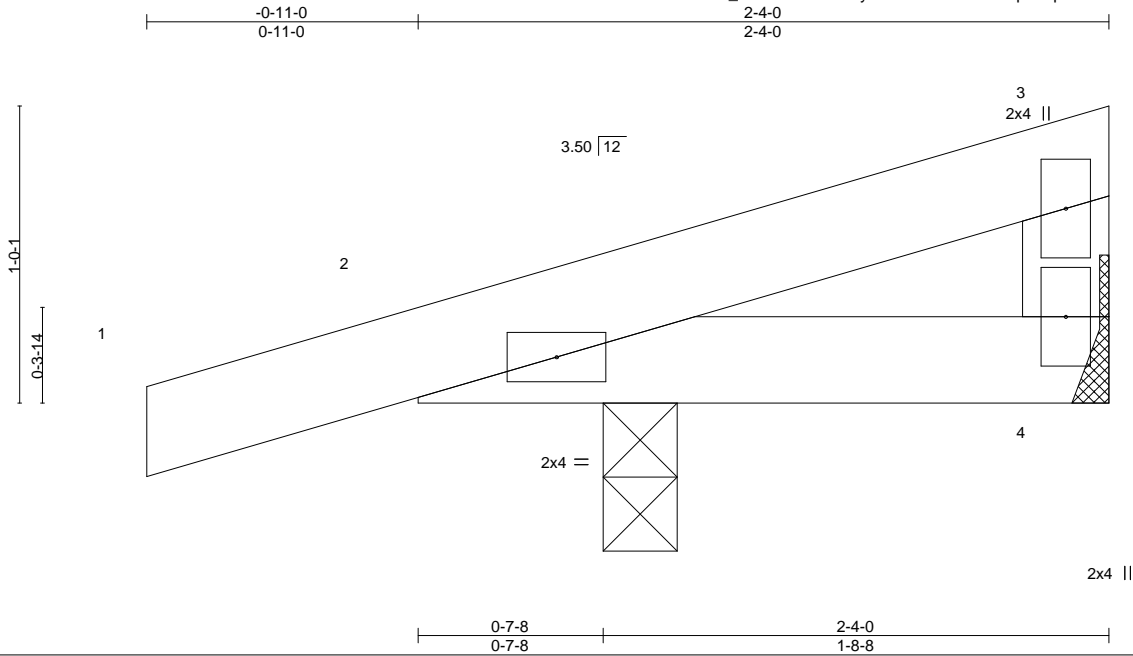

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.08	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 11.6/15.0	Plate Grip DOL 1.15	BC 0.07	Vert(LL) -0.00 5 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.00 5 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MP	Horz(CT) 0.00 4 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 9 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-4-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 4=Mechanical, 2=0-3-0
Max Horz 2=27(LC 15)
Max Uplift 4=-1(LC 20), 2=-56(LC 16)
Max Grav 4=27(LC 7), 2=216(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816291
25-3222-A	M03	Monopitch	8	1	Job Reference (optional)	


Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:31 2025 Page 1

ID:BxI2MwYau_NHkbraGCMhloyOvst-2mvlLAOhSlnp843pTC5H8CqxuQzbudEH0becDPzBjMg



Scale: 3/4"=1'

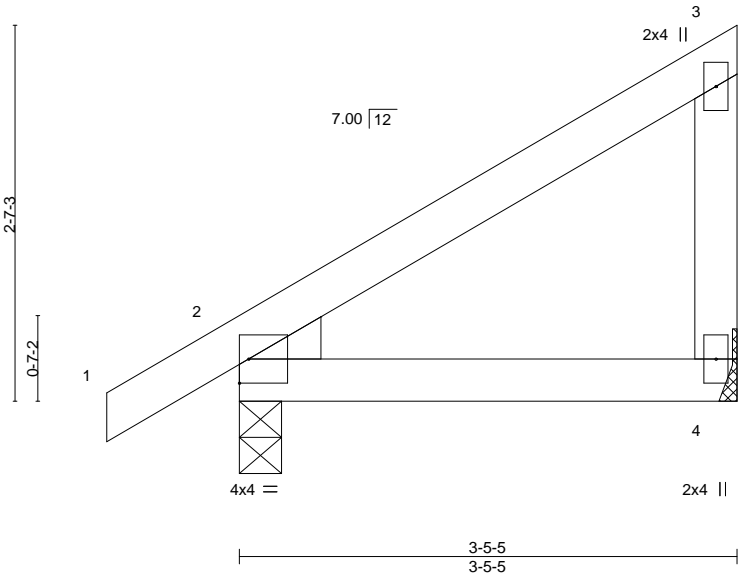

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.15	Vert(LL)	-0.01	4-7	>999	240	MT20	244/190
Snow (Pf/Pg) 11.6/15.0	Plate Grip DOL 1.15	BC 0.13	Vert(CT)	-0.01	4-7	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MP							
BCDL 10.0	Code IRC2018/TPI2014								
								Weight: 17 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-5 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-3-8
Max Horz 2=82(LC 15)
Max Uplift 4=19(LC 13), 2=37(LC 16)
Max Grav 4=138(LC 21), 2=194(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 3-3-9 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816292
25-3222-A	PB01	Piggyback	24	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541, 8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:32 2025 Page 1
ID:Bxl2MwYau_NHkbraGCmHloyOvst-WyTzZWPJD3vgmEe?1wcWhPN7tqL7d4AQFFOAmrzBjMf

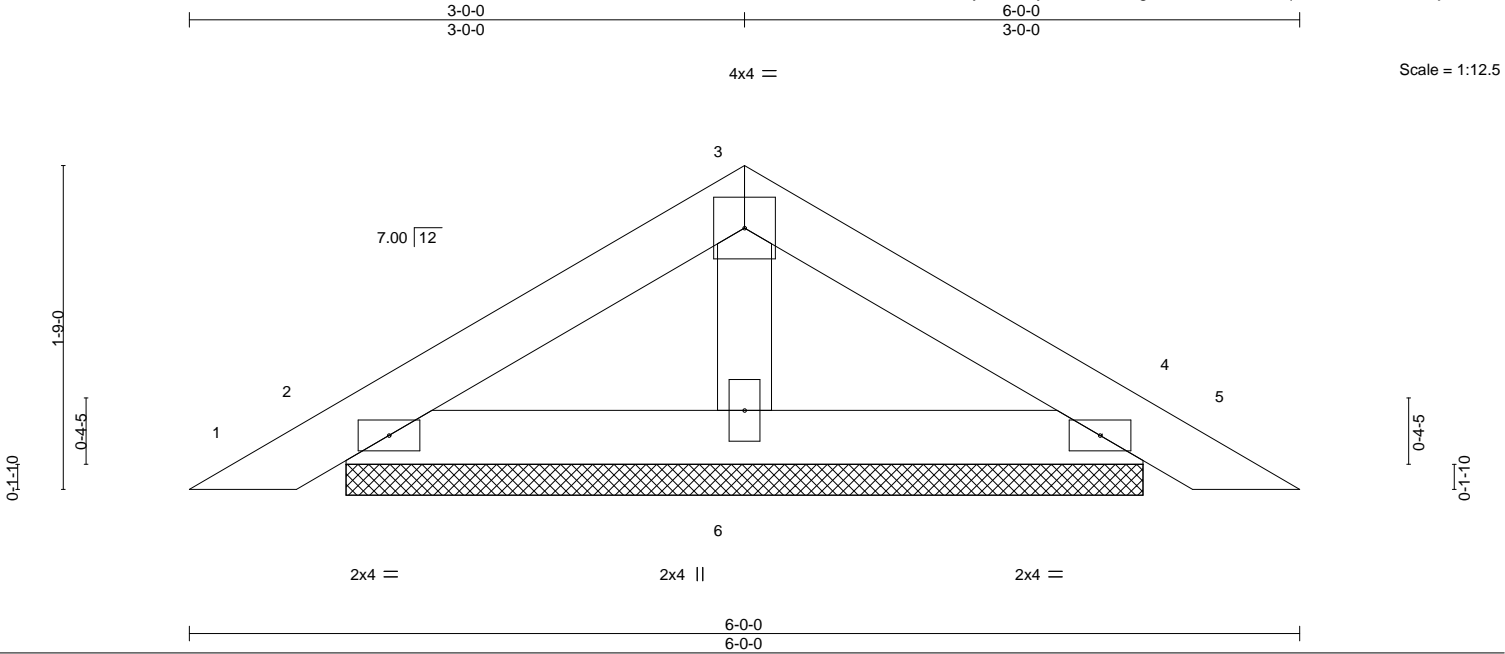

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.07	Vert(LL) 0.00	5	n/r	120		MT20	244/190
Snow (Pf/Pg) 11.6/15.0	Plate Grip DOL 1.15	BC 0.05	Vert(CT) 0.00	5	n/r	120			
TCDL 10.0	Lumber DOL 1.15	WB 0.02	Horz(CT) 0.00	4	n/a	n/a			
BCLL 0.0 *	Rep Stress Incr YES	Matrix-P							
BCDL 10.0	Code IRC2018/TPI2014								
								Weight: 18 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=4-3-11, 4=4-3-11, 6=4-3-11
Max Horz 2=-32(LC 14)
Max Uplift 2=-37(LC 16), 4=-37(LC 16)
Max Grav 2=129(LC 21), 4=129(LC 22), 6=157(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - 6) Gable requires continuous bottom chord bearing.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816293
25-3222-A	SD01	Hip	1	1		

Riverside Roof Truss, LLC,
Danville, Va - 24541,
8.830 s Apr 24 2025 MiTek Industries, Inc.
Thu May 29 06:47:32 2025
Page 1
ID:BxI2MwYau_NHkbraGCmHloyOvst-WyTzZWPJD3vgmEe?1wcWhPN2lqBAd2nQFFOAmrzBjMf

0-11-0
0-11-0

4-5-0
4-5-0

8-10-0
4-5-0


13-6-0
4-8-0

17-11-0
4-5-0

22-4-0
4-5-0

23-3-0
0-11-0

Scale = 1:40.0

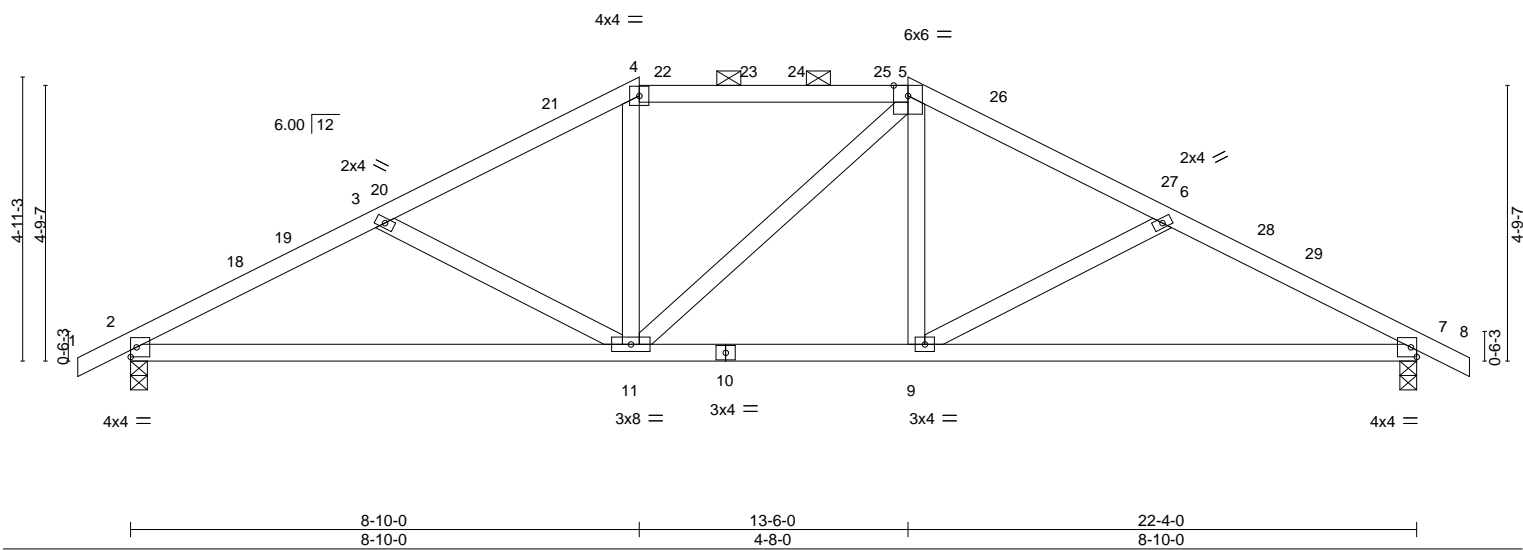

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL (roof)	20.0	2-0-0		TC	0.43	in (loc)	l/defl	L/d	MT20	244/190	
Snow (Pf/Pg)	16.5/15.0	Lumber DOL	1.15	BC	0.68	Vert(LL)	-0.12 9-17	>999			
TCDL	10.0	Rep Stress Incr	YES	WB	0.17	Vert(CT)	-0.25 9-17	>999			
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MS		Horz(CT)	0.04 7	n/a			
BCDL	10.0								Weight: 109 lb	FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-5-14 oc purlins, except
BOT CHORD	2x4 SP No.2		2-0-0 oc purlins (5-2-13 max.): 4-5.
WEBS	2x4 SP No.3	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS.			
(size) 2=0-3-8, 7=0-3-8			
Max Horz 2=-79(LC 14)			
Max Uplift 2=-83(LC 16), 7=-83(LC 16)			
Max Grav 2=1024(LC 39), 7=1024(LC 39)			

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-1605/222, 3-4=-1259/178, 4-5=-1071/191, 5-6=-1259/178, 6-7=-1604/222
BOT CHORD	2-11=-132/1373, 9-11=-39/1071, 7-9=-141/1373
WEBS	3-11=-354/117, 4-11=0/317, 5-9=0/317, 6-9=-355/116

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 8-10-0, Exterior(2R) 8-10-0 to 13-0-15, Interior(1) 13-0-15 to 13-6-0, Exterior(2R) 13-6-0 to 17-8-15, Interior(1) 17-8-15 to 23-3-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=16.5 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 7.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




May 30,2025

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816294
25-3222-A	SD02	Hip	1	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:33 2025 Page 1

ID:Bxl2MwYau_NHkbraGcmHloyOvst_81LmsQx_N1XOODCbd7lEdvAHDVKMTgaTv7jllzBjMe



Scale = 1:40.0

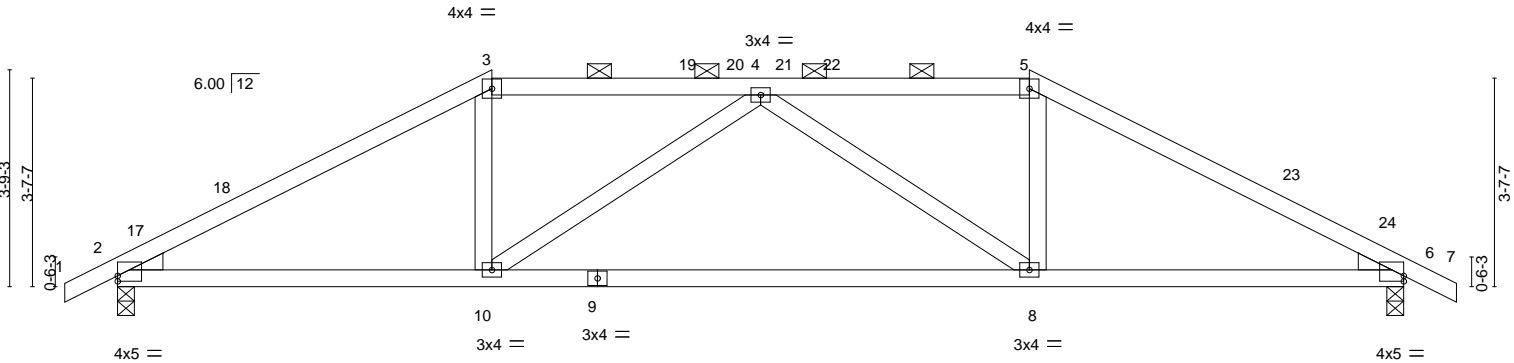


Plate Offsets (X,Y)--	[2:0-0-0,0-1-2], [6:Edge,0-1-2]
-----------------------	---------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.61	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 16.5/15.0	Plate Grip DOL 1.15	BC 0.82	Vert(LL) -0.21 8-10 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.26	Vert(CT) -0.44 8-10 >612 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.05 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 100 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-0-1 oc purlins, except
BOT CHORD 2x4 SP No.2	2-0-0 oc purlins (5-0-7 max.): 3-5.
WEBS 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEDGE	
Left: 2x4 SP No.3, Right: 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 6=0-3-8
Max Horz 2=-60(LC 14)
Max Uplift 2=-83(LC 16), 6=-83(LC 16)
Max Grav 2=948(LC 2), 6=948(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1511/152, 3-4=-1261/177, 4-5=-1261/175, 5-6=-1511/151
BOT CHORD 2-10=-48/1274, 8-10=-119/1495, 6-8=-55/1274
WEBS 3-10=0/406, 4-10=-383/95, 4-8=-383/95, 5-8=0/406

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-6-0, Exterior(2R) 6-6-0 to 10-8-15, Interior(1) 10-8-15 to 15-10-0, Exterior(2R) 15-10-0 to 20-0-15, Interior(1) 20-0-15 to 23-3-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=16.5 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - 6) Provide adequate drainage to prevent water ponding.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job 25-3222-A	Truss SM01G	Truss Type Half Hip Girder	Qty 2	Ply 1	RVF-LOT #35 ROOF	173816295
Job Reference (optional)						

Riverside Roof Truss, LLC,

Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:34 2025 Page 1

ID:BxI2MwYau_NHkbraGcmHloyOvst-SLbj_BRZlg9O?YnO8Le_mqST7d1x5_ejiZtGqkBjMd

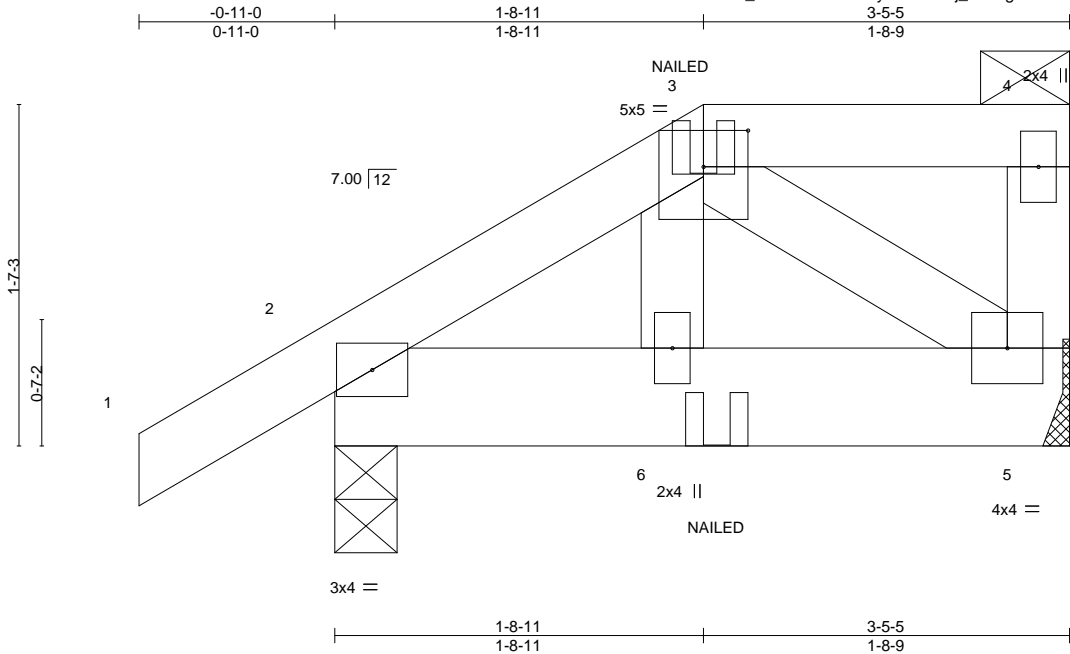


Plate Offsets (X,Y)-- [3:0-2-8,0-2-1]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	in (loc)	l/defl	MT20	GRIP
Snow (Pf/Pg)	16.5/15.0	Lumber DOL	1.15	BC	0.03	Vert(LL)	-0.00 6 >999		244/190
TCDL	10.0	Rep Stress Incr	NO	WB	0.02	Vert(CT)	-0.00 6 >999		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MP		Horz(CT)	0.00 5 n/a		
BCDL	10.0							Weight: 20 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-5 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=Mechanical
 Max Horz 2=49(LC 11)
 Max Uplift 2=-41(LC 12), 5=-22(LC 9)
 Max Grav 2=227(LC 32), 5=137(LC 31)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=16.5 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
- 5) Provide adequate drainage to prevent water ponding.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 12) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 13) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
Vert: 1-3=-43, 3-4=-53, 5-7=-20
- Concentrated Loads (lb)
Vert: 6=-3(B) 3=-5(B)



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816296
25-3222-A	T01	PIGGYBACK BASE	14	1		
Job Reference (optional)						

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:34 2025 Page 1

ID:BxI2MwYau_NHkbraGCmHloyOvst-SLbj_BRZlg9O?YnO8Le_mqSH?dqa5r1jiZtGqkzBjMd

-0-11-0 5-7-0 11-2-0 16-9-0 22-9-0 28-4-0 33-11-0 39-6-0 40-5-0
0-11-0 5-7-0 5-7-0 5-7-0 6-0-0 5-7-0 5-7-0 5-7-0 0-11-0

Scale = 1:71.1

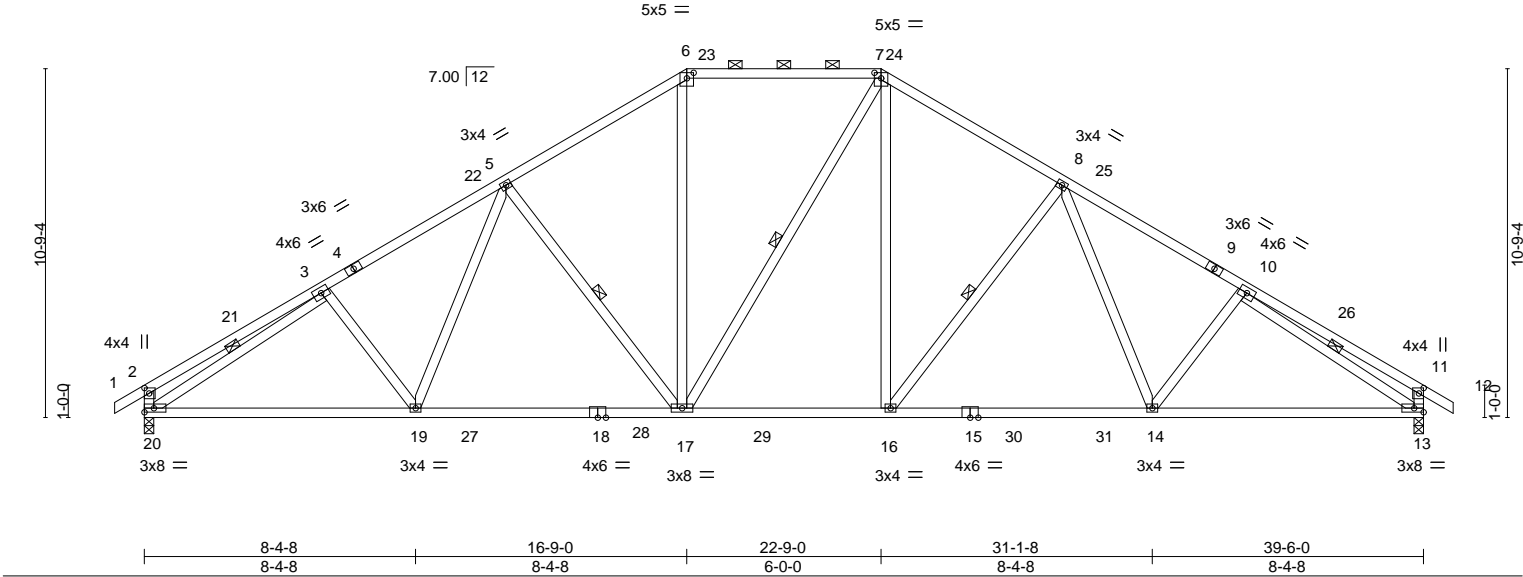


Plate Offsets (X,Y)--		[2:0-2-0,0-1-12], [6:0-2-8,0-2-1], [7:0-2-8,0-2-1], [11:0-2-0,0-1-12]							
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL (roof)	20.0	2-0-0		TC 0.86		in (loc) l/defl L/d		MT20	
Snow (Pf/Pg)	16.5/15.0	Plate Grip DOL 1.15		BC 0.88		Vert(LL) -0.23 14-16 >999 240		GRIP	
TCDL	10.0	Lumber DOL 1.15		WB 0.64		Vert(CT) -0.39 14-16 >999 180		244/190	
BCLL	0.0 *	Rep Stress Incr YES		Matrix-MS		Horz(CT) 0.12 13 n/a n/a		Weight: 259 lb	
BCDL	10.0	Code IRC2018/TPI2014						FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-3-13 oc purlins, except end verticals, and 2-0-0 oc purlins (2-10-4 max.): 6-7.
BOT CHORD	2x4 SP No.1 *Except* 15-18: 2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 5-17, 7-17, 8-16, 3-20, 10-13

REACTIONS.	
(size)	20=0-3-8, 13=0-3-8
Max Horz	20=-232(LC 14)
Max Uplift	20=-128(LC 16), 13=-128(LC 16)
Max Grav	20=1863(LC 28), 13=1866(LC 29)

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-525/102, 3-5=-2605/210, 5-6=-2062/241, 6-7=-1690/236, 7-8=-2068/241, 8-10=-2611/210, 10-11=-525/102, 2-20=-452/120, 11-13=-452/120
BOT CHORD	19-20=-57/2321, 17-19=-21/2174, 16-17=0/1732, 14-16=0/2038, 13-14=-57/2152
WEBS	5-19=0/405, 5-17=-650/131, 6-17=-22/766, 7-16=-22/830, 8-16=-651/131, 8-14=0/405, 3-20=-2248/88, 10-13=-2254/88

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=40ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 3-0-6, Interior(1) 3-0-6 to 16-9-0, Exterior(2R) 16-9-0 to 22-4-1, Interior(1) 22-4-1 to 22-9-0, Exterior(2R) 22-9-0 to 28-4-0, Interior(1) 28-4-0 to 40-5-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=16.5 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - 6) Provide adequate drainage to prevent water ponding.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=128, 13=128.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816297
25-3222-A	T01GE	PIGGYBACK BASE SUPPO	1	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:36 2025 Page 1

ID:Bxl2MwYau_NHkbraGCmHloyOvst-PjiUPtSpGHP6FrXnGmgSrFxnCRiNZrN09tMNVczBjMb

0-11-0 16-9-0 22-9-0 39-6-0 40-5-0

0-11-0 16-9-0 6-0-0 16-9-0 0-11-0

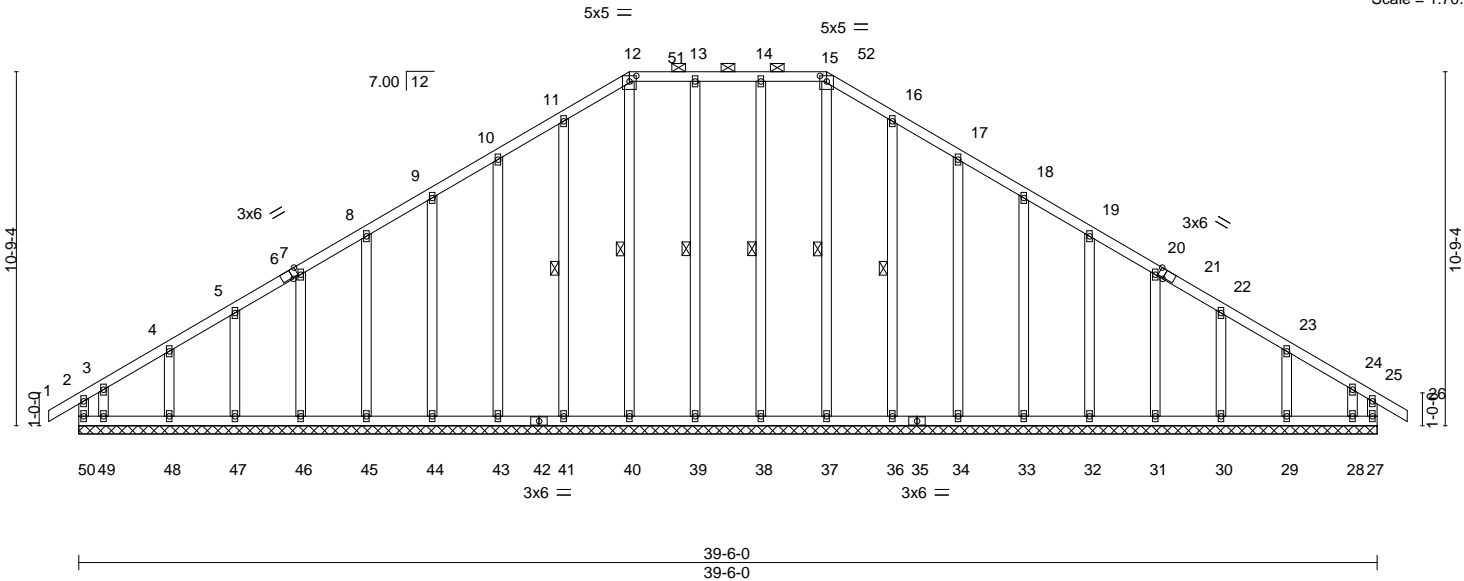


Plate Offsets (X, Y)-- [6:0-2-3,Edge], [12:0-2-8,0-2-1], [15:0-2-8,0-2-1], [21:0-2-3,Edge]									
LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	-0.00	26	n/r	120
Snow (Pf/Pg)	16.5/15.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	-0.00	26	n/r	120
TCDL	10.0	Rep Stress Incr	YES	WB 0.20	Horz(CT)	0.01	27	n/a	n/a
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-R					
BCDL	10.0								
									GRIP
									244/190
									Weight: 310 lb FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 12-15.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 15-37, 14-38, 13-39, 12-40, 11-41, 16-36
OTHERS	2x4 SP No.3		

REACTIONS. All bearings 39-6-0.
(lb) - Max Horz 50=-232(LC 14)
Max Uplift All uplift 100 lb or less at joint(s) 38, 39, 41, 43, 44, 45, 46, 47, 48, 36, 34, 33, 32, 31, 30, 29 except 50=-215(LC 14), 27=-104(LC 15), 49=-154(LC 15), 28=-106(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 27, 37, 38, 39, 40, 41, 43, 44, 45, 46, 47, 48, 36, 34, 33, 32, 31, 30, 29, 28 except 50=271(LC 29), 49=259(LC 14)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 10-11=-149/258, 11-12=-177/303, 12-13=-155/278, 13-14=-155/278, 14-15=-155/278, 15-16=-177/303, 16-17=-149/258

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=40ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Corner(3E) -0-11-0 to 2-9-0, Exterior(2N) 2-9-0 to 16-9-0, Corner(3R) 16-9-0 to 20-9-0, Exterior(2N) 20-9-0 to 22-9-0, Corner(3R) 22-9-0 to 26-9-0, Exterior(2N) 26-9-0 to 40-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=16.5 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 38, 39, 41, 43, 40, 39, 40, 38, 39, 41, 43, 36, 34, 33, 32, 31, 30, 29 except (it=lb) 50=215, 27=104, 49=154, 28=106.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816297
25-3222-A	T01GE	PIGGYBACK BASE SUPPO	1	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:36 2025 Page 2
ID:Bxl2MwYau_NHkbraGCmHloyOvst-PjiUPtSpGHP6FrXnGmgSrFXnCRiNZrN09tMNVczBjMb

- NOTES-**
- 15) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 16) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 30,2025


Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816298
25-3222-A	T01S	PIGGYBACK BASE	8	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541, 8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:37 2025 Page 1

ID:BxI2MwYau_NHkbraGCMHloyOvst-tvGscDTR1bXzs?WzqTBhOT4nxrrHI8O9OX5xR3zBjMa

-0-11-0 6-4-8 12-9-0 16-9-0 22-9-0 28-4-0 33-11-0 39-6-0 40-5-0
0-11-0 6-4-8 6-4-8 4-0-0 6-0-0 5-7-0 5-7-0 5-7-0 0-11-0

Scale = 1:72.4

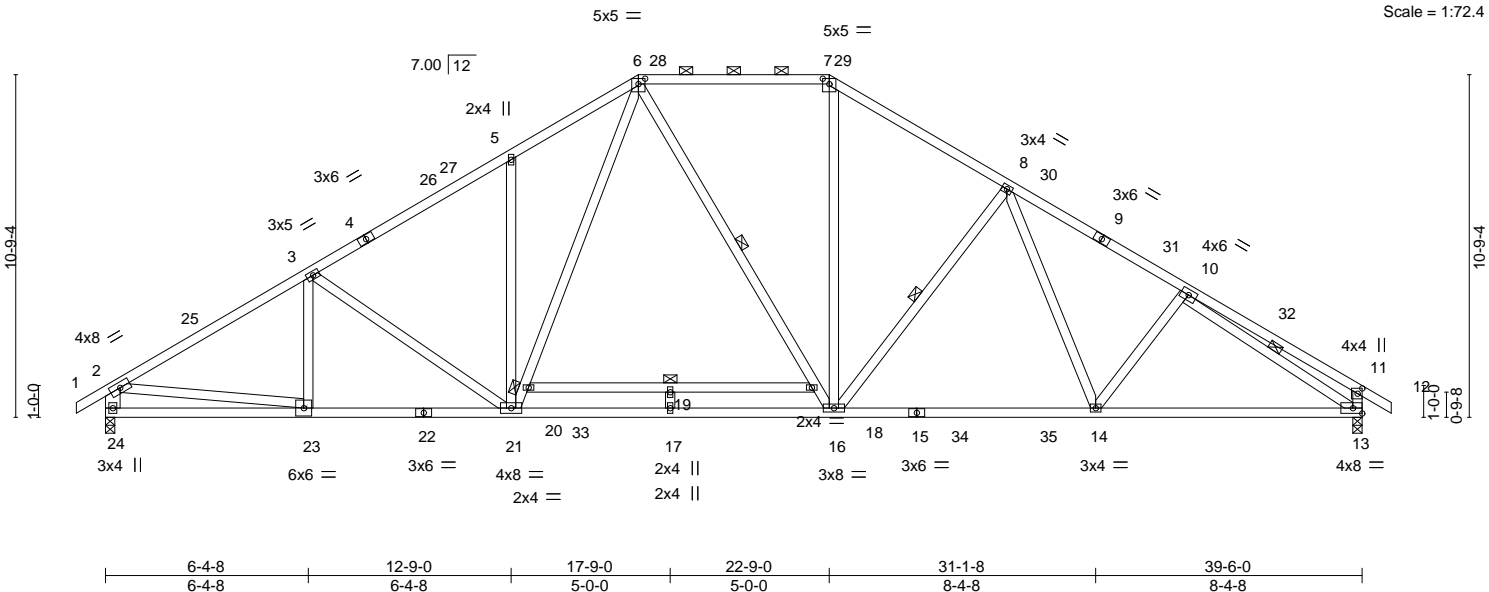

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF
25-3222-A	T01SGE	GABLE Gable Gable COMMON Gable	1	1	I73816299
Job Reference (optional)					

- NOTES-**
- 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 30,2025

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816300
25-3222-A	T02	COMMON	2	1	Job Reference (optional)	


Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:39 2025 Page 1

ID:BxI2MwYau_NHkbraGCmHloyOvst-plOc1vUiZCog6JgLxuE9Tu9EFeazm1mSsra1VxzBjMY

0-11-0 5-10-12 11-6-0 17-1-4 23-0-0 23-11-0
0-11-0 5-10-12 5-7-4 5-7-4 5-10-12 0-11-0

Scale: 1/4"=1'

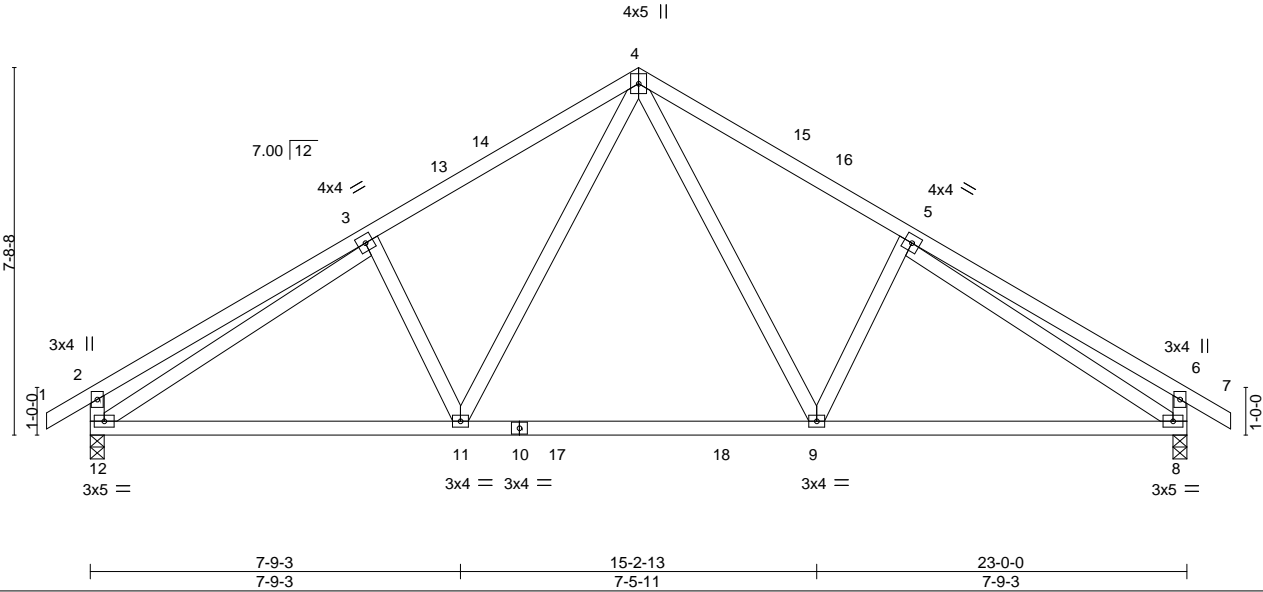

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.45	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 11.6/15.0	Plate Grip DOL 1.15	BC 0.67	Vert(LL) -0.11 9-11 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.92	Vert(CT) -0.17 8-9 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.04 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 135 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 12=0-3-8, 8=0-3-8
Max Horz 12=170(LC 15)
Max Uplift 12=-88(LC 16), 8=-88(LC 16)
Max Grav 12=1075(LC 28), 8=1075(LC 29)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-420/112, 3-4=-1253/179, 4-5=-1253/179, 5-6=-419/112, 2-12=-393/122, 6-8=-393/122
BOT CHORD 11-12=-55/1182, 9-11=0/831, 8-9=-44/1080
WEBS 4-9=-42/562, 4-11=-42/562, 3-12=-1011/46, 5-8=-1010/46

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 11-6-0, Exterior(2R) 11-6-0 to 14-6-0, Interior(1) 14-6-0 to 23-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816301
25-3222-A	T02GE	COMMON SUPPORTED GAB	1	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:40 2025 Page 1

ID:Bxl2MwYau_NHkbraGCmHloyOvst-HUy_EFVKWwXjTFYVbIO05iUm24DVhUb4VKb2OzBjMX

-0-11-0

0-11-0

11-6-0

11-6-0

23-0-0


11-6-0

23-11-0

0-11-0

4x4 =

Scale = 1:49.8

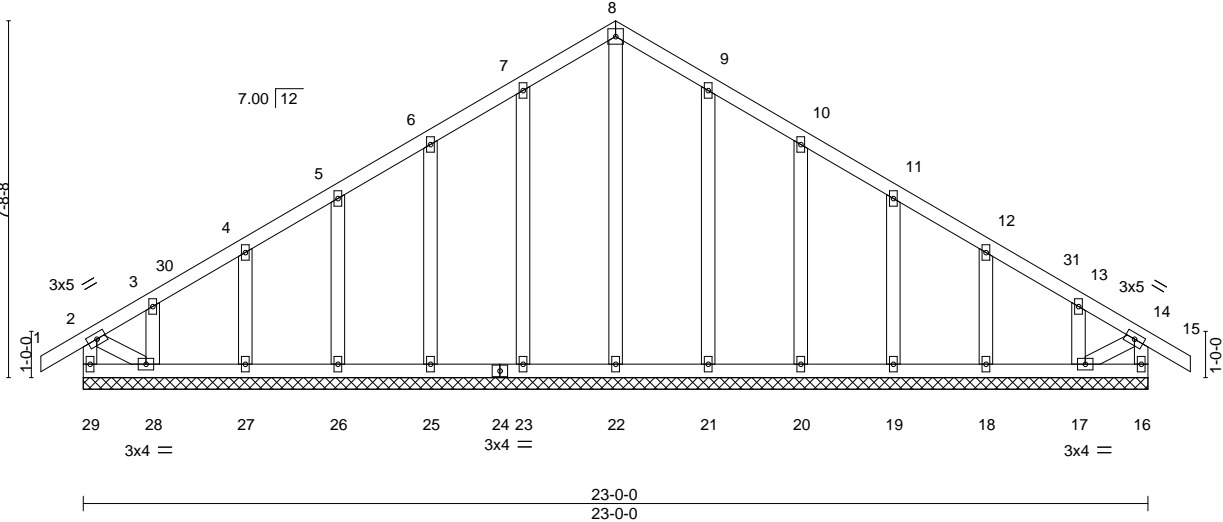

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES	GRIP
TCLL (roof)	20.0	2-0-0		TC	0.08	in	(loc)	l/defl	L/d	MT20	244/190
Snow (Pf/Pg)	11.6/15.0	Plate Grip DOL	1.15	BC	0.03	Vert(LL)	-0.00	15	n/r		
TCDL	10.0	Lumber DOL	1.15	WB	0.13	Vert(CT)	-0.00	15	n/r		
BCLL	0.0 *	Rep Stress Incr	YES	Matrix-S		Horz(CT)	0.00	16	n/a		
BCDL	10.0	Code IRC2018/TPI2014								Weight: 148 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 28-29,16-17.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS. All bearings 23-0-0.
(lb) - Max Horz 29=170(LC 14)
Max Uplift All uplift 100 lb or less at joint(s) 29, 23, 25, 26, 27, 28, 21, 20, 19, 18, 17
Max Grav All reactions 250 lb or less at joint(s) 29, 16, 22, 23, 25, 26, 27, 28, 21, 20, 19, 18, 17

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.



- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Corner(3E) -0-11-0 to 2-1-0, Exterior(2N) 2-1-0 to 11-6-0, Corner(3R) 11-6-0 to 14-6-0, Exterior(2N) 14-6-0 to 23-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 29, 23, 25, 26, 27, 28, 21, 20, 19, 18, 17.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816302
25-3222-A	T03	Common	1	1	Job Reference (optional)	

Riverside Roof Truss, LLC, Danville, Va - 24541, 8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:41 2025 Page 1
ID:BxI2MwYau_NHkbraGcmHloyOvst-lhWNSbWy5q2OLdqk3JGdYJFZ2SGOE6rI938aqzBjMW

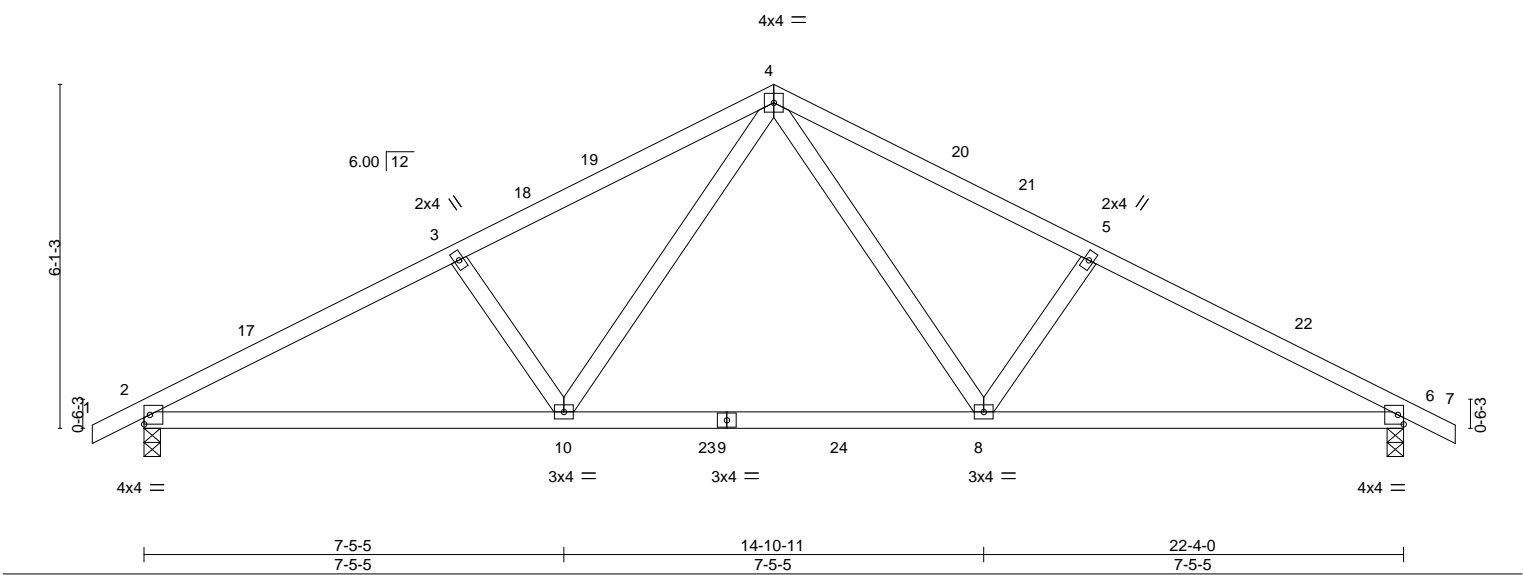

LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.49	Vert(LL)	-0.13 8-10	>999	240	MT20	244/190
Snow (Pf/Pg)	11.6/15.0	Lumber DOL	1.15	BC	0.68	Vert(CT)	-0.23 8-10	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.25	Horz(CT)	0.04 6	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MS						Weight: 103 lb	FT = 20%
BCDL	10.0										

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-6-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS.	(size) 2=0-3-8, 6=0-3-8
	Max Horz 2=100(LC 15)
	Max Uplift 2=83(LC 16), 6=83(LC 16)
	Max Grav 2=1027(LC 28), 6=1027(LC 29)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1626/234, 3-4=-1477/247, 4-5=-1477/247, 5-6=-1626/234
BOT CHORD	2-10=-130/1466, 8-10=-21/967, 6-8=-137/1403
WEBS	4-8=-52/625, 5-8=-320/161, 4-10=-52/625, 3-10=-320/161

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 11-2-0, Exterior(2R) 11-2-0 to 14-2-0, Interior(1) 14-2-0 to 23-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
 - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.




May 30,2025

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816303
25-3222-A	T04	Common	5	1	Job Reference (optional)	


Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:41 2025 Page 1

ID:Bx12MwYau_NHkbraGCmHloyOvst-IhWNSbWy5q2OLdqk3JGdYJFZbSirE83J938aqzBjMW



Scale = 1:22.2

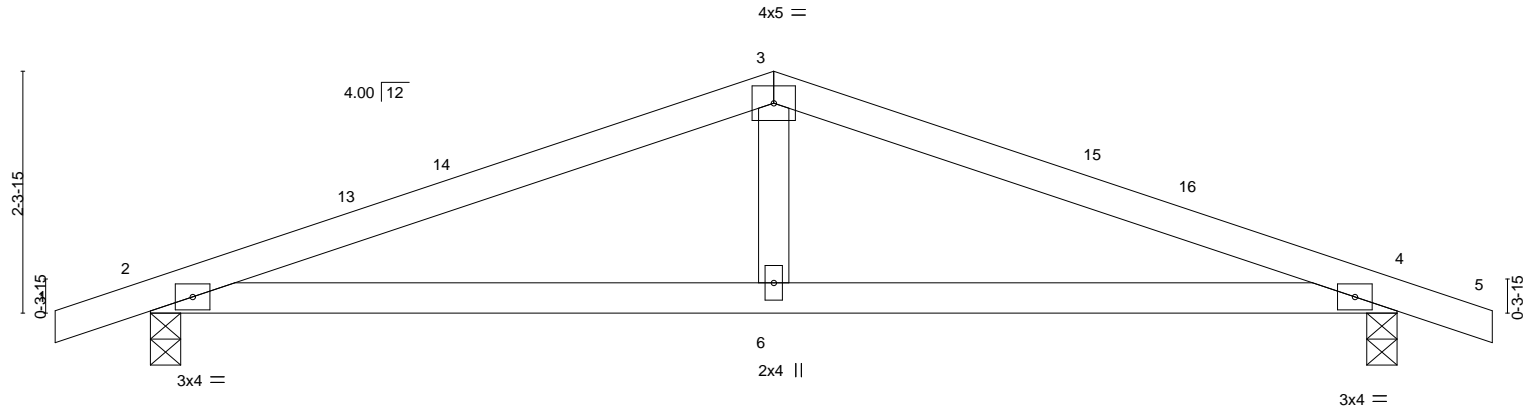

6-0-0		12-0-0	
6-0-0		6-0-0	
LOADING (psf)		SPACING-	2-0-0
TCLL (roof)	20.0	Plate Grip DOL	1.15
Snow (Pf/Pg)	11.6/15.0	Lumber DOL	1.15
TCDL	10.0	Rep Stress Incr	YES
BCLL	0.0 *	Code IRC2018/TPI2014	
BCDL	10.0		
		CSI.	
		TC	0.46
		BC	0.52
		WB	0.11
		Matrix-MS	
		DEFL.	
		in (loc)	l/defl L/d
		Vert(LL)	-0.05 6-12 >999 240
		Vert(CT)	-0.10 6-12 >999 180
		Horz(CT)	0.01 4 n/a n/a
		PLATES	GRIP
		MT20	244/190
		Weight: 42 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-5-14 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 4=0-3-8
Max Horz 2=24(LC 15)
Max Uplift 2=-58(LC 16), 4=-58(LC 16)
Max Grav 2=535(LC 2), 4=535(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-892/294, 3-4=-892/294
BOT CHORD 2-6=-198/813, 4-6=-198/813
WEBS 3-6=0/277

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-0-0, Exterior(2R) 6-0-0 to 9-0-0, Interior(1) 9-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	RVF-LOT #35 ROOF	173816304
25-3222-A	T04GE	GABLE	1	1	Job Reference (optional)	


Riverside Roof Truss, LLC, Danville, Va - 24541,

8.830 s Apr 24 2025 MiTek Industries, Inc. Thu May 29 06:47:42 2025 Page 1

ID:BxI2MwYau_NHkbraGCmHloyOvst-Dt4IfwXas7AFzmPwc0ns5WnrscmjzcGuYpph6GzBjMV



Scale = 1:22.2

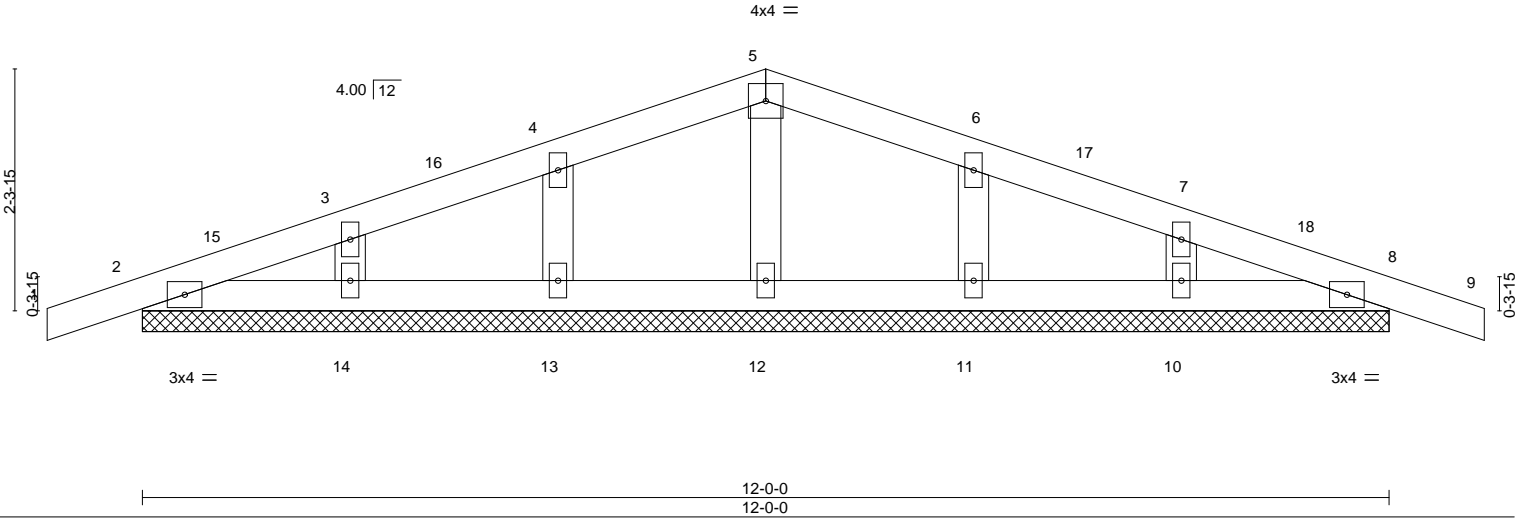

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES	GRIP
TCLL (roof)	20.0	2-0-0		TC	0.06	in	(loc)	l/defl	L/d	MT20	244/190
Snow (Pf/Pg)	11.6/15.0	Plate Grip DOL	1.15	BC	0.03	Vert(LL)	-0.00	8	n/r		
TCDL	10.0	Lumber DOL	1.15	WB	0.04	Vert(CT)	-0.00	9	n/r		
BCLL	0.0 *	Rep Stress Incr	YES	Matrix-S		Horz(CT)	0.00	8	n/a		
BCDL	10.0	Code IRC2018/TPI2014								Weight: 47 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 12-0-0.
(lb) - Max Horz 2=24(LC 14)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Corner(3E) -0-11-0 to 2-0-0, Exterior(2N) 2-0-0 to 6-0-0, Corner(3R) 6-0-0 to 9-0-0, Exterior(2N) 9-0-0 to 12-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pf=11.6 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs non-concurrent with other live loads.
- 7) All plates are 2x4 MT20 unless otherwise indicated.
- 8) Gable requires continuous bottom chord bearing.
- 9) Gable studs spaced at 2-0-0 oc.
- 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.
- 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 30,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MITEK Affiliate

818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

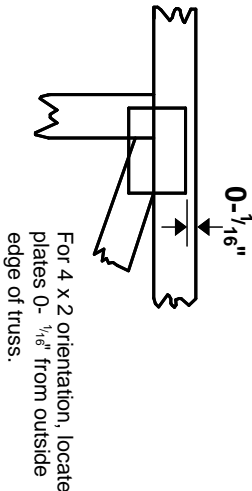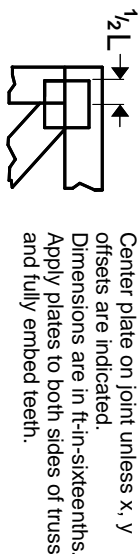

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

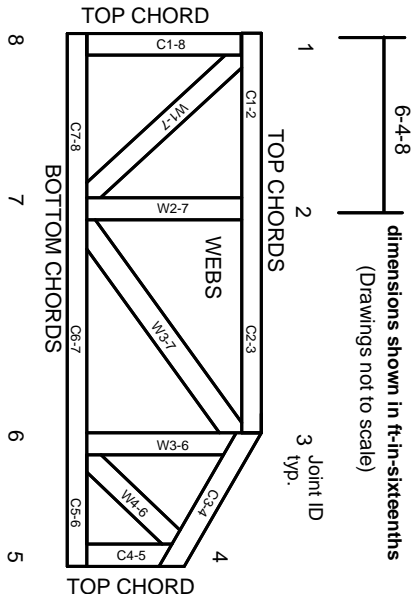

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023