




THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO MEET THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.

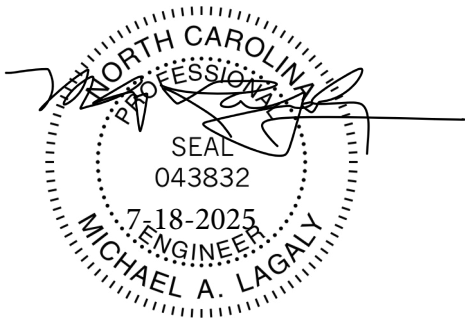

VA LANDSCAPE PACKAGE

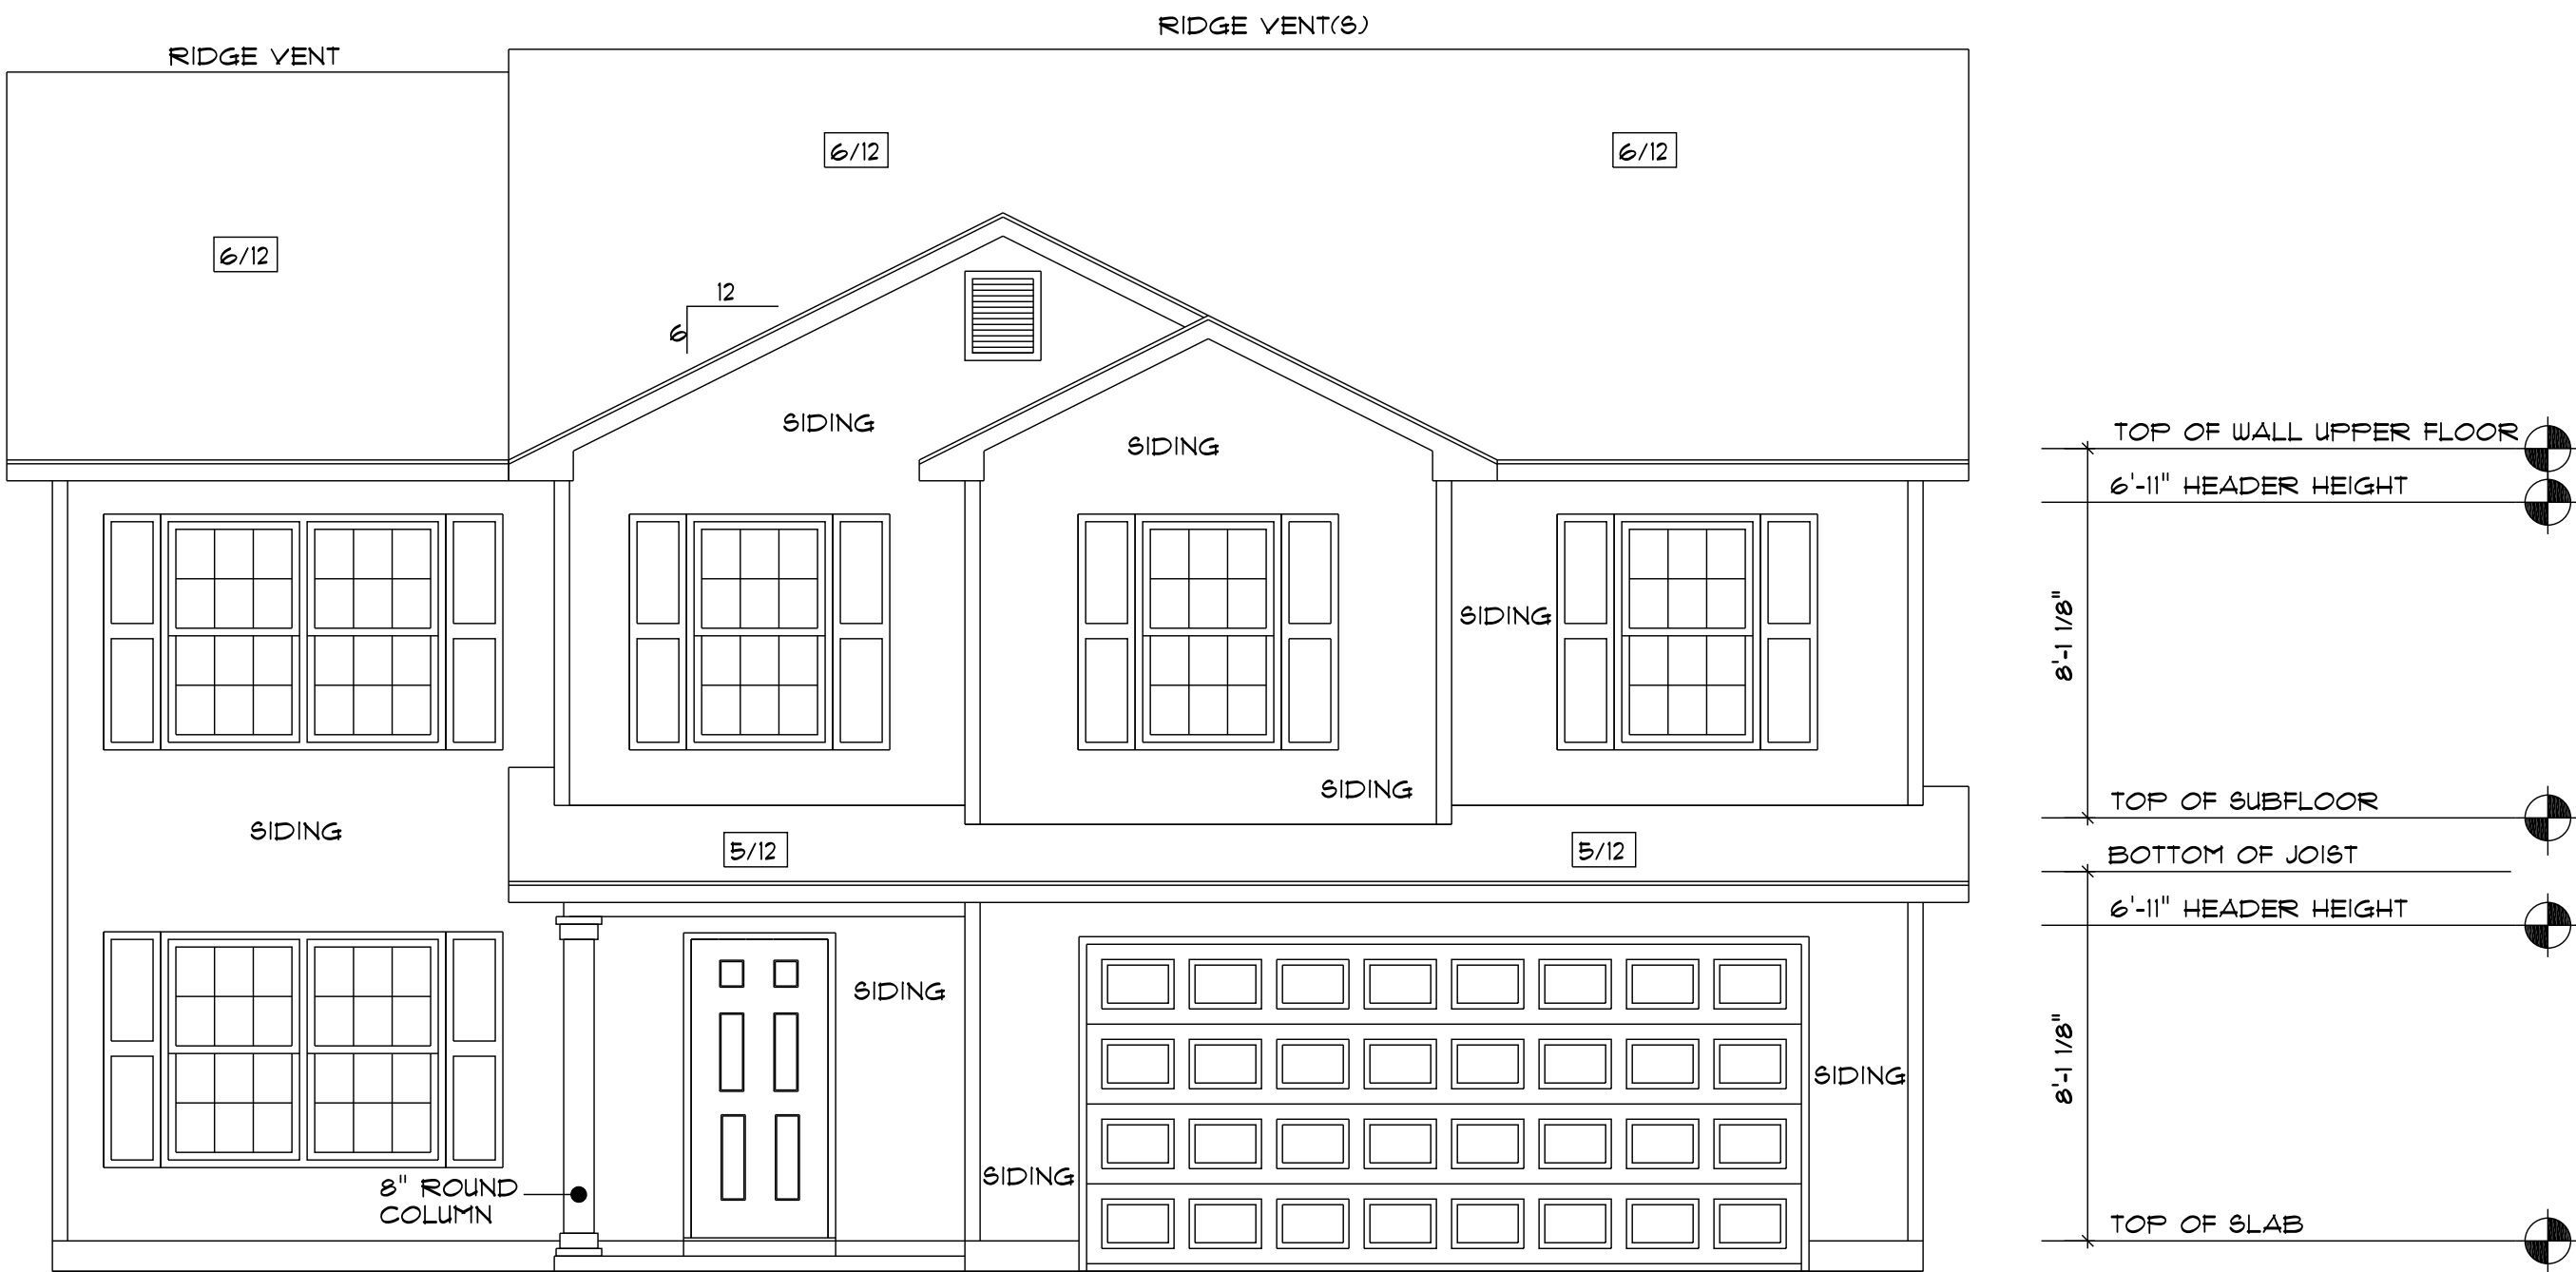

FRONT ELEVATION
SCALE: 1/8" = 1'-0"

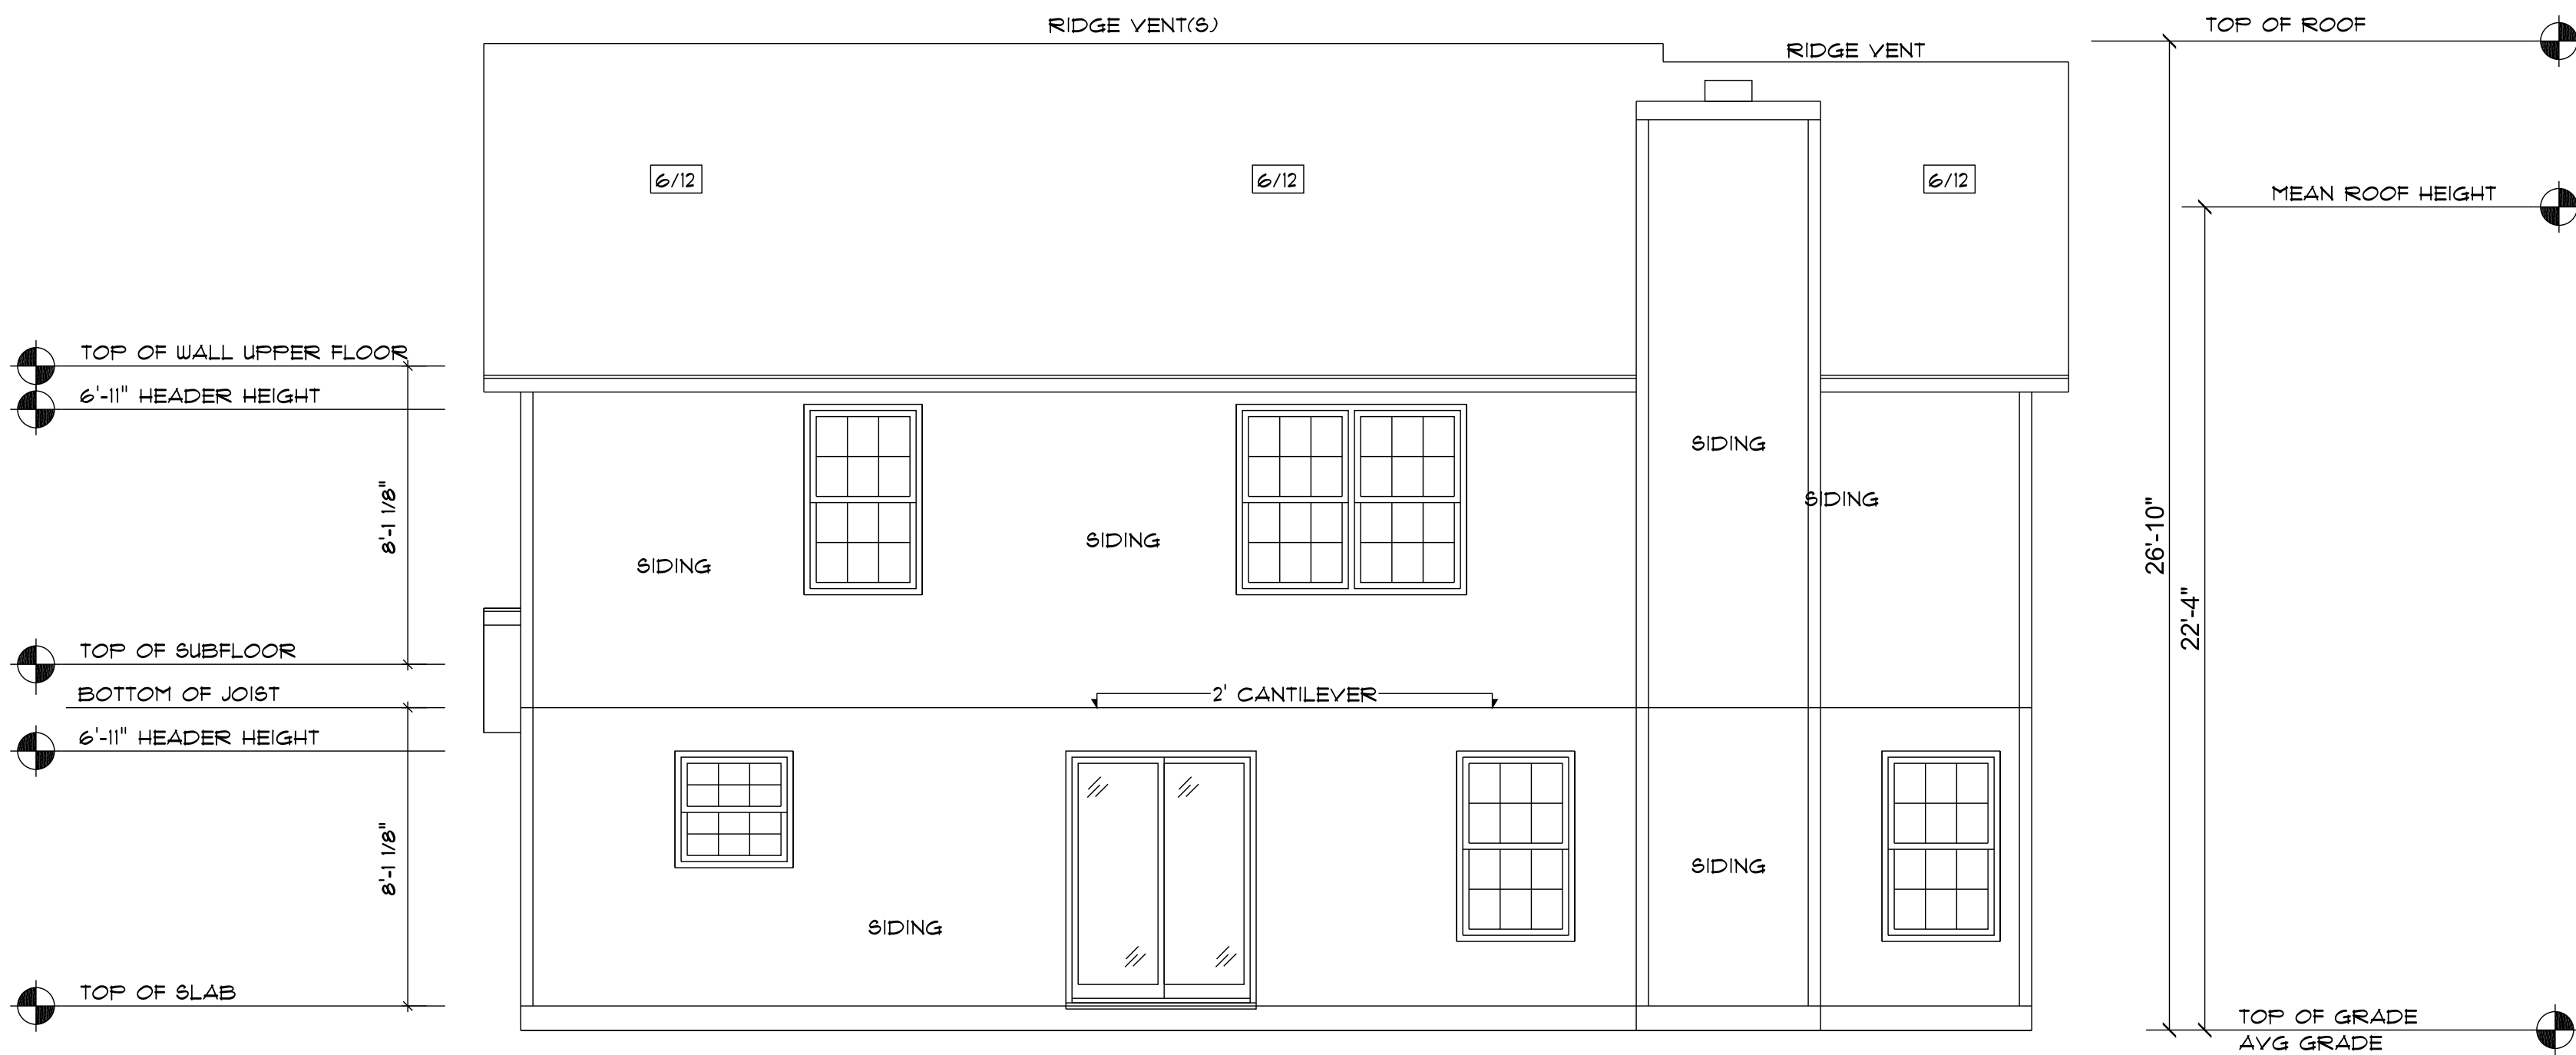

REAR ELEVATION
SCALE: 1/8" = 1'-0"

GENERAL NOTES

- 1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.
- 4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
- 5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.
- 6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.
- 7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.
- 8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.
- 9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.
- 10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.
- 11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.
- 12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC

SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1341
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2121

JOB NUMBER & CLIENT NAME:

XXXXXXXXXX

ELEVATION:

CLASSIC

TOWN/CITY:

XXXXXXXXXX

COUNTY:

XXXXXXXXXX

AUTHORED DATE:

2022


DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH
PERM: 04/14/2025 BES
FINAL:


Front & Rear Elevations

WESTOVER

PERMANENT
109-24-109 HENDERSON

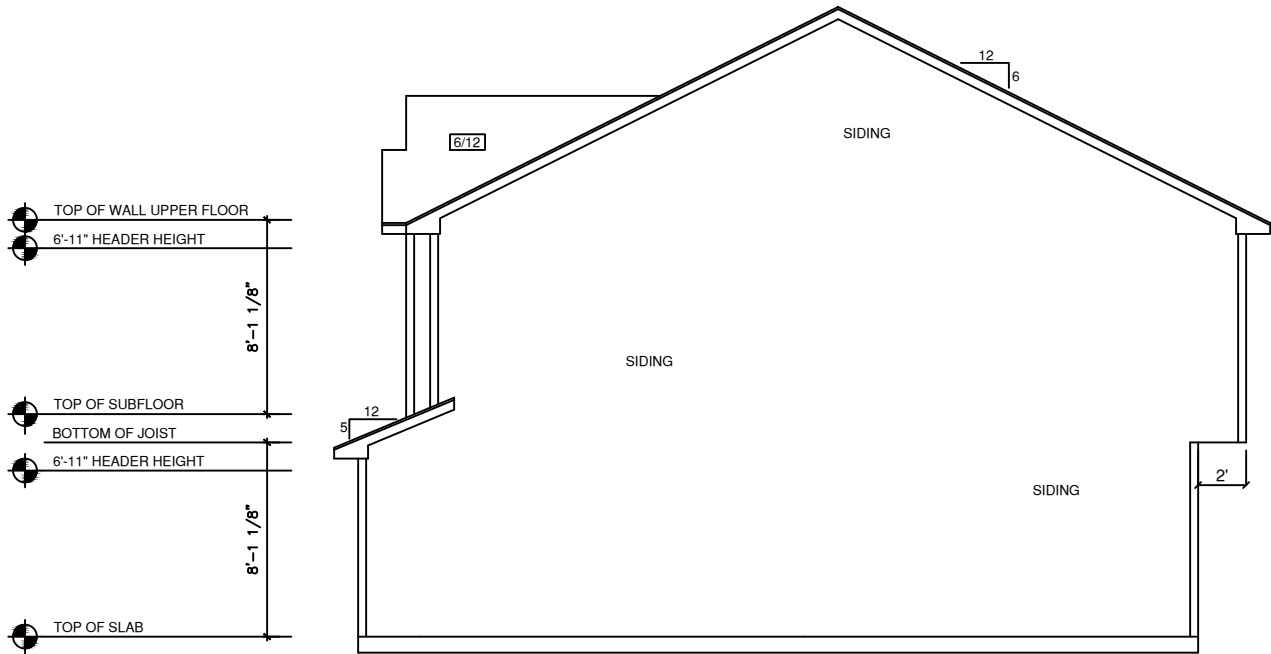

RIGHT ELEVATION
SCALE: 1/8" = 1'-0"

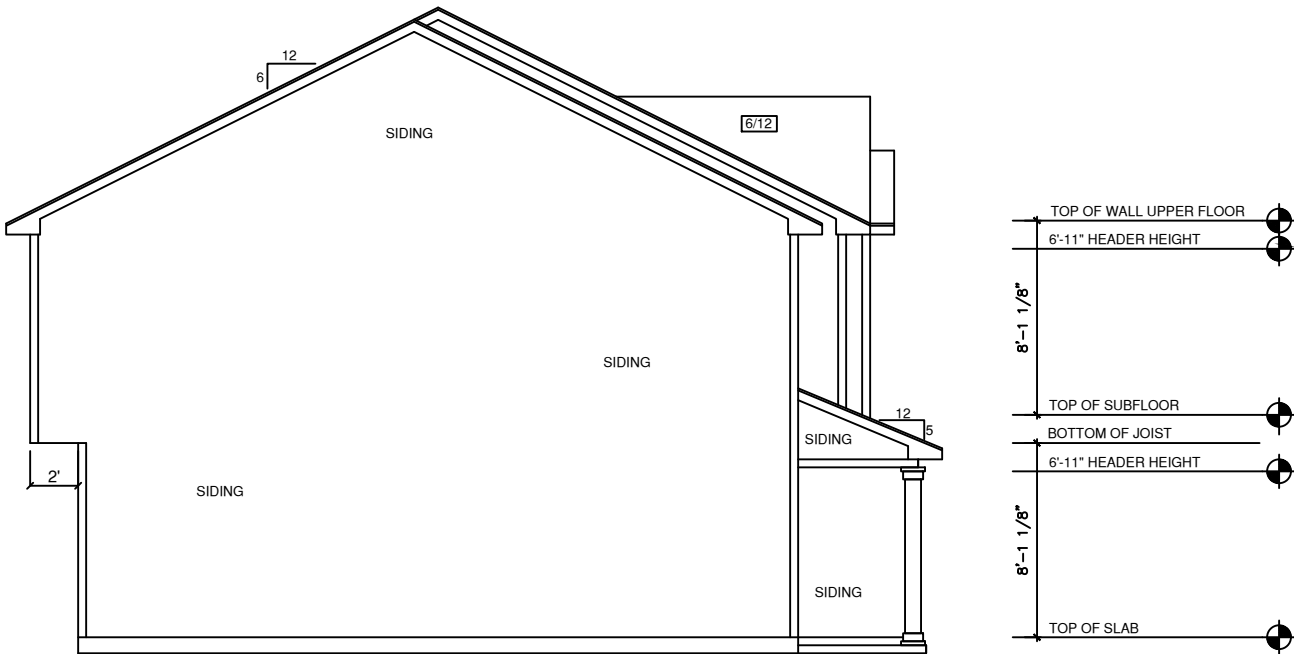

LEFT ELEVATION
SCALE: 1/8" = 1'-0"

GENERAL NOTES

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE, HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC

RED DOOR

homes

RedDoorHomesCarolinas.com

SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727

JOB NUMBER & CLIENT NAME:

XXXXXXXXXX

ELEVATION:

CLASSIC

TOWN/CITY:

XXXXXXXXXX

COUNTY:

XXXXXXXXXX

AUTHORED DATE:

2022

DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH



PERM: 04/14/2025 BES*

FINAL:

Right & Left Elevations

WESTOVER

PERMANENT
109-24-109 HENDERSON

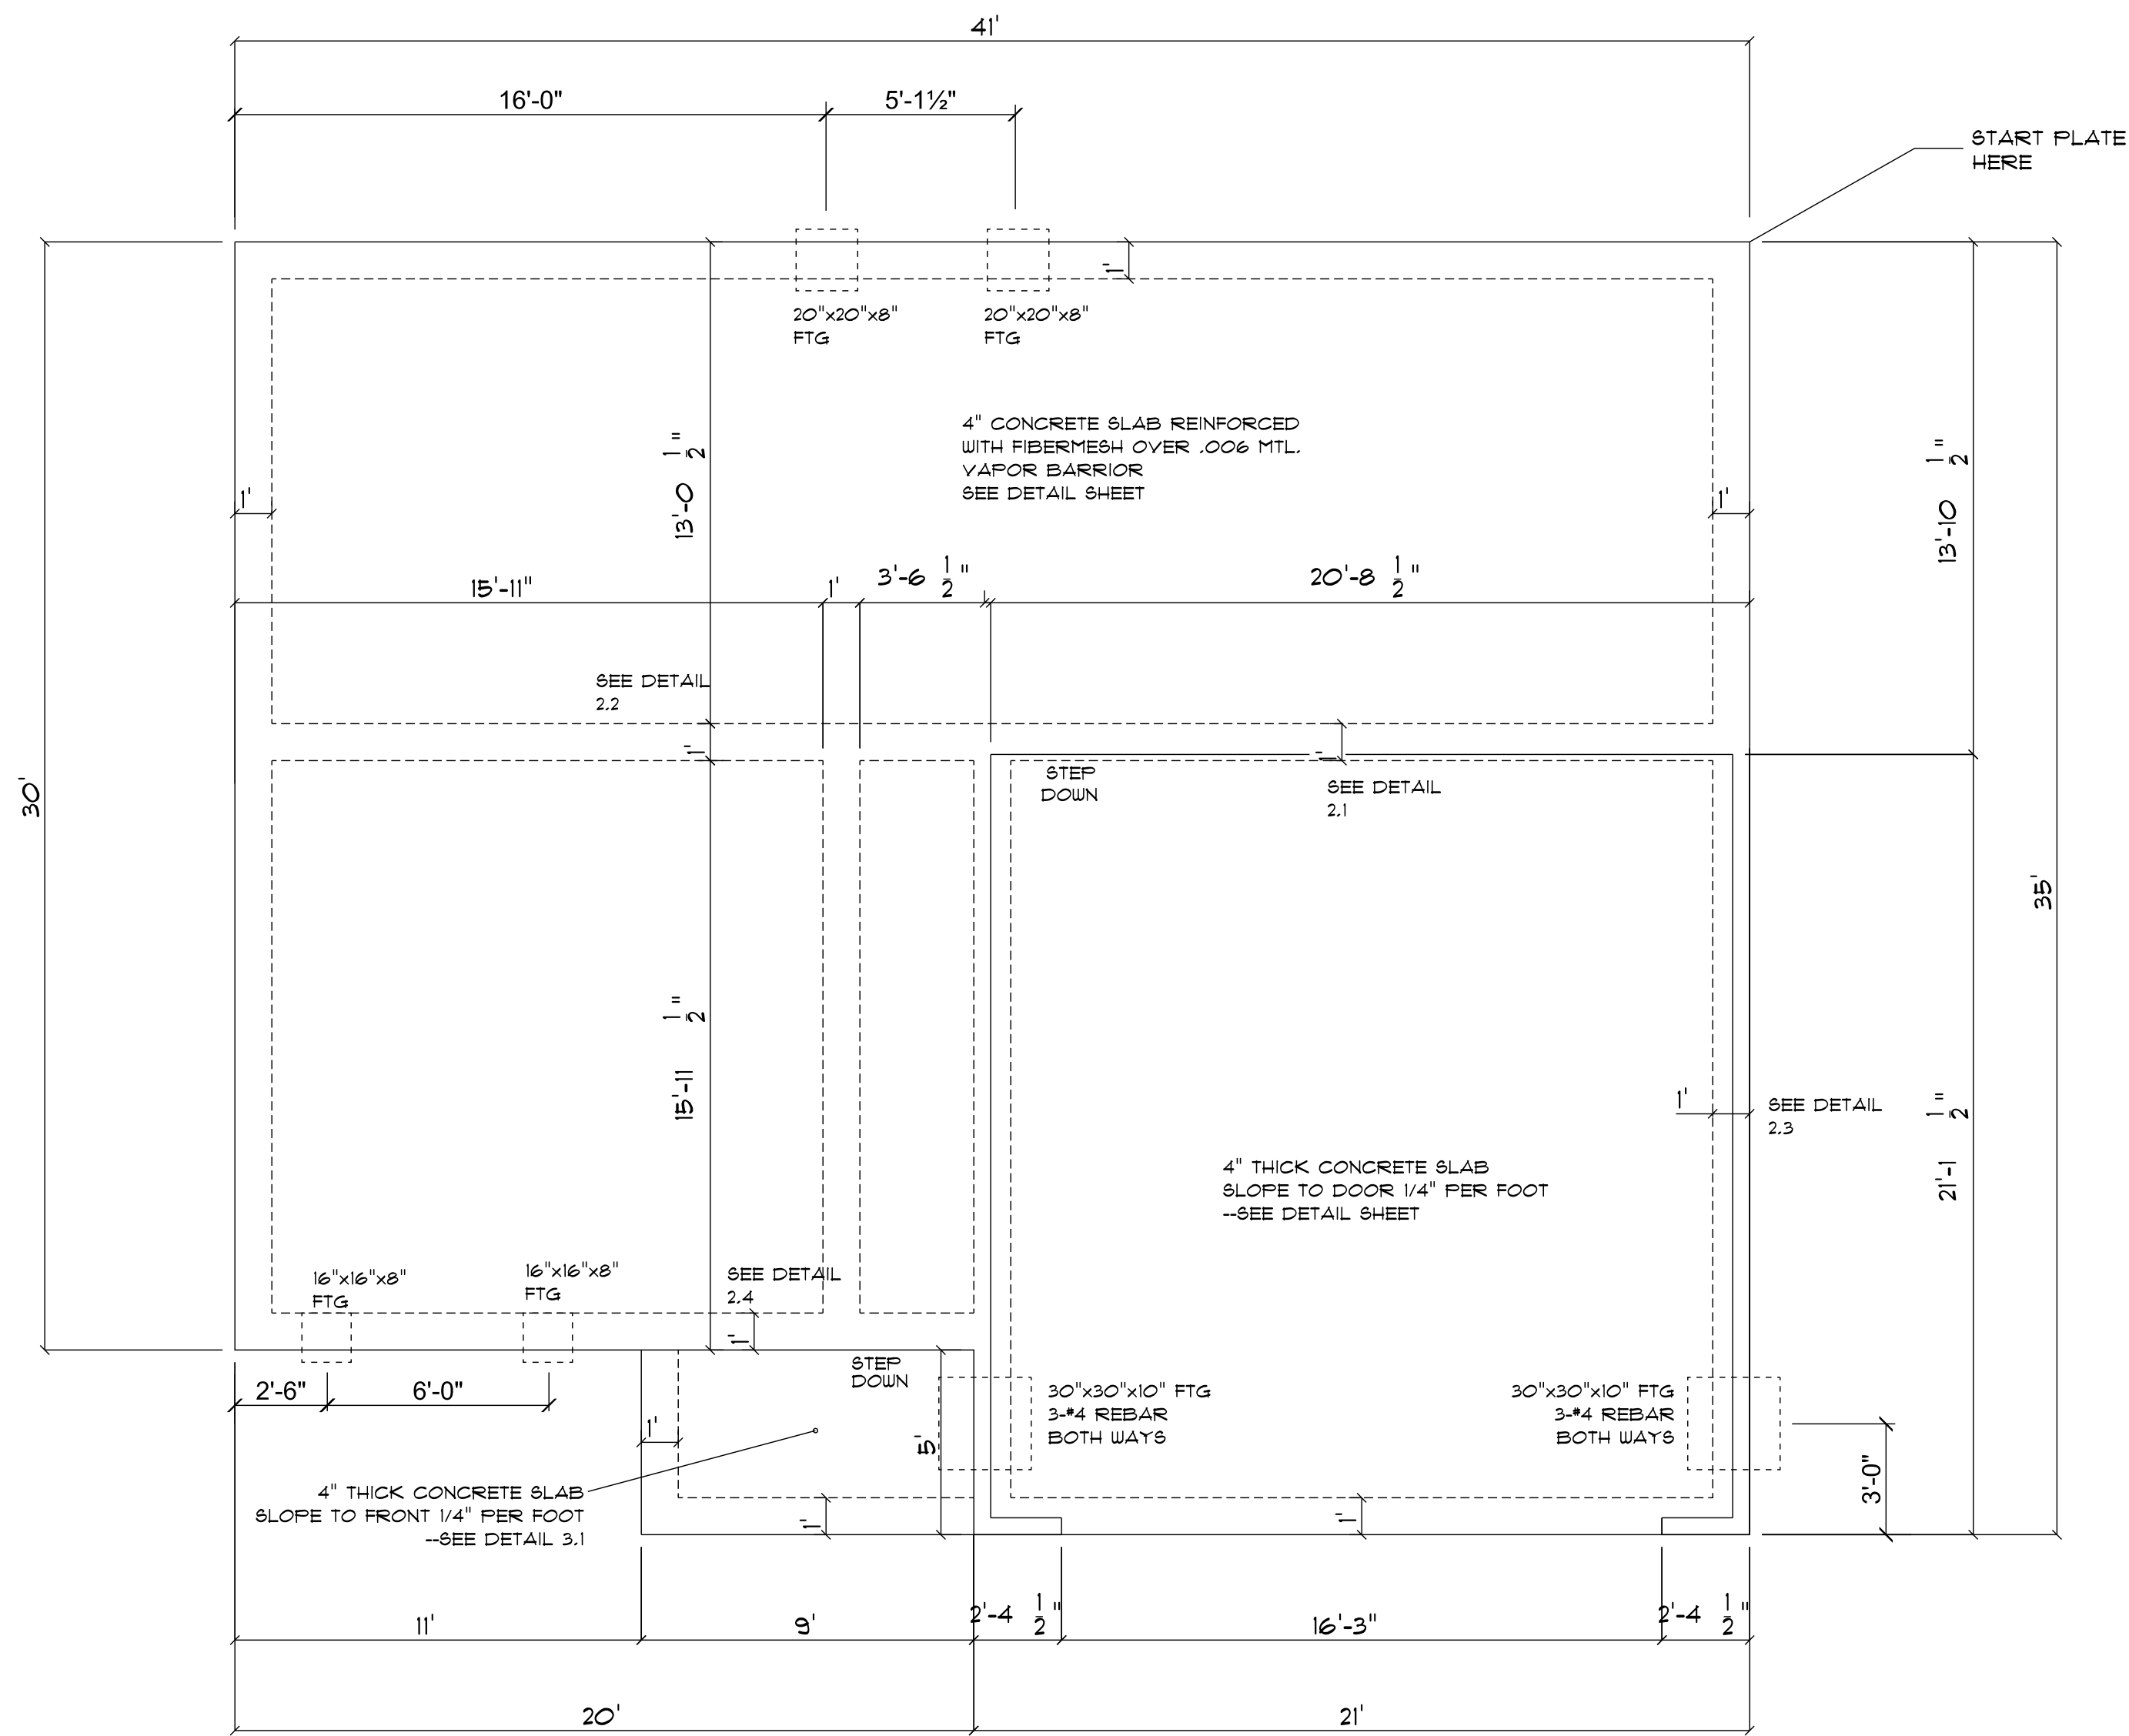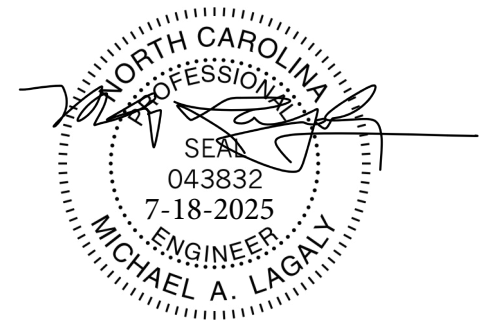

MONOLITHIC FOUNDATION PLAN
SCALE 1/8" = 1'-0"

GENERAL NOTES

- 1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3/2" UNLESS NOTED OTHERWISE.
- 4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
- 5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.
- 6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.
- 7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.
- 8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.
- 9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.
- 10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.
- 11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.
- 12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC

SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1341
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2721

JOB NUMBER & CLIENT NAME:
XXXXXXXXXXXX

ELEVATION:
CLASSIC

TOWN/CITY:
XXXXXXXXXXXX

COUNTY:
XXXXXXXXXXXX

AUTHORED DATE:
2022


DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH
PERM: 04/14/2025 BEB
FINAL:

Monolithic Foundation Plan

WESTOVER

PERMANENT
109-24-109 HENDERSON

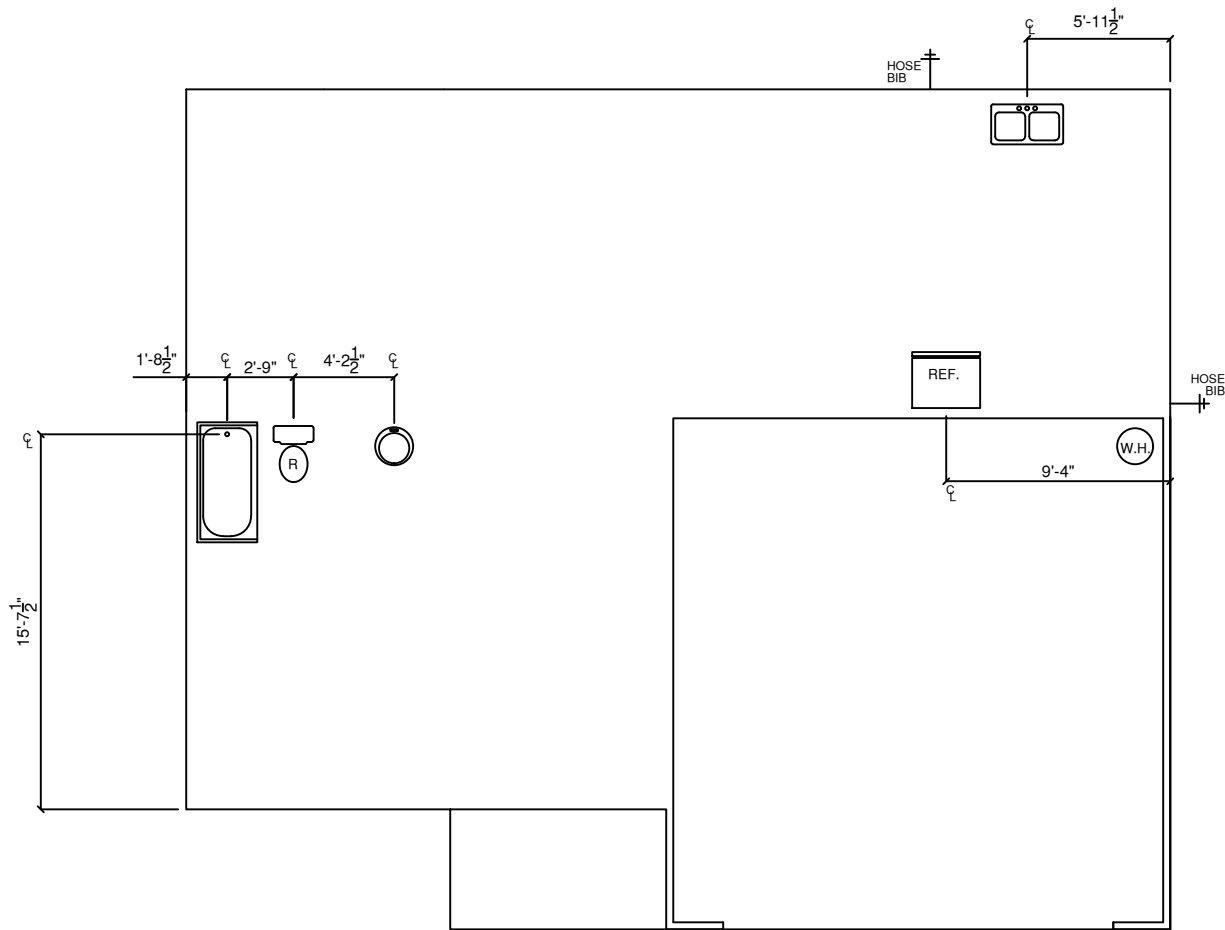

NOTE: DIMENSIONS TO THE
CENTER OF PLUMBING FIXTURES

PLUMBING PLAN
SCALE 1/8" = 1'-0"

PERMANENT
109-24-109 HENDERSON

GENERAL NOTES

- 1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3/4" UNLESS NOTED OTHERWISE.
- 4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
- 5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.
- 6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.
- 7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.
- 8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.
- 9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.
- 10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.
- 11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.
- 12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC





SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727

JOB NUMBER & CLIENT NAME:
XXXXXXXXXX
ELEVATION:
CLASSIC
TOWN/CITY:
XXXXXXXXXX
COUNTY:
XXXXXXXXXX
AUTHORED DATE:
2022
DRAFTING UPDATES:
PRELIMINARY: 3/17/2024 JPH PERM: 04/14/2025 BES* FINAL:

Plumbing Plan

WESTOVER

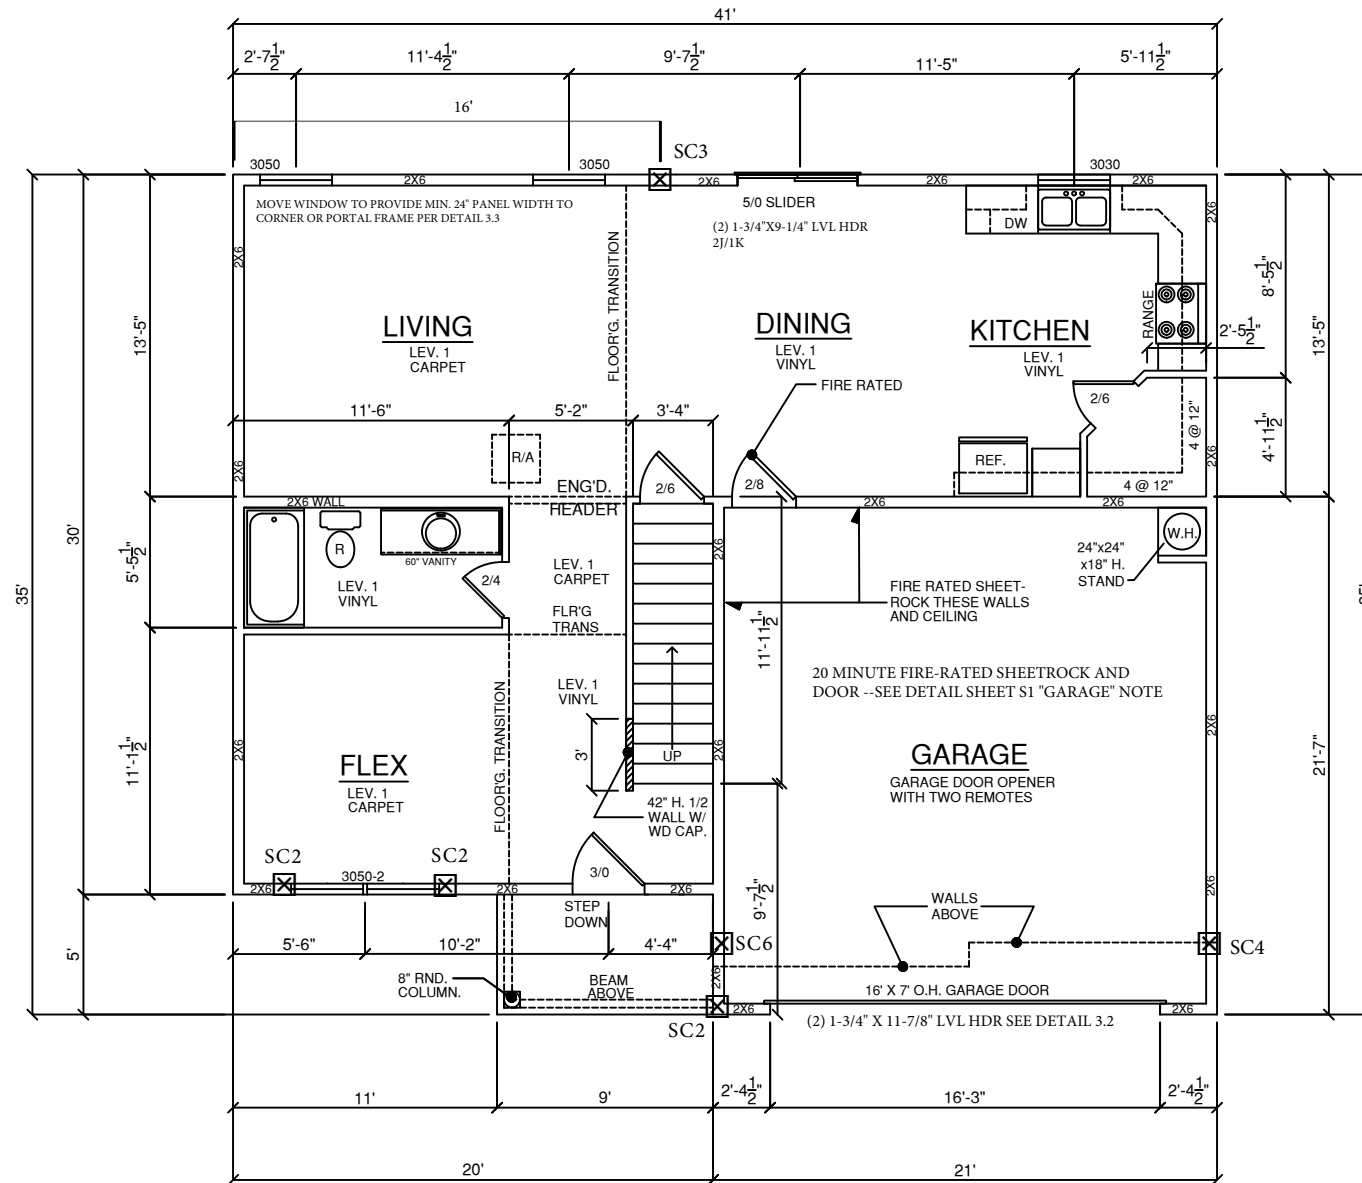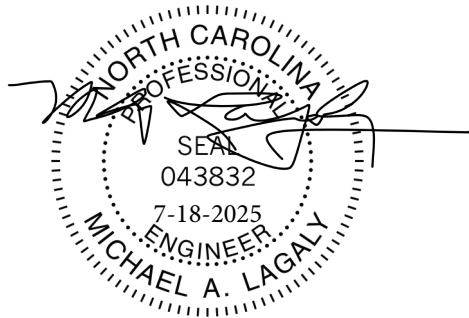

FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES

- 1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.
- 4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
- 5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.
- 6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.
- 7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.
- 8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.
- 9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.
- 10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.
- 11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.
- 12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC



SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727

JOB NUMBER & CLIENT NAME:

XXXXXXXXXX

ELEVATION:

CLASSIC

TOWN/CITY:

XXXXXXXXXX

COUNTY:

XXXXXXXXXX

AUTHORED DATE:

2022



DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH
PERM: 04/14/2025 BES*
FINAL:

First Floor Plan

WESTOVER

PERMANENT
109-24-109 HENDERSON

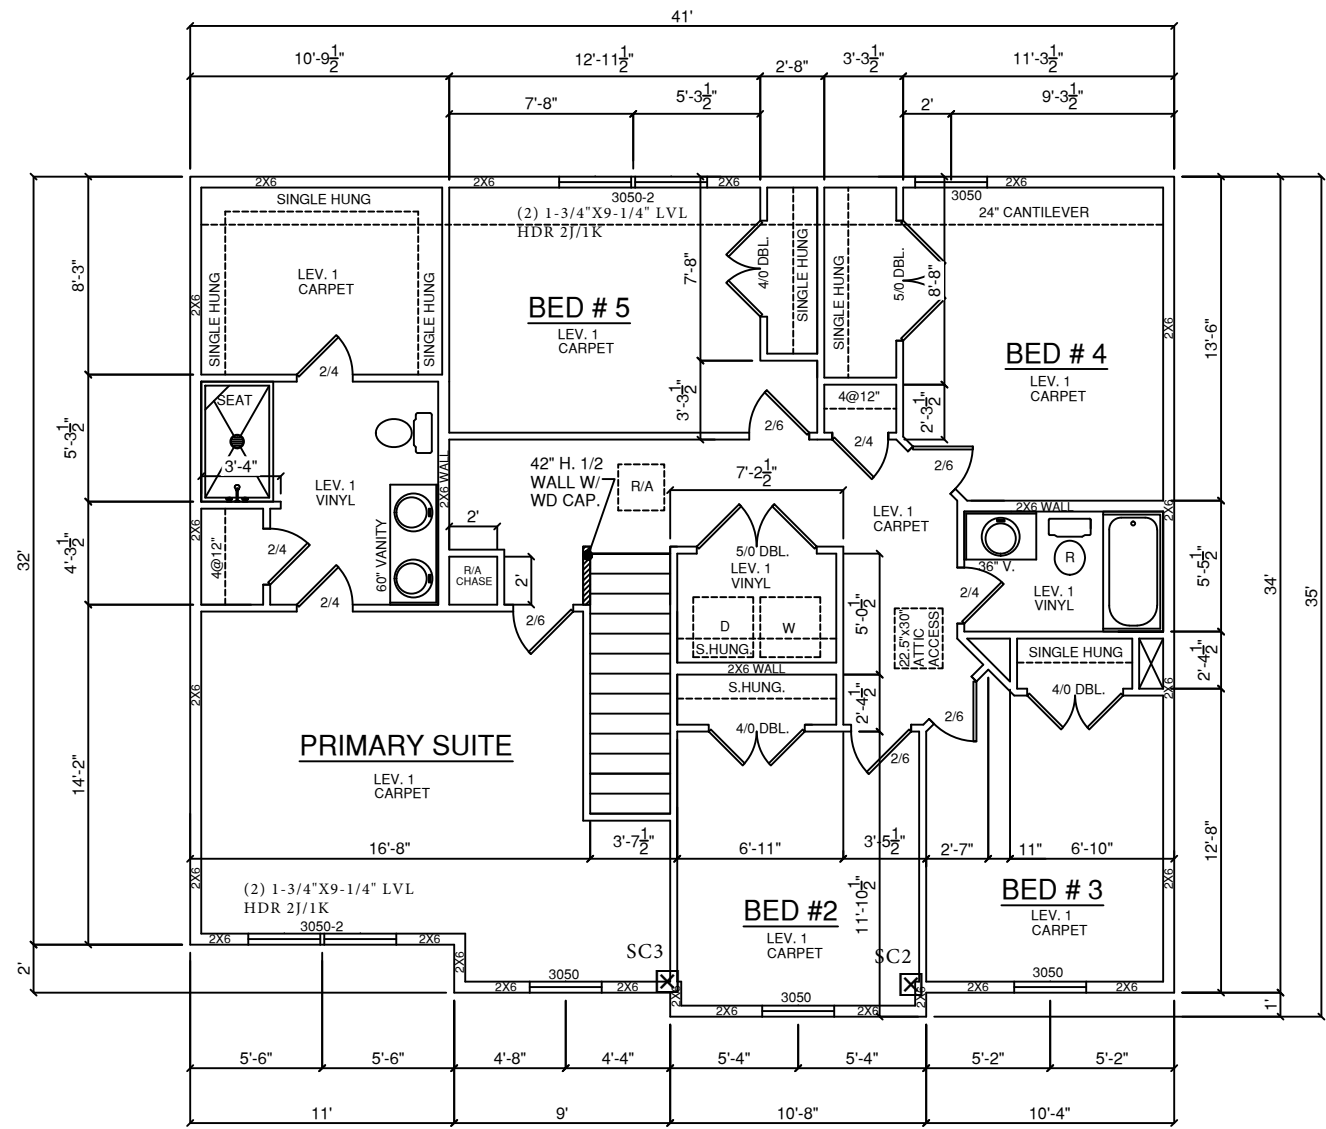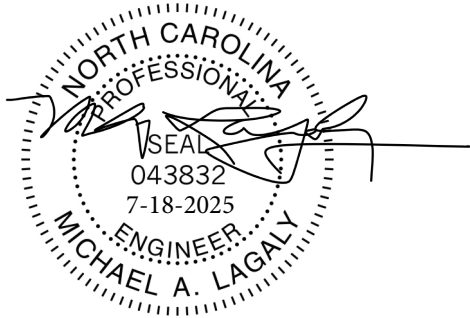

CHOICE SECOND FLOOR CANTILEVER PLAN
W/ 5TH BEDROOM
SCALE: 1/8" = 1'-0"

GENERAL NOTES

- 1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.
- 4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
- 5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.
- 6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.
- 7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.
- 8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.
- 9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.
- 10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.
- 11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.
- 12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC



SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727

JOB NUMBER & CLIENT NAME:

XXXXXXXXXX

ELEVATION:

CLASSIC

TOWN/CITY:

XXXXXXXXXX

COUNTY:

XXXXXXXXXX

AUTHORED DATE:

2022


DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH
PERM: 04/14/2025 BES
FINAL:


Second Floor Plan

WESTOVER

PERMANENT
109-24-109 HENDERSON

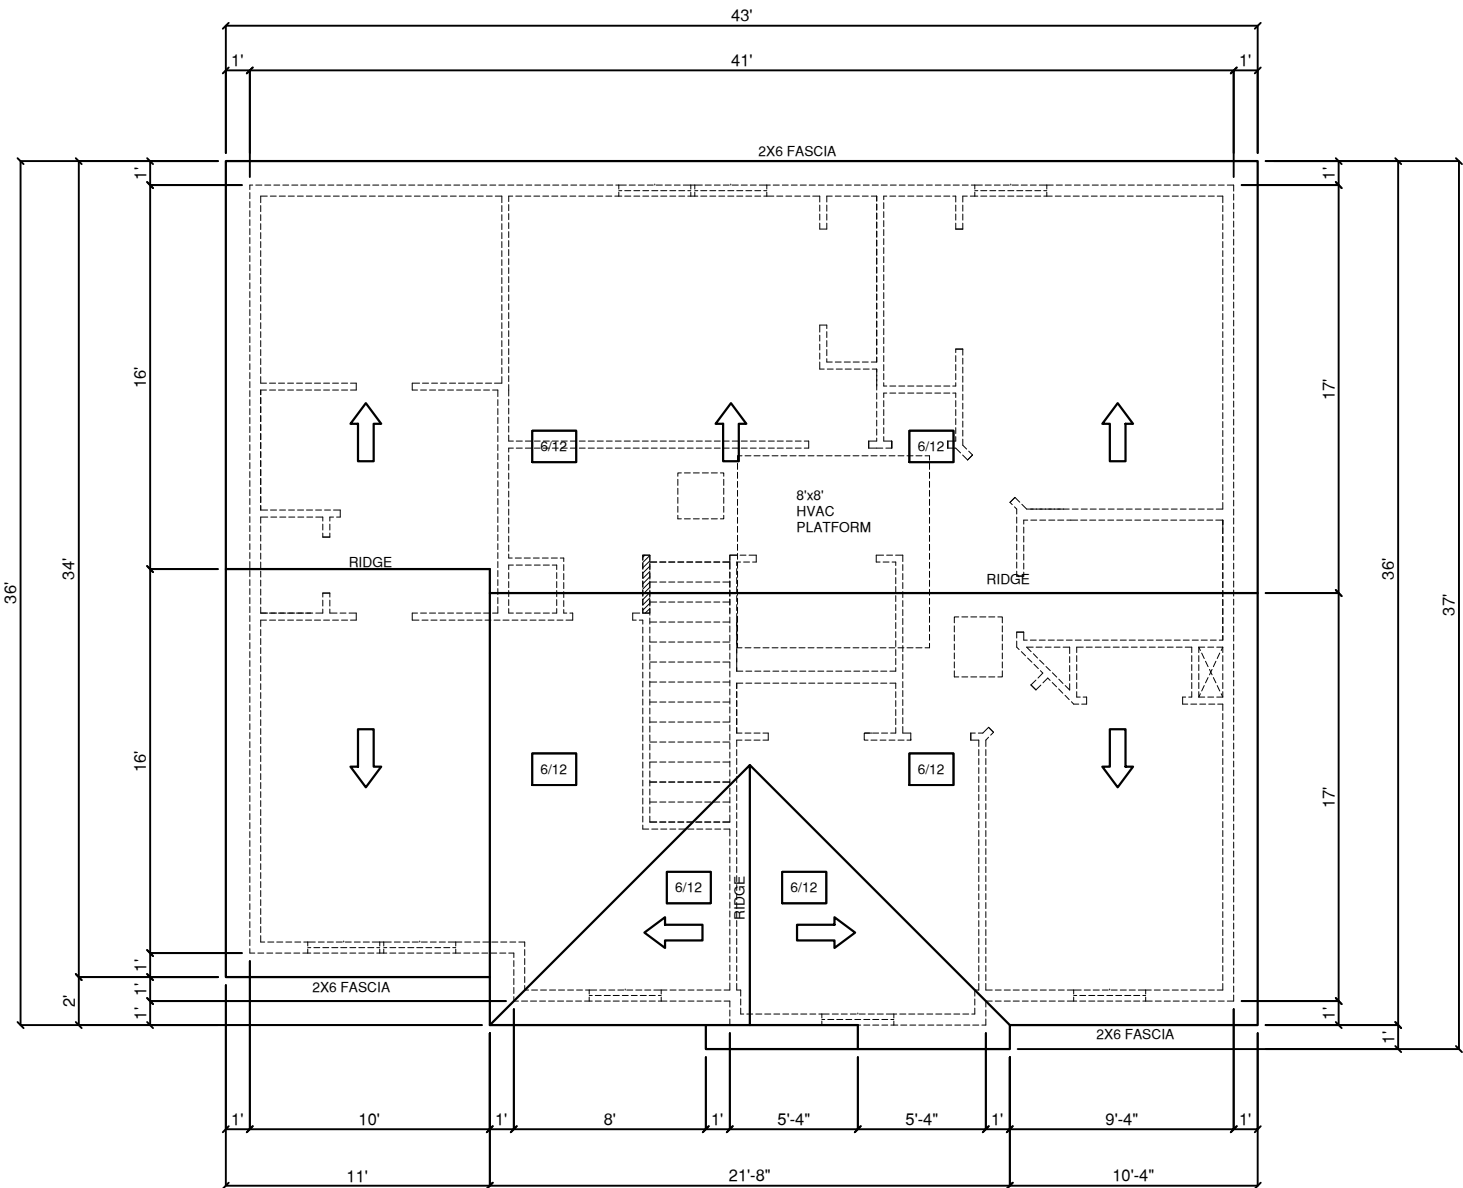


ROOF PLAN
SCALE 1/8" = 1'-0"

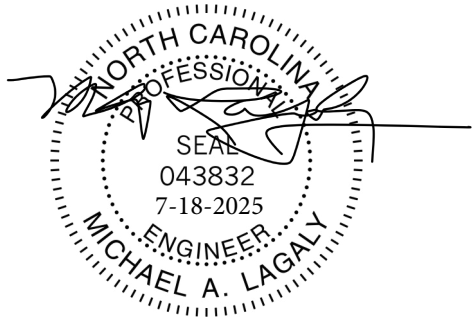

MAIN ROOF VENT AREA CALCULATION
ATTIC AREA: 1382.7 SQ. FT.
TOTAL VENT SPACE REQ'D: 93 SQ. FT.
SOFFIT NFA REQ'D: 4.65 SQ. FT.
RIDGE/GABLE NFA REQ'D: 4.65 SQ. FT.

NOTE:
TOTAL NET FREE VENT AREA CAN BE
REDUCED BY HALF IF 0-80 PERCENT OF VENT
SPACE IS LOCATED 3' OR MORE ABOVE THE
EAVE VENTS -OR-
WHEN CLASS I OR II VAPOR RETARDER IS
INSTALLED PER R806.2

LOWER ROOF VENT AREA CALCULATION
ATTIC AREA: 81.9 SQ. FT.
TOTAL VENT SPACE REQ'D: .55 SQ. FT.
SOFFIT NFA REQ'D: 0.275 SQ. FT.
RIDGE/GABLE NFA REQ'D: 0.275 SQ. FT.

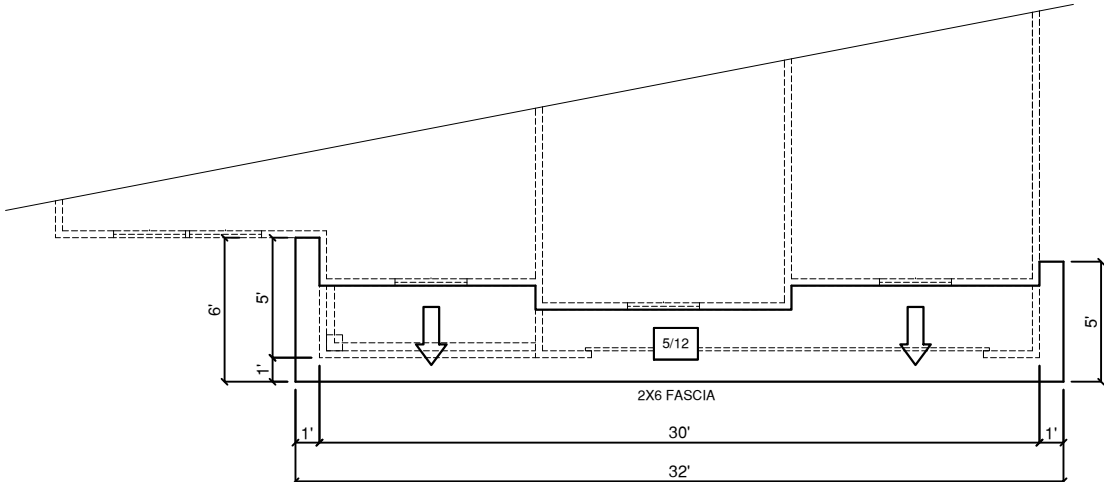

GENERAL NOTES

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC

RED DOOR

homes

RedDoorHomesCarolinas.com

SQUARE FOOTAGE CHART	
MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727
JOB NUMBER & CLIENT NAME: XXXXXXXXXX	
ELEVATION: CLASSIC	
TOWN/CITY: XXXXXXXXXX	
COUNTY: XXXXXXXXXX	
AUTHORED DATE: 2022	
DRAFTING UPDATES:	
PRELIMINARY: 3/17/2024 JPH PERM: 04/14/2025 BES* FINAL:	
Roof Plan	
WESTOVER	

PERMANENT
109-24-109 HENDERSON

ELECTRICAL LEGEND

	DUPLEX OUTLET
	GROUND FAULT INTERRUPTER OUTLET
	WATER PROOF OUTLET
	220 VOLT OUTLET
	SINGLE POLE SWITCH
	THREE-WAY SWITCH
	FOUR-WAY SWITCH
	LIGHT, SURFACE MOUNTED
	LIGHT, L.E.D. RECESSED MOUNTED
	LIGHT, PENDANT
	LIGHT, COACH / VANITY
	LIGHT, UNDER WALL CABINET
	LIGHT, OUTDOOR FLOOD
	EXHAUST FAN
	SMOKE DETECTOR
	THERMOSTAT
	CEILING FAN WITH LIGHT
	CEILING FAN PRE-WIRE AT LIGHT
	RECEPTACLE, PHONE
	RECEPTACLE, CAT CABLE
	RECEPTACLE, T.V. CABLE
	ELECTRICAL PANEL
	METER BASE
	CHIME BELL, DOOR
	EAVE LIGHT

ELECTRICAL NOTES

1. ALL ELECTRICAL TO MEET N.E.C.

2. PROVIDE 200 AMP SINGLE PHASE SERVICE

3. PROVIDE ALL COPPER WIRING

4. CONTRACTOR TO CONNECT ALL FIXTURES AND APPLIANCES

5. CONTRACTOR TO HAVE VALID LICENSE TO DO ELECTRICAL WORK

6. PROVIDE #5 REBAR ELECTRICAL GROUND TO FOUNDATION STEEL

7. PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS AS REQUIRED BY NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES

8. PROVIDE AND INSTALL GROUND FAULT CIRCUIT- INTERRUPTERS (GFI) AS REQUIRED BY NATIONAL ELECTRICAL CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES

9. UNLESS OTHERWISE INDICATED, INSTALL SWITCHES & RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE THE FINISHED FLOOR:

SWITCHES

42"

OUTLETS

14"

TELEPHONE

14"

TELEVISION

14"

FIRST FLOOR ELECTRICAL PLAN
SCALE: 1/8" = 1'-0"

PERMANENT
109-24-109 HENDERSON

GENERAL NOTES

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE, HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC

RedDoorHomesCarolinas.com

SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727

JOB NUMBER & CLIENT NAME:

XXXXXXXXXX

ELEVATION:

CLASSIC

TOWN/CITY:

XXXXXXXXXX

COUNTY:

XXXXXXXXXX

AUTHORED DATE:

2022

DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH

PERM: 04/14/2025 BES*

FINAL:

First Floor Electrical Plan

WESTOVER

ELECTRICAL LEGEND

	DUPLEX OUTLET
	GROUND FAULT INTERRUPTER OUTLET
	WATER PROOF OUTLET
	220 VOLT OUTLET
	SINGLE POLE SWITCH
	THREE-WAY SWITCH
	FOUR-WAY SWITCH
	LIGHT, SURFACE MOUNTED
	LIGHT, L.E.D. RECESSED MOUNTED
	LIGHT, PENDANT
	LIGHT, COACH / VANITY
	LIGHT, UNDER WALL CABINET
	LIGHT, OUTDOOR FLOOD
	EXHAUST FAN
	SMOKE DETECTOR
	THERMOSTAT
	CEILING FAN WITH LIGHT
	CEILING FAN PRE-WIRE AT LIGHT
	RECEPTACLE, PHONE
	RECEPTACLE, CAT CABLE
	RECEPTACLE, T.V. CABLE
	ELECTRICAL PANEL
	METER BASE
	CHIME BELL, DOOR
	EAVE LIGHT

ELECTRICAL NOTES

1. ALL ELECTRICAL TO MEET N.E.C.

2. PROVIDE 200 AMP SINGLE PHASE SERVICE

3. PROVIDE ALL COPPER WIRING

4. CONTRACTOR TO CONNECT ALL FIXTURES AND APPLIANCES

5. CONTRACTOR TO HAVE VALID LICENSE TO DO ELECTRICAL WORK

6. PROVIDE #5 REBAR ELECTRICAL GROUND TO FOUNDATION STEEL

7. PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS AS REQUIRED BY NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES

8. PROVIDE AND INSTALL GROUND FAULT CIRCUIT- INTERRUPTERS (GFI) AS REQUIRED BY NATIONAL ELECTRICAL CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES

9. UNLESS OTHERWISE INDICATED, INSTALL SWITCHES & RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE THE FINISHED FLOOR:

SWITCHES

42"

OUTLETS

14"

TELEPHONE

14"

TELEVISION

14"

SECOND FLOOR ELECTRICAL PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE, HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC

RED DOOR

homes

RedDoorHomesCarolinas.com

SQUARE FOOTAGE CHART

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727

JOB NUMBER & CLIENT NAME:

XXXXXXXXXX

ELEVATION:

CLASSIC

TOWN/CITY:

XXXXXXXXXX

COUNTY:

XXXXXXXXXX

AUTHORED DATE:

2022

DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH

PERM: 04/14/2025 BES*

FINAL:


Second Floor Electrical Plan

WESTOVER


PERMANENT
109-24-109 HENDERSON

60" VANITY


SCALE: = 1/4" = 1'-0"



SCALE: = 1/4" = 1'-0"

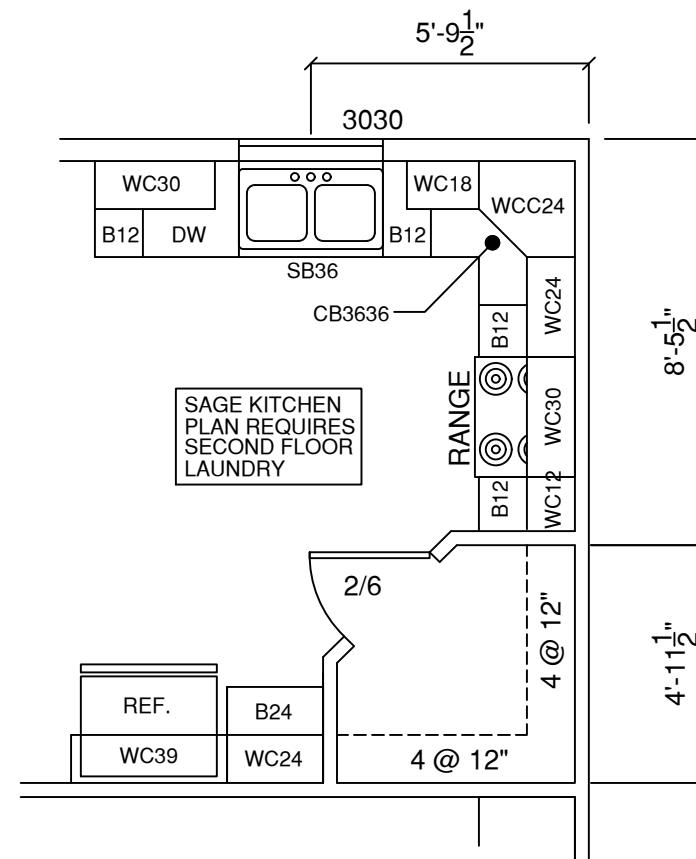

SCALE: 1/4" = 1'-0"

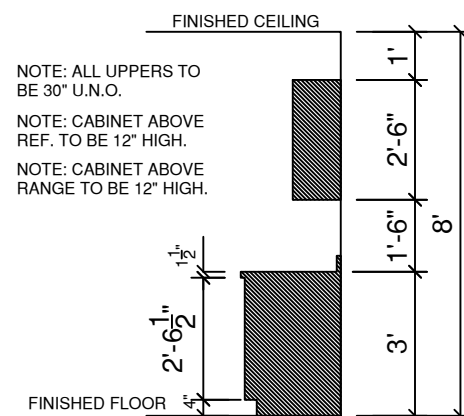

SCALE: = 1/4" = 1'-0"

- ☐ OPTIONAL SCRIBE TRIM MLD'G.
- ☐ OPTIONAL CROWN MLD'G.

WC: WALL CABINET
WCC: WALL CORNER CABINET
B: BASE CABINET
SB: SINK BASE
CB: CORNER BASE

- 1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 2.) OPTIONAL BONUS FLOOR HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.
- 3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.
- 4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
- 5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.
- 6.) SIZE, LOCATION AND MATERIALS OF BEAMS, TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER, TRUSS SHOP OR LICENSED ENGINEER.
- 7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.
- 8.) ROOF VENTILATION TO BE DETERMINED & VERIFIED BY A BUILDER, ROOFING CONTRACTOR OR LICENSED ENGINEER.
- 9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.
- 10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.
- 11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECEDENCE OVER DRAWINGS.
- 12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC.
LICENSED TO RED DOOR HOMES OF:
THE CAROLINAS LLC



RedDoorHomesCarolinas.com

MAIN FLOOR AREA TO FRAMING:	893
SECOND FLOOR TO FRAMING:	1347
TOTAL HEATED & COOLED TO FRAMING:	2240
GARAGE AREA TO FRAMING:	442
FRONT PORCH AREA:	45
TOTAL UNDER BEAM AREA	2727

JOB NUMBER & CLIENT NAME:

XXXXXXXXXX

ELEVATION:

CLASSIC

TOWN/CITY:

XXXXXXXXXXXX

COUNTY:

XXXXXXXXXX

AUTHORED DATE:

2022

DRAFTING UPDATES:

PRELIMINARY: 3/17/2024 JPH
BERM: 04/14/2025 RES*

FINAL:

Cabinet Layout

WESTOVER

PERMANENT
109-24-109 HENDERSON

GENERAL NOTES

1. PLANS ARE ISSUED FOR THE CONDITIONAL USE TO BUILD THE STRUCTURE ON THE LOT OR ADDRESS SPECIFIED IN THE TITLE BLOCK. PLANS MUST HAVE SIGNED SEAL AND BE CONSTRUCTED ON THE SPECIFIED LOT OR ADDRESS TO BE VALID.
2. ENGINEER'S SEAL APPLIES TO STRUCTURAL COMPONENTS ONLY. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF GEOMETRY. MDL ENGINEERING SERVICES ASSUMES NO LIABILITY FOR CHANGES MADE TO THESE PLANS BY OTHERS, OR FOR CONSTRUCTION METHODS, OR FOR ANY DEVIATION FROM THE PLANS. ENGINEER OF RECORD TO BE NOTIFIED PRIOR TO CONSTRUCTION IF ANY DISCREPANCIES ARE NOTED ON THE PLANS.
3. ALL CONSTRUCTION WORKMANSHIP, MATERIAL QUALITY AND SELECTION SHALL BE IN ACCORDANCE WITH THE 2018 EDITION OF THE NORTH CAROLINA STATE BUILDING CODE. DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE AND CODE SHALL TAKE PRECEDENCE OVER DIMENSIONS.
4. SEALED ENGINEERING DRAWINGS TAKE PRECEDENCE OVER STANDARD DETAILS AND NOTES.

CONSTRUCTION

1. IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION. CONTRACTOR IS ULTIMATELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS AND SAFETY ON-SITE. NOTIFY MDL ENGINEERING IMMEDIATELY IF DISCREPANCIES ON PLANS ARE DISCOVERED.
2. ALL BEAMS TO BE CONTINUOUSLY SUPPORTED Laterally and shall bear full width on the supporting walls or columns indicated with a minimum of three studs u.n.o.
3. Solid blocking to be provided at all point loads through floor levels to the foundation or other structural components.
4. ALL ENGINEERED WOOD PRODUCTS (LVL, PSL, LSL, ETC.) SHALL BE INSTALLED WITH CONNECTIONS PER MANUFACTURER SPECIFICATIONS.
5. ENGINEERED FLOOR SYSTEMS, WALL SYSTEMS AND ROOF TRUSS SYSTEMS TO BE PROVIDED FOR REVIEW AND COORDINATED WITH THE ENGINEER OF RECORD PRIOR TO CONSTRUCTION. INSTALLATION TO BE IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS.
6. ALL STEEL BEAMS TO BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3'-1/2" AND FULL FLANGE WIDTH U.N.O. BEAMS MUST BE ATTACHED AT EACH END WITH A MINIMUM OF FOUR 16d NAILS OR TWO 12" X 4" LAG SCREWS U.N.O.
7. STEEL FLITCH BEAMS TO BE BOLTED TOGETHER USING TWO ROWS OF 1/2" DIAMETER BOLTS (ASTM 307) WITH WASHERS AT BOTH ENDS. BOLTS TO BE SPACED AT 24" O.C. AND STAGGERED TOP AND BOTTOM OF THE BEAM (2" MIN. EDGE DISTANCE), WITH TWO BOLTS LOCATED AT 6" FROM EACH END.
8. ALL METAL HANGERS, STRAPS AND HOLD-DOWNS TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
9. SEE TABLE R602.3 NCRBC 2018 FOR STRUCTURAL MEMBER FASTENING REQUIREMENTS.

MATERIALS

1. INTERIOR FRAMING LUMBER SHALL BE #2 SPRUCE PINE FIR (SPF) WITH THE FOLLOWING PROPERTIES:
Fb=875 PSI Fv=70 PSI E=1.4E6 PSI
2. FRAMING LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND, CONCRETE OR MASONRY SHALL BE PRESSURE TREATED #2 SOUTHERN YELLOW PINE (SYP) WITH THE FOLLOWING PROPERTIES:
Fb=975 PSI Fv=95 PSI E=1.6E6 PSI
3. LVL (LAMINATED VENEER LUMBER) STRUCTURAL MEMBERS TO HAVE THE FOLLOWING PROPERTIES:
Fb=2600 PSI Fv=285 PSI E=1.9E6 PSI
4. PSL (PARALLEL STRAND LUMBER) STRUCTURAL MEMBERS TO HAVE THE FOLLOWING PROPERTIES:
Fb=2900 PSI Fv=290 PSI E=2.0E6 PSI
5. LSL (LAMINATED STRAND LUMBER) STRUCTURAL MEMBERS TO HAVE THE FOLLOWING PROPERTIES:
Fb=2250 PSI Fv=400 PSI E=1.55E6 PSI
6. STRUCTURAL STEEL WIDE FLANGE BEAMS SHALL CONFORM TO ASTM A36, Fy=36 KSI
7. REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615 GRADE 60.
8. POURED CONCRETE TO BE MINIMUM 3000 PSI @ 28 DAYS. MATERIALS USED TO PRODUCE CONCRETE SHALL COMPLY WITH THE APPLICABLE STANDARDS LISTED IN ACI 318 OR ASTM C 1157.
9. CONCRETE SUBJECT TO MODERATE OR SEVERE WEATHERING AS INDICATED IN TABLE R301.2(1) SHALL BE AIR ENTRAINED AS SPECIFIED IN TABLE R402.2
10. MASONRY UNITS SHALL CONFORM TO ACI 530/ASCE 5/TMS 402 AND MORTAR SHALL COMPLY WITH ASTM C 270.

FOUNDATION MATERIALS:

1. PRESUMPTIVE LOAD-BEARING VALUES OF FOUNDATION MATERIALS TO BE PER TABLE R401.4.1
2. FOUNDATION MATERIALS MUST HAVE A MINIMUM LOAD-BEARING CAPACITY OF 2000 PSF
3. TOP OR SUBSOILS FOUND TO BE COMPRESSIBLE OR SHIFTING TO BE REMOVED TO A DEPTH OF 12" BELOW AND DOUBLE THE WIDTH OF THE FOOTING AND REPLACED WITH COMPACTED SCREENINGS, WASHED 57 STONE OR CONCRETE. REMOVED SOILS SHALL NOT BE USED AS STRUCTURAL FILL.

DRAINAGE:

1. INSTALL AROUND FOUNDATION, DRAIN TILES, GRAVEL OR CRUSHED STONE DRAINS, PERFORATED PIPES OR OTHER APPROVED SYSTEM AS REQUIRED BY GRADE.
2. FINISH GRADE OF LOT TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS AT A MINIMUM OF 6" WITHIN THE FIRST 10'.

CAVITY ACCESS:

1. ATTIC ACCESS TO BE 22" X 30" MINIMUM.
2. ACCESS SIZE MAY BE INCREASED IF MECHANICAL EQUIPMENT IS LOCATED IN CAVITY - SEE NC MECHANICAL CODE FOR SIZE REQUIREMENTS.

STAIRWAYS:

1. STAIRWAYS SHALL BE A MINIMUM OF 3' WIDE.
2. HANDRAILS SHALL NOT PROJECT MORE THAN 4-1/2" ON EITHER SIDE.
3. MINIMUM CLEAR WIDTH OF THE STAIRWAY AT AND BELOW THE HANDRAIL SHALL NOT BE LESS THAN 31 1/2" WHERE THE HANDRAIL IS INSTALLED ON ONE SIDE AND 27" WHERE HANDRAILS ARE ON BOTH SIDES.
4. STAIRS NOT REQUIRED FOR EGRESS MAY BE AS NARROW AS 26"
5. MAXIMUM RISER HEIGHT SHALL BE 8-1/4" AND THE MINIMUM TREAD DEPTH SHALL BE 9".
6. NOSING SHALL BE 3/4" MINIMUM AND 1-1/4" MAXIMUM
7. MINIMUM HEADROOM IN ALL PARTS OF THE STAIR SHALL NOT BE LESS THAN 6'-8" PER R311.7.2
8. WINDERS MUST, AT A POINT NOT MORE THAN 12" FROM THE SIDE WHERE THE TREAD IS NARROWEST BE GREATER THAN 9" AND THE MINIMUM WIDTH OF ANY TREAD AT ANY POINT MUST BE GREATER THAN 4".

HANDRAIL AND GUARD

1. HANDRAILS SHALL HAVE A MINIMUM HEIGHT OF 34" AND A MAXIMUM HEIGHT OF 38"
2. PORCHES, BALCONIES OR RAISED FLOORS OVER 30" ABOVE FLOOR OR GRADE SHALL HAVE GUARDRAILS NO LESS THAN 36" HIGH.
3. STAIRS THAT HAVE A RISE OF 30" ABOVE THE FLOOR SHALL HAVE HANDRAILS OF 34" MIN. HEIGHT.
4. GUARDS ON OPEN SIDES OF STAIRWAYS, RAISED FLOORS, BALCONIES AND PORCHES SHALL HAVE INTERMEDIATE RAILS OR ORNAMENTAL CLOSERS THAT DO NOT ALLOW PASSAGE OF AN OBJECT 4" OR MORE IN DIAMETER ON VERTICAL MEMBERS OR 6" ON HORIZONTAL MEMBERS.

EMERGENCY EGRESS:

1. OPENINGS PROVIDED FOR MEANS OF ESCAPE CANNOT HAVE A SILL HEIGHT OF MORE THAN 44" ABOVE FINISHED FLOOR.
2. ESCAPE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 4 SQ. FT. WITH A MINIMUM CLEAR OPENING HEIGHT OF 20".
3. ESCAPE OPENING SHALL HAVE A MINIMUM TOTAL GLASS AREA OF 5 SQ. FT. FOR A GROUND WINDOW AND 5.7 SQ. FT. FOR AN UPPER STORY WINDOW.
4. REQUIRED EXIT DOORS SHALL BE NO LESS THAN 30" X 6'-8".

GARAGE

1. DOOR FROM GARAGE TO HOUSE MUST BE 1-3/8" THICK SOLID WOOD, HONEYCOMBED CORE STEEL OR 20 MINUTE FIRE RATED PER R302.5.1.
2. GARAGE TO BE SEPARATED FROM THE RESIDENCE AS REQUIRED BY TABLE R302.6. 1/2" GYPSUM OR EQUIVALENT APPLIED TO GARAGE SIDE FOR WALLS AND ATTICS. 5/8" TYPE X GYPSUM OR EQUIVALENT APPLIED TO CEILINGS BELOW HABITABLE ROOMS.
3. SLOPE GARAGE SLAB TOWARDS DOOR AT 1/4" PER FOOT.

ANCHORAGE:

1. WOOD SOLE PLATE AT EXTERIOR WALLS ON MONOLITHIC SLAB FOUNDATIONS AND THE WOOD SILL PLATE SHALL BE ANCHORED TO THE FOUNDATION WITH ANCHOR BOLTS SPACED A MAXIMUM OD 6" O.C. AND LOCATED 12" FROM THE ENDS OF EACH PLATE SECTION. BOLTS SHALL BE AT LEAST 1/2" IN DIAMETER AND EMBEDDED A MINIMUM OF 7" INTO MASONRY OR CONCRETE.
2. BOLTS MAY BE REPLACED BY ANCHOR STRAPS, SPACED AS REQUIRED TO PROVIDE EQUIVALENT ANCHORAGE.
3. INTERIOR BEARING WALL SOLE PLATES ON MONOLITHIC SLABS SHALL BE ANCHORED WITH APPROVED FASTENERS.

BRACE WALL NOTES:

1. ALL EXTERIOR WALLS CONTINUOUSLY SHEATHED WITH 7/16" OSB EXTERIOR AND 1/2" GYPSUM INSIDE UNO.
2. OSB TO BE NAILED USING 8d @ 6" O.C. ON EDGE AND 12" O.C. ON ALL INTERMEDIATE STUDS.
3. GYPSUM FASTENED USING 1-1/8" MINIMUM SCREWS SPACED @ 7" O.C. ALONG ALL EDGES AND ALL INTERMEDIATE STUDS.

DESIGN LOADS

TABLE R301.5	LIVE LOAD (PSF)
ATTICS W/O STORAGE	10
ATTICS WITH STORAGE	20
ATTICS W/ FIXED STAIRS	30
DECKS & EXTERIOR BALCONIES	40
FIRE ESCAPES	40
GUARDRAILS AND HANDRAILS	200
GUARG IN-FILL COMPONENTS	50
PASSENGER VEHICLE GARAGES	50
ROOMS OTHER THAN SLEEPING ROOMS	40
SLEEPING ROOMS	30
STAIRS	40
SNOW (TABLE R301.2(1))	20

ULTIMATE DESIGN WIND SPEED: 120 MPH

DESIGN POSITIVE AND NEGATIVE PRESSURE FOR DOORS AND WINDOWS SHALL BE 25 PSF

DESIGN POSITIVE AND NEGATIVE PRESSURE FOR WALL CLADDING SHALL BE 24.1 PSF

DESIGN POSITIVE AND NEGATIVE PRESSURE FOR ROOF COMPONENT AND CLADDING SHALL BE:
34.8 PSF FOR MEAN ROOF HEIGHT TO 30'
36.5 PSF FOR MEAN ROOF HEIGHT TO 35'
37.9 PSF FOR MEAN ROOF HEIGHT TO 40'

VALUES FOR ENERGY COMPLIANCE
R-VALUES ARE MINIMUM (N1102.1.2)
U-VALUES ARE MAXIMUM (N1102.1.4)
REFER TO N1102 FOR ALL OTHER

IECC CLIMATE ZONE:	4	4
CEILINGS:	R-38	U-0.030
WOOD FRAME WALLS:	R-15	U-0.077
MASS WALLS:	R-5	U-0.070
MASS WALL (INS. ON INTERIOR):	R-13	U-0.141
FLOORS:	R-19	U-0.047
BASEMENT WALLS (CONTINUOUS):	R-10	U-0.059
BASEMENT WALLS (CAVITY):	R-15	
FENESTRATION U-FACTOR:	0.35	
MAX. GLAZING U-FACTOR:	0.30	
SKYLIGHT U-FACTOR:	0.55	

HEADER SCHEDULE U.N.O.


HDR SIZE	SPAN
(2) 2 X 6	0 TO 4'-8"
(2) 2 X 8	4'-8" TO 5'-6"
(2) 2 X 10	5'-6" TO 6'-5"
(2) 2 X 12	6'-5" TO 7'-6"

SUPPORT COLUMN

CALLOUT	USE
SC2	2 - 2 X 4
SC3	3 - 2 X 4
SC4	4 - 2 X 4
SC5	5 - 2 X 4

ROOF TRUSS TIE SCHEDULE

UPLIFT (MAX. LBS.)	SIMPSON (OR EQUIV.)	FASTENER TO TRUSS	FASTENER TO TOP PLATE
400	H1	(6) 8d X 1 1/2"	(4) 8d
545	H2.5T	(5) 8d	(5) 8d
1015	H10A	(9) 10d X 1 1/2"	(9) 10d X 1 1/2"
1450	H10A +HGA10	(4) 1/4" X 1 1/2" SDS	(4) 1/4" X 1 1/2" SDS
1885	H10A +HGA10 X2	(8) 1/4" X 1 1/2" SDS	(8) 1/4" X 1 1/2" SDS
3830	HTT4	(18) SD #10 X 1 1/2"	TITEN 5/8" X 5" ON STUD
4845	HTT4 +H10A	(9) 10d X 1 1/2"	(9) 10d X 1 1/2"

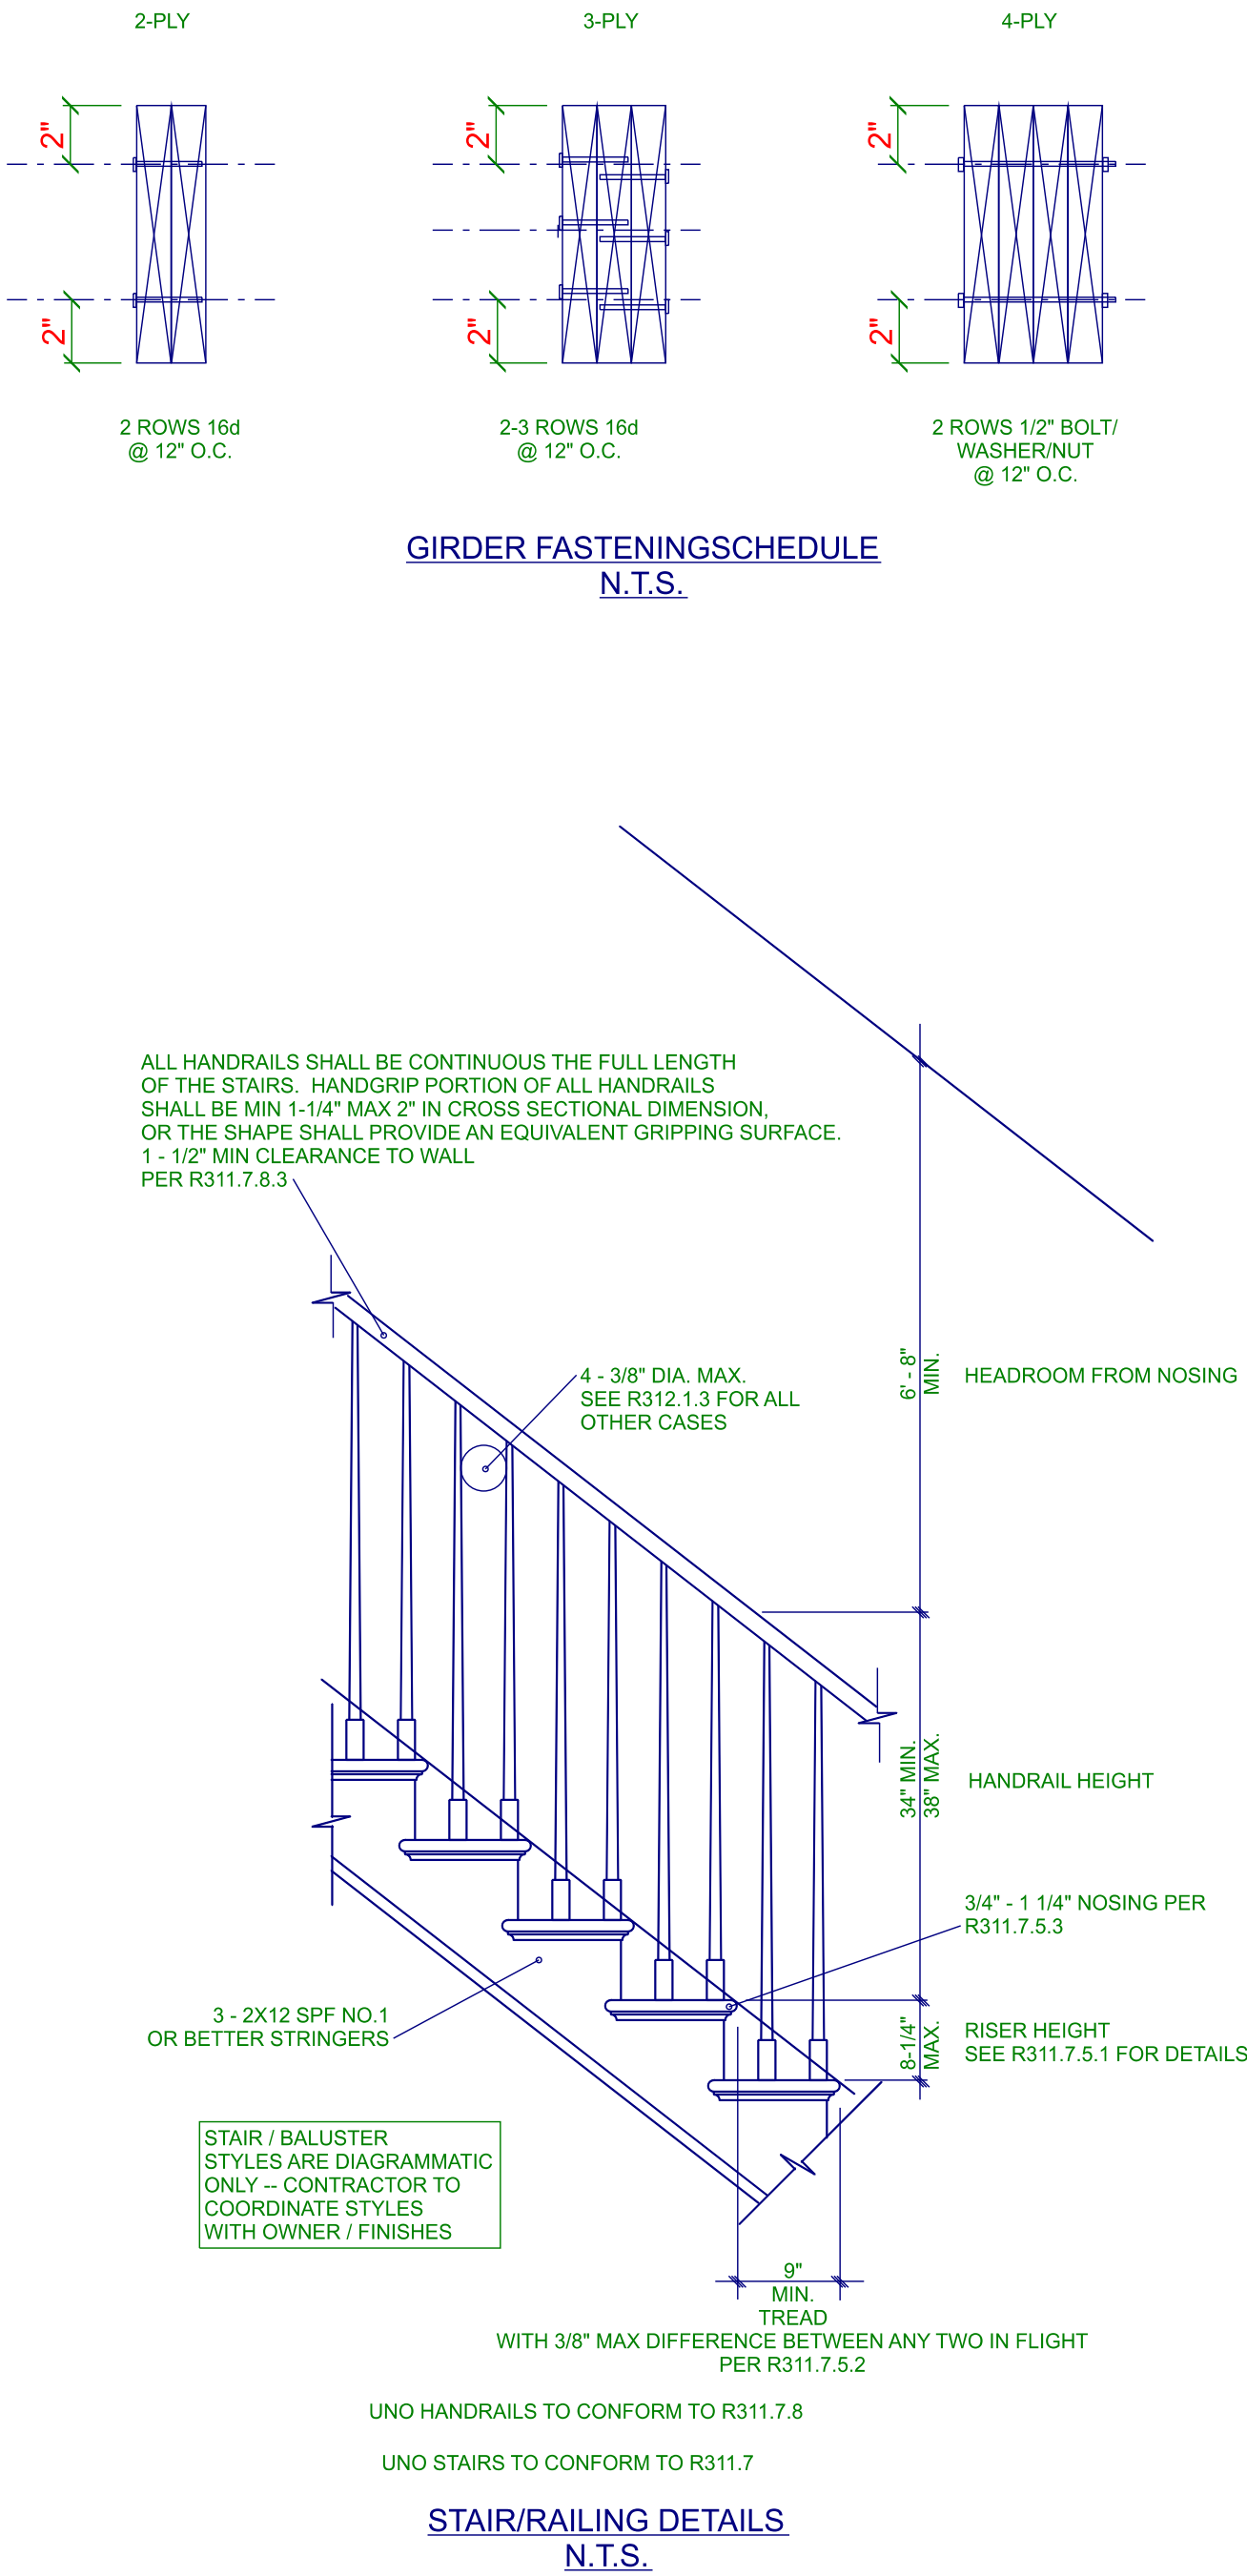

THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO MEET THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE. THIS DETAIL SHEET IS TO BE USED ONLY IN CONJUNCTION WITH PLANS CREATED BY RED DOOR HOMES.



MDL
ENGINEERING
SERVICES

213 Linton Banks Pl.
Cary, NC 27513
(919) 999-8153






RED DOOR HOMES
1209 US Business 70 West
Clayton, NC 27520
PROJECT: 109-25-109

DRAWN BY: ML
DATE: July 16, 2025
FILE: SD11462
REV: A

SCALE: 1/4 INCH = 1 FOOT

SHEET

S1

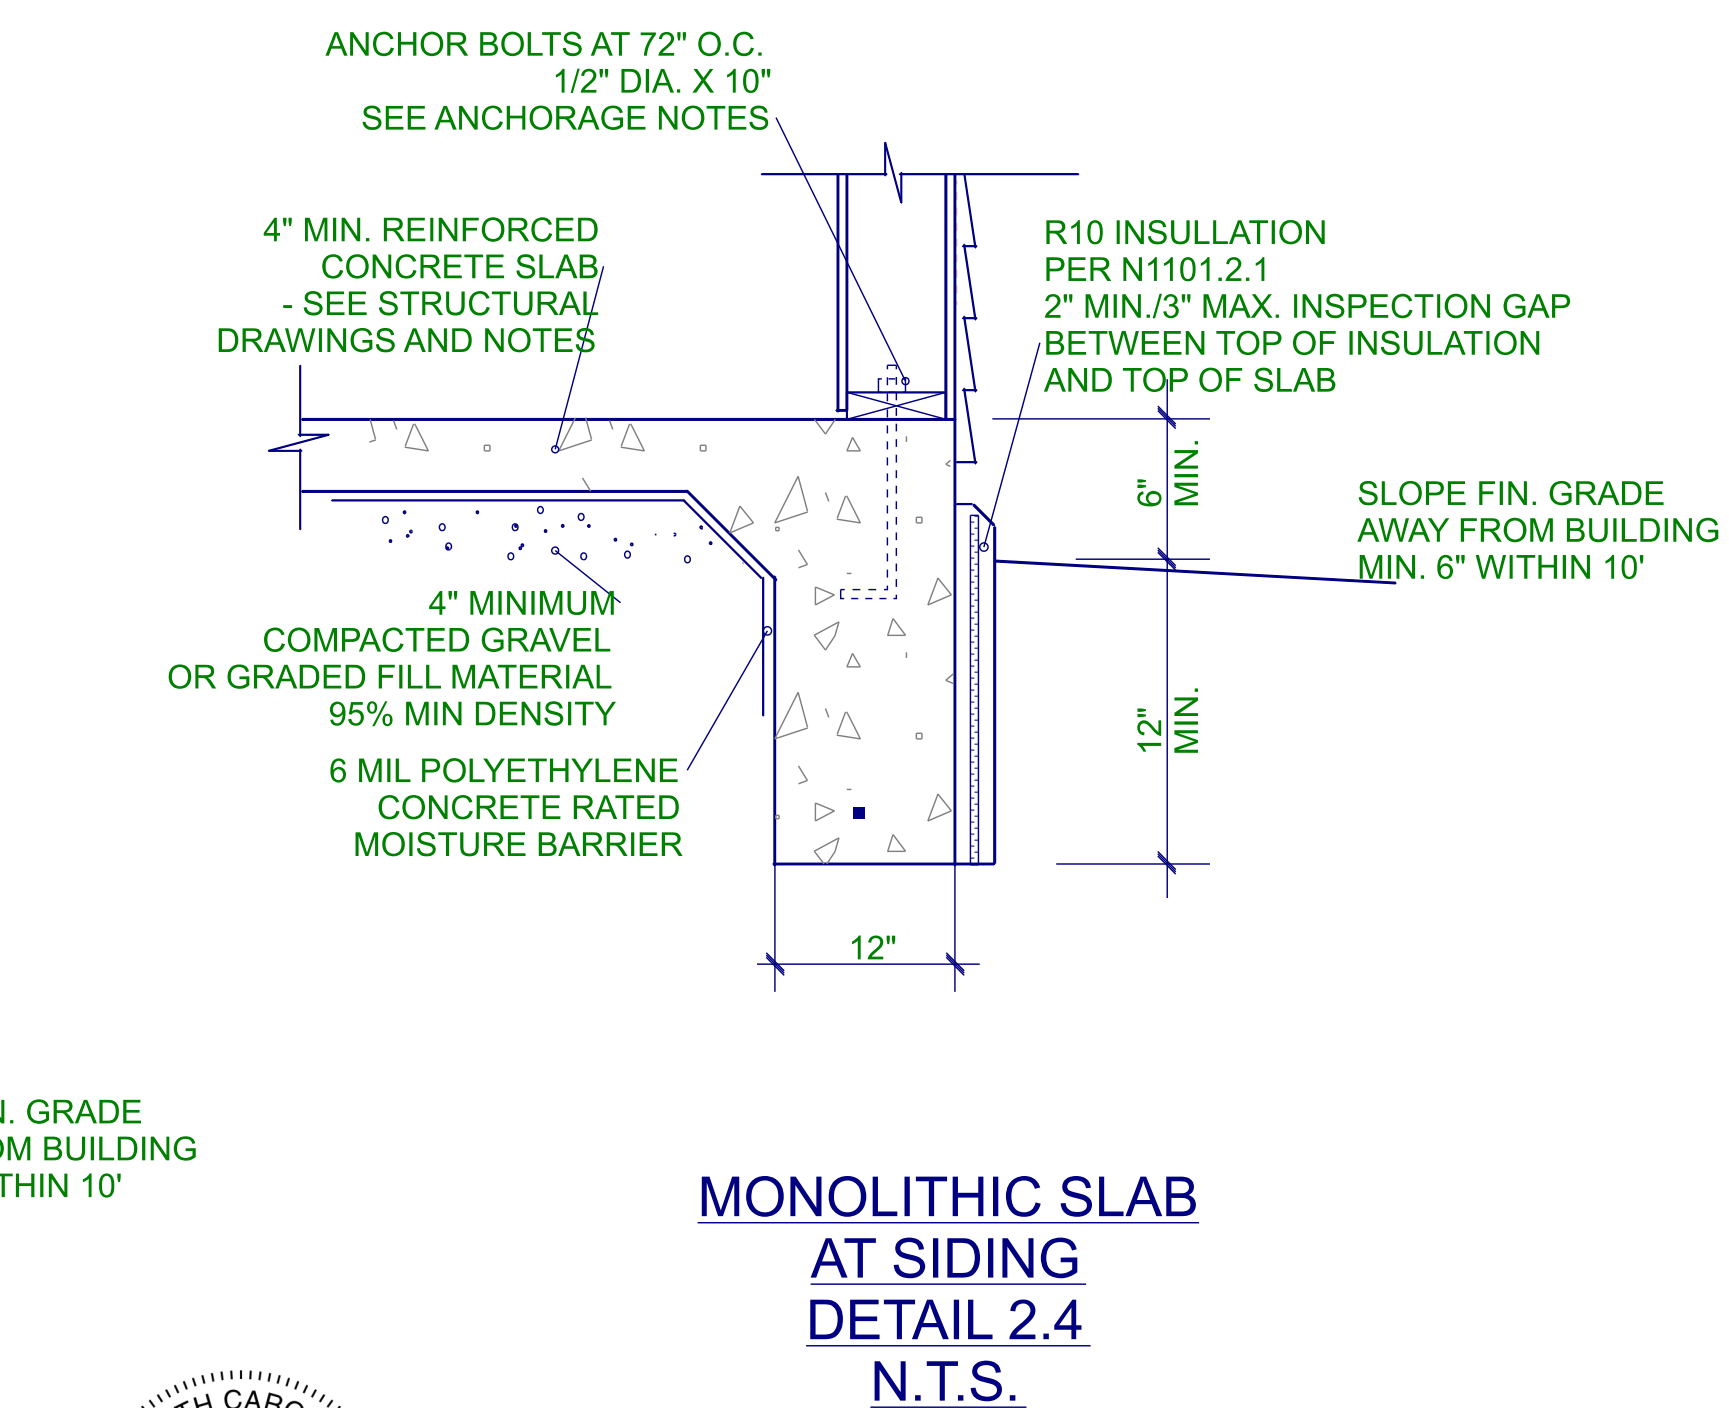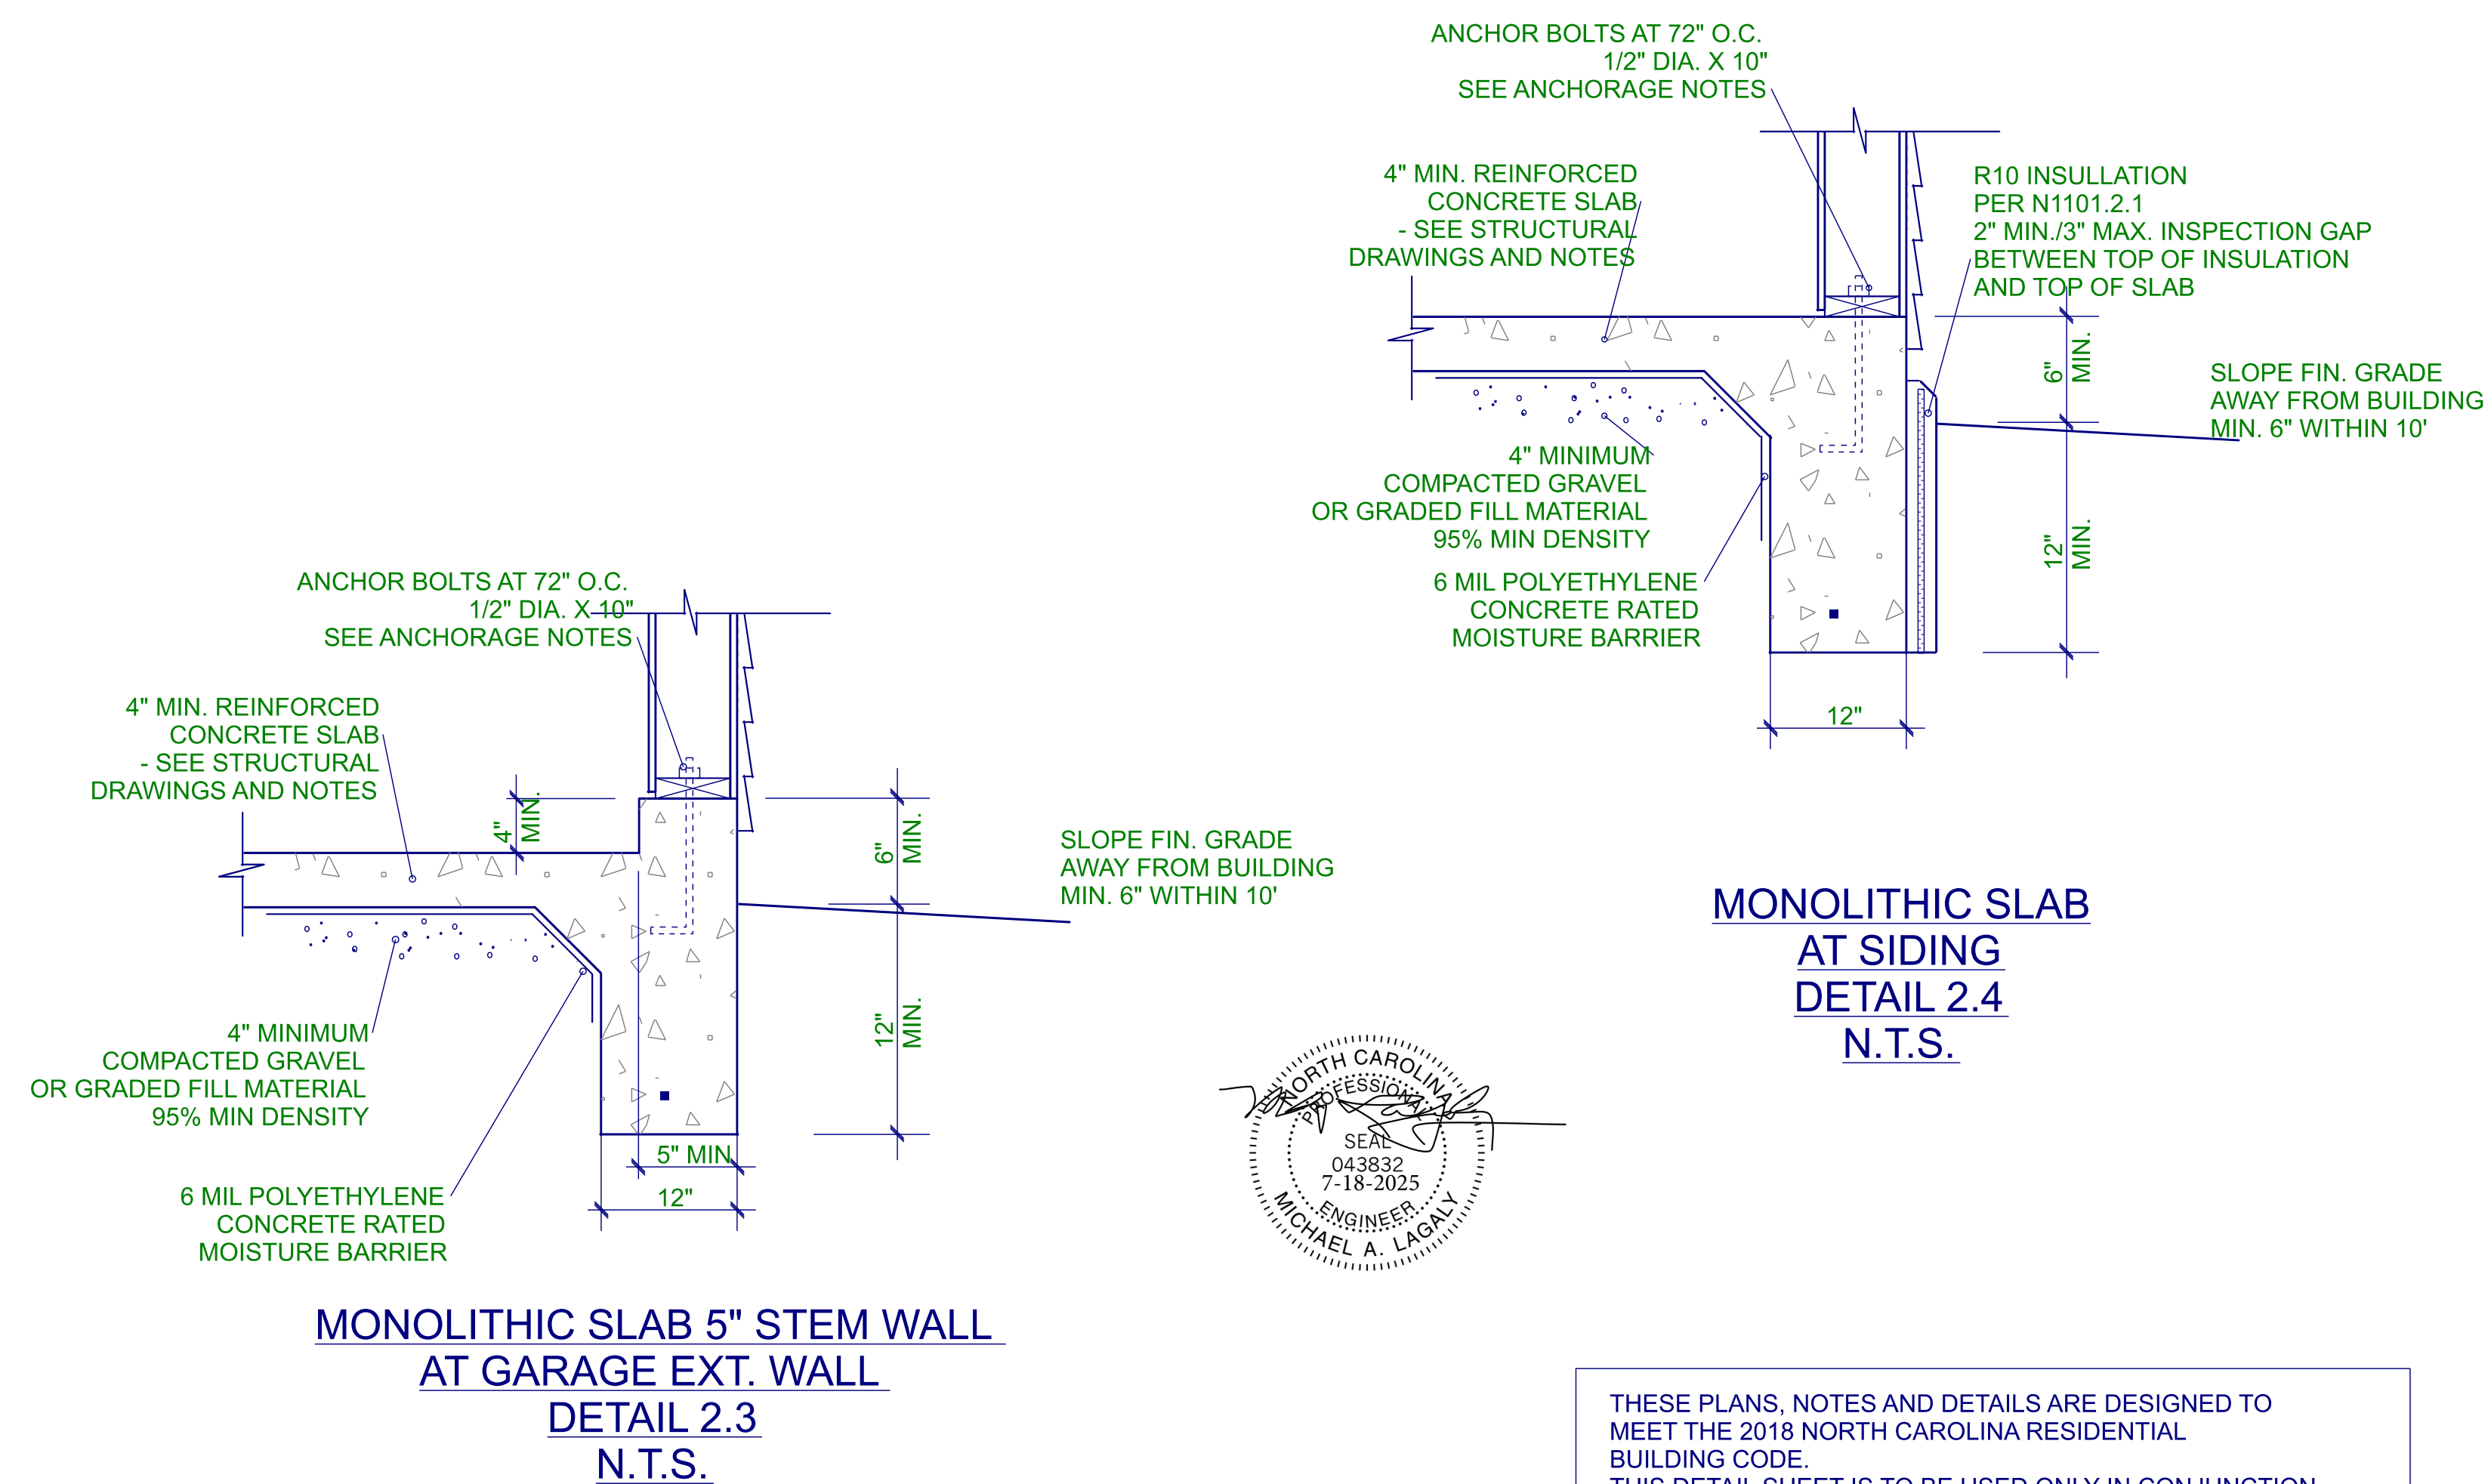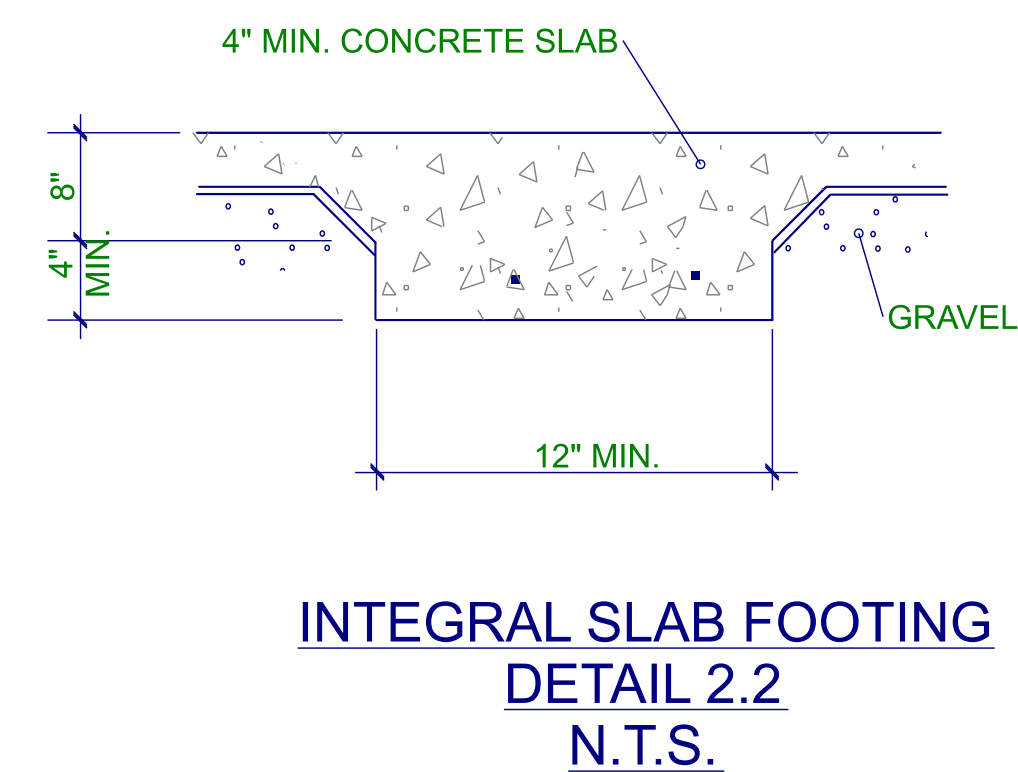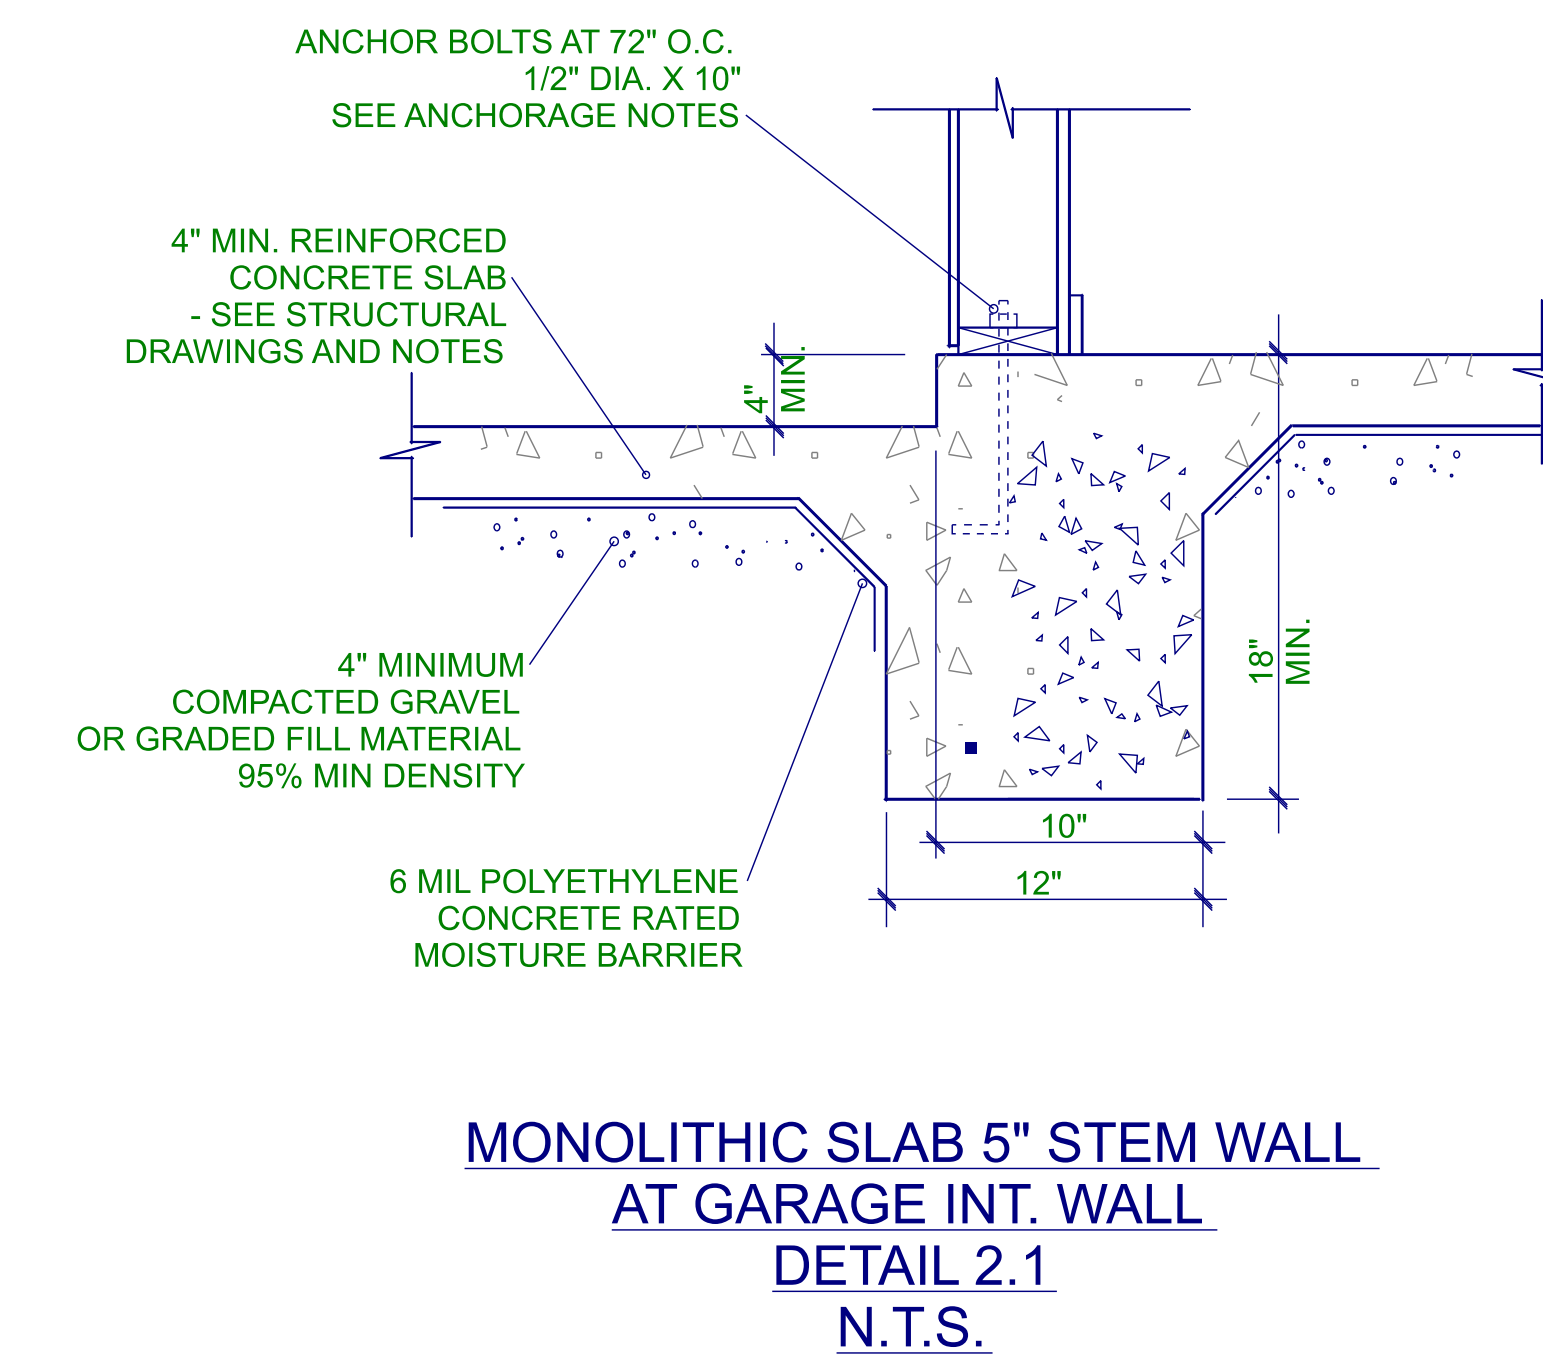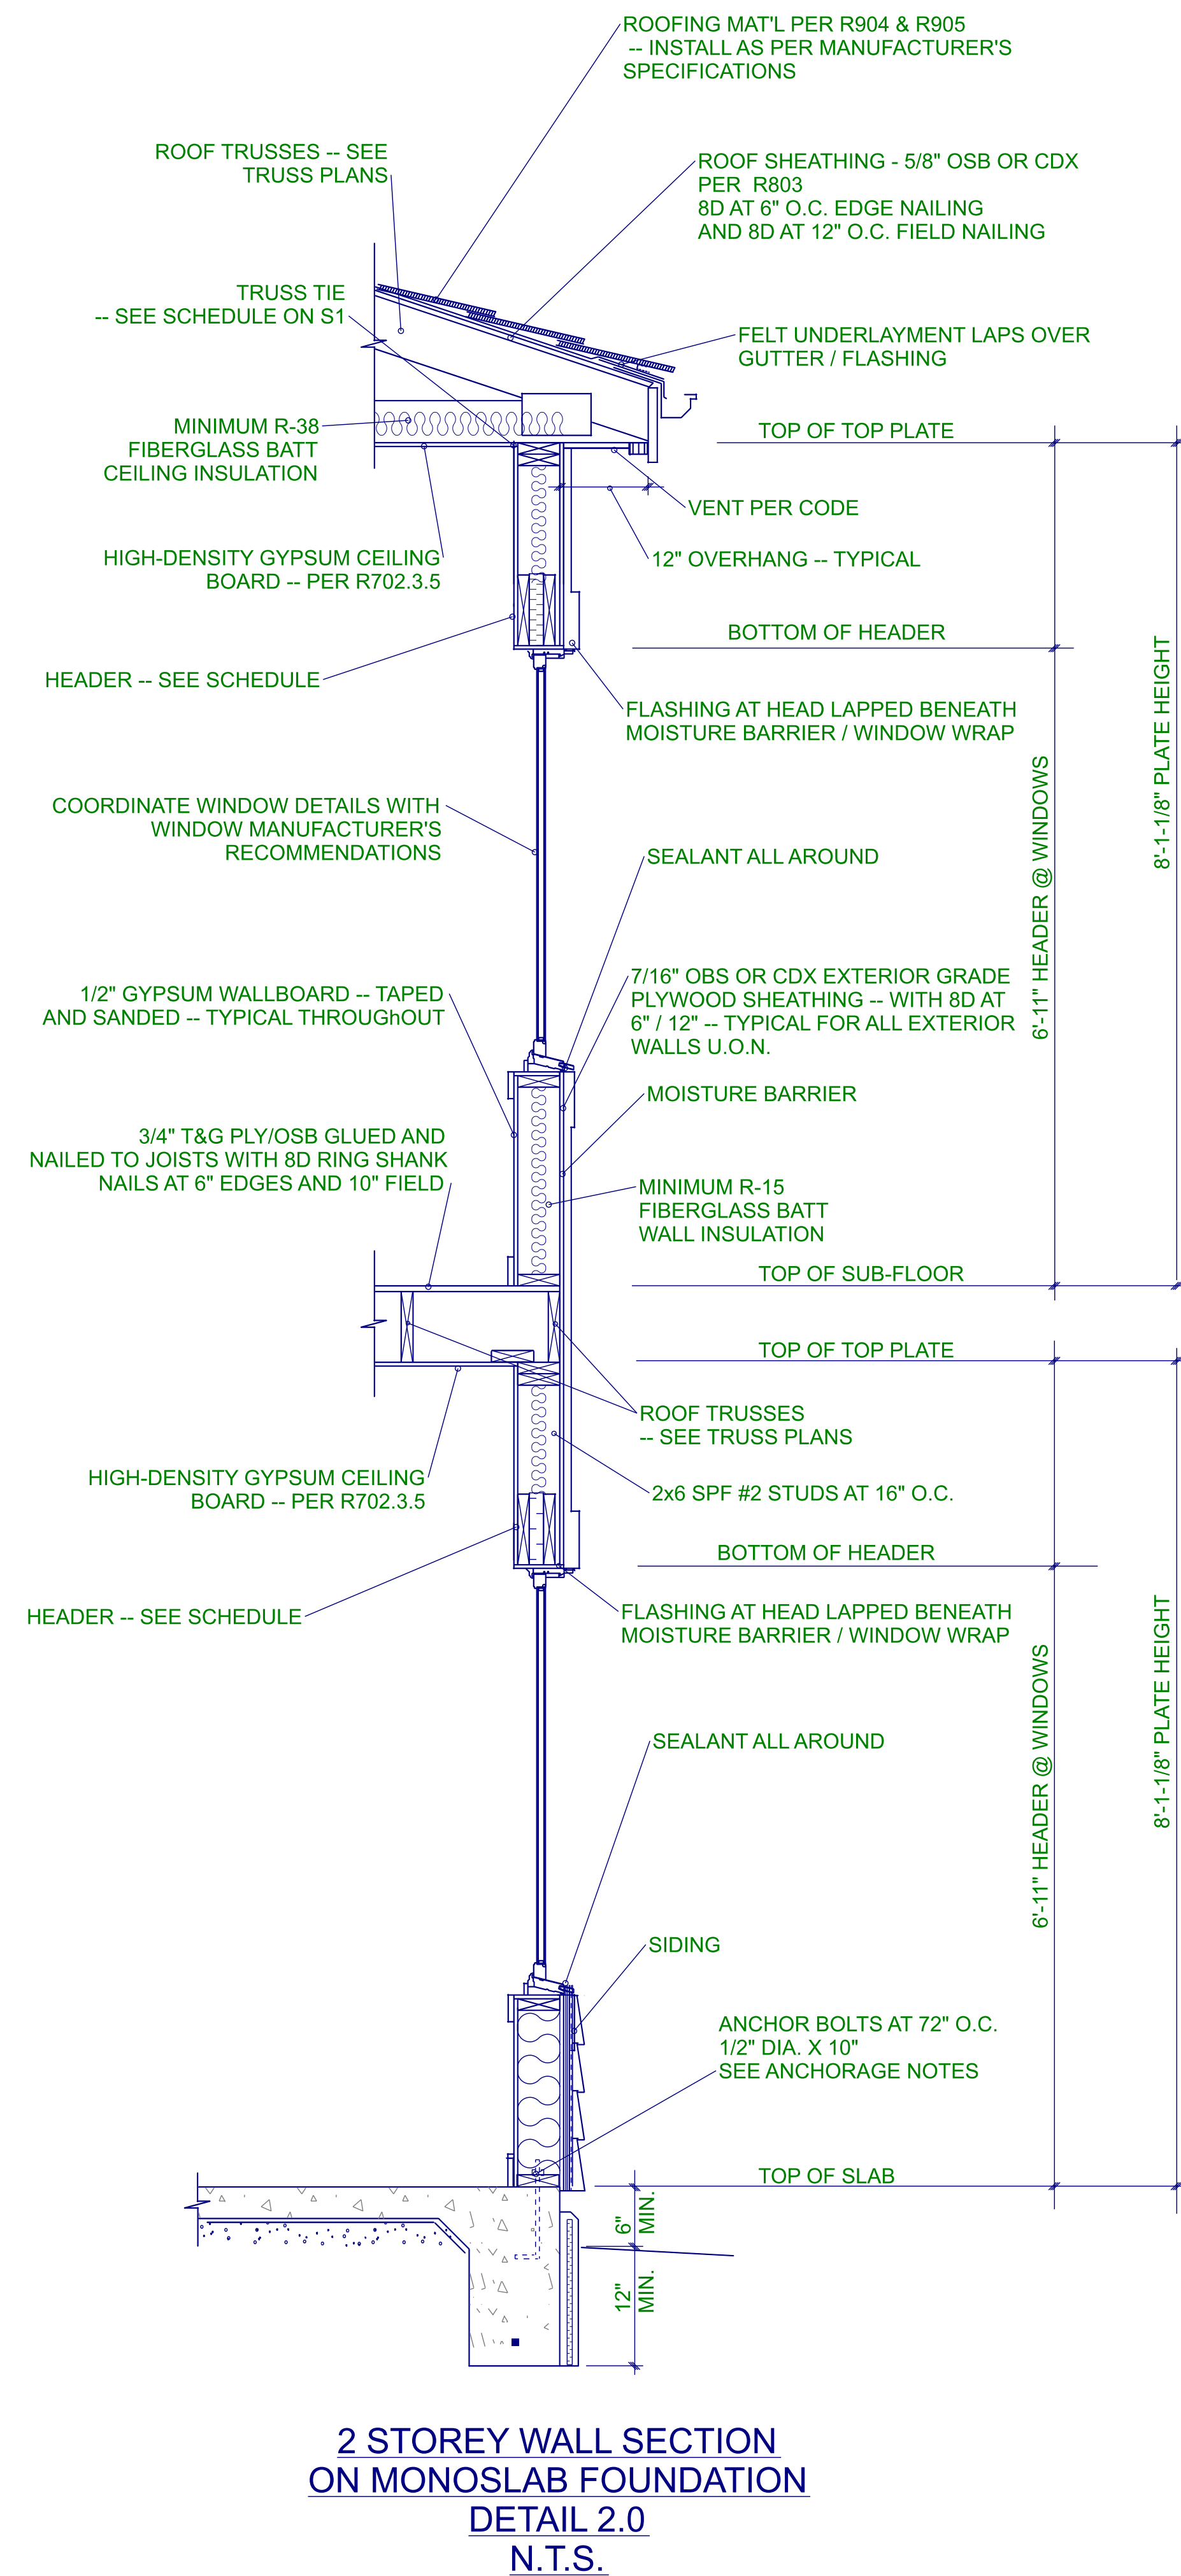

THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO MEET THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.
THIS DETAIL SHEET IS TO BE USED ONLY IN CONJUNCTION WITH PLANS CREATED BY RED DOOR HOMES.

MDL
ENGINEERING
SERVICES

213 Linton Banks Pl.
Cary, NC 27513
(919) 999-8153


RED DOOR HOMES
1209 US Business 70 West
Clayton, NC 27520
PROJECT: 109-25-109

DRAWN BY: ML
DATE: July 16, 2025
FILE: SD11462
REV: A


SCALE: 1/4 INCH = 1 FOOT

SHEET


S2

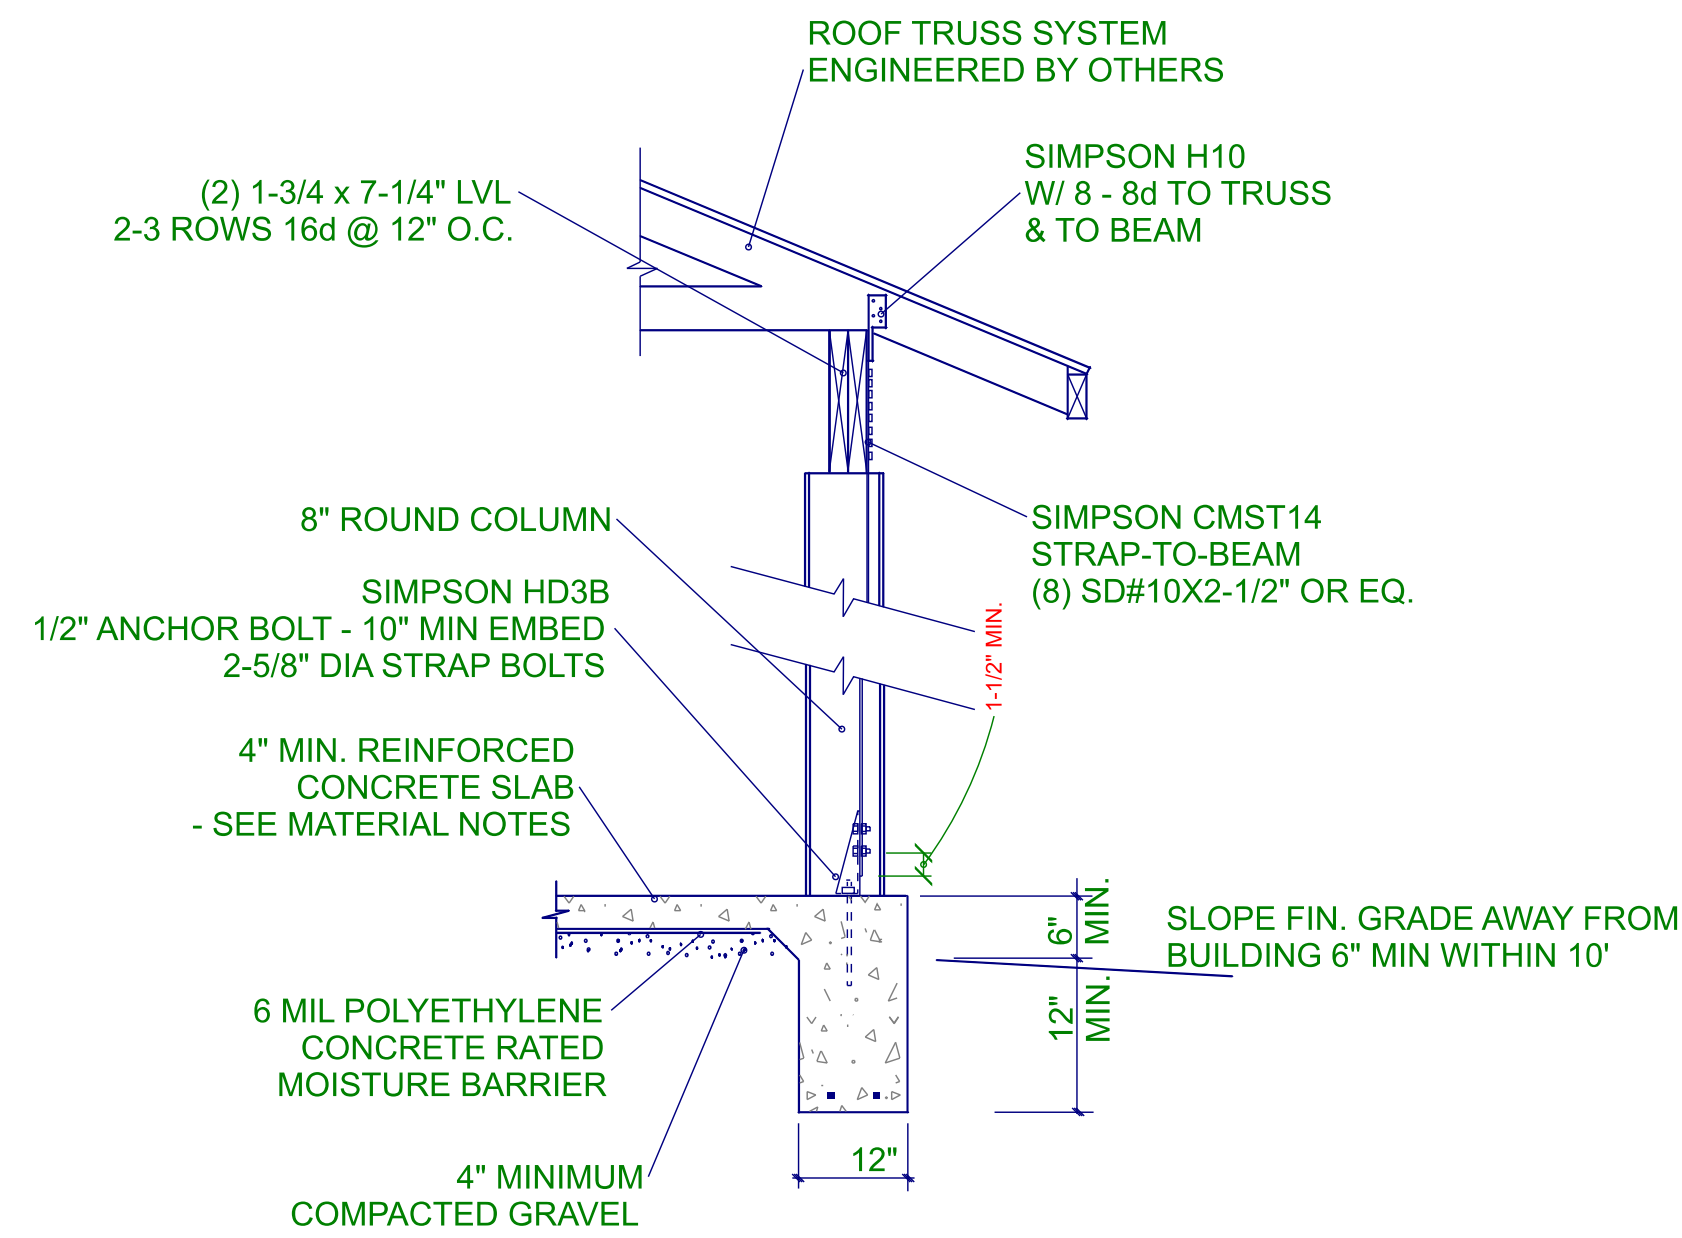


FRONT PORCH
PORCH FOOTING
POST AND BEAM CONNECTION
DETAIL 3.1
N.T.S.

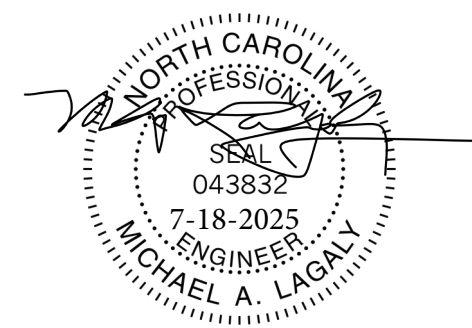

THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO MEET THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.
THIS DETAIL SHEET IS TO BE USED ONLY IN CONJUNCTION WITH PLANS CREATED BY RED DOOR HOMES.

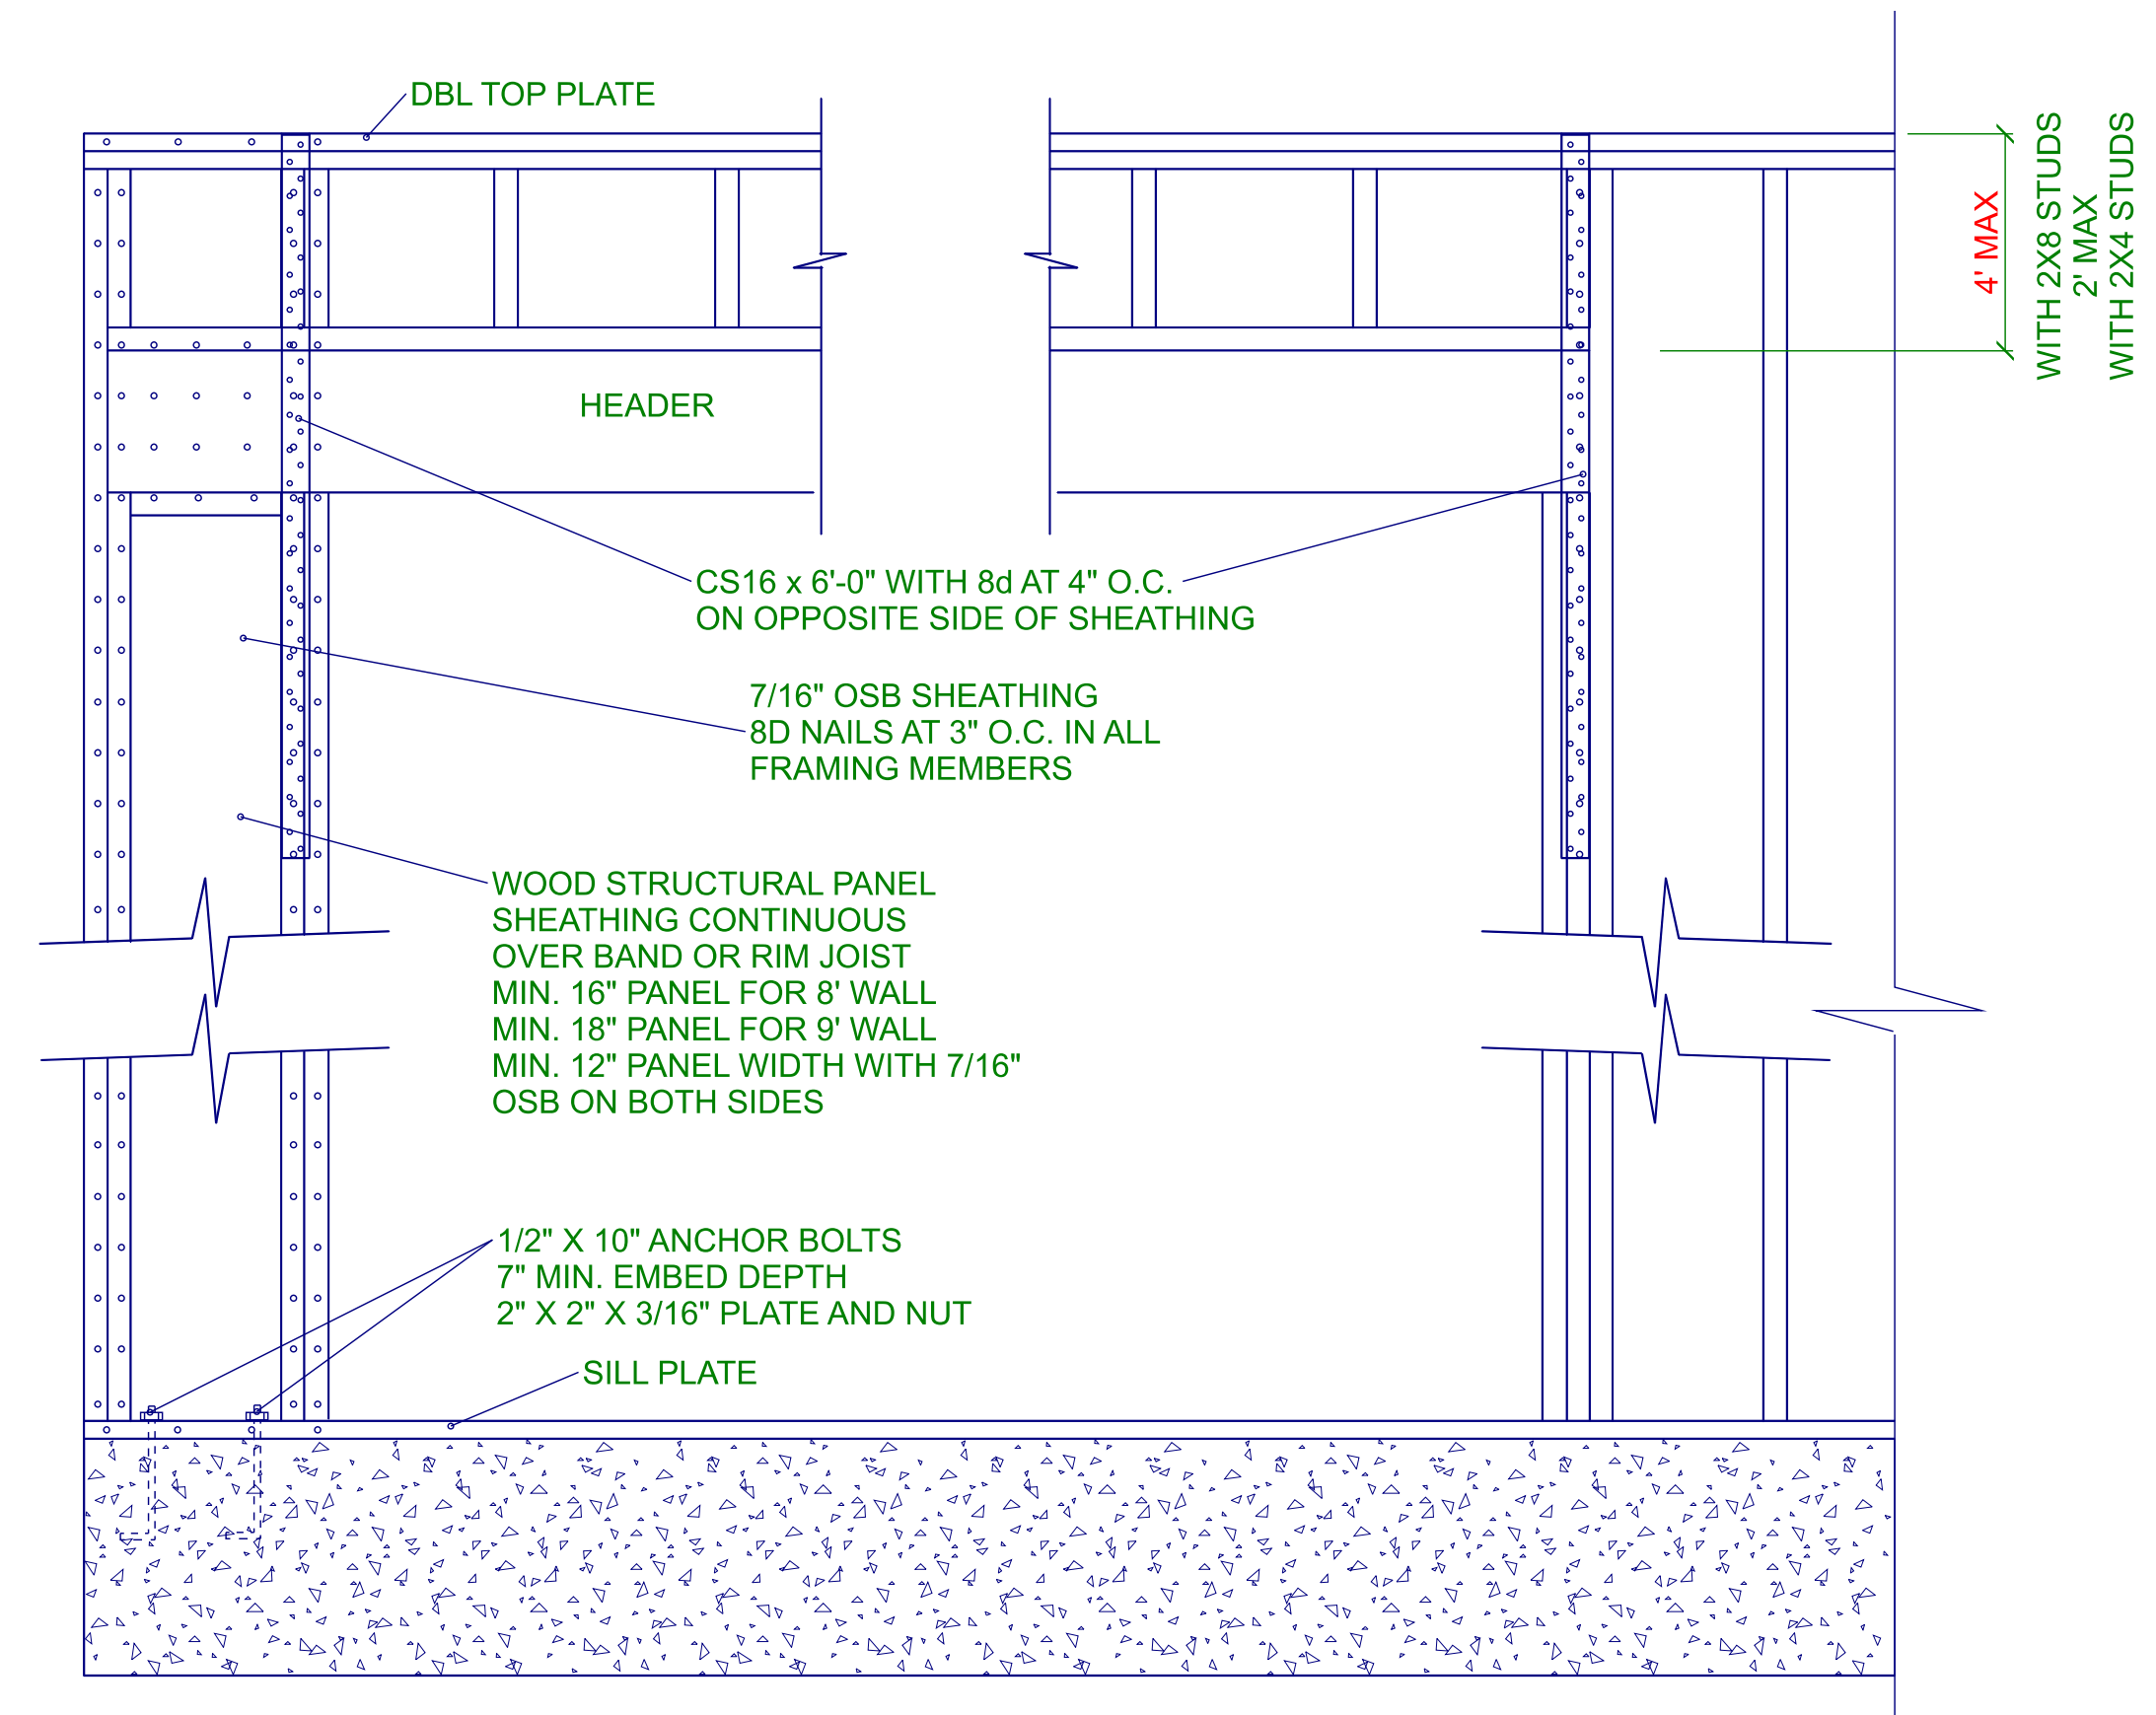

PORTAL FRAME AT WINDOW
DETAIL 3.2
PER R602.10.1
N.T.S.

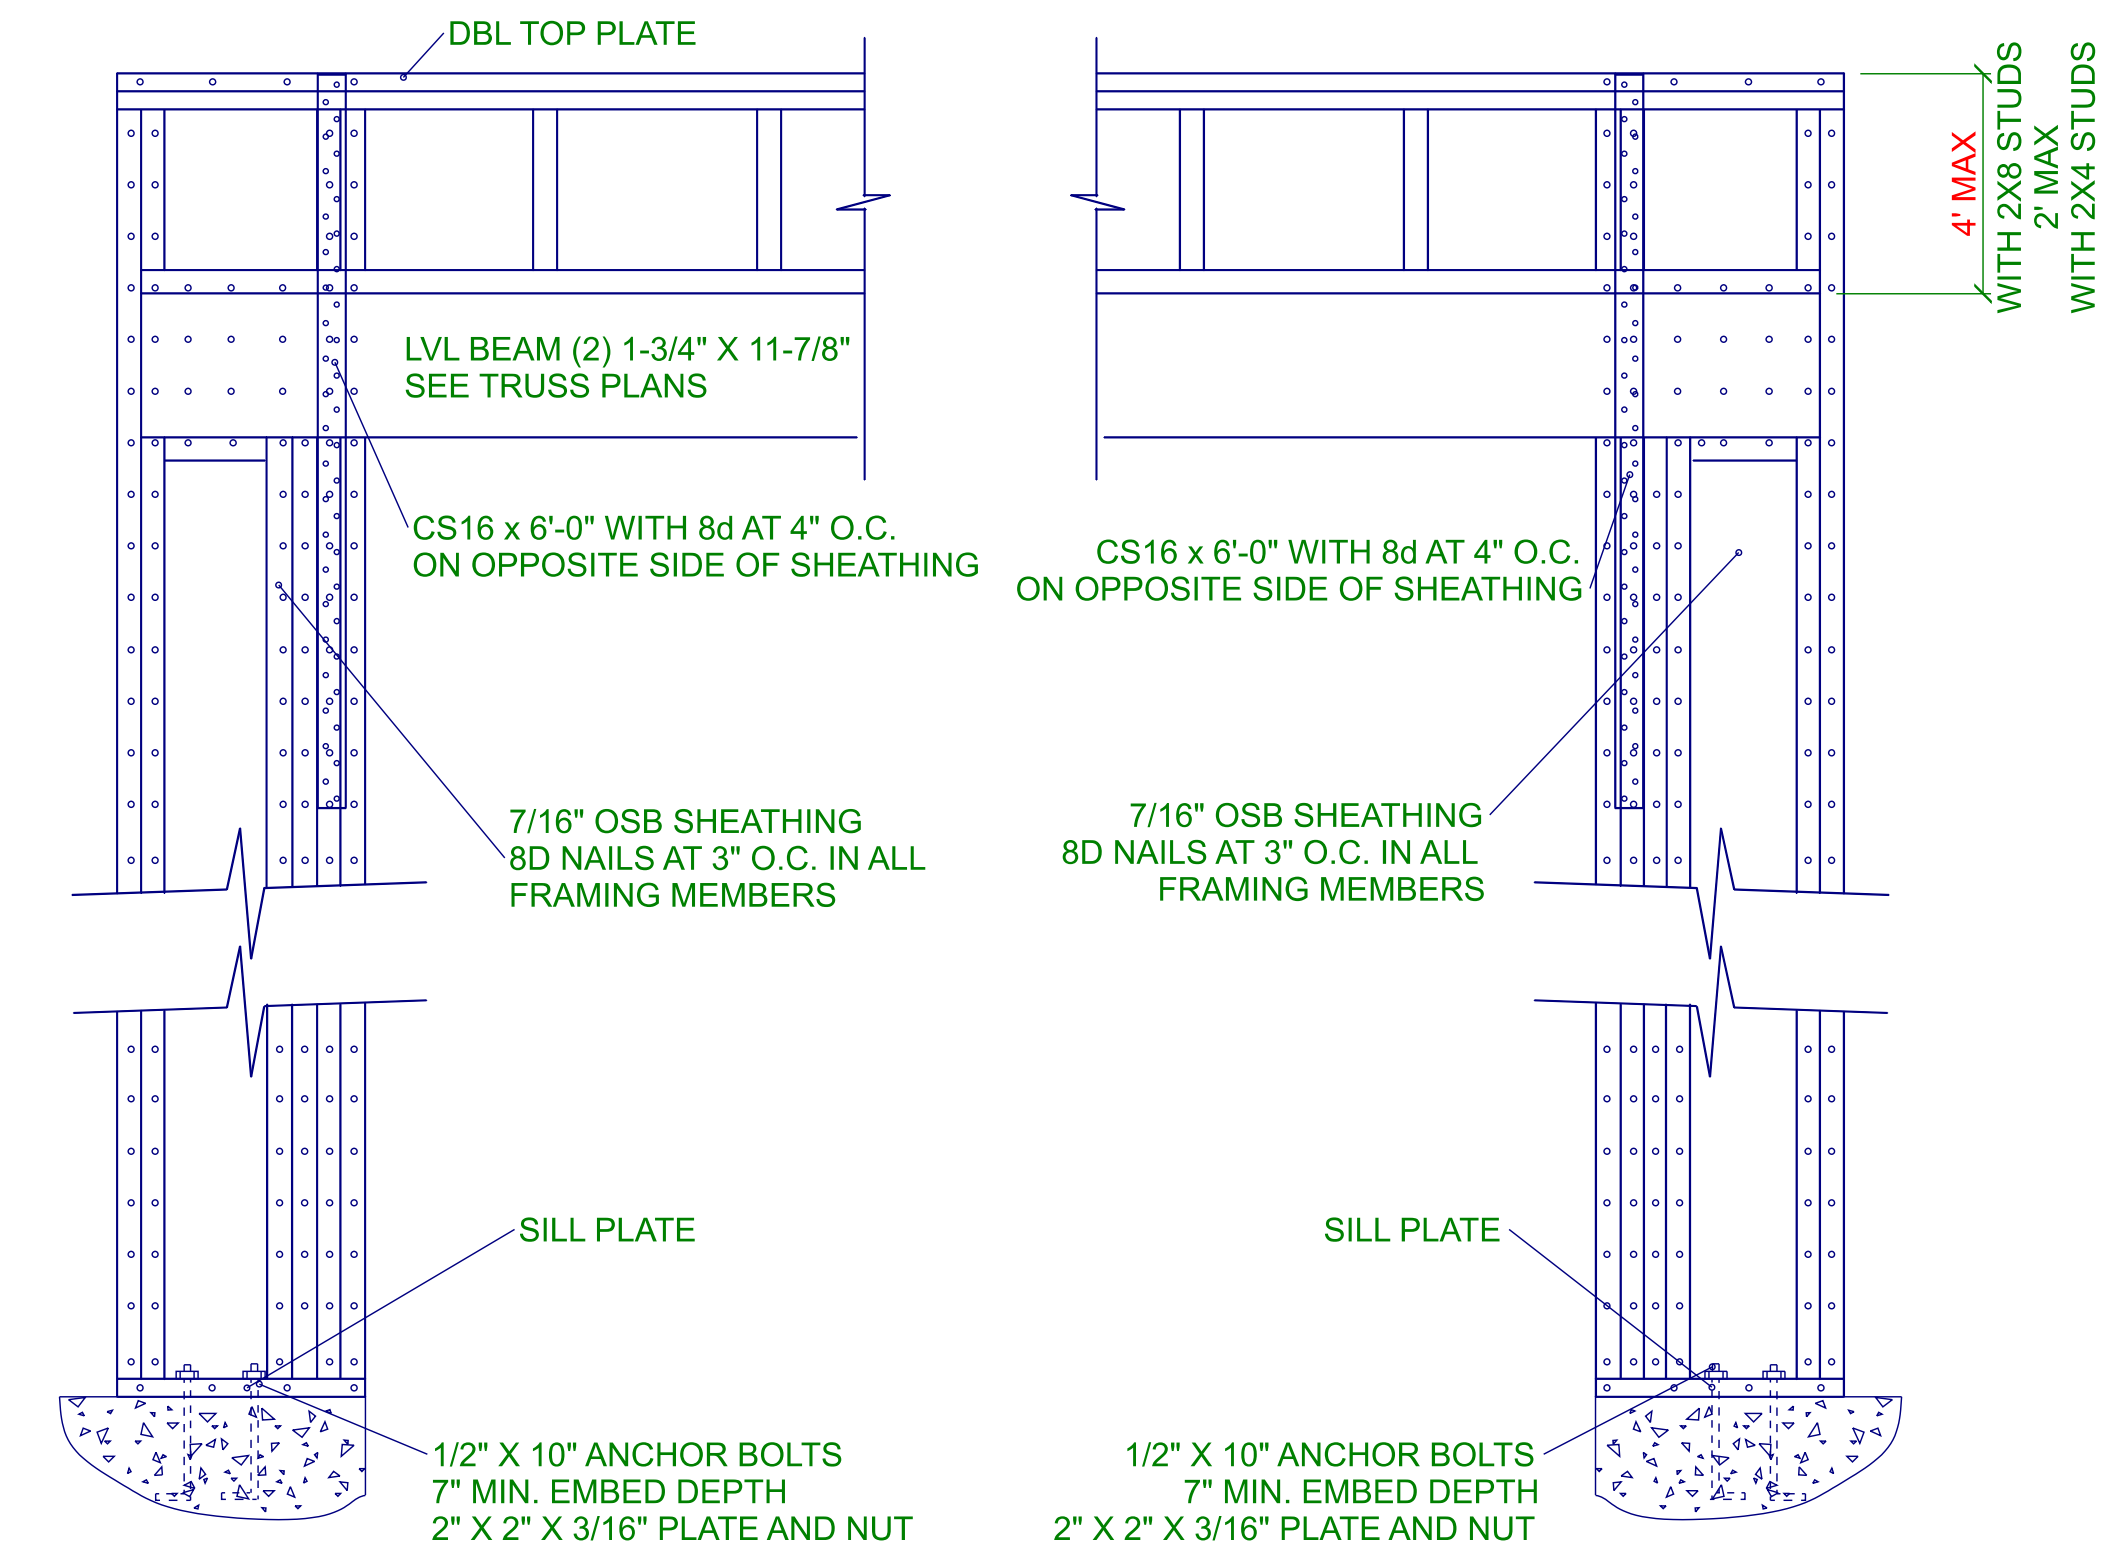

PORTAL FRAME AT GARAGE DOOR
PER R602.10.1
DETAIL 3.2
N.T.S.

MDL ENGINEERING SERVICES

213 Linton Banks Pl.
Cary, NC 27513
(919) 999-8153

RED DOOR HOMES
1209 US Business 70 West
Clayton, NC 27520
PROJECT: 109-25-109

DRAWN BY: ML
DATE: July 16, 2025
FILE: SD11462
REV: A

SCALE: 1/4 INCH = 1 FOOT

SHEET

S3



Marshall Naylor

CITY / CO.	Cameron / Harnett
ADDRESS	McKoy Town Rd.
MODEL	Floor
DATE REV.	05/05/25
DRAWN BY	Marshall Naylor
SALES REP.	Marshall Naylor

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general questions regarding bracing, consult BCSS-B1 and BCSS-B3 provided with the truss delivery package or online @ sbcindustry.com



 = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature
Marshall Naylor

LOAD CHART FOR JACK STUDS


(BASED ON TABLES R502.5(1) & (b))
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/GIRDER

END REACTION (UP TO)	REQ'D STUDS FOR (1) PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (3) PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (4) PLY HEADER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

COUNTY	Harnett
ADDRESS	McKoy Town Rd.
MODEL	Roof
DATE REV.	05/05/25
DRAWN BY	Marshall Naylor
SALESMAN	Marshall Naylor

BUILDER	Red Door Homes
JOB NAME	109-25-109 Henderson
PLAN	Westover 2' Cantilever (NP)
SEAL DATE	N/A
QUOTE #	
JOB #	J0525-2437

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

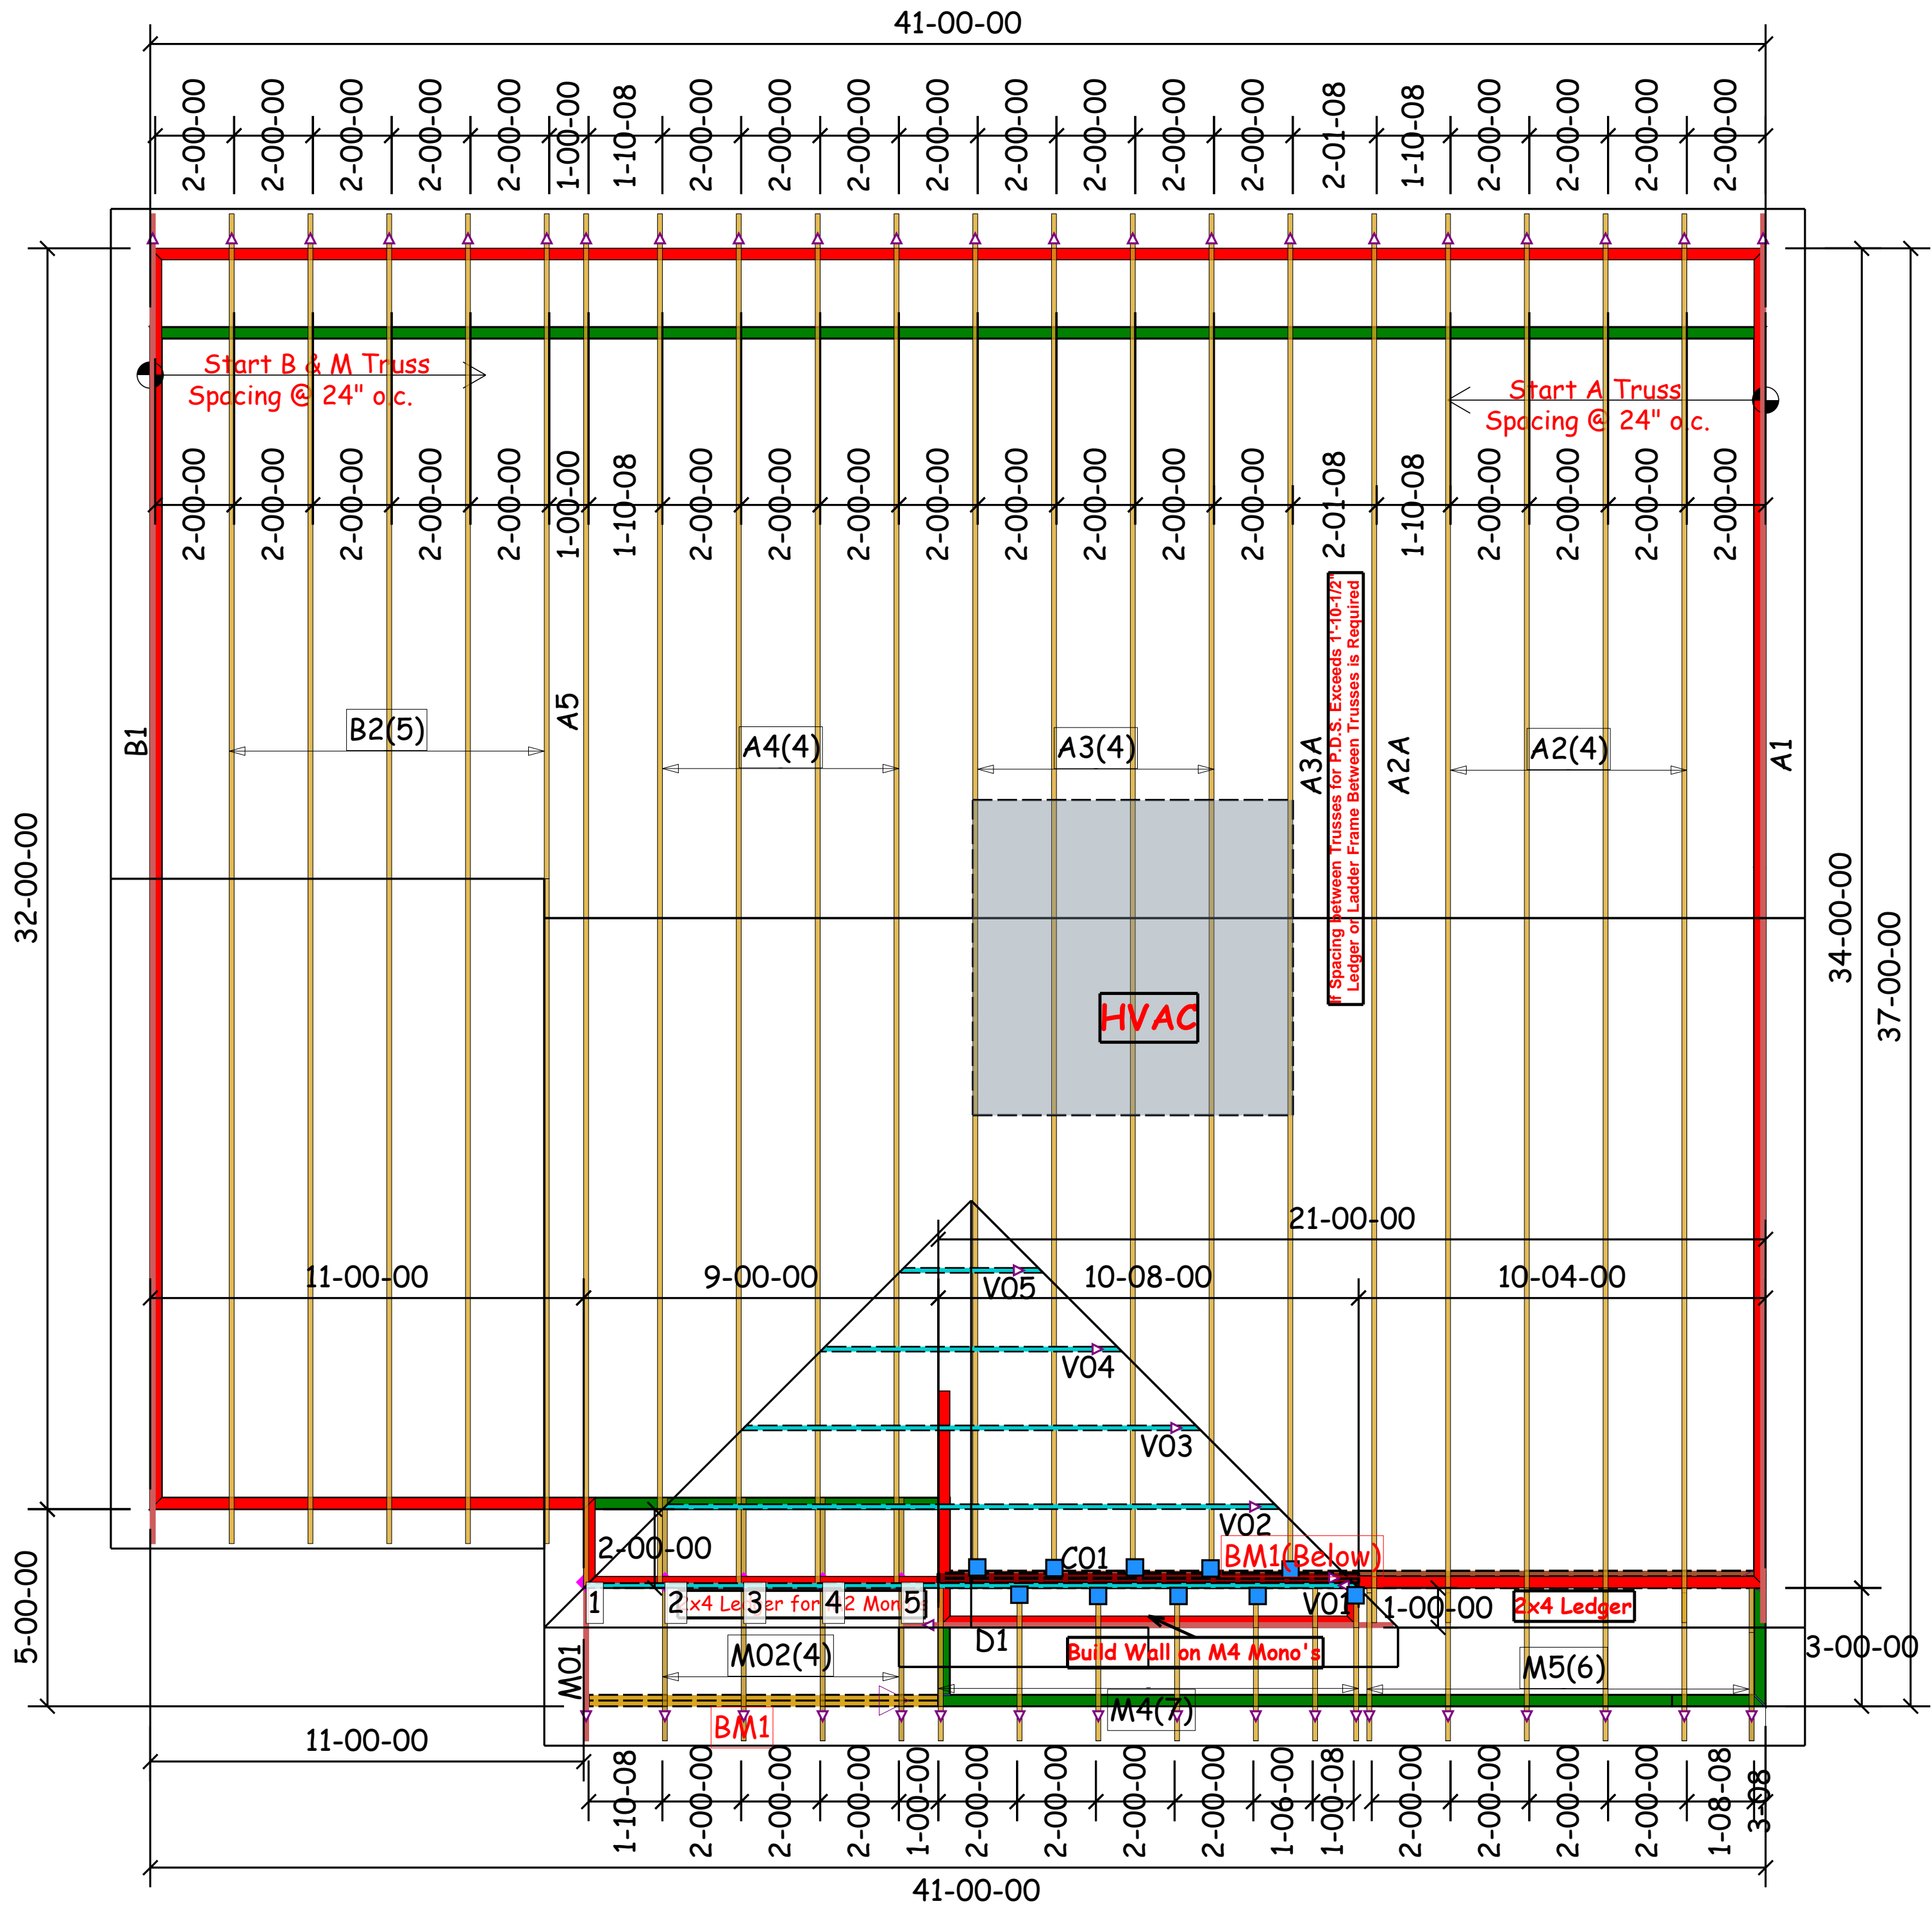

HUS26	USP	10	NA	16d/3-1/2"	16d/3-1/2"
-------	-----	----	----	------------	------------

■ = 1st Level Wall

■ = 2nd Level Wall

▲ = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

Truss Placement Plan
SCALE: NTS