

# Harnett County Department of Public Health

PERMIT # 5FD 2506-0148

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 6322 US 401 N Fugrey varina

Name: (owner) McCann & Sons Builders INC SUBDIVISION \_\_\_\_\_

LOT # \_\_\_\_\_

System Installer: Elite Site & Septic

Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet


System Type: 25% Reduction Type III(b) 3-Chamber Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

o needs pump + alarm for float

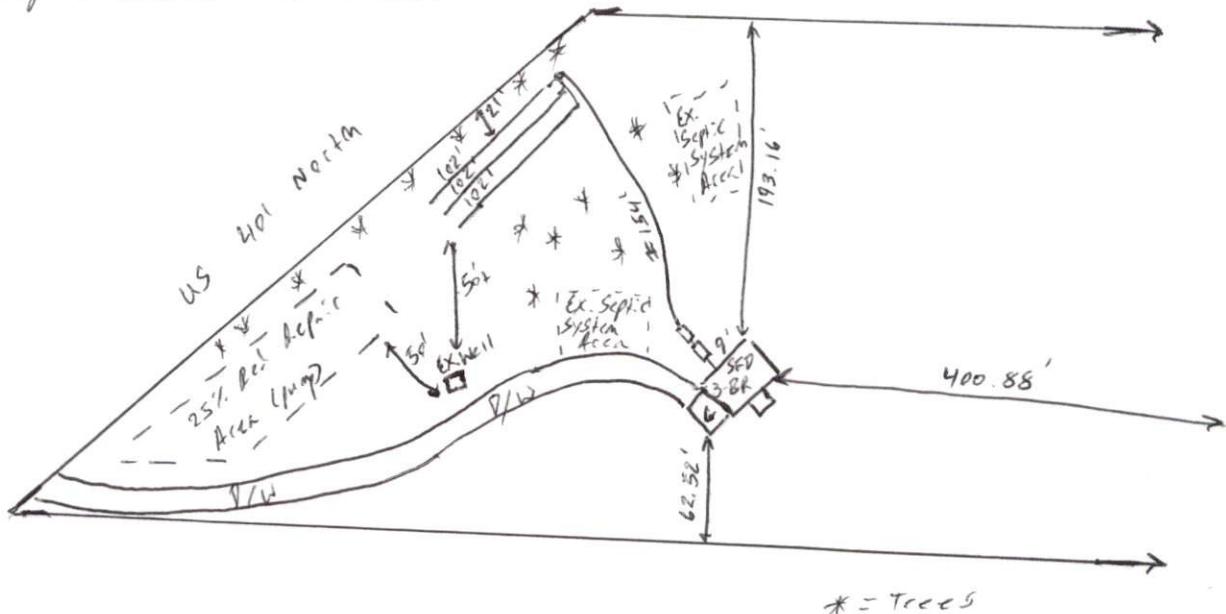

### PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2OLine  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Type III(b) 3-Chamber Septic Tank: 1,000 gallons Pump Tank: 1,000 gallons

Subsurface No. of exact length width of depth of ditches \_\_\_\_\_ of each ditch \_\_\_\_\_ feet ditches \_\_\_\_\_ feet ditches \_\_\_\_\_ inches

Drainage Field ditches 3 of each ditch 102' feet width of ditches 3' feet depth of ditches 21-25" inches

French Drain Required: Linear feet

Authorized State Agent \_\_\_\_\_

REMS

Date 11/20/25