

Harnett County Department of Public Health

PERMIT # SFD 2507-0050

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 174 Harriette Cr (NC 27)

Name: (owner) Clayton Properties Group

SUBDIVISION Leander Lee Preserve

LOT # 65

System Installer: DBS


Basement with plumbing: Garage Number of Bedrooms 3 (6 people)

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Type III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

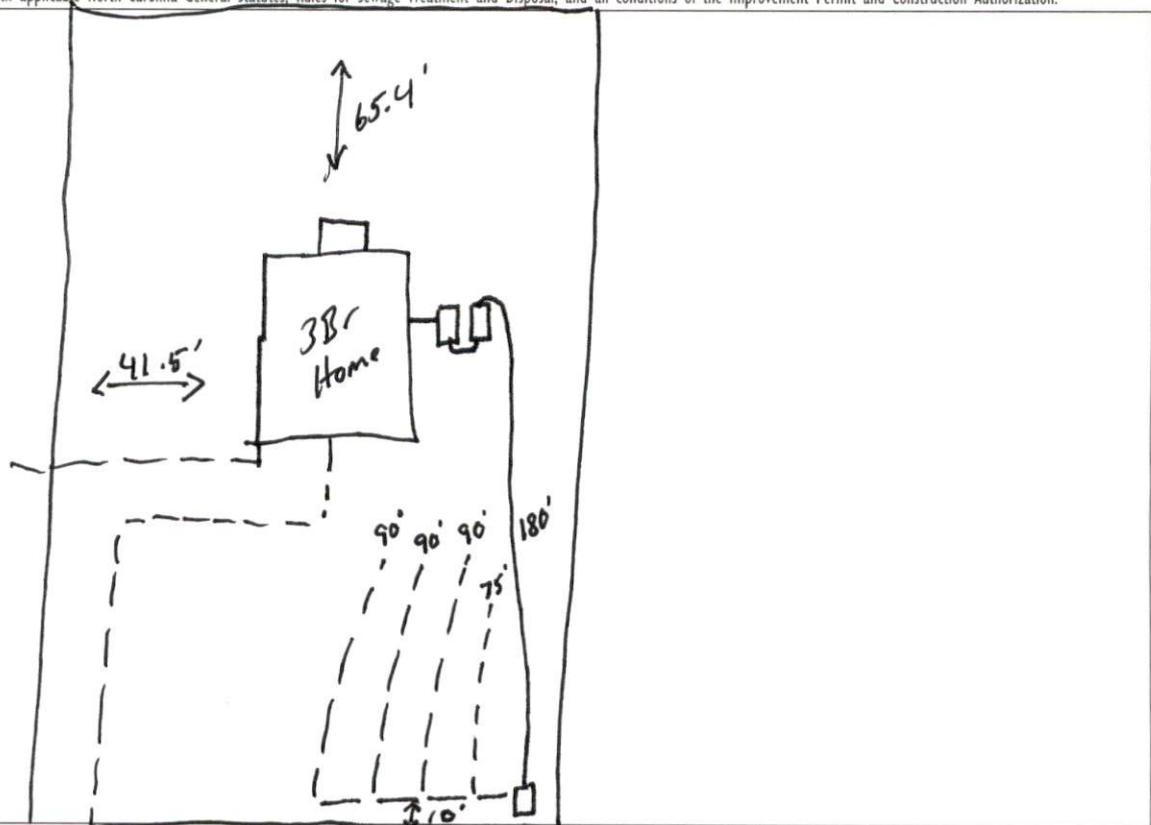

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Manifold D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:	<input type="checkbox"/> Conventional	<input checked="" type="checkbox"/> Other <u>25% reduction</u>	<u>104</u>	Septic Tank: <u>1000</u> gallons	Pump Tank: <u>1000</u> gallons
Subsurface	No. of	exact length		width of	depth of
Drainage Field	ditches <u>1</u>	of each ditch <u>345</u> feet		ditches <u>3</u> feet	ditches <u>18</u> inches
French Drain Required:		Linear feet			

Authorized State Agent _____

Date 11-24-25