


RALEIGH - LOT 00.0029 THE FARM AT NEILL'S CREEK

ELEVATION 4.1 - GR


LOT SPECIFIC

[illegible][illegible][illegible]

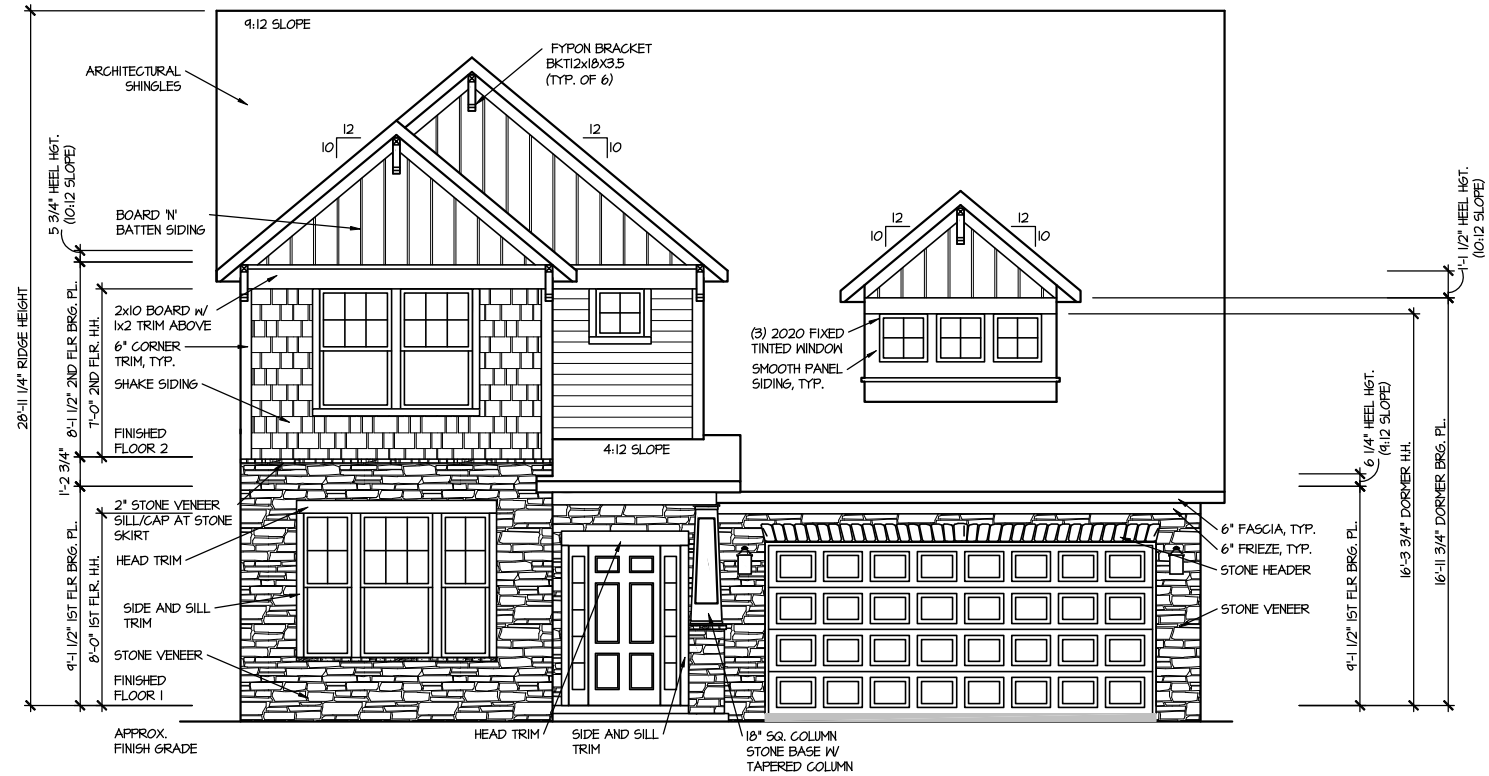

FRONT ELEVATION 4.1

SCALE: 1/8" = 1'-0"

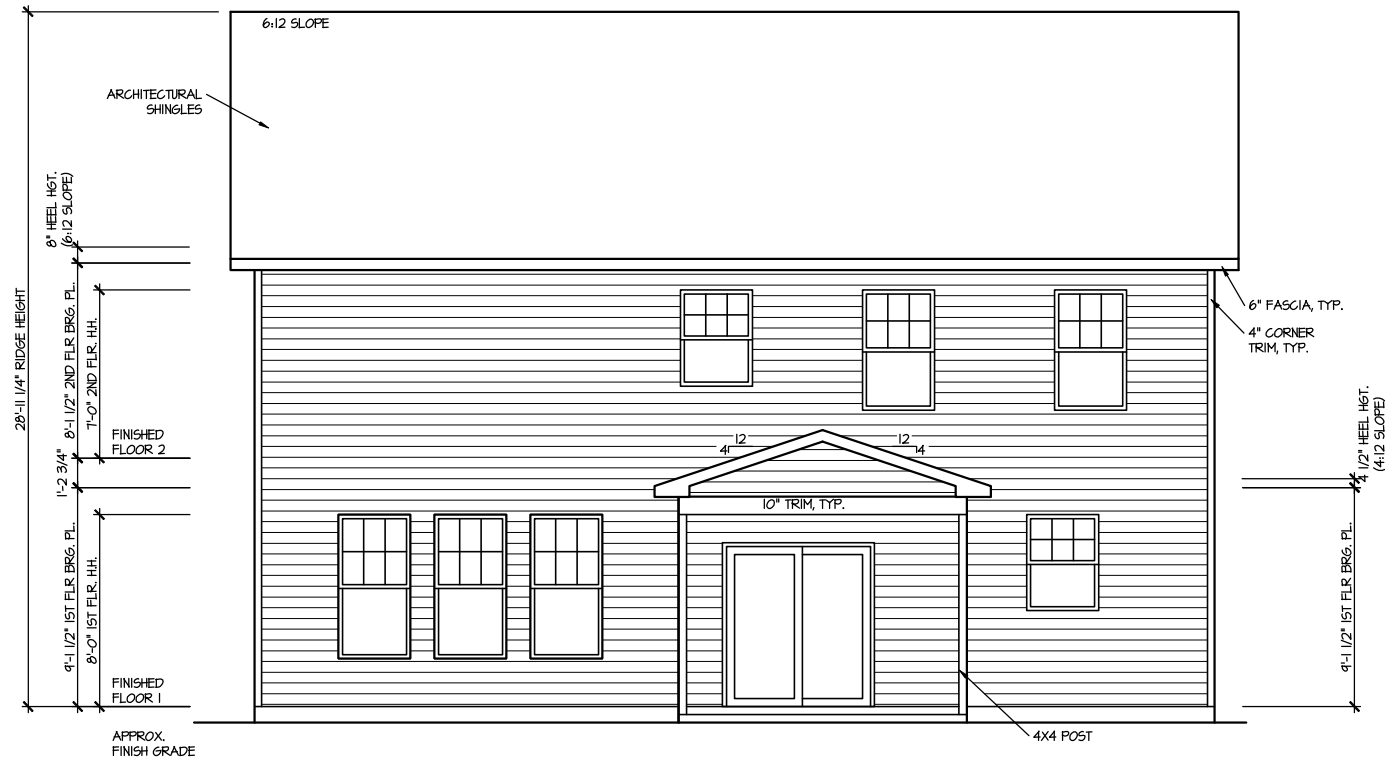

REAR ELEVATION 4.1

SCALE: 1/8" = 1'-0"

MASTER PLAN INFORMATION

DRAWN BY:
ITS

DATE:
07/11/2025

PLAN NO.
2695

REVISION
2-RALE

DATE
03-06-2019

UPDATED DATE
04-26-2024

DRB
HOMES


HOUSE NAME:
DRAYTON

DRAWING TITLE

FRONT & REAR ELEVATIONS


SHEET No.

A.1

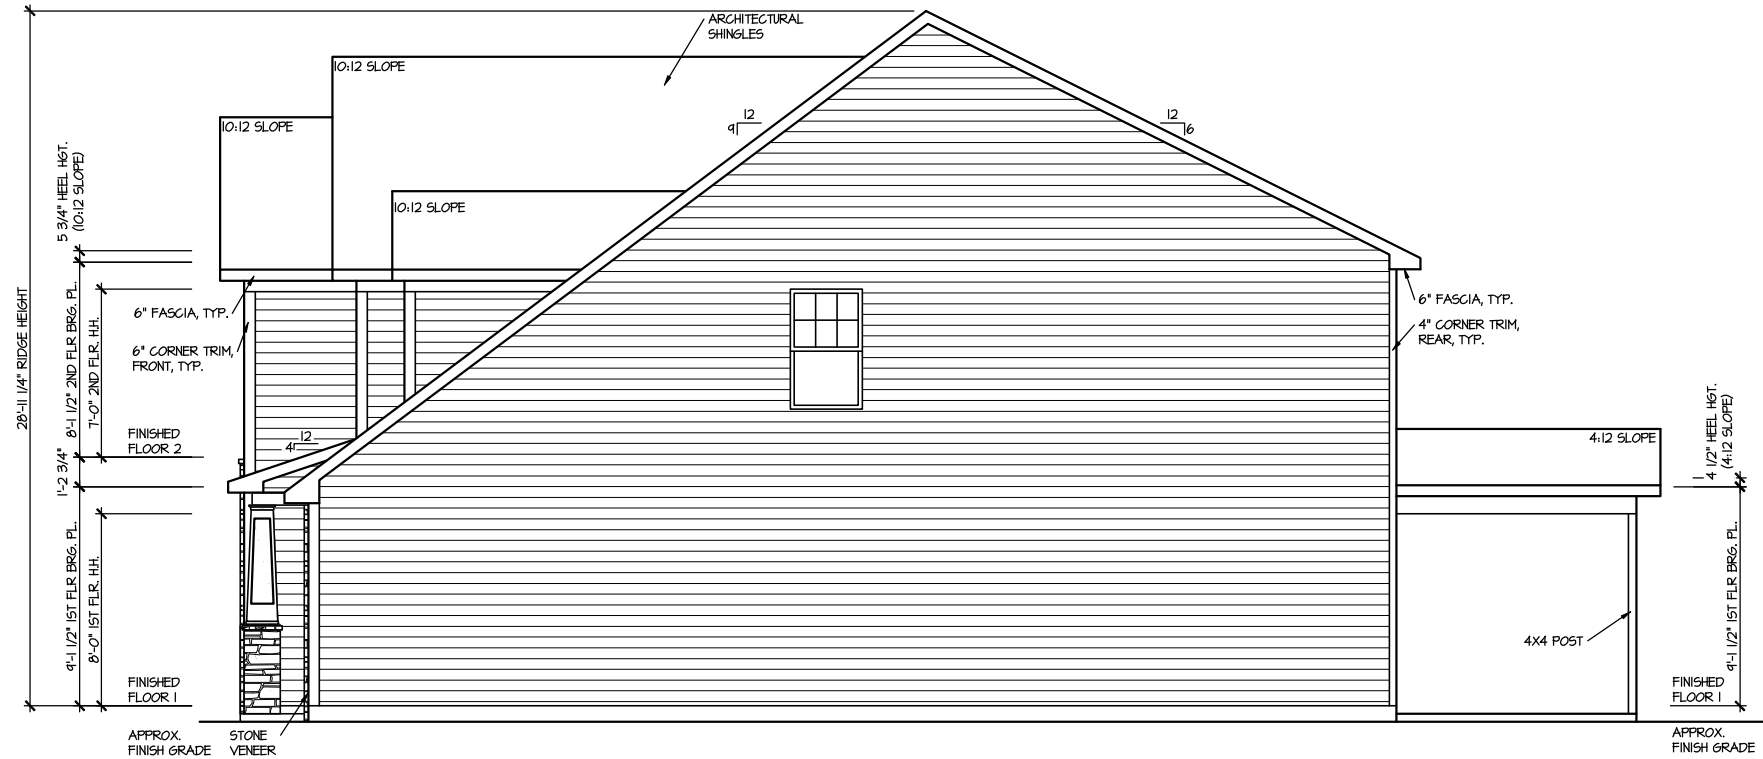

RIGHT ELEVATION 4.1

SCALE: 1/8" = 1'-0"

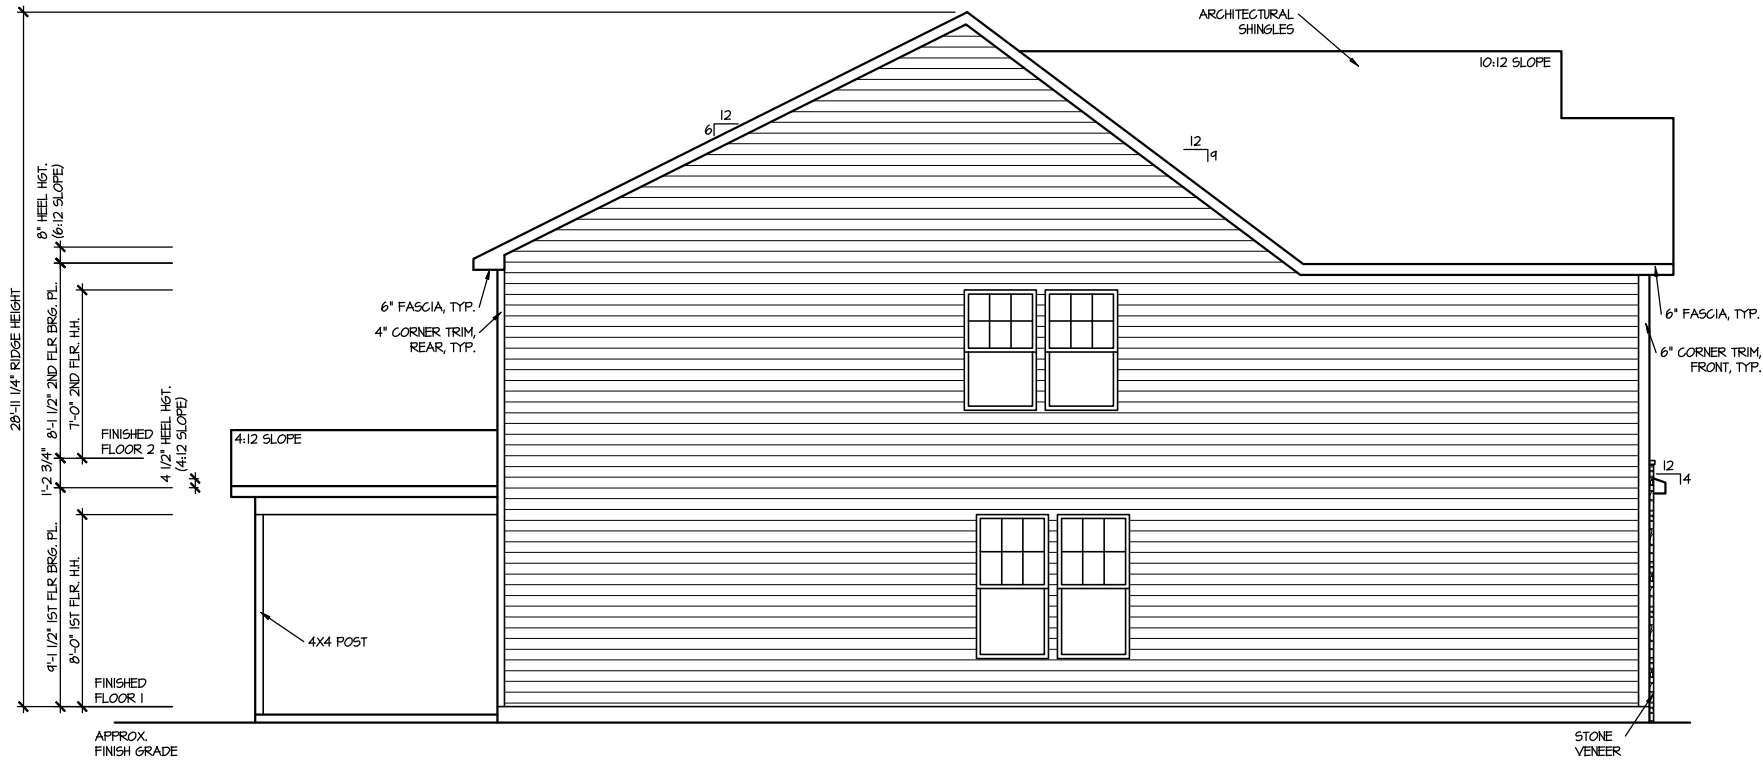

LEFT ELEVATION 4.1

SCALE: 1/8" = 1'-0"

MASTER PLAN INFORMATION			UPDATED DATE
REVISION	DATE		
2-RALE	03-06-2019		04-26-2024

DRAWN BY:	ITS
DATE:	07/11/2025
PLAN NO.	2695


DRB
HOMES

HOUSE NAME:	DRAYTON
DRAWING TITLE	RIGHT & LEFT ELEVATIONS

SHEET No.
A.2

ROOF AREA 1836 SQ. FT.
OVERALL REQUIRED VENTILATION:
 1 TO 150 = 12.24 SQ. FT.
 1 TO 300 = 6.12 SQ. FT.
 50-80% IN TOP THIRD = 3.06- 4.90 FT. (1 TO 300)
 NET FREE AREA OF VENTED SOFFIT = 5.7 SQ. IN / LINEAR FT.
 NET FREE AREA OF RIDGE VENT = 18 SQ. IN / LINEAR FT.

LOWER VENTING: (BOTTOM 2/3 RDS)
77 LINEAR FEET OF SOFFIT X 5.7 SQ. IN. = 3.05 SQ. FT.
UPPER VENTING: (TOP 1/3 RD)
26 LINEAR FEET OF RIDGE X 18 SQ. IN. = 3.25 SQ. FT.
3.25 SQ. FT. BETWEEN 50% - 80%
(1 TO 300 ALLOWED)
TOTAL ROOF VENTILATION: 6.30 SQ. FT. > 6.12 SQ. FT. (REQ'D)

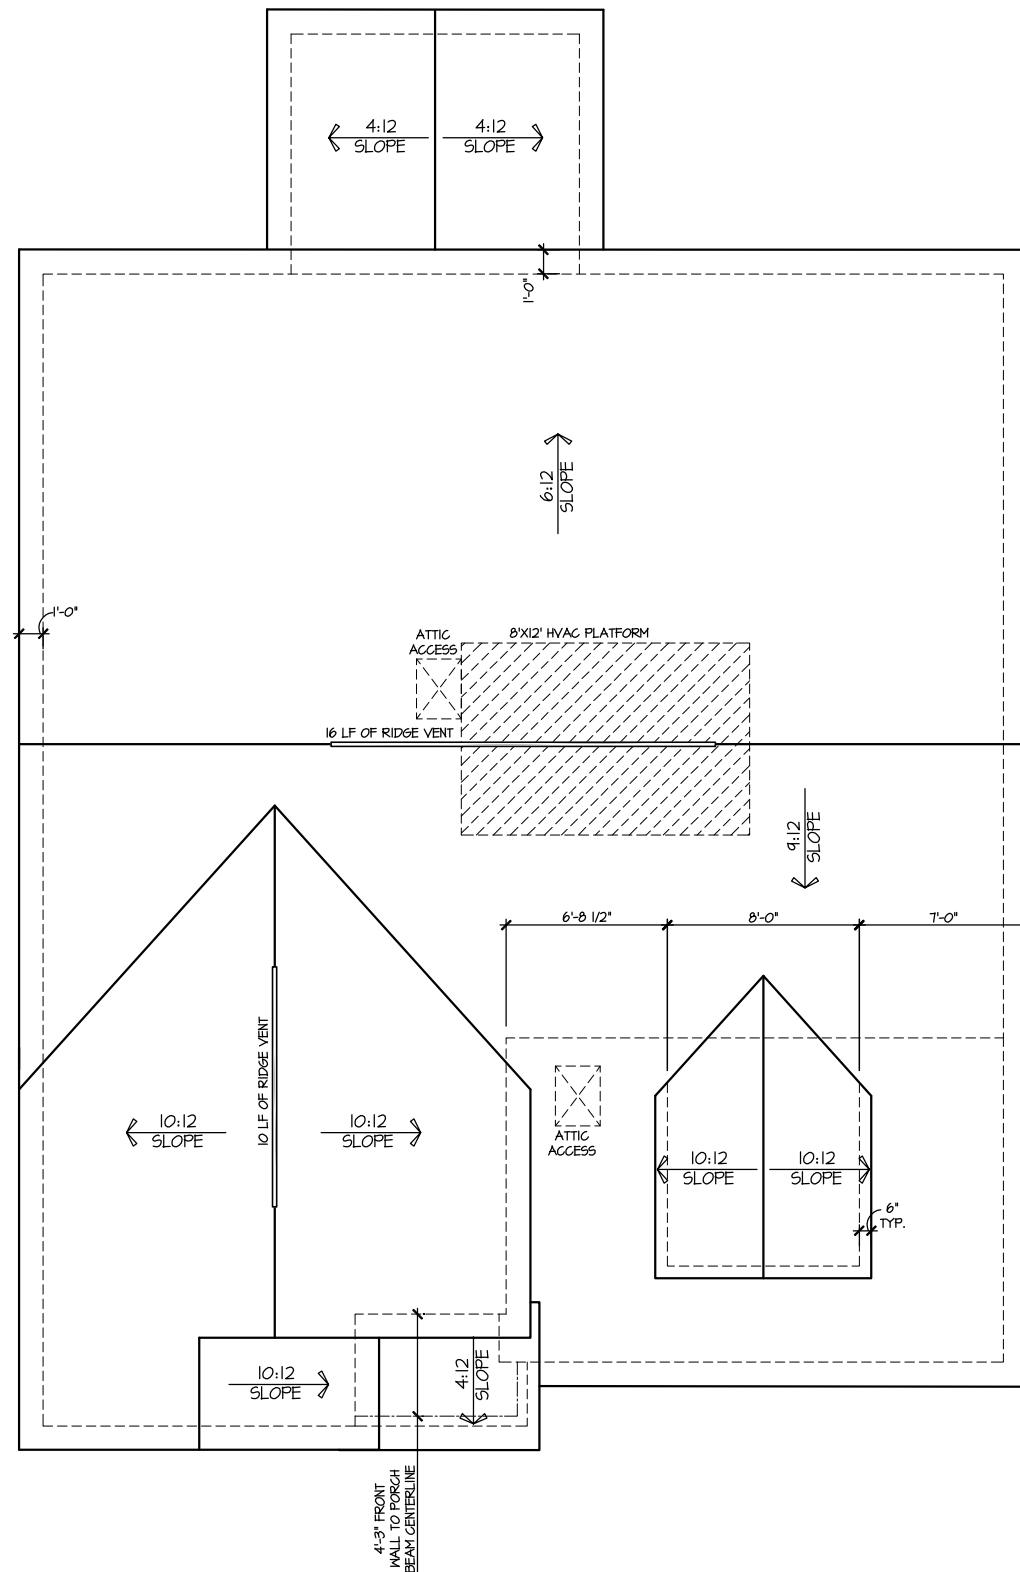

SCALE: 1/8" = 1'-0"

[illegible]


DRAWN BY:	ITS
DATE:	07/11/2025
PLAN NO.	2695



DRM
HOMES

HOUSE NAME:	DRAYTON
DRAWING TITLE	ROOF PLAN

SHEET No.
A | 3

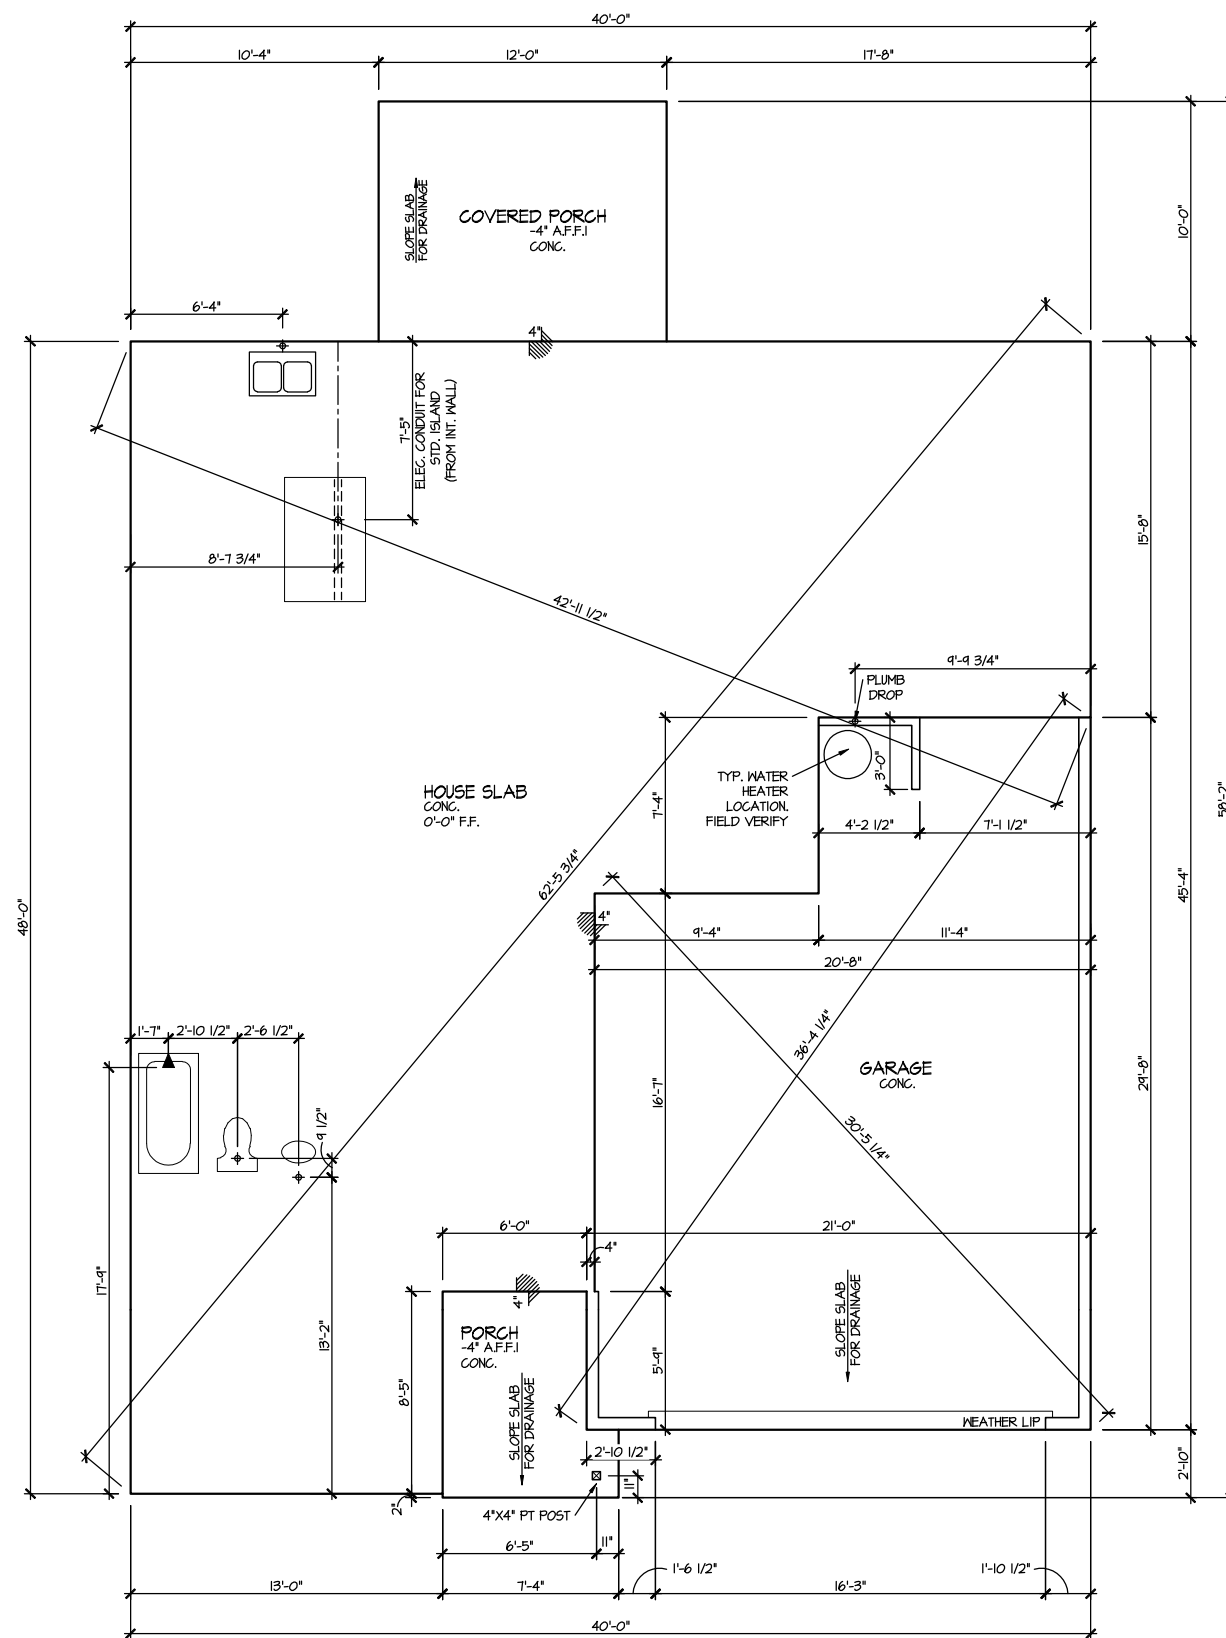

ELEVATION 4.1
SLAB PLAN
SCALE: 1/8" = 1'-0"

MASTER PLAN INFORMATION		
REVISION	DATE	UPDATED DATE
2 - RALE	03-06-2019	04-26-2024


DRAWN BY:	ITS
DATE:	07/11/2025
PLAN NO.	2695



HOUSE NAME:
DRAYTON

DRAWING TITLE
SLAB PLAN

SHEET No.
A2.1

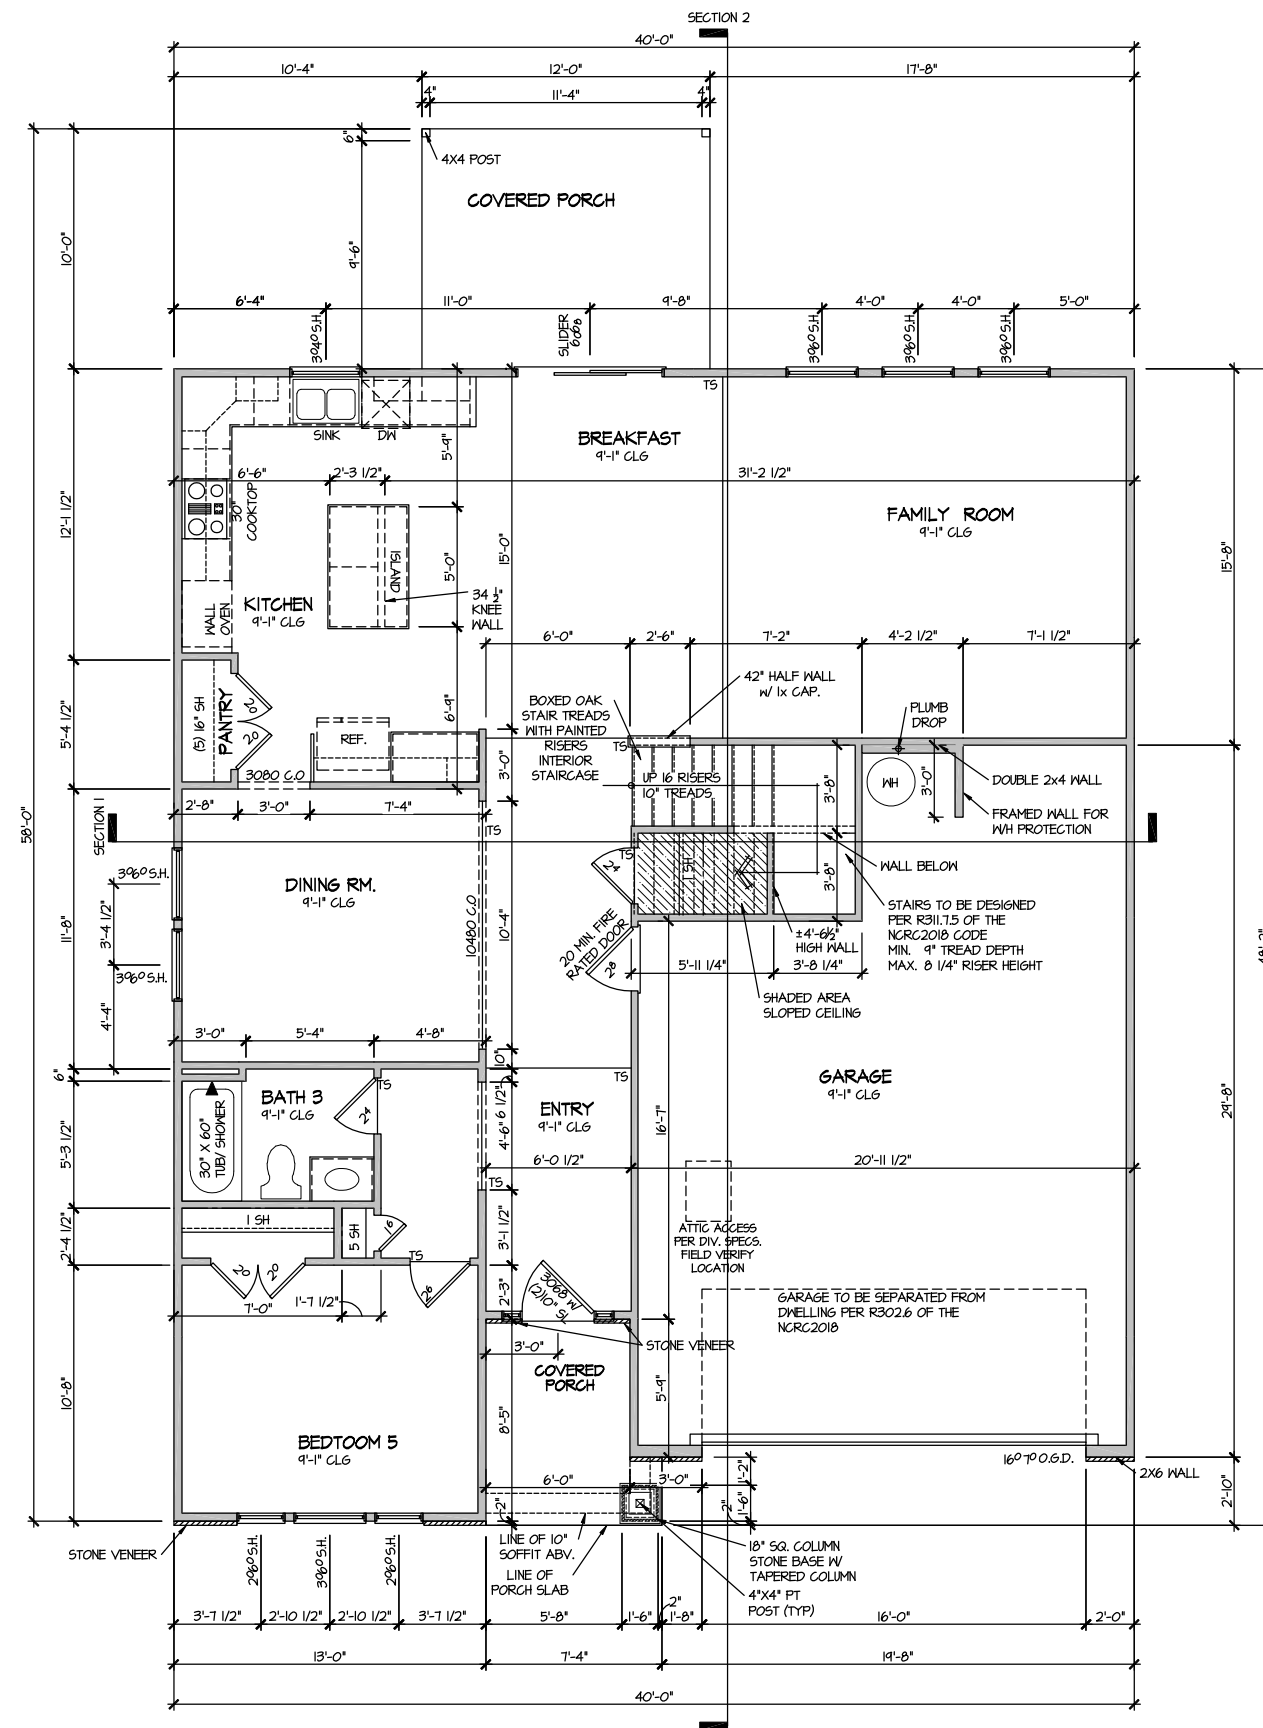

ELEVATION 4.1
FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"

[illegible]


DRAWN BY: ITS
DATE: 07/11/2025
PLAN NO. 2695



HOUSE NAME: **DRAYTON**

DRAWING TITLE **FIRST FLOOR PLAN**

SHEET No. A3.

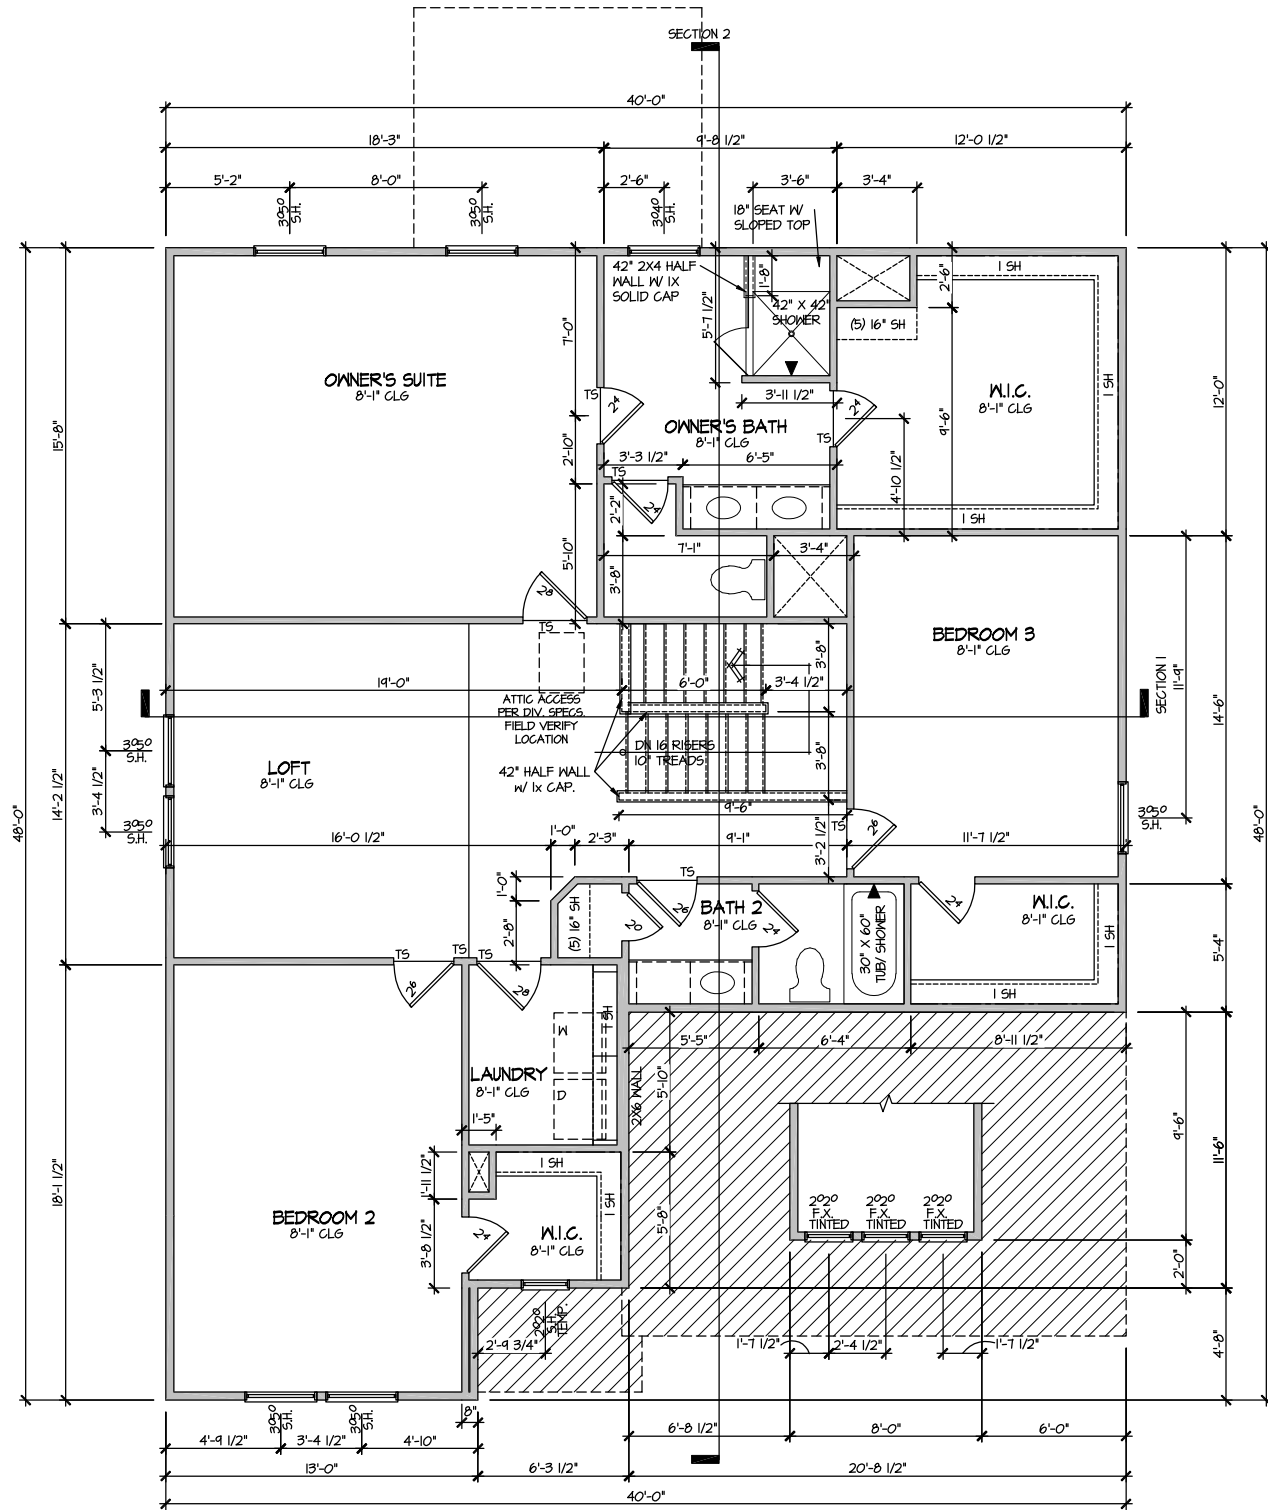

ELEVATION 4.1
SECOND FLOOR PLAN
SCALE: 1/8" = 1'-0"

MASTER PLAN INFORMATION			UPDATED DATE
REVISION	DATE		
2-RALE	03-06-2019		04-26-2024


DRAWN BY:	ITS
DATE:	07/11/2025
PLAN NO.	2695



HOUSE NAME:	DRAYTON
DRAWING TITLE	SECOND FLOOR PLAN


SHEET No.	A3.2
-----------	------

FILE: Lot 00.0029.dwg DATE: 7/11/2025 10:23 AM

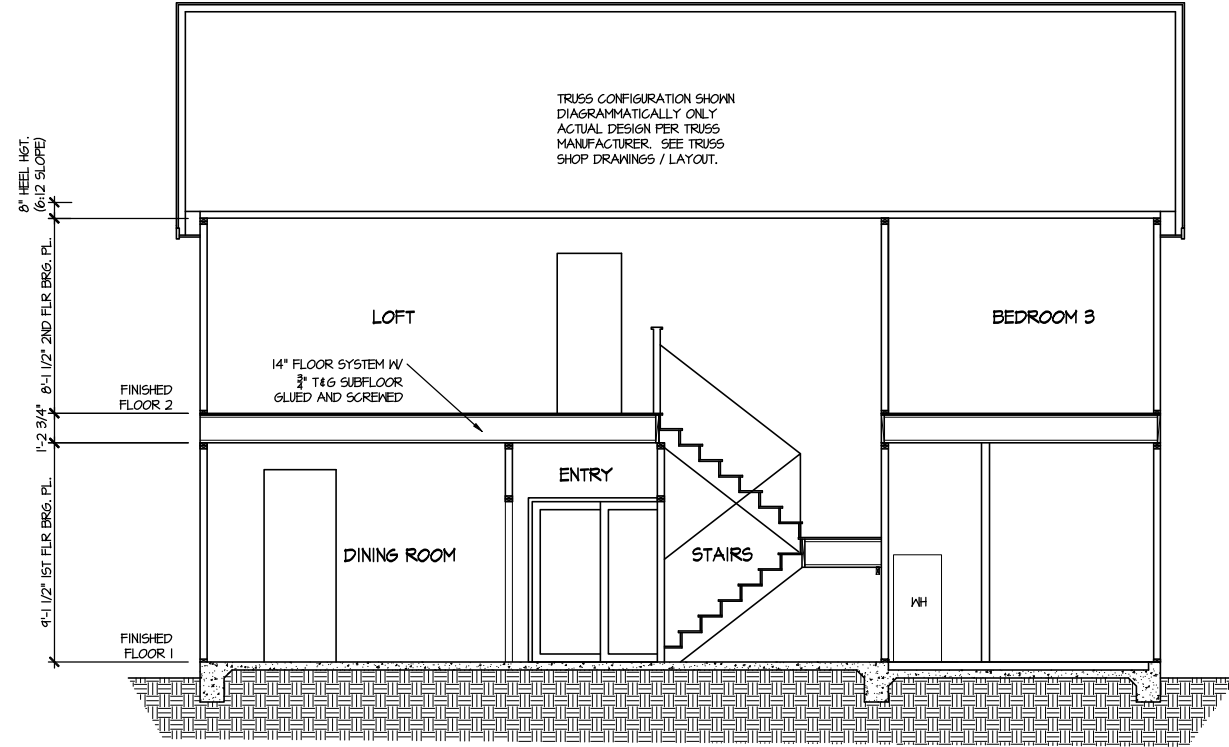

SECTION I

SCALE: 1/8" = 1'-0"

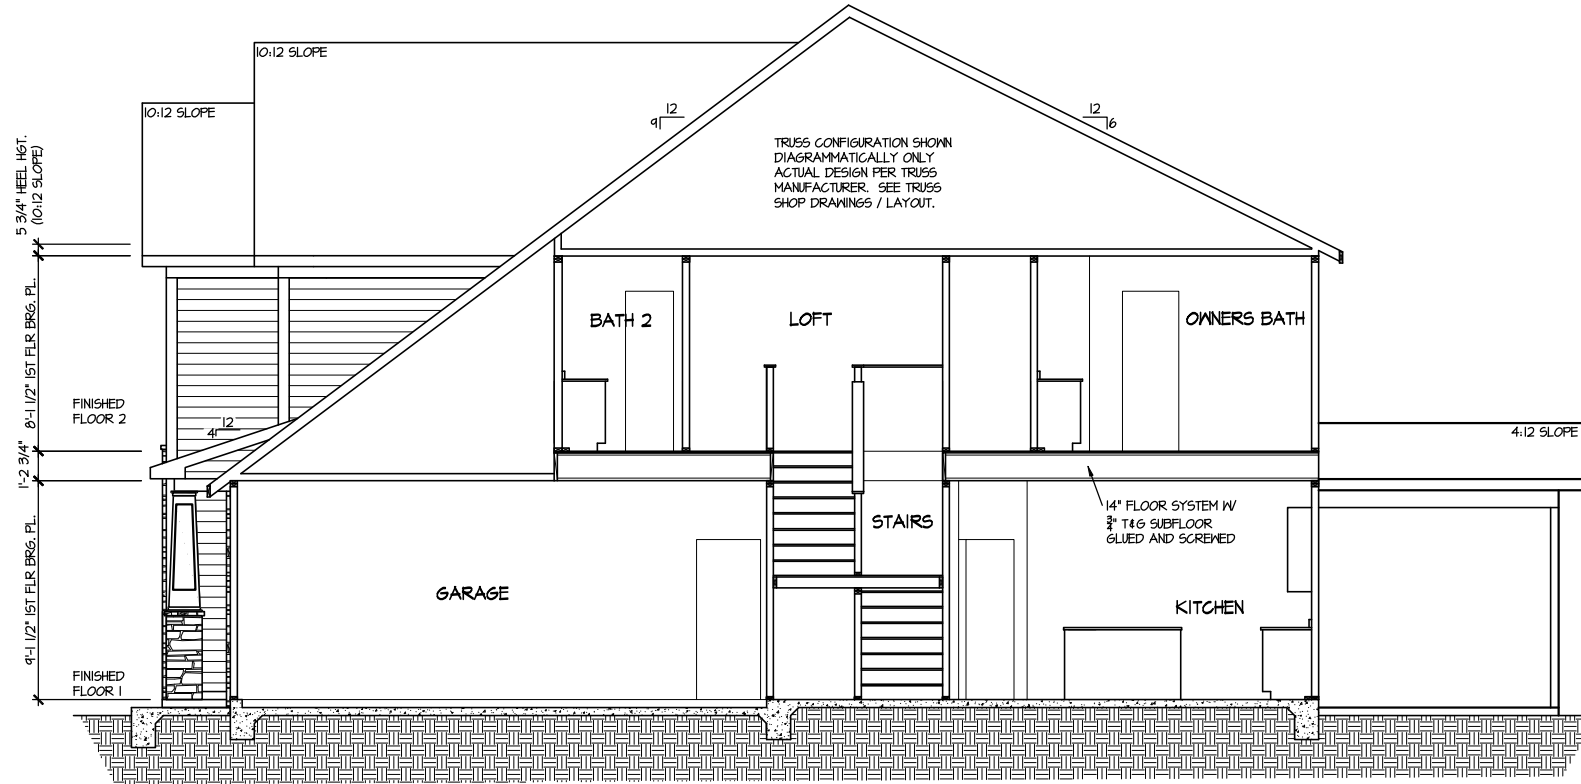

SECTION 2

SCALE: 1/8" = 1'-0"

MASTER PLAN INFORMATION			UPDATED DATE
REVISION	DATE		
2-RALE	03-06-2019		04-26-2024

DRAWN BY:	ITS
DATE:	07/11/2025
PLAN NO.	2695

DRB
HOMES


HOUSE NAME:
DRAYTON
DRAWING TITLE
BUILDING SECTION

SHEET No.
A4.1

ELECTRICAL LEGEND

- SINGLE POLE SWITCH
- THREE WAY SWITCH
- FOUR WAY SWITCH
- DUPLEX AFCI RECEPTACLE
- DUPLEX AFCI RECEPTACLE - BOTTOM HALF SWITCHED
- DUPLEX AFCI RECEPTACLE - FLOOR MOUNTED
- RECEPTACLE - 220V
- DUPLEX AFCI RECEPTACLE - GFI
- DUPLEX AFCI RECEPTACLE - WATERPROOF GFI
- SMOKE DETECTOR - WIRED IN SERIES
- EXHAUST FAN MOTOR
- CO DETECTOR
- DOOR CHIME
- LIGHT FIXTURE - WALL MOUNTED
- LIGHT FIXTURE - CEILING MOUNTED
- LIGHT FIXTURE - LED SURFACE MOUNTED
- PULLCHAIN LAMPHOLDER
- KEYLESS LAMPHOLDER

NOTE: ALL ELECTRICAL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE ADOPTED VERSION OF THE NATIONAL ELECTRICAL CODE, THE LOCAL POWER COMPANY AND TO ALL APPLICABLE LOCAL REGULATIONS.

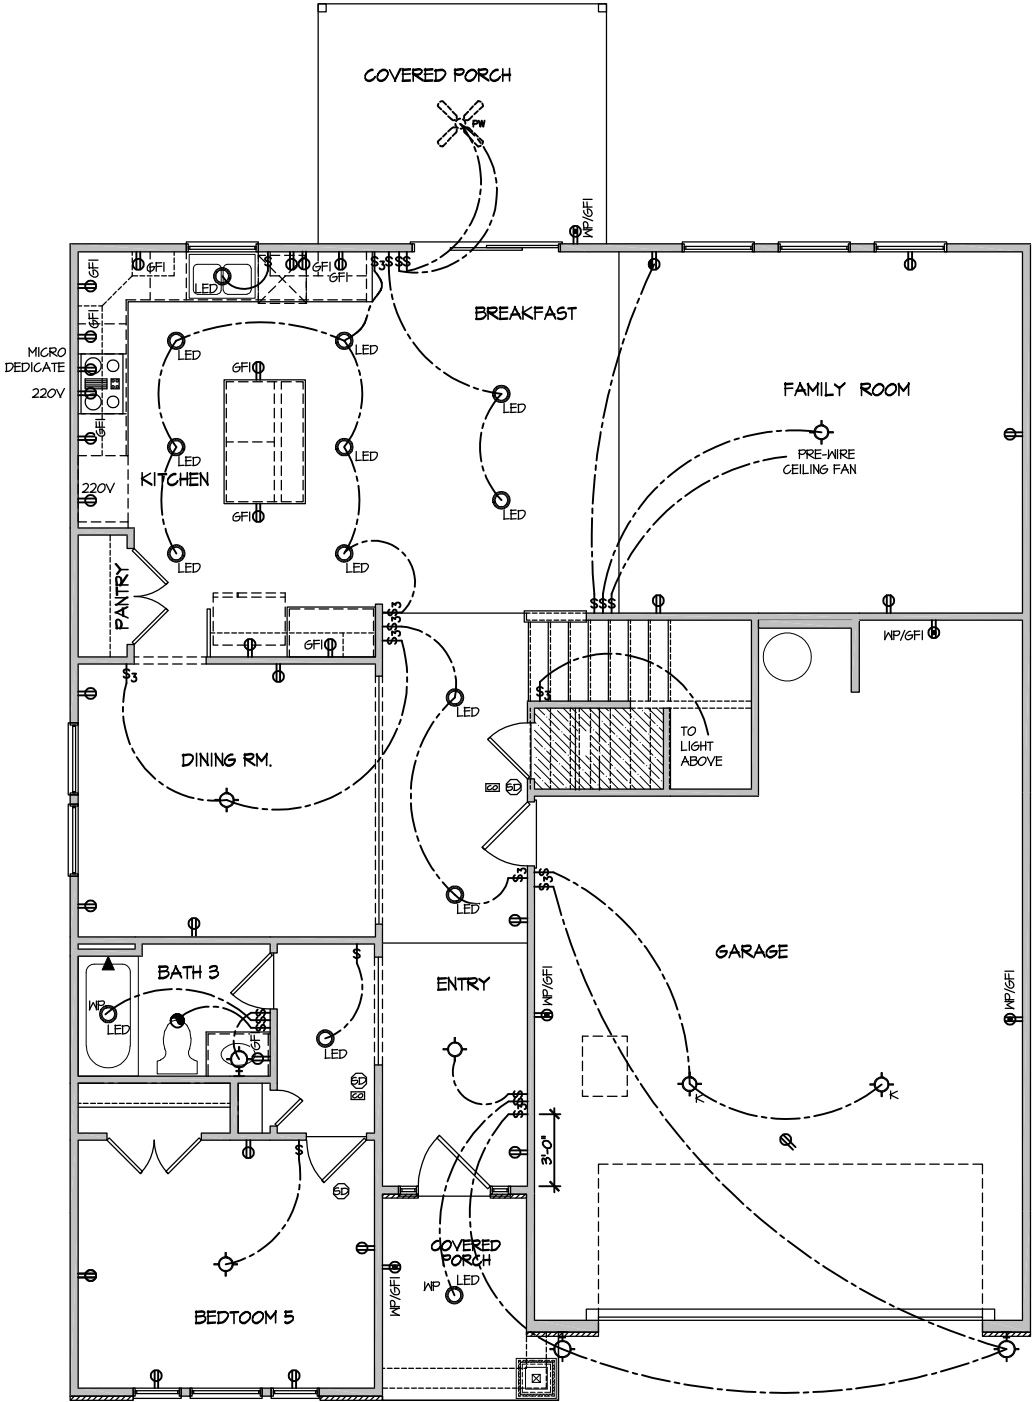

ELECTRICAL PLAN
FIRST FLOOR - ELEV. 4.1

SCALE: 1/8" = 1'-0"

MASTER PLAN INFORMATION			UPDATED DATE
REVISION	DATE		
2-RALE	03-06-2019		04-26-2024

DRAWN BY:	ITS
DATE:	07/11/2025
PLAN NO.	2695

DRB
HOMES


HOUSE NAME:	DRAYTON
DRAWING TITLE	FIRST FLOOR ELECTRICAL

SHEET No.	1.1
-----------	-----

ELECTRICAL LEGEND

- Ⓢ SINGLE POLE SWITCH
- Ⓢ₃ THREE WAY SWITCH
- Ⓢ₄ FOUR WAY SWITCH
- ⓈⓈ DUPLEX AFCI RECEPTACLE
- ⓈⓈ₃ DUPLEX AFCI RECEPTACLE - BOTTOM HALF SWITCHED
- ⓈⓈ₄ DUPLEX AFCI RECEPTACLE - FLOOR MOUNTED
- 220V Ⓢ RECEPTACLE - 220V
- GFI Ⓢ DUPLEX AFCI RECEPTACLE - GFI
- WP/GFI Ⓢ DUPLEX AFCI RECEPTACLE - WATERPROOF GFI
- ⓈⓈ SMOKE DETECTOR - WIRED IN SERIES
- Ⓢ EXHAUST FAN MOTOR
- Ⓢ CO DETECTOR
- Ⓢ DOOR CHIME
- Ⓢ LIGHT FIXTURE - WALL MOUNTED
- Ⓢ LIGHT FIXTURE - CEILING MOUNTED
- Ⓢ_{LED} LIGHT FIXTURE - LED SURFACE MOUNTED
- Ⓢ_P PULLCHAIN LAMPHOLDER
- Ⓢ_K KEYLESS LAMPHOLDER

NOTE: ALL ELECTRICAL WORK SHALL CONFORM TO THE REQUIREMENTS OF THE ADOPTED VERSION OF THE NATIONAL ELECTRICAL CODE, THE LOCAL POWER COMPANY AND TO ALL APPLICABLE LOCAL REGULATIONS.

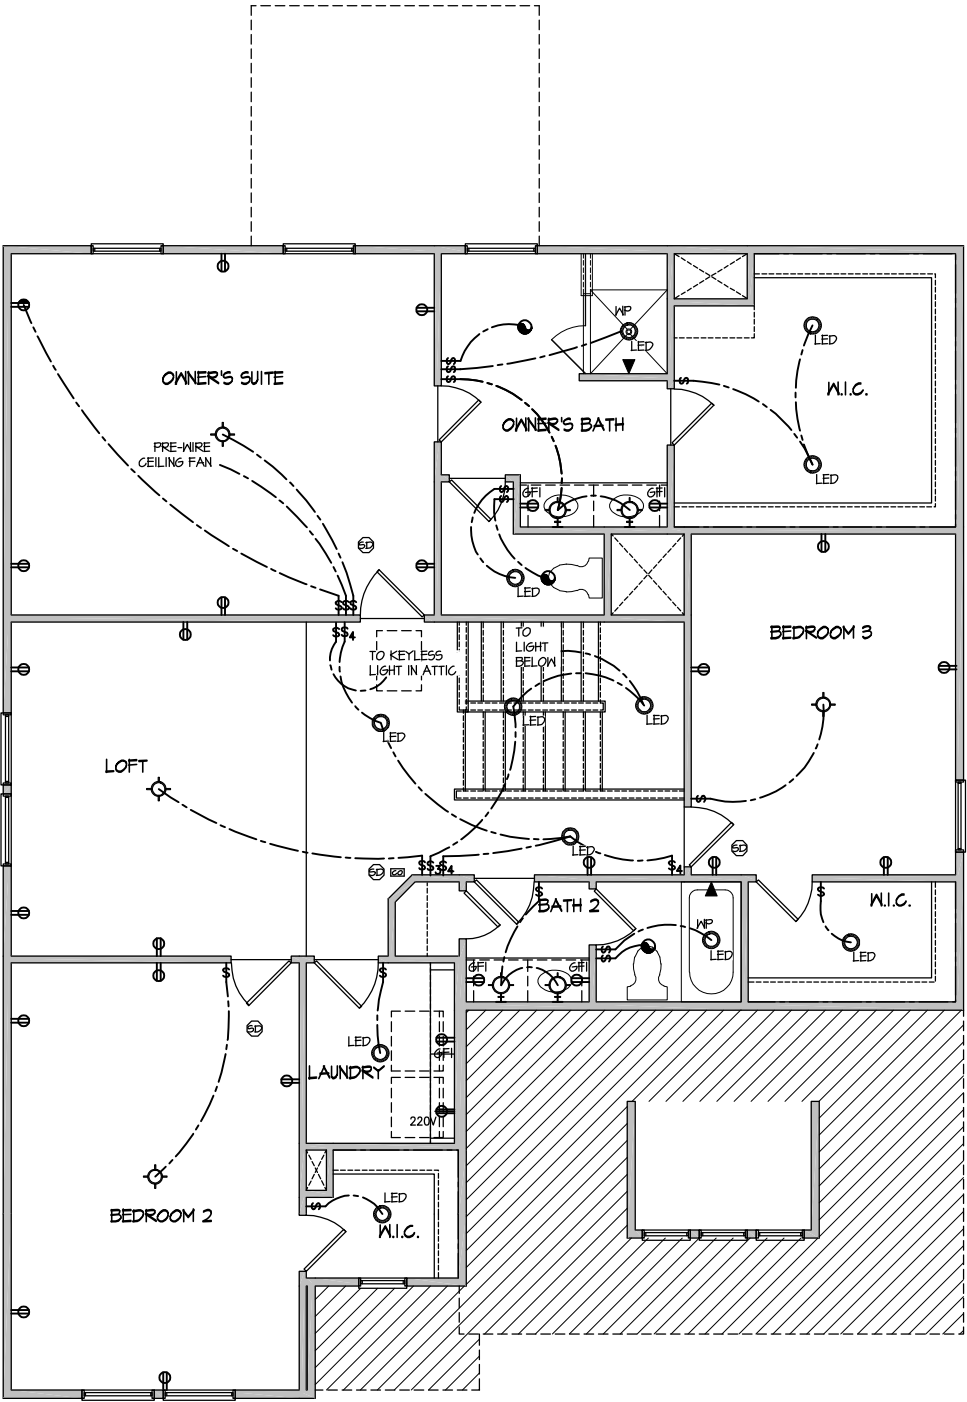

ELECTRICAL PLAN
SECOND FLOOR - ELEV. 4.1
SCALE: 1/8" = 1'-0"

FILE: Lot 00.0029.dwg DATE: 7/11/2025 10:23 AM

MASTER PLAN INFORMATION		UPDATED DATE
REVISION	DATE	04-26-2024
2-RALE	03-06-2019	



DRAWN BY:	ITS
DATE:	07/11/2025
PLAN NO.	2695

DRB
HOMES

HOUSE NAME:	DRAYTON
DRAWING TITLE	SECOND FLOOR ELECTRICAL

SHEET No.	1.2
-----------	-----

FILE: RALE TILE SHOWER DETAIL 8-2022.dwg DATE: 09-19-2022

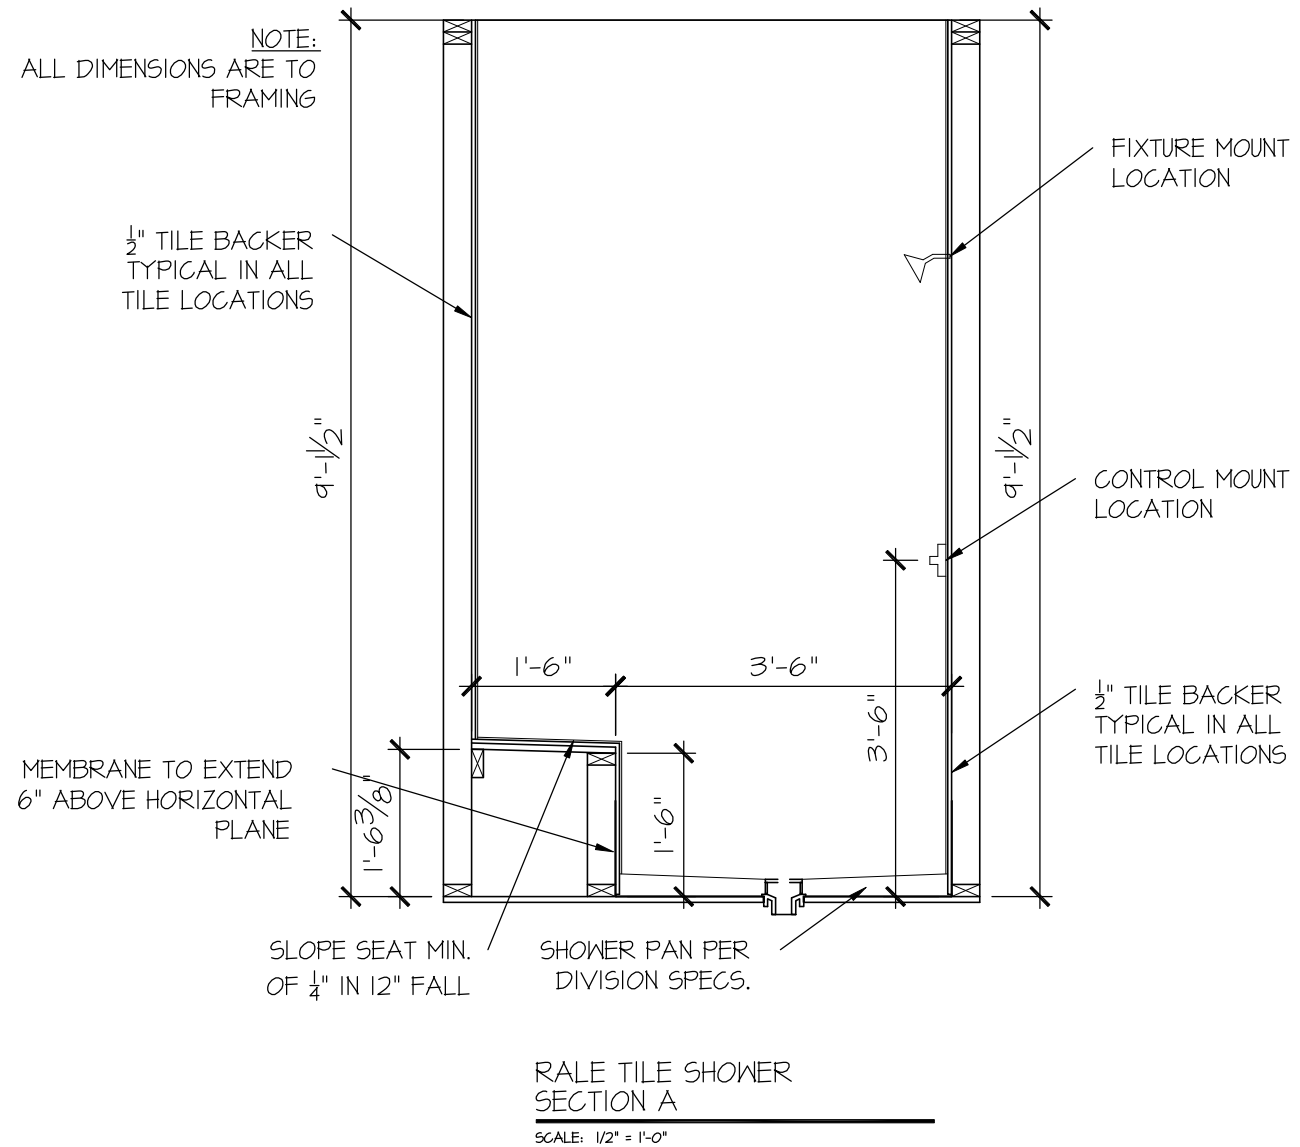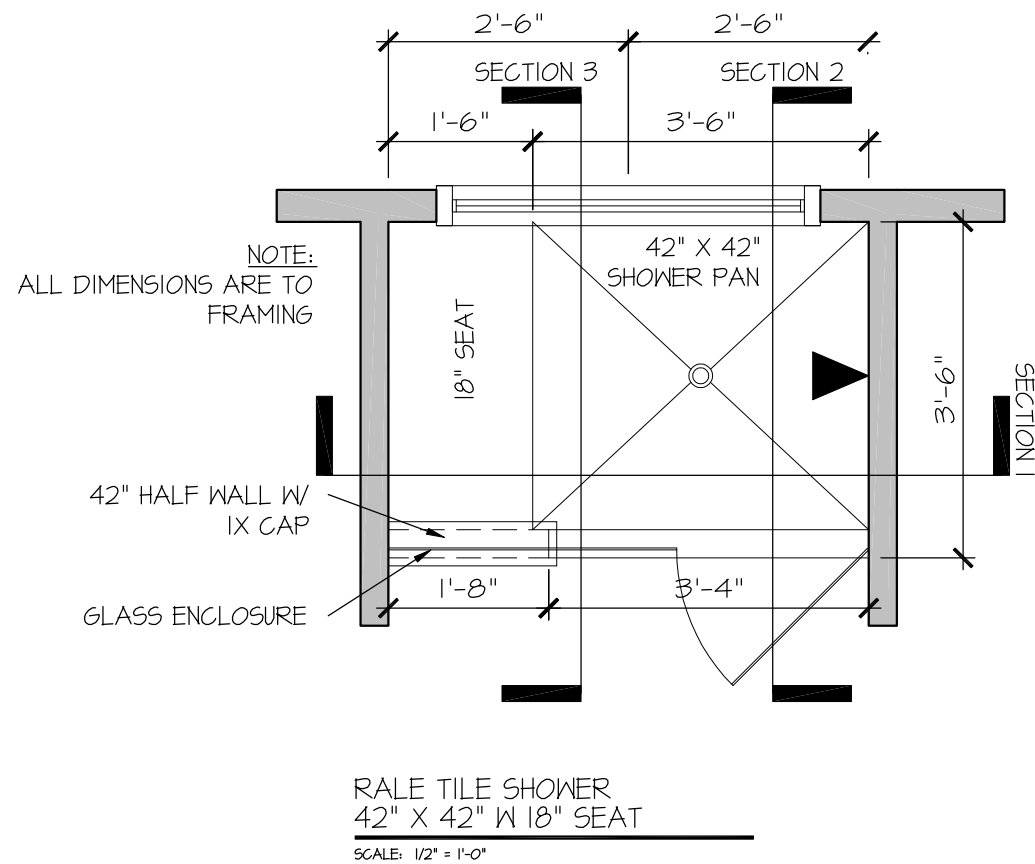

CONSULTANT LOGO

SEAL

DRAWN BY:
L. BEAVERS
DATE: 9/1/22
PLAN NO.
11 X 17 SCALE
24 X 36 SCALE

DRB
HOMES

HOUSE NAME:


DRAWING TITLE

RALE TILE SHOWER DETAIL

SHEET No.


0111

FILE: RALE TILE SHOWER DETAIL 8-2022.dwg DATE: 09-19-2022

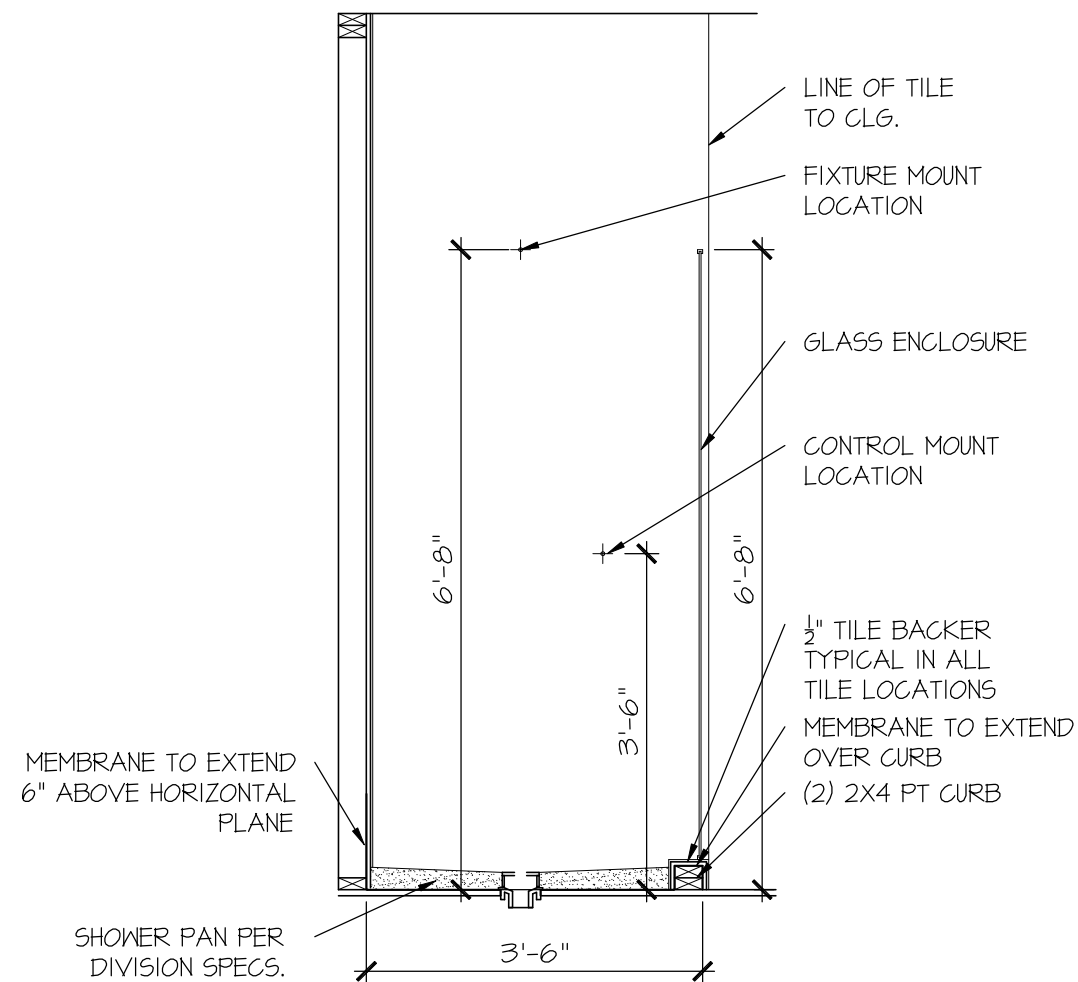

RALE TILE SHOWER
SECTION B

SCALE: 1/2" = 1'-0"

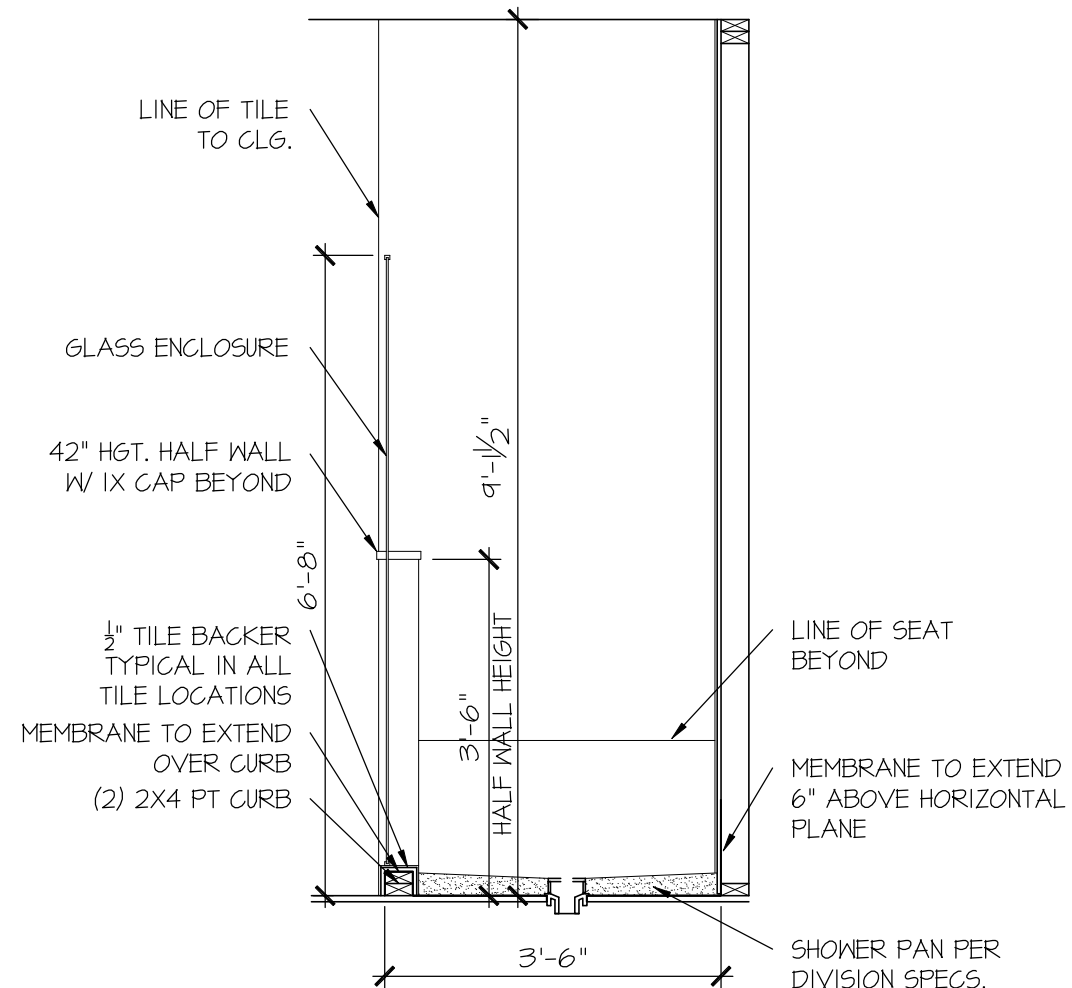

RALE TILE SHOWER
SECTION C

SCALE: 1/2" = 1'-0"

CONSULTANT LOGO

SEAL

DRAWN BY:
L. BEAVERS
DATE: 9/1/22
PLAN NO.
11 X 17 SCALE
24 X 36 SCALE

DRB
HOMES

HOUSE NAME:
DRAWING TITLE
RALE TILE SHOWER DETAIL

SHEET No.

01.12

GENERAL STRUCTURAL NOTES

FOUNDATION

• DESIGN IS BASED ON 2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE.

• FOOTING DESIGN - 2,000 PSF ALLOWABLE SOIL BEARING PRESSURE IS ASSUMED. BUILDER/CONTRACTOR MUST VERIFY.

• FASTEN 2x SILL PLATES TO FND WITH A MINIMUM OF 2 ANCHORS PER PLATE, 12" MAX. FROM PLATE ENDS - UTILIZING:

- 1/2" DIA. ANCHOR BOLTS @ 6'-0" O.C., 1" MIN. EMBEDMENT (CONC), 15" MIN. EMBEDMENT (CMU)
- SIMPSON MASA ANCHOR STRAPS @ 6'-0" O.C. (CONC.)
- SIMPSON MAB23 ANCHOR STRAPS @ 2'-8" O.C. (CMU)

(REFER TO DETAILS FOR 10' TALL WALL ANCHOR REQUIREMENTS)

• ALL LUMBER EXPOSED TO WEATHER OR IN CONTACT W/ CONCRETE OR CMU SHALL BE PRESERVATIVE TREATED SOUTHERN PINE #2.

• BUILDER TO VERIFY CORROSION-RESISTANCE COMPATIBILITY OF HARDWARE & FASTENERS IN CONTACT W/ PRESERVATIVE-TREATED WOOD. CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD.

• BASEMENT INTERIOR BEARING WALLS & EXTERIOR WALK-OUT BASEMENT WALLS SHALL BE 2x6 @ 16" O.C. SFF OR SYP, "STUD" GRADE OR BETTER.

• CONCRETE DESIGN BASED ON ACI 318. CONCRETE SHALL ATTAIN THE FOLLOWING MIN. COMPRESSIVE STRENGTHS IN 28 DAYS, UNO.:

fc = 4000 psi: FOUNDATION WALLS

2500 psi: FOOTINGS & INTERIOR SLABS ON GRADE

3000 psi: GARAGE & EXTERIOR SLABS ON GRADE

fy = 60,000 psi

• BASEMENT FOUNDATION WALL DESIGN BASED ON:

- 1' OR 10' HEIGHT (AS NOTED ON PLANS)
- TALLER WALLS MUST BE ENGINEERED.
- NOMINAL WIDTH (9 1/2" FOR 10" THICK WALL).

• BASEMENT WALL DESIGN IS BASED ON 60 PCF BACKFILL SOIL TYPE CLASSIFICATIONS (SC, ML-CL, OR CL).

• BASEMENT WALLS SHALL BE BRACED, PRIOR TO BACKFILLING, BY ADEQUATE TEMPORARY BRACING OR INSTALL 1st FLOOR DECK.

• PROVIDE (2) #5 BARS AROUND ALL SIDES OF OPENINGS IN CONCRETE BSMT. FND. WALL WITH 2" CLEAR. REINFORCEMENT SHALL EXTEND 12" PAST CORNER OF OPENING IN ALL DIRECTIONS.

- FOR OPENINGS UP TO 36", PROVIDE MINIMUM 10" CONCRETE DEPTH OVER OPENING OR (3)2x10 W/ (2)2x6 JACK STUDS, UNO.
- LARGER OPENINGS SHALL BE PER PLAN.

• ALL CONCRETE EXPOSED TO THE WEATHER SHALL NOT HAVE LESS THAN 5% OR MORE THAN 1% AIR ENTRAINMENT.

• ALL FOOTINGS SHALL BEAR AT LEAST 12" BELOW FINISH GRADE.

• FOOTINGS AND SLABS ON GRADE SHALL BEAR ON VIRGIN SOIL OR 95% COMPACTED FILL.

• PROVIDE CONTROL JOINTS AT ALL INSIDE CORNERS OF SLAB EDGES, AND OTHER LOCATIONS WHERE SLAB CRACKS ARE LIKELY TO DEVELOP.

- JOINTS SHALL BE LOCATED @ 10'-0" O.C. (RECOMMENDED) OR 15'-0" O.C. (MAXIMUM)
- JOINT GRID PATTERN SHALL BE AS CLOSE TO SQUARES AS POSSIBLE (1:1 RATIO), WITH A MAXIMUM OF 1:1.5 RATIO
- CONTROL JOINTS SHALL NOT BE INSTALLED IN STRUCTURAL SLABS

• CONCRETE MASONRY UNITS (CMU) SHALL BE ASTM C90 WITH A MIN. COMPRESSIVE STRENGTH OF 1900 psi (Fm=1500 psi). MORTAR SHALL BE ASTM C270, TYPE S. CMU DESIGN PER ACI 530 & 530.1.

• CMU FOUNDATION WALLS SHALL HAVE 'DUR-O-WALL' HORIZONTAL JOINT REINFORCEMENT (OR EQUAL) - 9 GA. MINIMUM @ 16" O.C.

• PROVIDE 2x6 (MIN.) x 16" LONG P.T. PLATE ON TOP OF ALL CRAWL SPACE PIERS. ALL PIERS SHALL BE FASTENED PER ANCHORAGE SPECIFICATIONS NOTED ABOVE. TOP 2 COURSES (MIN.) OF PIER TO BE GROUTED SOLID (8 COURSE MAX. PIER HEIGHT).

• PROVIDE 2x6 P.T. PLATE ON INTERIOR CRAWL SPACE WALLS, FASTENED PER ANCHORAGE SPECIFICATION NOTED ABOVE. TOP 2 COURSES (MIN.) OF WALL TO BE GROUTED SOLID (8 COURSE MAX. WALL HEIGHT)

• DIMENSIONS BY OTHERS, BUILDER TO VERIFY.

• BUILDER TO VERIFY THAT MODEL HAS BEEN ADEQUATELY TREATED BY A LICENSED AND BONDED PEST CONTROL COMPANY FOR SUBTERRANEAN TERMITES. METHOD AND TYPE OF TREATMENT TO BE DETERMINED BY PEST CONTROL COMPANY.

GENERAL STRUCTURAL NOTES

GENERAL FRAMING

• DESIGN IS BASED ON 2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE.

• WOOD FRAME ENGINEERING IS BASED ON NDS, "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION" - LATEST EDITION.

• DESIGN LOADS:

ROOF DEAD = 7 PSF T.C., 10 PSF B.C.
LIVE = 16 PSF
LOAD DURATION FACTOR = 1.25

FLOOR LIVE = 40 PSF (30 PSF @ SLEEPING AREAS)
DEAD = 10 PSF (1-JOISTS & SOLID SAMN)
10 PSF T.C., 5 PSF B.C. (TRUSSES)
(ADD'L 10 PSF @ TILE)

LATERAL 120 MPH, EXPOSURE B. SEISMIC A/B.

SOIL 2,000 PSF ASSUMED ALLOWABLE BEARING PRESSURE (TO BE VERIFIED BY BUILDER)

• ALL TYP. NAIL FASTENER REQUIREMENTS ARE NOTED IN STANDARD CONNECTIONS TABLE OR ON PLANS. ALL NAILS SPECIFIED ARE MIN DIAMETER AND LENGTH REQUIRED FOR CONNECTION. ALL HANGER NAILS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS FOR MAX CHARTED CAPACITY. ~~NOTE: HANGERS USE COMMON NAIL DIAMETERS NOT TYPICAL FRAMING GUN NAILS.~~

• REFER TO FASTENING SCHEDULE TABLE R602.3(1) FOR ALL CONNECTIONS, TYP. UNO.

• EXT. & INT. BRG WALLS SHALL BE 2x4 OR 2x6 (AS SHOWN ON PLANS) @ 16" O.C. SFF OR SYP "STUD" GRADE LUMBER, OR BETTER, UNO.

- WALLS OVER 12' TALL SHALL BE PER PLAN.

• ALL HEADERS, BEAMS & OTHER STRUCTURAL MEMBERS SHALL BE SPRUCE-PINE-FIR #2 (SFF) OR SOUTHERN PINE #2 (SYP) LUMBER, OR BETTER (KILN-DRIED). ALL HEADERS HAVE BEEN DESIGNED BASED ON CALCULATED LOADS & SIZED ACCORDINGLY. CODE TABLES HAVE NOT BEEN USED.

• ALL NON-BEARING INTERIOR STUD WALLS SHALL BE CONSTRUCTED WITH 2x "STUD" GRADE MEMBERS SPACED @ 16" O.C. (MAX., UNO.)

- HEADERS IN NON-LOAD BEARING WALLS SHALL BE: (1)2x4/6 FLAT @ OPENINGS UP TO 4'; (2)2x4/6 FLAT UP TO 8'.

• ALL FRAMING LUMBER SHALL BE DRIED TO 15% MC (KD-15).

• ENGINEERED LUMBER BEAMS TO MEET OR EXCEED THE FOLLOWING:

- 'LSL' - Fb=2325 psi; Fv=310 psi; E=1.55x10⁶ psi
- 'LVL' - Fb=2600 psi; Fv=285 psi; E=2.0x10⁶ psi
- 'PSL' - Fb=2400 PSI; Fv=240 PSI; E=2.0x10⁶ PSI

• MKK SHALL BE FULLY INDEMNIFIED FOR ANY AND ALL ISSUES RESULTING FROM OR RELATED TO ANY BUILDING COMPONENT IF THE OWNER DOES NOT SUBMIT THE COMPONENT SHOP DRAWINGS TO MKK FOR STRUCTURAL REVIEW PRIOR TO FABRICATION, DELIVERY, OR INSTALLATION.

• FOR 2 & 3 PLY BEAMS OF EQUAL WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF 3"x0.120" NAILS @ 8" O/C OR 2 ROWS 1/4"x3/8" SIMPSON SDS SCREWS (OR 3/8" TRUSSLOK SCREWS) @ 16" O/C. USE A MINIMUM OF 3 ROWS FOR BEAM DEPTHS OF 14" OR GREATER. APPLY FASTENING AT BOTH FACES FOR 3-PLY CONDITION. LOCATE TOP & BOTTOM NAILS/SCREWS 2" FROM EDGE. SOLID 3 1/2" OR 5 1/4" BEAMS ARE ACCEPTABLE. USE 2 ROWS OF NAILS FOR 2x6 & 2x8 MEMBERS.

• FOR 4 PLY BEAMS OF EQUAL WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF 1/4"x6" SIMPSON SDS SCREWS (OR 6 3/4" TRUSSLOK SCREWS) @ 16" O/C. USE A MINIMUM OF 4 ROWS FOR BEAM DEPTHS OF 14" OR GREATER. APPLY FASTENING AT BOTH FACES (ONE SIDE ONLY FOR TRUSSLOK SCREWS). LOCATE TOP AND BOTTOM SCREWS 2" FROM EDGE. A SOLID 7" BEAM IS ACCEPTABLE.

• ALL HEADERS SHALL BE SUPPORTED BY (1)2x JACK STUD & (1)2x KING STUD, MINIMUM.

- THE NUMBER OF STUDS SPECIFIED AT A SUPPORT INDICATES THE NUMBER OF JACK STUDS REQUIRED, UNO..

• ALL MULTI-PLY STUDS TO BE FASTENED TOGETHER W/ 3"x0.131" NAILS @ 24" O.C. (MIN.), EACH PLY.

• PROVIDE SOLID BLOCKING IN FLOOR SYSTEM UNDER ALL POSTS CONTINUOUS TO FND/BEARING. BLOCKING TO MATCH POST ABOVE.

• FASTEN 2x WOOD PLATES TO TOP FLANGE OF STEEL BEAMS WITH P.A.F.'s (HILTI' X-CF PINS OR EQUAL) @ 16" O.C. STAGGERED, OR 1/2" DIA. BOLTS @ 48" O.C. STAGGERED.

• ALL EXTERIOR 4x4 WOOD POSTS SHALL HAVE SIMPSON BCS2-2/4 CAP & ABW44Z BASE, UNO.

FLOOR FRAMING

ROOF FRAMING

• 1-JOISTS/TRUSSES SHALL BE DESIGNED BY MANUF. TO MEET OR EXCEED L/480 LIVE LOAD DEFLECTION CRITERIA. (EXCLUDES MARBLE FLOORS - CONTACT MKK FOR MARBLE FLOOR DESIGNS)

• AT 1-JOIST FLOORS, PROVIDE 1 1/8" MIN. OSB RIM BOARD.

• METAL HANGERS SHALL BE SPECIFIED BY MANUFACTURER, UNO.

• FLOOR SHEATHING SHALL BE 23/32" A.P.A. RATED 'STURD-I-FLOOR' 24" O.C. EXPOSURE 1 (OR APPROVED EQUAL) WITH TONGUE AND GROOVE EDGES. FASTEN TO FRAMING MEMBERS W/ GLUE AND - 2 1/2" x 0.131" NAILS @ 6"o.c. @ PANEL EDGES @ 12"o.c. FIELD.

- 2 3/8" x 0.120" NAILS @ 4" O.C. @ PANEL EDGES @ 8" O.C. FIELD.

- 2 3/8" x 0.113" NAILS @ 3" O.C. @ PANEL EDGES @ 6" O.C. IN FIELD.

- #6 x 2" MIN. SCREWS @ 6" O.C. @ PANEL EDGES @ 12" O.C. FIELD.

• BAY WINDOWS & SHED ROOFS (UP TO 6' SPAN) CAN BE 2x4 OR 2x6 RAFTERS & CEILING JOISTS @ 16/24" O.C.

• FASTEN EACH ROOF TRUSS TO TOP PLATE W/ SIMPSON H2.5T CLIP (OR APPROVED EQUAL) @ ALL BEARING POINTS. PROVIDE (2) H2.5T CLIPS AT 2-PLY GIRDER TRUSSES, (3) H2.5T CLIPS AT 3-PLY GIRDER TRUSSES & ROOF BEAMS - AT ALL BEARING POINTS.

• METAL HANGERS SHALL BE SPECIFIED BY THE MANUFACTURER, UNO.

• ERECT AND INSTALL ROOF TRUSSES PER WTC&A & TPI'S BCSI 1-08 "GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING & BRACING OF METAL PLATE CONNECTED WOOD TRUSSES."

• SUPPORT PORCH & SHORT SPAN ROOF TRUSSES (MAX 7' SPAN) W/ 2x4 LEDGER FASTENED TO:

- RIM BOARD W/ (2) 3"x0.131" NAILS @ 16" O.C. MAX. (1-JOISTS)
- TRUSS VERTICALS W/ (3) 3"x0.131" NAILS @ 14.2" O.C. MAX. (FLOOR TRUSSES)

• ROOF SHEATHING SHALL BE 1/4" A.P.A. RATED SHEATHING 24/16 EXPOSURE 1 (OR APPROVED EQUAL). FASTEN TO FRAMING MEMBERS

- W/ 2 1/2" x 0.131" NAILS @ 6"o.c. @ PANEL EDGES @ 12" O.C. FIELD.
- W/ 2 3/8" x 0.120" NAILS @ 4"o.c. @ PANEL EDGES @ 8" O.C. FIELD.
- W/ 2 3/8" x 0.113" NAILS @ 3"o.c. @ PANEL EDGES @ 6" O.C. FIELD.

HOLD-DOWN SCHEDULE	
SYMBOL	SPECIFICATION
	HD-1 SIMPSON HTT4 HOLD-DOWN @ 1/8" DIA. ANCHOR
	HD-2 SIMPSON MSTC666 STRAP TIE (CENTER STRAP ON FLOOR SYSTEM UNO.) -OR- MSTC666B3 ALTERNATE
	HD-3 SIMPSON STHD14/STHD14RJ
* UTILIZE THE 56TB24 ANCHOR BOLT @ ALL MONOSLAB & INTERIOR RAISED SLAB (I.E. THICKENED SLABS, FOOTINGS) CONDITIONS. MINIMUM 24" MIN. FOOTING THICKNESS REQUIRED. EPOXY-SET ALTERNATE FOR MONOSLAB & INTERIOR RAISED SLAB CONDITIONS ONLY; UTILIZE SIMPSON 'SET' EPOXY SYSTEM TO FASTEN THREADED ROD INTO CONCRETE FOUNDATION. PROVIDE 10" (FOR 5/8" DIA.) OR 15" (FOR 1/2" DIA.) MIN. EMBEDMENT INTO CONCRETE. INSTALL PER MANUF. INSTRUCTIONS. MINIMUM 16" FOOTING THICKNESS REQ'D. DO NOT LOCATE ANCHORS WITHIN 1 3/4" OF EDGE OF CONCRETE.	

LEGEND

- INTERIOR BEARING WALL
- BEARING WALL ABOVE
- BEAM / HEADER
- INDICATES SHEAR WALL & EXTENT
- EXTENT OF OVERFRAMING
- JL METAL HANGER
- INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.
- INDICATES HOLD-DOWN OR STRAP. REFER TO SCHEDULE.

NON-BEARING HEADER SCHEDULE		
SPAN	2x4 NON-BEARING PARTITION WALL	2x6 NON-BEARING PARTITION WALL
UP TO 3'-0"	(1)2x4 FLAT	(1)2x6 FLAT
UP TO 6'-0"	(2)2x4	(3)2x4
UP TO 8'-0"	(2)2x6	(3)2x6
UP TO 12'-0"	(2)2x8	(3)2x8
NOTES: • ALL NON-BEARING INTERIOR STUD WALLS SHALL BE CONSTRUCTED WITH 2x "STUD" GRADE MEMBERS SPACED @ 24" O.C. (MAX.)		

LATERAL BRACING & SHEAR WALL SHEATHING SPECIFICATIONS

EXT. WALL SHEATHING SPECIFICATION

BLOCKED PANEL EDGES

NOTES

THIS MODEL HAS BEEN DESIGNED TO RESIST LATERAL FORCES RESULTING FROM:

120 MPH WIND IN 2018 NCSCBC:RC

(120 MPH WIND SPEED IN ASCE 7-10 WIND MAP, PER IRC R301.2.1.1) EXP. B, RISK CAT. 2 & SEISMIC CAT. A/B.

THE DESIGN WAS COMPLETED PER 2015 IBC (SECTION I609) & ASCE 7-10, AS PERMITTED BY R301.1.3 OF THE 2018 NCSCBC:RC, OR THE SIMPLIFIED PRESCRIPTIVE PROCEDURE IN ACCORDANCE WITH THE 2015 IRC IF THE PARAMETERS OF SECTION R602.1.2 COMPLY. ACCORDINGLY, THIS MODEL, AS DOCUMENTED AND DETAILED HEREWITHIN, IS ADEQUATE TO RESIST THE CODE REQUIRED LATERAL FORCES.

DESIGN WIND UPLIFT LOADS HAVE BEEN CALCULATED UTILIZING ASCE 7-10 (ACCEPTED ENGINEERING PRACTICE) AS ALLOWED PER 2018 NCSCBC:RC SECTION R802.1.1.1. THIS MODEL HAS BEEN DETAILED WHERE REQUIRED & ENGINEERED TO RESIST THE WIND UPLIFT LOAD PATH PER SECTIONS R602.3.54 R802.11.

• AT DESIGNATED AREAS - FASTEN SHEATHING W/ 2 3/8" x 0.113" NAILS @ 6" O.C. AT ALL PANEL EDGES AND 12" O.C. IN THE PANEL FIELD OR 1 1/4" 16 GA STAPLES (1/8" CROWN) @ 3" O.C. AT EDGES @ 6" O.C. IN FIELD. ALL SHEATHING PANELS SHALL BE ORIENTED AND INSTALLED FULL HEIGHT OF SHEAR WALL OR 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT ALL UNSUPPORTED PANEL EDGES & EDGE FASTENING.

3" O.C. EDGE NAILING

• AT DESIGNATED AREAS - FASTEN PANEL EDGES OF WOOD STRUCTURAL WALL SHEATHING TO FRAMING W/ 8d NAILS @ 3" O.C. NO STAPLE ALTERNATIVE AVAILABLE AT THIS SPEC. ALL SHEATHING PANELS SHALL BE ORIENTED AND INSTALLED FULL HEIGHT OF SHEAR WALL OR 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT UNSUPPORTED PANEL EDGES AND 3" O.C. EDGE FASTENING.

NOTES

• SEE CONNECTION SPECIFICATIONS CHART FOR STANDARD SHEAR TRANSFER DETAILING. IF ADDITIONAL CAPACITY IS REQUIRED BY DESIGN, IT WILL BE SPECIFICALLY NOTED ON PLAN.

• DESIGN ASSUMES 16" O.C. MAX. STUD SPACING, UNO.

• ALL STRICTURAL PANELS ARE TO BE DIRECTLY APPLIED TO STUD FRAMING.

• PRE-MANUFACTURED PANELIZED WALLS: FASTEN TOGETHER END STUDS OF WALL PANELS SHEATHED W/ OSB OR PLYWOOD W/ 3" x 0.120" NAILS @ 4" O.C. (THRU ONE SIDE ONLY)

--- INDICATES EXTENT OF INT. OSB SHEARNWALL OR 3" O.C. OSB SHEARNWALL.

INDICATES HOLDDOWN BELOW

MEANS & METHODS NOTES

ADDITIONAL NOTES FOR TRUSS & I-JOIST MANUFACTURER

SD2.I REFERS TO SD2.IA FOR LVL/PSL/LSL BEAMS OR SD2.IB FOR FLITCH BEAMS OR SD2.IC FOR STEEL BEAMS

ALTERNATE F.J MANUFACTURERS

THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FINISHED AND ALL PLAN, DETAIL, AND NOTE SPECIFICATIONS HAVE BEEN COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE THE ERECTION PROCEDURES AND SEQUENCE TO INSURE THE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION. THIS INCLUDES, BUT IS NOT LIMITED TO, THE ADDITION OF NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, AND TIE-DOWNS. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORING AND BRACING REQUIRED TO STABILIZE AND PROTECT EXISTING AND ADJACENT STRUCTURES AND SYSTEMS DURING COURSE OF DEMOLITION AND CONSTRUCTION OF THE PROJECT.

STRUCTURAL DESIGN AND SPECIFICATIONS ASSUME THAT ALL SUPPORTING AND NON-SUPPORTING ELEMENTS IN CONTACT WITH FLOOR FRAMING ARE LEVEL, INCLUDING, BUT NOT LIMITED TO; FOUNDATIONS, SLABS ON GRADE, BEAMS, WALLS, AND NON-BEARING ELEMENTS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY LEVELNESS AND MAKE ADJUSTMENTS AS NECESSARY, INCLUDING CONSIDERATION OF THOSE AREAS THAT MAY BE WITHIN CONTRACTUAL, INDUSTRY, OR WARRANTY TOLERANCES.


TRUSSES/JOISTS SHALL BE DESIGNED SO THAT DIFFERENTIAL DEFLECTION BETWEEN ADJACENT PARALLEL TRUSSES/JOISTS OR GIRDER TRUSSES/FLUSH BEAMS DO NOT EXCEED THE FOLLOWING:

A. ROOF TRUSSES:
1/4" DEAD LOAD

B. FLOOR TRUSSES, ATTIC TRUSSES, & I-JOISTS:
1/8" DEAD LOAD

C. FLOOR TRUSSES & ATTIC TRUSSES ADJACENT TO FLOOR FRAMING BY OTHERS:
LIMIT ABSOLUTE TRUSS DEFLECTION TO 3/16" DEAD LOAD. (NOT DIFFERENTIAL DEFLECTION)

• FLOOR JOISTS BY MANUFACTURER'S OTHER THAN THOSE SHOWN ON PLAN SHALL CONFORM TO THE APA PERFORMANCE RELATED I-JOISTS DESIGN AND CONSTRUCTION GUIDE. MINIMUM JOIST PROPERTIES INCLUDING, BUT NOT LIMITED TO, ALLOWABLE SHEAR, ALLOWABLE MOMENT, STRENGTH, AND STIFFNESS, SHALL MEET OR EXCEED THOSE LISTED FOR THE PRI-60 SERIES I-JOISTS. ALL ALLOWABLE HOLES, BEARING STIFFENERS, AND JOIST TO JOIST CONNECTIONS ARE PER THE JOIST MANUFACTURER.

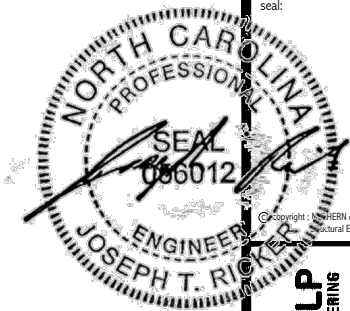

seal: 7/17/25

MULHERN+KULP

RESIDENTIAL STRUCTURAL ENGINEERING

300 Bunkie Ave, Building 4 - Ardur, PA 10082
P 215-545-2001 • mulhern+kulp.com
NC LICENSE #C-3825

M&K project number:

126-22076

project mgr: JTR

drawn by: NLD

issue date: 07-14-25

REVISIONS:

date: initial:




STRUCTURAL NOTES

FARM AT NEIL'S CREEK

LOT 29 - DRAYTON 4.1

RALEIGH, NC

sheet: S0.0

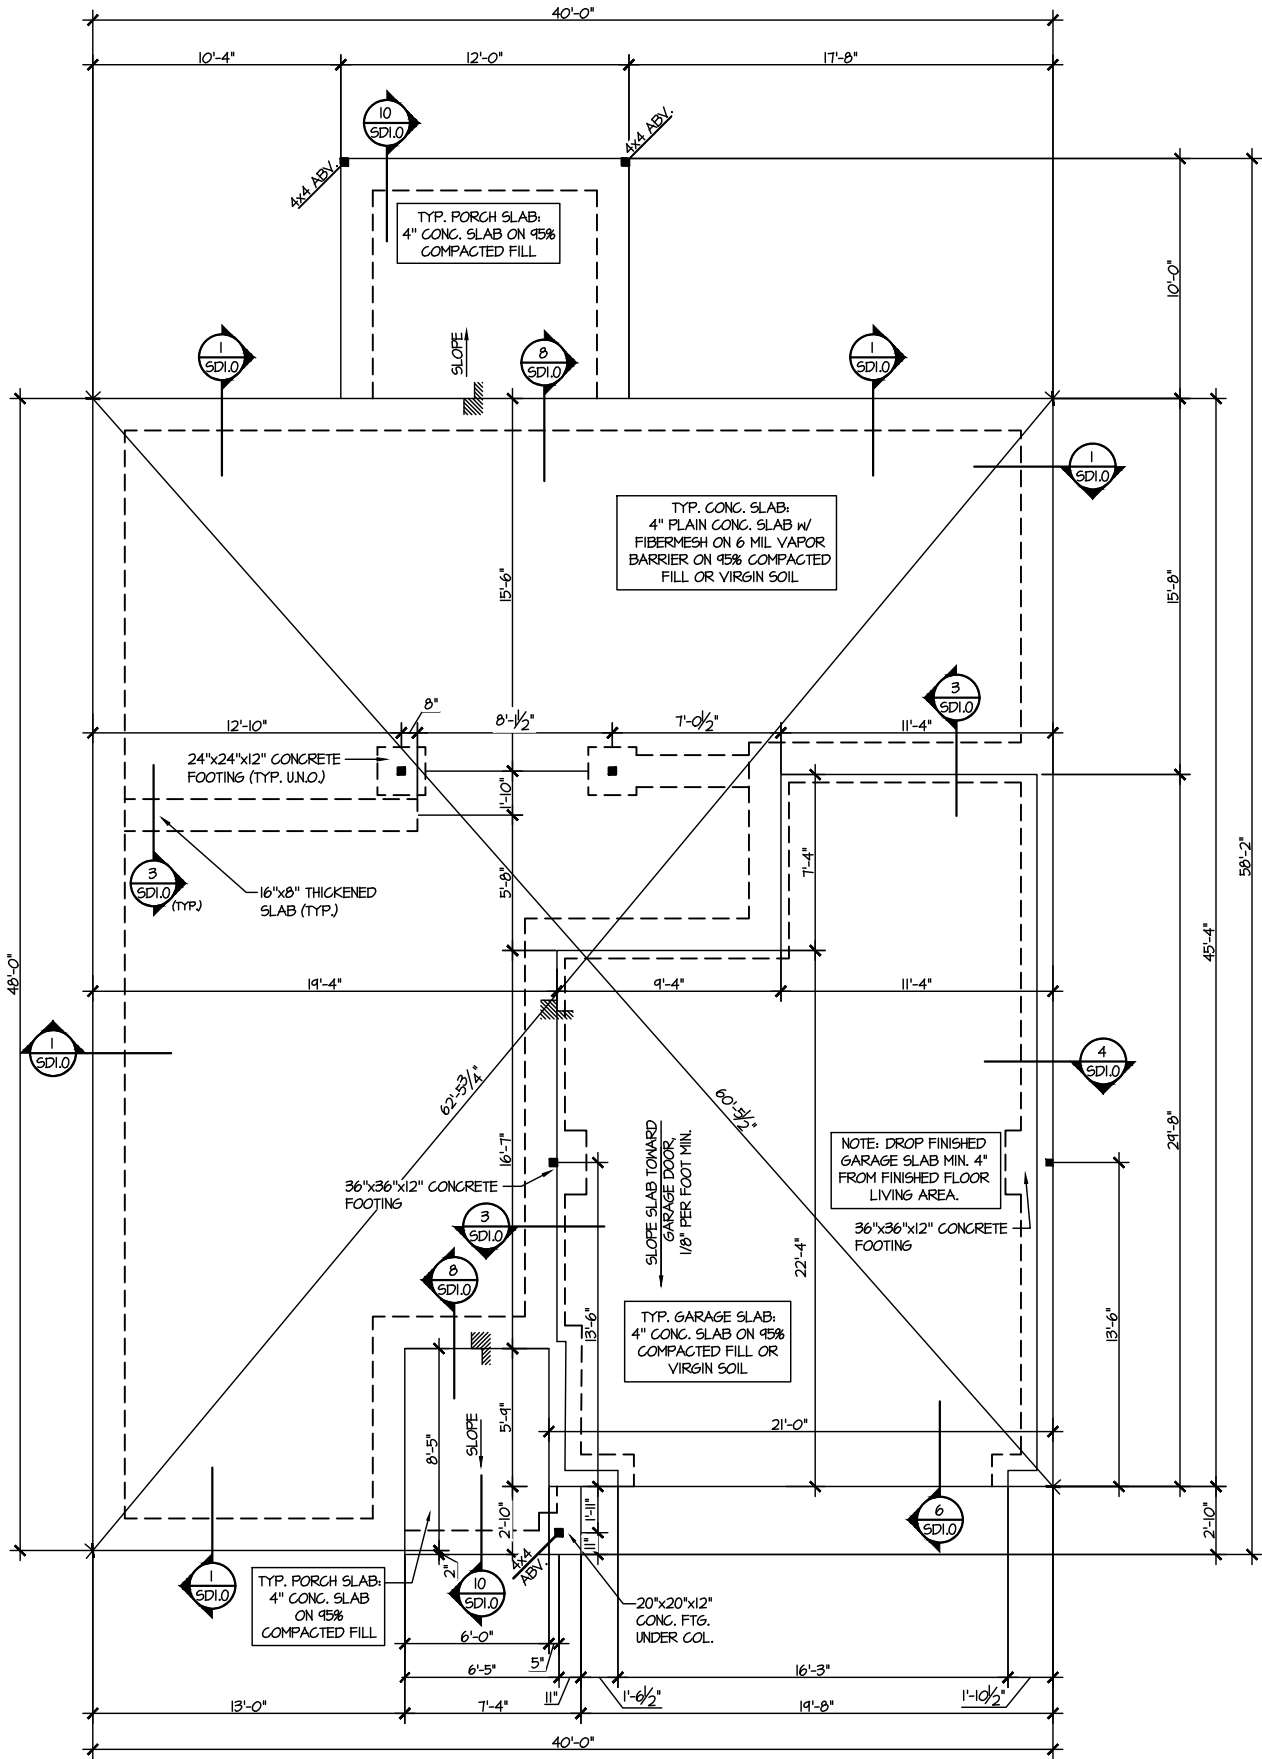


1 MONO SLAB FOUNDATION PLAN
SCALE: 1/8"=1'-0"

LEGEND

- INTERIOR BEARING WALL
- BEARING WALL ABOVE
- BEAM / HEADER
- INDICATES SHEAR WALL & EXTENT
- EXTENT OF OVERFRAMING
- METAL HANGER
- INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.
- INDICATES HOLD-DOWN OR STRAP. REFER TO SCHEDULE.

**REFER TO SO.0 FOR
TYPICAL STRUCTURAL NOTES
& SCHEDULES**

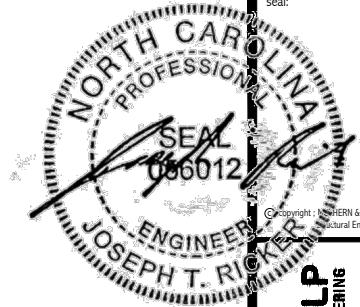

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING

300 Riverside Ave., Building 4 - Asheville, PA 10002
P 252-546-8001 • mulhern+kulp.com

NC LICENSE #C-3825

M&K project number:
126-22076


project mgr: JTR
drawn by: NLD
issue date: 07-14-25

REVISIONS:	
date:	initial:



FOUNDATION PLANS
FARM AT NEILS CREEK
LOT 29 - DRAYTON 4.1
RALEIGH, NC

sheet:
S1.0

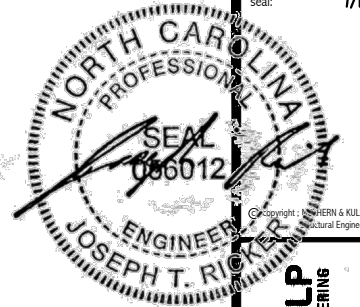

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
3000 Blackhawk Ave., Building 4 • Ambler, PA 19002
p 215-646-5001 • multip@mkp.com
NC LICENSE #C-3825

ALTERNATE F.J. MANUFACTURERS

- FLOOR JOISTS BY MANUFACTURER'S OTHER THAN THOSE SHOWN ON PLAN SHALL CONFORM TO THE APA PERFORMANCE RELATED I-JOISTS DESIGN AND CONSTRUCTION GUIDE. MINIMUM JOIST PROPERTIES INCLUDING, BUT NOT LIMITED TO, ALLOWABLE SHEAR, ALLOWABLE MOMENT, STRENGTH, AND STIFFNESS, SHALL MEET OR EXCEED THOSE LISTED FOR THE FRI-60 SERIES I-JOISTS. ALL ALLOWABLE HOLES, BEARING STIFFENERS, AND JOIST TO JOIST CONNECTIONS ARE PER THE JOIST MANUFACTURER.







ENGINEERED BEAM MATERIAL SCHEDULE

BEAM NUMBER	LVL OPTION	PSL OPTION	L5L OPTION	FLITCH OPTION	STEEL OPTION
001	(2)3/4"x14" - F	3/5"x14" - F	(2)3/4"x14" - F	(2)2x12 + (1) 3/4"x11/8" STEEL FLITCH PLATES - FB	M12x14 - F
002	(2)3/4"x14" - F	3/5"x14" - F	(2)3/4"x14" - F	(2)2x12 + (1) 3/4"x11/8" STEEL FLITCH PLATES - FB	M12x14 - F
003	(3)3/8"x18" - FB or (2)3/4"x20" - FB	3/4"x18" - FB	N/A	(3)2x12 + (2) 3/4"x11/8" STEEL FLITCH PLATES - FB	M12x26 - F
004	(2)3/4"x14" - F	3/5"x14" - F	(2)3/4"x14" - F	(2)2x12 + (1) 3/4"x11/8" STEEL FLITCH PLATES - FB	M12x14 - F
005	(2)3/4"x11 3/8" - H cont.	3/5"x11 3/8" - H cont.	(2)3/4"x11 3/8" - H cont.	(2)2x12 + (2) 3/4"x11/8" STEEL FLITCH PLATES - H cont.	N/A
005A	(3)3/4"x14" - H cont.	3/4"x14" - H cont.	N/A	(3)2x12 + (2) 3/4"x11/8" STEEL FLITCH PLATES - H cont.	N/A
006	(1)3/4"x14" - F	3/5"x14" - F	(2)3/4"x14" - F	(2)2x12 + (1) 3/4"x14" STEEL FLITCH PLATES - FB	M12x14 - F
007	(2)3/4"x11 3/8" - D	3/5"x11 3/8" - D	(2)3/4"x11 3/8" - D	(2)2x12 + (1) 3/4"x11/8" STEEL FLITCH PLATES - D	M10x12 - D
008	(2)3/4"x16" - H cont.	3/5"x16" - H cont.	(3)3/4"x16" - H cont.	(3)2x12 + (2) 3/4"x11/8" STEEL FLITCH PLATES - H cont.	N/A
009	(2)3/4"x9/4" - F	3/5"x9/4" - F	(2)3/4"x9/4" - F	(2)2x10 + (1) 3/4"x9/4" STEEL FLITCH PLATES - F	M8x10 - F
010	(2)3/4"x14" - F	3/5"x14" - F	(2)3/4"x14" - F	(2)2x12 + (1) 3/4"x11/8" STEEL FLITCH PLATES - FB	M12x14 - F
011	(2)3/4"x14" - F	3/5"x14" - F	(2)3/4"x14" - F	(2)2x12 + (1) 3/4"x11/8" STEEL FLITCH PLATES - FB	M12x14 - F
012	(2)3/4"x11 3/8" - D	3/5"x11 3/8" - D	(2)3/4"x11 3/8" - D	(2)2x12 + (1) 3/4"x11/8" STEEL FLITCH PLATES - D	M10x12 - D

- **BEAM NOTATION:**
 - "F" INDICATES FLUSH BEAM
 - "FT" INDICATES FLUSH TOP BEAM
 - "FB" INDICATES FLUSH BOTTOM BEAM
 - "D" INDICATES DROPPED BEAM
 - "H" INDICATES DROPPED OPENING HEADER
- REFER TO DETAIL D/S2D.0 FOR TYPICAL FLITCH BEAM CONNECTIONS
- REFER TO DETAIL E/S2D.0 FOR TYPICAL STEEL BEAM CONNECTIONS
- FOR FLUSH TOP BEAMS PROVIDE 2x STACKED PLATES BENEATH BEAM AS REQ'D. FASTEN PLATES IN SUCCESSION W/ (2) 3"x10"120" NAILS @ 8" O.C.
- FOR FLUSH BOTTOM BEAMS PROVIDE 2x STACKED PLATES ATOB BEAM AS REQ'D. FASTEN PLATES IN SUCCESSION W/ (2) 3"x10"120" NAILS @ 8" O.C.

SD2.I REFERS TO SD2.IA FOR
LVL/PSL/LSL BEAMS OR SD2.IB
FOR FLITCH BEAMS OR SD2.IC
FOR STEEL BEAMS


LEGEND

-  INTERIOR BEARING WALL
 -  BEARING WALL ABOVE
 -  BEAM / HEADER
 -  INDICATES SHEAR WALL & EXTENT
 -  EXTENT OF OVERFRAMING
- 11. METAL HANGER**
- * INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.
-  INDICATES HOLD-DOWN OR STRAP. REFER TO SCHEDULE.


REFER TO 50.0 FOR
TYPICAL STRUCTURAL NOTES
& SCHEDULES

FOUR TRAMING PLANS
FARM AT NEIL'S CREEK
LOT 29 - DRAYTON 4:1
RALEIGH, NC

S2.0

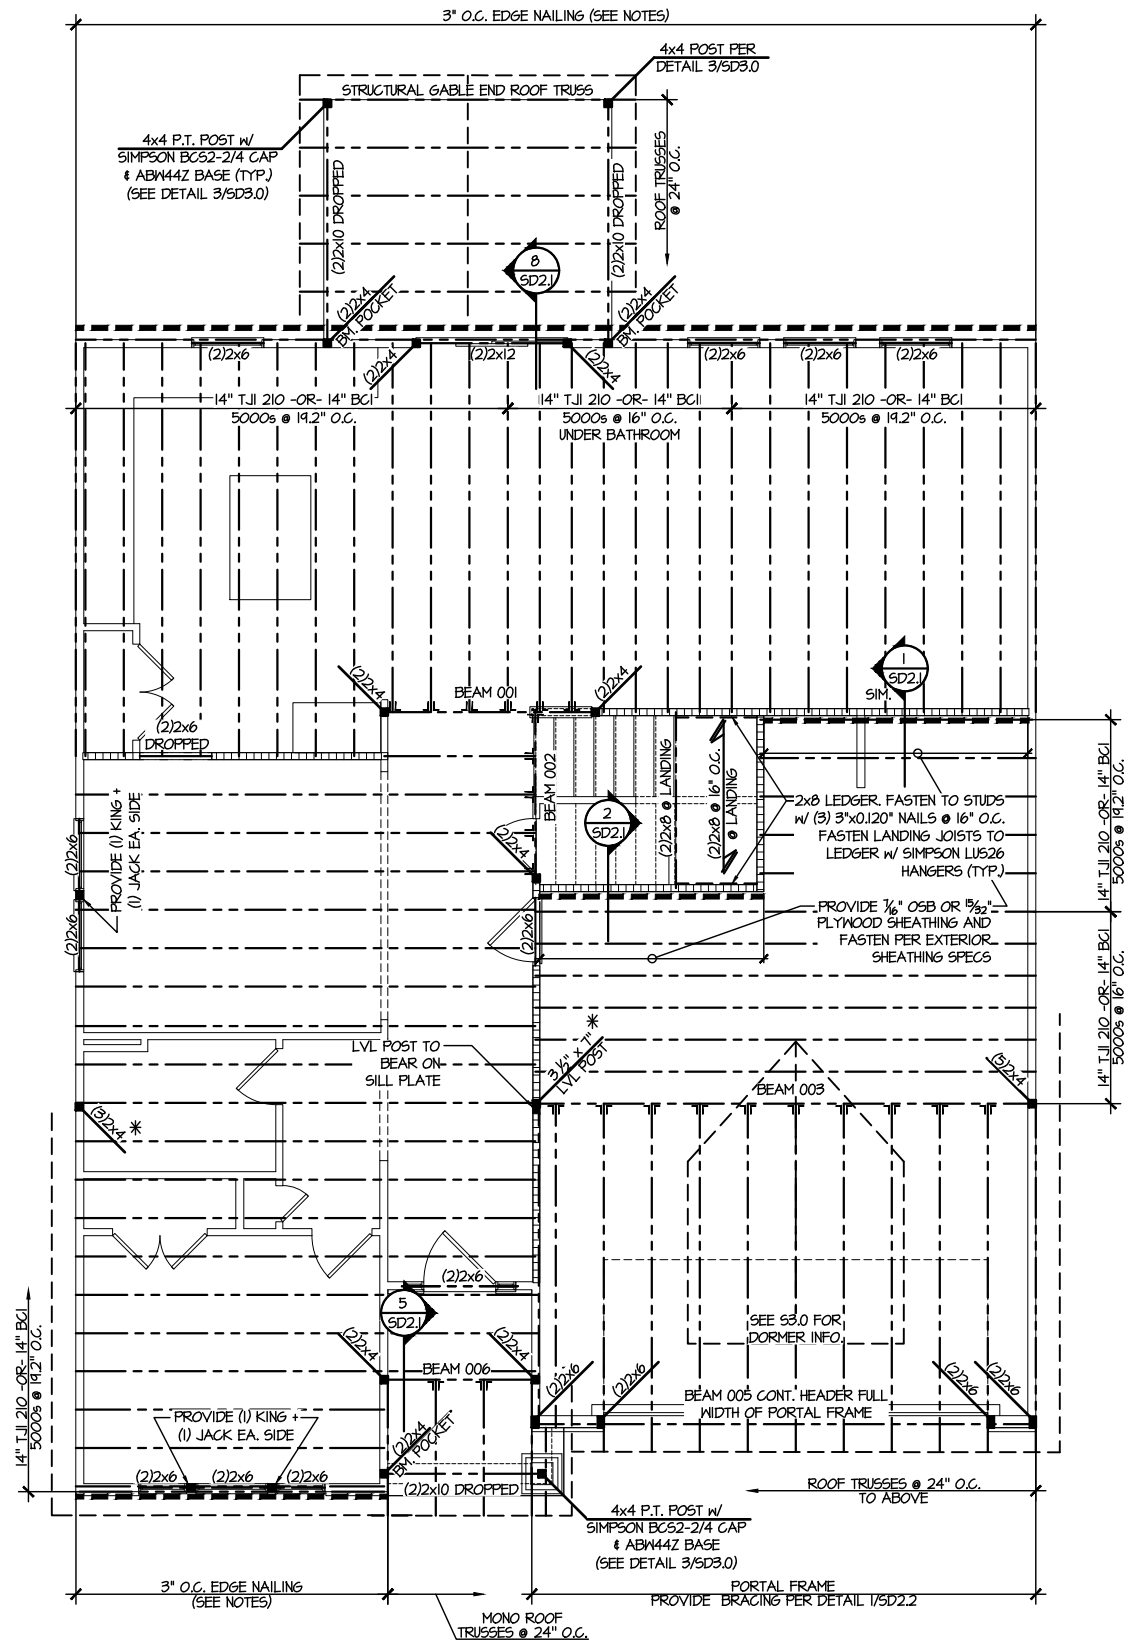

2ND FLOOR FRAMING PLAN
SCALE: 1/8"=1'-0"

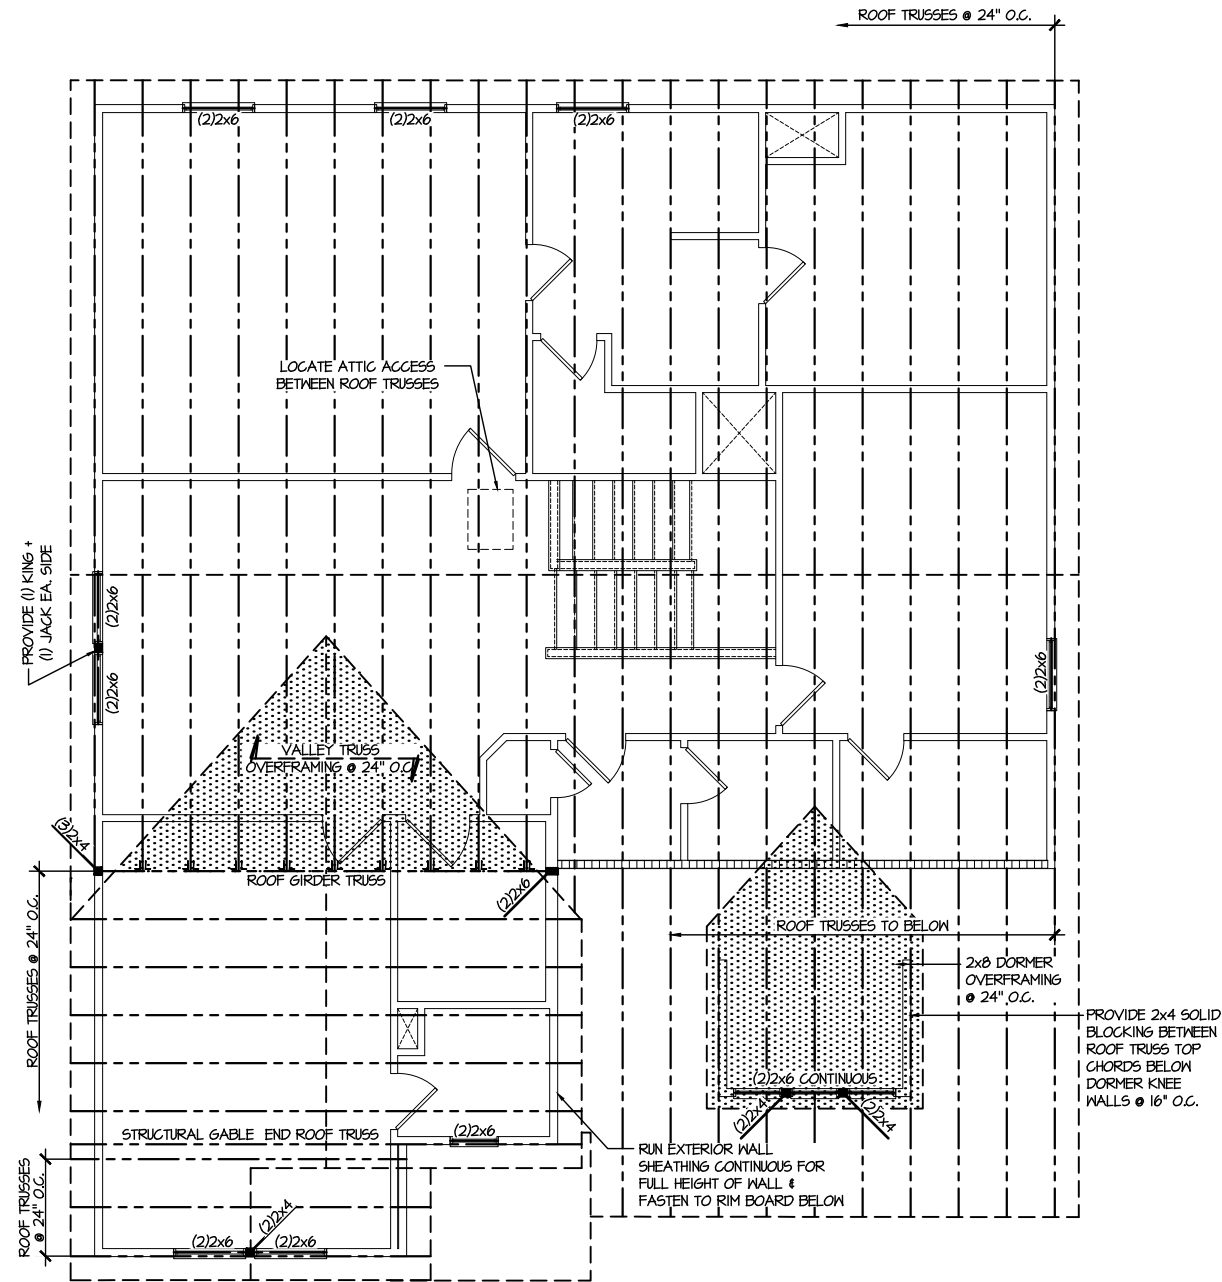

1 ROOF FRAMING PLAN
SCALE: 1/8"=1'-0"

LEGEND

- INTERIOR BEARING WALL
- BEARING WALL ABOVE
- BEAM / HEADER
- INDICATES SHEAR WALL & EXTENT
- EXTENT OF OVERFRAMING
- 11 METAL HANGER
- * INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.
- ▶ INDICATES HOLD-DOWN OR STRAP. REFER TO SCHEDULE.

**REFER TO S.O. FOR
TYPICAL STRUCTURAL NOTES
& SCHEDULES**

seal: 7/17/25

NORTH CAROLINA
PROFESSIONAL
SEAL
086012
ENGINEER
JOSEPH T. RICKER


MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Riverside Ave., Building 4 - Asheville, PA 10002
P 215-946-8001 • mulhern+kulp.com
NC LICENSE #C-3825

M&K project number:	126-22076
project mgr:	JTR
drawn by:	NLD
issue date:	07-14-25
REVISIONS:	
date:	initial:




ROOF FRAMING PLANS
FARM AT NEILS CREEK
LOT 29 - DRAYTON 4.1
RALEIGH, NC

sheet:
S3.0

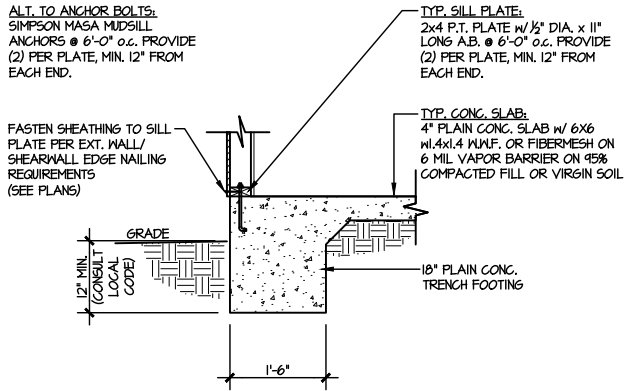


1 TYPICAL SLAB ON GRADE
PERIMETER FOOTING

SCALE: 3/8"=1'-0"

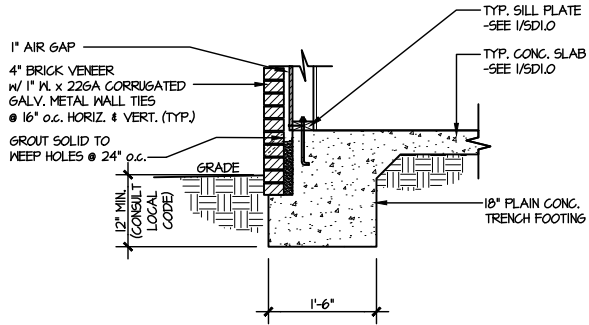


2 TYPICAL SLAB ON GRADE
PERIMETER FOOTING

SCALE: 3/8"=1'-0"

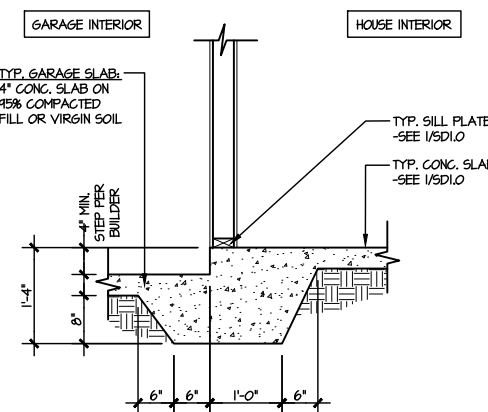


3 TYPICAL MONOLITHIC INTERIOR
GARAGE FOOTING

SCALE: 3/8"=1'-0"

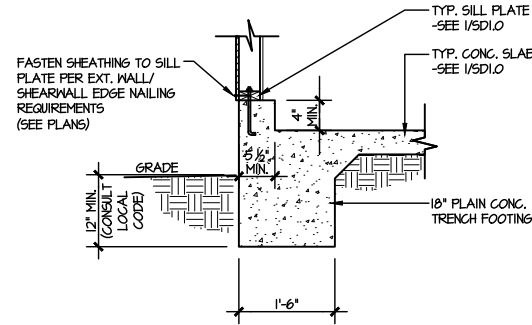


4 TYPICAL SLAB ON GRADE GARAGE
PERIMETER FOOTING

SCALE: 3/8"=1'-0"

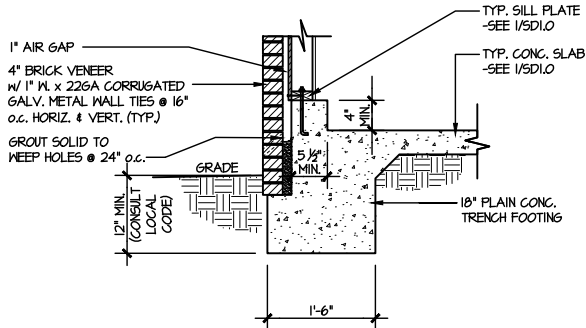


5 TYPICAL SLAB ON GRADE GARAGE
PERIMETER FOOTING

SCALE: 3/8"=1'-0"

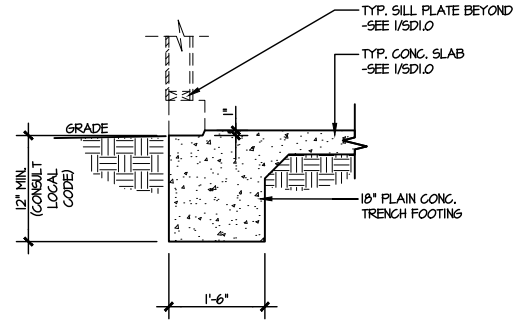


6 TYPICAL SLAB ON GRADE GARAGE
ENTRY & PERIMETER FOOTING

SCALE: 3/8"=1'-0"

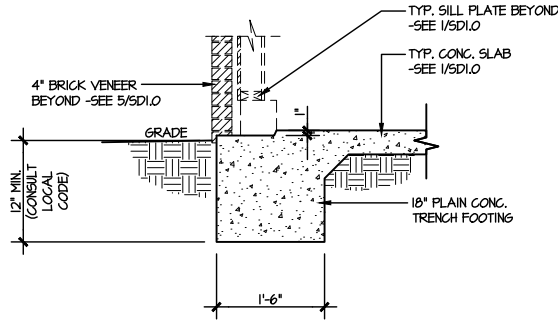


7 TYPICAL SLAB ON GRADE GARAGE
ENTRY & PERIMETER FOOTING

SCALE: 3/8"=1'-0"

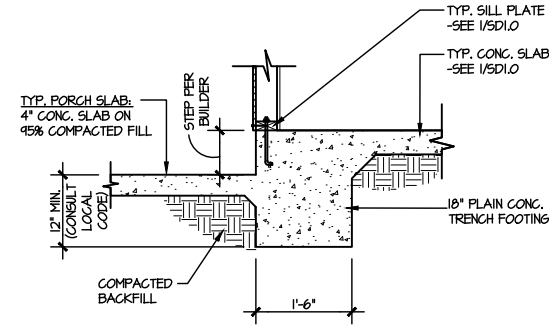


8 TYPICAL SLAB ON GRADE PERIMETER
FOOTING & PORCH/PATIO

SCALE: 3/8"=1'-0"

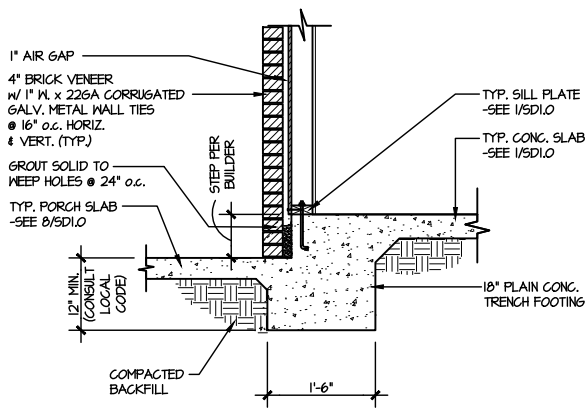


9 TYPICAL SLAB ON GRADE PERIMETER
FOOTING & PORCH/PATIO

SCALE: 3/8"=1'-0"

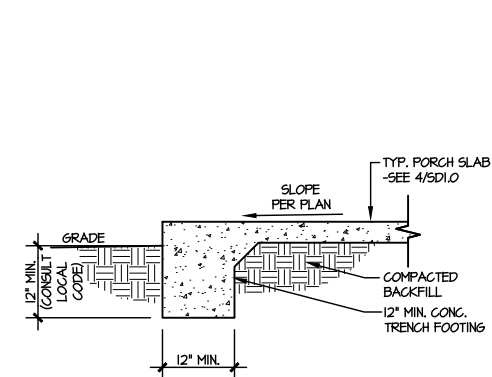


10 TYPICAL FOOTING & PORCH SLAB

SCALE: 3/8"=1'-0"

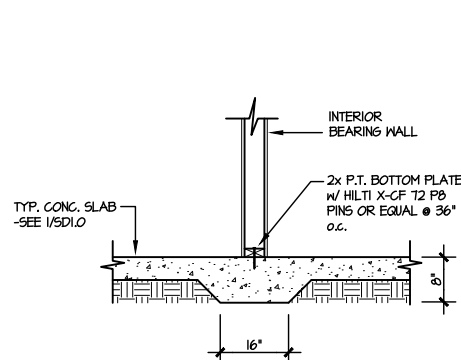

11 TYPICAL THICKENED SLAB @
INTERIOR BEARING WALL

SCALE: 3/8"=1'-0"

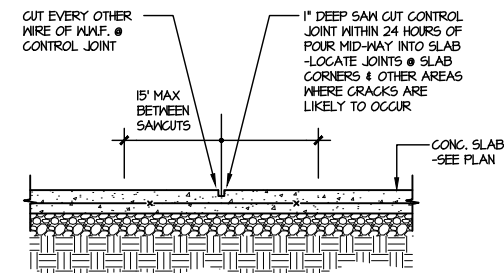


A TYPICAL CONTROL JOINT

SCALE: 3/8"=1'-0"

LOCATE @ 15'-0" o.c. MAX.
OR CORNERS WHERE CRACKS
LIKELY TO DEVELOP

LETTERED DETAILS ARE TYPICAL FOR
THIS HOME & SHALL BE IMPLEMENTED IN
ALL APPLICABLE AREAS. THESE
DETAILS ARE NOT "CUT" ON THE PLANS.

NUMBERED DETAILS ARE PLAN
SPECIFIC AND ARE ONLY REQUIRED
WHERE SPECIFICALLY INDICATED
("CUT") ON THE PLANS.

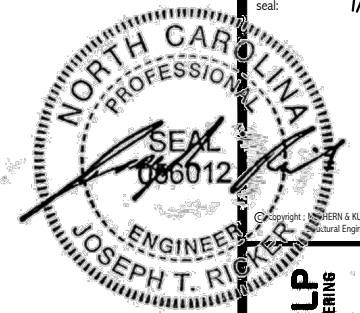

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Bunkie Ave., Building 4 - Asheville, PA 10002
P 215-546-8001 - mulhern+kulp.com

NC LICENSE #C-3825

M&K project number:
126-22076

project mgr: JTR
drawn by: NLD
issue date: 07-14-25


REVISIONS:
date: initial:

DRB
HOMES


FOUNDATION DETAILS
FARM AT NEILS CREEK
LOT 29 - DRAYTON 41
RALEIGH, NC

sheet:


SD1.0

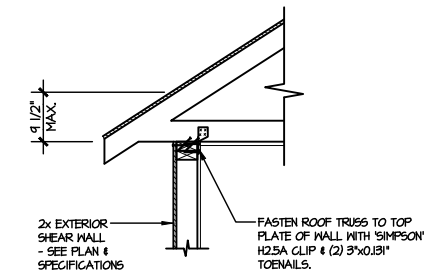


**TYPICAL SHEAR
TRANSFER DETAIL @ ROOF**
A1 SCALE: 3/8"=1'-0" HEEL HEIGHT LESS THAN 9 1/2" NO BLOCKING REQ'D

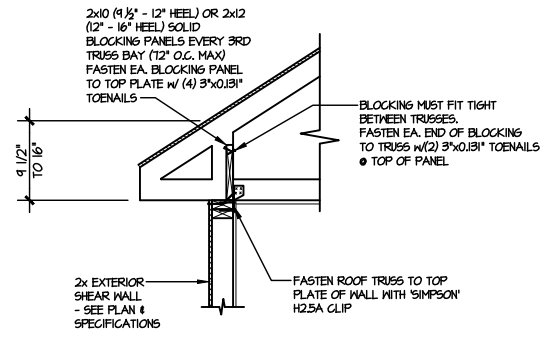


**TYPICAL SHEAR
TRANSFER DETAIL @ ROOF**
A2 SCALE: 3/8"=1'-0" HEEL HEIGHT BETWEEN 9 1/2" - 16" BLOCKING REQ'D

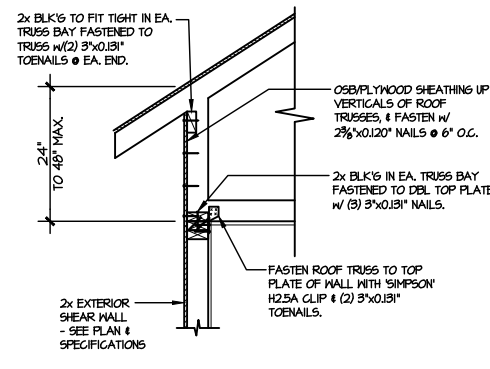


**TYPICAL SHEAR TRANSFER
DETAIL @ RAISED HEEL TRUSS**
A3 SCALE: 3/8"=1'-0" HEEL HEIGHT UP TO 48" MAX.

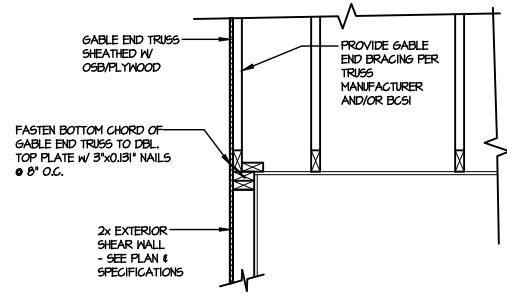


TYPICAL GABLE END DETAIL
B SCALE: 3/8"=1'-0"

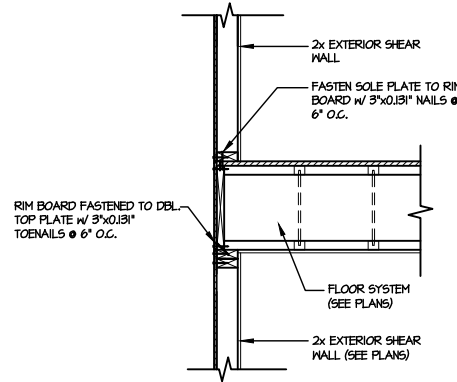

**TYPICAL SHEAR TRANSFER DETAIL
BETWEEN FLOORS @ EXTERIOR WALL**
C SCALE: 3/8"=1'-0"

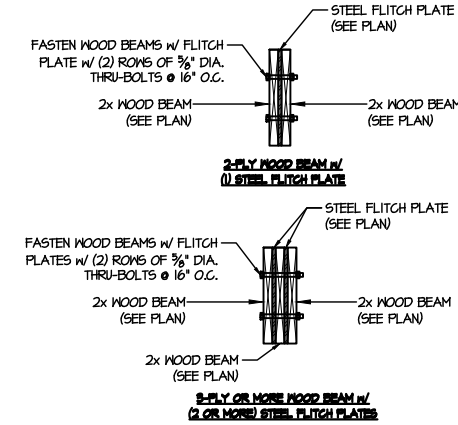


TYPICAL FLITCH BEAM CONNECTION DETAIL
D SCALE: 3/4"=1'-0"

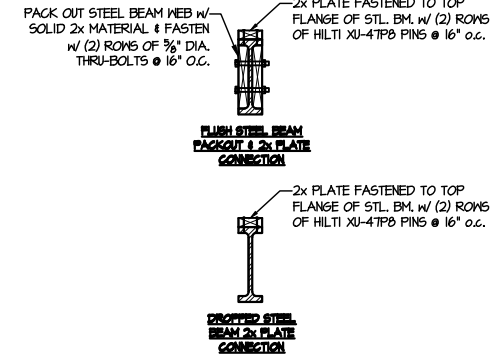

TYPICAL STEEL BEAM CONNECTION DETAIL
E SCALE: 3/4"=1'-0"

LETTERED DETAILS ARE TYPICAL FOR THIS HOME & SHALL BE IMPLEMENTED IN ALL APPLICABLE AREAS. THESE DETAILS ARE NOT "CUT" ON THE PLANS.

NUMBERED DETAILS ARE PLAN SPECIFIC AND ARE ONLY REQUIRED WHERE SPECIFICALLY INDICATED ("CUT") ON THE PLANS.

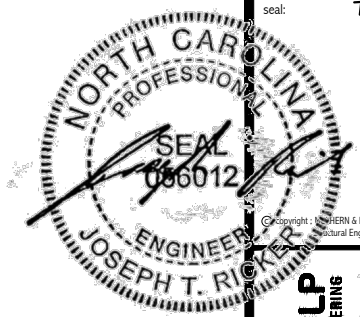

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
3000 Bunkie Ave, Building 4 - Asheville, NC 28802
P 252-946-8801 - mulhern+kulp.com
NC LICENSE #C-3825

M&K project number:
126-22076


project mgr: **JTR**
drawn by: **NLD**
issue date: **07-14-25**

REVISIONS:	
date:	initial:


DRB
HOMES

FRAMING DETAILS
FARM AT NEIL'S CREEK
LOT 29 - DRAYTON 4.1
RALEIGH, NC


sheet:
SD2.0

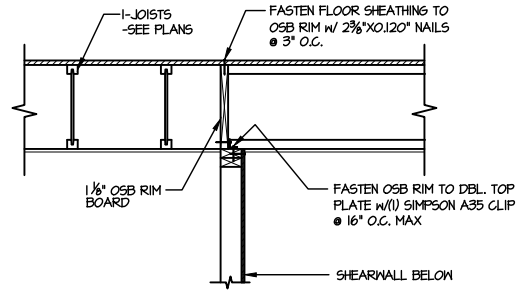


1 SHEAR TRANSFER DETAIL @ INTERIOR SHEARWALL BELOW
SCALE: 3/4"=1'-0" PARALLEL FRAMING

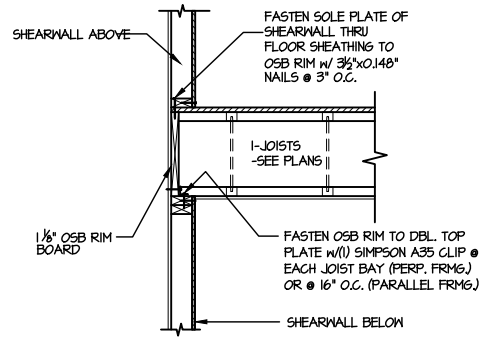


2 SHEAR TRANSFER DETAIL @ INT. SHEARWALL ABOVE & BELOW
SCALE: 3/4"=1'-0" EDGE OF FRAMING

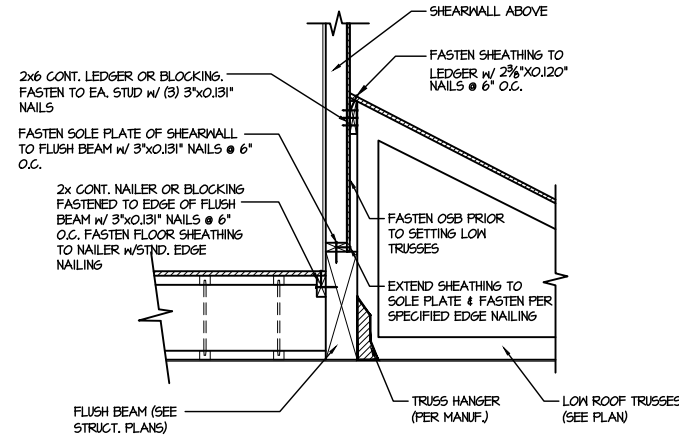


3 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

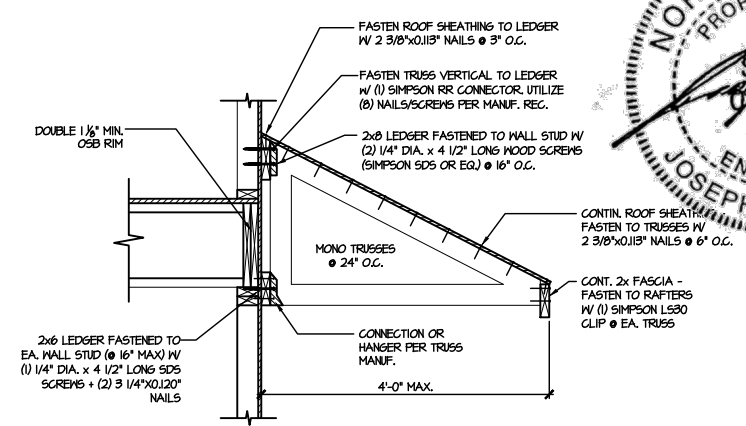


4 DETAIL @ SHED ROOF
SCALE: 3/8"=1'-0"

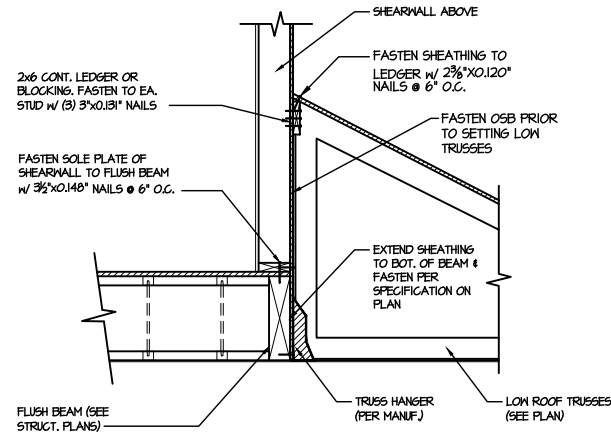


5 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

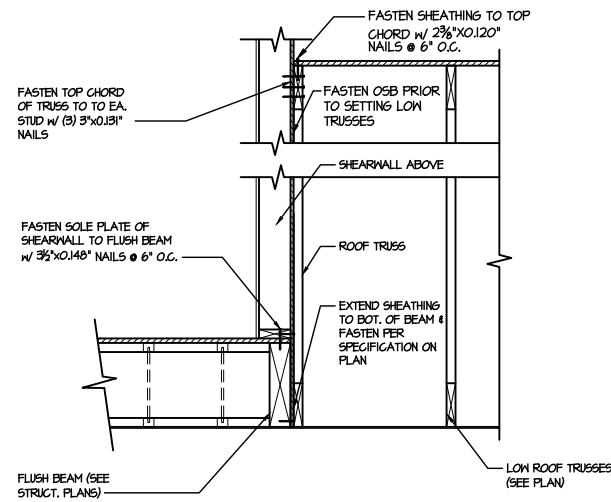


6 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

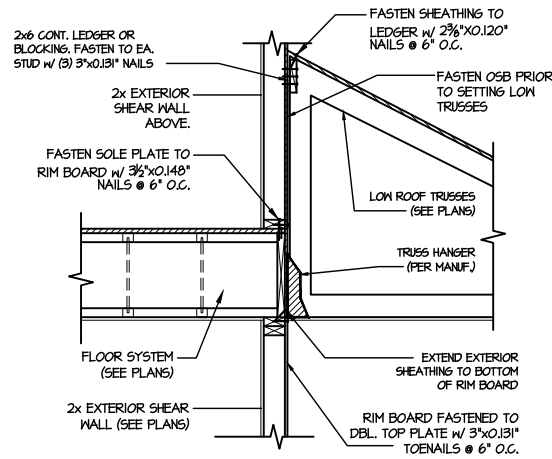


7 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ INTERIOR WALL
SCALE: 3/4"=1'-0"

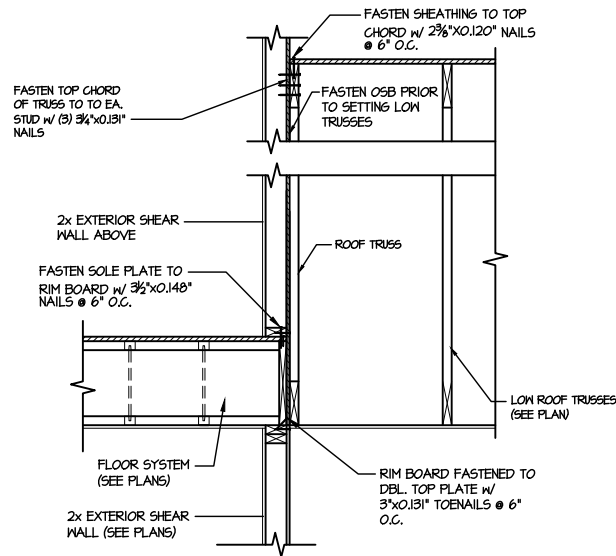

8 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ INTERIOR WALL
SCALE: 3/4"=1'-0"

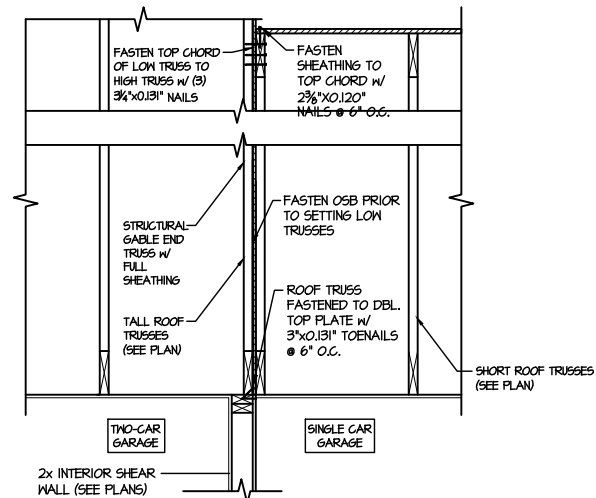


9 TYPICAL SHEAR TRANSFER DETAIL BETWEEN GARAGE BAYS
SCALE: 3/4"=1'-0"

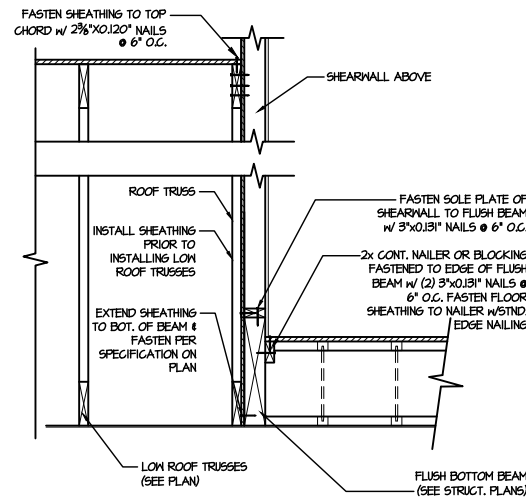

13 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

LETTERED DETAILS ARE TYPICAL FOR THIS HOME & SHALL BE IMPLEMENTED IN ALL APPLICABLE AREAS. THESE DETAILS ARE NOT "CUT" ON THE PLANS.

NUMBERED DETAILS ARE PLAN SPECIFIC AND ARE ONLY REQUIRED WHERE SPECIFICALLY INDICATED ("CUT") ON THE PLANS.

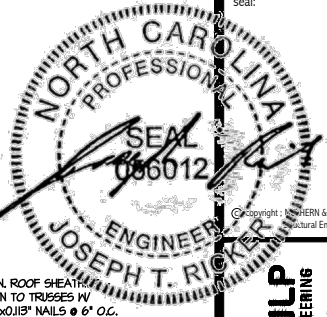


M&K project number: 126-22076
project mgr: JTR
drawn by: NLD
issue date: 07-14-25

REVISIONS:
date: initial:




FRAMING DETAILS
FARM AT NEIL'S CREEK
LOT 29 - DRAYTON 4.1
RALEIGH, NC


sheet: SD2.1A

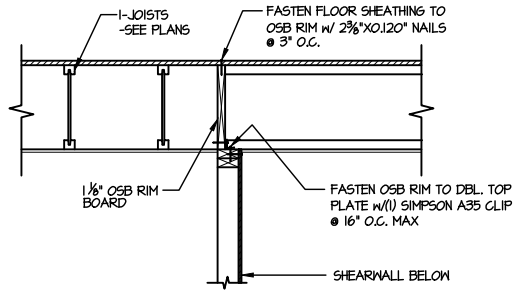


1 SHEAR TRANSFER DETAIL @ INTERIOR SHEARWALL BELOW
SCALE: 3/4"=1'-0"
PARALLEL FRAMING

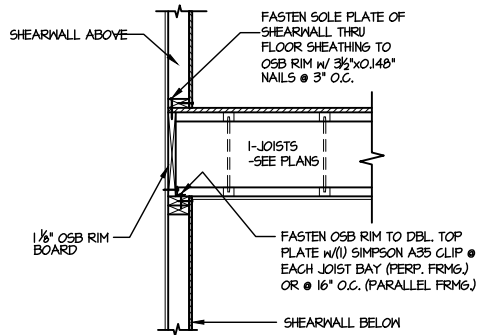


2 SHEAR TRANSFER DETAIL @ INT. SHEARWALL ABOVE & BELOW
SCALE: 3/4"=1'-0"
EDGE OF FRAMING

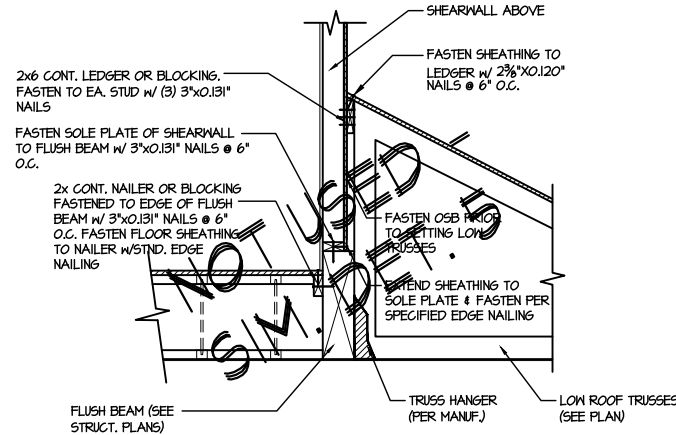


3 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

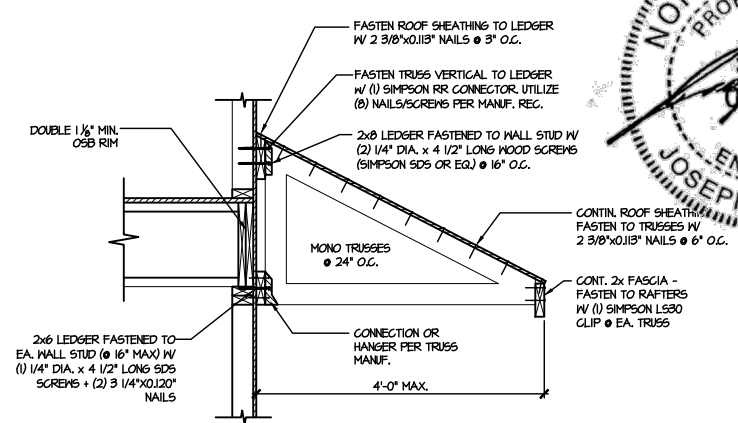


4 DETAIL @ SHED ROOF
SCALE: 3/8"=1'-0"

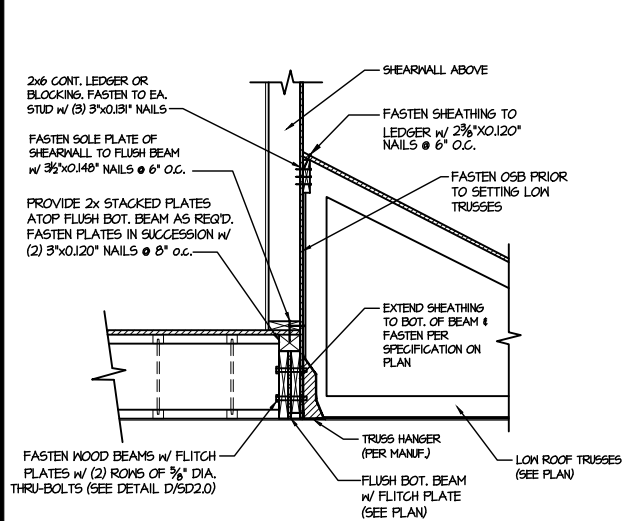


5 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

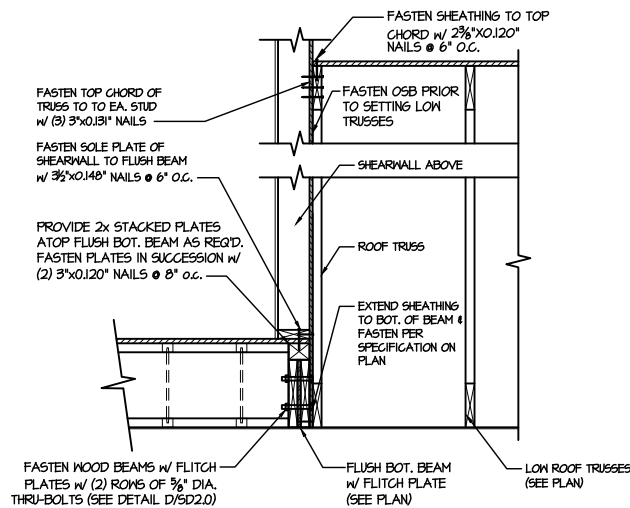


6 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

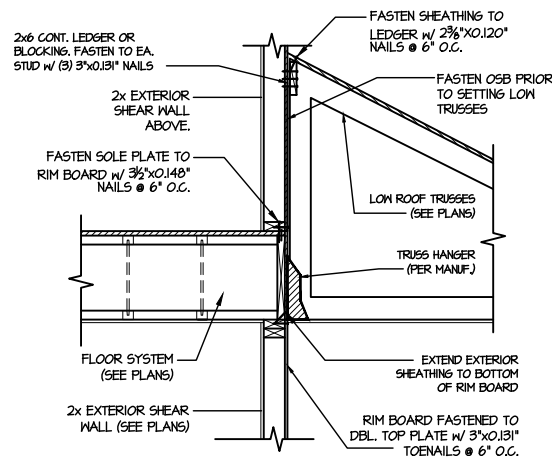


7 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ INTERIOR WALL
SCALE: 3/4"=1'-0"

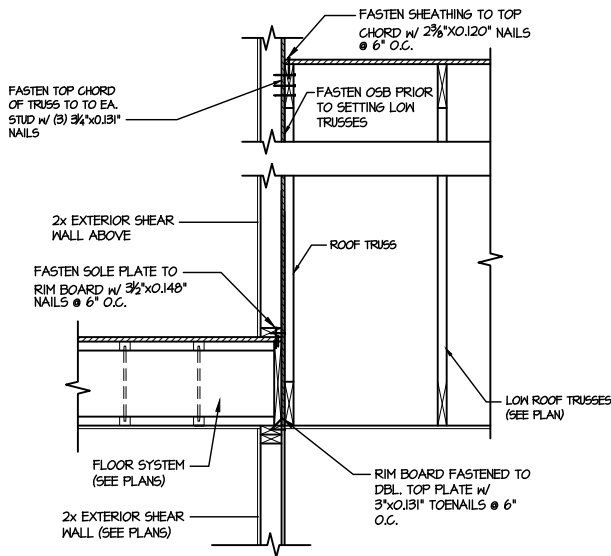

8 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ INTERIOR WALL
SCALE: 3/4"=1'-0"

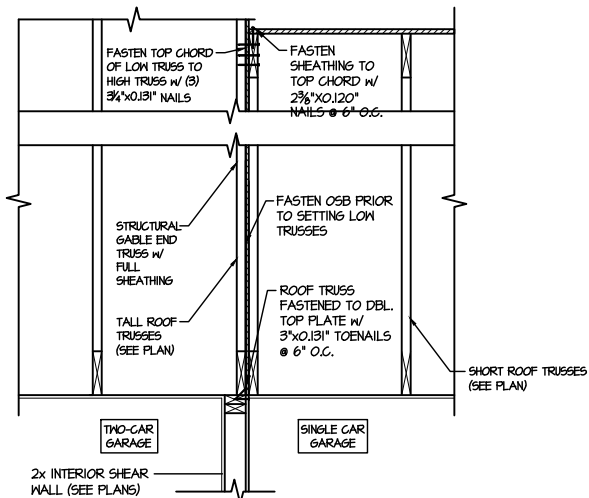


9 TYPICAL SHEAR TRANSFER DETAIL BETWEEN GARAGE BAYS
SCALE: 3/4"=1'-0"

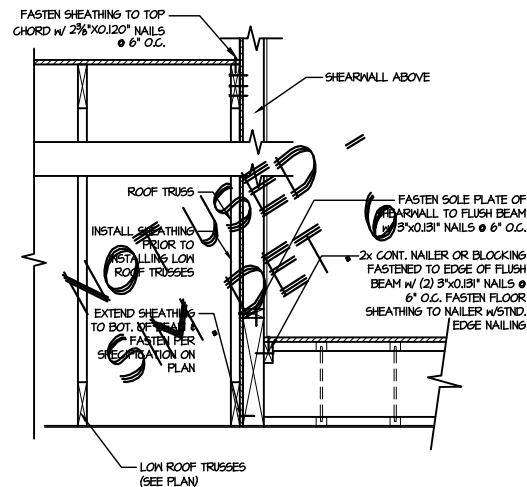

13 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

LETTERED DETAILS ARE TYPICAL FOR THIS HOME & SHALL BE IMPLEMENTED IN ALL APPLICABLE AREAS. THESE DETAILS ARE NOT "CUT" ON THE PLANS.

NUMBERED DETAILS ARE PLAN SPECIFIC AND ARE ONLY REQUIRED WHERE SPECIFICALLY INDICATED ("CUT") ON THE PLANS.

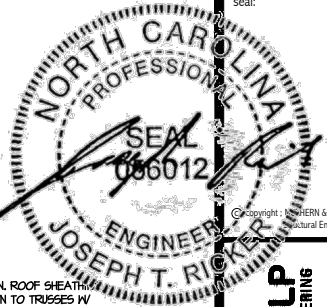

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Remondelle Ave., Building 4 - Asheville, PA 18002
P: 215-546-8801 - mulhern+kulp.com
NC LICENSE #C-3825

M&K project number:
126-22076


project mgr: **JTR**
drawn by: **NLD**
issue date: **07-14-25**

REVISIONS:
date: initial:


DRB HOMES

FRAMING DETAILS
FARM AT NEIL'S CREEK
LOT 29 - DRAYTON 41
RALEIGH, NC


sheet:
SD2.1B

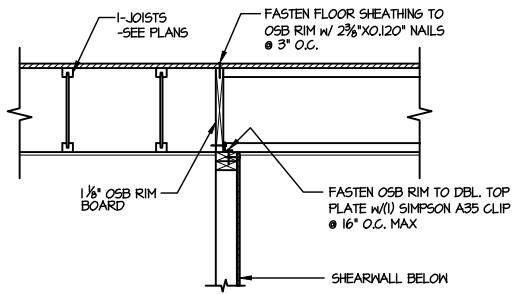


1 SHEAR TRANSFER DETAIL @ INTERIOR SHEARWALL BELOW
SCALE: 3/4"=1'-0" PARALLEL FRAMING

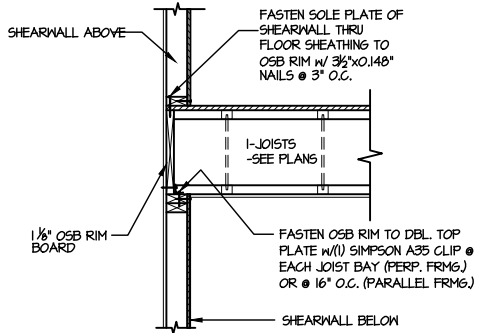


2 SHEAR TRANSFER DETAIL @ INT. SHEARWALL ABOVE & BELOW
SCALE: 3/4"=1'-0" EDGE OF FRAMING

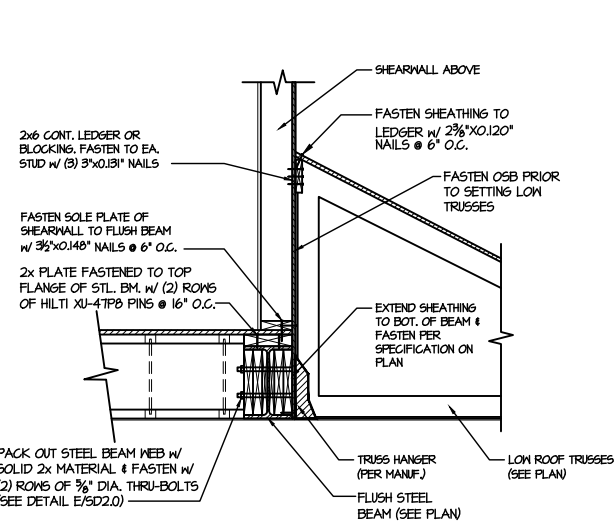


5 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

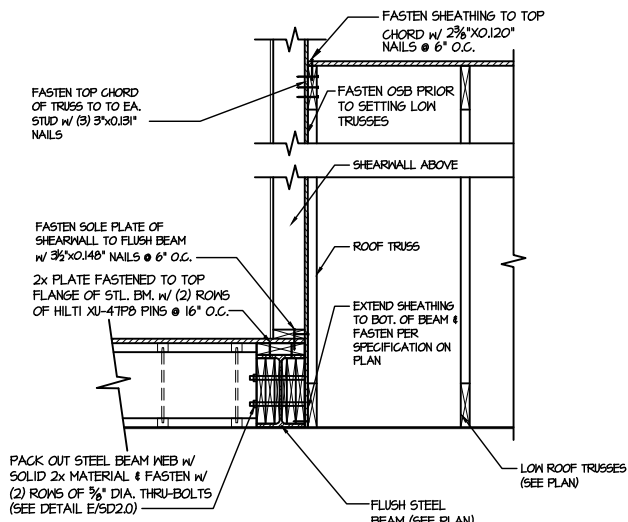


6 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

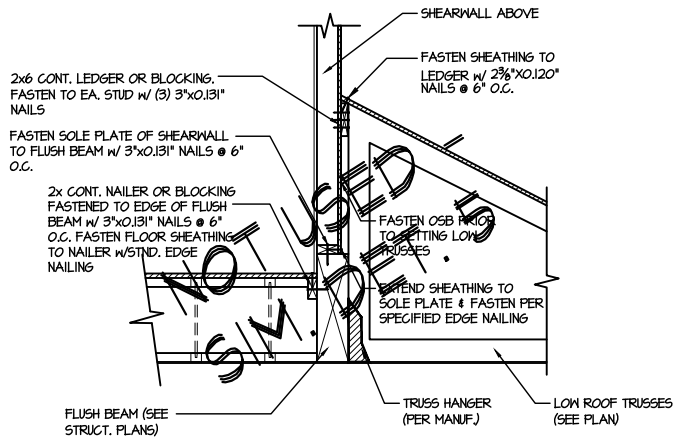


3 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

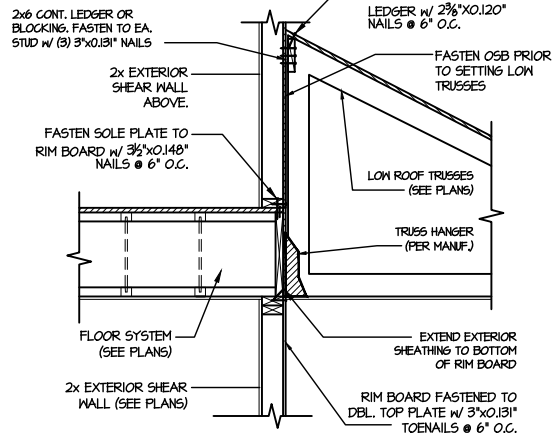


7 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ INTERIOR WALL
SCALE: 3/4"=1'-0"

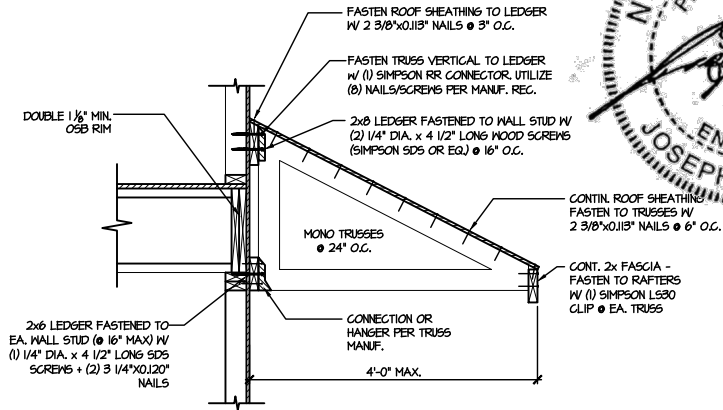


4 DETAIL @ SHED ROOF
SCALE: 3/8"=1'-0"

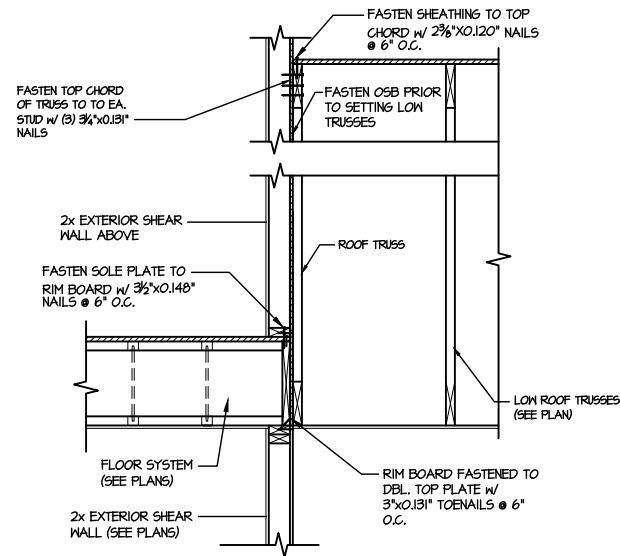

8 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ INTERIOR WALL
SCALE: 3/4"=1'-0"

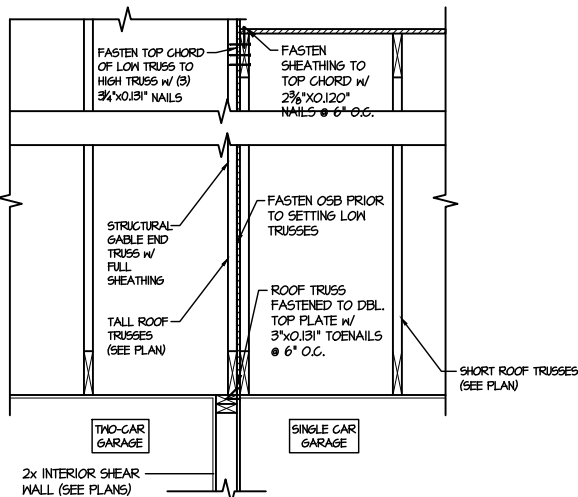


9 TYPICAL SHEAR TRANSFER DETAIL BETWEEN GARAGE BAYS
SCALE: 3/4"=1'-0"

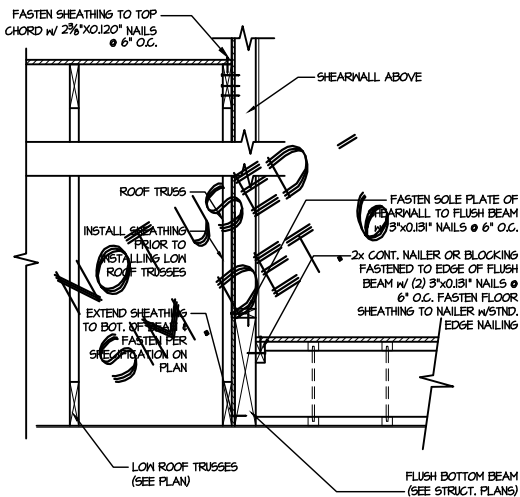

13 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

LETTERED DETAILS ARE TYPICAL FOR THIS HOME & SHALL BE IMPLEMENTED IN ALL APPLICABLE AREAS. THESE DETAILS ARE NOT "CUT" ON THE PLANS.




NUMBERED DETAILS ARE PLAN SPECIFIC AND ARE ONLY REQUIRED WHERE SPECIFICALLY INDICATED ("CUT") ON THE PLANS.

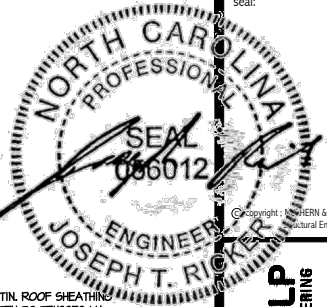


M&K project number:	126-22076
project mgr:	JTR
drawn by:	NLD
issue date:	07-14-25
REVISIONS:	
date:	initial:



FRAMING DETAILS
FARM AT NEILS CREEK
LOT 29 - DRAYTON 4.1
RALEIGH, NC

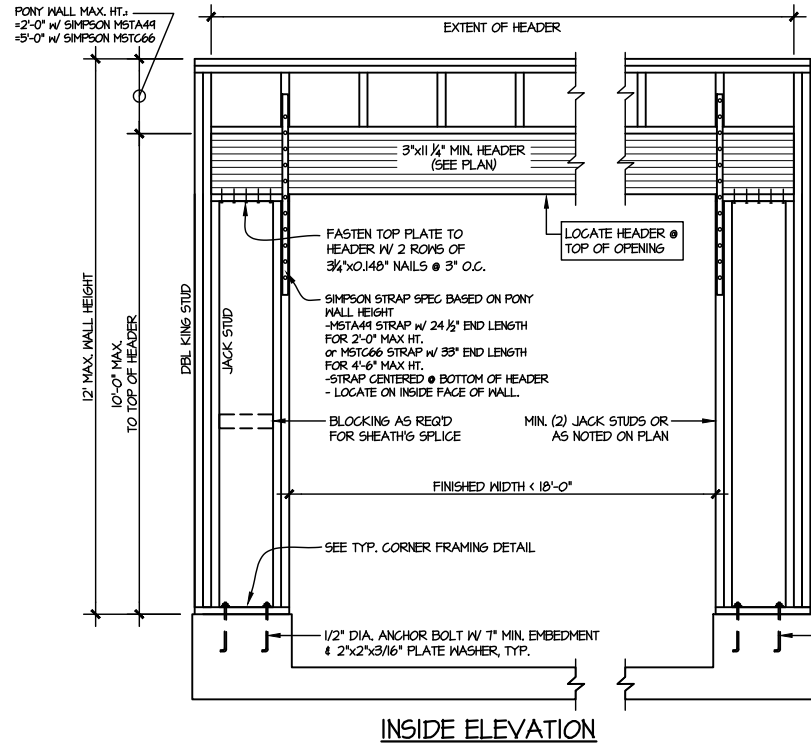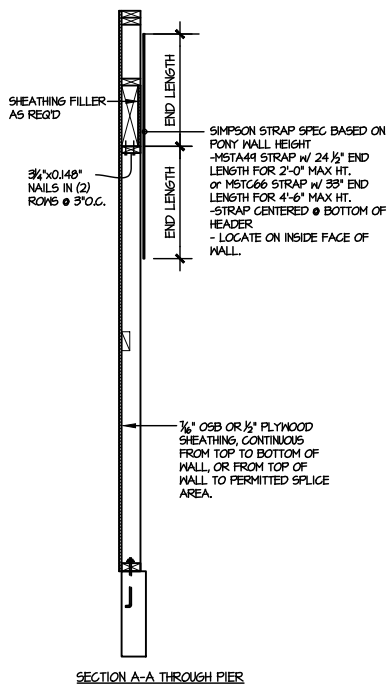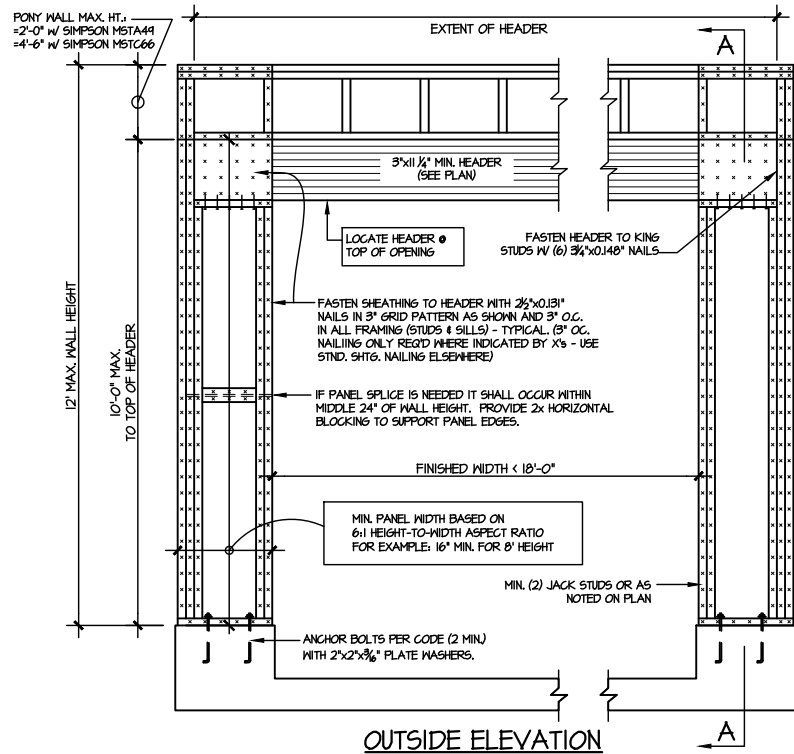


NOTE: ALL SHEATHABLE AREAS OF
EXTERIOR WALL SHALL BE FULLY
SHEATHED WITH 1/2" PLYWOOD OR 1/2" OSB



- ALTERNATIVES TO 1/2" DIA. ANCHOR BOLT:
- 1) 1/2" DIA. x 6" LONG SIMPSON TITEN HD
 - 2) 1/2" DIA. THREADED ROD EPOXY SET
W/ 4 1/2" EMBED. (MIN) UTILIZING HILTI HY200
EPOXY ANCHORING SYSTEM (OR EQUAL)

TWO SIDED GARAGE PORTAL FRAME BRACING
ELEVATION ON CONCRETE STEM

SCALE: N.T.S.

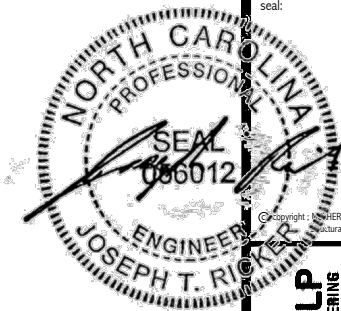

7/17/25

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Bunkie Ave, Building 4 - Asheville, PA 18002
P 215-546-8801 • mulhern+kulp.com
NC LICENSE #C-3825

M&K project number:
126-22076



project mgr: JTR
drawn by: NLD
issue date: 07-14-25

REVISIONS:
date: initial:

DRB
HOMES

FRAMING DETAILS
FARM AT NEILS CREEK
LOT 29 - DRAYTON 4.1
RALEIGH, NC

sheet:
SD2.2

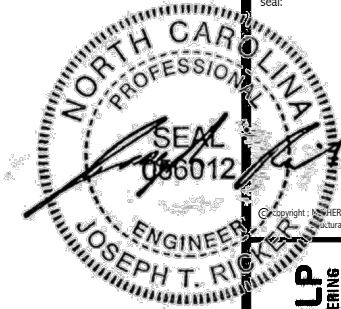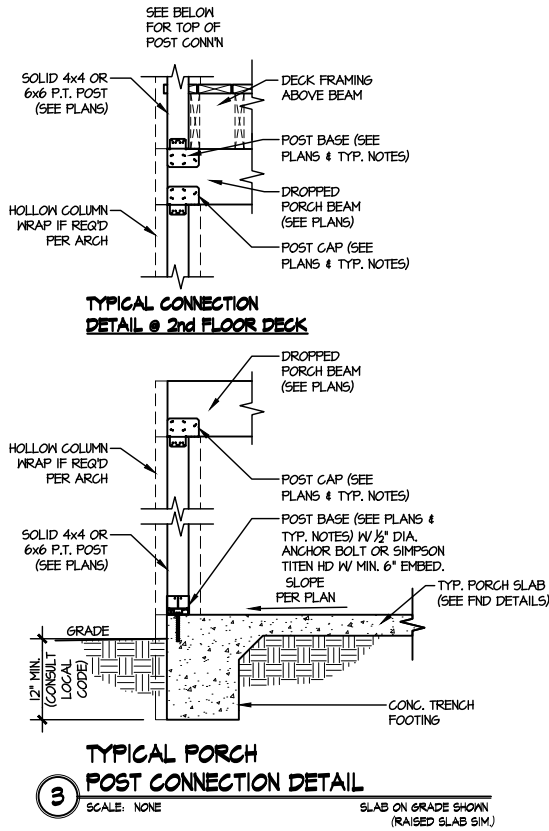

M&K project number:
126-22076

project mgr: JTR
drawn by: NLD
issue date: 07-14-25

REVISIONS:	
date:	initial:



FRAMING DETAILS

FARM AT NEIL'S CREEK


LOT 29 - DRAYTON 4.1

RALEIGH, NC

sheet:
SD3.0

OWF TRUSS LAYOUT

SCALE: NTS

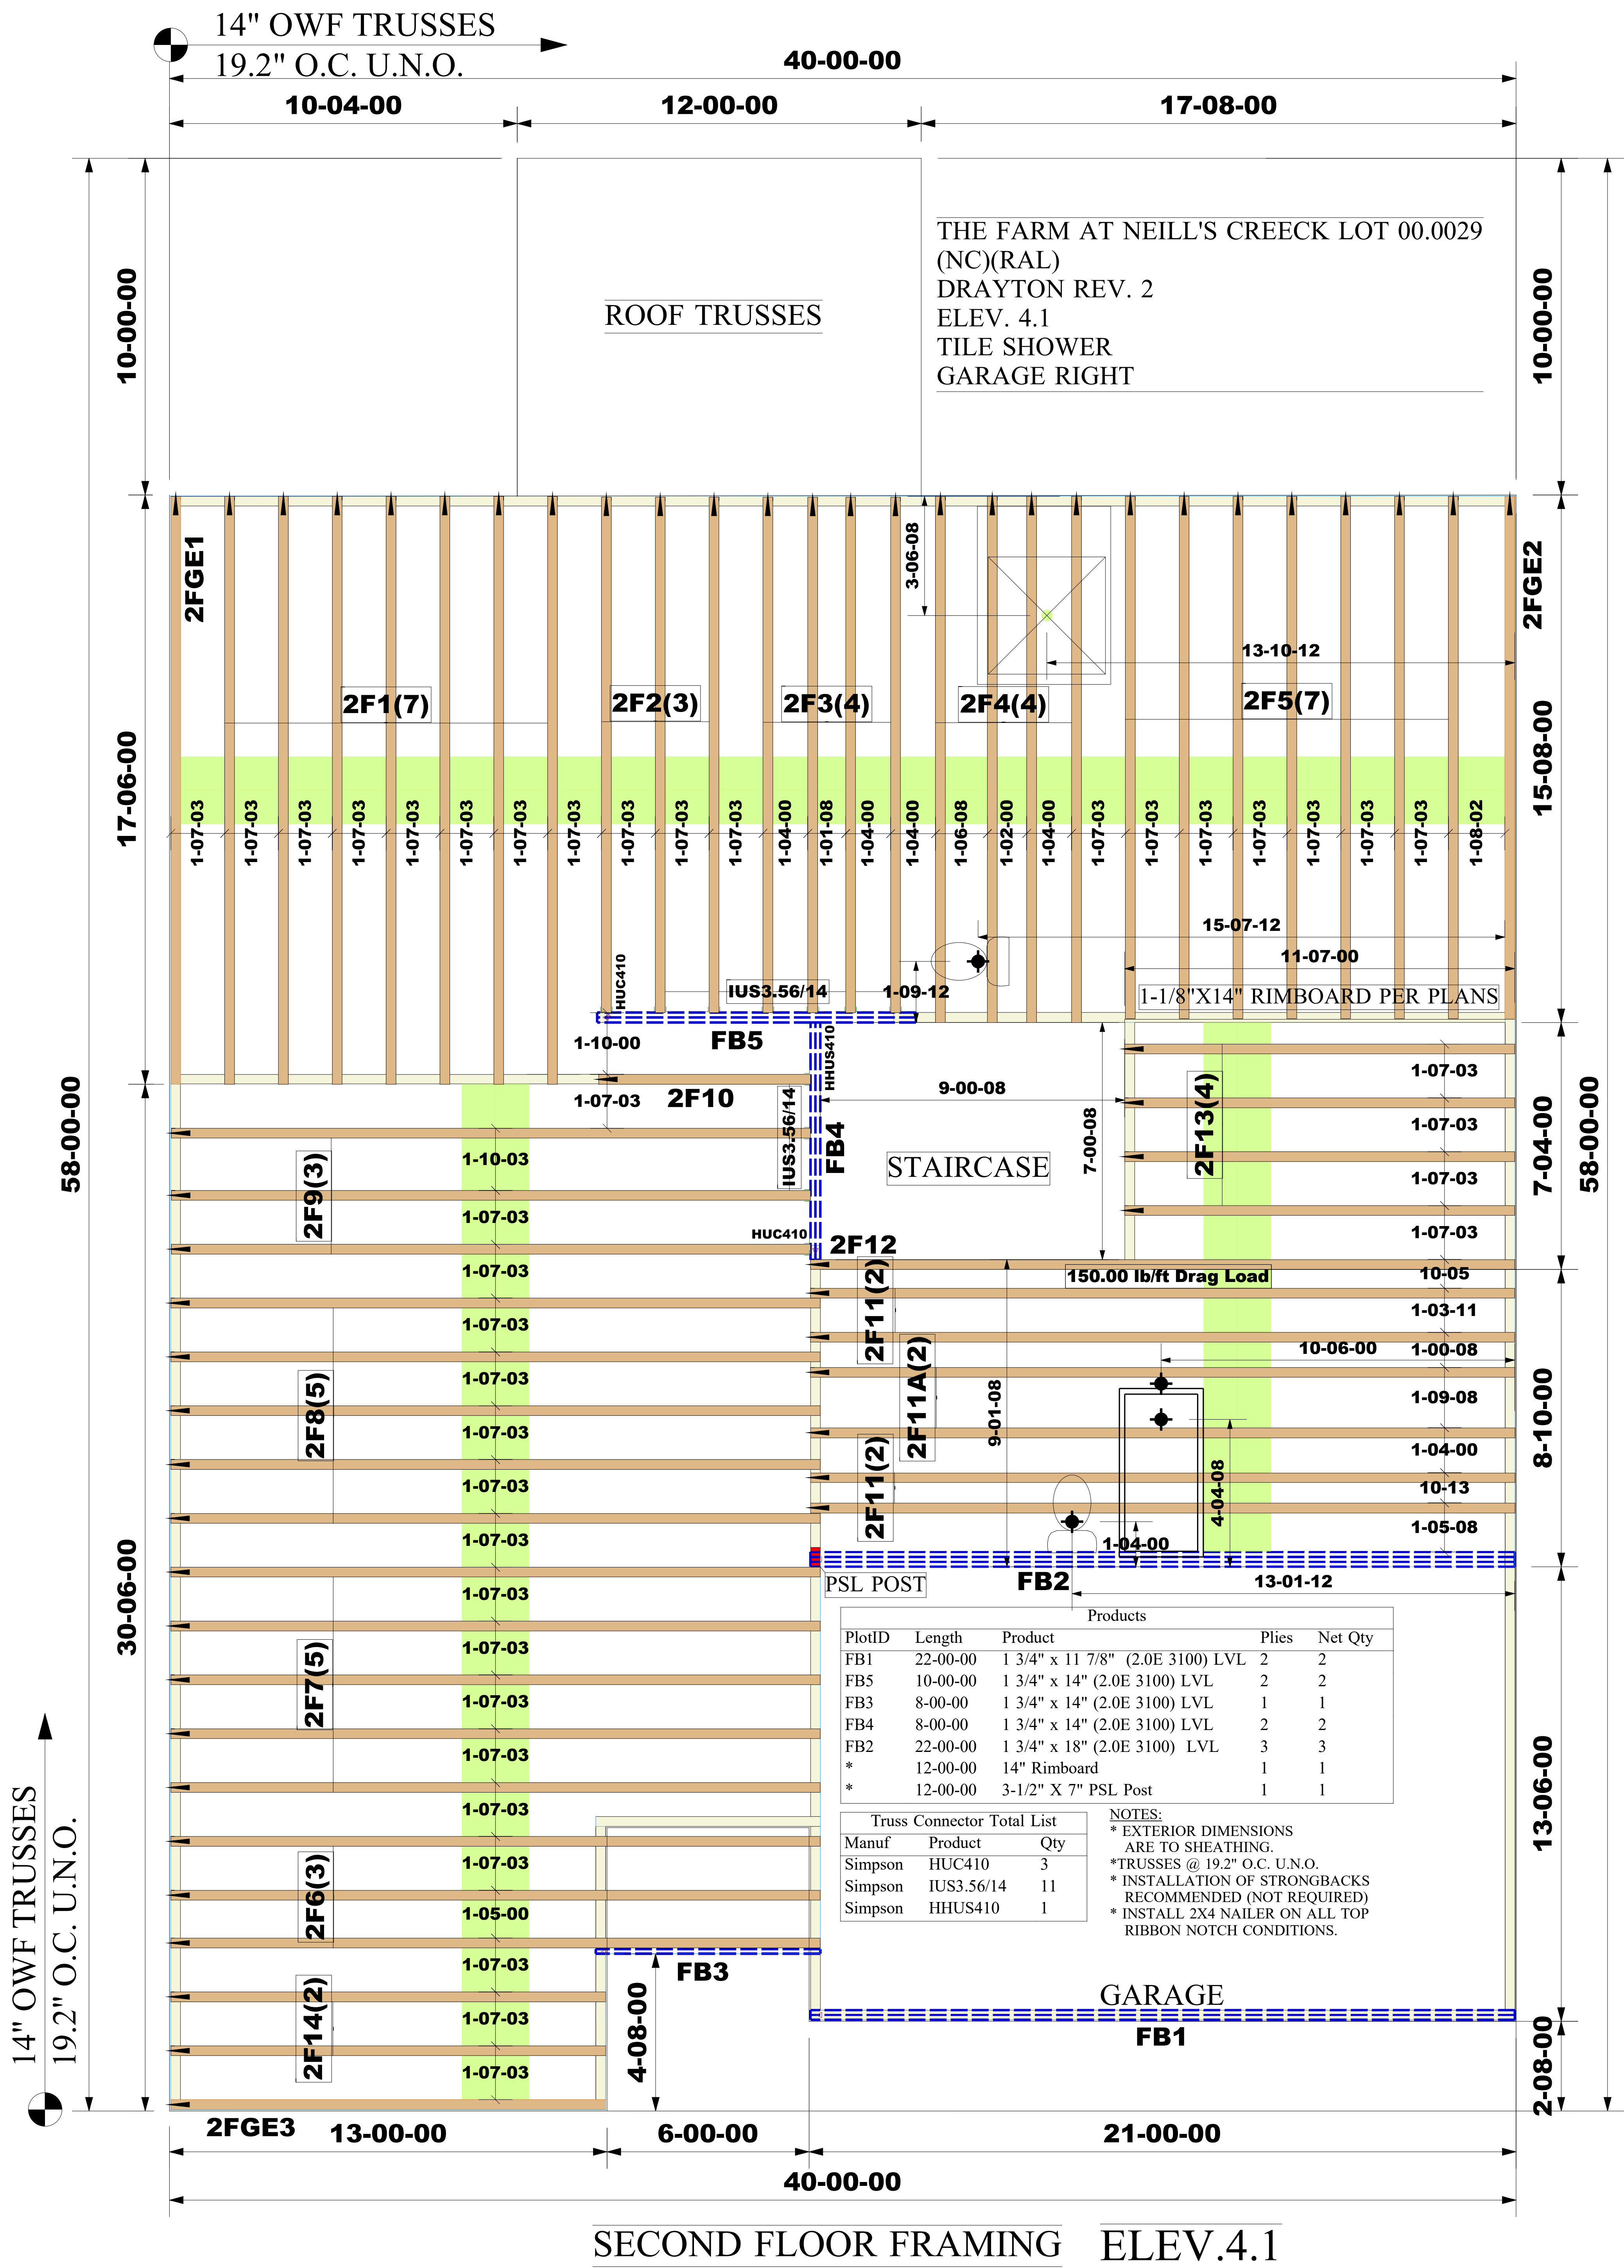

		Products		
PlotID	Length	Product	Plies	Net Qty
FB1	22-00-00	1 3/4" x 11 7/8" (2.0E 3100) LVL	2	2
FB5	10-00-00	1 3/4" x 14" (2.0E 3100) LVL	2	2
FB3	8-00-00	1 3/4" x 14" (2.0E 3100) LVL	1	1
FB4	8-00-00	1 3/4" x 14" (2.0E 3100) LVL	2	2
FB2	22-00-00	1 3/4" x 18" (2.0E 3100) LVL	3	3
*	12-00-00	14" Rimboard	1	1
*	12-00-00	3-1/2" X 7" PSL Post	1	1


Truss Connector Total List		
Manuf	Product	Qty
Simpson	HUC410	3
Simpson	IUS3.56/14	11
Simpson	HHUS410	1

NOTES:

- * EXTERIOR DIMENSIONS ARE TO SHEATHING.
- * TRUSSES @ 19.2" O.C. U.N.O.
- * INSTALLATION OF STRONGBACKS RECOMMENDED (NOT REQUIRED)
- * INSTALL 2X4 NAILER ON ALL TOP RIBBON NOTCH CONDITIONS.

ROOF TRUSS LAYOUT

SCALE: NTS

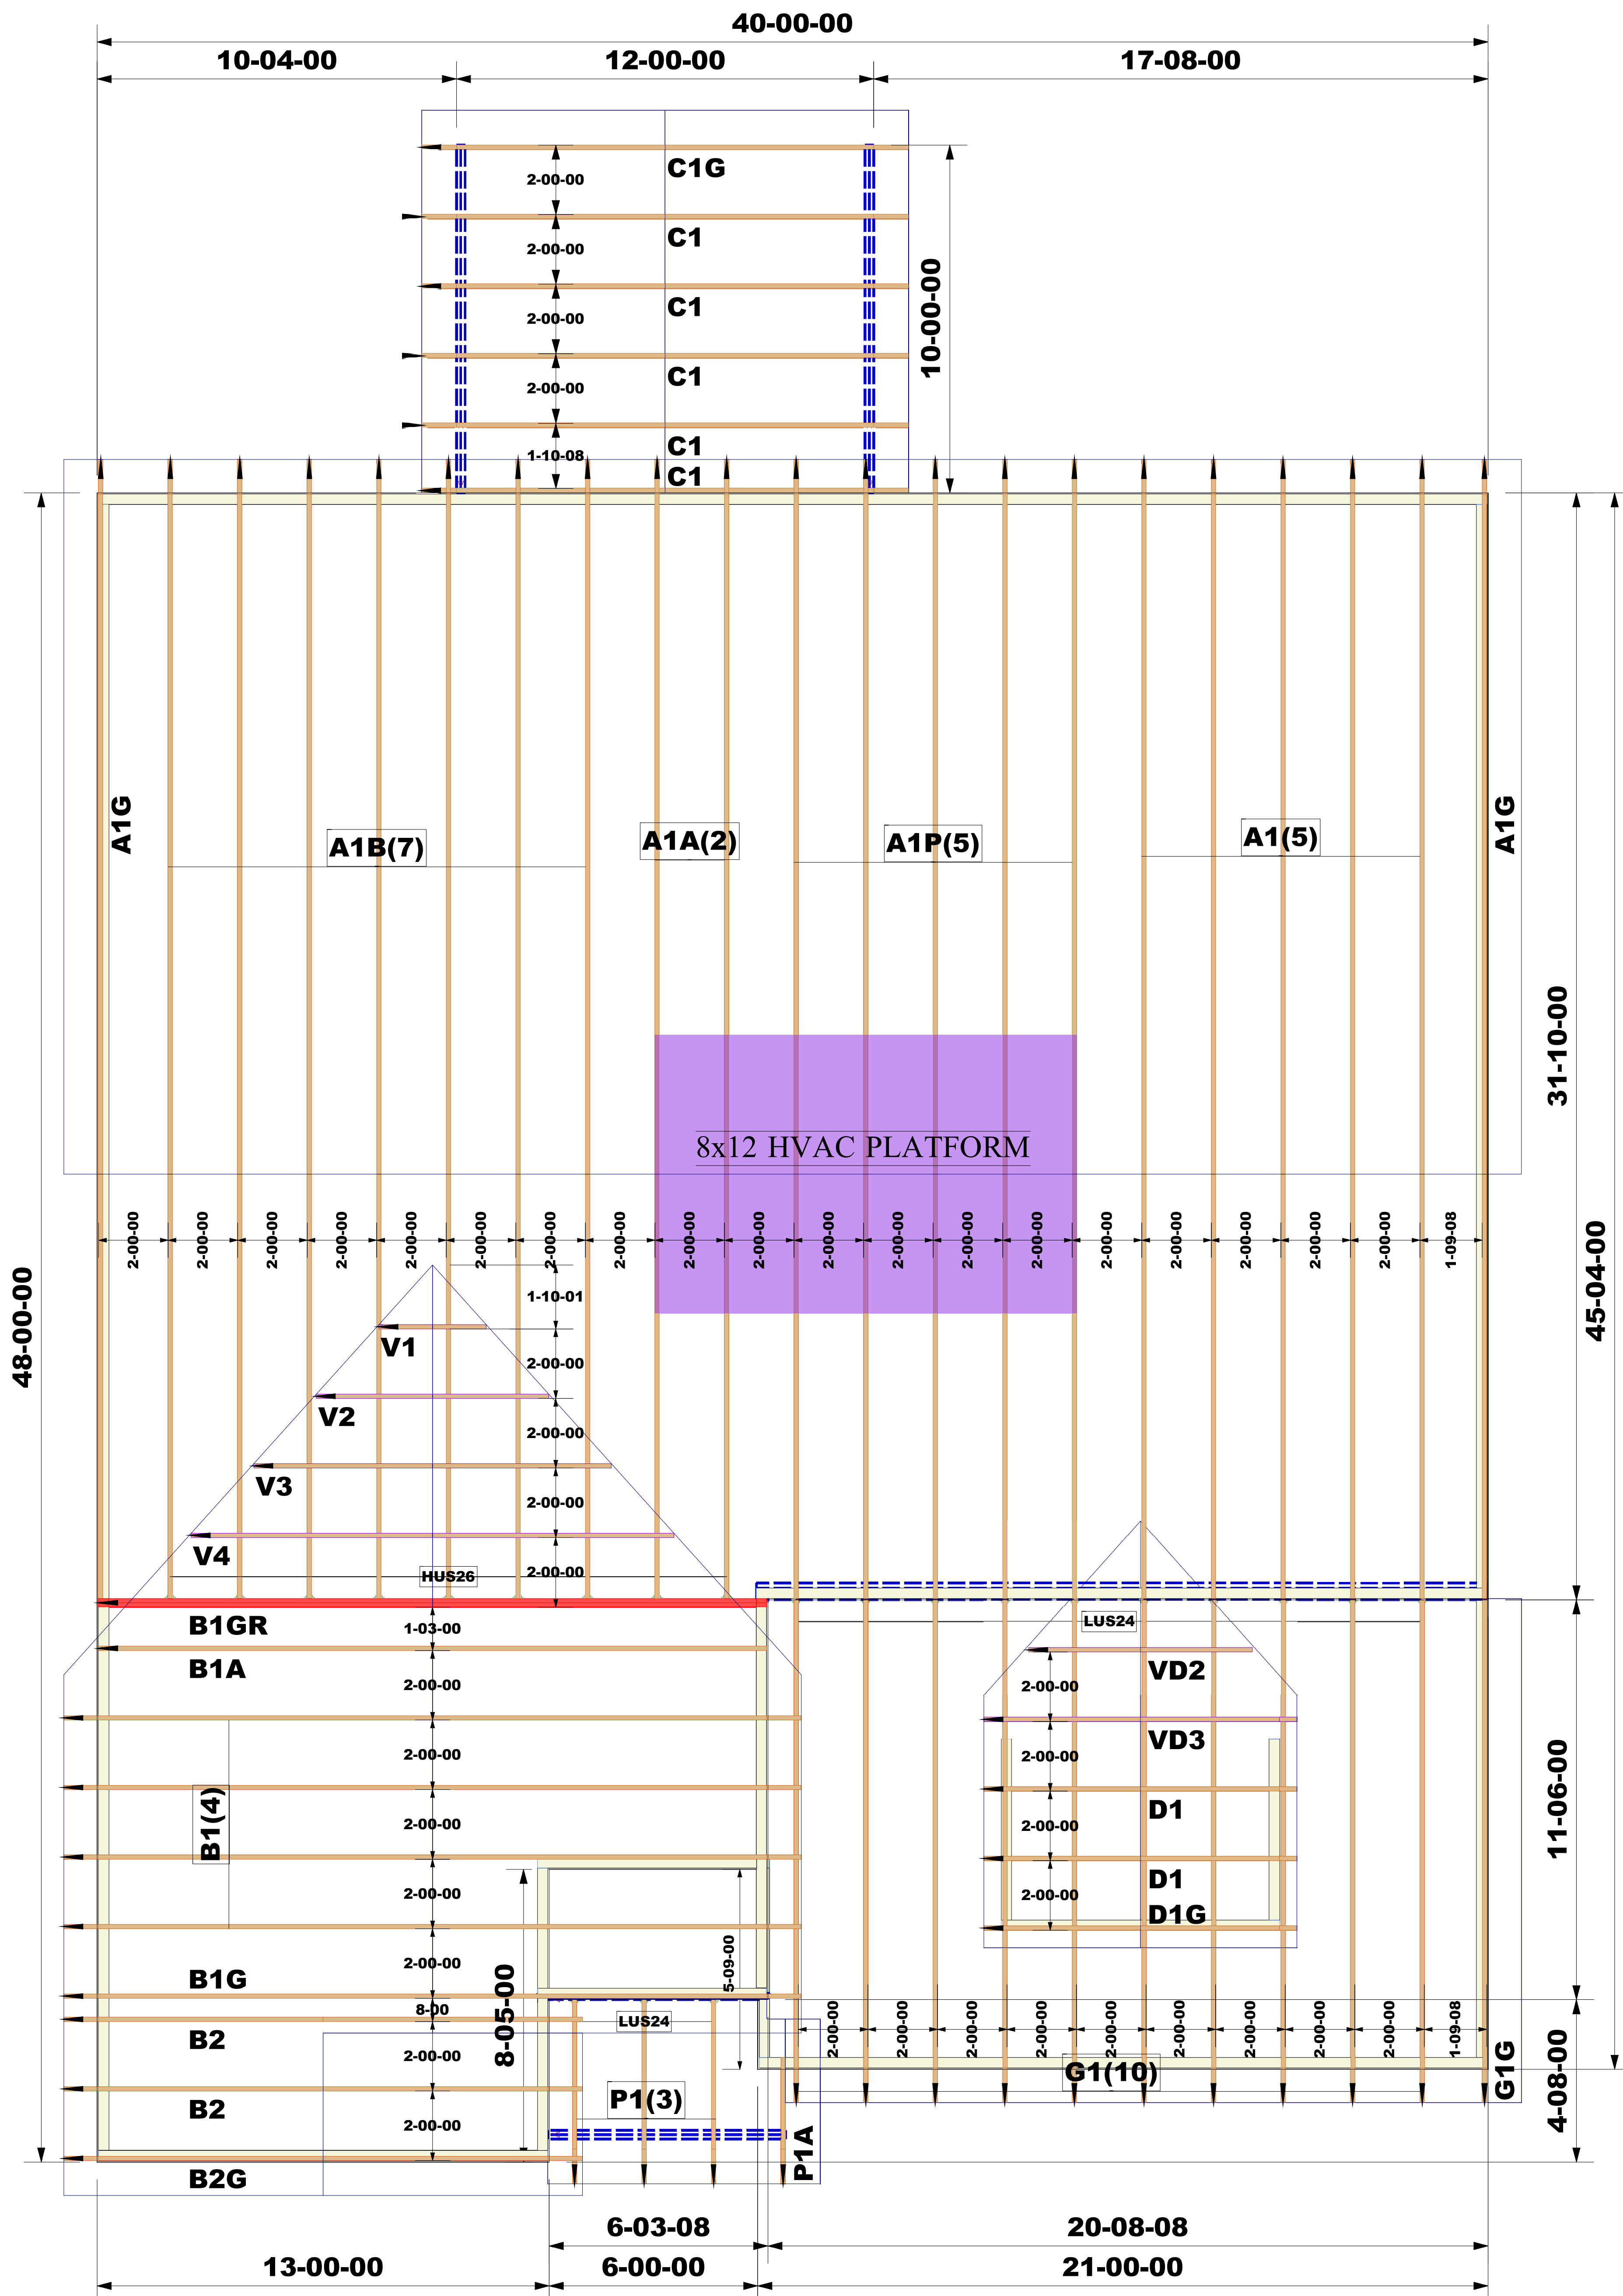



The Farm at Neill's Creek L 00.0029
(NC)(RAL)
DRAYTON REV.2
EL. 4.1
COVERED PORCH
GARAGE RIGHT

*EXTERIOR DIMENSIONS ARE
TO STUD.
*TOE-NAIL CONNECTIONS U.N.O.
*TRUSSES @ 2' O/C U.N.O.
*SEE PROFILE DWGS. FOR TRUSS
ORIENTATION BEFORE INSTALLATION.

Truss Connector Total List		
Manuf	Product	Qty
Simpson	HUS26	10
Simpson	LUS24	15
Simpson	One H2.5A	90

ROOF FRAMING PLAN

Job #:	WARNING:	NOTE:	Customer: DRB Raleigh	
2507-2046	CONVENTIONAL FRAMING, ERECTION AND/OR PERMANENT BRACING IS NOT THE RESPONSIBILITY OF THE TRUSS DESIGNER, PLATE MANUFACTURER, OR THE TRUSS MANUFACTURER. PERSONS ERECTING TRUSSES ARE CAUTIONED TO SEEK PROFESSIONAL ADVICE REGARDING THE ERECTION BRACING WHICH IS ALWAYS REQUIRED TO PREVENT TOPPLING AND DOWNING DURING ERECTION. AND PERMANENT BRACING WHICH MAY BE REQUIRED IN SPECIFIC APPLICATIONS. SEE "BRACING WOOD TRUSSES COMMENTARY AND RECOMMENDATIONS" (BCS1 1) FOR FURTHER INFORMATION.	IT IS THE RESPONSIBILITY OF THE BUILDING DESIGNER OR ARCHITECT TO PROVIDE AN APPROPRIATE CONNECTION FOR TRUSSES TO SUPPORTING STRUCTURE PER REACTIONS SHOWN ON TRUSS ENGINEERING. SPECIAL CONSIDERATIONS FOR MECHANICAL EQUIPMENT AND/OR PLUMBING (AND THEIR CONNECTIONS) IN TRUSS SPACE MUST BE DIAGRAMMED BY BUILDER ON APPROVED TRUSS LAYOUT PRIOR TO FABRICATION.	Job Name: The Farm at Neill's Creek	
Designer:			Lot #: 00.0029	
Priyanka Santra	TRUSSES SHALL BE INSTALLED IN A STRAIGHT AND PLUMB POSITION WHERE NO SHEETING IS APPLIED DIRECTLY TO TOP AND/OR BOTTOM CHORDS. THEY SHALL BE BRACED AS SPECIFIED ON THE ENGINEERED DESIGN. TRUSSES SHALL BE HANDLED WITH REASONABLE CARE DURING ERECTION TO PREVENT DAMAGE OR PERSONAL INJURY.	THIS COMPANY IS A TRUSS MANUFACTURER WHOSE RESPONSIBILITIES ARE LIMITED TO THOSE DESCRIBED IN WTC 1-1995 "DESIGN RESPONSIBILITIES". ACCORDINGLY, IT DISCLAIMS ANY RESPONSIBILITIES AND LIABILITY FOR THE CONSTRUCTION DESIGN, DRAWINGS, DOCUMENTS INCLUDING THE INSTALLATION, AND BRACING OF TRUSSES MANUFACTURED BY THIS COMPANY.	Model Name: Drayton	
Sales Rep:				
Robbie Zarobinski				
				Structural, LLC 201 Poplar Avenue Thurmont, MD 21788 Phone: 301-271-7591