


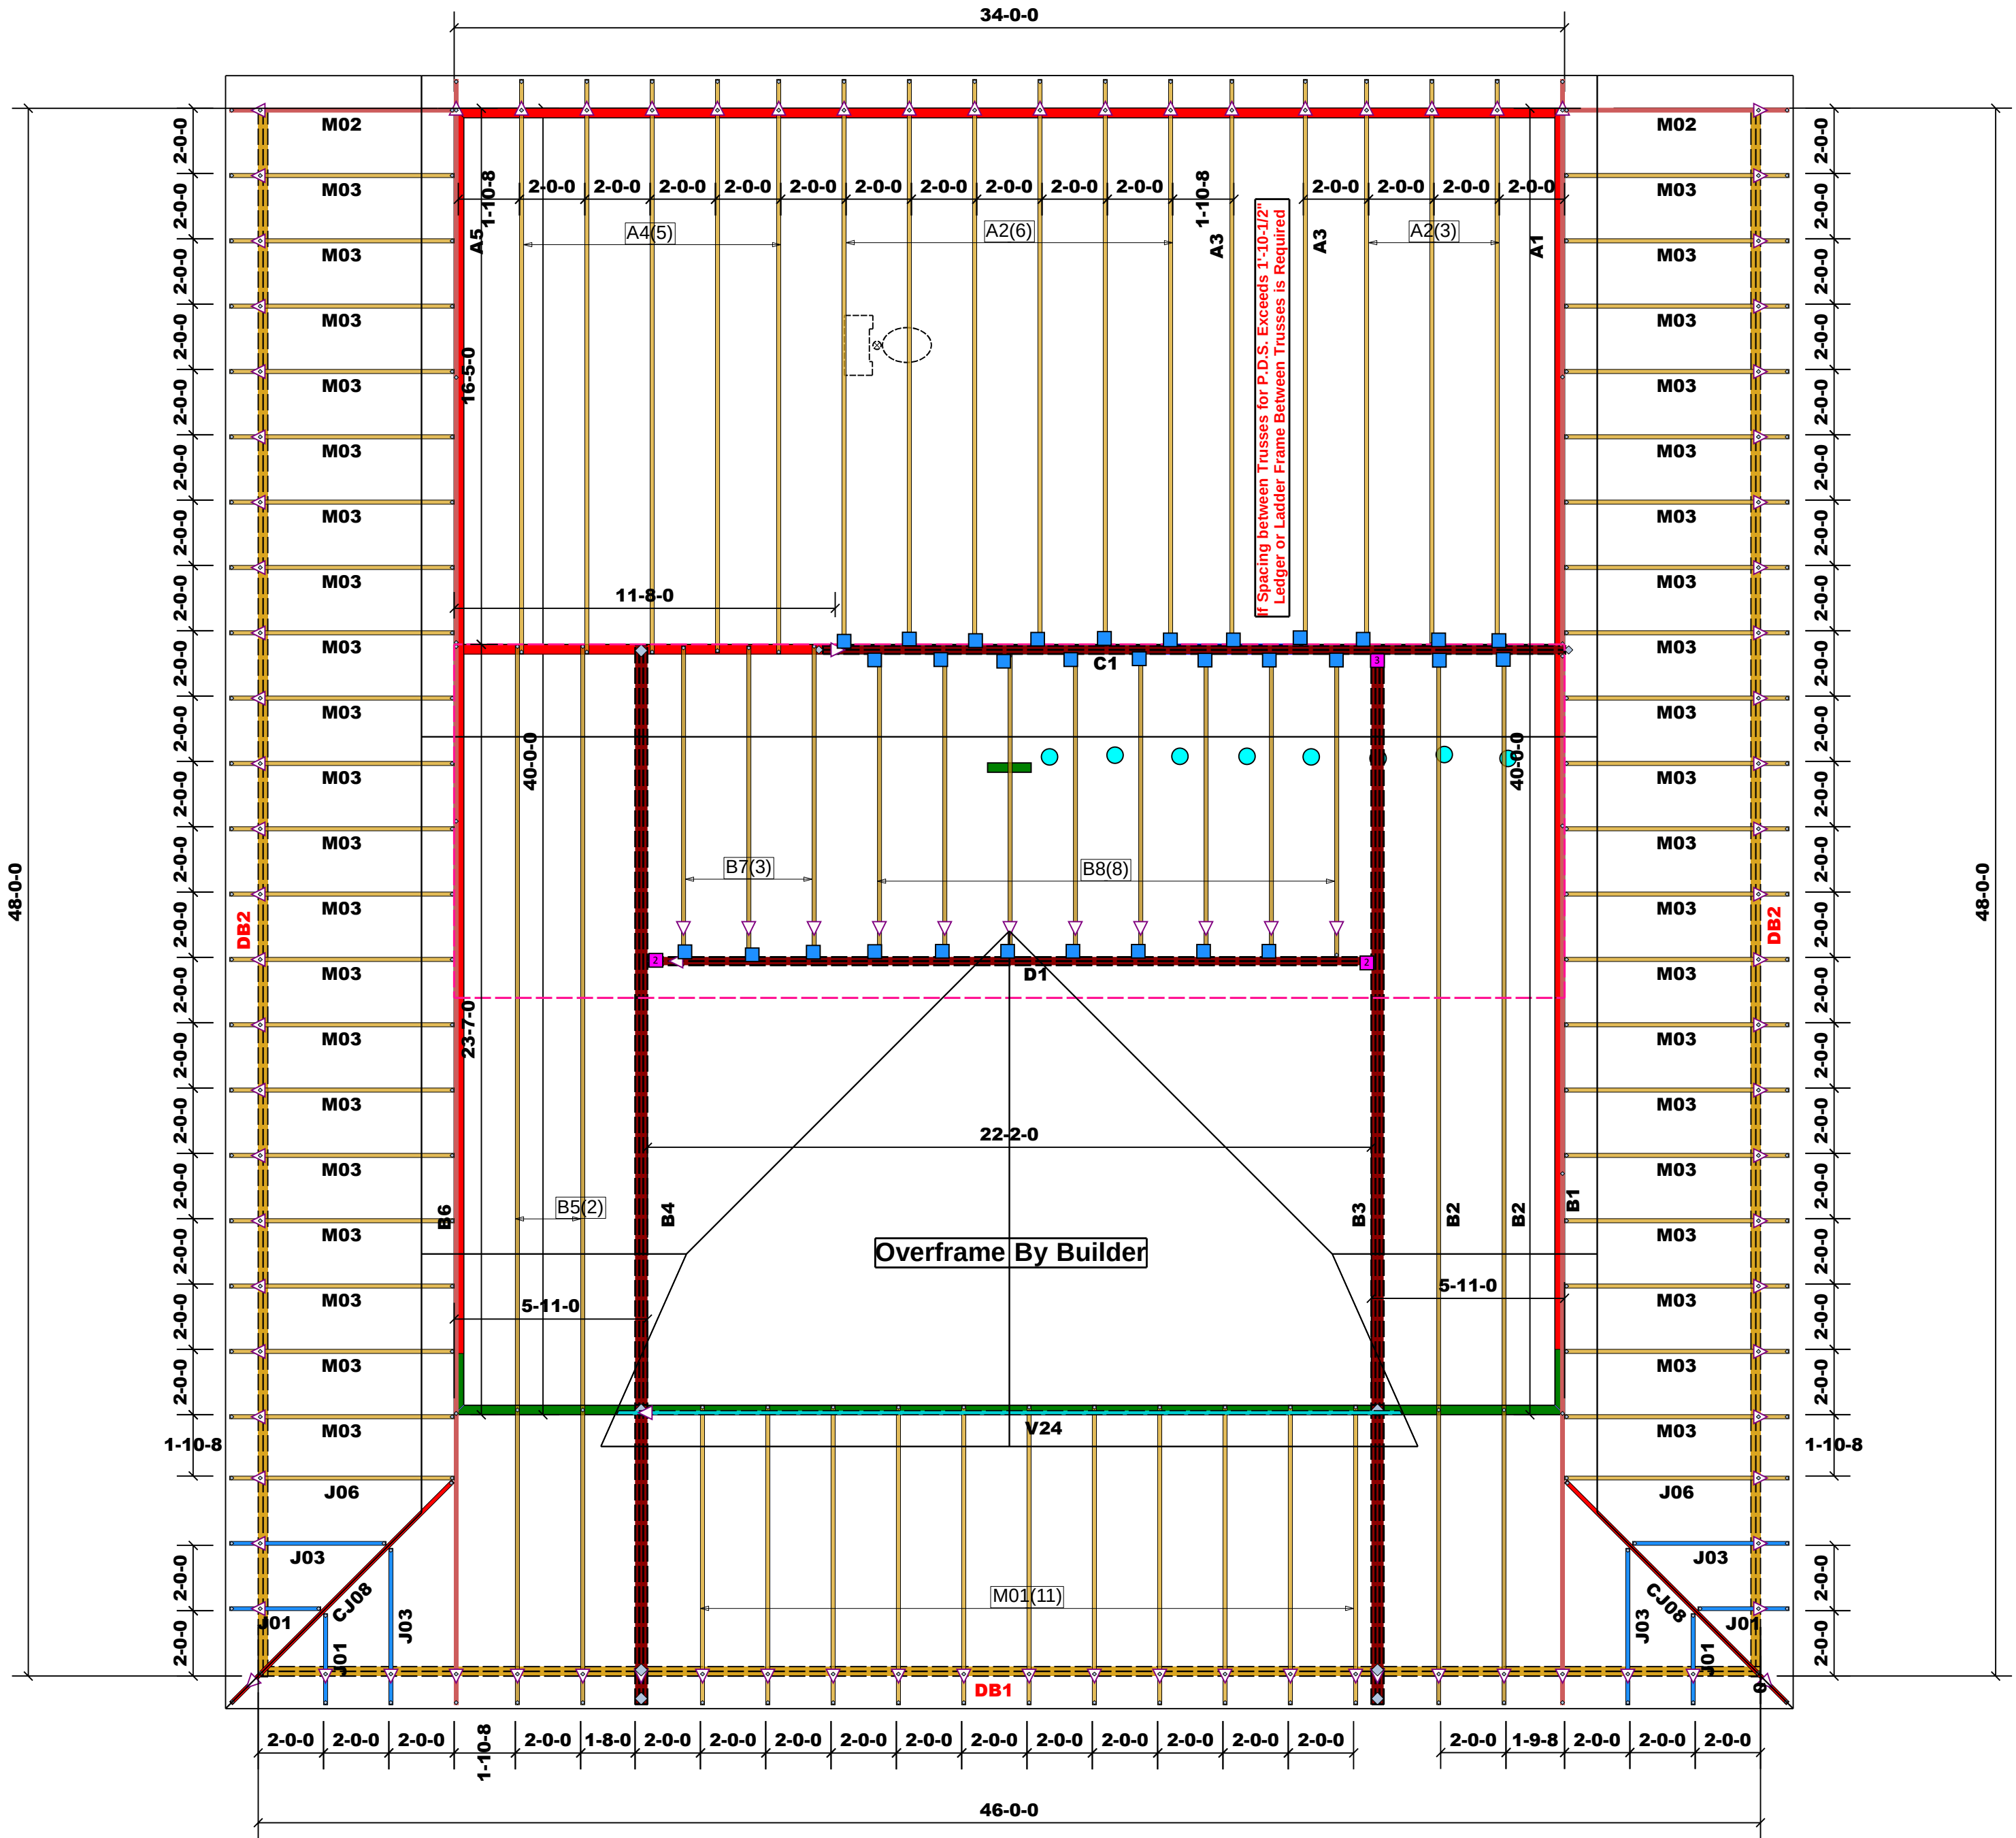

■	HUS26	USP	31	NA	16d/3-1/2"	16d/3-1/2"
■	THDH210-2	USP	2	Varies	16d/3-1/2"	16d/3-1/2"
■	THDH210-3	USP	1	Varies	16d/3-1/2"	16d/3-1/2"

■ = 1st Level Wall

■ = 2nd Level Wall

LVL						
PlotID	Length	Product	Plies	Net Qty	Fab Type	
DB2	48-0-0	1-3/4"x 9-1/4" LVL Kerto-S	2	4	FF	
DB1	46-0-0	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF	

Truss Placement Plan
SCALE: N.T.S.

PLEASE NOTE:

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.



ROOF & FLOOR
TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

CUSTOMER (ACCOUNT)	Red Door Homes of Fayetteville	STREET	Olivia Rd
	(BUILDER)		CITY Sanford, NC
	JOB NAME - LEVEL		TAX AUTH. NC - Harnett
	109-25-129 COX109-25-129 COX - Roof		SALES REP. Marshall Naylor ()
	PLAN NAME Beaufort Wrap Porch		DESIGNER (& ASST.) Marshall Naylor (Bruce McLaurin)
PLAN SEAL DATE (EOR)	6/30/2025	PLAN REV. DATE	7/30/2025
	JOB # (OT REF) 250593 - A		

THIS IS A TRUSS PLACEMENT
DIAGRAM ONLY

These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))
NUMBER OF JACK STUDS REQUIRED @ EA END OF
HEADER/GIRDER

END REACTION (UP TO)	REQ'D STUDS FOR (2) FLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (3) FLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (4) FLY HEADER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				