


Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A1T	Hip Girder	1	2	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:34

ID:a?q6?71yTvSHVH?OIzQvZz8gqv-hsTaFpFDZeQvmCAYUIDY?ZjBhq3PuO5Ev?0FTayqbsD

Page: 1

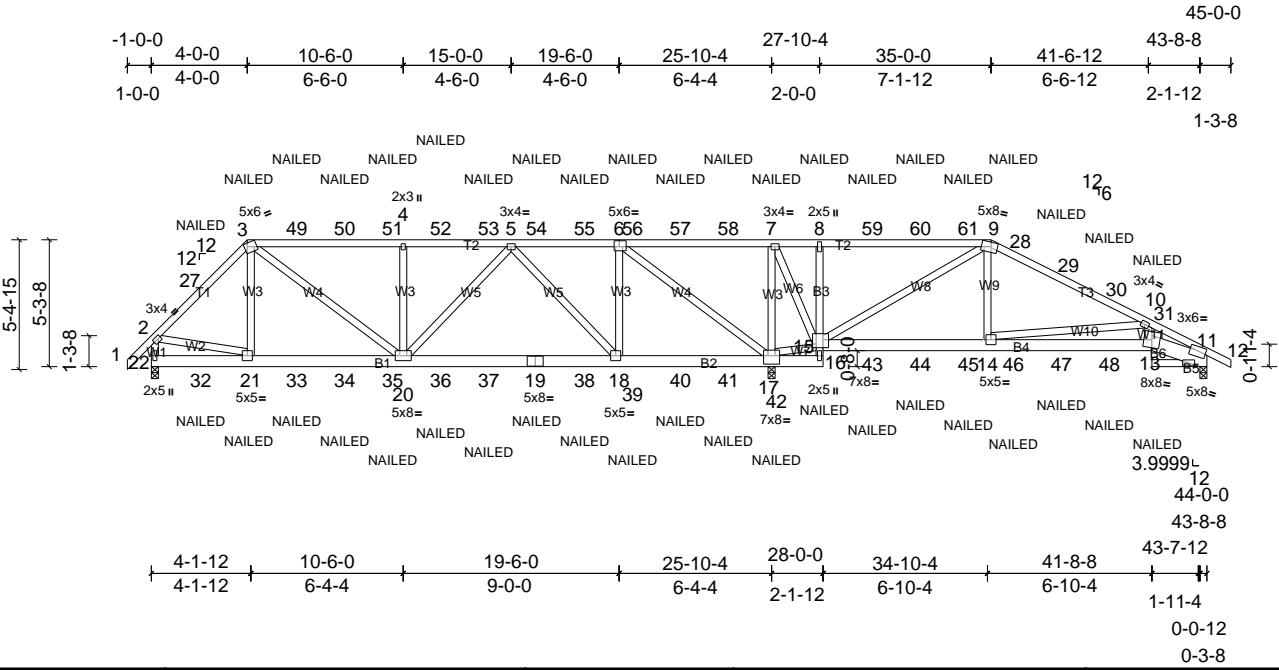

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.49	Vert(LL)	0.07	18-20	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	-0.08	18-20	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.59	Horz(CT)	0.03	11	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 602 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2 *Except* 16-8:2x4 SP No.3,
11-23:2x4 SP No.2, 13-11:2x8 SP No.2
WEBS 2x4 SP No.3
BRACING
TOP CHORD Structural wood sheathing directly applied or
6-0-0 oc purlins, except end verticals, and
2-0-0 oc purlins (6-0-0 max.): 3-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing. Direct:
6-0-0 oc bracing: 16-17.
REACTIONS (lb/size) 11=731/0-3-8, (min. 0-1-8),
17=3028/0-3-8, (min. 0-1-14),
22=1214/0-3-8, (min. 0-1-8)
Max Horiz 22=-164 (LC 6)
Max Uplift 11=-270 (LC 9), 17=-2111 (LC 4),
22=-773 (LC 5)
Max Grav 11=732 (LC 20), 17=3223 (LC 17),
22=1256 (LC 15)
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250
(lb) or less except when shown.
TOP CHORD 2-27=-1287/871, 3-27=-1168/840,
9-28=-488/338, 28-29=-539/329,
29-30=-552/332, 10-30=-645/327,
10-31=-1632/666, 11-31=-1695/674,
2-22=-1203/775, 3-49=-1487/1109,
49-50=-1487/1109, 50-51=-1487/1109,
4-51=-1487/1109, 4-52=-1487/1109,
52-53=-1487/1109, 5-53=-1487/1109,
5-54=-572/517, 54-55=-572/517,
6-55=-572/517, 6-56=-679/1224,
56-57=-679/1224, 57-58=-679/1224,
7-58=-679/1224, 7-8=-423/798,
8-59=-393/760, 59-60=-393/760,
60-61=-393/760, 9-61=-393/760

NOTES
1) 2-ply truss to be connected together with 10d
(0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0
oc.
Bottom chords connected as follows: 2x6 - 2 rows
staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc, 2x8 - 2
rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
2) All loads are considered equally applied to all plies,
except if noted as front (F) or back (B) face in the LOAD
CASE(S) section. Ply to ply connections have been
provided to distribute only loads noted as (F) or (B),
unless otherwise indicated.
3) Unbalanced roof live loads have been considered for
this design.
4) Wind: ASCE 7-10; Vult=130mph (3-second gust)
Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat.
II; Exp B; Enclosed; MWFRS (envelope) exterior zone;
cantilever left and right exposed ; end vertical left
and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
5) Provide adequate drainage to prevent water ponding.
6) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.

7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

8) Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2111 lb uplift at joint 17, 773 lb uplift at joint 22 and 270 lb uplift at joint 11.

10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

12) "NAILED" indicates Girder: 3-10d (0.148" x 3") toe-nails per NDS guidelines.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-60, 2-3=-60, 9-12=-60, 16-22=-20,
13-15=-20, 13-24=-20, 3-9=-60
Concentrated Loads (lb)

7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

8) Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2111 lb uplift at joint 17, 773 lb uplift at joint 22 and 270 lb uplift at joint 11.

10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

12) "NAILED" indicates Girder: 3-10d (0.148" x 3") toe-nails per NDS guidelines.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-60, 2-3=-60, 9-12=-60, 16-22=-20,
13-15=-20, 13-24=-20, 3-9=-60
Concentrated Loads (lb)

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A1T	Hip Girder	1	2	Job Reference (optional)

Vert: 3=-39 (F), 19=-23 (F), 16=-36 (F), 8=-25 (F),
13=-26 (F), 21=-23 (F), 7=-39 (F), 27=-39 (F), 28=22
(F), 29=-23 (F), 30=-31 (F), 31=-46 (F), 32=-21 (F),
33=-23 (F), 34=-23 (F), 35=-23 (F), 36=-23 (F),
37=-23 (F), 38=-23 (F), 39=-23 (F), 40=-23 (F),
41=-23 (F), 42=-23 (F), 43=-36 (F), 44=-36 (F),
45=-36 (F), 46=-123 (F), 47=-39 (F), 48=-30 (F),
49=-39 (F), 50=-39 (F), 51=-39 (F), 52=-39 (F),
53=-39 (F), 54=-39 (F), 55=-39 (F), 56=-39 (F),
57=-39 (F), 58=-39 (F), 59=-25 (F), 60=-25 (F),
61=-25 (F)




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A2T	Hip	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:35
ID:a?q6?71yTv6SHVH?OlZqvZz8gqv-5R9jtqH6sZoUdgv79tnFdBLfx15t5iQgbzEv4vyqbsA

Page: 1

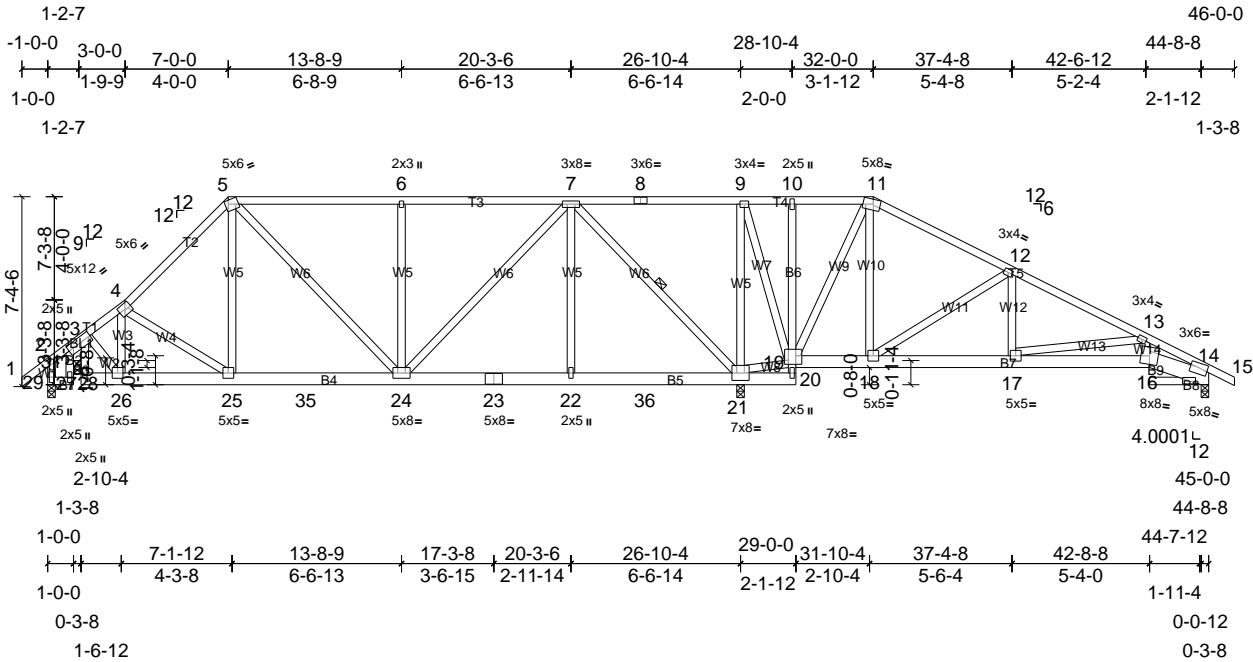

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	0.03	16-17	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.28	Vert(CT)	-0.06	16-17	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.81	Horz(CT)	0.02	14	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 347 lb FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.3 *Except* 29-28,14-30:2x4 SP No.2, 27-23,19-16,23-20:2x6 SP No.2, 16-14:2x8 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-9-5 oc purlins, except end verticals, and 2-0-0 oc purlins (5-10-6 max.): 5-11.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 7-21

REACTIONS
All bearings 0-3-8.
(lb) - Max Horiz 29=215 (LC 8)
Max Uplift All uplift 100 (lb) or less at joint(s) except 14=120 (LC 11), 21=282 (LC 6), 29=162 (LC 6), 31=180 (LC 7)
Max Grav All reactions 250 (lb) or less at joint (s) 29 except 14=518 (LC 22), 21=2226 (LC 1), 31=963 (LC 21)


FORCES
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=637/185, 4-5=872/250, 5-6=741/266, 6-7=741/266, 7-8=27/688, 8-9=27/688, 9-10=0/502, 10-11=0/497, 12-13=496/133, 13-14=1005/211
BOT CHORD 3-31=929/145, 25-26=92/499, 25-35=80/604, 24-35=80/604, 23-24=106/409, 22-23=106/409, 22-36=106/409, 21-36=106/409, 17-18=0/390, 16-17=150/864, 14-16=138/875
WEBS 3-26=91/716, 4-26=413/101, 6-24=430/207, 7-21=1344/290, 19-21=633/334, 9-19=82/568, 11-19=810/200, 11-18=63/416, 12-18=621/237, 12-17=0/324, 13-17=481/177, 7-22=0/312, 7-24=138/618, 9-21=889/246

NOTES


- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 14, 31 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 162 lb uplift at joint 29, 281 lb uplift at joint 21, 119 lb uplift at joint 14 and 180 lb uplift at joint 31.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry	Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:36	Page: 1
ID:a?q6?71yTv6SHVH?OIzqv2z8gqv-Zej55AlkdtwLFpTJjblUAPtnTRPvqBBqpd_ScLyqbs9		

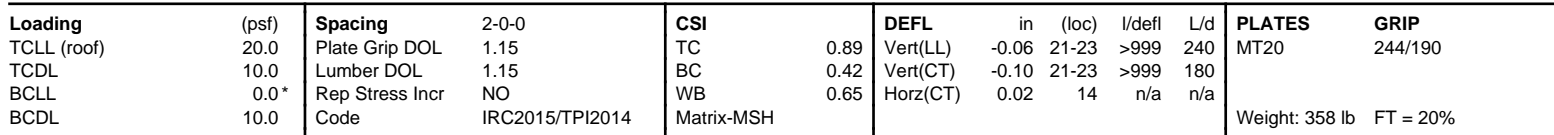

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry	Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:37	Page: 1
ID:a?q6?71yTv6SHVH?OIzQv2z8gqv-2qHTIWJMOA2Csz2VHlpjicQxLrLIYYz2Hj09nyqbs8		

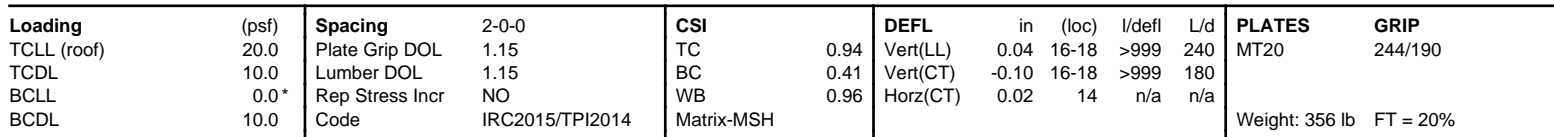


Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A5T	Roof Special	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:38

Page: 1

ID:a?q6?71yTv6SHVH?OIzQvZz8qqv-W0rsWsJ_9UA3U7dir0KyFqz80F2hI2S6HxTZhEygqbs7

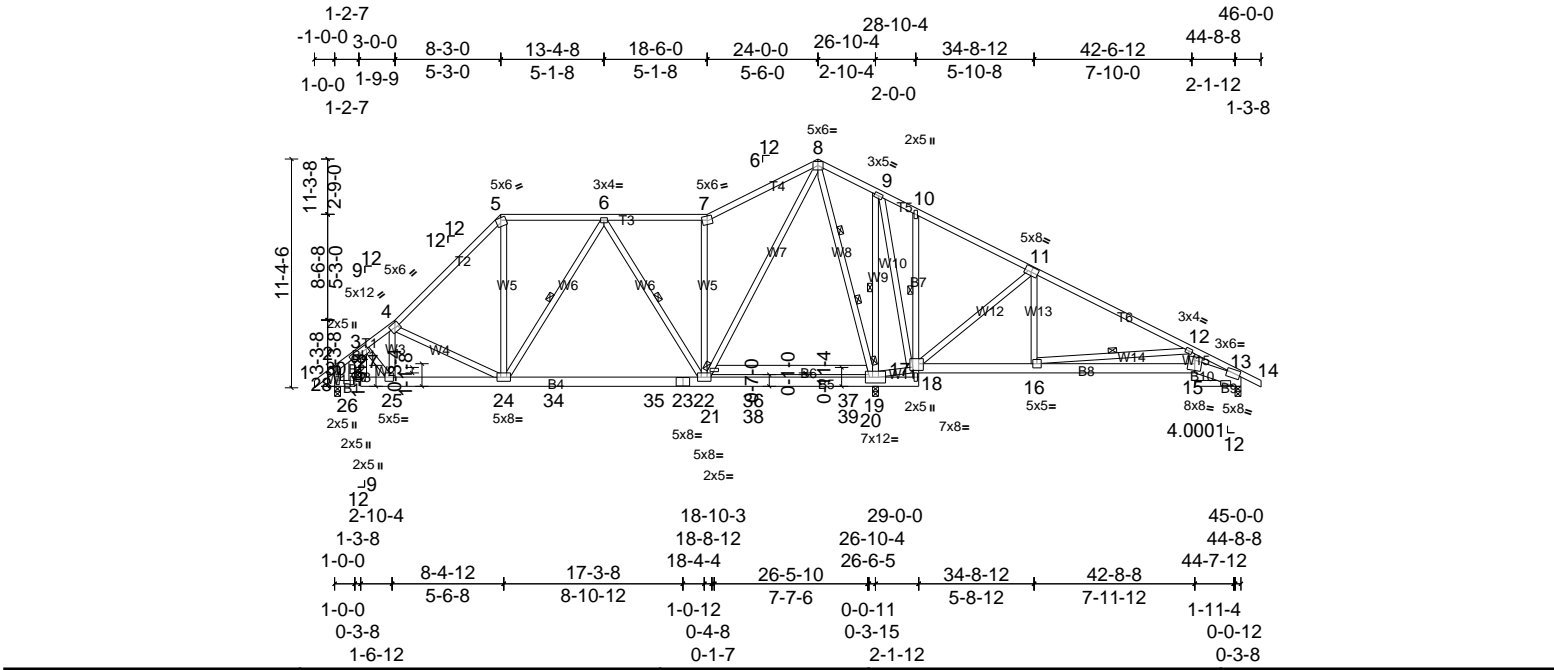

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	-0.11	20-21	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.53	Vert(CT)	-0.18	20-21	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.79	Horz(CT)	0.02	13	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 384 lb FT = 20%

LUMBER			1) Unbalanced roof live loads have been considered for this design.								
TOP CHORD	2x4 SP No.2		2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60								
BOT CHORD	2x6 SP No.2 *Except* 28-27,13-29:2x4 SP No.2, 27-3,3-26,18-10:2x4 SP No.3, 15-13:2x8 SP No.2		3) Provide adequate drainage to prevent water ponding.								
WEBS	2x4 SP No.3		4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.								
OTHERS	2x4 SP No.3		5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.								
BRACING			6) Bearing at joint(s) 13, 30 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.								
TOP CHORD	Structural wood sheathing directly applied or 4-9-13 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-7.		7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint (s) 13 except (jt=lb) 28=230, 19=211, 30=319.								
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing. Except:		8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.								
1 Row at midpt	10-17		9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.								
WEBS	1 Row at midpt 6-24, 6-22, 12-16, 9-19		LOAD CASE(S) Standard								
WEBS	2 Rows at 1/3 pts 8-20										
REACTIONS											
	All bearings 0-3-8.										
	(lb) - Max Horiz 28=-284 (LC 8)										
	Max Uplift All uplift 100 (lb) or less at joint(s) 13 except 19=212 (LC 11), 28=-231 (LC 6), 30=-320 (LC 10)										
	Max Grav All reactions 250 (lb) or less at joint (s) 28 except 13=481 (LC 22), 19=2522 (LC 2), 30=1057 (LC 17)										
FORCES											
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.										
TOP CHORD	3-4=-629/156, 4-5=-912/199, 5-6=-584/225, 6-7=-532/145, 7-8=-667/243, 8-9=0/756, 9-10=0/620, 10-11=-77/650, 12-13=-1057/182										
BOT CHORD	3-30=-972/235, 24-25=-185/550, 24-34=-87/685, 34-35=-87/685, 23-35=-87/685, 22-23=-87/685, 22-36=-285/385, 36-37=-285/385, 19-37=-285/385, 15-16=-163/959, 13-15=-129/956										
WEBS	3-25=-177/776, 4-25=-478/161, 5-24=-5/331, 6-22=-396/174, 7-22=-539/262, 21-22=-319/1175, 8-21=-269/1321, 17-19=-596/450, 11-17=-726/272, 11-16=0/410, 12-16=-865/350, 12-15=0/265, 9-19=-553/214, 9-17=-158/459, 8-20=-1525/286, 19-20=-1690/235										
NOTES											


Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A6T	Roof Special	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:39

ID:a?q6771yTv6SHVH?OlZqvZz8gqv-_COEjCKcvolw6HCuOjrBn1VHpeJ01UBGWbC7Dgyqbs6

Page: 1

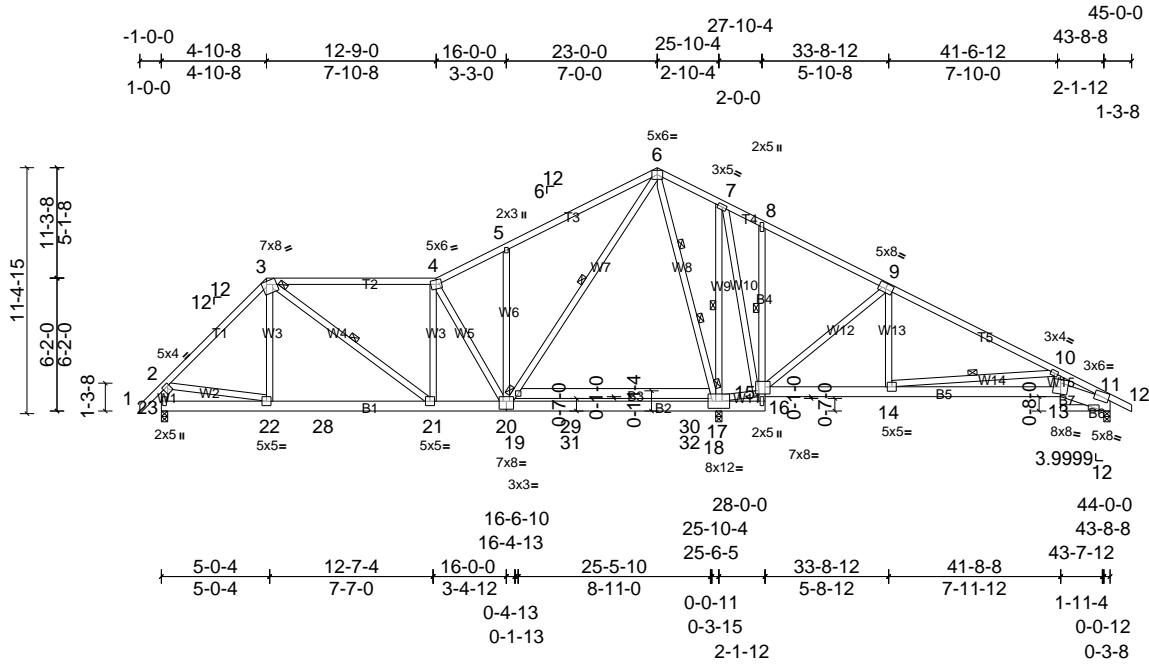

Loading	(psf)	Spacing	2-3-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.95	Vert(LL)	-0.21	18-19	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.85	Vert(CT)	-0.36	18-19	>854	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.89	Horz(CT)	0.03	11	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 371 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 3-4:2x4 SP SS
BOT CHORD 2x6 SP No.2 *Except* 16-8:2x4 SP No.3, 11-24:2x4 SP No.2, 13-11:2x8 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD 2-0-0 oc purlins (3-2-2 max.), except end verticals
(Switched from sheeted: Spacing > 2-0-0).
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. Except:

1 Row at midpt 8-15
WEBS 1 Row at midpt 3-21, 10-14, 7-17, 6-19
WEBS 2 Rows at 1/3 pts 6-18

REACTIONS (lb/size)
11=464/0-3-8, (min. 0-1-8),
17=2866/0-3-8, (min. 0-3-7),
23=969/0-3-8, (min. 0-1-8)
Max Horiz 23=-284 (LC 8)
Max Uplift 11=-106 (LC 11), 17=-207 (LC 11), 23=-179 (LC 10)
Max Grav 11=524 (LC 22), 17=2902 (LC 2), 23=1067 (LC 21)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1059/187, 3-4=-947/204, 4-5=-776/158, 5-6=-840/323, 6-7=0/933, 7-8=0/781, 8-9=-91/819, 10-11=-1145/211, 2-23=-1023/221

BOT CHORD 22-23=-301/374, 22-28=-171/762, 21-28=-171/762, 20-21=-156/950, 20-29=-318/429, 29-30=-318/429, 17-30=-318/429, 13-14=-198/1040, 11-13=-160/1037

WEBS 3-21=-51/339, 4-20=-651/206, 15-17=-713/524, 7-15=-201/479, 9-15=-814/306, 10-14=-970/394, 2-22=-73/617, 10-13=0/290, 9-14=0/457, 7-17=-580/246, 6-18=-1775/367, 17-18=-1920/302, 19-20=-425/1304, 6-19=-362/1493, 5-20=-392/299

NOTES
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 207 lb uplift at joint 17, 179 lb uplift at joint 23 and 106 lb uplift at joint 11.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A7	Roof Special	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:39

Page: 1

ID:a?q6771yTv6SHVH?OIzQvZz8gqv_-COEjCKcvolw6HCuOjrBn1VH?eHk1UDGWBc7Dgyqbs6

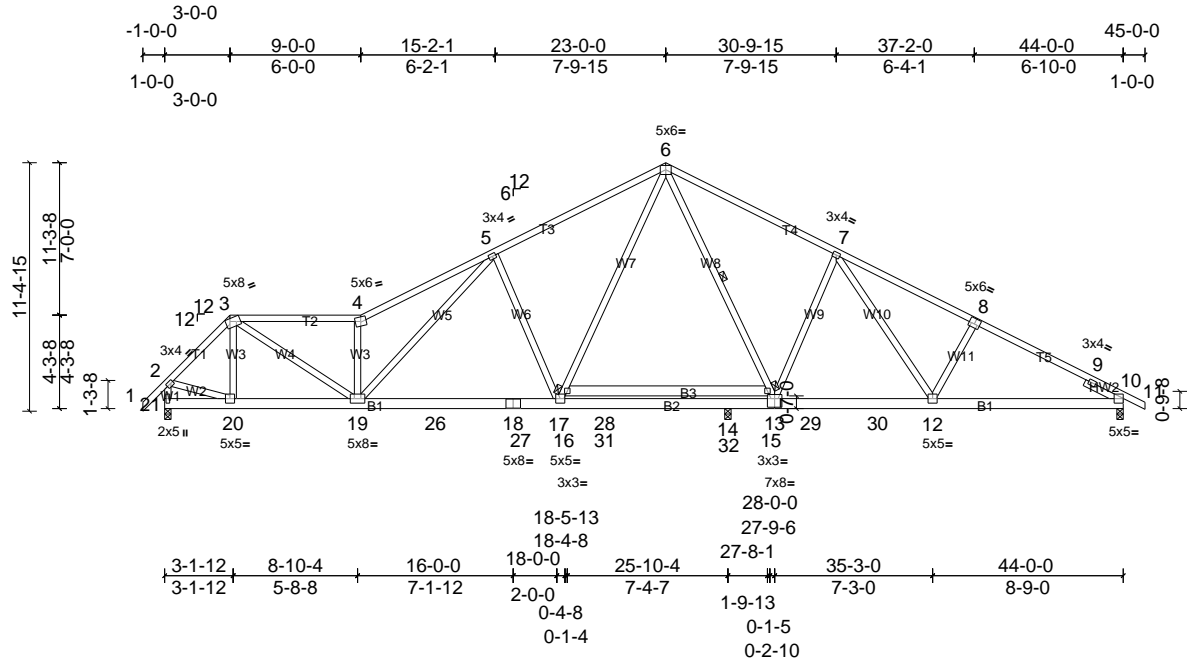

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.28	15-16	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.99	Vert(CT)	-0.54	15-16	>574	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.05	10	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 318 lb	FT = 20%

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x6 SP No.1 *Except* 16-15:2x6 SP No.2
WEBS	2x4 SP No.3
SLIDER	Right 2x4 SP No.3 -- 1-11-0
BRACING	
TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-2-0 max.): 3-4.
BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	1 Row at midpt 6-15
REACTIONS (lb/size)	
10=1268/0-3-8, (min. 0-1-8),	
14=1101/0-3-8, (min. 0-1-8),	
21=1458/0-3-8, (min. 0-1-12)	
Max Horiz 21=225 (LC 8)	
Max Uplift 10=184 (LC 11), 14=36 (LC 10),	
21=205 (LC 10)	
Max Grav 10=1268 (LC 1), 14=1261 (LC 2),	
21=1458 (LC 1)	
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-1419/334, 3-4=-2421/551,
	4-5=-2819/714, 5-6=-1772/531,
	6-7=-1252/461, 7-8=-1871/525,
	8-9=-1997/494, 9-10=-673/0, 2-21=-1427/356
BOT CHORD	19-20=-227/969, 19-26=-200/1791,
	18-26=-200/1791, 18-27=-200/1791,
	17-27=-200/1791, 17-28=0/1143,
	14-28=0/1143, 13-14=0/1143,
	13-29=-118/1290, 29-30=-118/1290,
	12-30=-118/1290, 10-12=-305/1723
WEBS	2-20=-109/986, 8-12=-280/220,
	5-17=-818/412, 6-15=-264/161,
	13-15=-390/54, 7-13=-752/388,
	7-12=-160/628, 5-19=-268/1049,
	3-19=-331/1780, 16-17=-237/907,
	6-16=-180/1101, 4-19=-1517/476,
	3-20=-259/78

NOTES
1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 205 lb uplift at joint 21, 184 lb uplift at joint 10 and 36 lb uplift at joint 14.
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A8	Roof Special	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:40
ID:a?q6771yTv6SHVH?OIzQvZz8gqv-SPycxYLEg5QnjRn4yRMQKE2R42dJmxNPKfYgl6yqbs5

Page: 1

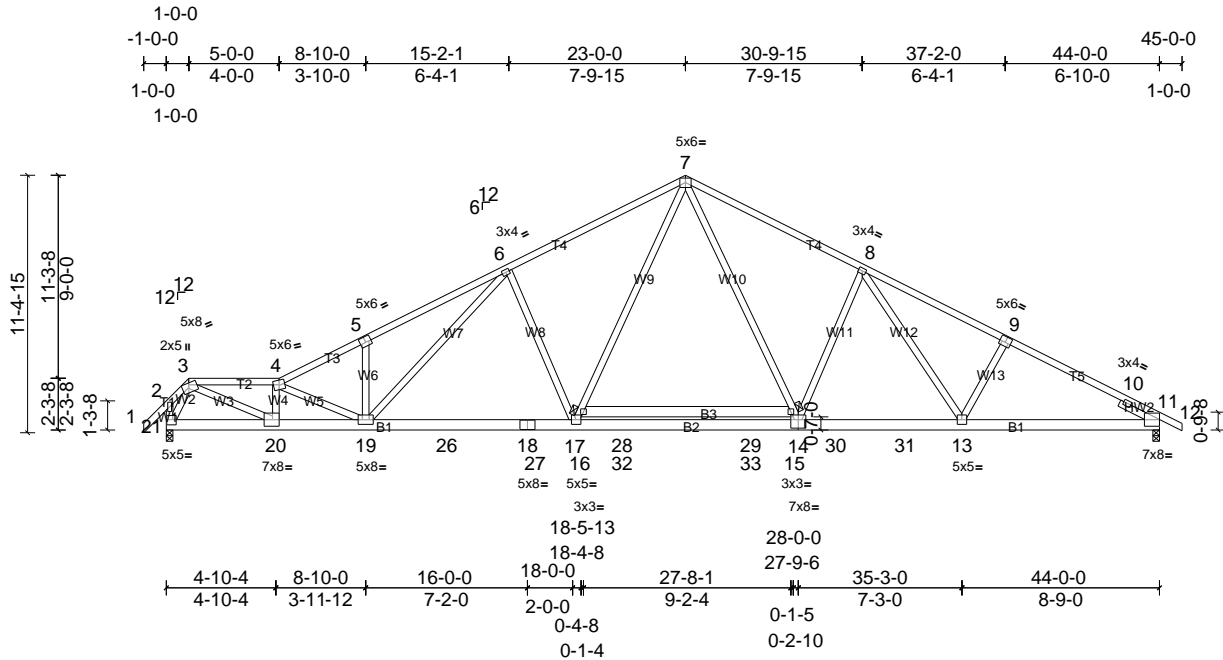

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.38	15-16	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.97	Vert(CT)	-0.73	15-16	>718	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.12	11	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 315 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 9-12:2x4 SP No.1, 9-7,5-7:2x4 SP SS
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except* 20-3,19-4:2x4 SP No.2
SLIDER Right 2x4 SP No.3 -- 1-11-0

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-6-4 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS (lb/size) 11=1913/0-3-8, (min. 0-2-5), 21=1914/0-3-8, (min. 0-2-5)
Max Horiz 21=195 (LC 8)
Max Uplift 11=195 (LC 11), 21=220 (LC 10)
Max Grav 11=1966 (LC 2), 21=1952 (LC 2)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-313/144, 3-4=-4108/846, 4-5=-4108/819, 5-6=-4144/946, 6-7=-3069/729, 7-8=-2963/715, 8-9=-3280/738, 9-10=-3416/707, 10-11=-1411/29, 2-21=-338/180
BOT CHORD 20-21=-239/895, 19-20=-771/4237, 19-26=-379/2952, 18-26=-379/2952, 18-27=-379/2952, 17-27=-379/2952, 17-28=-119/2253, 28-29=-119/2253, 14-29=-119/2253, 14-30=-336/2755, 30-31=-336/2755, 13-31=-336/2755, 11-13=-494/2984
WEBS 3-20=-701/3639, 4-20=-1689/373, 4-19=-697/206, 6-19=-305/1072, 6-17=-820/423, 8-13=-111/363, 9-13=-258/216, 3-21=-1679/293, 16-17=-284/1138, 7-16=-232/1362, 7-15=-199/1127, 14-15=-250/899, 8-14=-629/363, 5-19=-306/216

NOTES
1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) -1-0-0 to 45-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 220 lb uplift at joint 21 and 195 lb uplift at joint 11.
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:41 Page: 1
ID:a?q6?71yTv6SHVH?OIzqv2z8gqv-wbW_8uMtrPZeLbMHW8uftSbbTs_NVRpZzvDIYyqbs4




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A9B	Common	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:41
ID:a?q6?7?yTv6SHVH?OIzQvZz8gqv-wbW_8uMtrPZeLbMHW8uftSbbVS_NVRsZzvDIYyqbs4

Page: 1

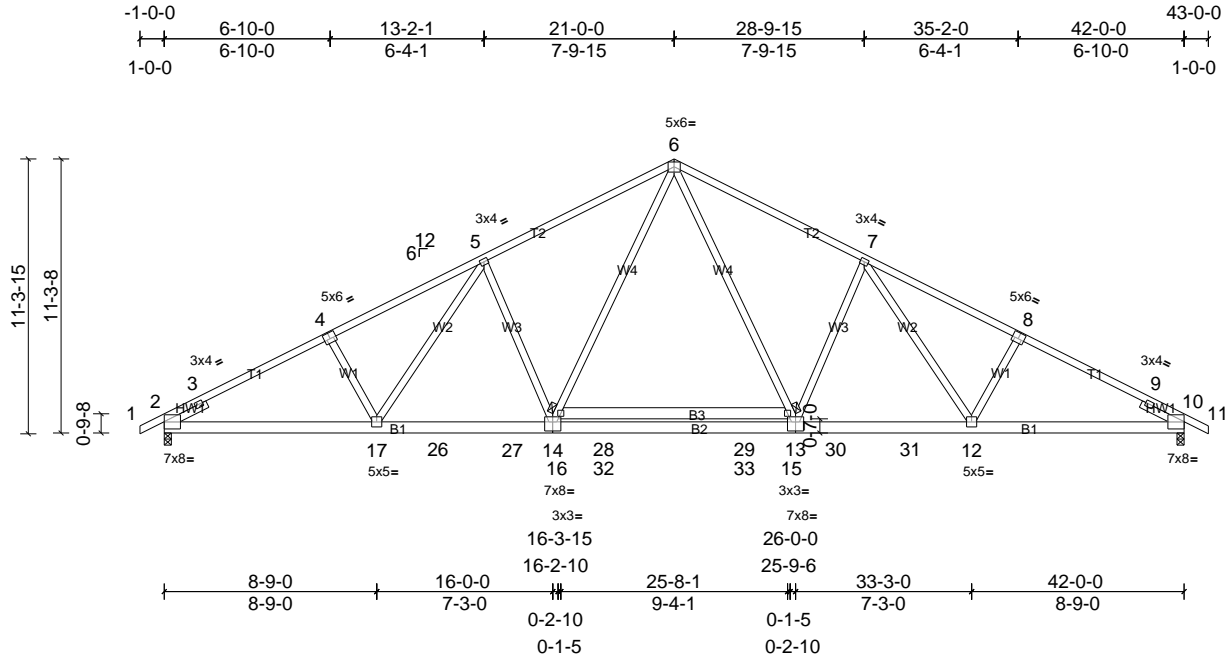


Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A10	Common	2	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:42

Page: 1

ID:a?q6?71yTv6SHVH?OlZqvZz8gqv-On4MLEMVCjhVzKxT4rPuPf7ntsJiEs1iCZRnq?yqbs3

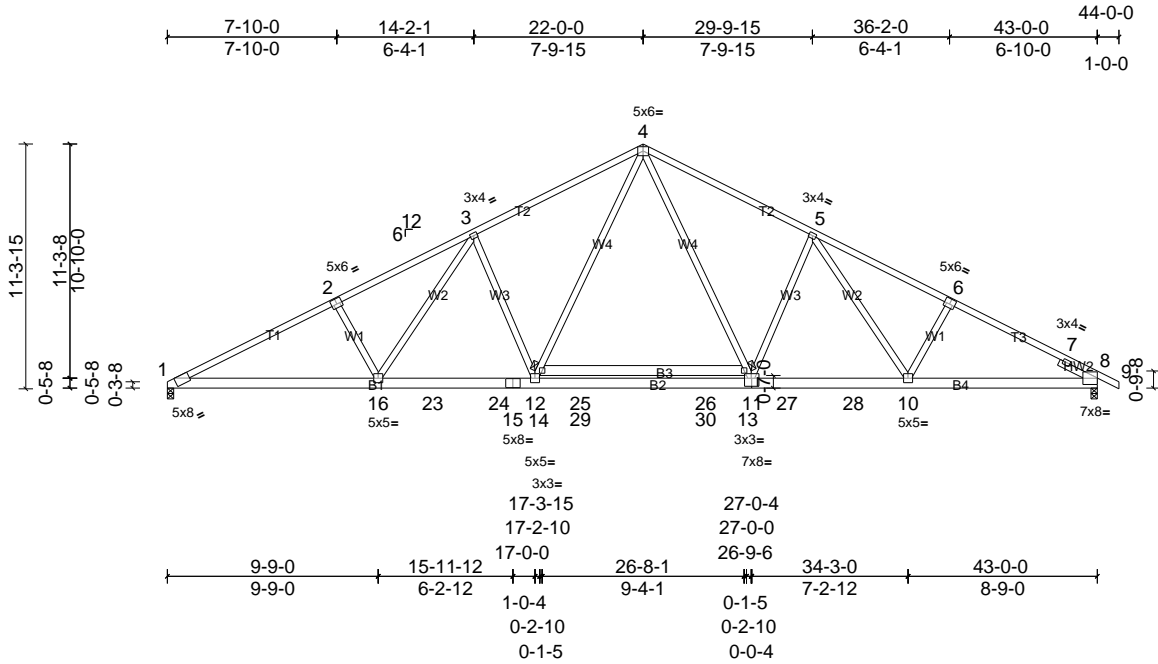

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.36	13-14	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.97	Vert(CT)	-0.68	13-14	>757	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.82	Horz(CT)	0.13	8	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 290 lb	FT = 20%

LUMBER	
TOP CHORD	2x4 SP SS *Except* 6-9:2x4 SP No.1, 2-1:2x4 SP No.2
BOT CHORD	2x6 SP No.2
WEBS	2x4 SP No.3
SLIDER	Right 2x4 SP No.3 -- 1-11-0
BRACING	
TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
REACTIONS (lb/size)	
1=1808/0-3-8, (min. 0-2-3), 8=1873/0-3-8, (min. 0-2-4)	
Max Horiz 1=196 (LC 15)	
Max Uplift 1=180 (LC 10), 8=193 (LC 11)	
Max Grav 1=1854 (LC 2), 8=1920 (LC 2)	
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-2=-3677/761, 2-3=-3519/790, 3-4=-2904/704, 4-5=-2872/697, 5-6=-3187/721, 6-7=-3323/691, 7-8=-1375/21
BOT CHORD	1-16=-554/3227, 16-23=-338/2760, 23-24=-338/2760, 15-24=-338/2760, 12-15=-338/2760, 12-25=-111/2192, 25-26=-111/2192, 11-26=-111/2192, 11-27=-319/2672, 27-28=-319/2672, 10-28=-319/2672, 8-10=-479/2902
WEBS	2-16=-364/252, 3-16=-186/661, 3-12=-754/393, 12-14=-263/982, 4-14=-213/1222, 4-13=-196/1150, 11-13=-247/914, 5-11=-628/364, 5-10=-114/362, 6-10=-260/216

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 180 lb uplift at joint 1 and 193 lb uplift at joint 8.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.





Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A11	Hip	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:42
ID:a?q6?71yTv6SHVH?OIzQvZz8gqv-On4MLEMVCjhVzKxT4rPuPf7nSsLiE_LiCZRnq?yqbs3

Page: 1

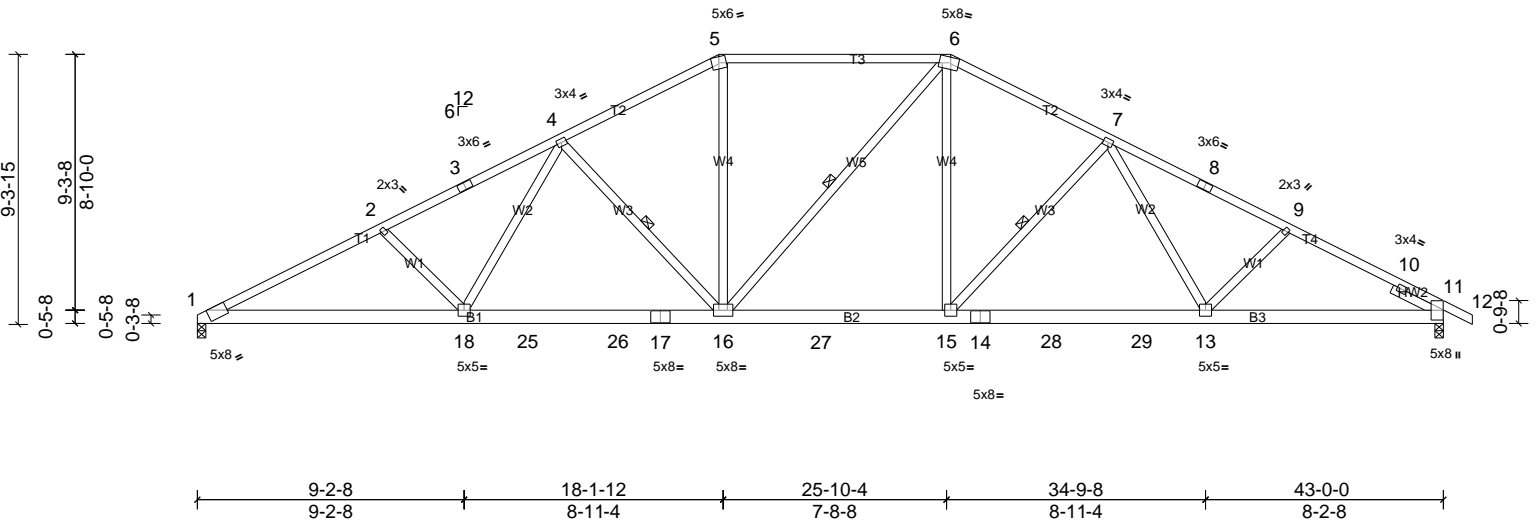

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.21	13-15	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.85	Vert(CT)	-0.41	13-15	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.29	Horz(CT)	0.12	11	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 272 lb	FT = 20%

LUMBER		
TOP CHORD	2x4 SP No.2 *Except* 5-6:2x4 SP SS	
BOT CHORD	2x6 SP No.2	
WEBS	2x4 SP No.3	
SLIDER	Right 2x4 SP No.3 -- 1-11-0	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 5-6.	
BOT CHORD	Rigid ceiling directly applied or 8-9-2 oc bracing.	
WEBS	1 Row at midpt 4-16, 6-16, 7-15	
REACTIONS (lb/size)		
	1=1713/0-3-8, (min. 0-2-0), 11=1775/0-3-8, (min. 0-2-2)	
	Max Horiz 1=161 (LC 15)	
	Max Uplift 1=207 (LC 10), 11=222 (LC 11)	
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-2=-3368/886, 2-3=-3135/830, 3-4=-3050/848, 4-5=-2334/718, 5-6=-2035/687, 6-7=-2329/712, 7-8=-2762/770, 8-9=-2836/752, 9-10=-3002/795, 10-11=-1228/199	
BOT CHORD	1-18=-690/2974, 18-25=-474/2461, 25-26=-474/2461, 17-26=-474/2461, 16-17=-474/2461, 16-27=-266/2034, 15-27=-266/2034, 14-15=-444/2342, 14-28=-444/2342, 28-29=-444/2342, 13-29=-444/2342, 11-13=-593/2621	
WEBS	2-18=-360/248, 4-18=-96/575, 4-16=-660/305, 5-16=-117/682, 6-15=-110/699, 7-15=-529/269, 7-13=-32/359	

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 207 lb uplift at joint 1 and 222 lb uplift at joint 11.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.


LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A12	Hip	1	1	Job Reference (optional)

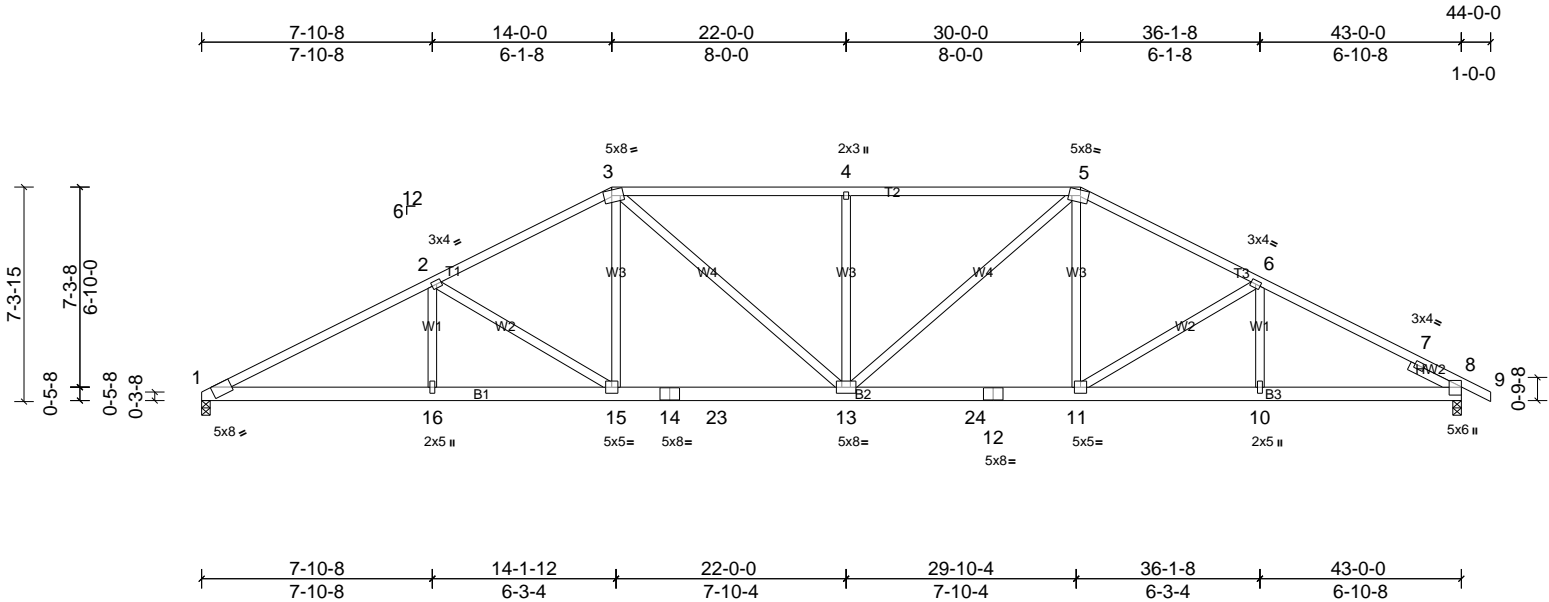

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.19	13-15	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.93	Vert(CT)	-0.38	13-15	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.70	Horz(CT)	0.12	8	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 263 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 *Except* 3-5:2x4 SP SS

BOT CHORD 2x6 SP No.2

WEBS 2x4 SP No.3

SLIDER Right 2x4 SP No.3 -- 1-11-0

BRACING

TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (3-2-14 max.): 3-5.

BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS (lb/size) 1=1713/0-3-8, (min. 0-2-0), 8=1775/0-3-8, (min. 0-2-2)

Max Horiz 1=126 (LC 15)

Max Uplift 1=170 (LC 10), 8=183 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3353/830, 2-3=-2711/731, 3-4=-2720/787, 4-5=-2720/787, 5-6=-2626/708, 6-7=-2951/741, 7-8=-1237/91

BOT CHORD 1-16=-617/2923, 15-16=-617/2923, 14-15=-375/2351, 14-23=-375/2351, 13-23=-375/2351, 13-24=-357/2281, 12-24=-357/2281, 11-12=-357/2281, 10-11=-526/2570, 8-10=-526/2570

WEBS 2-16=0/322, 2-15=-684/285, 3-15=-59/534, 3-13=-176/630, 4-13=-554/266, 5-13=-180/710, 5-11=-27/450, 6-11=-365/210

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 170 lb uplift at joint 1 and 183 lb uplift at joint 8.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A13	Roof Special Girder	1	2	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:45
ID:a?q6771yTv6SHVH?OIzQvZz8gqv-s_eIzZN7z0pMauWfdZw7tgytVGI0zJOrQDAKMRyqbs2

Page: 1

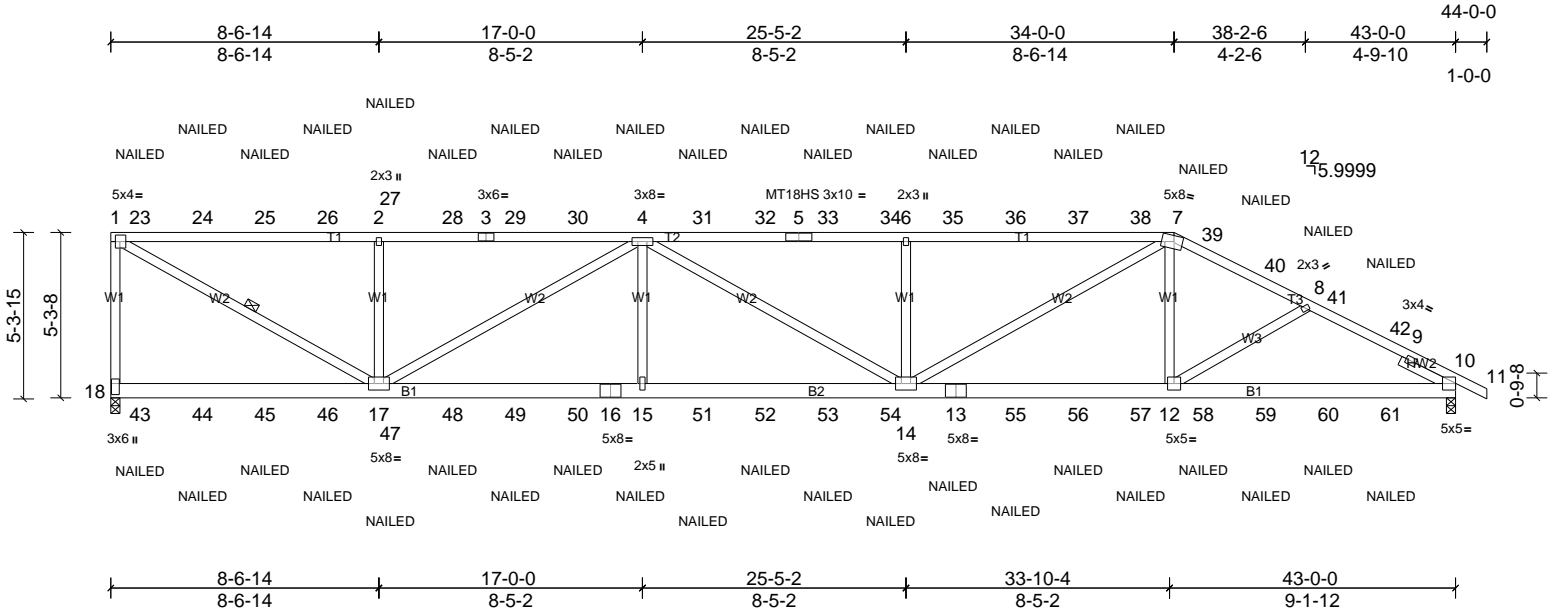

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	0.40	14-15	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(CT)	-0.39	14-15	>999	180	MT18HS 244/190
BCLL	0.0*	Rep Stress Incr	NO	WB	0.81	Horz(CT)	-0.08	10	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 534 lb FT = 20%

LUMBER
TOP CHORD 2x4 SP SS *Except* 7-11,3-5:2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3
SLIDER Right 2x4 SP No.3 -- 1-11-10

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-1-8 oc purlins, except end verticals, and 2-0-0 oc purlins (4-6-4 max.): 1-7.
BOT CHORD Rigid ceiling directly applied or 8-4-5 oc bracing.

WEBS 1 Row at midpt 1-17
REACTIONS (lb/size) 10=2484/0-3-8, (min. 0-1-8), 18=2402/0-3-8, (min. 0-1-9)
Max Horiz 18=207 (LC 6)
Max Uplift 10=1467 (LC 4), 18=1805 (LC 4)
Max Grav 10=2563 (LC 17), 18=2628 (LC 17)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=2479/1775, 1-23=3799/2593, 23-24=3799/2593, 24-25=3799/2593, 25-26=3799/2593, 2-26=3799/2593, 2-27=3799/2593, 27-28=3799/2593, 3-28=3799/2593, 3-29=3799/2593, 29-30=3799/2593, 4-30=3799/2593, 4-31=5721/3850, 31-32=5721/3850, 5-32=5721/3850, 5-33=5721/3850, 33-34=5721/3850, 6-34=5721/3850, 6-35=5721/3850, 35-36=5721/3850, 36-37=5721/3850, 37-38=5721/3850, 7-38=5721/3850, 7-39=4297/2829, 39-40=4395/2827, 8-40=4420/2829, 8-41=4425/2794, 41-42=4485/2798, 9-42=4513/2813, 9-10=2138/1138

NOTES
1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
3) Unbalanced roof live loads have been considered for this design.
4) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
5) Provide adequate drainage to prevent water ponding.
6) All plates are MT20 plates unless otherwise indicated.
7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1805 lb uplift at joint 18 and 1467 lb uplift at joint 10.
10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
12) "NAILED" indicates Girder: 3-10d (0.148" x 3") toe-nails per NDS guidelines.


LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-7=60, 7-11=60, 18-19=20
Concentrated Loads (lb)
Vert: 4=39 (B), 15=23 (B), 13=23 (B), 23=45 (B), 24=39 (B), 25=39 (B), 26=39 (B), 27=39 (B), 28=39 (B), 29=39 (B), 30=39 (B), 31=39 (B), 32=39 (B), 33=39 (B), 34=39 (B), 35=39 (B), 36=39 (B), 37=39 (B), 38=39 (B), 40=11 (B), 41=40 (B), 42=46 (B), 43=25 (B), 44=23 (B), 45=23 (B), 46=23 (B), 47=23 (B), 48=23 (B), 49=23 (B), 50=23 (B), 51=23 (B), 52=23 (B), 53=23 (B), 54=23 (B), 55=23 (B), 56=23 (B), 57=23 (B), 58=151 (B), 59=52 (B), 60=22 (B), 61=26 (B)



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	A14	Jack-Closed Supported Gable	2	1	Job Reference (optional)

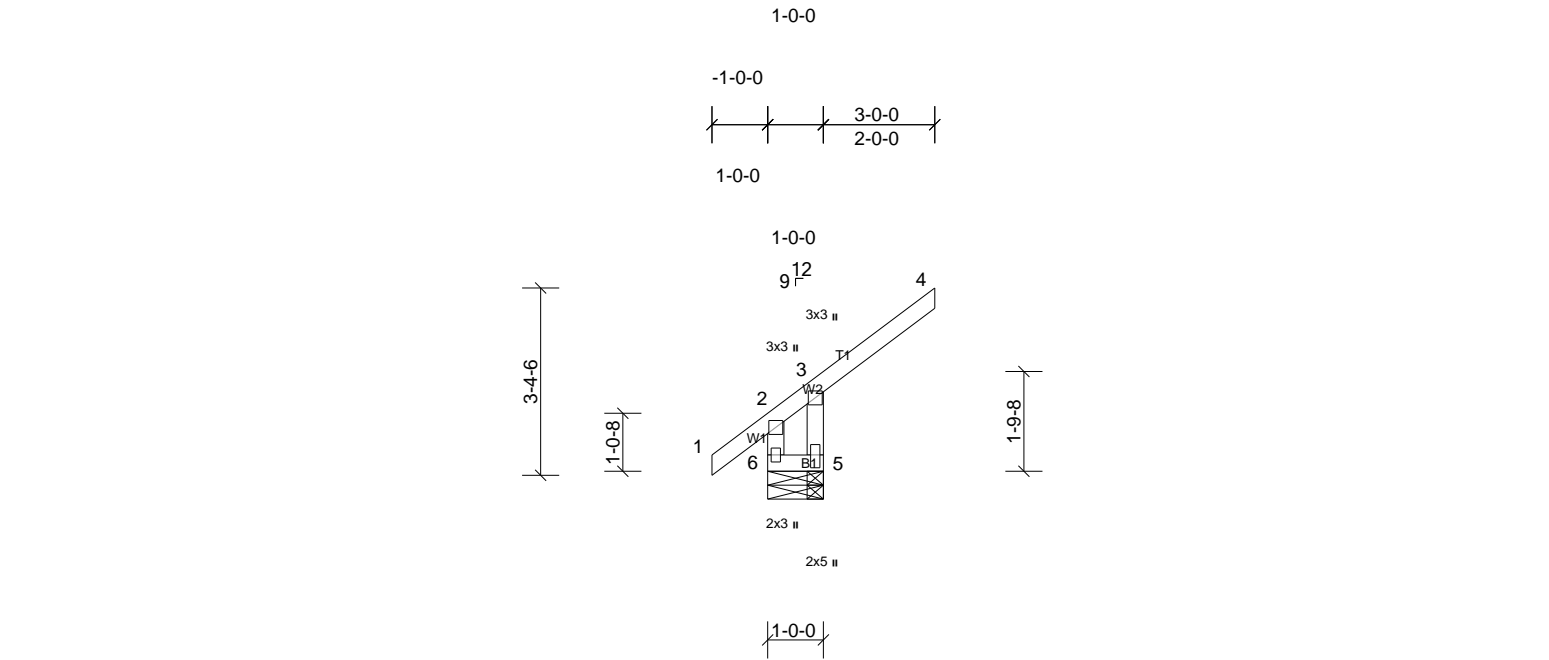

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	0.00	5-6	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	0.00	5-6	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 12 lb	FT = 20%

- LUMBER**
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
- REACTIONS** (lb/size) 5=296/1-0-0, (min. 0-1-8), 6=42/1-0-0, (min. 0-1-8)
 Max Horiz 6=112 (LC 7)
 Max Uplift 5=333 (LC 7), 6=118 (LC 6)
 Max Grav 5=322 (LC 17), 6=294 (LC 7)
- FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-299/142, 3-5=-300/493, 2-6=-297/107

- NOTES**
 1) Unbalanced roof live loads have been considered for this design.
 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 118 lb uplift at joint 6 and 333 lb uplift at joint 5.
 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard




UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:46 Page: 1
ID:nLgRojpyMdJ9y1Na4d8mboznrgO-HZKiBbQ?GxBwSMEEJhTqaVldsTqnArSi7BP_zmyqbs?



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	CP1G	Common Structural Gable	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:47 Page: 1
ID:zkW0hH9WmDrAJLWzjVeKkiznrFy-HZKtBbQ?GxBwSMEEJhTqaVlc8TqUAs4I7BP_zmyqbs?

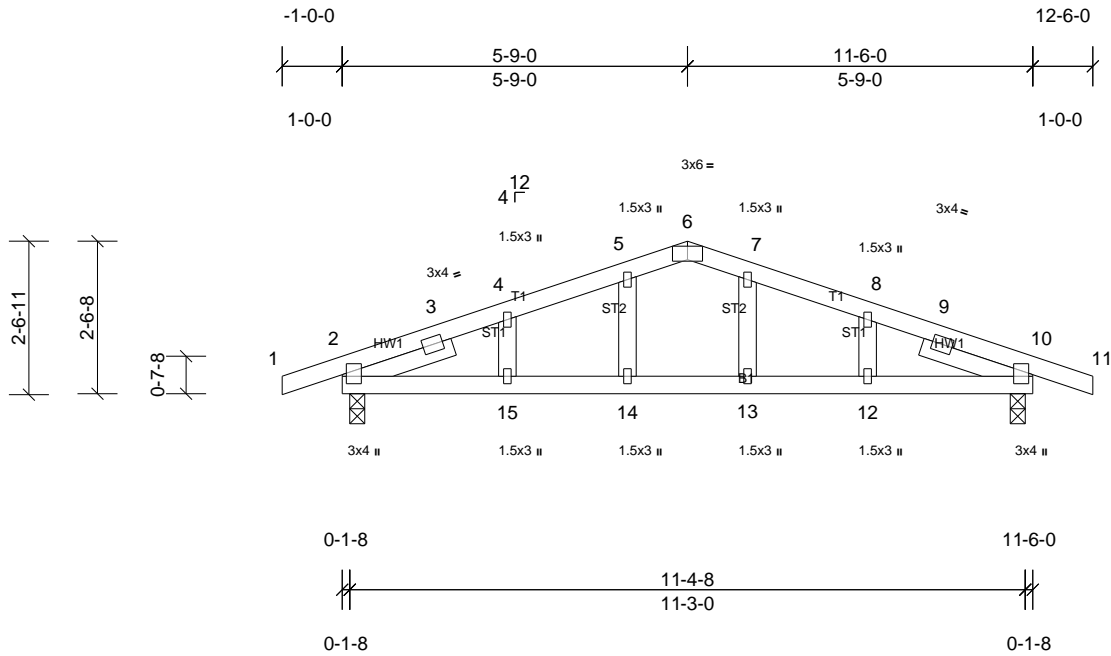

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.36	Vert(LL)	0.05	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.34	Vert(CT)	-0.07	12-13	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 52 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-11-0, Right 2x4 SP No.3 -- 1-11-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 7-4-12 oc bracing.

REACTIONS (lb/size) 2=520/0-3-0, (min. 0-1-8), 10=520/0-3-0, (min. 0-1-8)
Max Horiz 2=-39 (LC 11)
Max Uplift 2=-227 (LC 6), 10=-227 (LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-458/473, 3-4=-693/706, 4-5=-707/724, 5-6=-642/682, 6-7=-642/682, 7-8=-707/724, 8-9=-693/706, 9-10=-430/460
BOT CHORD 2-15=-598/656, 14-15=-598/656, 13-14=-598/656, 12-13=-598/656, 10-12=-598/656

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 227 lb uplift at joint 2 and 227 lb uplift at joint 10.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ1	Jack-Open	29	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:47
 Page: 1

ID:2eSnhc8aKqcOXHEVg1K1s?yJ0CT-lItFPxQe1FJn3WpQsP_36jrkMtAOvJ2RLr8YVCyqbs_

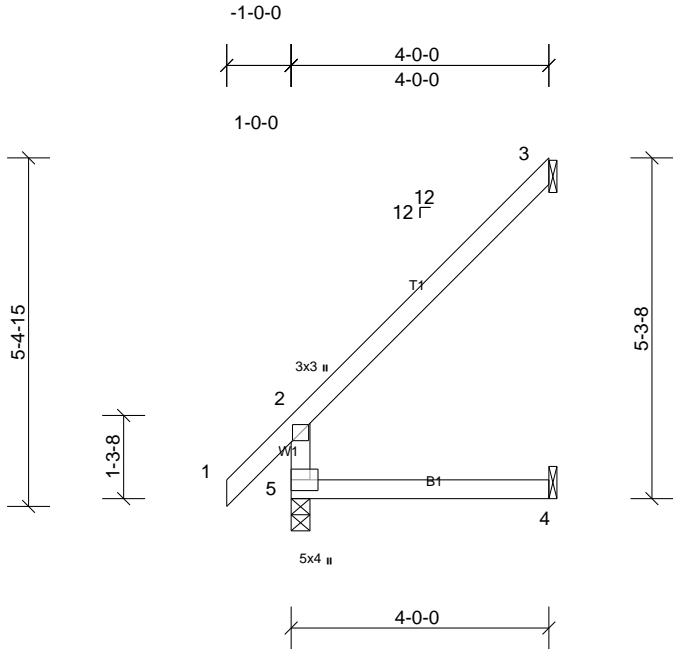

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.53	Vert(LL)	0.03	4-5	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.36	Vert(CT)	-0.03	4-5	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.06	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 18 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=99/ Mechanical, 4=43/ Mechanical, 5=231/0-3-8, (min. 0-1-8)
 Max Horiz 5=178 (LC 10)
 Max Uplift 3=-132 (LC 10), 4=-18 (LC 10)
 Max Grav 3=126 (LC 17), 4=73 (LC 3), 5=231 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 132 lb uplift at joint 3 and 18 lb uplift at joint 4.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ1G	Jack-Open Supported Gable	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:47
ID:GINTIRRDZDiAmyDD9j8mBzZyJ0DO-ltFPxQe1FJn3WpQsP_36jroBtDyvJGRLr8YVCyqbs_

Page: 1

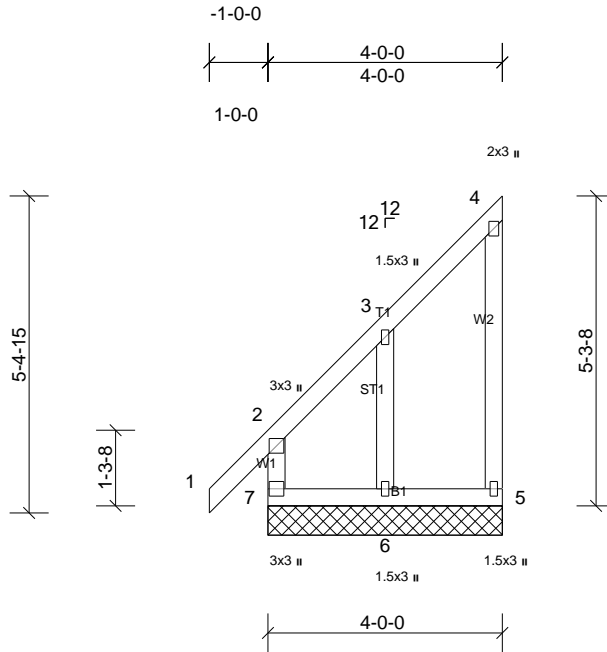

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.14	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 29 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 5=63/4-0-0, (min. 0-1-8),
6=149/4-0-0, (min. 0-1-8),
7=153/4-0-0, (min. 0-1-8)
Max Horiz 7=207 (LC 7)
Max Uplift 5=-44 (LC 9), 6=-205 (LC 10),
7=-81 (LC 6)
Max Grav 5=82 (LC 17), 6=233 (LC 17),
7=242 (LC 18)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 7, 44 lb uplift at joint 5 and 205 lb uplift at joint 6.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ1T	Jack-Open	4	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:47
ID:t3KTWUQ?wuW8opVwWMEQHryJ0C6-ItFPxQe1FJn3WpQsP_36jrtorAVvj2RLr8YVCyqbs_

Page: 1

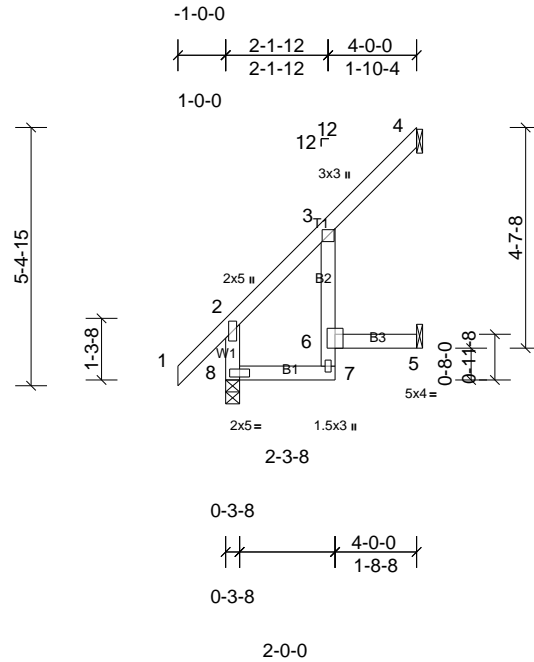

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	0.03	7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.36	Vert(CT)	-0.03	7	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.04	4	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 22 lb	FT = 20%

LUMBER **LOAD CASE(S)** Standard

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* 7-3:2x4 SP No.3
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or
4-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (lb/size) 4=85/ Mechanical, 5=56/
Mechanical, 8=231/0-3-8, (min.
0-1-8)
Max Horiz 8=178 (LC 10)
Max Uplift 4=97 (LC 10), 5=54 (LC 10)
Max Grav 4=106 (LC 17), 5=75 (LC 17),
8=231 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250
(lb) or less except when shown.

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat.
II; Exp B; Enclosed; MWFRS (envelope) exterior zone
and C-C Exterior (2) zone; cantilever left and right
exposed; end vertical left and right exposed; C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 5) Bearing at joint(s) 8 considers parallel to grain value
using ANSI/TPI 1 angle to grain formula. Building
designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 97 lb uplift at joint
4 and 54 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2015
International Residential Code sections R502.11.1 and
R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ2	Jack-Open	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:48
ID:INdqUTurZiIMfPDILwKqsyJ0BW-DxRecHRGoZRehfOdQ6WlfwNyPHXlelSbaVu40eyqbrz

Page: 1

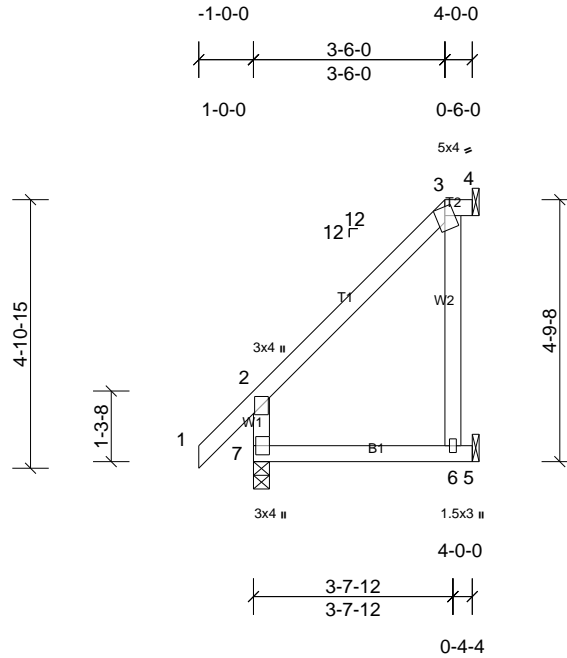

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.38	Vert(LL)	0.04	6-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	-0.04	6-7	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.12	Horz(CT)	-0.06	4	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 24 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4'-0-0 oc purlins, except end verticals, and 2'-0-0 oc purlins: 3-4.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS (lb/size) 4=-30/ Mechanical, 5=171/ Mechanical, 7=231/0-3-8, (min. 0-1-8)
Max Horiz 7=162 (LC 10)
Max Uplift 4=-62 (LC 17), 5=-239 (LC 10)
Max Grav 4=115 (LC 10), 5=224 (LC 17), 7=231 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-6=-300/287

NOTES


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06-00 tall by 2'-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 4 and 239 lb uplift at joint 5.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry	Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:48	Page: 1
ID:XGI??G0A380Y0y05iN585TyJ0A3-DxRecHRGoZRhfOdQ6WlwfNzqHXgemSBaVvu40eyqbrz		

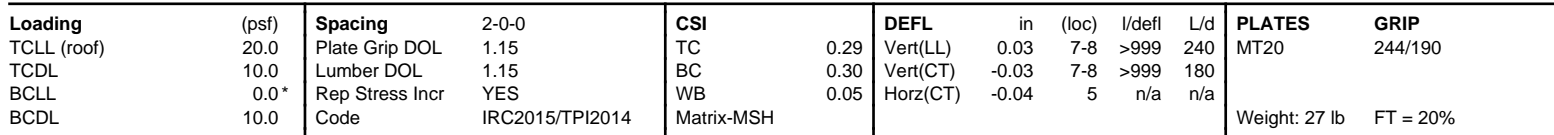

LOAD CASE(S) Standard




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ3	Jack-Open	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:48
ID:cEGNQf0EWtTmTis23J4czzyJ08m-DxRecHRGoZRehfOdQ6WlfwNzbHYbemrbaVu40eyqbrz

Page: 1

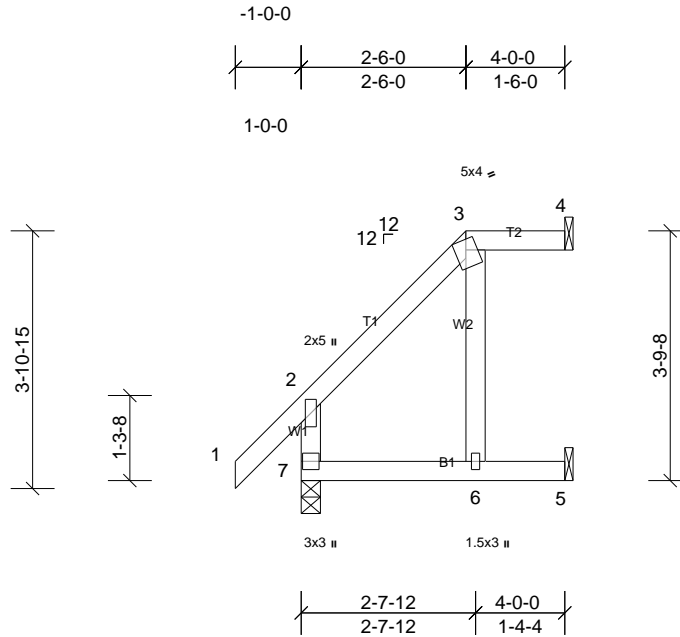

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	0.03	6-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.04	6-7	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	-0.07	4	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 22 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.

BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 4=69/ Mechanical, 5=72/ Mechanical, 7=231/0-3-8, (min. 0-1-8)
Max Horiz 7=122 (LC 10)
Max Uplift 4=-29 (LC 7), 5=-48 (LC 10)
Max Grav 4=69 (LC 1), 5=78 (LC 17), 7=231 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 4 and 48 lb uplift at joint 5.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ3T	Jack-Open	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:49
ID:RF93FWIf5iNVkE6Tve_?OqyJ08P-h8?0qdSuZsZVJpzp_p1XB8w96gt2NDYkp9ddZ5yqbry

Page: 1

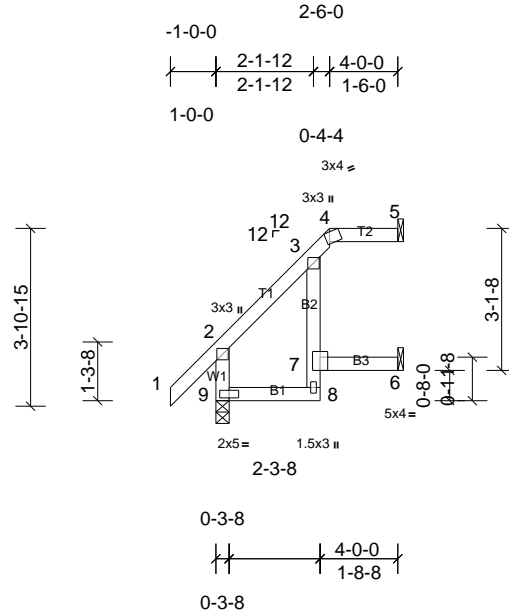

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	0.03	8	>999	240	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.29	Vert(CT)	-0.03	8	>999	180	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.05	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 22 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* 8-3:2x4 SP No.3
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-5.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 5=83/ Mechanical, 6=59/ Mechanical, 9=231/0-3-8, (min. 0-1-8)
Max Horiz 9=122 (LC 10)
Max Uplift 5=-38 (LC 7), 6=-34 (LC 10)
Max Grav 5=83 (LC 1), 6=66 (LC 3), 9=231 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 5 and 34 lb uplift at joint 6.

- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ4	Jack-Open	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:49
ID:cKN4ivruVX27d9262bIYjJyJ07i-h8?0qdSuZsZVJpzp_p1XB8w7sguGNDYkp9ddZ5yqbry

Page: 1

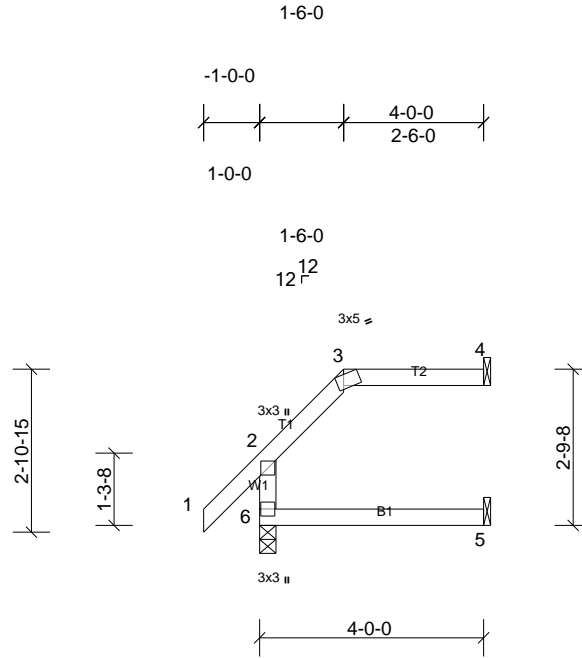

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	0.02	5-6	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.02	5-6	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.06	4	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 17 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 4=100/ Mechanical, 5=41/ Mechanical, 6=231/0-3-8, (min. 0-1-8)
Max Horiz 6=82 (LC 10)
Max Uplift 4=-54 (LC 7), 6=-17 (LC 10)
Max Grav 4=100 (LC 1), 5=72 (LC 3), 6=231 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 6 and 54 lb uplift at joint 4.
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ4T	Jack-Open	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:49
ID:Zz0GhP3p1NRQP4?mf48?_KyJ07P-h8?0qdSuZsZVJpzp_p1XB8w9mgv2NDYkp9ddZ5yqbry

Page: 1

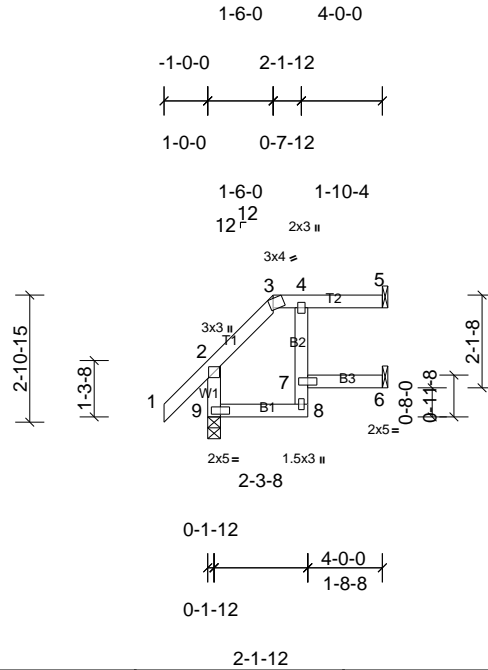

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	0.01	7	>999	240	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(CT)	-0.02	7	>999	180	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.03	5	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 20 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* 8-4:2x4 SP No.3
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 5=91/ Mechanical, 6=50/ Mechanical, 9=231/0-3-8, (min. 0-1-8)
Max Horiz 9=82 (LC 10)
Max Uplift 5=-38 (LC 7), 6=-9 (LC 7), 9=-17 (LC 10)
Max Grav 5=91 (LC 1), 6=59 (LC 3), 9=231 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 5, 9 lb uplift at joint 6 and 17 lb uplift at joint 9.

- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.


LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ5	Jack-Open	2	1	Job Reference (optional)

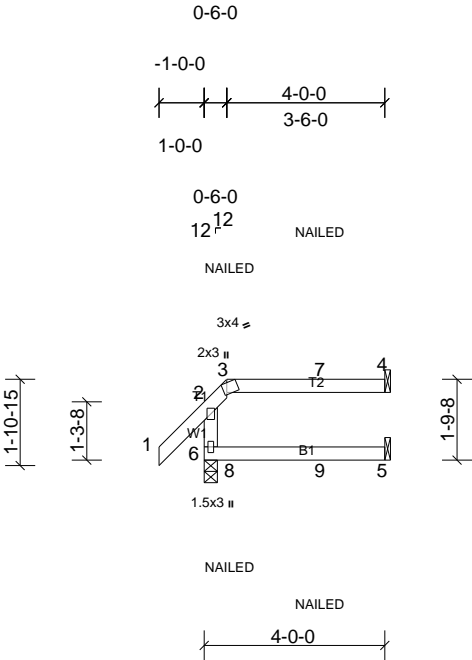

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	0.01	5-6	>999	240	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(CT)	-0.02	5-6	>999	180	244/190
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.03	4	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 16 lb FT = 20%

- LUMBER**
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
- 9) "NAILED" indicates Girder: 3-10d (0.148" x 3") toe-nails per NDS guidelines.
 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- LOAD CASE(S)** Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-60, 2-3=-60, 3-4=-60, 5-6=-20
 Concentrated Loads (lb)
 Vert: 8=-10 (B), 9=-4 (B)

- REACTIONS** (lb/size) 4=101/ Mechanical, 5=43/ Mechanical, 6=241/0-3-8, (min. 0-1-8)
 Max Horiz 6=52 (LC 5)
 Max Uplift 4=-52 (LC 5), 6=-48 (LC 8)
 Max Grav 4=106 (LC 20), 5=73 (LC 3), 6=241 (LC 1)

- FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
 1) Unbalanced roof live loads have been considered for this design.
 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 3) Provide adequate drainage to prevent water ponding.
 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 6 and 52 lb uplift at joint 4.
 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	EJ6	Jack-Open	1	1	Job Reference (optional)


UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:50
ID:kMjrZzPNRzzSmN88lyea7EyJ06z-9KZO1zTWKAhMwzY?YXYmkLTJ84F66got2pNB5Xyqbrx

Page: 1



NAILED

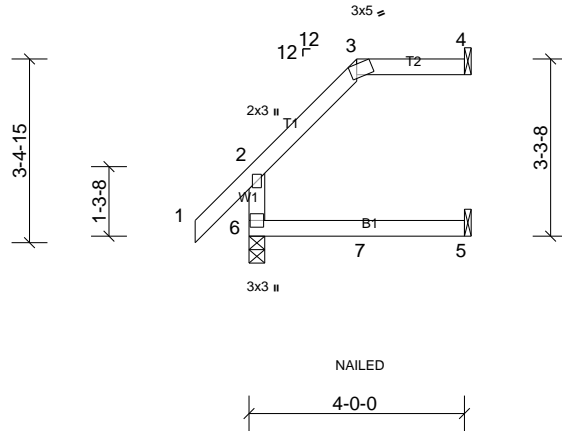

NAILED

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	0.03	5-6	>999	240	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(CT)	-0.02	5-6	>999	180	244/190
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	-0.10	4	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 17 lb FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 4=99/ Mechanical, 5=41/ Mechanical, 6=230/0-3-8, (min. 0-1-8)
Max Horiz 6=102 (LC 8)
Max Uplift 4=-78 (LC 5), 5=-19 (LC 8), 6=-48 (LC 8)
Max Grav 4=99 (LC 1), 5=72 (LC 3), 6=230 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) "NAILED" indicates Girder: 3-10d (0.148" x 3") toe-nails per NDS guidelines.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-60, 2-3=-60, 3-4=-60, 5-6=-20
Concentrated Loads (lb)
Vert: 7=2 (B)

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 6, 78 lb uplift at joint 4 and 19 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	P1	Monopitch	7	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:50
ID:a?q6?71yTv6SHVH?OlZqvZz8gqv-9KZO1zTWKAhMwzY?YXYmkLTJH4ED6got2pNB5Xyqbrx

Page: 1

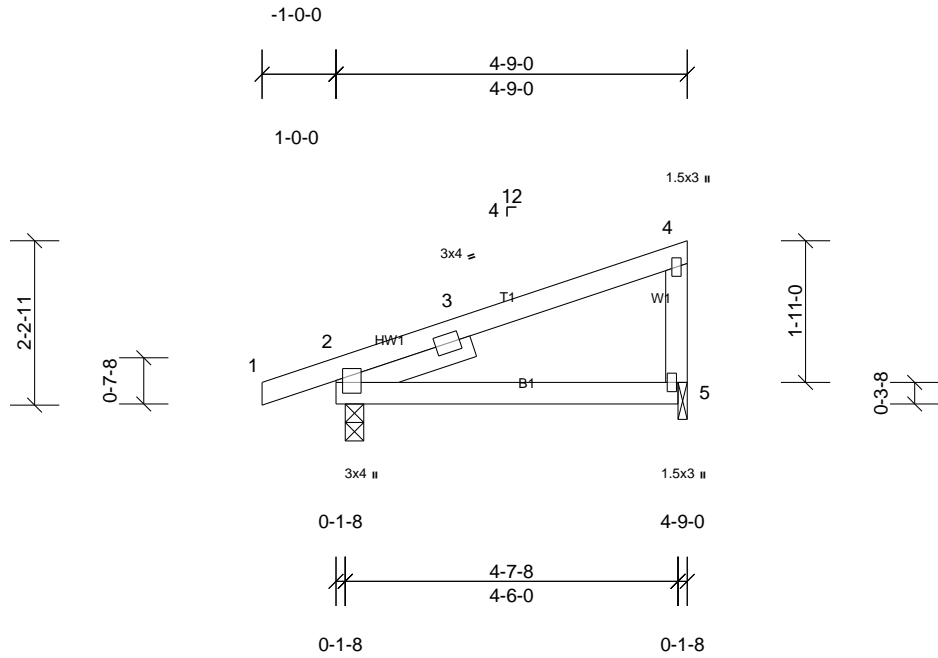

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	0.05	5-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.04	5-8	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 21 lb	FT = 20%

LUMBER **LOAD CASE(S)** Standard

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-11-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-9-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=251/0-3-0, (min. 0-1-8),
5=178/0-1-8, (min. 0-1-8)
Max Horiz 2=84 (LC 9)
Max Uplift 2=-121 (LC 6), 5=-85 (LC 6)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250
(lb) or less except when shown.

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 2 and 85 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	P2	Monopitch	4	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:50

Page: 1

ID:a?q6?71yTv6SHVH?OlZqv2z8gqv-9KZO1zTWKAhMwzY?YXYmkLT114DI6got2pNB5Xyqbrx

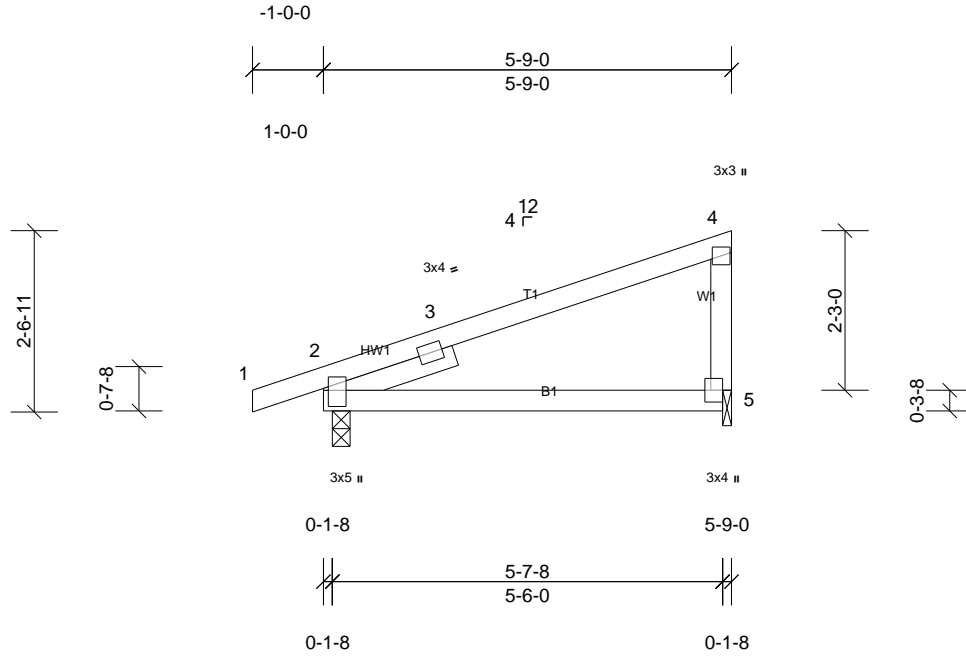

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	0.08	5-8	>852	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.29	Vert(CT)	-0.06	5-8	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 25 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-11-0

8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-9-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=290/0-3-0, (min. 0-1-8),
5=219/0-1-8, (min. 0-1-8)
Max Horiz 2=99 (LC 9)
Max Uplift 2=-137 (LC 6), 5=-104 (LC 6)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-256/281

NOTES


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 137 lb uplift at joint 2 and 104 lb uplift at joint 5.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	SJ1	Jack-Open	4	1	Job Reference (optional)

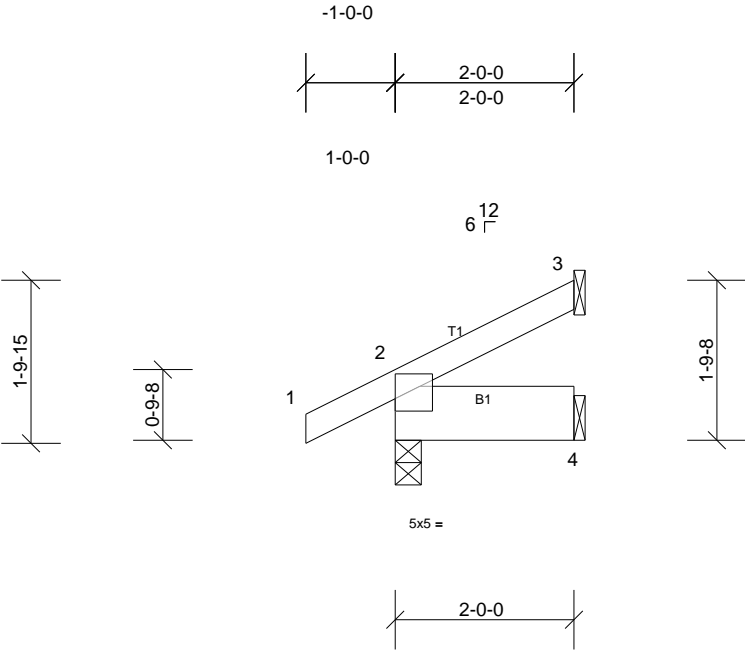

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.01	Vert(CT)	0.00	4-7	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 11 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x8 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=155/0-3-8, (min. 0-1-8), 3=41/ Mechanical, 4=24/ Mechanical
 Max Horiz 2=57 (LC 10)
 Max Uplift 2=-27 (LC 10), 3=-27 (LC 10), 4=-1 (LC 10)
 Max Grav 2=155 (LC 1), 3=41 (LC 1), 4=40 (LC 3)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 3, 27 lb uplift at joint 2 and 1 lb uplift at joint 4.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	SJ2	Jack-Open	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:51
ID:ng4F_nZzVNndUYSZio?4j4yJ0Fo-dW7mEJT85UpDY77C5E3?GZ?UJUaar721GT6kdzyqbrw

Page: 1

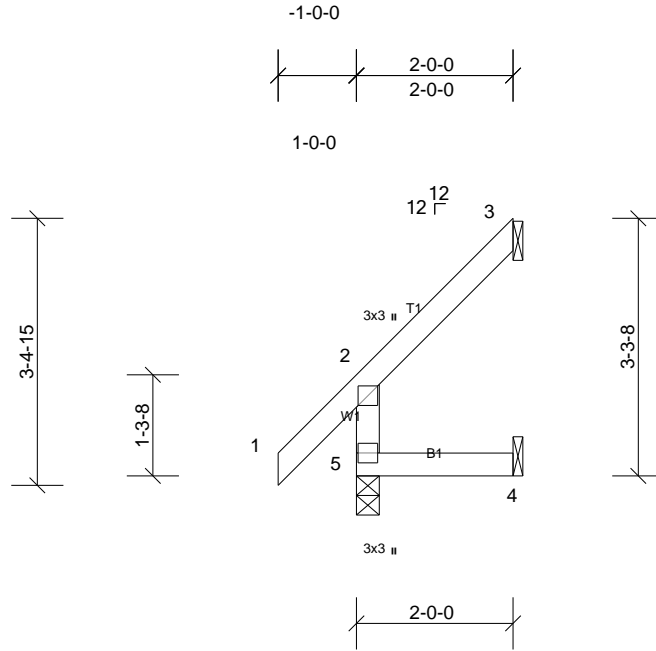

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	0.00	4-5	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(CT)	0.00	4-5	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 11 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=38/ Mechanical, 4=15/ Mechanical, 5=164/0-3-8, (min. 0-1-8)
Max Horiz 5=99 (LC 10)
Max Uplift 3=-72 (LC 10), 4=-22 (LC 10)
Max Grav 3=57 (LC 17), 4=34 (LC 8), 5=164 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 72 lb uplift at joint 3 and 22 lb uplift at joint 4.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	V1	Valley	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:51
ID:7plsK206KF_8zUxj?8AIsNyJ0GW-dW7mEJT85UpDY77C5E3?GZ?THUazr4L1GT6kdzyqbrw

Page: 1

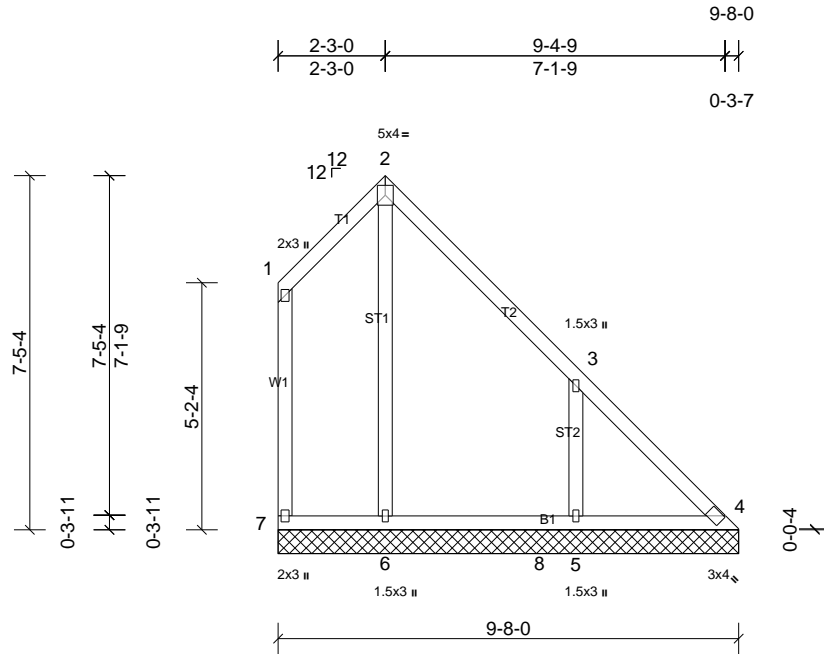

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.24	Horiz(TL)	0.00	4	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 56 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

All bearings 9-8-0.
(lb) - Max Horiz 7=-251 (LC 6)
Max Uplift All uplift 100 (lb) or less at joint(s) 4, 6, 7 except 5=-244 (LC 11)
Max Grav All reactions 250 (lb) or less at joint (s) 4, 7 except 5=434 (LC 18), 6=387 (LC 18)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-266/216
WEBS 2-6=-251/161, 3-5=-357/288

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint (s) 7, 4, 6 except (jt=lb) 5=243.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:51 Page: 1
ID:F22LUhzcG0UjUsdymI6MiXyJ0Ga-dW7mEJT85UpDY77C5E3?GZ?V2UJr501GT6kdzyqbrw




Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	V3	Valley	1	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:52
ID:u4FSRzvTRUrQO5I_zlWB?UyJ0Gf-5jh8SeUmsnx4AHiOfyaEpmYg4uxoaZYAV7sl9Qyqbrv

Page: 1

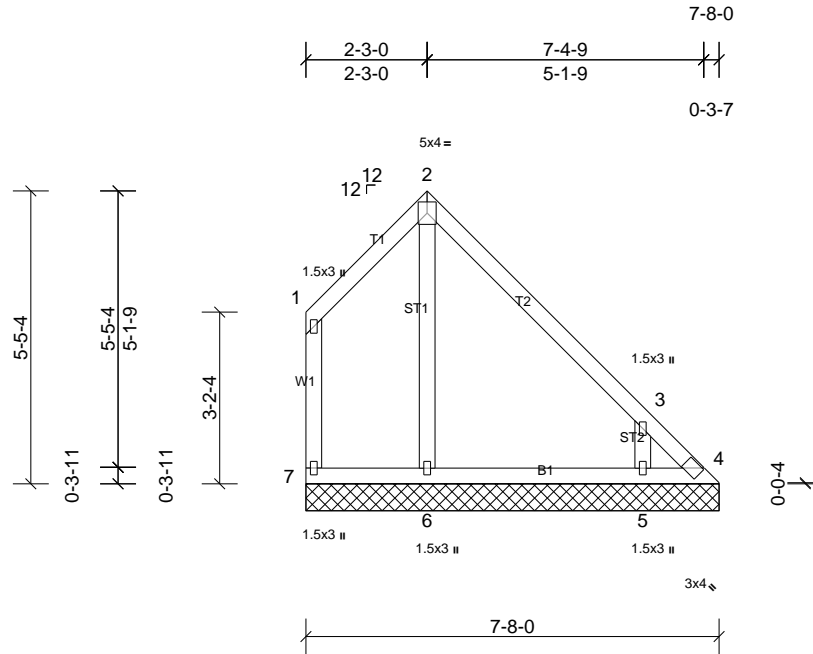

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horiz(TL)	0.00	4	n/a	n/a	Weight: 40 lb
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							FT = 20%

LUMBER **LOAD CASE(S)** Standard

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS All bearings 7-8-0.
(lb) - Max Horiz 7=-172 (LC 6)
Max Uplift All uplift 100 (lb) or less at joint(s)
6, 7 except 4=-160 (LC 9), 5=-231 (LC 11)
Max Grav All reactions 250 (lb) or less at joint (s) 4, 7 except 5=364 (LC 18), 6=299 (LC 18)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-5=-371/314


- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint (s) 7, 6 except (jt=lb) 4=159, 5=231.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	V4	Valley	1	1	Job Reference (optional)

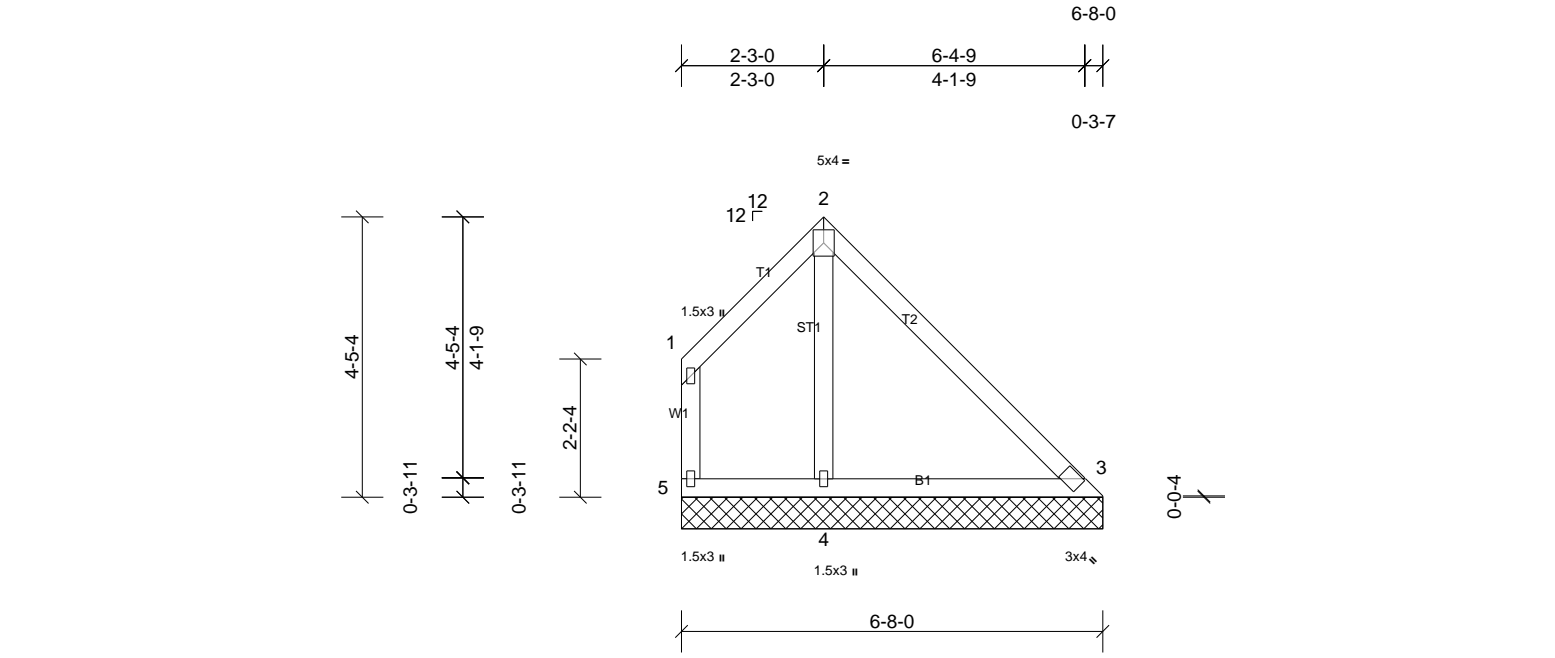

Loading	(psf)	Spacing		CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	2-0-0	TC	0.21	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.18	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 32 lb	FT = 20%

LUMBER		LOAD CASE(S)	Standard
TOP CHORD	2x4 SP No.2		
BOT CHORD	2x4 SP No.2		
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS	(lb/size)	3=144/6-8-0, (min. 0-1-8), 4=304/6-8-0, (min. 0-1-8), 5=47/6-8-0, (min. 0-1-8)
	Max Horiz	5=-132 (LC 6)
	Max Uplift	3=-27 (LC 7), 4=-66 (LC 6), 5=-58 (LC 7)
	Max Grav	3=172 (LC 17), 4=358 (LC 18), 5=88 (LC 17)


FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
---------------	--

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 5, 27 lb uplift at joint 3 and 66 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Page: 1

Job	Truss	Truss Type	Qty	Ply	MUNGO HOMES - TELFAIR D ROOF
72521941	V6	Valley	1	1	Job Reference (optional)

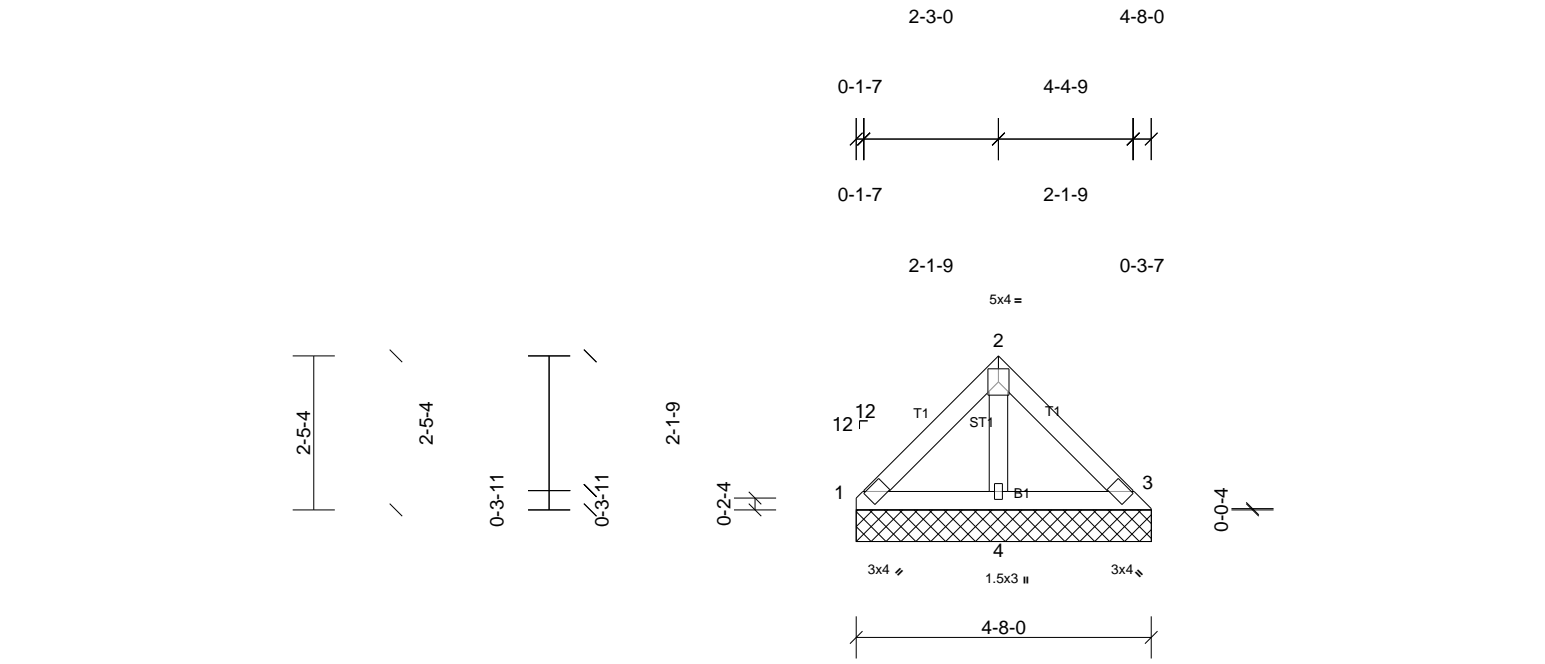

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(TL)	n/a	-	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	3	n/a	Weight: 18 lb
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP						FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-8-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 1=12/4-8-0, (min. 0-1-8), 3=1/4-8-0, (min. 0-1-8), 4=334/4-8-0, (min. 0-1-8)
 Max Horiz 1=57 (LC 7)
 Max Uplift 1=-33 (LC 22), 3=-1 (LC 11), 4=-35 (LC 10)
 Max Grav 1=51 (LC 21), 3=1 (LC 18), 4=334 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint (s) 1, 3, 4, 3.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Joy Perry Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Wed Aug 06 11:08:53 Page: 1
ID:dexosmkBbUlqPbZa_fpCEkyJ0JS-avFXf_VOc53xnRHaDf5TM_4u9IhJ1XKkmbriysqbru

