

Trenco

818 Soundside Rd
Edenton, NC 27932

Re: 2504831-29312
518 Creekside Oaks South

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by 84 Lumber 2383 (Dunn, NC).

Pages or sheets covered by this seal: I76355948 thru I76355976

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844



September 16, 2025

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355948
2504831-29312	A	ATTIC	10	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:26
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

Page: 1

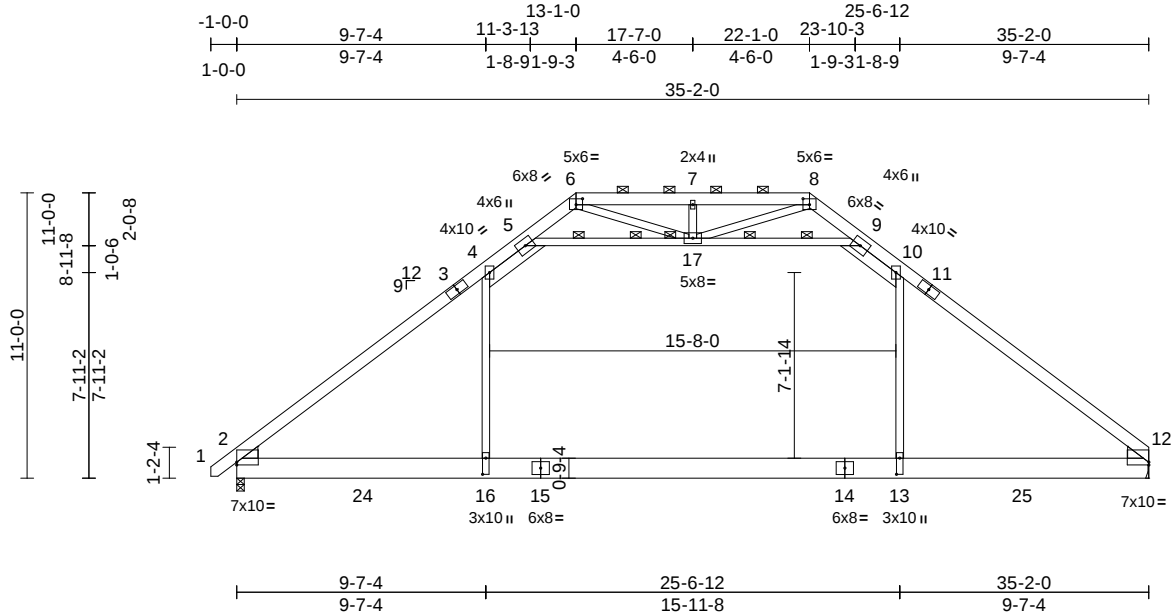

Scale = 1:88.8

Plate Offsets (X, Y): [2:Edge,0-1-5], [6:0-3-0,0-2-12], [8:0-3-0,0-2-12], [12:Edge,0-1-5], [13:0-7-8,0-1-8], [16:0-7-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.67	Vert(LL)	-0.41	13-16	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.61	13-16	>687	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.36	Horz(CT)	0.05	12	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS		Attic	-0.28	13-16	>673	360	Weight: 311 lb FT = 20%

LUMBER

TOP CHORD 2x6 SP DSS *Except* 6-8,4-5,9-10:2x6 SP No.2
BOT CHORD 2x10 SP DSS
WEBS 2x4 SP No.2
WEDGE Left: 2x6 SP No.2
Right: 2x6 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-5-4 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 9-3-11 oc bracing.
WEBS 2 Rows at 1/3 pts 5-17, 9-17
JOINTS 1 Brace at Jt(s): 17

REACTIONS (size) 2=0-3-8, 12= Mechanical
Max Horiz 2=255 (LC 9)
Max Grav 2=2205 (LC 2), 12=2161 (LC 2)


FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/31, 2-4=-3050/23, 4-5=-2100/22, 5-6=-342/332, 6-7=-568/356, 7-8=-568/356, 8-9=-340/333, 9-10=-2100/21, 10-12=-3048/373
BOT CHORD 2-16=-316/2266, 13-16=0/2266, 12-13=-126/2266
WEBS 4-16=0/1262, 5-17=-2744/94, 9-17=-2745/92, 10-13=0/1258, 7-17=-295/126, 6-17=-160/616, 8-17=-160/617

NOTES

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Ceiling dead load (5.0 psf) on member(s). 4-5, 9-10, 5-17, 9-17; Wall dead load (5.0psf) on member(s). 4-16, 10-13
- 7) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 13-16
- 8) Refer to girder(s) for truss to truss connections.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

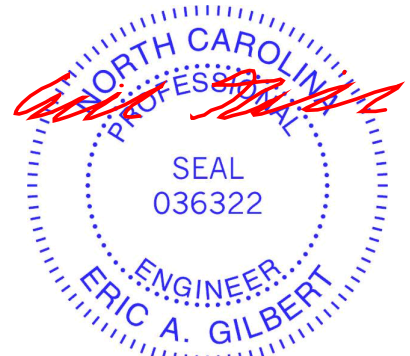

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355949
2504831-29312	A1	ATTIC	2	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:27
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?I

Page: 1

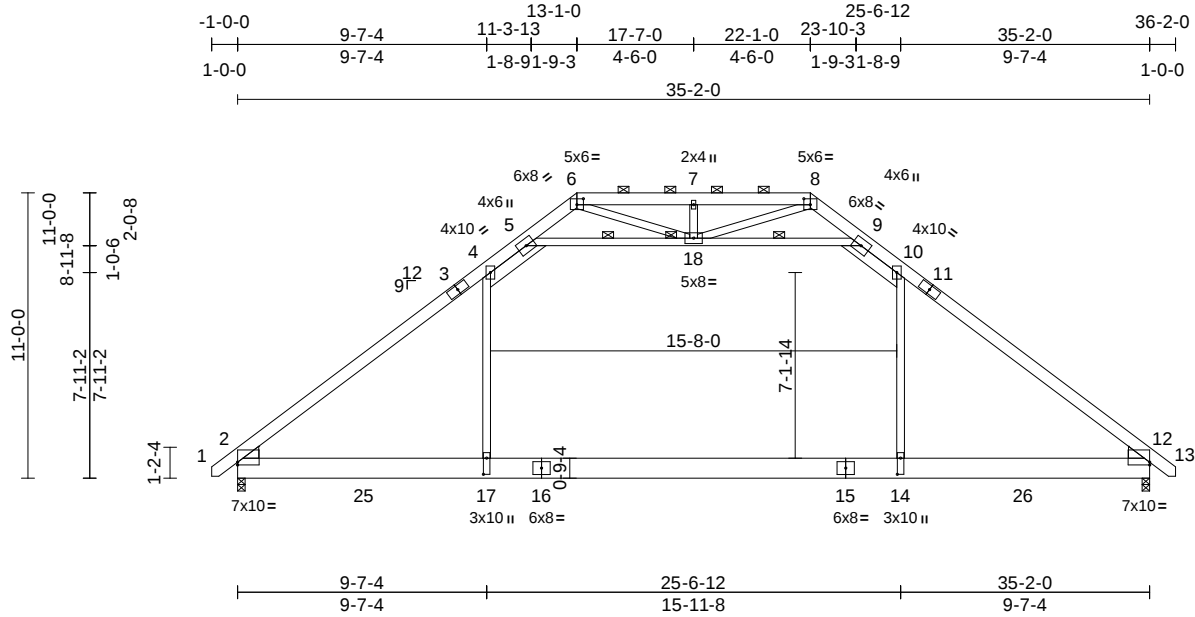

Scale = 1:88.8

Plate Offsets (X, Y): [2:Edge,0-1-5], [6:0-3-0,0-2-12], [8:0-3-0,0-2-12], [12:Edge,0-1-5], [14:0-7-8,0-1-8], [17:0-7-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.67	Vert(LL)	-0.41	14-17	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.61	14-17	>688	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.36	Horz(CT)	0.04	12	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS		Attic	-0.28	14-17	>674	360	Weight: 314 lb FT = 20%

LUMBER

TOP CHORD 2x6 SP DSS *Except* 6-8,4-5,9-10:2x6 SP No.2
BOT CHORD 2x10 SP DSS
WEBS 2x4 SP No.2
WEDGE Left: 2x6 SP No.2
Right: 2x6 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-5-4 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 9-3-11 oc bracing.
WEBS 1 Row at midpt 5-18, 9-18
JOINTS 1 Brace at Jt(s): 18

REACTIONS (size) 2=0-3-8, 12=0-3-8
Max Horiz 2=-260 (LC 10)
Max Grav 2=2204 (LC 2), 12=2204 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/31, 2-4=-3048/23, 4-5=-2099/21, 5-6=-343/331, 6-7=-570/355, 7-8=-570/355, 8-9=-343/331, 9-10=-2099/21, 10-12=-3048/23, 12-13=0/31
BOT CHORD 2-17=-305/2264, 14-17=0/2264, 12-14=-132/2264
WEBS 4-17=0/1261, 5-18=-2740/93, 9-18=-2739/92, 10-14=0/1261, 7-18=-295/126, 6-18=-160/616, 8-18=-160/616

NOTES

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Ceiling dead load (5.0 psf) on member(s). 4-5, 9-10, 5-18, 9-18; Wall dead load (5.0psf) on member(s).4-17, 10-14
- 7) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 14-17
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard



September 16,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	I76355950
2504831-29312	A1E	GABLE	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:28
ID:Fg8LOi5C4YzciAiqPkxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?i

Page: 1

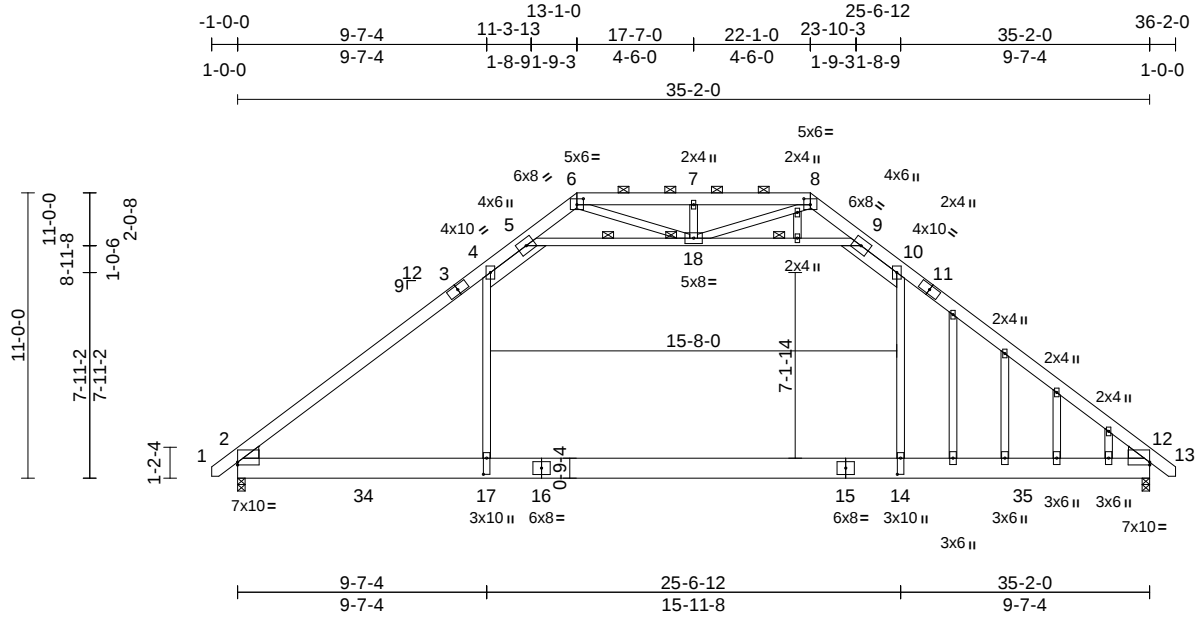

Scale = 1:88.8

Plate Offsets (X, Y): [2:Edge,0-1-5], [6:0-3-0,0-2-12], [8:0-3-0,0-2-12], [12:Edge,0-1-5], [14:0-7-8,0-1-8], [17:0-7-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.67	Vert(LL)	-0.41	14-17	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.61	14-17	>688	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.36	Horz(CT)	0.04	12	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS		Attic	-0.28	14-17	>674	360	Weight: 335 lb	FT = 20%

LUMBER

TOP CHORD	2x6 SP DSS *Except* 6-8,4-5,9-10:2x6 SP No.2
BOT CHORD	2x10 SP DSS
WEBS	2x4 SP No.2
OTHERS	2x4 SP No.2
WEDGE	Left: 2x6 SP No.2 Right: 2x6 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-5-4 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 6-8.
BOT CHORD	Rigid ceiling directly applied or 9-3-11 oc bracing.
WEBS	1 Row at midpt 5-18, 9-18
JOINTS	1 Brace at Jt(s): 18

REACTIONS	(size) 2=0-3-8, 12=0-3-8 Max Horiz 2=-260 (LC 10) Max Grav 2=2204 (LC 2), 12=2204 (LC 2)
-----------	--

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/31, 2-4=-3048/23, 4-5=-2099/21, 5-6=-343/331, 6-7=-570/355, 7-8=-570/355, 8-9=-343/331, 9-10=-2099/21, 10-12=-3048/23, 12-13=0/31
BOT CHORD	2-17=-305/2264, 14-17=0/2264, 12-14=-132/2264
WEBS	4-17=0/1261, 5-18=-2740/93, 9-18=-2739/92, 10-14=0/1261, 7-18=-295/126, 6-18=-160/616, 8-18=-160/616

NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Ceiling dead load (5.0 psf) on member(s). 4-5, 9-10, 5-18, 9-18; Wall dead load (5.0psf) on member(s).4-17, 10-14
- 7) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 14-17
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard



September 16,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355951
2504831-29312	AE	Attic Supported Gable	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:28
ID:Fg8LOi5C4YZciAiqPkxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

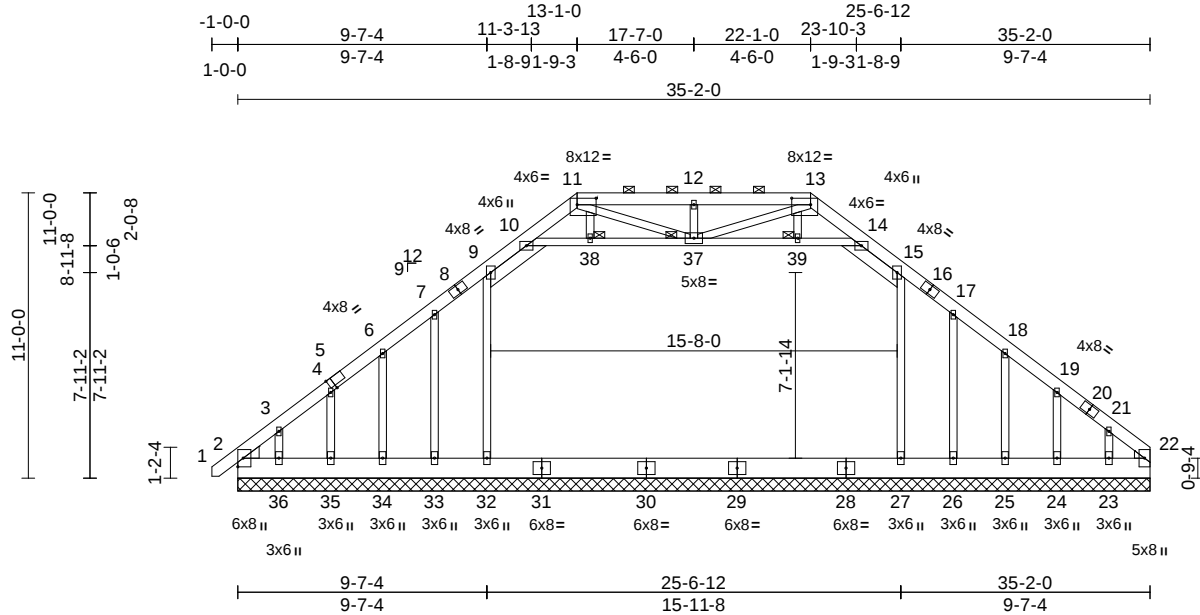

Scale = 1:88.8

Plate Offsets (X, Y): [5:0-2-5,Edge], [11:0-8-12,0-3-0], [13:0-8-12,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.20	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.25	Horz(CT)	0.01	22	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							
Weight: 354 lb FT = 20%											

LUMBER
TOP CHORD 2x6 SP No.2
BOT CHORD 2x10 SP DSS
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2
WEDGE Left: 2x6 SP No.2
Right: 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 11-13.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 37, 38, 39

REACTIONS (size) 2=35-2-0, 22=35-2-0, 23=35-2-0, 24=35-2-0, 25=35-2-0, 26=35-2-0, 27=35-2-0, 32=35-2-0, 33=35-2-0, 34=35-2-0, 35=35-2-0, 36=35-2-0
Max Horiz 2=233 (LC 11)
Max Uplift 2=159 (LC 8), 22=140 (LC 9), 23=123 (LC 13), 24=87 (LC 13), 25=24 (LC 13), 26=840 (LC 18), 33=840 (LC 18), 34=24 (LC 12), 35=88 (LC 12), 36=121 (LC 12)
Max Grav 2=507 (LC 1), 22=438 (LC 1), 23=174 (LC 21), 24=144 (LC 21), 25=419 (LC 21), 26=128 (LC 9), 27=1337 (LC 18), 32=1337 (LC 18), 33=134 (LC 8), 34=419 (LC 20), 35=148 (LC 20), 36=159 (LC 20)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/8, 2-3=-570/242, 3-4=-499/210, 4-6=-496/202, 6-7=-500/197, 7-9=-452/195, 9-10=-532/168, 10-11=-650/232, 11-12=-839/327, 12-13=-839/327, 13-14=-650/228, 14-15=-532/159, 15-17=-452/166, 17-18=-500/173, 18-19=-496/177, 19-21=-499/185, 21-22=-559/217
BOT CHORD 2-36=-147/386, 35-36=-147/386, 34-35=-147/386, 33-34=-147/386, 32-33=-147/386, 27-32=-147/386, 26-27=-147/386, 25-26=-147/386, 24-25=-147/386, 23-24=-147/386, 22-23=-147/386
WEBS 9-32=-268/110, 10-38=-91/195, 37-38=-91/195, 37-39=-66/195, 14-39=-66/195, 15-27=-268/89, 12-37=-260/118, 11-37=-185/373, 13-37=-185/373, 11-38=-4/4, 7-33=-78/84, 6-34=-138/98, 4-35=-133/102, 3-36=-103/132, 13-39=-3/4, 17-26=-83/89, 18-25=-138/98, 19-24=-132/100, 21-23=-104/138

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 (||) MT20 unless otherwise indicated.

- Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Ceiling dead load (5.0 psf) on member(s): 9-10, 14-15, 10-38, 37-38, 37-39, 14-39; Wall dead load (5.0psf) on member(s): 9-32, 15-27
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Attic room checked for L/360 deflection.
- LOAD CASE(S)** Standard



September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355952
2504831-29312	AGR	ATTIC	1	2	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:29
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?I

Page: 1

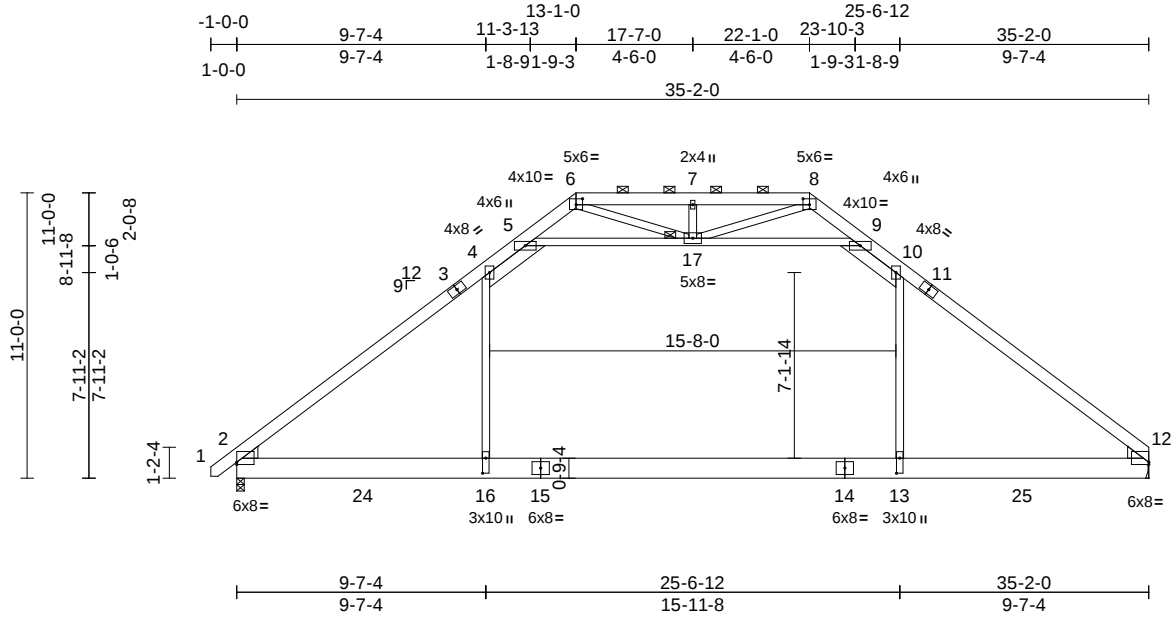

Scale = 1:88.8

Plate Offsets (X, Y): [2:Edge,0-1-1], [6:0-3-0,0-2-12], [8:0-3-0,0-2-12], [12:Edge,0-1-1], [13:0-7-0,0-1-8], [16:0-7-0,0-1-8]

Loading	(psf)	Spacing	2-8-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.62	Vert(LL)	-0.29	13-16	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.43	13-16	>974	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.24	Horz(CT)	0.03	12	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS		Attic	-0.19	13-16	>991	360	Weight: 622 lb FT = 20%

LUMBER
TOP CHORD 2x6 SP No.2 *Except* 3-6,8-11:2x6 SP DSS
BOT CHORD 2x10 SP DSS
WEBS 2x4 SP No.2
WEDGE Left: 2x6 SP No.2
Right: 2x6 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except 2'-0" oc purlins (6'-0" max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

JOINTS 1 Brace at Jt(s): 17
REACTIONS (size) 2=0-3-8, 12= Mechanical
Max Horiz 2=340 (LC 9)
Max Grav 2=2940 (LC 2), 12=2881 (LC 2)


FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/41, 2-4=-4068/0, 4-5=-2809/30, 5-6=-401/506, 6-7=-708/484, 7-8=-708/484, 8-9=-396/509, 9-10=-2810/30, 10-12=-4064/413
BOT CHORD 2-16=-412/3033, 13-16=0/3033, 12-13=-155/3033
WEBS 4-16=0/1670, 5-17=-3761/145, 9-17=-3765/144, 10-13=0/1663, 7-17=-400/167, 6-17=-194/809, 8-17=-193/814

NOTES

- 2-ply truss to be connected together with 10d (0.120"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 9-10, 5-17, 9-17; Wall dead load (5.0psf) on member(s).4-16, 10-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 13-16
- Refer to girder(s) for truss to truss connections.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

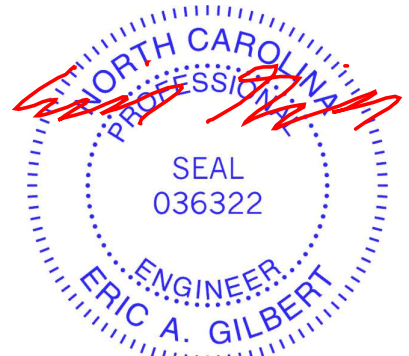

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355953
2504831-29312	AGR1	ATTIC	1	2	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:29
ID:Fg8LOi5C4YZciAiqPkXjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?

Page: 1

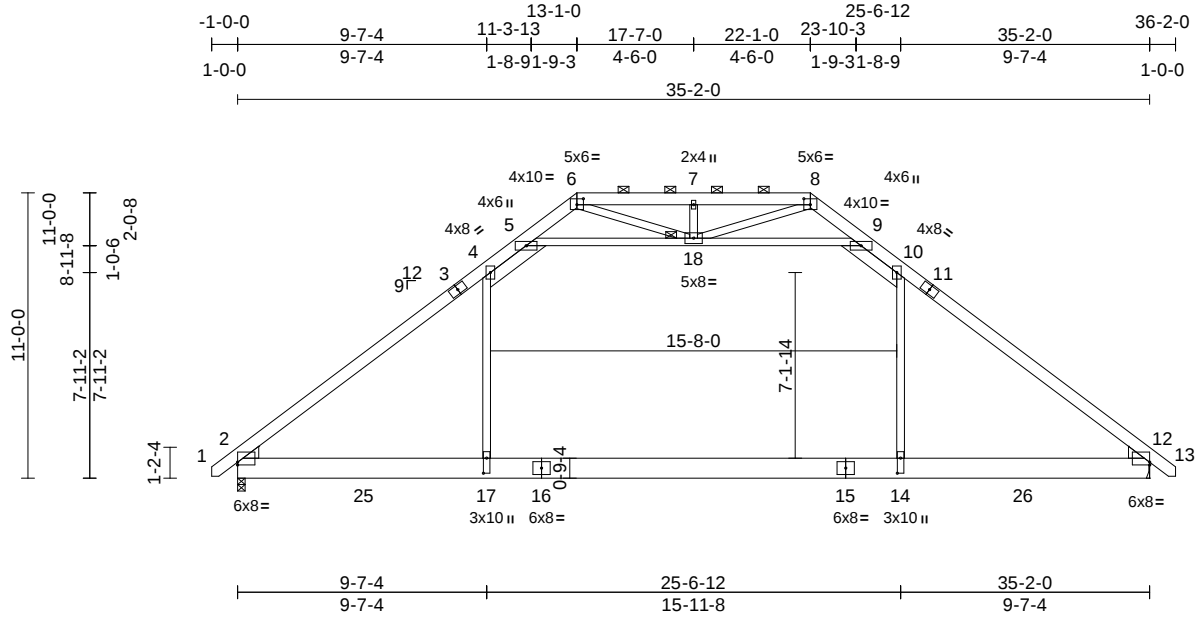

Scale = 1:88.8

Plate Offsets (X, Y): [2:Edge,0-1-5], [6:0-3-0,0-2-12], [8:0-3-0,0-2-12], [12:Edge,0-1-5], [14:0-7-0,0-1-8], [17:0-7-0,0-1-8]

Loading	(psf)	Spacing	2-8-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.62	Vert(LL)	-0.29	14-17	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.43	14-17	>977	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.24	Horz(CT)	0.03	12	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS		Attic	-0.19	14-17	>992	360	Weight: 628 lb	FT = 20%

LUMBER

TOP CHORD	2x6 SP No.2 *Except* 3-6,8-11:2x6 SP DSS
BOT CHORD	2x10 SP DSS
WEBS	2x4 SP No.2
WEDGE	Left: 2x6 SP No.2 Right: 2x6 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 6-8.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

JOINTS 1 Brace at Jt(s): 18

REACTIONS	(size) 2=0-3-8, 12= Mechanical Max Horiz 2=-347 (LC 10) Max Grav 2=2939 (LC 2), 12=2939 (LC 2)
-----------	--

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/41, 2-4=-4065/0, 4-5=-2808/30, 5-6=-403/503, 6-7=-711/483, 7-8=-711/483, 8-9=-403/503, 9-10=-2808/30, 10-12=-4065/0, 12-13=0/41
BOT CHORD	2-17=-398/3031, 14-17=0/3031, 12-14=-165/3031
WEBS	4-17=0/1669, 5-18=-3754/144, 9-18=-3753/143, 10-14=0/1669, 7-18=-399/167, 6-18=-194/811, 8-18=-194/811

NOTES

- 2-ply truss to be connected together with 10d (0.120"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 9-10, 5-18, 9-18; Wall dead load (5.0psf) on member(s). 4-17, 10-14
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 14-17
- Refer to girder(s) for truss to truss connections.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Attic room checked for L/360 deflection.

LOAD CASE(S) Standard



September 16, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334, Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:29 Page: 1
ID:Fq8LOi5C4YZciAiaPkKxiZzUkHL-RfC?PsB70Ha3NSaPqnL8w3uITxbGKWRcDoi7J4zJC?f



Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.19	12-14	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.38	Vert(CT)	-0.29	12-14	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.28	Horz(CT)	0.03	10	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS		Attic	-0.11	12-14	>999	360	Weight: 262 lb	FT = 20%

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Ceiling dead load (5.0 psf) on member(s). 3-5, 8-9, 5-8; Wall dead load (5.0psf) on member(s). 3-14, 9-12
- 7) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 12-14
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliat


818 Soundside Road
Edenton, NC 27922

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355955
2504831-29312	BE	GABLE	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:30
ID:Fg8LOi5C4YZciAiqPkXjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

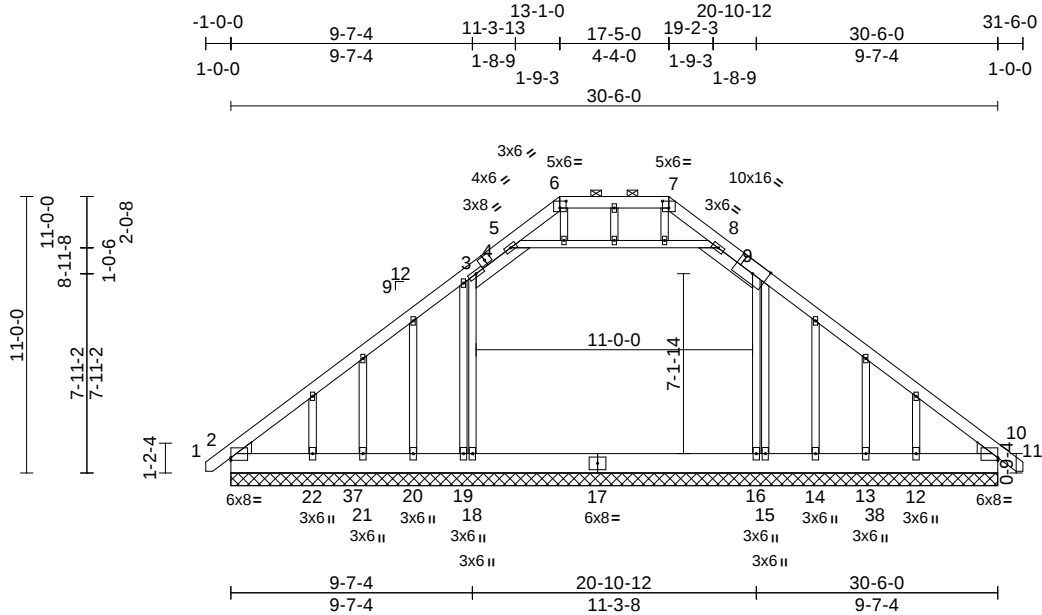

Scale = 1:91.6

Plate Offsets (X, Y): [2:Edge,0-1-5], [6:0-3-0,0-3-4], [7:0-3-0,0-3-4], [9:0-6-12,Edge], [10:Edge,0-1-5]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.68	Horz(CT)	0.01	10	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							
Weight: 323 lb FT = 20%											

LUMBER
TOP CHORD 2x6 SP No.2
BOT CHORD 2x10 SP DSS
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2
WEDGE Left: 2x6 SP No.2
Right: 2x6 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)
2=30-6-0, 10=30-6-0, 12=30-6-0, 13=30-6-0, 14=30-6-0, 15=30-6-0, 16=30-6-0, 18=30-6-0, 19=30-6-0, 20=30-6-0, 21=30-6-0, 22=30-6-0
Max Horiz 2=260 (LC 10)
Max Uplift 2=-11 (LC 8), 10=-11 (LC 9), 12=-214 (LC 13), 13=-100 (LC 27), 15=-1844 (LC 18), 19=-1843 (LC 18), 21=-86 (LC 26), 22=-203 (LC 12)
Max Grav 2=316 (LC 22), 10=295 (LC 23), 12=446 (LC 21), 13=124 (LC 13), 14=185 (LC 18), 15=348 (LC 13), 16=2603 (LC 21), 18=2587 (LC 20), 19=349 (LC 12), 20=183 (LC 18), 21=120 (LC 12), 22=414 (LC 20)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/8, 2-3=-387/201, 3-5=-332/41, 5-6=-323/106, 6-7=-213/86, 7-8=-327/101, 8-10=-368/230, 10-11=0/8


BOT CHORD 2-22=-141/390, 21-22=-141/390, 20-21=-141/390, 19-20=-141/390, 18-19=-141/390, 16-18=-141/390, 15-16=-160/406, 14-15=-160/406, 13-14=-160/406, 12-13=-160/406, 10-12=-160/406
WEBS 3-18=-723/319, 5-8=-50/130, 9-16=-731/390

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are 2x4 (||) MT20 unless otherwise indicated.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 10) Ceiling dead load (5.0 psf) on member(s). 3-5, 8-9, 5-8; Wall dead load (5.0psf) on member(s). 3-18, 9-16
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 2, 11 lb uplift at joint 10, 1843 lb uplift at joint 19, 86 lb uplift at joint 21, 203 lb uplift at joint 22, 1844 lb uplift at joint 15, 100 lb uplift at joint 13 and 214 lb uplift at joint 12.

- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 13) This truss has large uplift reaction(s) from gravity load case(s). Proper connection is required to secure truss against upward movement at the bearings. Building designer must provide for uplift reactions indicated.
- 14) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

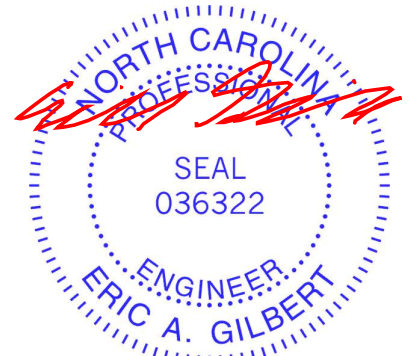

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355956
2504831-29312	CE	GABLE	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:30
ID:Fg8LOi5C4YZciAiqPkXjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

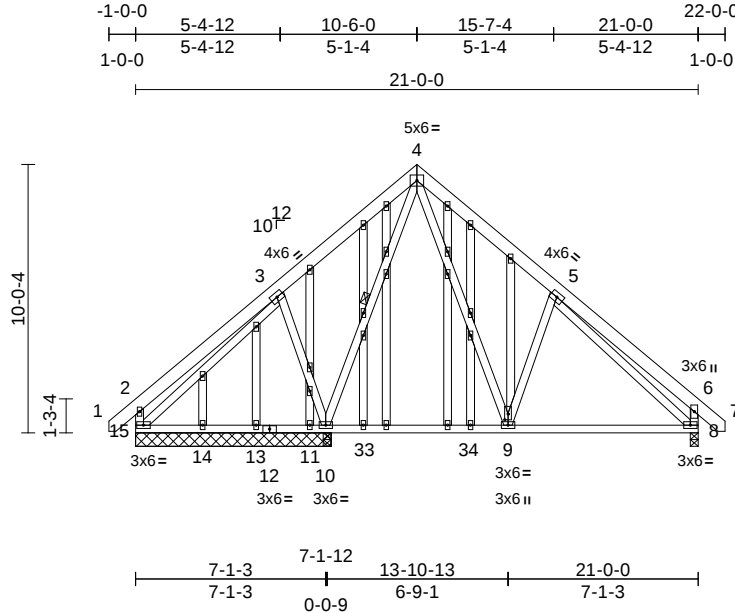

Scale = 1:86

Plate Offsets (X, Y): [9:0-2-10,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	-0.06	9-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.47	Vert(CT)	-0.11	8-9	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.35	Horz(CT)	0.01	8	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS							Weight: 242 lb	FT = 20%

LUMBER

TOP CHORD	2x6 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 4-10

REACTIONS	(size)	8=0-3-8, 10=7-3-8, 11=7-3-8, 13=7-3-8, 14=7-3-8, 15=7-3-8
	Max Horiz	15=-269 (LC 10)
	Max Uplift	8=-91 (LC 13), 10=-93 (LC 12), 11=-330 (LC 18), 15=-80 (LC 13)
	Max Grav	8=701 (LC 20), 10=1163 (LC 19), 11=-53 (LC 13), 13=98 (LC 18), 14=91 (LC 3), 15=334 (LC 20)

FORCES


	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/39, 2-3=-168/147, 3-4=-183/205, 4-5=-581/232, 5-6=-314/141, 6-7=0/39, 2-15=-250/156, 6-8=-352/154
BOT CHORD	14-15=-109/216, 13-14=-109/216, 11-13=-109/216, 10-11=-109/216, 9-10=-31/239, 8-9=0/414
WEBS	4-9=-164/573, 5-9=-272/261, 4-10=-446/0, 3-10=-328/276, 3-15=-186/111, 5-8=-390/0

NOTES

- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 (||) MT20 unless otherwise indicated.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 10, 15, 8, and 11. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard

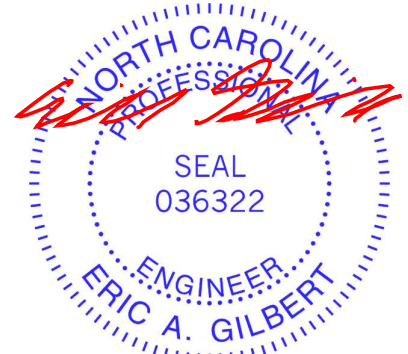

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355957
2504831-29312	CGR	COMMON GIRDER	1	4	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:31

Page: 1

ID:Fg8LOi5C4YZciAiQPkXjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?

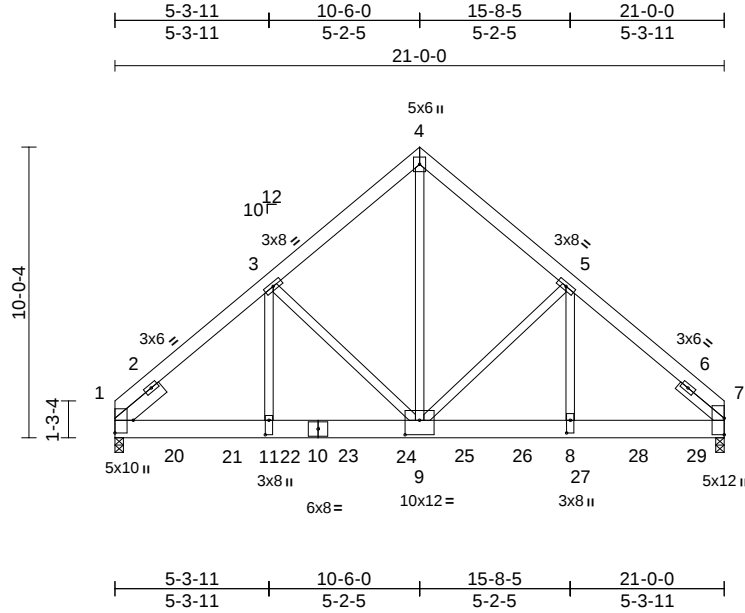

Scale = 1:79.4

Plate Offsets (X, Y): [1:Edge,0-7-9], [8:0-5-4,0-1-8], [9:0-6-0,0-6-0], [11:0-6-0,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.50	Vert(LL)	-0.09	8-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.34	Vert(CT)	-0.16	8-9	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.86	Horz(CT)	0.05	7	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS							Weight: 739 lb	FT = 20%

LUMBER

TOP CHORD	2x6 SP No.2
BOT CHORD	2x8 SP DSS
WEBS	2x4 SP No.2
SLIDER	Left 2x6 SP No.2 -- 2-0-0, Right 2x4 SP No.2 -- 2-0-0

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size) 1=0-3-8, 7=0-3-8
	Max Horiz 1=-216 (LC 32)
	Max Grav 1=10866 (LC 2), 7=12013 (LC 2)

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-3=-12379/0, 3-4=-9091/0, 4-5=-9081/0, 5-7=-12507/0
BOT CHORD	1-11=0/9267, 9-11=0/9267, 8-9=0/9307, 7-8=0/9307
WEBS	4-9=0/11006, 5-9=-3246/0, 5-8=0/4662, 3-9=-3152/0, 3-11=0/4456

NOTES

- 4-ply truss to be connected together with 10d (0.120"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 4 rows staggered at 0-5-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
Attach BC w/ 1/2" diam. bolts (ASTM A-307) in the center of the member w/washers at 4-0-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2141 lb down at 2-0-12, 2141 lb down at 4-0-12, 2141 lb down at 6-0-12, 2141 lb down at 8-0-12, 2141 lb down at 10-0-12, 2141 lb down at 12-0-12, 2141 lb down at 14-0-12, 2141 lb down at 16-0-12, and 2141 lb down at 18-0-12, and 2141 lb down at 20-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-4=-60, 4-7=-60, 12-16=-20
Concentrated Loads (lb)
Vert: 20=-1623 (B), 21=-1623 (B), 22=-1623 (B), 23=-1623 (B), 24=-1623 (B), 25=-1623 (B), 26=-1623 (B), 27=-1623 (B), 28=-1623 (B), 29=-1623 (B)



September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	
2504831-29312	D	Common	1	1	Job Reference (optional)	I76355958

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:31

Page: 1

ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?

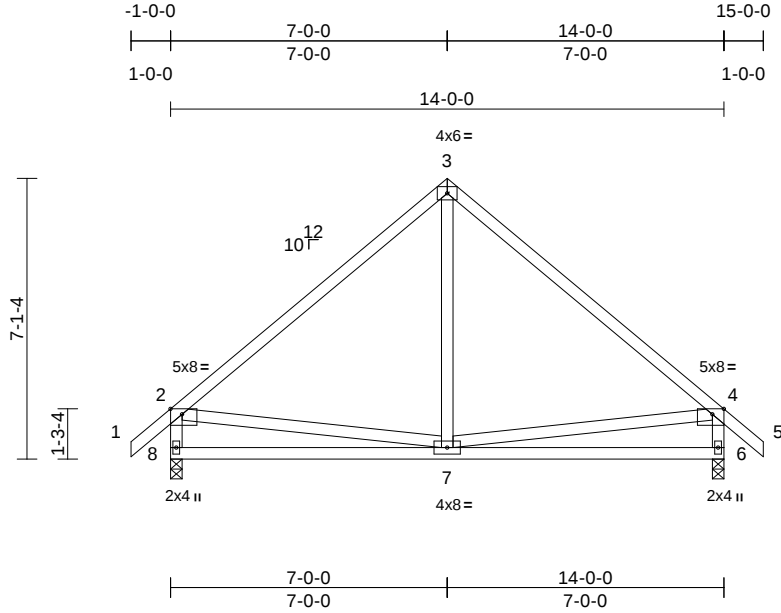

Scale = 1:58.3

Plate Offsets (X, Y): [2:0-3-8,Edge], [4:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	-0.04	7-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.09	7-8	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS							Weight: 84 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

- 5) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 8 and 6. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS

(size) 6=0-3-8, 8=0-3-8
Max Horiz 8=203 (LC 11)
Max Uplift 6=-70 (LC 13), 8=-70 (LC 12)
Max Grav 6=617 (LC 1), 8=617 (LC 1)


FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/44, 2-3=-539/110, 3-4=-539/110, 4-5=0/44, 2-8=-556/105, 4-6=-556/105
BOT CHORD 7-8=-251/410, 6-7=-173/261
WEBS 3-7=0/278, 2-7=-125/286, 4-7=-130/288

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.

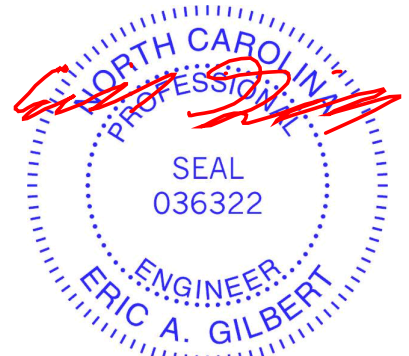

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	
2504831-29312	DE	GABLE	1	1	Job Reference (optional)	I76355959

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:31
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

Page: 1

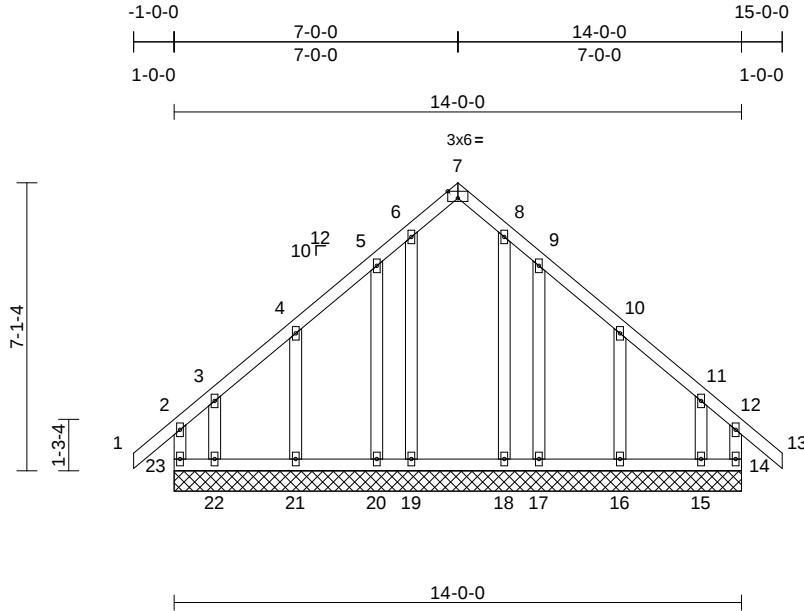

Scale = 1:56.8

Plate Offsets (X, Y): [7:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.00	14	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-R							
Weight: 100 lb FT = 20%											

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
OTHERS	2x4 SP No.2

WEBS

6-19=-126/20, 8-18=-122/20, 5-20=-115/126,
4-21=-145/113, 3-22=-134/146,
9-17=-115/128, 10-16=-145/113,
11-15=-133/144

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 (||) MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 130 lb uplift at joint 23, 110 lb uplift at joint 14, 116 lb uplift at joint 20, 79 lb uplift at joint 21, 214 lb uplift at joint 22, 117 lb uplift at joint 17, 79 lb uplift at joint 16 and 208 lb uplift at joint 15.

LOAD CASE(S) Standard

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	14=14-0-0, 15=14-0-0, 16=14-0-0, 17=14-0-0, 18=14-0-0, 19=14-0-0, 20=14-0-0, 21=14-0-0, 22=14-0-0, 23=14-0-0
Max Horiz	23=203 (LC 11)
Max Uplift	14=-110 (LC 9), 15=-208 (LC 13), 16=-79 (LC 13), 17=-117 (LC 13), 20=-116 (LC 12), 21=-79 (LC 12), 22=-214 (LC 12), 23=-130 (LC 8)
Max Grav	14=222 (LC 19), 15=205 (LC 20), 16=219 (LC 20), 17=125 (LC 20), 18=208 (LC 21), 19=212 (LC 22), 20=222 (LC 19), 21=218 (LC 19), 22=218 (LC 10), 23=238 (LC 20)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	2-23=-175/89, 1-2=0/44, 2-3=-162/131, 3-4=-89/82, 4-5=-80/100, 5-6=-111/160, 6-7=-87/100, 7-8=-87/97, 8-9=-111/154, 9-10=-71/95, 10-11=-83/72, 11-12=-155/114, 12-13=0/44, 12-14=-163/76
BOT CHORD	22-23=-101/119, 21-22=-101/119, 20-21=-101/119, 19-20=-101/119, 18-19=-101/119, 17-18=-101/119, 16-17=-101/119, 15-16=-101/119, 14-15=-101/119



September 16,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	
2504831-29312	E	Common	6	1	Job Reference (optional)	I76355960

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:31
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

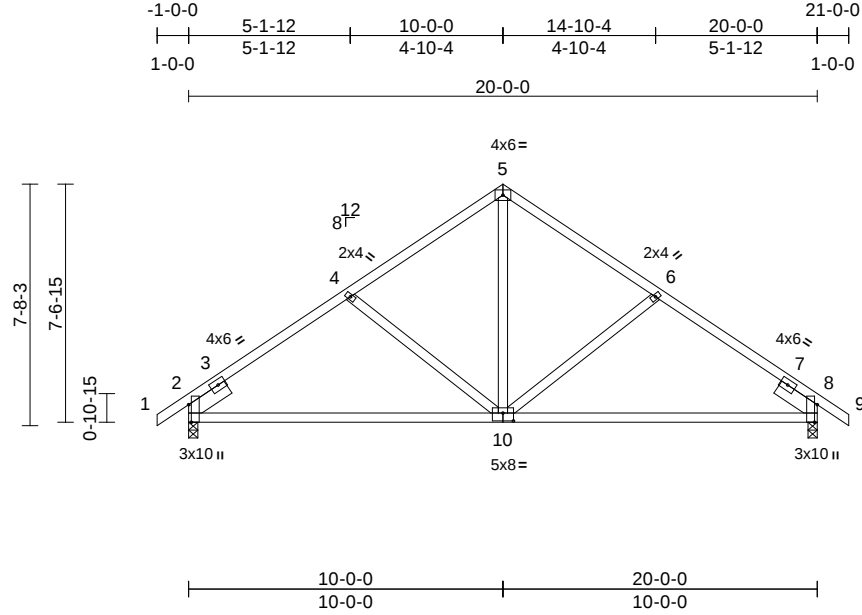

Scale = 1:73.3

Plate Offsets (X, Y): [2:0-6-11,Edge], [8:0-6-11,Edge], [10:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	-0.13	10-17	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.79	Vert(CT)	-0.25	10-17	>953	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.19	Horz(CT)	0.03	8	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS							Weight: 105 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
SLIDER	Left 2x6 SP No.2 -- 1-6-0, Right 2x6 SP No.2 -- 1-6-0

- 5) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 8. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-3-15 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS


(size)	2=0-3-8, 8=0-3-8
Max Horiz	2=-181 (LC 10)
Max Uplift	2=-104 (LC 12), 8=-104 (LC 13)
Max Grav	2=860 (LC 1), 8=860 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/33, 2-4=-987/145, 4-5=-777/143, 5-6=-777/143, 6-8=-987/145, 8-9=0/33
BOT CHORD	2-8=-201/800
WEBS	5-10=-40/529, 6-10=-279/194, 4-10=-278/194

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

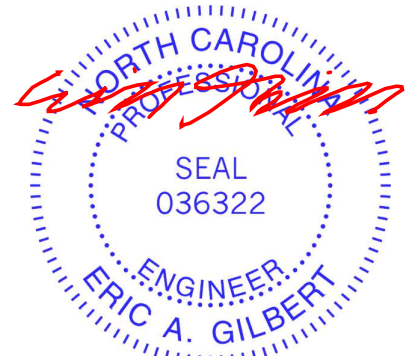

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	I76355961
2504831-29312	EE	GABLE	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:31

Page: 1

ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?I

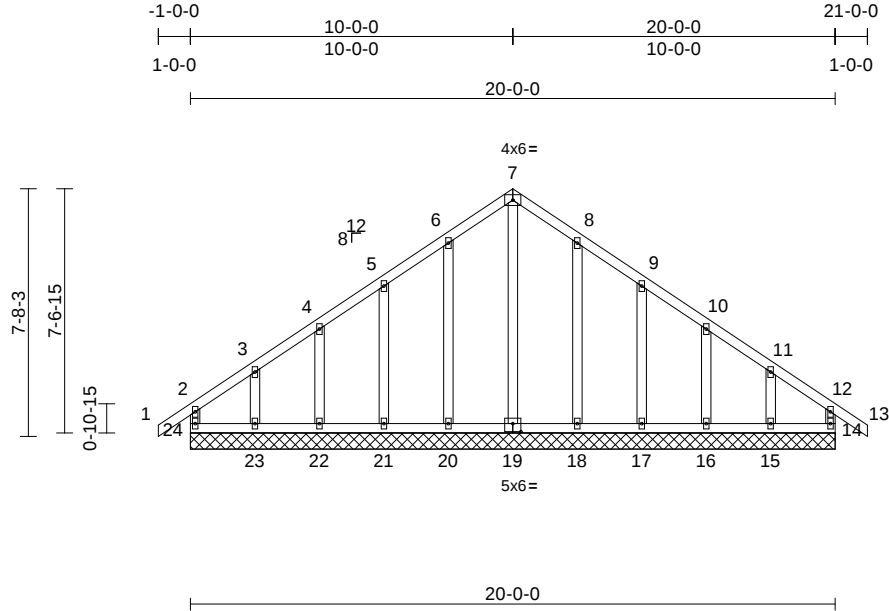

Scale = 1:71.5

Plate Offsets (X, Y): [19:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.00	14	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-R							
Weight: 125 lb FT = 20%											

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
OTHERS	2x4 SP No.2

WEBS

7-19=-167/61, 6-20=-139/85, 5-21=-129/91,
4-22=-128/82, 3-23=-140/112, 8-18=-138/85,
9-17=-129/91, 10-16=-130/83,
11-15=-133/108


NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 (||) MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 74 lb uplift at joint 24, 44 lb uplift at joint 14, 61 lb uplift at joint 20, 69 lb uplift at joint 21, 52 lb uplift at joint 22, 113 lb uplift at joint 23, 60 lb uplift at joint 18, 69 lb uplift at joint 17, 53 lb uplift at joint 16 and 105 lb uplift at joint 15.

LOAD CASE(S) Standard

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/38, 2-3=-133/127, 3-4=-99/101, 4-5=-86/131, 5-6=-106/168, 6-7=-139/199, 7-8=-139/188, 8-9=-106/151, 9-10=-71/115, 10-11=-65/79, 11-12=-95/89, 12-13=0/38, 2-24=-150/65, 12-14=-133/40
BOT CHORD	23-24=-91/103, 22-23=-91/103, 21-22=-91/103, 20-21=-91/103, 18-20=-91/103, 17-18=-91/103, 16-17=-91/103, 15-16=-91/103, 14-15=-91/103

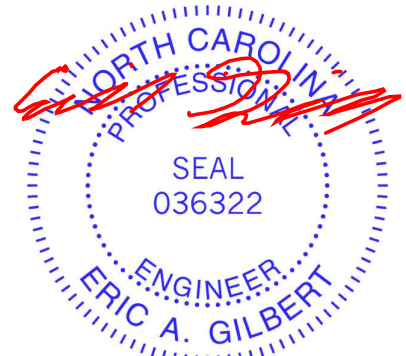

September 16,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job 2504831-29312	Truss F	Truss Type Common	Qty 6	Ply 1	518 Creekside Oaks South Job Reference (optional)	176355962
----------------------	------------	----------------------	----------	----------	--	-----------

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:32
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

Page: 1

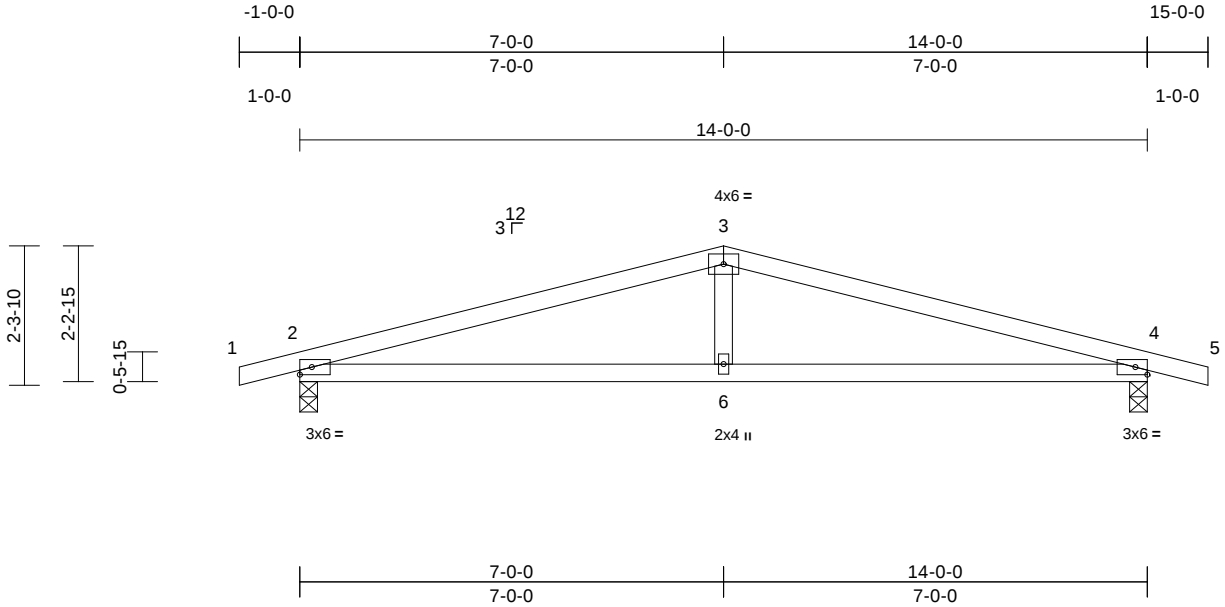

Scale = 1:38.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.65	Vert(LL)	-0.07	6-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.13	6-9	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.02	4	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS							Weight: 48 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4=0-3-8

Max Horiz 2=33 (LC 12)
Max Uplift 2=-117 (LC 8), 4=-117 (LC 9)
Max Grav 2=620 (LC 1), 4=620 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/15, 2-3=-1199/123, 3-4=-1199/123, 4-5=0/15

BOT CHORD 2-6=-81/1115, 4-6=-81/1115

WEBS 3-6=0/293

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 4. This connection is for uplift only and does not consider lateral forces.

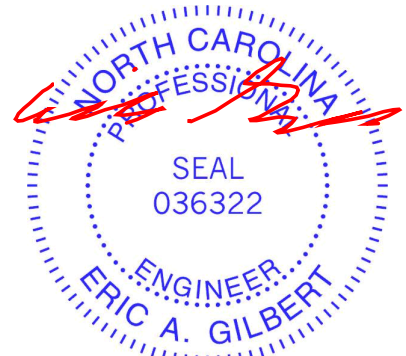

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355963
2504831-29312	FE	Common Supported Gable	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:32
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?i

Page: 1

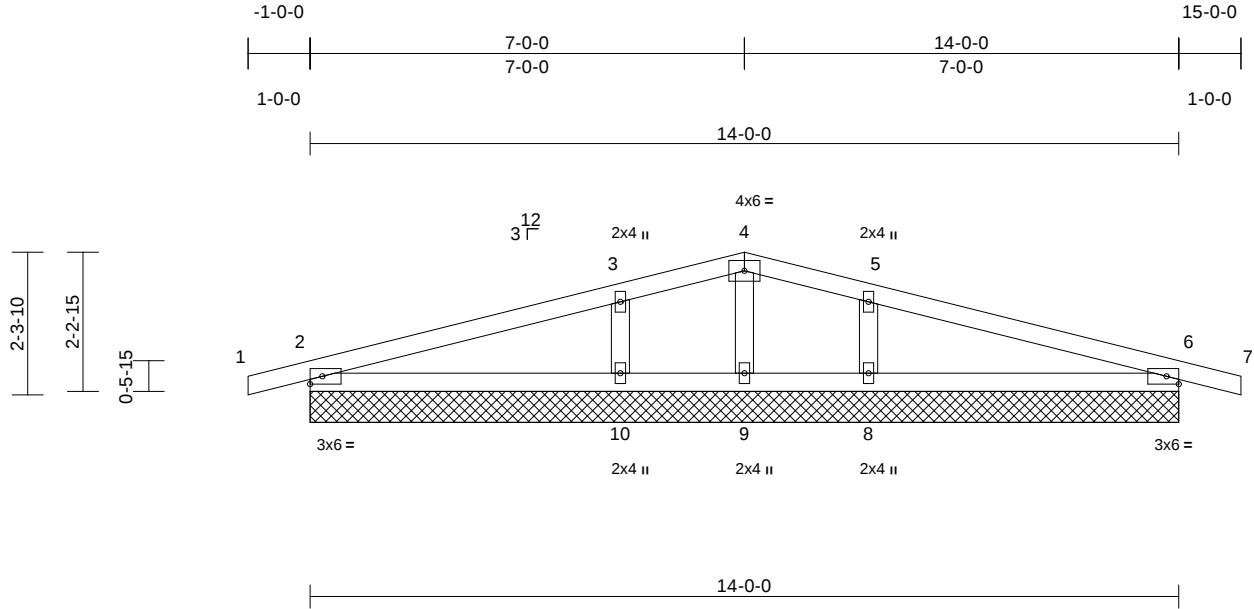

Scale = 1:37.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.28	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.20	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	6	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S						Weight: 52 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS	(size)	2=14-0-0, 6=14-0-0, 8=14-0-0, 9=14-0-0, 10=14-0-0
	Max Horiz	2=33 (LC 12)
	Max Uplift	2=-70 (LC 8), 6=-74 (LC 9), 8=-85 (LC 13), 9=-60 (LC 1), 10=-86 (LC 12)
	Max Grav	2=229 (LC 25), 6=229 (LC 26), 8=421 (LC 1), 9=28 (LC 13), 10=421 (LC 1)

FORCES


	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/3, 2-3=-43/55, 3-4=-37/54, 4-5=-37/53, 5-6=-37/46, 6-7=0/3
BOT CHORD	2-10=-10/27, 9-10=-10/27, 8-9=-10/27, 6-8=-10/27
WEBS	4-9=-28/32, 3-10=-295/137, 5-8=-295/136

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 70 lb uplift at joint 2, 74 lb uplift at joint 6, 60 lb uplift at joint 9, 86 lb uplift at joint 10 and 85 lb uplift at joint 8.

LOAD CASE(S) Standard

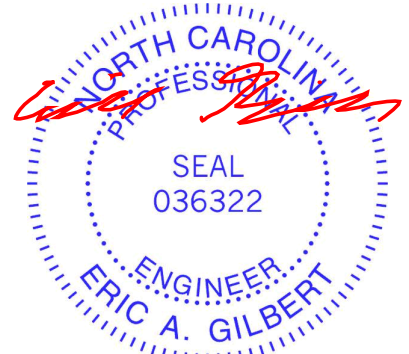

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355964
2504831-29312	M1	GABLE	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:32
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?

Page: 1

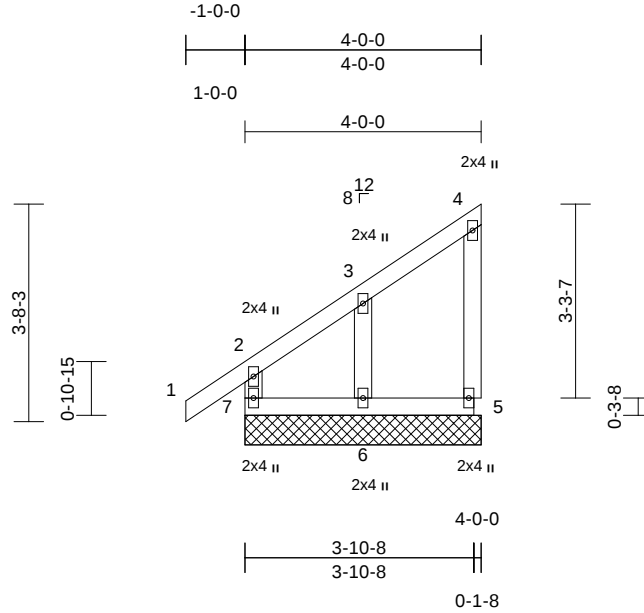

Scale = 1:39

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.11	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.08	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	5	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-R						Weight: 23 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size) 5=4-0-0, 6=4-0-0, 7=4-0-0
	Max Horiz 7=131 (LC 9)
	Max Uplift 5=-17 (LC 9), 6=-96 (LC 12), 7=-20 (LC 8)
	Max Grav 5=72 (LC 19), 6=184 (LC 19), 7=162 (LC 20)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD	1-2=0/38, 2-3=-96/160, 3-4=-69/69, 4-5=-67/24, 2-7=-135/77
BOT CHORD	6-7=-55/64, 5-6=-55/64
WEBS	3-6=-199/100

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).

- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 5, 20 lb uplift at joint 7 and 96 lb uplift at joint 6.

LOAD CASE(S) Standard

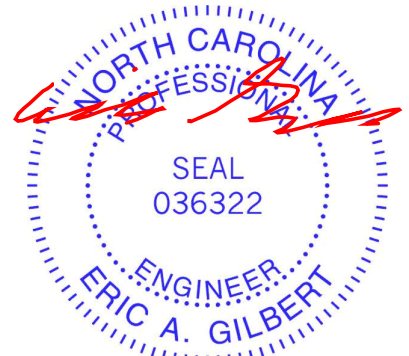

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355965
2504831-29312	M1A	Monopitch	3	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:32
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

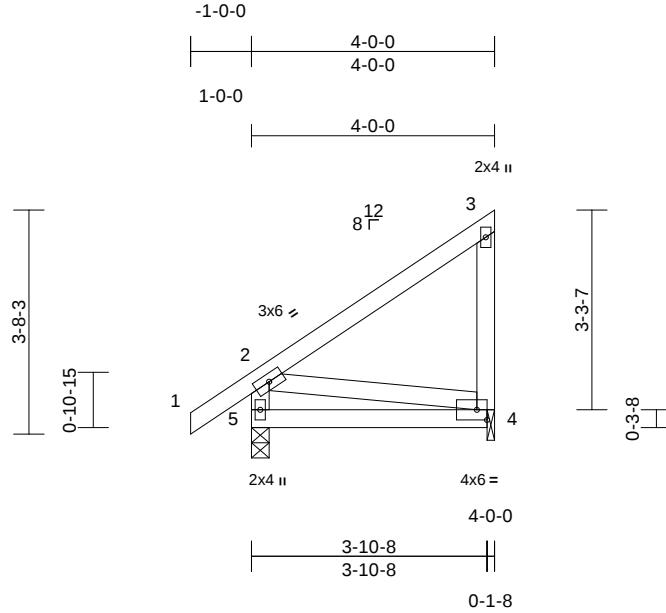

Scale = 1:37.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.24	Vert(LL)	-0.01	4-5	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(CT)	-0.02	4-5	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MP							Weight: 25 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)

4=0-1-8, 5=0-3-8
Max Horiz 5=131 (LC 9)
Max Uplift 4=49 (LC 12), 5=30 (LC 12)
Max Grav 4=164 (LC 19), 5=228 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/38, 2-3=-105/122, 3-4=-160/55,
2-5=-191/52

BOT CHORD 4-5=-127/164


WEBS 2-4=-121/100

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.
- 5) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

- 6) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 5 and 49 lb uplift at joint 4.

LOAD CASE(S) Standard

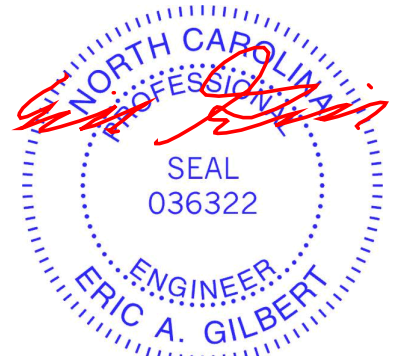

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355966
2504831-29312	M2	GABLE	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:33
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

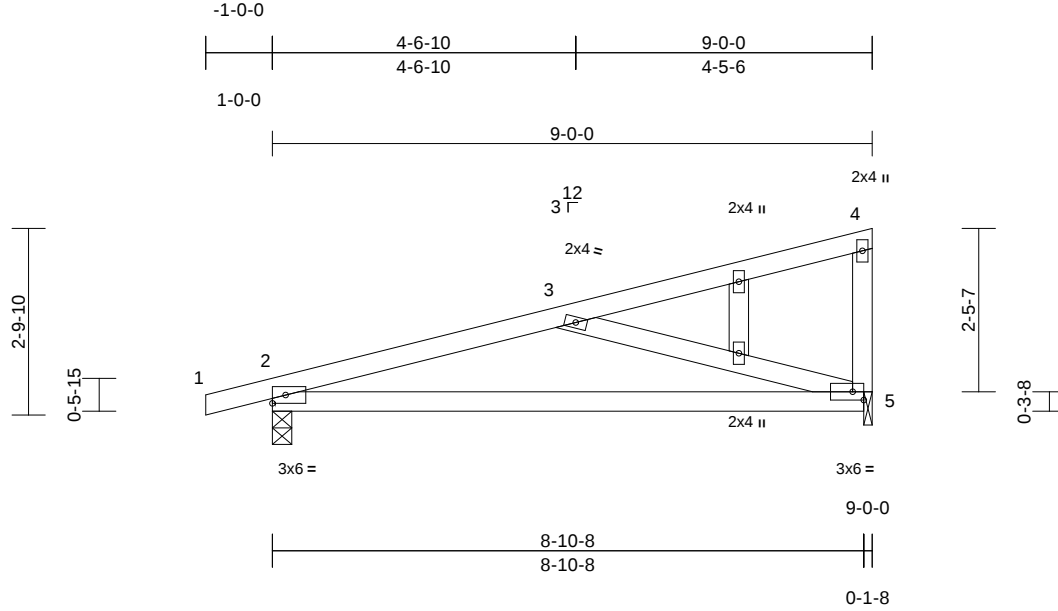

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.18	5-10	>578	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.37	5-10	>289	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.24	Horz(CT)	0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS							Weight: 40 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)

Max Horiz	2=100 (LC 11)
Max Uplift	2=-101 (LC 8), 5=-70 (LC 12)
Max Grav	2=418 (LC 1), 5=351 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/15, 2-3=-662/181, 3-4=-64/51, 4-5=-108/55
BOT CHORD	2-5=-183/631
WEBS	3-5=-654/213

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 101 lb uplift at joint 2 and 70 lb uplift at joint 5.

LOAD CASE(S) Standard



September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355967
2504831-29312	M2A	Monopitch	5	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:33

Page: 1

ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

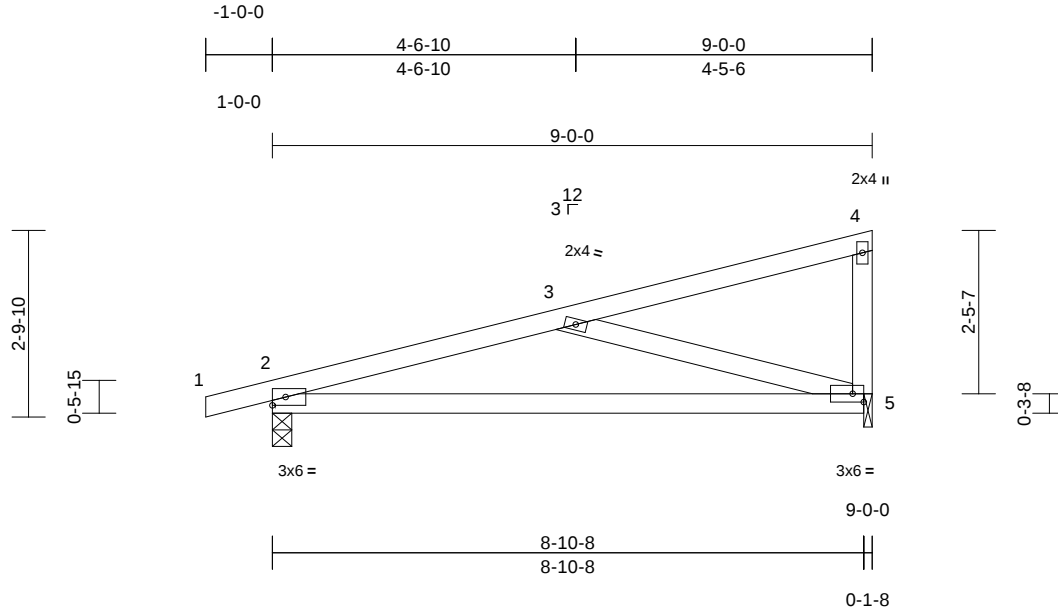

Scale = 1:34.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.18	5-8	>578	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.37	5-8	>289	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.24	Horz(CT)	0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS							Weight: 39 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS

(size) 2=0-3-8, 5=0-1-8
Max Horiz 2=100 (LC 11)
Max Uplift 2=-101 (LC 8), 5=-70 (LC 12)
Max Grav 2=418 (LC 1), 5=351 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/15, 2-3=-662/181, 3-4=-64/51, 4-5=-108/55
BOT CHORD 2-5=-183/631
WEBS 3-5=-654/213

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 101 lb uplift at joint 2 and 70 lb uplift at joint 5.

LOAD CASE(S) Standard

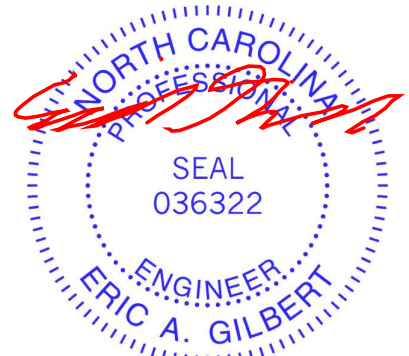

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	I76355968
2504831-29312	M3	Monopitch	4	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:33
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

Page: 1

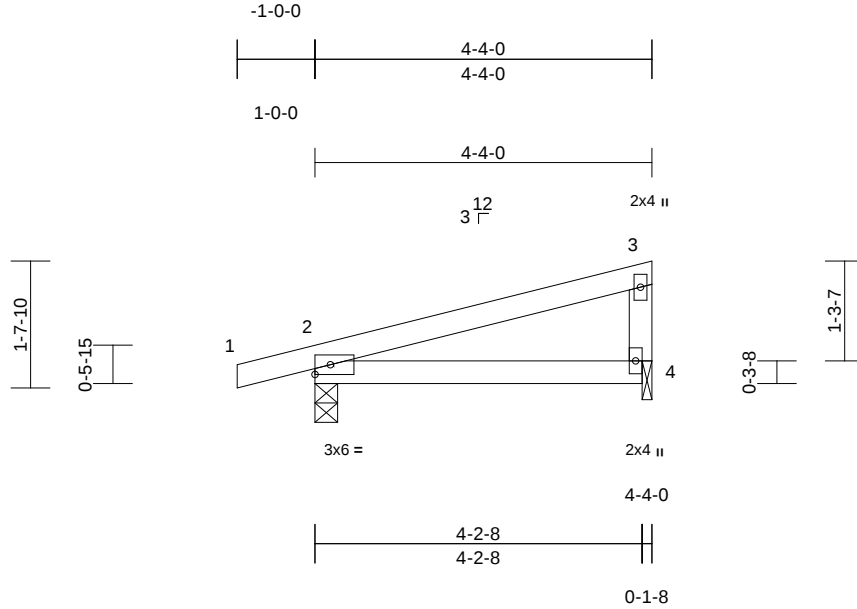

Scale = 1:29.6

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.24	Vert(LL)	0.01	4-7	>999	240	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(CT)	-0.03	4-7	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MP							Weight: 16 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 2 and 32 lb uplift at joint 4.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-4-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4=0-1-8

Max Horiz 2=53 (LC 11)
Max Uplift 2=-71 (LC 8), 4=-32 (LC 12)
Max Grav 2=235 (LC 1), 4=160 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/15, 2-3=-55/39, 3-4=-109/44
BOT CHORD 2-4=-28/86

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.



September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompoments.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355969
2504831-29312	PB1	Piggyback	2	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:33
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

Page: 1

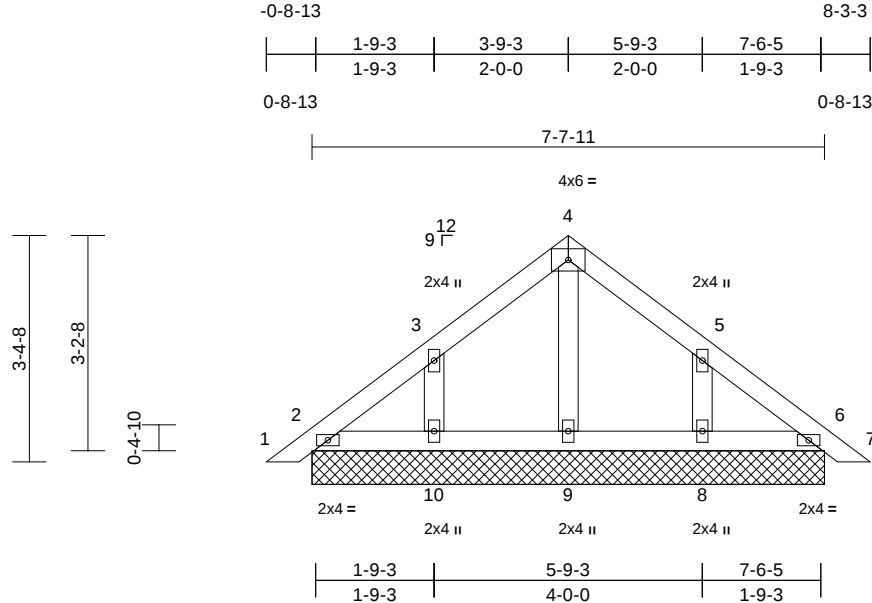

Scale = 1:34.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.05	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	6	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-P						Weight: 35 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=7-7-11, 6=7-7-11, 8=7-7-11, 9=7-7-11, 10=7-7-11
Max Horiz	2=-79 (LC 10)
Max Uplift	2=-10 (LC 13), 8=-86 (LC 13), 10=-87 (LC 12)
Max Grav	2=97 (LC 1), 6=97 (LC 1), 8=192 (LC 20), 9=115 (LC 22), 10=193 (LC 19)

FORCES


(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/16, 2-3=-73/58, 3-4=-71/66, 4-5=-71/54, 5-6=-55/36, 6-7=0/16
BOT CHORD	2-10=-31/59, 9-10=-31/59, 8-9=-31/59, 6-8=-31/59
WEBS	4-9=-76/0, 5-8=-159/111, 3-10=-159/112

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 4-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2, 8, and 10. This connection is for uplift only and does not consider lateral forces.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- LOAD CASE(S)** Standard

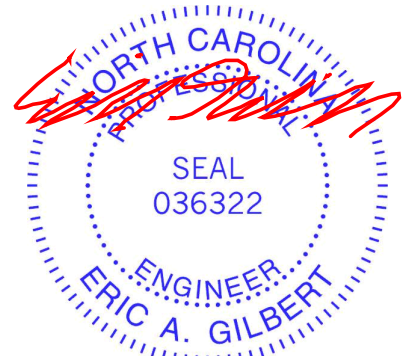


September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Page: 1

LUMBER

BRACING

REACTIONS (size) 2=7-7-11, 4=7-7-11, 6=7-7-11
 Max Horiz 2=-105 (LC 10)
 Max Uplift 2=-64 (LC 12), 4=-78 (LC 13)
 Max Grav 2=264 (LC 1), 4=264 (LC 1), 6=354 (LC 1)

TOP CHORD 1-2=0/21, 2-3=-145/85, 3-4=-130/62,
4-5=0/21

BOT CHORD 2-6=-24/72, 4-6=-24/72
WEBS 3-6=-229/57

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at j(s) 2 and 4. This connection is for uplift only and does not consider lateral forces.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard



Design valid for use only with MiTeK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355971
2504831-29312	PB3	Piggyback	6	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:34
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

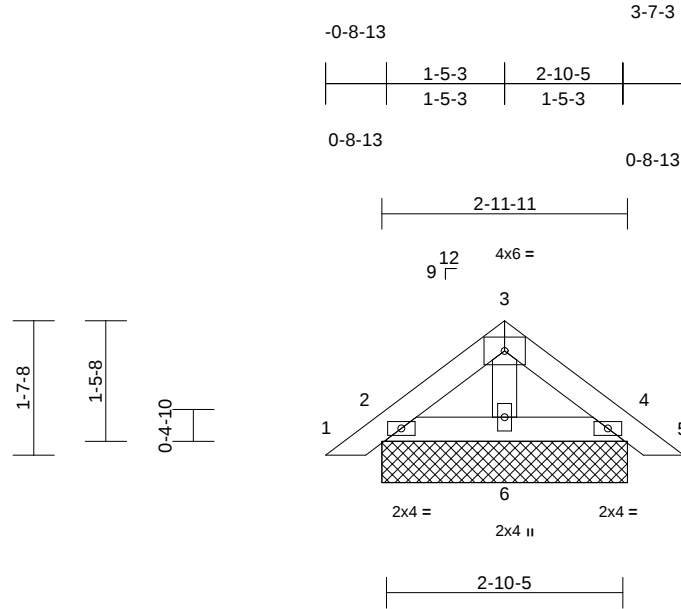

Scale = 1:27.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.03	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.01	Horz(CT)	0.00	4	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-P							Weight: 13 lb FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-4-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	2=2-11-11, 4=2-11-11, 6=2-11-11
	Max Horiz	2=-36 (LC 10)
	Max Uplift	2=-27 (LC 12), 4=-32 (LC 13)
	Max Grav	2=97 (LC 1), 4=97 (LC 1), 6=95 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD	1-2=0/16, 2-3=-46/26, 3-4=-43/19, 4-5=0/16
BOT CHORD	2-6=-10/25, 4-6=-10/25
WEBS	3-6=-59/13

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 4. This connection is for uplift only and does not consider lateral forces.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

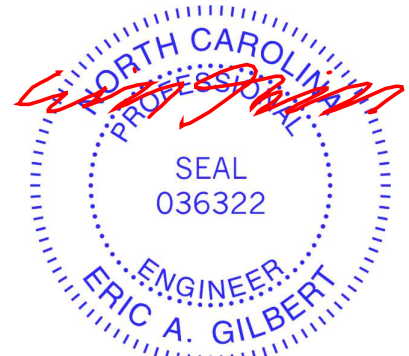

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	
2504831-29312	V3	Valley	1	1	Job Reference (optional)	I76355972

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:34
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

Page: 1

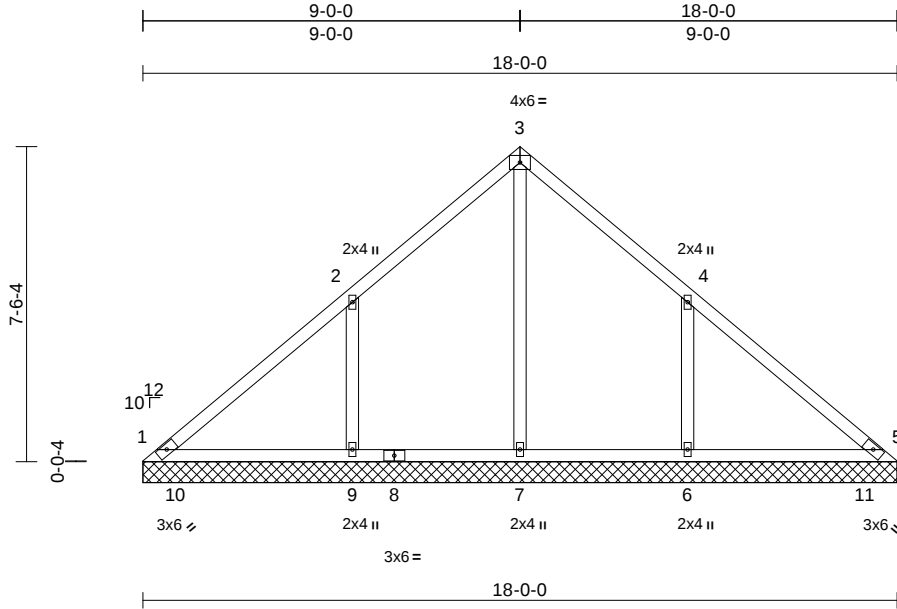

Scale = 1:55

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							Weight: 81 lb FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS	(size)	1=18'-0", 5=18'-0", 6=18'-0", 7=18'-0", 9=18'-0"
	Max Horiz	1=178 (LC 11)
	Max Uplift	1=-11 (LC 8), 6=-221 (LC 13), 9=-221 (LC 12)
	Max Grav	1=211 (LC 20), 5=185 (LC 19), 6=561 (LC 20), 7=346 (LC 22), 9=561 (LC 19)


FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-165/142, 2-3=-149/153, 3-4=-132/127, 4-5=-134/102
BOT CHORD	1-9=-63/138, 7-9=-63/138, 6-7=-63/138, 5-6=-63/138
WEBS	3-7=-158/0, 2-9=-348/269, 4-6=-348/268

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 0'-0" oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 1, 221 lb uplift at joint 9 and 221 lb uplift at joint 6.
- LOAD CASE(S)** Standard

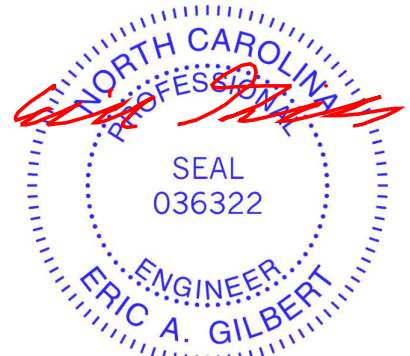

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	
2504831-29312	V4	Valley	1	1	Job Reference (optional)	I76355973

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:34
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?

Page: 1

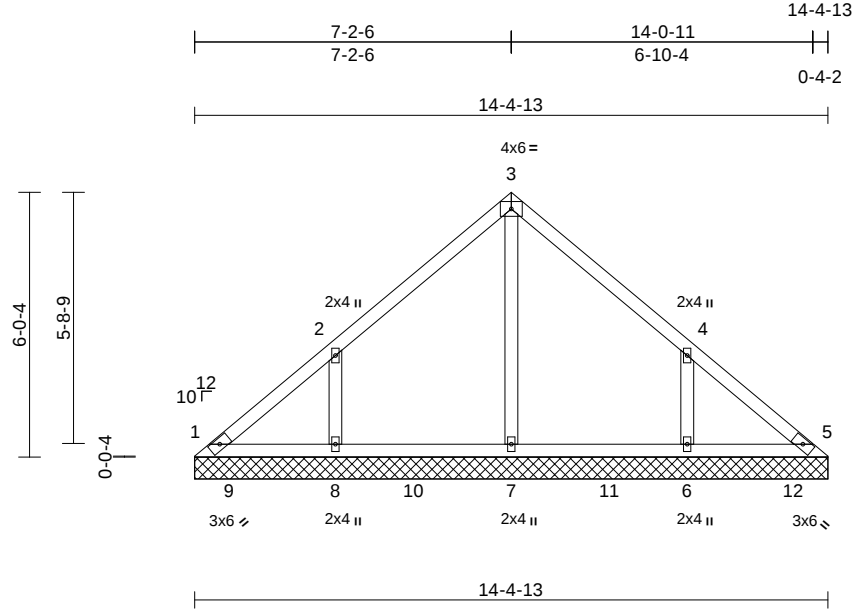

Scale = 1:52.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							Weight: 62 lb FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=14-4-13, 5=14-4-13, 6=14-4-13, 7=14-4-13, 8=14-4-13
	Max Horiz	1=-141 (LC 8)
	Max Uplift	1=-25 (LC 8), 6=-175 (LC 13), 8=-175 (LC 12)
	Max Grav	1=141 (LC 20), 5=120 (LC 19), 6=417 (LC 20), 7=353 (LC 19), 8=417 (LC 19)


FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-135/111, 2-3=-144/121, 3-4=-130/93, 4-5=-111/69
BOT CHORD	1-8=-45/101, 7-8=-45/101, 5-6=-45/101
WEBS	3-7=-161/0, 2-8=-276/216, 4-6=-276/216

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 0-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1, 175 lb uplift at joint 8 and 175 lb uplift at joint 6.
- LOAD CASE(S)** Standard

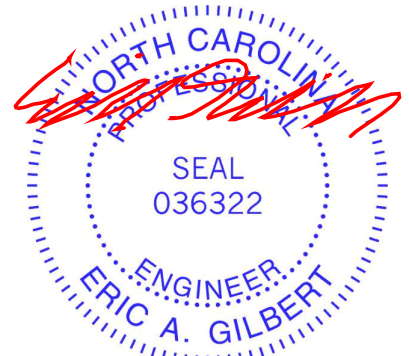

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	176355974
2504831-29312	V5	Valley	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:34
ID:Fg8LOi5C4YZciAiqPkKxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?

Page: 1

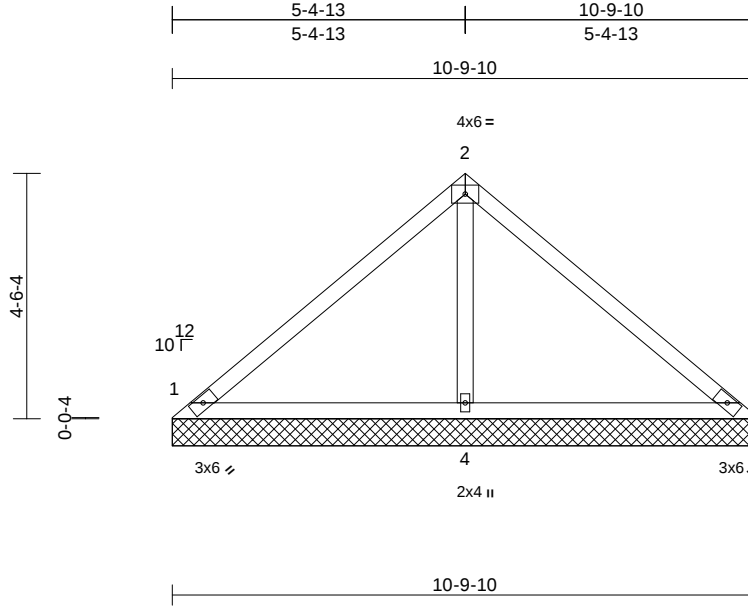

Scale = 1:42.5

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.25	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-S							Weight: 41 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1=10-9-10, 3=10-9-10, 4=10-9-10
Max Horiz 1=104 (LC 9)
Max Uplift 1=-34 (LC 13), 3=-47 (LC 13), 4=-8 (LC 12)
Max Grav 1=210 (LC 1), 3=210 (LC 1), 4=383 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-170/89, 2-3=-160/68
BOT CHORD 1-4=-22/75, 3-4=-22/75
WEBS 2-4=-233/61

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 0-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 1, 47 lb uplift at joint 3 and 8 lb uplift at joint 4.

LOAD CASE(S) Standard

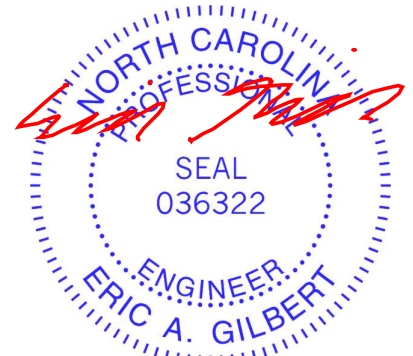

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	I76355975
2504831-29312	V6	Valley	1	1	Job Reference (optional)	

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:34
ID:Fg8LOi5C4YZciAiqPkkxjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

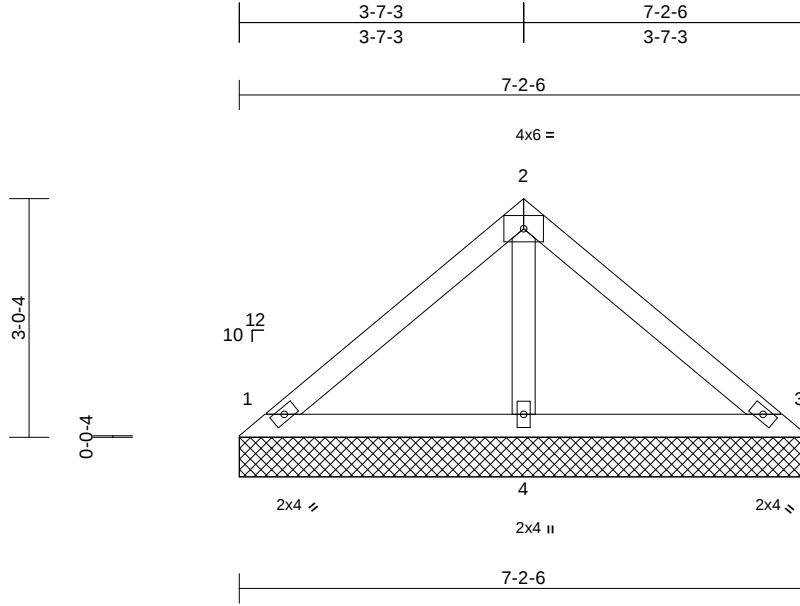

Scale = 1:29.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-P							Weight: 27 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1=7-2-6, 3=7-2-6, 4=7-2-6
Max Horiz 1=-66 (LC 8)
Max Uplift 1=-31 (LC 13), 3=-39 (LC 13)
Max Grav 1=146 (LC 1), 3=146 (LC 1), 4=223 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-100/56, 2-3=-90/42
BOT CHORD 1-4=-16/46, 3-4=-16/46
WEBS 2-4=-142/36

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 0-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 1 and 39 lb uplift at joint 3.

LOAD CASE(S) Standard

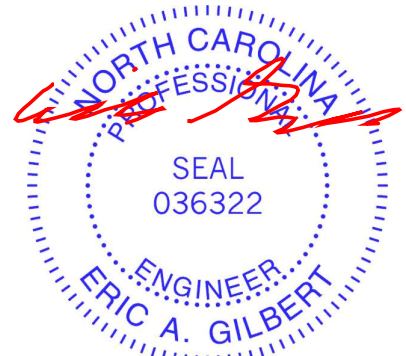

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	518 Creekside Oaks South	
2504831-29312	V7	Valley	1	1	Job Reference (optional)	I76355976

84 Lumber-2383 (Dunn, NC), Dunn, NC - 28334,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Sep 15 10:02:35
ID:Fg8LOi5C4YZciAiqPkkXjZzUkHL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

Page: 1

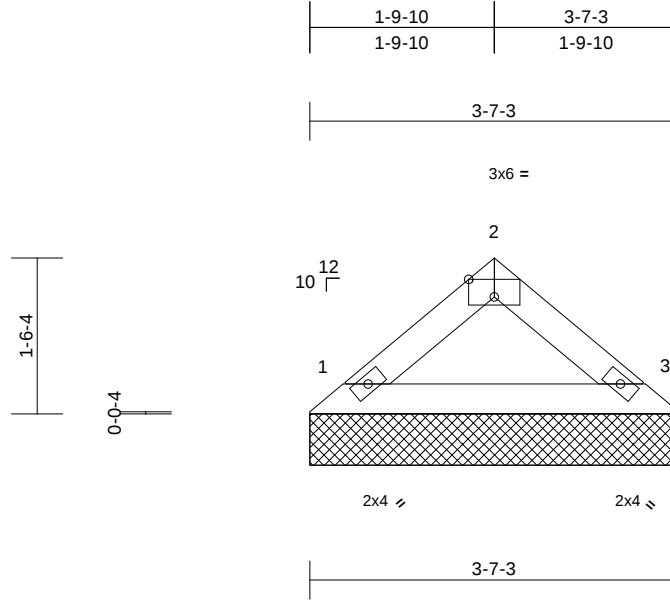

Scale = 1:22.5

Plate Offsets (X, Y): [2:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.03	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-P							Weight: 11 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-7-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=3-7-3, 3=3-7-3
Max Horiz 1=-29 (LC 8)
Max Uplift 1=-11 (LC 12), 3=-11 (LC 13)
Max Grav 1=114 (LC 1), 3=114 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-88/31, 2-3=-88/31
BOT CHORD 1-3=-8/54

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 0-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 1 and 11 lb uplift at joint 3.

LOAD CASE(S) Standard

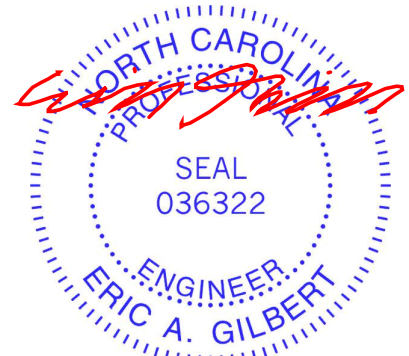

September 16, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

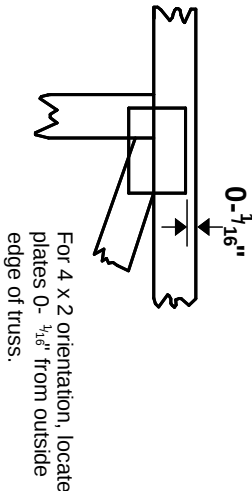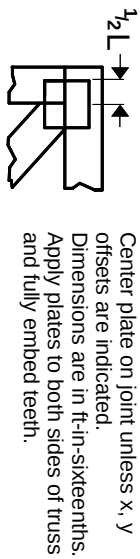

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

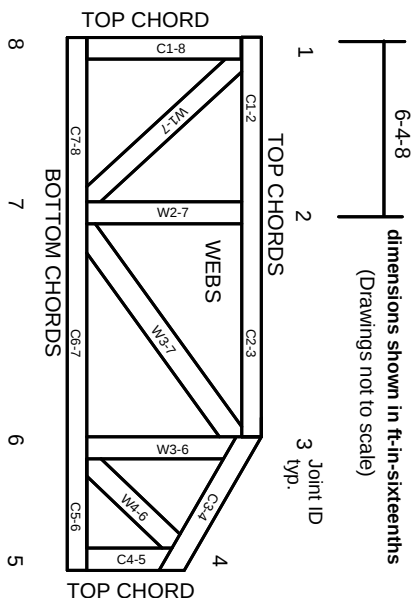

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023