

RE: 4844907 -

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Project Customer: Tri Pointe Homes Project Name:
 Lot/Block: 365 Subdivision: SERENITY
 Address: 70 SHADY CREEK WAY
 City: FUQUAY-VARINA State: NC

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
 Address:
 City, County: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2021/TPI2014	Design Program: MiTek 20/20 8.8
Wind Code: ASCE 7-16	Design Method: MWFRS (Envelope)/C-C hybrid Wind ASCE 7-16
Wind Speed: 115 mph	
Roof Load: 40.0 psf	Floor Load: N/A psf

This package includes 1 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Job ID#	Truss Name	Date
1	I77874405	4844907	C05	11/19/25

The truss drawing(s) referenced above have been prepared by
 Truss Engineering Co. under my direct supervision based on the parameters
 provided by Builders FirstSource (Apex,NC).

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2025.

IMPORTANT NOTE: The seal on these truss component designs is a certification
 that the engineer named is licensed in the jurisdiction(s) identified and that the
 designs comply with ANSI/TPI 1. These designs are based upon parameters
 shown (e.g., loads, supports, dimensions, shapes and design codes), which were
 given to MiTek or TRENCO. Any project specific information included is for MiTek's or
 TRENCO's customers file reference purpose only, and was not taken into account in the
 preparation of these designs. MiTek or TRENCO has not independently verified the
 applicability of the design parameters or the designs for any particular building. Before use,
 the building designer should verify applicability of design parameters and properly
 incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



November 19,2025

Gilbert, Eric

RE: \$JOBNAME - \$JOBDESC

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Project Customer: \$SI_CUSTOMER Project Name: \$SI_JOBNAME
Lot/Block: \$SI_LOTNUM Subdivision: \$SI_SUBDIV
Address: \$SI_SITEADDR
City, County: \$SI_SITECITY State: \$SI_SITESTATE

RE: \$JOBNAME - \$JOBDESC

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Project Customer: \$SI_CUSTOMER Project Name: \$SI_JOBNAME
Lot/Block: \$SI_LOTNUM Subdivision: \$SI_SUBDIV
Address: \$SI_SITEADDR
City, County: \$SI_SITECITY State: \$SI_SITESTATE

Job 4844907	Truss C05	Truss Type Attic	Qty 4	Ply 1	Job Reference (optional) I77874405
----------------	--------------	---------------------	----------	----------	---------------------------------------

Builders FirstSource (Apex, NC), Apex, NC - 27523,


Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Nov 17 12:50:16
ID:u2SlySgYRzO16NVgfdi_8Qz3Khc-Rfc?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

DAMAGED PLATE AT JOINT 2.
BREAK IN WEB 3-26 AT 20" FROM JOINT 3.
BROKEN OUT WEB 26-31.
BROKEN OUT SECTION OF WEB 4-25
FROM JOINT 31 TO 2' ABOVE BOTTOM CHORD.

6-8-0 12-10-8 15-1-4 24-0-0 27-2-8 34-1-12 40-2-8
6-8-0 6-2-8 2-2-12 5-10-0 3-2-8 5-9-0 6-0-12

PLATE(S) AT JOINTS 24, 25
MUST BE FULLY EMBEDDED AND UNDISTURBED.

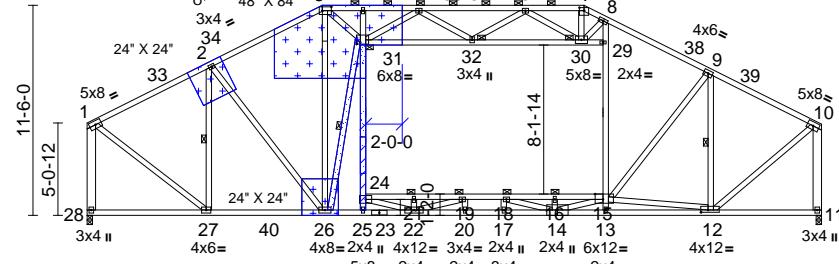

ATTACH 7/16" OSB GUSSET (7/16" RATED SHEATHING 24/16 EXP 1)
TO EACH FACE OF TRUSS WITH (0.131" X 2.5" MIN) NAILS PER THE FOLLOWING NAIL SCHEDULE:
2 X 3'S - 2 ROWS, 2 X 4'S - 3 ROWS, 2 X 6'S AND LARGER - 4 ROWS: SPACED @ 4" O.C.
NAILS TO BE DRIVEN FROM BOTH FACES, STAGGER SPACING FROM FRONT TO BACK FACE
FOR A NET 2" O.C. SPACING IN EACH COVERED TRUSS MEMBER. USE 2" MEMBER END DISTANCE.

APPLY 2 X 4 X 4' SPF/DF/SP NO.2 SCAB(S) TO EACH FACE OF TRUSS CENTERED
ON SPLICING. ATTACH WITH (0.131" X 3") NAILS PER THE FOLLOWING NAIL
SCHEDULE: 2 ROWS:
SPACED @ 4" O.C. STAGGER NAIL SPACING FROM FRONT FACE AND BACK FACE
FOR A NET 2" O.C. SPACING IN THE TRUSS. USE 2" MEMBER END DISTANCE.

17-10-12 16-0-0 15-3-0 22-9-12 25-7-4 28-3-0
6-8-0 13-0-4 15-1-4 20-8-4 25-9-0 28-4-12
6-8-0 6-4-4 2-1-0-10-12 2-1-8-2-9-8 5-9-0 34-1-12
0-1-12 0-9-0 2-9-8 0-1-12 2-6-0 40-2-8
0-1-12

Scale = 1:126.2

Plate Offsets (X, Y): [3:0-6-0,0-2-8], [7:0-3-0,0-2-0], [12:0-4-12,0-1-8], [15:0-5-4,Edge], [31:0-2-8,0-1-2]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	-0.30	18-19	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	Vert(CT)	-0.48	18-19	>989	240	MT20HS	187/143
BCLL	0.0*	Rep Stress Incr	YES	WB	Horz(CT)	0.08	11	n/a	n/a		
BCDL	10.0	Code	IRC2021/TPI2014	Matrix-MS	Wind(LL)	0.08	25-26	>999	240	Weight: 374 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* 28-23:2x4 SP No.1,
23-14:2x4 SP 2400F 2.0E or 2x4 SP DSS or
2x4 SP SS
WEBS 2x4 SP No.3 *Except*
4-25,8-13,31-29,14-15,22-24,14-18,22-19:2x
4 SP No.2, 28-1,11-10:2x6 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or
3-1-15 oc purlins, except end verticals, and
2-0-0 oc purlins (3-3-8 max.): 3-7.
BOT CHORD Rigid ceiling directly applied or 3-3-7 oc
bracing.

WEBS 1 Row at midpt 2-27, 9-12, 26-31
JOINTS 1 Brace at Jt(s): 30,
31, 32

REACTIONS (size) 11=0-3-8, 28=0-3-8
Max Horiz 28=-86 (LC 13)

Max Grav 11=2574 (LC 2), 28=2454 (LC 2)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 1-2=2054/0, 2-3=2500/0, 3-4=2248/120,
4-5=2213/138, 5-6=2556/11, 6-7=1905/0,
7-8=2113/0, 8-9=2834/0, 9-10=2038/0,
1-28=2355/0, 10-11=2480/0

BOT CHORD 27-28=-87/97, 26-27=0/1779, 25-26=0/2471,
22-25=0/2324, 20-22=0/4815, 17-20=0/4815,
13-17=-191/4815, 12-13=-158/668,
11-12=-3/28, 21-24=-1859/0, 19-21=-1859/0,
18-19=-2527/0, 16-18=-721/541,
15-16=-654/557

WEBS

2-27=-1039/0, 2-26=0/695, 3-26=-69/1134,
24-25=0/194, 24-31=0/1055, 4-31=-100/45,
13-15=0/247, 15-29=0/852, 8-29=0/843,
31-32=-373/747, 30-32=-378/467,
29-30=-70/20, 1-27=0/2191, 10-12=0/2274,
9-12=-1457/0, 7-30=0/958, 12-15=0/1507,
9-15=0/1107, 3-31=-421/503,
26-31=-1594/17, 5-31=-738/183,
5-32=-122/159, 6-32=-60/211,
6-30=-814/190, 14-15=0/2971, 22-24=0/2161,
14-16=-408/0, 21-22=-414/0, 14-18=-1884/0,
19-22=-699/210, 19-20=-56/29, 17-18=0/187,
8-30=-899/0

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-2-12 to 4-3-0, Interior (1) 4-3-0 to 12-10-8, Exterior(2R) 12-10-8 to 18-6-12, Interior (1) 18-6-12 to 27-2-8, Exterior(2R) 27-2-8 to 32-10-12, Interior (1) 32-10-12 to 39-11-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-0 tall by 2-00-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Ceiling dead load (5.0 psf) on member(s). 31-32, 30-32, 29-30; Wall dead load (5.0psf) on member(s).24-31, 15-29
- 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 21-24, 19-21, 18-19, 16-18, 15-16

9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

10) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard



November 19, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DDS-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcaccomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless X, Y offsets are indicated.

Dimensions are in ft-in-sixteenths.

Apply plates to both sides of truss and fully embed teeth.

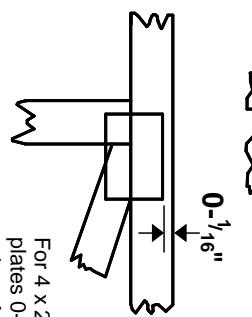

This symbol indicates the required direction of slots in connector plates.


* Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



BEARING

Indicated by symbol shown and/or by text in the bracing section or the output. Use T or I bracing if indicated.



Industry Standards:


ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.

DSB-22: Design Standard for Bracing.

BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths
(Drawings not to scale)

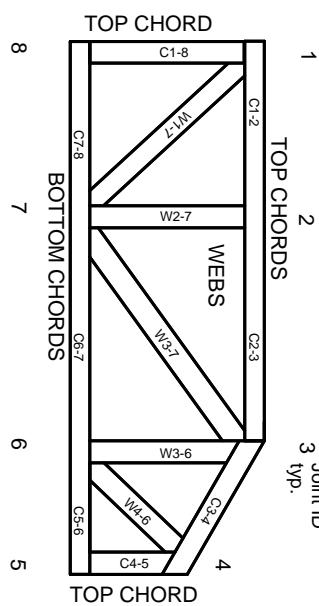

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MiTek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.

2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, individual lateral braces themselves may require bracing, or alternative Tor! bracing should be considered.

3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.

4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.

5. Cut members to bear tightly against each other.

6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1.

7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1.

8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.

9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.

10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.

11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.

12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.

13. Top chords must be sheathed or purlins provided at spacing indicated on design.

14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.

15. Connections not shown are the responsibility of others.

16. Do not cut or alter truss member or plate without prior approval of an engineer.

17. Install and load vertically unless indicated otherwise.

18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.

19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.

20. Design assumes manufacture in accordance with ANSI/TP1 Quality Criteria.

21. The design does not take into account any dynamic or other loads other than those expressly stated.

MiTek®
ENGINEERING BY
TRENGO
A MiTek Affiliate