

|        |                                     |        |                           |
|--------|-------------------------------------|--------|---------------------------|
| ABV    | ABOVE                               | L      | LENGTH                    |
| AC     | AIR CONDITIONING                    | LA     | LAUNDRY                   |
| AD     | AREA DRAIN                          | LAV    | LAVATORY                  |
| ADJ    | ADJUSTABLE                          | LVR    | LOUVER                    |
| ALT    | ALTERNATE                           | MAX    | MAXIMUM                   |
| ALUM   | ALUMINUM                            | MCH    | MECHANICAL                |
| ARCH.  | ARCHITECTURAL                       | MFR.   | MANUFACTURER              |
| BA     | BATHROOM                            | MIN    | MINIMUM                   |
| BD     | BOARD                               | MISC   | MISCELLANEOUS             |
| BF     | BI-FOLD (DOOR)                      | N      | NORTH                     |
| BLDG   | BUILDING                            | N.T.S. | NOT TO SCALE              |
| BLK    | BLOCK (2x4x6)                       | O.G.   | OVERHEAD GARAGE DOOR      |
| BLN    | BELONG                              | OH     | OVERHEAD                  |
| BM     | BEAM                                | OPT    | OPTIONAL                  |
| BP     | BI-PASS (DOOR)                      | PAR    | PARALLEL                  |
| BPT    | BUSH BOTTOM                         | PBR    | PER BIT                   |
| BTN    | BETWEEN                             | PKR    | POWDER                    |
| CB     | CABINET                             | PED    | PEDISTAL                  |
| CE     | CERAMIC                             | PL     | PLATE                     |
| CJ     | CONTROL JOINT OR CONSTRUCTION JOINT | PR     | PRIMER                    |
| CL     | CLOSET OR CENTER LINE               | PT     | PRESSURE TREATED WOOD     |
| CL6    | CEILING                             | PVC    | POLYVINYL CHLORIDE PIPE   |
| CLR    | CLEAR                               | PVM    | PAVEMENT                  |
| CMU    | CONCRETE MASONRY UNIT               | PW     | PRE-WIRE                  |
| COL    | COLUMN                              | PWD    | PLYWOOD                   |
| CONC   | CONCRETE                            | R      | RANGE                     |
| C      | CARPET                              | RA6    | RETURN AIR GRILL          |
| CR     | CORROSION RESISTANT                 | REF    | REFRIGERATOR              |
| CSMT   | CASEMENT                            | REFR   | REFRIGERATOR              |
| C      | CERAMIC TILE                        | REQ    | REQUIRED                  |
| D      | DRYER                               | S      | SOUTH                     |
| DEL    | DOUBLE                              | SD     | SMOKE DETECTOR            |
| DM     | DOUBLE HUNG                         | S.F.   | SQUARE FEET               |
| DH     | DIMENSION                           | S.G.D. | SLIDING GLASS DOOR        |
| DISP   | DISPOSAL                            | SH     | SINGLE HUNG OR SHELF      |
| DN     | DOWN                                | SHM    | SIMILAR                   |
| DR     | DOOR                                | SLO    | SLOPING                   |
| DS     | DOWNPOUT                            | SHELF  | SHELF AND POLE            |
| DISH   | DISH WASHER                         | SPEC   | SPECIFICATIONS            |
| DWG    | DRAWING                             | STD    | STANDARD                  |
| E      | EAST                                | STR    | STRUCTURAL                |
| EA     | EACH                                | SQ     | SQUARE                    |
| ELEV   | ELEVATION                           | SYM    | SYMBOL                    |
| ELC    | ELECTRICAL                          | S4S    | SMOOTH FOUR SIDES         |
| EQ     | EQUAL                               | T      | TREAD (AT STAIRS) OR TILE |
| EXT    | EXTERIOR                            | TB     | TIMBER                    |
| FAU    | FORCED AIR UNIT                     | TEMP   | TEMPERED (GLASS)          |
| F.C.   | FLOOR CHANGE                        | T&G    | TONGUE & GROOVE           |
| F.D.   | FLOOR DRAIN                         | T.O.G. | TOP OF CURB               |
| FFL    | FINISH FLOOR LINE                   | TV     | TELEVISION                |
| F.G.   | FINISHED GRADE                      | TYP    | TYPICAL                   |
| FLR    | FLOORING                            | UNO.   | UNLESS NOTED OTHERWISE    |
| FL     | FLORESCENT (LIGHT)                  | V.B.   | VAPOR BARRIER             |
| FND    | FOUNDATION                          | VERT   | VERTICAL                  |
| F.O.S. | FACE OF STUD                        | V.T.R. | VENT TRIP ROOF            |
| FTG    | FOOTING                             | W      | WASHING MACHINE           |
| FX     | FIXED GLASS                         | WD     | WOOD                      |
| GALV   | GALVANIZED                          | WDM    | WINDOR                    |
| GAR    | GARAGE                              | WH     | WATER HEATER              |
| G.B.   | GYPSUM BOARD                        | W/     | WROUGHT IRON              |
| GD     | GRADE OR GRADING                    | MCH    | MALK-IN GLOSET            |
| G.D.D. | GRADE DOOR OPENER                   | N/W    | WITH OR WITHOUT           |
| GR     | GROUND FAULT INTERRUPTER            | WP     | WATERPROOFING             |
| GL     | GLASS OR GLAZING                    | WM     | WELDED RISE MESH          |
| GYP BD | GYPSUM BOARD                        | R      | R. PROPERTY LINE          |
| HB     | HOSE BIBB                           | Ø      | ROUND / DIAMETER          |
| HD     | HEAD OR HARD                        | &      | AND                       |
| HDR    | HEADER                              | G      | CENTERLINE                |
| HGT    | HEIGHT                              | #      | NOT / NUMBER              |
| H/VAC  | HEATING/VENTILATING/AIR COND.       |        |                           |
| HWD    | HARDWOOD                            |        |                           |
| INT    | INTERIOR                            |        |                           |
| JST    | JOIST                               |        |                           |
| KIT    | KITCHEN                             |        |                           |

ALL CONSTRUCTION TO COMPLY WITH LOCAL CODES AND ORDINANCES CURRENTLY IN USE WITH THE LOCAL JURISDICTION.

APPLICABLE CODES:  
FOLLOW ALL APPLICABLE STATE AND LOCAL CODES.  
2018 NORTH CAROLINA STATE SUPPLEMENTS AND AMENDMENTS

CONTRACTOR AND BUILDER SHALL REVIEW ENTIRE PLAN TO VERIFY CONFORMANCE WITH ALL CURRENT APPLICABLE CODES IN EFFECT AT TIME OF CONSTRUCTION. BY USING THESE DRAWINGS FOR CONSTRUCTION IT IS UNDERSTOOD THAT CONFORMANCE WITH ALL APPLICABLE CODES IS THE RESPONSIBILITY OF THE BUILDER AND CONTRACTOR.

PRODUCT:  
SINGLE FAMILY RESIDENCE

OCCUPANCY CLASSIFICATION  
RESIDENTIAL R-3

CONSTRUCTION TYPE:  
TYPE VB

| MODEL 'HAYDEN' |                                                 |
|----------------|-------------------------------------------------|
| 0              | TITLE SHEET / COVER SHEET                       |
| 0.1            | QUICK VIEW                                      |
| 0.2            | QUICK VIEW                                      |
| 1 A            | FRONT ELEVATION 'A'                             |
| 1.1 A          | ROOF PLAN 'A'                                   |
| 2 A            | SIDE AND REAR ELEVATIONS 'A'                    |
| 2.1 A          | SIDE AND REAR ELEVATIONS 'A'-<br>W/ CRAWL SPACE |
| 2.2 A          | SIDE AND REAR ELEVATIONS 'A'-<br>W/ BASEMENT    |
| 3 MS A         | MONOLITHIC SLAB PLAN 'A'                        |
| 3 SW A         | STEM WALL PLAN 'A'                              |
| 3 CS A         | CRAWL SPACE PLAN 'A'                            |
| 3 BS A         | BASEMENT PLAN 'A'                               |
| 4 A            | 1ST FLOOR PLAN 'A'                              |
| 5 A            | 2ND FLOOR PLAN 'A'                              |
| 1 B            | FRONT ELEVATION 'B'                             |
| 1.1 B          | ROOF PLAN 'B'                                   |
| 2 B            | SIDE AND REAR ELEVATIONS 'B'                    |
| 2.1 B          | SIDE AND REAR ELEVATIONS 'B'-<br>W/ CRAWL SPACE |
| 2.2 B          | SIDE AND REAR ELEVATIONS 'B'-<br>W/ BASEMENT    |
| 3 MS B         | MONOLITHIC SLAB PLAN 'B'                        |
| 3 SW B         | STEM WALL PLAN 'B'                              |
| 3 CS B         | CRAWL SPACE PLAN 'B'                            |
| 3 BS B         | BASEMENT PLAN 'B'                               |
| 4 B            | 1ST FLOOR PLAN 'B'                              |
| 5 B            | 2ND FLOOR PLAN 'B'                              |
| 1 F            | FRONT ELEVATION 'F'                             |
| 1.1 F          | ROOF PLAN 'F'                                   |
| 2 F            | SIDE AND REAR ELEVATIONS 'F'                    |
| 2.1 F          | SIDE AND REAR ELEVATIONS 'F'-<br>W/ CRAWL SPACE |
| 2.2 F          | SIDE AND REAR ELEVATIONS 'F'-<br>W/ BASEMENT    |
| 3 MS F         | MONOLITHIC SLAB PLAN 'F'                        |
| 3 SW F         | STEM WALL PLAN 'F'                              |
| 3 CS F         | CRAWL SPACE PLAN 'F'                            |
| 3 BS F         | BASEMENT PLAN 'F'                               |
| 4 F            | 1ST FLOOR PLAN 'F'                              |
| 5 F            | 2ND FLOOR PLAN 'F'                              |
| 1 K            | FRONT ELEVATION 'K'                             |
| 1.1 K          | ROOF PLAN 'K'                                   |
| 2 K            | SIDE AND REAR ELEVATIONS 'K'                    |
| 2.1 K          | SIDE AND REAR ELEVATIONS 'K'-<br>W/ CRAWL SPACE |
| 2.2 K          | SIDE AND REAR ELEVATIONS 'K'-<br>W/ BASEMENT    |
| 3 MS K         | MONOLITHIC SLAB PLAN 'K'                        |
| 3 SW K         | STEM WALL PLAN 'K'                              |
| 3 CS K         | CRAWL SPACE PLAN 'K'                            |
| 3 BS K         | BASEMENT PLAN 'K'                               |
| 4 K            | 1ST FLOOR PLAN 'K'                              |
| 5 K            | 2ND FLOOR PLAN 'K'                              |
| 1 P            | FRONT ELEVATION 'P'                             |
| 1.1 P          | ROOF PLAN 'P'                                   |
| 2 P            | SIDE AND REAR ELEVATIONS 'P'                    |
| 2.1 P          | SIDE AND REAR ELEVATIONS 'P'-<br>W/ CRAWL SPACE |
| 2.2 P          | SIDE AND REAR ELEVATIONS 'P'-<br>W/ BASEMENT    |
| 3 MS P         | MONOLITHIC SLAB PLAN 'P'                        |
| 3 SW P         | STEM WALL PLAN 'P'                              |
| 3 CS P         | CRAWL SPACE PLAN 'P'                            |
| 3 BS P         | BASEMENT PLAN 'P'                               |
| 4 P            | 1ST FLOOR PLAN 'P'                              |
| 5 P            | 2ND FLOOR PLAN 'P'                              |
| 1 R            | FRONT ELEVATION 'R'                             |
| 1.1 R          | ROOF PLAN 'R'                                   |
| 2 R            | SIDE AND REAR ELEVATIONS 'R'                    |
| 2.1 R          | SIDE AND REAR ELEVATIONS 'R'-<br>W/ CRAWL SPACE |
| 2.2 R          | SIDE AND REAR ELEVATIONS 'R'-<br>W/ BASEMENT    |
| 3 MS R         | MONOLITHIC SLAB PLAN 'R'                        |
| 3 SW R         | STEM WALL PLAN 'R'                              |
| 3 CS R         | CRAWL SPACE PLAN 'R'                            |
| 3 BS R         | BASEMENT PLAN 'R'                               |
| 4 R            | 1ST FLOOR PLAN 'R'                              |
| 5 R            | 2ND FLOOR PLAN 'R'                              |
| 1 A S          | BUILDING SECTIONS                               |
| 1.1 A S        | BUILDING SECTIONS                               |
| 1.1.2 A S      | BUILDING SECTIONS                               |
| 1.1.3 A S      | BUILDING SECTIONS                               |
| 6              | BASEMENT UTILITY PLAN                           |
| 7              | 1ST FLOOR UTILITY PLAN                          |
| 8              | 2ND FLOOR UTILITY PLAN                          |
| 9 B            | OPTIONAL EXT. COVERED PORCH                     |
| 9 F            | OPTIONAL EXT. COVERED PORCH                     |
| 9 K            | OPTIONAL EXT. COVERED PORCH                     |

79
ARCHITECTURAL SHEETS

THE CONSULTANT DRAWINGS ACCOMPANYING THESE ARCHITECTURAL DRAWINGS HAVE NOT BEEN PREPARED BY OR UNDER THE DIRECTION OF GMD DESIGN GROUP, INC. GMD DESIGN GROUP INC. THEREFORE ASSUMES NO LIABILITY FOR THE COMPLETENESS OR CORRECTNESS OF THESE DRAWINGS.

Cross Creek  
Lot 26  
Spring Lake, NC 28390

|  |  |  |  |
|--|--|--|--|
|  |  |  |  |
|--|--|--|--|

THESE DOCUMENTS ARE THE PROPERTY OF THE DESIGNER AND SHALL NOT BE COPIED, DUPLICATED, ALTERED, MODIFIED OR REVISED IN ANY WAY WITHOUT THE EXPRESSED WRITTEN APPROVAL OF THE DESIGNER.

**CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE SITE AND ALL INCONSISTENCIES SHALL BE BROUGHT TO THE ATTENTION OF THE DEVELOPER AND THE DESIGNER BEFORE PROCEEDING WITH WORK.**

**ANY ERRORS OR OMISSIONS FOUND IN THESE DRAWINGS SHALL BE BROUGHT TO DEVELOPERS AND DESIGNERS ATTENTION IMMEDIATELY.**

**DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS.**

**ALL DIMENSIONS ARE TO FACE OF STUD OR TO FACE OF FRAMING UNLESS OTHERWISE NOTED.**

**ALL TRUSS DRAWINGS TO BE REVIEWED AND APPROVED BY THE STRUCTURAL ENGINEER PRIOR TO ISSUANCE OF BUILDING PERMIT.**

**ALL OR EQUAL SUBSTITUTIONS MUST BE SUBMITTED TO AND APPROVED BY CITY BUILDING OFFICIAL PRIOR TO INSTALLATION.**

**ALL ANGLED PARTITIONS ARE 45 DEGREES UNLESS OTHERWISE NOTED.**

**PROVIDE FIREBLOCKING. (PER LOCAL CODES)**

**ALL ELECTRICAL AND MECHANICAL EQUIPMENT AND METERS ARE SUBJECT TO RELOCATION DUE TO FIELD CONDITIONS, CONTRACTOR TO VERIFY.**

**TOILET PAPER AND/OR BACKING AT ALL TOILET BAR, TOILET RING AND/OR TOILET PAPER HOLDER LOCATIONS, AS SHOWN PER PLAN, TYPICAL AT ALL BATHROOMS AND POWDER ROOMS. VERIFY LOCATIONS AT FRAMING WALL.**

**ELASTOMERIC SHEET WATERPROOFING: FURNISH AND INSTALL ALL WATERPROOFING COMPLETE. A 40 MIL, SELF-ADHERING MEMBRANE OF RUBBERIZED ASPHALT INTEGRALLY BONDED TO POLYETHYLENE SHEETING, OR EQUAL. INSTALL PER MANUFACTURER'S AND TRADE ASSOCIATIONS PRINTED INSTALLATION INSTRUCTIONS. 6" MINIMUM LAP AT ALL ADJACENT WALL SURFACES.**

**TO THE BEST OF THE DESIGNER'S KNOWLEDGE THESE DOCUMENTS ARE IN CONFORMANCE WITH THE REQUIREMENTS OF THE BUILDING AUTHORITIES HAVING JURISDICTION OVER THIS TYPE OF CONSTRUCTION AND OCCUPANCY.**

**SHOP DRAWING REVIEW AND DISTRIBUTION, ALONG WITH PRODUCT SUBMITTALS, REQUESTED IN THE CONSTRUCTION DOCUMENTS, SHALL BE THE SOLE RESPONSIBILITY OF THE GENERAL CONTRACTOR, UNLESS DIRECTED OTHERWISE UNDER A SEPARATE AGREEMENT.**

**DEVIATIONS FROM THESE DOCUMENTS IN THE CONSTRUCTION PHASE SHALL BE REVIEWED BY THE DESIGNER AND THE OWNER PRIOR TO THE START OF WORK IN QUESTION. ANY DEVIATIONS FROM THESE DOCUMENTS WITHOUT PRIOR REVIEW, SHALL BE THE SOLE RESPONSIBILITY OF THE GENERAL CONTRACTOR.**

**THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK AND MATERIALS REPRESENTED ON THESE DOCUMENTS INCLUDING THE WORK AND MATERIALS FURNISHED BY SUBCONTRACTORS AND VENDORS.**

**THE BUILDER SHALL FURNISH ANY AND ALL REPORTS RECEIVED FROM THE GEOTECHNICAL ENGINEER (SOILS REPORT), ON THE STUDY OF THE PROPOSED SITE, TO THE DESIGNER, STRUCTURAL ENGINEER, AND GENERAL CONTRACTOR. IN THE EVENT THE GEOTECHNICAL REPORTS DO NOT EXIST, THE SOILS CONDITION SHALL BE ASSUMED TO BE A MINIMUM DESIGN SOILS PREPARE STATED BY THE STRUCTURAL ENGINEER OF RECORD FOR THE PURPOSE OF STRUCTURAL DESIGN. GENERAL CONTRACTOR SHALL ASSURE THE SOIL CONDITIONS MEET OR EXCEED THE CRITERIA.**

**ALL WORK PERFORMED BY THE GENERAL CONTRACTOR SHALL COMPLY AND CONFORM WITH LOCAL AND STATE BUILDING CODES, ORDINANCES AND REGULATIONS, ALONG WITH ALL OTHER AUTHORITIES HAVING JURISDICTION. THE GENERAL CONTRACTOR IS RESPONSIBLE TO BE AWARE OF THESE REQUIREMENTS AND GOVERNING REGULATIONS.**

**PROVIDE AN APPROVED WASHER DRAIN PAN AT SECOND FLOOR ONLY THAT DRAINS TO EXTERIOR.**

**WINDOW SUPPLIER TO VERIFY AT LEAST ONE WINDOW IN ALL BEDROOMS TO HAVE A CLEAR OPENABLE AREA OF 4.0 SQ FT. THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 22" AND THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20". THE TOTAL AREA OF NOT LESS THAN 5.0 SQ FT IN THE CASE OF GROUND WINDOW AND NOT LESS THAN 5.7 SQ FT IN THE CASE OF AN UPPER STORY WINDOW. (PER NRC SECTION R301.1.1)**

**ALL HANDRAIL BALLUSTERS TO BE SPACED SUCH THAT A 4" SPHERE CANNOT PASS BETWEEN BALLUSTERS. (PER LOCAL CODES.)**

**PROVIDE STAIR HANDRAILS AND GUARDRAILS PER LOCAL CODES.**

THE SCOPE OF THIS SET OF PLANS IS TO PROVIDE A "BUILDER'S SET" OF CONSTRUCTION DOCUMENTS AND GENERAL NOTES HEREINAFTER REFERRED TO AS "PLANS". THIS SET OF PLANS IS SUFFICIENT TO OBTAIN A BUILDING PERMIT; HOWEVER, ALL MATERIALS AND METHODS OF CONSTRUCTION NECESSARY TO COMPLETE THE PROJECT ARE NOT NECESSARILY DESCRIBED. THE PLANS DELINEATE AND DESCRIBE ONLY LOCATIONS, DIMENSIONS, TYPES OF MATERIALS, AND GENERAL METHODS OF ASSEMBLING OR FASTENING. THEY ARE NOT INTENDED TO SPECIFY PARTICULAR PRODUCTS OR OTHER METHODS OF ANY SPECIFIC MATERIALS, PRODUCT OR METHOD. THE IMPLEMENTATION OF THE PLANS REQUIRES A CLIENT/ CONTRACTOR THOROUGHLY KNOWLEDGEABLE WITH THE APPLICABLE BUILDING CODES AND METHODS OF CONSTRUCTION SPECIFIC TO THIS PRODUCT TYPE AND TYPE OF CONSTRUCTION.

CONSTRUCTION REQUIREMENTS AND QUALITY: PROVIDE WORK OF THE SPECIFIC QUALITY, WHERE QUALITY LEVEL IS NOT INDICATED, PROVIDE WORK OF QUALITY CUSTOMARY IN SIMILAR TYPES OF WORK. WHERE THE PLANS AND SPECIFICATIONS, CODES, LAWS, REGULATIONS, MANUFACTURER'S RECOMMENDATIONS OR INDUSTRY STANDARDS REQUIRE WORK OF HIGHER QUALITY OR PERFORMANCE, PROVIDE WORK COMPLYING WITH THOSE REQUIREMENTS AND QUALITY. WHERE TWO OR MORE QUALITY PROVISIONS OF THOSE REQUIREMENTS CONFLICT WITH THE MOST STRINGENT REQUIREMENT, WHERE REQUIREMENTS ARE DIFFERENT BUT APPARENTLY EQUAL, AND WHERE IT IS UNCERTAIN WHICH REQUIREMENT IS MOST STRINGENT, OBTAIN CLARIFICATION FROM THE GMD DESIGN GROUP BEFORE PROCEEDING.

| MODEL 'HAYDEN' SQUARE FOOTAGES                        |               |
|-------------------------------------------------------|---------------|
| AREA                                                  | ELEV 'F', 'K' |
| 1st FLOOR                                             | 1066 SF       |
| 2nd FLOOR                                             | 1445 SF       |
| TOTAL LIVING                                          | 2511 SF       |
| GARAGE                                                | 422 SF        |
| PORCH                                                 | 109 SF        |
| OPT. COVERED PORCH                                    | 80 SF         |
| OPT. BASEMENT                                         | 1006 SF       |
| **BASEMENT AREA IS TAKEN TO INSIDE OF CONCRETE WALL** |               |

PROJECT NO: GMD1049

SHEET TITLE:

TITLE SHEET

PRINT DATE:

January 22, 2021

SHEET NO:

0

|     |          |                 |
|-----|----------|-----------------|
| NO: | DATE:    | REVISION:       |
| 1   | 09.06.23 | FOUNDATION NOTE |
| 2   | 04.15.25 |                 |

**PROFESSIONAL SEAL:**

PROJECT TITLE:

## 40' Series

**CLIENTS NAME:**

**D·R·HORTON**  
*America's Builder*  
8025 Knowledge Blvd., Charlotte, NC 28273 704.377.2006

PROJECT NO: GMD17049

SHEET TITLE:  
**TITLE SHEET**

PRINT DATE:  
January 22, 2021

SHEET NO:

0

**FOR  
CONSTRUCTION**



Front Elevation 'K'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X17" LAYOUT



Front Elevation 'P'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X17" LAYOUT



Front Elevation 'R'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X17" LAYOUT

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 09.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:

**D-R-HORTON**  
*America's Builder*  
With Knowledge, Skill, Creativity, We Build Your Dream

PROJECT NO: GMD17049

SHEET TITLE:

QUICK VIEW

PRINT DATE:

January 22, 2021

SHEET NO:

0.2

FOR  
CONSTRUCTION

AVAILABLE WITH OPTIONAL  
9'-1" FIRST FLOOR PLATE

NOTES AT OPT 9'-1" PLT:

- WDW HT SET AT 7'-6"
- INTERIOR SOFFITS AT 8'-0"
- EXTERIOR SOFFITS AT 8'-0"

NOTES:

- GRADE CONDITIONS MAY VARY FOR INDIVIDUAL SITE FROM THAT SHOWN. BUILDER SHALL VERIFY AND COORDINATE PER ACTUAL SITE CONDITIONS.
- WINDOW HEAD HEIGHTS:  
1ST FLOOR = 8'-0" UNO. ON ELEVATIONS.  
2ND FLOOR = 7'-0" UNO. ON ELEVATIONS.
- ROOFING: PITCHED SHINGLES PER DEVELOPER.
- WINDOWS: MANUFACTURER PER DEVELOPER. DIVIDED LITES AS SHOWN ON THE EXTERIOR ELEVATIONS
- ENTRY DOOR: AS SELECTED BY DEVELOPER.
- GARAGE DOORS: AS SELECTED BY DEVELOPER, RAISED PANEL AS SHOWN.
- ALL EXTERIOR MATERIALS TO BE INSTALLED PER MANUFACTURER'S WRITTEN INSTRUCTIONS.
- PROTECTION AGAINST DECAY:  
(ALL PORTIONS OF A PORCH, SCREEN PORCH OR DECK FROM THE BOTTOM OF THE HEADER DOWN, INCLUDING POST, RAILS, PICKETS, STEPS AND FLOOR STRUCTURE.)
- INSULATION: PER TABLE R102.1.2.  
EXTERIOR WALLS: R-15 BATTS MINIMUM. VERIFY  
CEILING WITH ATTIC ABOVE: R-30 BATTS MINIMUM. VERIFY  
FLOOR OVER GARAGE: R-19 BATTS MINIMUM. VERIFY  
ATTIC KNEEWALL: R-19 BATTS MINIMUM. VERIFY  
GRAVEL SPACE FLOORING: R-19 BATTS MINIMUM. VERIFY

KEY NOTES:

MASONRY:

- [1] ADHERED STONE VENEER AS SELECTED BY DEVELOPER. HEIGHT AS NOTED.
- [2] MASONRY FULL BRICK AS SELECTED BY DEVELOPER. HEIGHT AS NOTED.
- [3] MASONRY FULL STONE AS SELECTED BY DEVELOPER. HEIGHT AS NOTED.
- [4] 8" SOLDIER COURSE.
- [5] RIMLOCK COURSE
- [6] N/A


TYPICALS:

- [7] CORROSION RESISTANT SCREEN LOUVERED VENTS, SIZE AS NOTED.
- [8] CODE APPROVED TERMINATION CHIMNEY CAP.
- [9] CORROSION RESISTANT ROOF TO WALL FLASHING. CODE COMPLIANT FLASHING PER NRC R105.2.8.3
- [10] STANDING SEAM METAL ROOF. INSTALL PER MANUFACTURER'S WRITTEN INSTRUCTIONS.
- [11] DECORATIVE WROUGHT IRON. SEE DETAILS.

SIDING:

- [12] VINYL SHAKE SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER. (AT SPECIFIED LOCATIONS. FIBER CEMENT SHAKE SIDING PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)
- [13] VINYL LAP SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER. (AT SPECIFIED LOCATIONS. FIBER CEMENT LAP SIDING PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)
- [14] VINYL WAVY SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER. (AT SPECIFIED LOCATIONS. FIBER CEMENT WAVY SIDING PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)
- [15] VINYL BOARD AND BATT SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER. (AT SPECIFIED LOCATIONS. FIBER CEMENT PANEL SIDING W/ 1X3 BATTS AT 12" O.C. PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)
- [16] VINYL TRIM SIZE AS NOTED (AT SPECIFIC LOCATIONS. 1X FIBER CEMENT TRIM OR EQUAL, UNO. SIZE AS NOTED FYPON SHUTTERS, TYPE AS SHOWN. SIZE AS NOTED.)
- [17] (AT SPECIFIC LOCATIONS: FALGSE VINYL SHUTTERS, TYPE AS SHOWN. SIZE AS NOTED.)

ALL WINDOWS WHOSE OPENING IS LESS THAN 24" ABOVE THE FINISH FLOOR AND WHOSE OPENING IS GREATER THAN 12" ABOVE THE OUTSIDE WALKING SURFACE MUST HAVE WINDOW OPENING LIMITING DEVICES COMPLYING WITH THE NRC SECTION R312.2.1 AND R312.2.2.

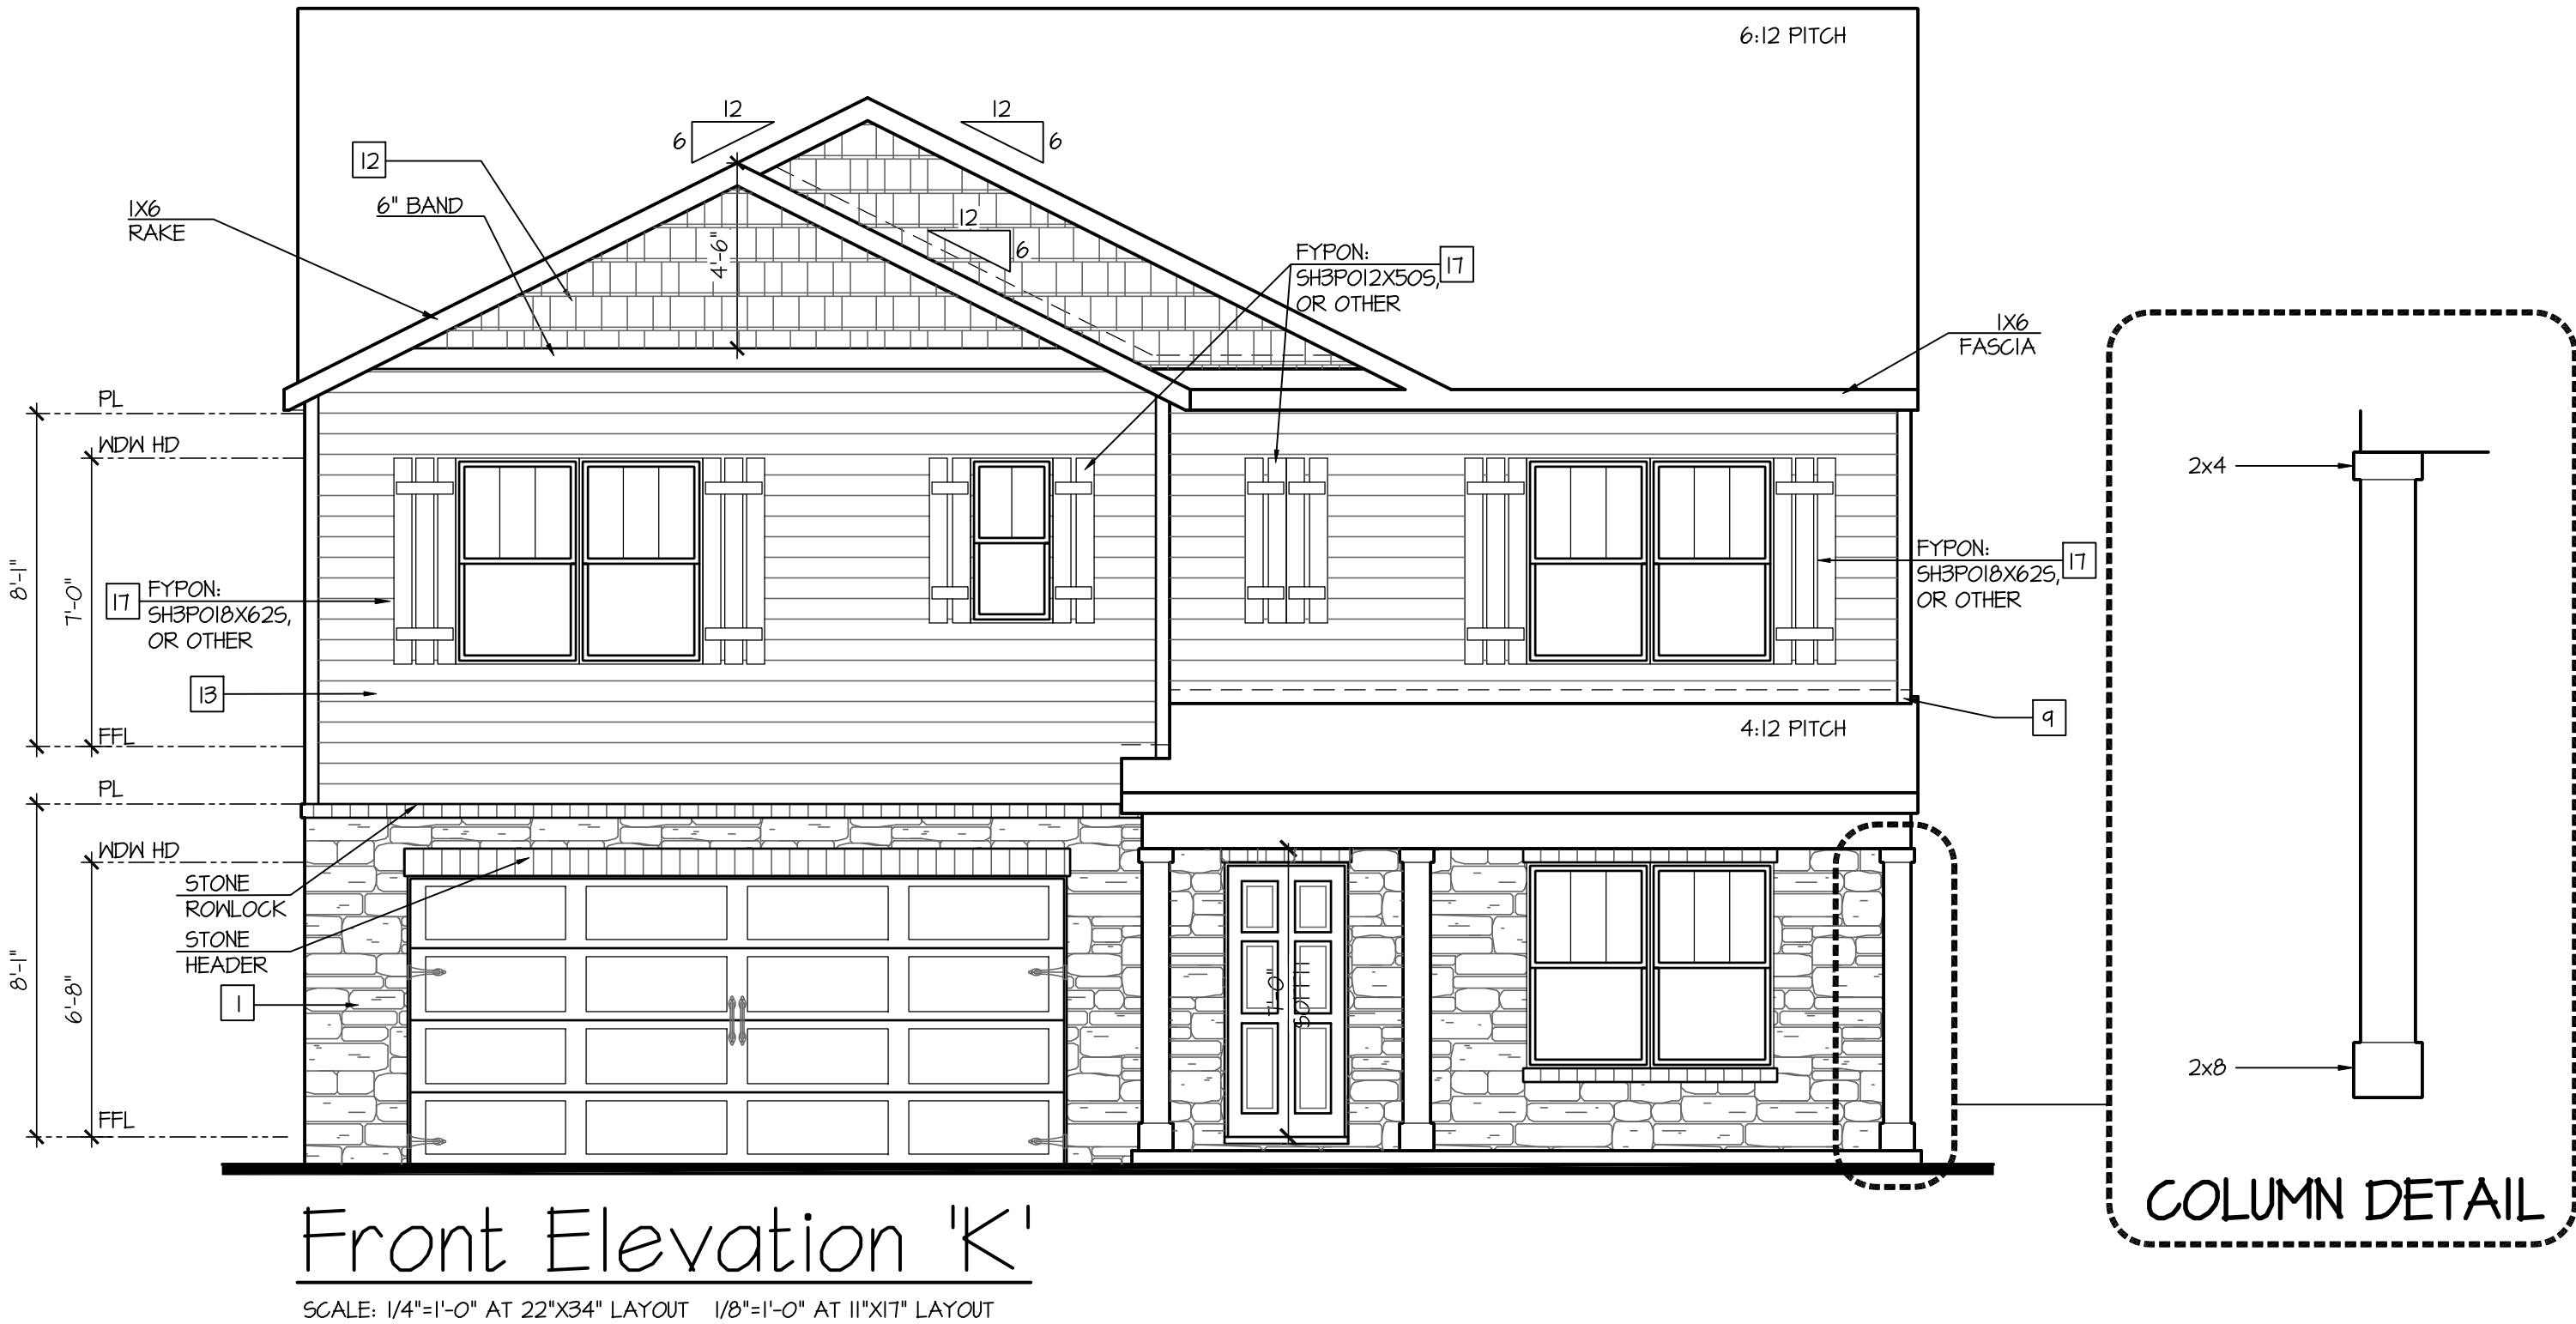

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 09.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:

**D-R-HORTON**  
*America's Builder*  
With Knowledge, Skill, Creativity, We Build Your Vision

PROJECT NO: GMD17049

SHEET TITLE:  
**'HAYDEN'**  
**EXTERIOR**  
**ELEVATIONS**  
**'4EPF-K'**

PRINT DATE:  
January 22, 2021

SHEET NO:  
**1K**

FOR  
CONSTRUCTION

ATTIC VENT CALCULATION FOR PLAN 'HAYDEN': 1:150 RATIO.

THE NET FREE VENTILATING AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF THE SPACE VENTILATED, PROVIDED THAT AT LEAST 50 PERCENT AND NOT MORE THAN 80 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE THE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS.

- EXCEPTIONS:
1. ENCLOSED ATTIC/RAFTER SPACES REQUIRING LESS THAN 1 SQ FT OF VENTILATION MAY BE VENTED WITH CONTINUOUS SOFFIT VENTILATION ONLY.
  2. ENCLOSED ATTIC/RAFTER SPACES OVER UNCONDITIONED SPACE MAY BE VENTED WITH CONTINUOUS SOFFIT VENT ONLY.

GENERAL CONTRACTOR SHALL VERIFY THE NET FREE VENTILATION OF THE VENT PRODUCT SELECTED BY OWNER. VERIFY WITH MANUFACTURER OF HIGH AND LOW VENTS TO BE USED FOR MINIMUM CALCULATED VENTS REQUIRED. THE REQUIRED VENTILATION SHALL BE MAINTAINED. PROVIDE INSULATION STOP SUCH THAT INSULATION DOES NOT OBSTRUCT FREE AIR MOVEMENT AS REQUIRED BY THE BUILDING OFFICIAL.

ALL OVERLAP FRAMED ROOF AREAS SHALL HAVE OPENINGS BETWEEN THE ADJACENT ATTICS IN THE ROOF SHEATHING (AS ALLOWED BY THE STRUCTURAL ENGINEER) TO ALLOW PASSAGE AND ATTIC VENTILATION BETWEEN THE TWO OR ISOLATED ATTIC SPACES SHALL BE VENTED INDEPENDENTLY TO CBC REQUIREMENTS.

PER DEVELOPER, AT ALL CANTILEVERED FLOORS, CANTILEVERED ARCHITECTURAL POP-OUTS, AND ANY DOUBLE FRAMING PROJECTIONS THAT ARE SEPARATED FROM THE VENTING CALCULATIONS SHOWN ABOVE, PROVIDE A CONTINUOUS 2" CORROSION RESISTANT SOFFIT VENT AT UNDERSIDE OF FRAMED ELEMENT.

(PER SECTION R302.2)

1 SQUARE INCH VENT FOR EVERY 150 SQUARE INCHES OF CEILING  
\*144 SQ. IN. = 1 SQ. FT.  
BLDG. CEILING (SF) X 144 = BLDG (SQ. IN.)  
BLDG. (SQ. IN.) / 150 = SQ. IN. OF VENT REQUIRED

ROOF AREA 1: = 1488 SF  
1488 SQ. FT. X 144 = 214272 SQ. IN.  
214272 SQ. IN. / 150 = 1428.48 SQ. IN. OF VENT REQ'D

ROOF AREA 2: = 34 SF  
34 SQ. FT. X 144 = 5616 SQ. IN.  
5616 SQ. IN. / 150 = 37.44 SQ. IN. OF VENT REQ'D

ROOF AREA 3: = 180 SF  
180 SQ. FT. X 144 = 25920 SQ. IN.  
25920 SQ. IN. / 150 = 172.80 SQ. IN. OF VENT REQ'D

NOTES:

- ALL ROOF DRAINAGE SHALL BE PIPED TO STREET OR APPROVED DRAINAGE FACILITY.
- DASHED LINES INDICATE WALL BELOW.
- LOCATE GUTTER AND DOWNSPOUTS PER BUILDER.
- PITCHED ROOFS AS NOTED.

- TRUSS MANUFACTURER SHALL SUBMIT STRUCTURAL CALCS AND SHOP DRAWINGS TO THE BUILDER'S GENERAL CONTRACTOR AND BUILDING DEPARTMENT FOR REVIEW PRIOR TO FABRICATIONS.

- ALL PLUMBING VENTS SHALL BE COMBINED INTO A MINIMUM AMOUNT OF ROOF PENETRATIONS. ALL ROOF PENETRATIONS SHALL OCCUR TO THE REAR OF THE MAIN RIDGE.

ATTIC VENT CALCULATION FOR PLAN 'HAYDEN': 1:300 RATIO.

AS AN ALTERNATE TO THE 1/150 RATIO LISTED ABOVE, THE NET FREE CROSS-VENTILATION AREA MAY BE REDUCED TO 1/300 WHEN A CLASS I OR II VAPOR RETARDER IS INSTALLED ON THE WARM - IN - WINTER SIDE OF THE CEILING.

GENERAL CONTRACTOR SHALL VERIFY THE NET FREE VENTILATION OF THE VENT PRODUCT SELECTED BY OWNER. VERIFY WITH MANUFACTURER OF HIGH AND LOW VENTS TO BE USED FOR MINIMUM CALCULATED VENTS REQUIRED. THE REQUIRED VENTILATION SHALL BE MAINTAINED. PROVIDE INSULATION STOP SUCH THAT INSULATION DOES NOT OBSTRUCT FREE AIR MOVEMENT AS REQUIRED BY THE BUILDING OFFICIAL.

ALL OVERLAP FRAMED ROOF AREAS SHALL HAVE OPENINGS BETWEEN THE ADJACENT ATTICS IN THE ROOF SHEATHING (AS ALLOWED BY THE STRUCTURAL ENGINEER) TO ALLOW PASSAGE AND ATTIC VENTILATION BETWEEN THE TWO OR ISOLATED ATTIC SPACES SHALL BE VENTED INDEPENDENTLY TO CBC REQUIREMENTS.

PER DEVELOPER, AT ALL CANTILEVERED FLOORS, CANTILEVERED ARCHITECTURAL POP-OUTS, AND ANY DOUBLE FRAMING PROJECTIONS THAT ARE SEPARATED FROM THE VENTING CALCULATIONS SHOWN ABOVE, PROVIDE A CONTINUOUS 2" CORROSION RESISTANT SOFFIT VENT AT UNDERSIDE OF FRAMED ELEMENT.

(PER SECTION R302.2)

1 SQUARE INCH VENT FOR EVERY 300 SQUARE INCHES OF CEILING  
\*144 SQ. IN. = 1 SQ. FT.  
BLDG. CEILING (SF) X 144 = BLDG (SQ. IN.)  
BLDG. (SQ. IN.) / 300 = SQ. IN. OF VENT REQUIRED  
SQ. IN. OF VENT REQUIRED / 2 = 50% AT HIGH & 50% AT LOW.


ROOF AREA 1: = 1488 SF  
1488 SQ. FT. X 144 = 214272 SQ. IN.  
214272 SQ. FT. / 300 = 714.24 SQ. IN. OF VENT REQ'D  
714.24 SQ. IN. / 2 = 357.12 SQ. IN.  
357.12 SQ. IN. OF VENT AT HIGH & 357.12 SQ. IN. OF VENT AT LOW REQUIRED.

ROOF AREA 2: = 34 SF  
34 SQ. FT. X 144 = 5616 SQ. IN.  
5616 SQ. FT. / 300 = 18.72 SQ. IN. OF VENT REQ'D  
18.72 SQ. IN. / 2 = 9.36 SQ. IN.  
9.36 SQ. IN. OF VENT AT HIGH & 9.36 SQ. IN. OF VENT AT LOW REQUIRED.

ROOF AREA 3: = 180 SF  
180 SQ. FT. X 144 = 25920 SQ. IN.  
25920 SQ. FT. / 300 = 86.40 SQ. IN. OF VENT REQ'D  
86.40 SQ. IN. / 2 = 43.20 SQ. IN.  
43.20 SQ. IN. OF VENT AT HIGH & 43.20 SQ. IN. OF VENT AT LOW REQUIRED.

BUILDER TO PROVIDE (2) LAYERS OF UNDERLAYMENT AT ANY ROOF W/ A SLOPE FROM 2:12 TO LESS THAN 4:12

AT SINGLE FAMILY DETACHED PLANS:  
PREFINISHED VENTED  
SOFFIT AT EAVE PER MANUFACTURER.  
(VERIFY FIRE SEPARATION DISTANCE FOR  
SOFFIT PROTECTION PER NCRC  
SECTION R302.1.1 AND TABLE R302.1)

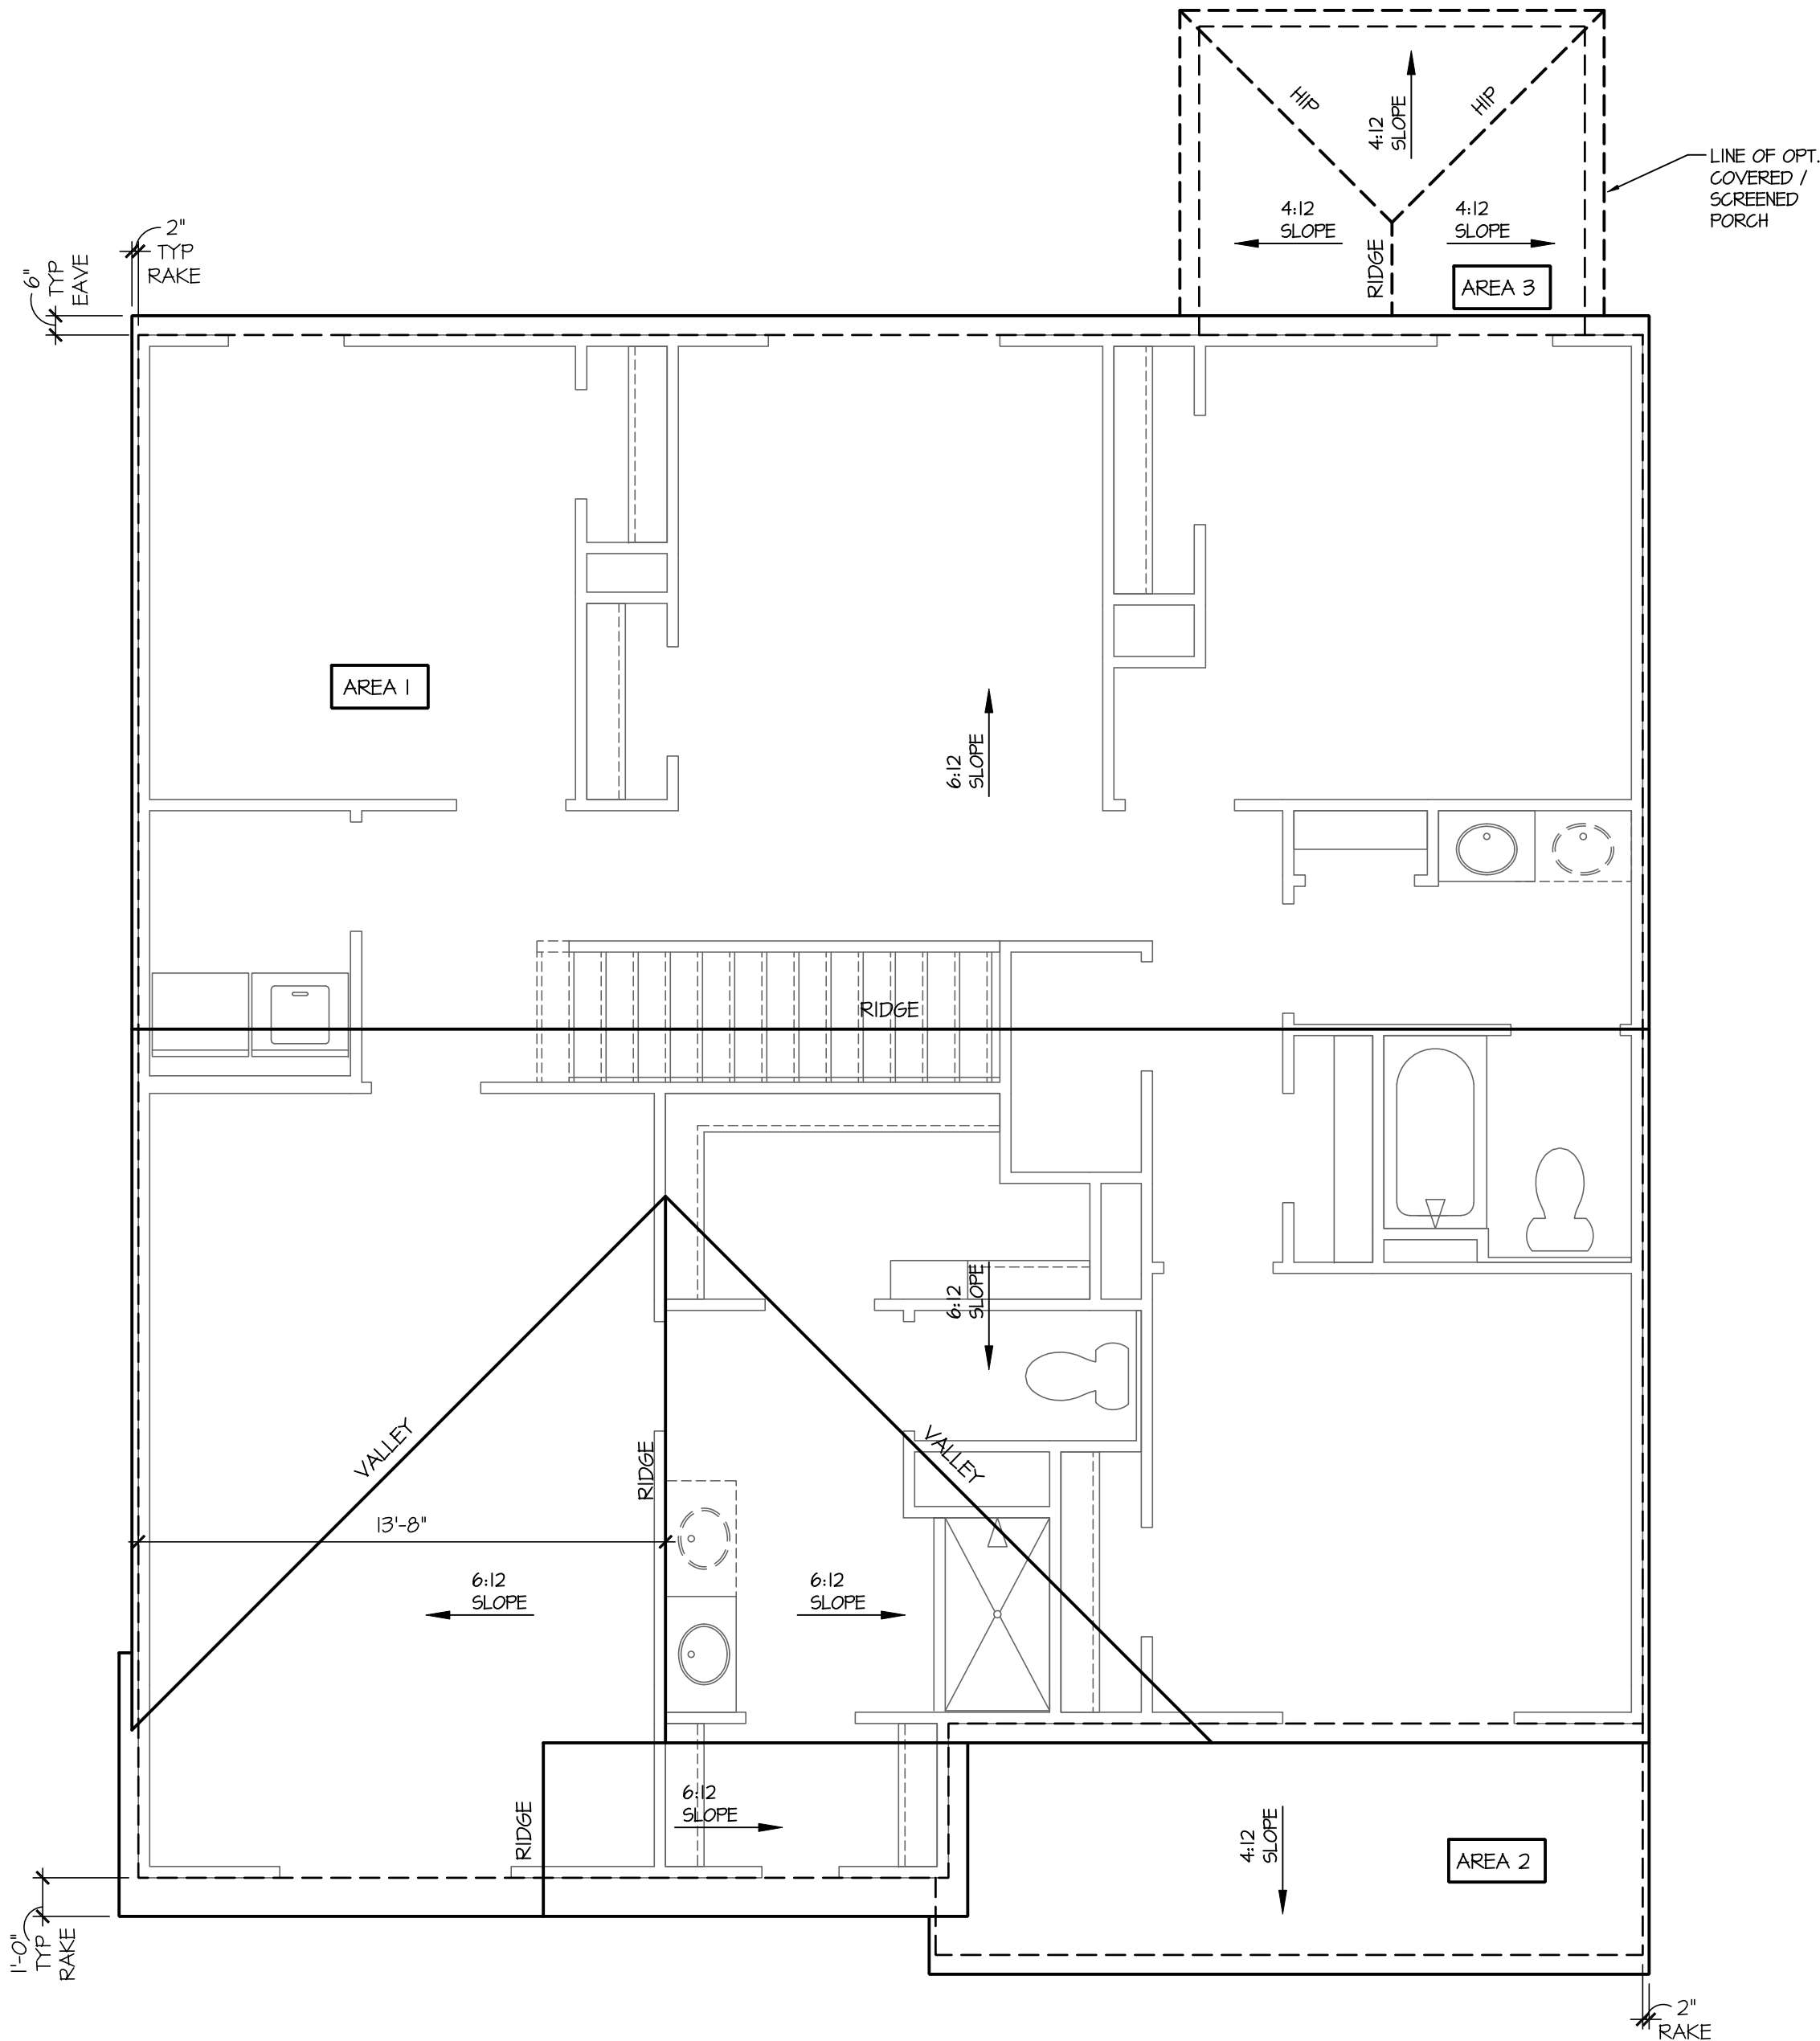

Roof Plan 'K'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X17" LAYOUT

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 09.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:

**D-R-HORTON**  
America's Builder  
10000 Woodbridge Blvd., Charlotte, NC 28277 704.271.1000

PROJECT NO: GMD17049

SHEET TITLE:

'HAYDEN'  
ROOF PLAN  
'4EPF-K'

PRINT DATE:

January 22, 2021

SHEET NO:

1.1 K

FOR  
CONSTRUCTION

NOTES:

- GRADE CONDITIONS MAY VARY FOR INDIVIDUAL SITE FROM THAT SHOWN. BUILDER SHALL VERIFY AND COORDINATE PER ACTUAL SITE CONDITIONS.

- WINDOW HEAD HEIGHTS:  
1ST FLOOR = 6'-8" U.N.O. ON ELEVATIONS.  
2ND FLOOR = 7'-0" U.N.O. ON ELEVATIONS.

- ROOFING: PITCHED SHINGLES PER DEVELOPER.

- WINDOWS: MANUFACTURER PER DEVELOPER. DIVIDED LITES AS SHOWN ON THE EXTERIOR ELEVATIONS

- ENTRY DOOR: AS SELECTED BY DEVELOPER.

- GARAGE DOORS: AS SELECTED BY DEVELOPER, RAISED PANEL AS SHOWN.

- ALL EXTERIOR MATERIALS TO BE INSTALLED PER MANUFACTURER'S WRITTEN INSTRUCTIONS.

- PROTECTION AGAINST DECAY:  
(ALL PORTIONS OF A PORCH, SCREEN PORCH OR DECK FROM THE BOTTOM OF THE HEADER DOWN, INCLUDING POST, RAILS, PICKETS, STEPS AND FLOOR STRUCTURE.)

- INSULATION: PER TABLE N102.1.2.  
EXTERIOR WALLS: R-15 BATTS MINIMUM. VERIFY  
CEILING WITH ATTIC ABOVE: R-30 BATTS MINIMUM. VERIFY  
FLOOR OVER GARAGE: R-14 BATTS MINIMUM. VERIFY  
ATTIC KNEEWALL: R-14 BATTS MINIMUM. VERIFY  
CRAWL SPACE FLOORING: R-14 BATTS MINIMUM. VERIFY

KEY NOTES:

MASONRY:  
1 ADHERED STONE VENEER AS SELECTED BY DEVELOPER. HEIGHT AS NOTED.  
2 MASONRY FULL BRICK AS SELECTED BY DEVELOPER. HEIGHT AS NOTED.  
3 MASONRY FULL STONE AS SELECTED BY DEVELOPER. HEIGHT AS NOTED.  
4 8" SOLDIER COURSE.  
5 ROWLOCK COURSE  
6 NA

TYPICALS:  
7 CORROSION RESISTANT SCREEN LOUVERED VENTS, SIZE AS NOTED.  
8 CODE APPROVED TERMINATION CHIMNEY CAP.  
9 CORROSION RESISTANT ROOF TO WALL FLASHING. CODE COMPLIANT FLASHING PER NCRG R305.2.8.3

10 STANDING SEAM METAL ROOF, INSTALL PER MANUFACTURER'S WRITTEN INSTRUCTIONS.  
11 DECORATIVE WROUGHT IRON. SEE DETAILS.

SIDING:  
12 VINYL SHAKE SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER.  
(AT SPECIFIED LOCATIONS:  
FIBER CEMENT SHAKE SIDING PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)  
13 VINYL LAP SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER.  
(AT SPECIFIED LOCATIONS:  
FIBER CEMENT LAP SIDING PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)  
14 VINYL NAVY SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER.  
(AT SPECIFIED LOCATIONS:  
FIBER CEMENT NAVY SIDING PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)  
15 VINYL BOARD AND BATT SIDING PER DEVELOPER WITH VINYL CORNER TRIM PER DEVELOPER.  
(AT SPECIFIED LOCATIONS:  
FIBER CEMENT PANEL SIDING W/ 1X3 BATTS AT 12" O.C. PER DEVELOPER W/ 1X4 CORNER TRIM BOARD.)  
16 VINYL TRIM SIZE AS NOTED  
(AT SPECIFIC LOCATIONS:  
1X FIBER CEMENT TRIM OR EQUAL, U.N.O. SIZE AS NOTED  
17 FYPON SHUTTERS, TYPE AS SHOWN. SIZE AS NOTED.  
(AT SPECIFIC LOCATIONS: FALSE VINYL SHUTTERS, TYPE AS SHOWN. SIZE AS NOTED.)

ALL WINDOWS WHOSE OPENING IS LESS THAN 24" ABOVE THE FINISH FLOOR AND WHOSE OPENING IS GREATER THAN 12" ABOVE THE OUTSIDE WALKING SURFACE MUST HAVE WINDOW OPENING LIMITING DEVICES COMPLYING WITH THE NCRG SECTION R312.2.1 AND R312.2.2.

AVAILABLE WITH OPTIONAL  
9'-1" FIRST FLOOR PLATE

NOTES AT OPT 9'-1" PLT:  
- WDW HT SET AT 7'-6"  
- INTERIOR SOFFITS AT 8'-0"  
- EXTERIOR SOFFITS AT 8'-0"

Left Elevation 'K'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X17" LAYOUT

Right Elevation 'K'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X17" LAYOUT

Rear Elevation 'K'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X17" LAYOUT

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 01.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:

PROJECT NO: GMD17049

SHEET TITLE:  
'HAYDEN'  
EXTERIOR  
ELEVATIONS  
'4EPF-K'


PRINT DATE:  
January 22, 2021

SHEET NO:

2 K

FOR  
CONSTRUCTION

- NOTES FOR NORTH CAROLINA:
- IRRIGATION SYSTEM SHALL BE DESIGNED TO PREVENT THE SATURATION OF SOIL ADJACENT TO BUILDING.
  - THIS PERIMETER DIMENSION PLAN IS FOR DIMENSIONAL INFORMATION ONLY.
  - SLOPE ALL STOOPS AND HARDSCAPE MATERIAL AWAY FROM BUILDING - TYPICAL.
  - SLOPE GARAGE FLOOR 1/8" PER FOOT TO GARAGE DOOR OPENING.
  - VERIFY CURB CUT BLOCKOUT WITH GARAGE DOOR MANUFACTURER.
  - REFER TO CIVIL DRAWINGS FOR FINISH SURFACE ELEVATIONS.
  - FINISH GRADE SHALL PROVIDE POSITIVE DRAINAGE AWAY FROM BUILDING. REFER TO SOILS REPORT FOR ANY SPECIFIC REQUIREMENTS.
  - REFER TO STRUCTURAL DRAWINGS FOR HOLDDOWNS, FOOTING DETAILS, CURB THICKNESS, AND INFORMATION NOT SHOWN ON THIS PLAN.
  - PLUMBING FIXTURES, VENT LOCATIONS, ETC. ARE APPROXIMATE. CONTRACTOR TO VERIFY COUNT AND LOCATION.
  - VERIFY THE SUPPLY FOR SEPARATE CONDUITS TO ANY ISLAND FOR GAS, WATER OR ELECTRIC.
  - VERIFY ALL DOOR THRESHOLD HEIGHTS TO HARD SURFACES.  
8 1/4" MAX AT INSURING DOORS. (PER NCRG SECTION R311.3.1)
  - TYP STOOP AT INSURING/SLIDER DOORS: 36" DEEP BY THE WIDTH OF THE DOOR SERVED, MINIMUM. (PER NCRG SECTION R311.3) PROVIDE A SLIP-RESISTANT FINISH.
  - FOR THE USE OF EXPOSED GAS WATER HEATERS IN THE GARAGE, PROTECT THE WATER HEATER WITH 3" DIA CONCRETE FILLED STEEL PIPE EMBEDDED INTO CONCRETE FOOTING.
  - SOILS TREATMENT:  
BORACARE TERMITE TO BE APPLIED TO FRAMING PER PRODUCT SPECIFICATIONS.  
(PROVIDE CHEMICAL TREATMENT FOR PROTECTION FROM TERMITE INVESTATION ACCORDING TO THE STANDARDS OF THE NC DEPT OF AGRICULTURE)
  - WOOD CONTACTING CONCRETE OR MASONRY OR LESS THAN CODE REQUIRED SEPARATION TO GRADE SHALL BE PRESSURE TREATED OR FOUNDATION GRADE REDWOOD. SET ALL EXTERIOR WALL SILLS IN MASTIC.

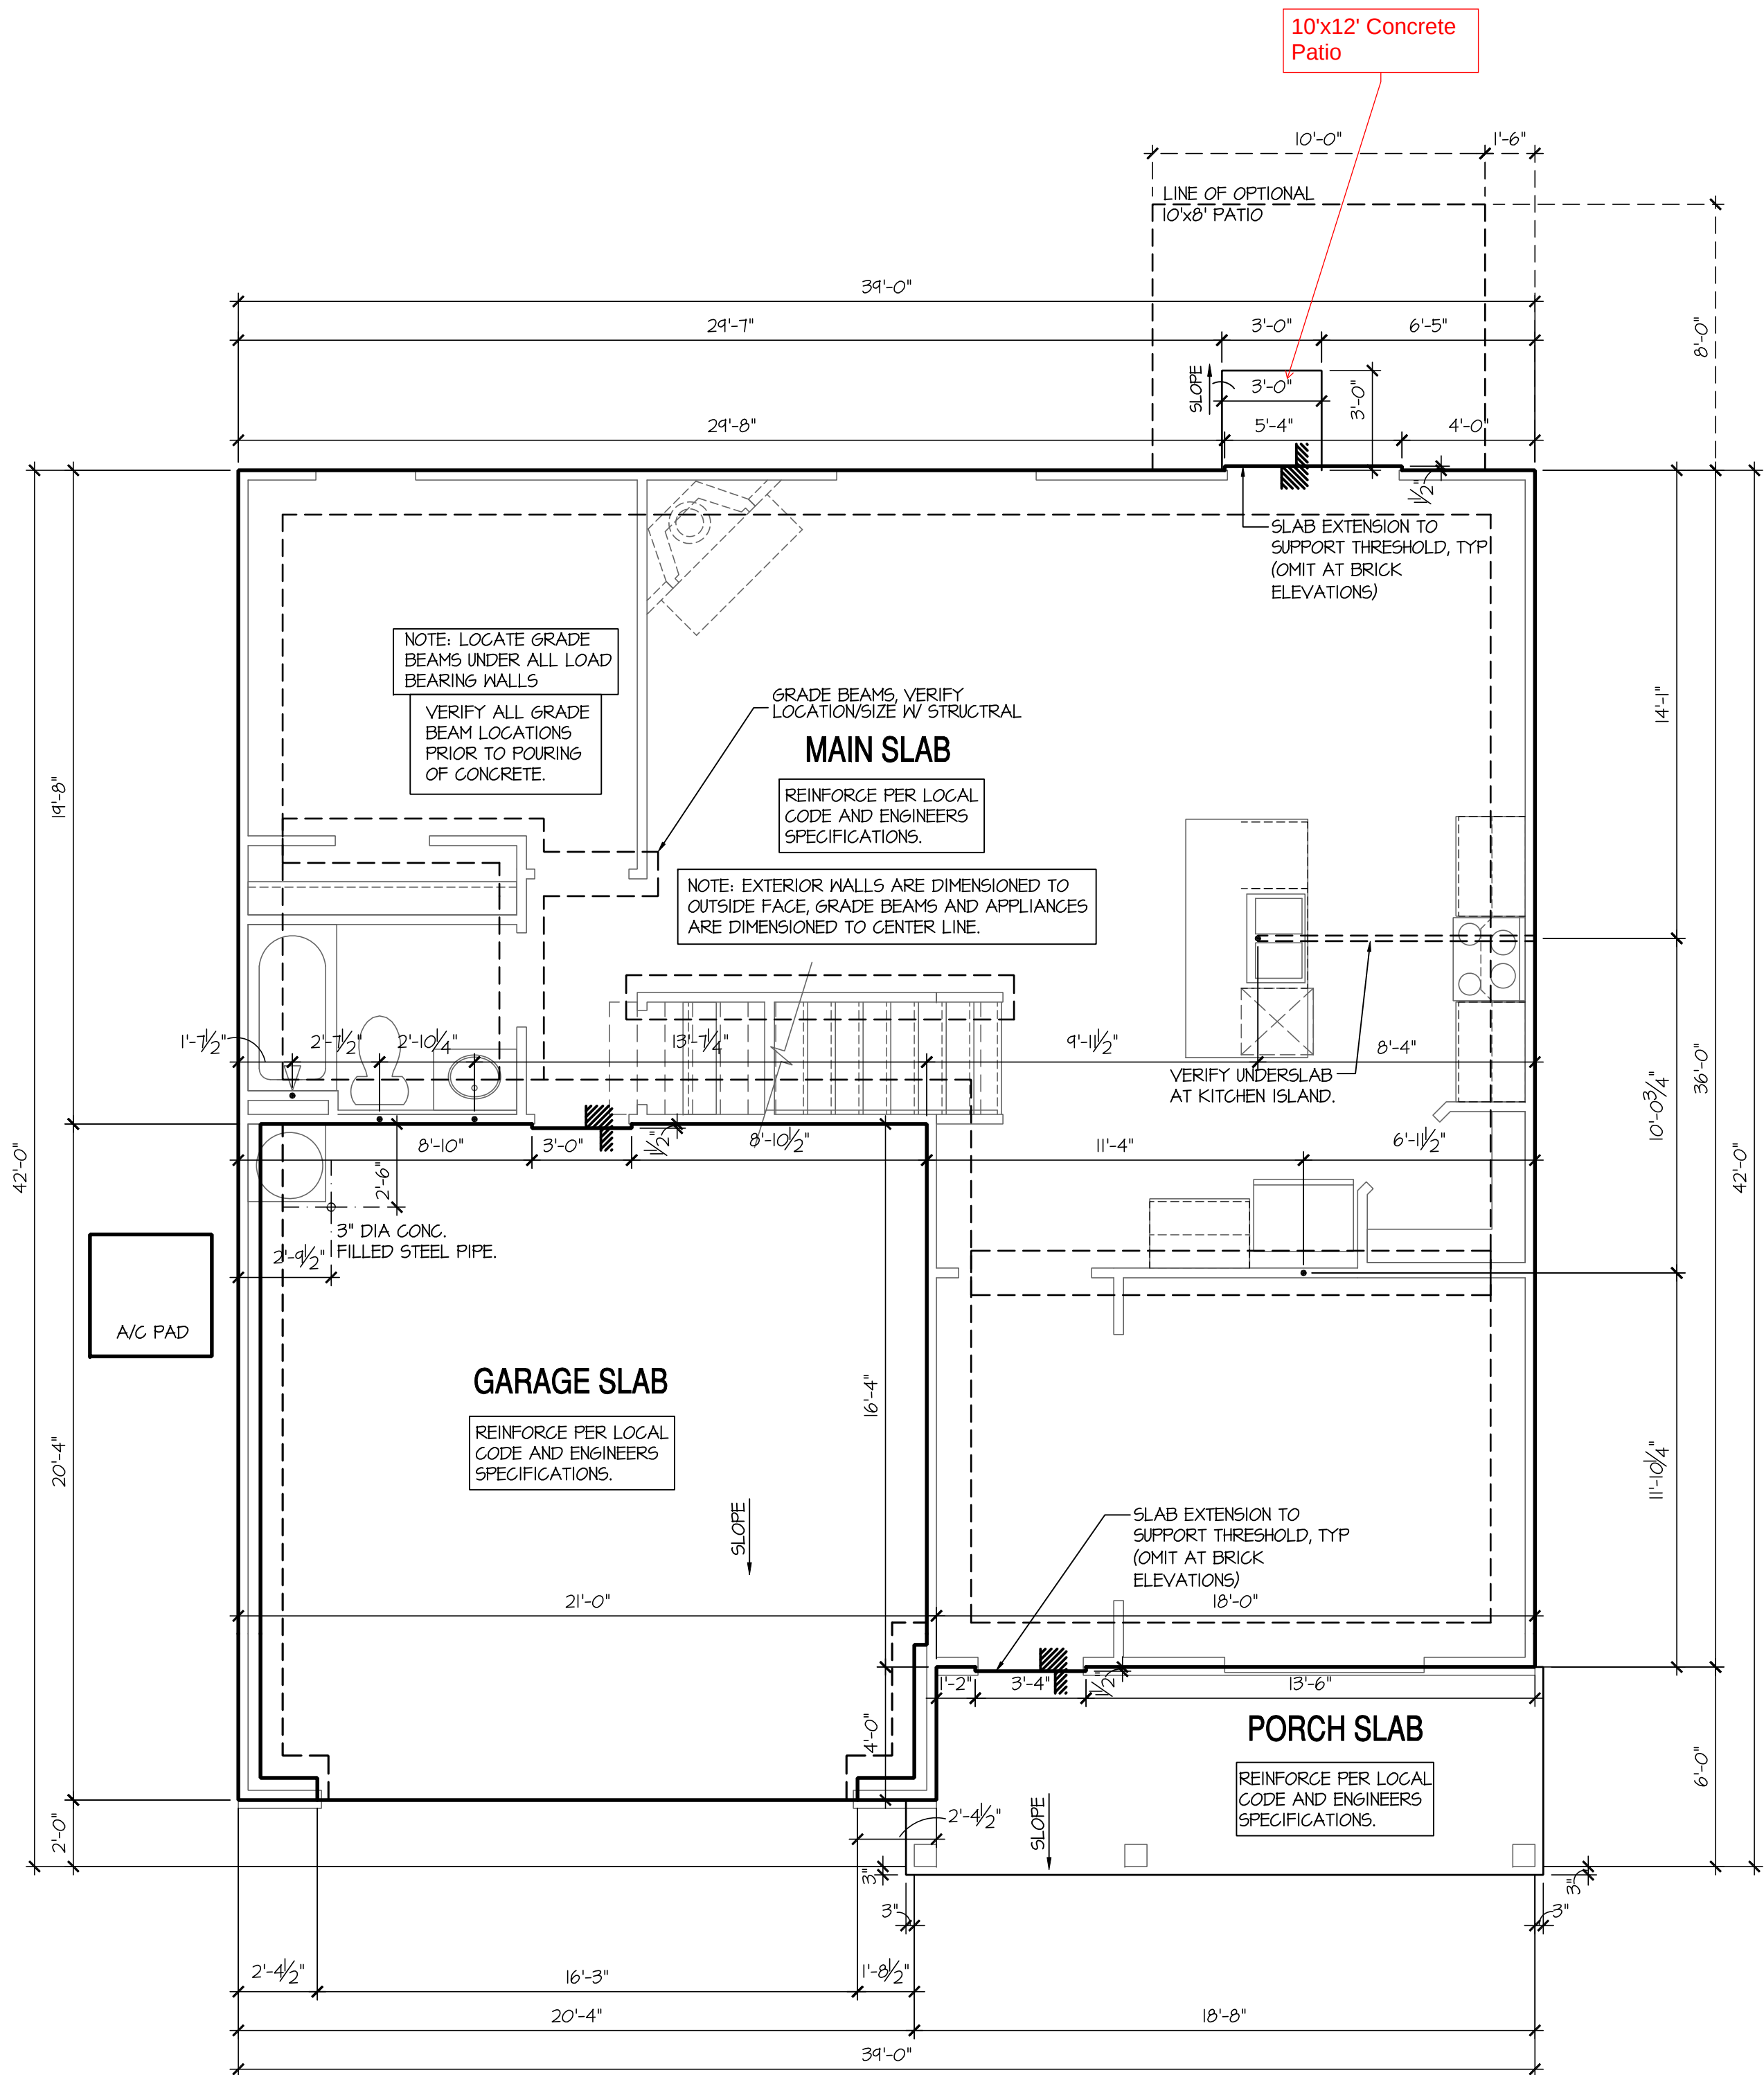

Monolithic Slab Plan 'K'

SCALE: 1/4"=1'-0" AT 22"x34" LAYOUT 1/8"=1'-0" AT 11"x11" LAYOUT

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 09.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:

**D-R-HORTON**  
*America's Builder*  
With Knowledge, Skill, Creativity, We Build Your Vision

PROJECT NO: GMD17049

SHEET TITLE:

'HAYDEN'  
MONOLITHIC  
SLAB  
PLAN '4EPF-K'

PRINT DATE:

January 22, 2021

SHEET NO:

3 MS K




FOR  
CONSTRUCTION


|                                                                                                                                                                      |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>8'-9 1/2" STAIR NOTE:</b><br>(USE 14" T.J.I WITH 3/4" PLYWOOD SUBFLOOR)<br>15 TREADS AT 10" EACH VERIFY<br>16 RISERS AT +/- 7.50" = 120 1/4" TOTAL<br>RISE VERIFY |
| <b>9'-1" STAIR NOTE:</b><br>(USE 14" T.J.I WITH 3/4" PLYWOOD SUBFLOOR)<br>16 TREADS AT 10" EACH VERIFY<br>17 RISERS AT +/- 7.27" = 123 3/4" TOTAL<br>RISE VERIFY     |
| <b>8'-1" STAIR NOTE:</b><br>(USE 14" T.J.I WITH 3/4" PLYWOOD SUBFLOOR)<br>14 TREADS AT 10" EACH VERIFY<br>15 RISERS AT +/- 7.45" = 111 3/4" TOTAL<br>RISE VERIFY     |

- FOR ADDITIONAL NOTES SEE GENERAL NOTES ON TITLE SHEET AND DETAILS.  
- WINDOW HEAD HEIGHTS:  
1ST FLOOR = 6'-8" U.N.O. ON ELEVATIONS.  
2ND FLOOR = 7'-0" U.N.O. ON ELEVATIONS.

ALL DIMENSIONS TO WINDOWS AND DOORS ARE TO CENTERLINE.

WALL LEGEND:

|                                                                                                                                              |                                                                                                                                        |
|----------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------|
|  FULL HEIGHT<br>2X4 WOOD STUD PARTITION                 |  FULL HEIGHT<br>2X6 WOOD STUD PARTITION           |
|  BRICK / STONE VENEER                                   |  STUD WALL BELOW<br>HEIGHT AND STUD SIZE AS NOTED |
|  LOW GYPSUM BOARD WALL<br>HEIGHT AND STUD SIZE AS NOTED |  DRYWALL OPENING, HEIGHT<br>AS NOTED ON PLAN.     |

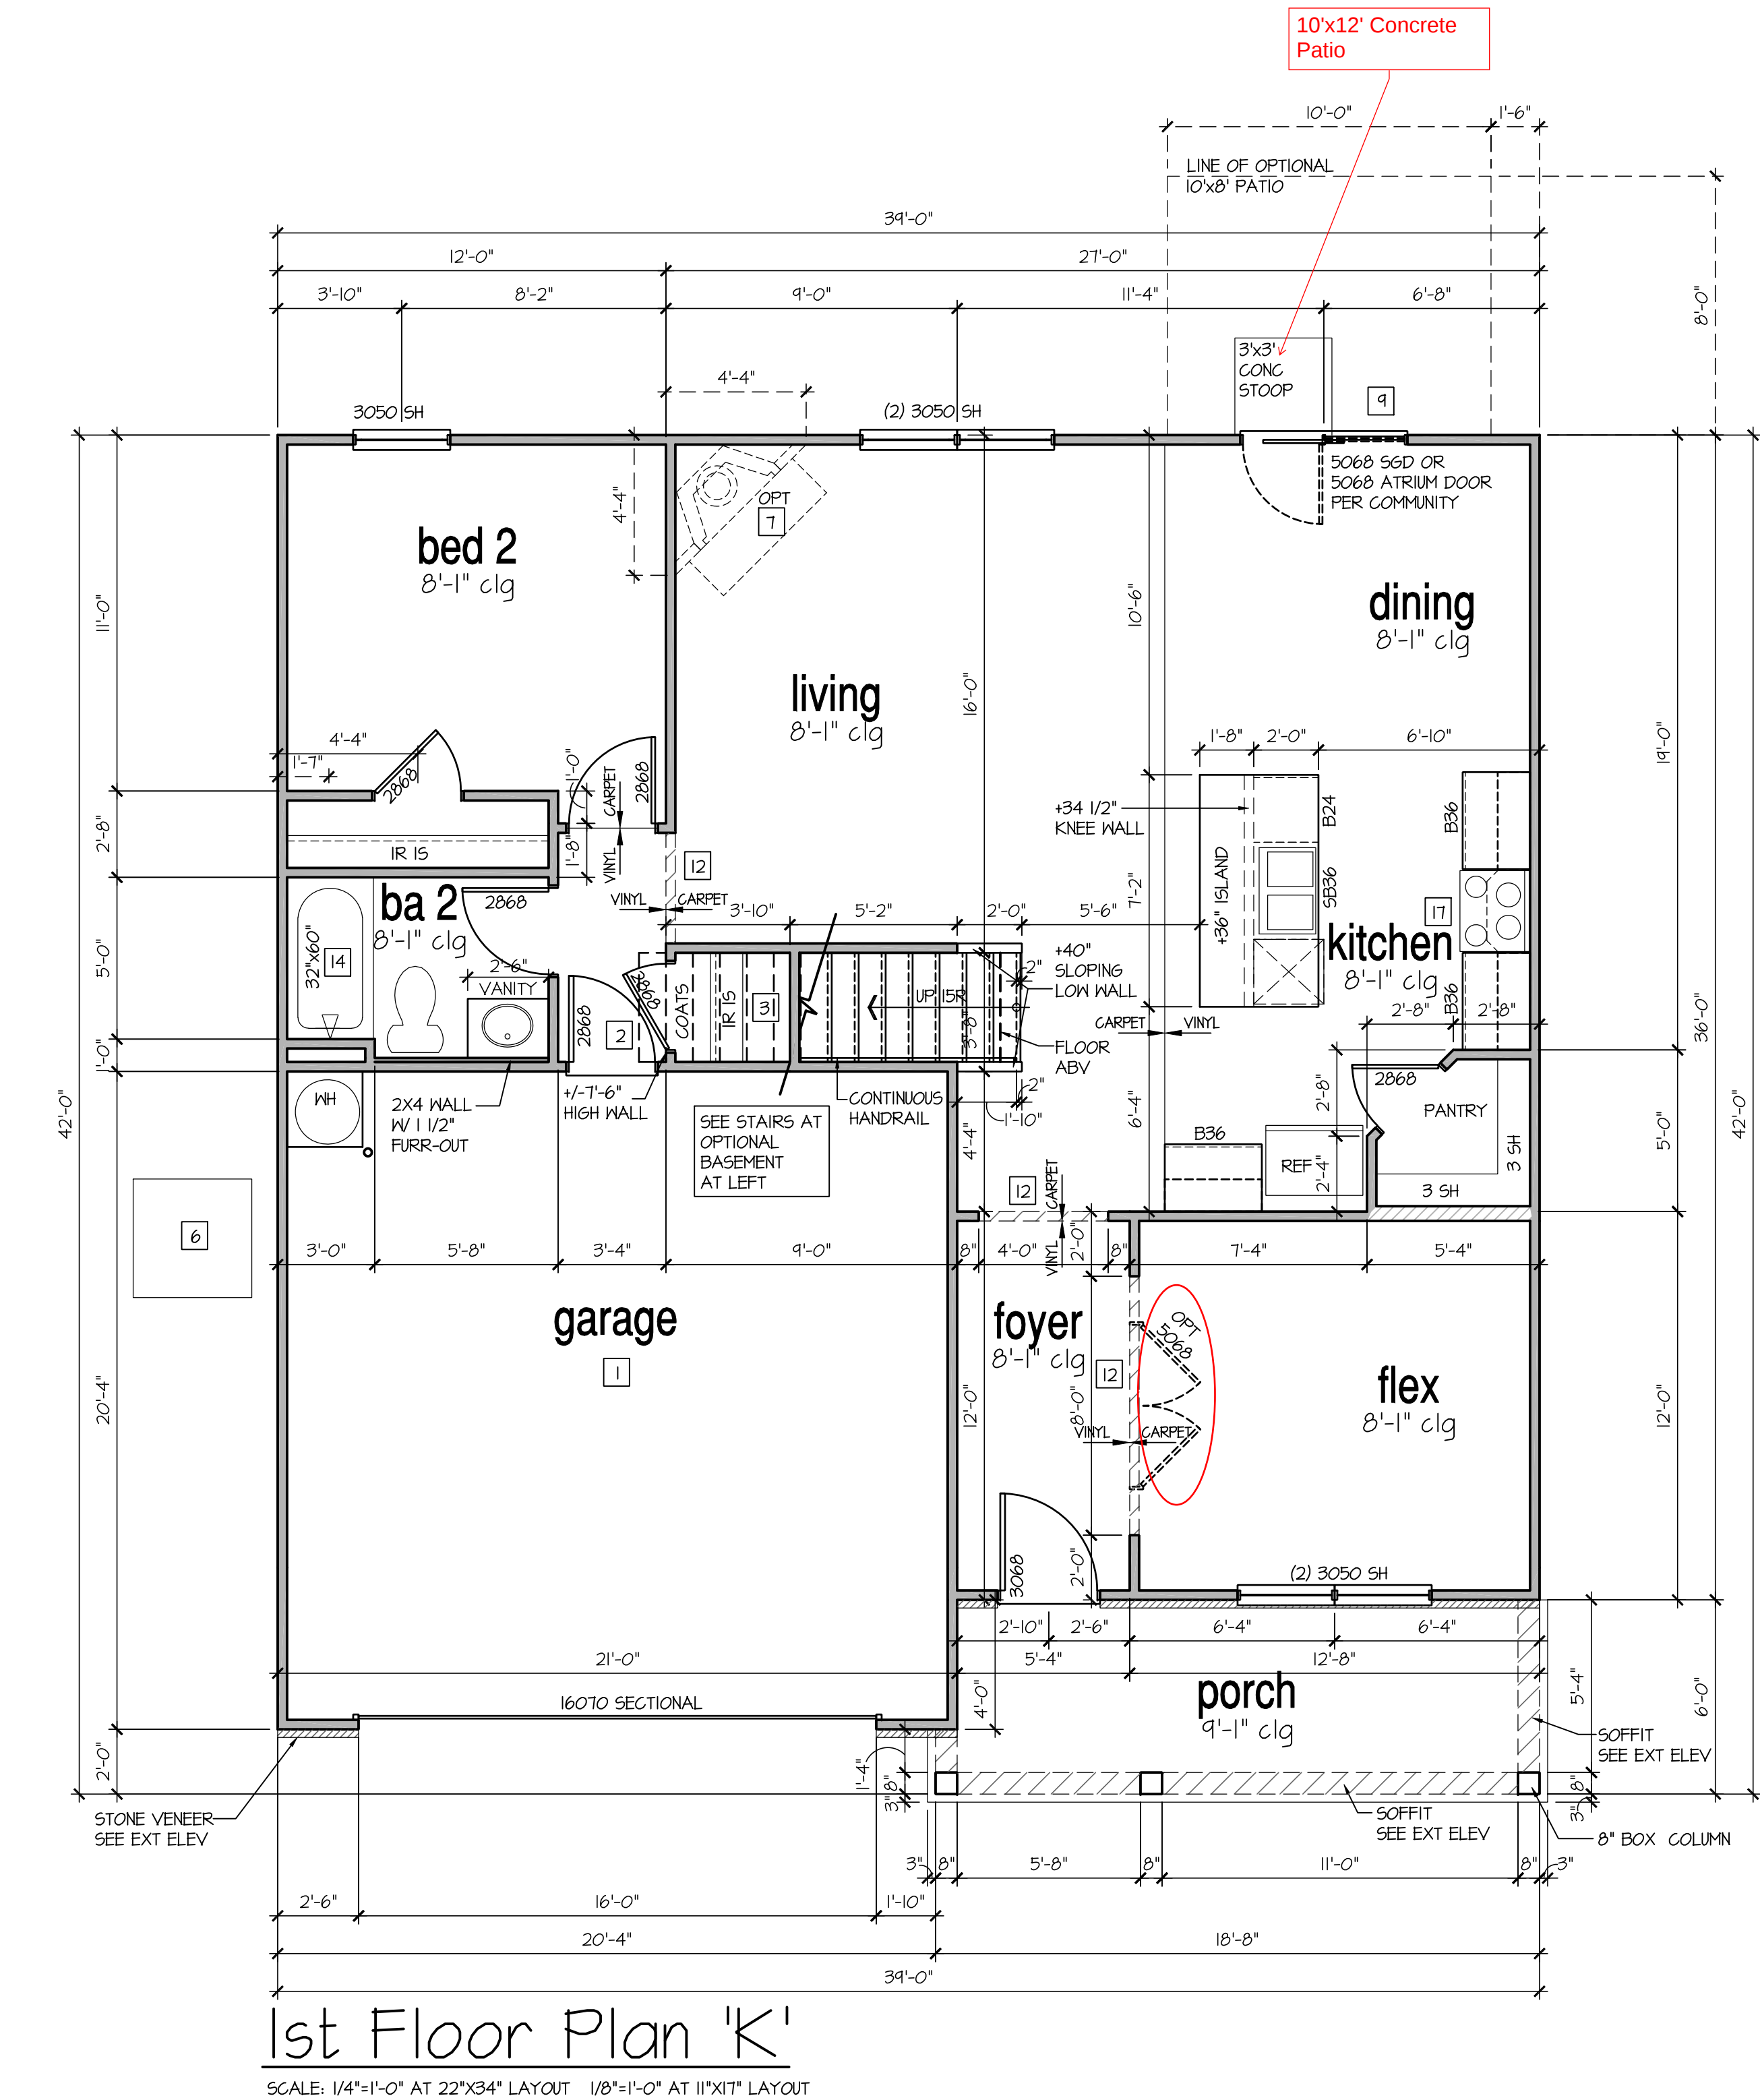

KEY NOTES FOR NORTH CAROLINA:

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p><b>FIRE PROTECTION:</b></p> <p>[1] HOUSE TO GARAGE FIRE SEPARATION. GARAGE/HOUSE SEPARATION AT VERTICAL SURFACES SHALL BE PROTECTED WITH ONE (1) LAYER 1/2" GYPSUM BOARD. (PER NCRC TABLE R302.6.)</p> <p>[2] HOUSE TO GARAGE DOOR SEPARATION. PROVIDE 1-3/8" SOLID CORE DOOR OR APPROVED 20 MINUTE RATED DOOR. (PER NCRC SECTION R302.5.1.)</p> <p>[3] BENEATH STAIRS AND LANDINGS, 1/2" GYPSUM BOARD ON WALLS AND CEILING OF ENCLOSED ACCESSIBLE AREAS. (PER NCRC SECTION R302.1.) IN CONCEALED SPACES BETWEEN STAIR STRINGERS PROVIDE FIREBLOCKING PER R302.11</p> <p>[4] GAS WATER HEATER ON 18" HIGH PLATFORM. (PER CHAPTER 5 NCRC-PLUMBING)</p> | <p>[5] FAN 8'X8' PLATFORM. VERIFY WITH TRUSS MANUFACTURER. (6'-6" MIN. CLEAR HEIGHT TO HORIZONTAL MEMBERS, 2"X6" OVER 2"X4" BOTTOM CHORD, OF TRUSS, VERIFY W/ TRUSSES.)</p> <p>[6] A/C CONDENSER PAD. (VERIFY)</p> <p>[7] PRE-FABRICATED METAL FIREPLACE. INSTALL PER MANUFACTURER'S WRITTEN INSTRUCTIONS.</p> <p>[8] ATTIC ACCESS LARGE ENOUGH TO REMOVE LARGEST PIECE OF EQUIPMENT BUT NOT LESS THAN 30"x22". FIRE RATED ACCESS AS NOTED. (PER NCRC 801.1) ATTIC ACCESS LADDER. VERIFY LOCATION AND SIZE WITH TRUSSES. (25 1/2" X 54" SIZE) FOR GARAGE TO ATTIC SEPARATION PER NCRC 302.5.1 EXCEPTION.</p> <p>TYPICALS:</p> <p>[9] TEMPERED SAFETY GLASS. (PER NCRC SECTION 308.4)</p> <p>[10] PLYWOOD SHELF ABOVE WITH DRYWALL FINISH OVER. HEIGHT AS NOTED.</p> <p>[11] HALF WALL, HEIGHT AS NOTED.</p> | <p>[12] INTERIOR SOFFITS: FFL = 8'-1" U.N.O. SFL = 7'-6" U.N.O.</p> <p>BATHS:</p> <p>[13] SHOWER. TEMPERED GLASS ENCLOSURE.</p> <p>[14] TUB-SHOWER COMBO. TEMPERED GLASS ENCLOSURE.</p> <p>[15] CERAMIC TILE SHOWER AND FLOOR. TEMPERED GLASS ENCLOSURE.</p> <p>KITCHEN:</p> <p>[16] ACRYLIC TUB W/ CERAMIC PLATFORM</p> <p>[17] 30" SLIDE-IN ELECTRICAL RANGE W/ HOOD AND MICRO ABV. VENT PER MANUFACTURER'S WRITTEN INSTRUCTIONS.</p> <p>[18] 30" GAS COOKTOP AND HOOD. VENT PER MANUFACTURER'S WRITTEN INSTRUCTIONS.</p> <p>[19] ELECTRIC OVEN WITH MICROWAVE OVEN.</p> |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 09.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:



PROJECT NO: GMD17049

SHEET TITLE:  
**'HAYDEN'**  
**1st FLOOR**  
**PLAN '4EPF-K'**


PRINT DATE:  
January 22, 2021

SHEET NO:  
**4 K**

FOR  
CONSTRUCTION

9'-1" STAIR NOTE:  
(USE 14" T.J. WITH 3/4" PLYWOOD SUBFLOOR)  
16 TREADS AT 10" EACH VERIFY  
17 RISERS AT +/- 1.27" = 123 3/4" TOTAL  
RISE VERIFY

8'-1" STAIR NOTE:  
(USE 14" T.J. WITH 3/4" PLYWOOD SUBFLOOR)  
14 TREADS AT 10" EACH VERIFY  
15 RISERS AT +/- 1.45" = 111 3/4" TOTAL  
RISE VERIFY

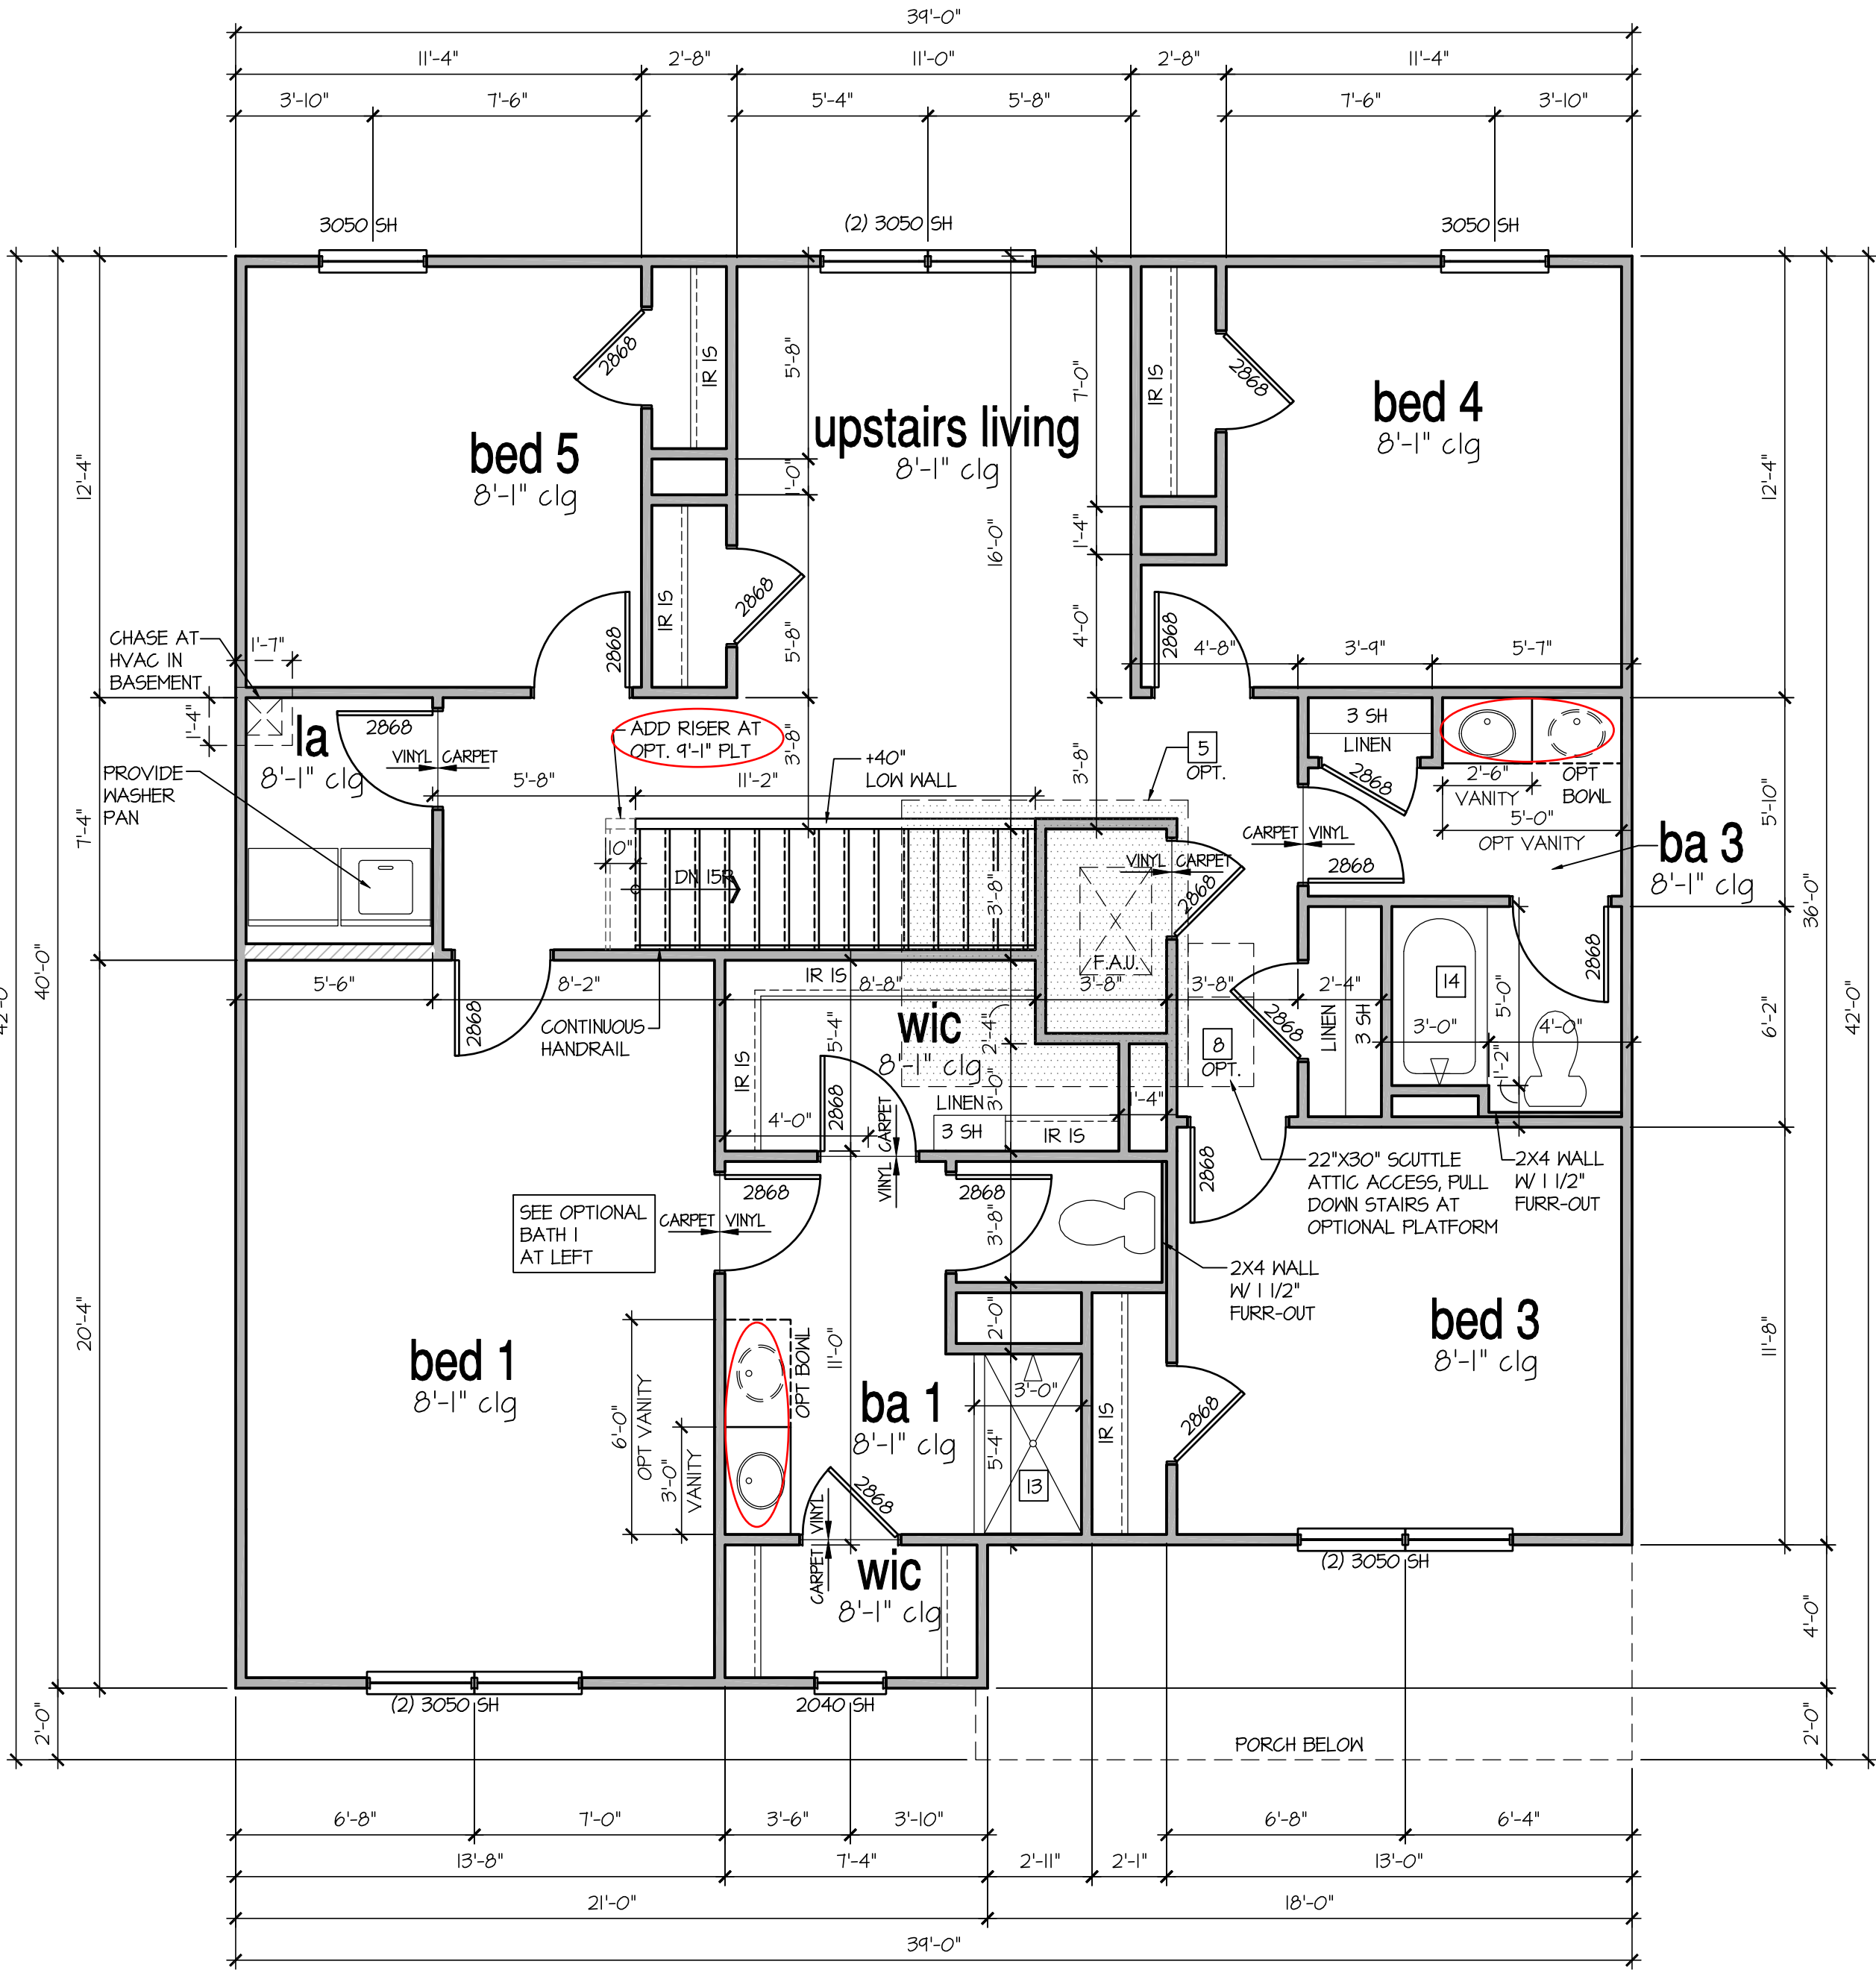

2nd Floor Plan 'K'

SCALE: 1/4"=1'-0" AT 22"x34" LAYOUT 1/8"=1'-0" AT 11"x17" LAYOUT

- FOR ADDITIONAL NOTES SEE GENERAL NOTES ON TITLE SHEET AND DETAILS.
- WINDOW HEAD HEIGHTS:  
1ST FLOOR = 6'-8" U.N.O. ON ELEVATIONS.  
2ND FLOOR = 7'-0" U.N.O. ON ELEVATIONS.

ALL DIMENSIONS TO WINDOWS AND DOORS ARE TO CENTERLINE.

WALL LEGEND:

|                                                        |                                                  |
|--------------------------------------------------------|--------------------------------------------------|
| FULL HEIGHT<br>2X4 WOOD STUD PARTITION                 | FULL HEIGHT<br>2X6 WOOD STUD PARTITION           |
| BRICK / STONE VENEER                                   | STUD WALL BELOW<br>HEIGHT AND STUD SIZE AS NOTED |
| LOW GYPSUM BOARD WALL<br>HEIGHT AND STUD SIZE AS NOTED | DRYWALL OPENING. HEIGHT<br>AS NOTED ON PLAN.     |

KEY NOTES FOR NORTH CAROLINA:

- FIRE PROTECTION:

  - [1] HOUSE TO GARAGE FIRE SEPARATION. GARAGE/HOUSE SEPARATION AT VERTICAL SURFACES SHALL BE PROTECTED WITH ONE (1) LAYER 1/2" GYPSUM BOARD. (PER NCRG TABLE R302.6.)
  - [2] HOUSE TO GARAGE DOOR SEPARATION. PROVIDE 1-3/8" SOLID CORE DOOR OR APPROVED 20 MINUTE RATED DOOR. (PER NCRG SECTION R302.5.1.)
  - [3] BENEATH STAIRS AND LANDINGS, 1/2" GYPSUM BOARD ON WALLS AND CEILING OF ENCLOSED ACCESSIBLE AREAS. (PER NCRG SECTION R302.1.) IN CONCEALED SPACES BETWEEN STAIR STRINGERS PROVIDE FIREBLOCKING PER R302.11 MEPS.
  - [4] GAS WATER HEATER ON 18" HIGH PLATFORM. (PER CHAPTER 5 NCRG-PLUMBING)
- [5] FAU 8'X8' PLATFORM. VERIFY WITH TRUSS MANUFACTURER. (6'-6" MIN. CLEAR HEIGHT TO HORIZONTAL TRUSSES, 2"x6" OVER 2"x4" BOTTOM CHORD, OF TRUSS, VERIFY W/ TRUSSES.)
  - [6] A/C CONDENSER PAD. (VERIFY)
  - [7] PRE-FABRICATED METAL FIREPLACE. INSTALL PER MANUFACTURER'S WRITTEN INSTRUCTIONS.
  - [8] ATTIC ACCESS LARGE ENOUGH TO REMOVE LARGEST PIECE OF EQUIPMENT BUT NOT LESS THAN 30"x22". FIRE RATED ACCESS AS NOTED. (PER NCRG 801.1) ATTIC ACCESS LADDER. VERIFY LOCATION AND SIZE WITH TRUSSES. (25 1/2" X 54" SIZE) FOR GARAGE TO ATTIC SEPARATION PER NCRG 302.5.1 EXCEPTION.
  - TYPICALS:
    - [9] TEMPERED SAFETY GLASS. (PER NCRG SECTION 308.4)
    - [10] PLYWOOD SHELF ABOVE WITH DRYWALL FINISH OVER. HEIGHT AS NOTED.
    - [11] HALF WALL, HEIGHT AS NOTED.
- [12] INTERIOR SOFFITS: FFL = 8'-1" U.N.O. SFL = 7'-6" U.N.O. BATHS:
    - [13] SHOWER. TEMPERED GLASS ENCLOSURE.
    - [14] TUB-SHOWER COMBO. TEMPERED GLASS ENCLOSURE.
    - [15] CERAMIC TILE SHOWER AND FLOOR. TEMPERED GLASS ENCLOSURE.
  - [16] ACRYLIC TUB W/ CERAMIC PLATFORM
  - KITCHEN:
    - [17] 30" SLIDE-IN ELECTRICAL RANGE W/ HOOD AND MICRO ABV. VENT PER MANUFACTURER'S WRITTEN INSTRUCTIONS.
    - [18] 30" GAS COOKTOP AND HOOD. VENT PER MANUFACTURER'S WRITTEN INSTRUCTIONS.
    - [19] ELECTRIC OVEN WITH MICROWAVE OVEN.

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
|     | 09.06.23 |                 |
|     | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:



PROJECT NO: GMD17049

SHEET TITLE:  
**'HAYDEN'**  
**2nd FLOOR**  
**PLAN '4EPF-K'**

PRINT DATE:  
January 22, 2021

SHEET NO:

5 K

FOR  
CONSTRUCTION

**9'-1" STAIR NOTE:**  
(USE 14" TJI WITH 3/4" PLYWOOD SUBFLOOR)  
16 TREADS AT 10" EACH VERIFY  
11 RISERS AT +/- 7.21" = 123 3/4" TOTAL  
RISE VERIFY


**8'-1" STAIR NOTE:**  
(USE 14" TJI WITH 3/4" PLYWOOD SUBFLOOR)  
14 TREADS AT 10" EACH VERIFY  
15 RISERS AT +/- 7.45" = 111 3/4" TOTAL  
RISE VERIFY

NOTES:

- REFER TO FLOOR PLAN NOTES FOR TYPICAL FIRE PROTECTION NOTES AND LOCATIONS.
- THESE BUILDING SECTIONS MAY VARY AT ALTERNATE ELEVATION STYLES AND AT "PLAN OPTION" CONDITIONS. REFER TO MAIN FLOOR PLAN AND ALTERNATE FLOOR PLANS FOR INFORMATION NOT SHOWN HERE.
- BUILDING SECTIONS SHOWN HERE DEPICT VOLUMN SPACES WITHIN THE STRUCTURE. REFER TO STRUCTURAL DRAWINGS, TRUSS DRAWINGS, STRUCTURAL DETAILS AND CALCULATIONS BY OTHER FOR ALL STRUCTURAL INFO.
- ROOFING: PITCHED SHINGLE ROOF. REFER TO ROOF PLAN FOR TYPICALS.
- WOOD FLOORS: FLOOR SHEATHING OVER FLOOR JOIST. REFER TO STRUCTURAL AND TRUSS DRAWINGS BY OTHERS.
- VERIFY STAIRS MINIMUM AND MAXIMUM REQUIREMENTS FOR CONSTRUCTION CLEARANCES WITH LOCAL CODES.
- INSULATION:
  - EXTERIOR WALLS ZONE 3: R-13 BATTS MINIMUM. VERIFY
  - EXTERIOR WALLS ZONE 4: R-15 BATTS MINIMUM. VERIFY
  - CEILING WITH ATTIC ABOVE COMPRESSED INSULATION: R-38 BATTS MINIMUM. VERIFY
  - CEILING WITH ATTIC ABOVE UNCOMPRESSED INSULATION (HEELS IN TRUSSES): R-30 BATTS MINIMUM. VERIFY
  - FLOOR OVER GARAGE: R-19 BATTS MINIMUM. VERIFY
  - ATTIC KNEEWALL: R-19 BATTS MINIMUM. VERIFY
  - GRAVL SPACE FLOORING: R-19 BATTS MINIMUM. VERIFY


PER STATE RESIDENTIAL CODE  
COMPLIANCE METHOD TO BE  
DETERMINED BY BUILDER.

WINDOW GLAZING "U" FACTOR: 0.35

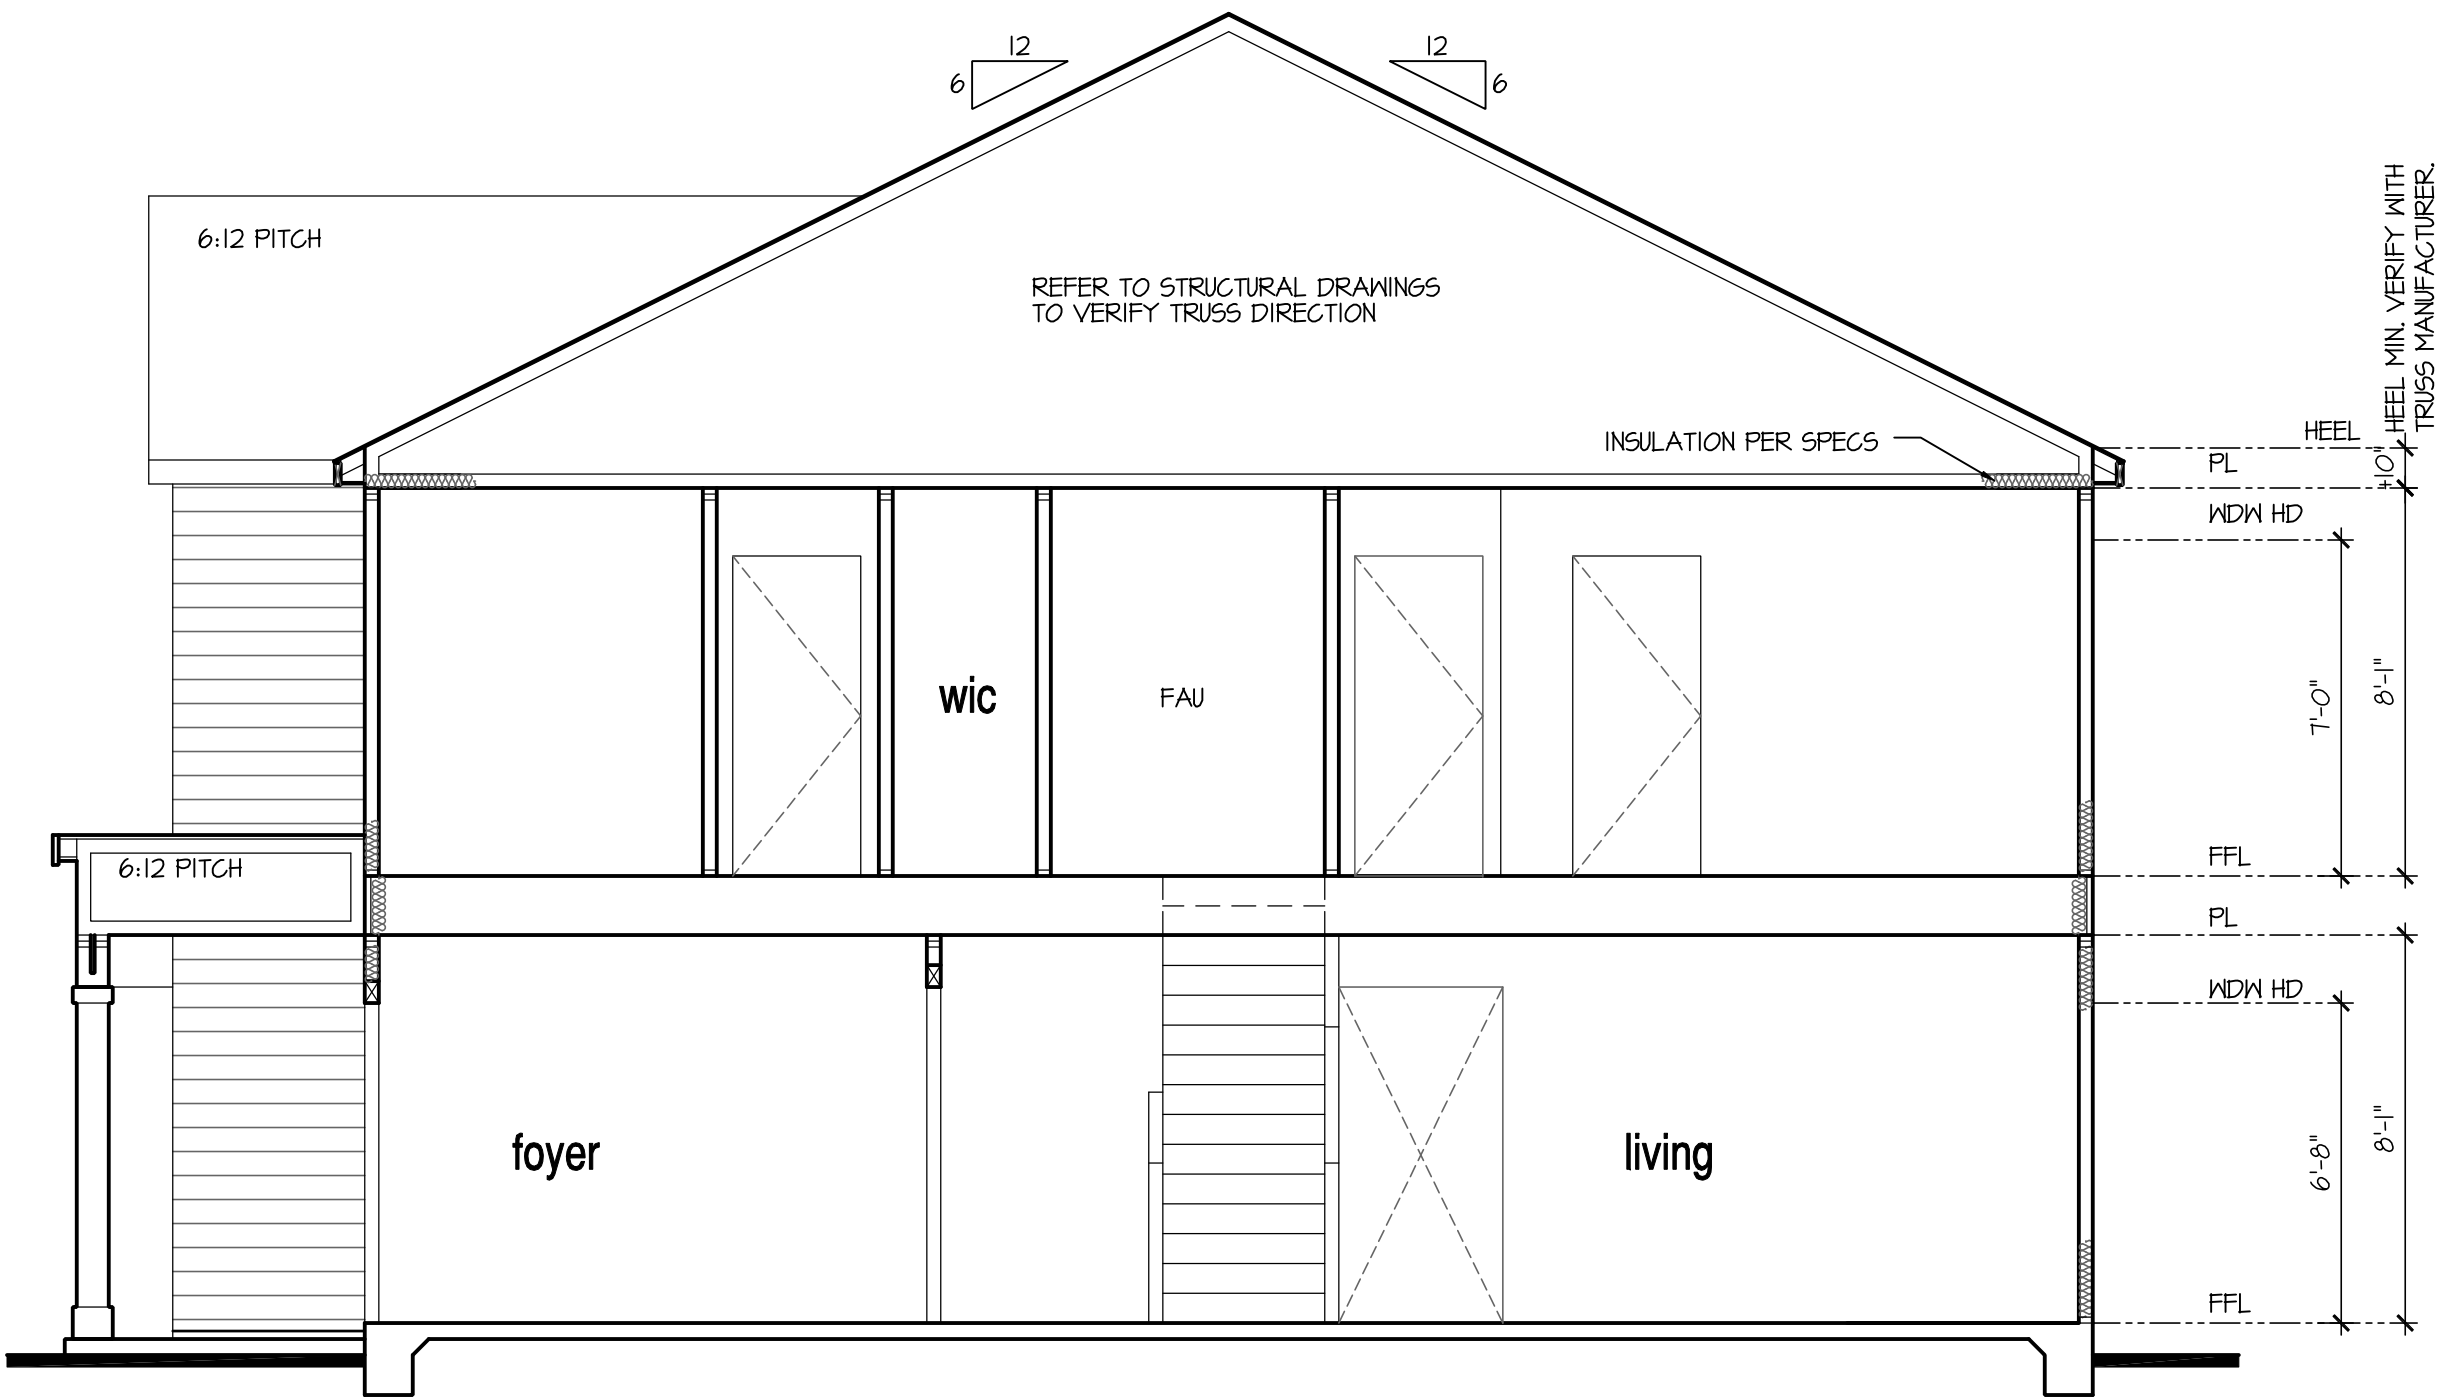


Building Section I at Monolithic Slab

SCALE: 1/4"=1'-0" AT 22"x34" LAYOUT 1/8"=1'-0" AT 11"x17" LAYOUT

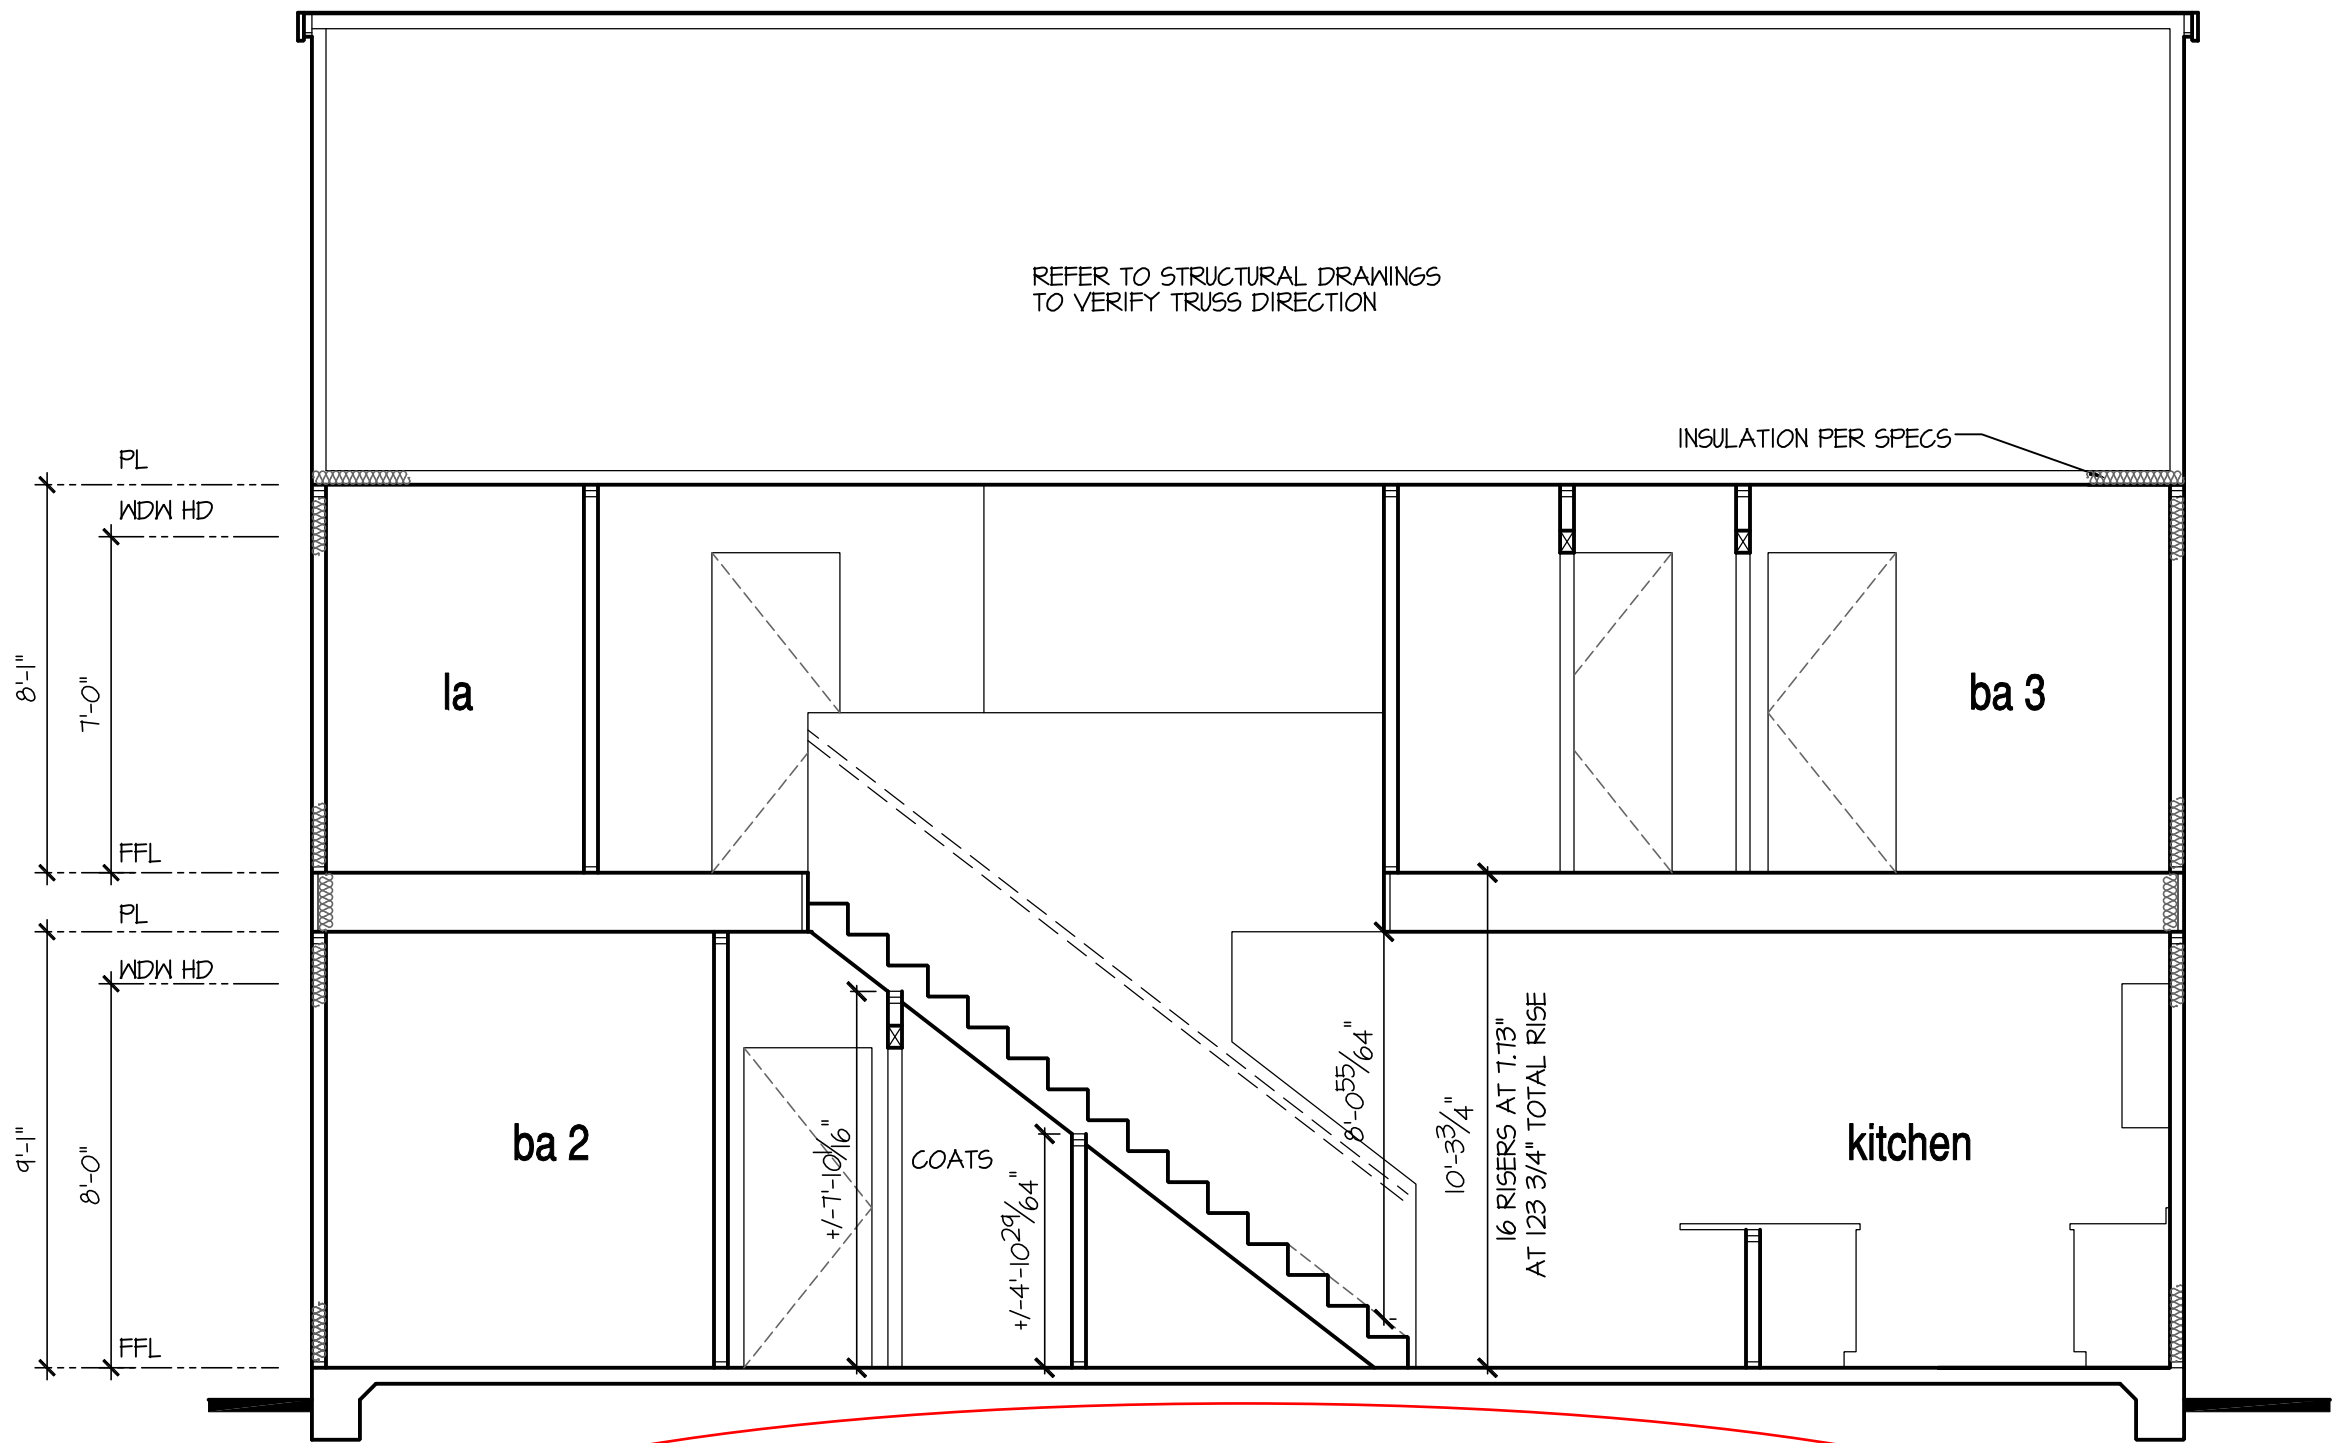

Building Section 2 at Optional 9' Plt

SCALE: 1/4"=1'-0" AT 22"x34" LAYOUT 1/8"=1'-0" AT 11"x17" LAYOUT

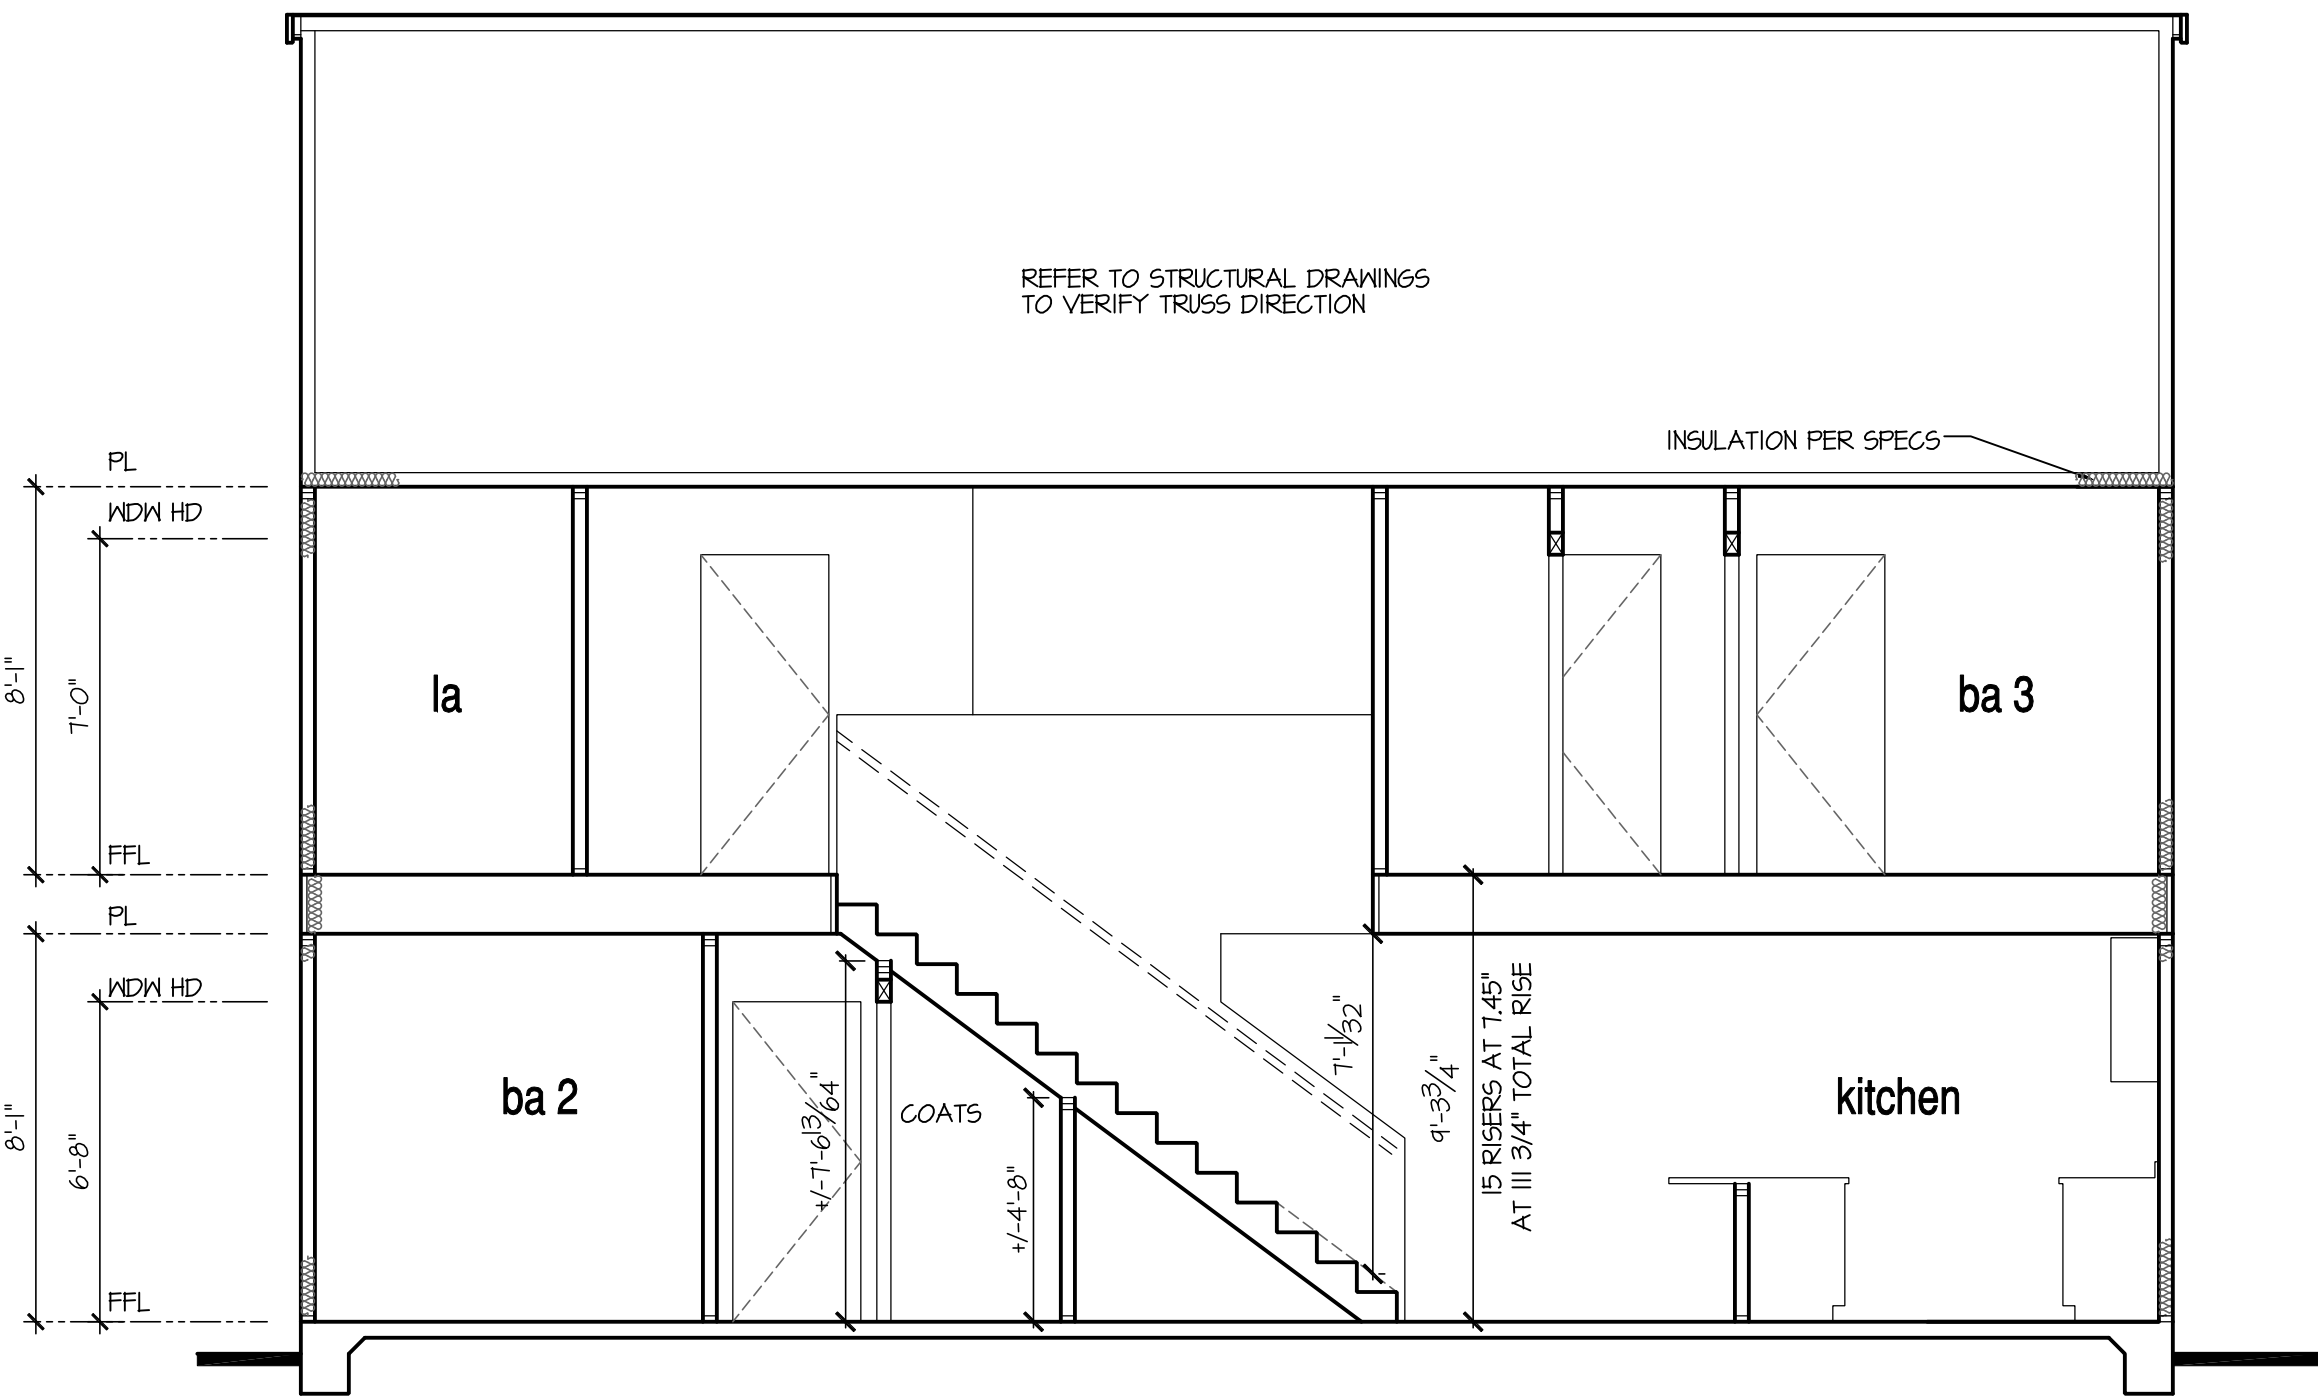

Building Section 2 at Monolithic Slab

SCALE: 1/4"=1'-0" AT 22"x34" LAYOUT 1/8"=1'-0" AT 11"x17" LAYOUT

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 04.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:

**D-R-HORTON**  
America's Builder

PROJECT NO: GMD17049

SHEET TITLE:

'HAYDEN'  
BUILDING  
SECTIONS


PRINT DATE:

January 22, 2021


SHEET NO:

1A S


FOR  
CONSTRUCTION

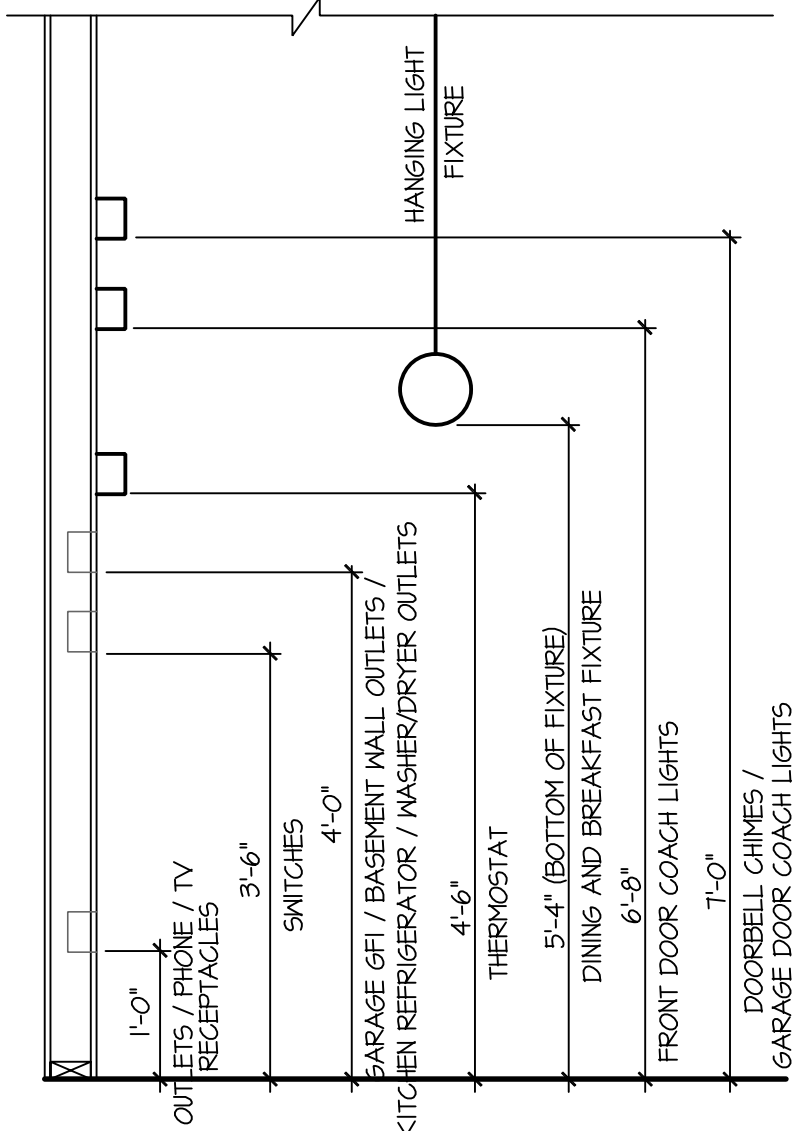

STANDARD ELECTRICAL BOX HEIGHTS

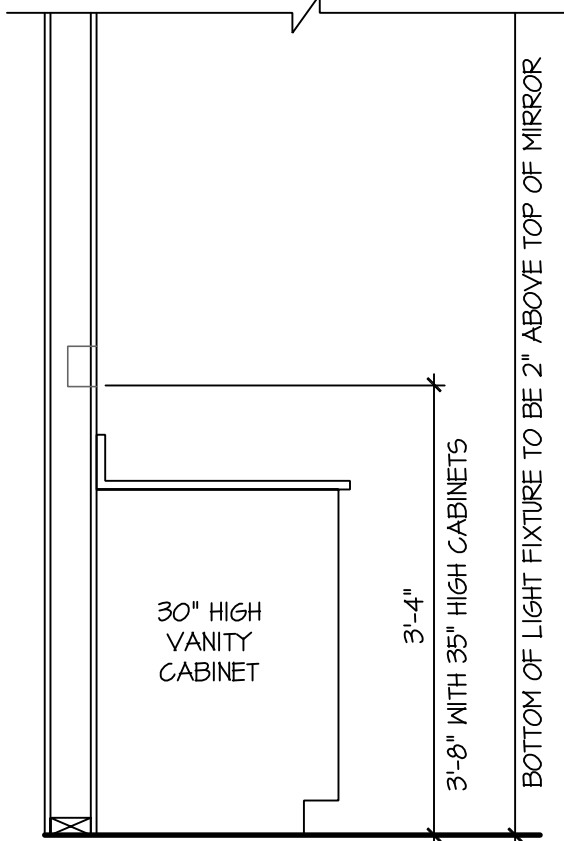


SWITCH AND RECEPTACLE BOXES OVER BATH CABINETS

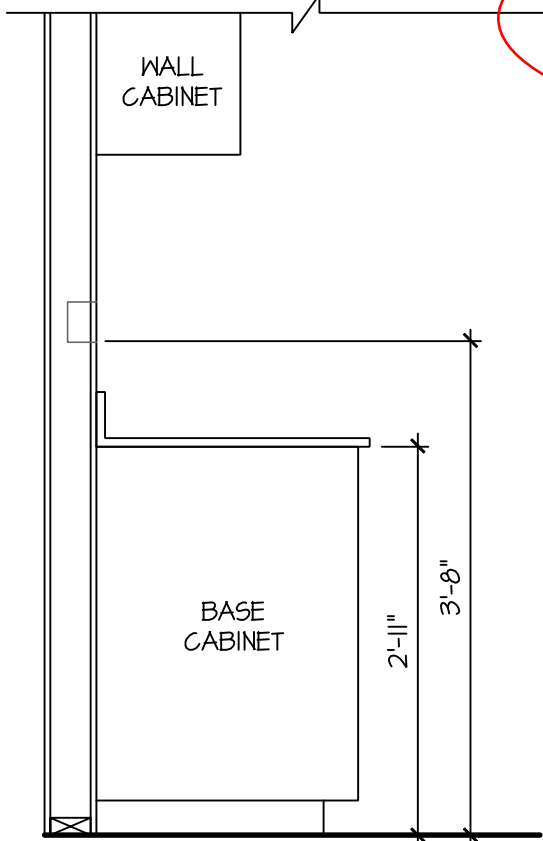

SWITCH AND RECEPTACLE BOXES OVER KITCHEN CABINETS

NOTE:  
SIZE SERVICE PANEL PER  
BUILDERS SPECIFICATIONS  
AND LOCAL CODES

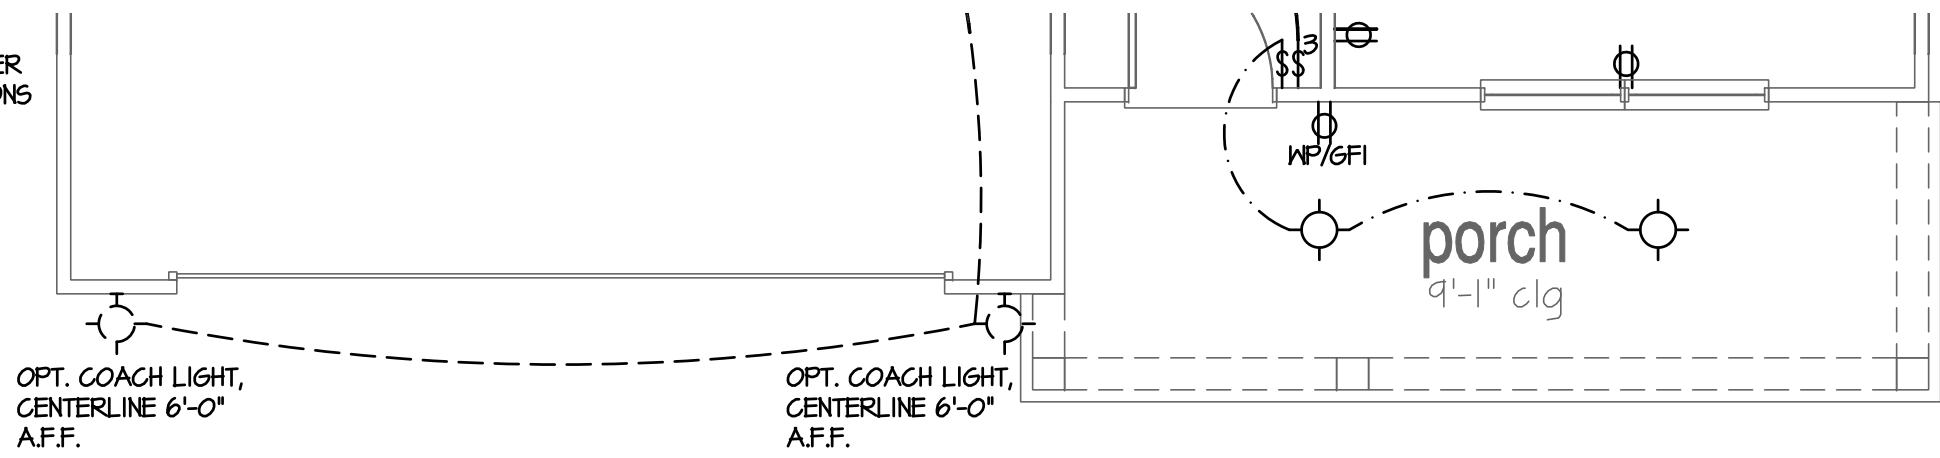

## 1st Floor Plan 'B'


SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X11" LAYOUT

### NOTES:

- PROVIDE GROUNDING ELECTRICAL ROD PER LOCAL CODES.
- PROVIDE AND INSTALL ARC FAULT CIRCUIT-INTERRUPTERS (AFCI) AS REQUIRED BY NATIONAL ELECTRICAL CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES.
- ALL EXHAUST FANS SHALL HAVE BACKDRAFT DAMPERS.
- FAN/LIGHTS IN WET/DAMP LOCATIONS SHALL BE LABELED "SUITABLE FOR WET OR DAMP LOCATIONS."
- ELECTRICAL SYSTEMS ARE SHOWN FOR INTENT ONLY. THESE SYSTEMS SHALL BE ENGINEERED BY OTHERS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROPER INSTALLATION AND PLACEMENT.
- PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS AND CO2 DETECTORS AS REQUIRED BY NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES.
- PROVIDE AND INSTALL GROUND FAULT CIRCUIT-INTERRUPTERS (GFI) AS REQUIRED BY NATIONAL ELECTRICAL CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES.
- ELECTRICAL CONTRACTOR TO PROVIDE REQUIRED DIRECT HOOK-UPS/CUTOFFS.
- HVAC CONTRACTOR TO VERIFY THERMOSTAT LOCATIONS.
- ALL ELECTRICAL AND MECHANICAL EQUIPMENT (FURNACES, A/C UNITS, ELECTRICAL PANELS, SANITARY SUMP PITS, DRAIN TILE SUMP, AND WATER HEATERS) ARE SUBJECT TO RELOCATION DUE TO FIELD CONDITIONS.
- PROVIDE POWER, LIGHT AND SWITCH AS REQUIRED FOR ATTIC FURNACE PER CODE AND MANUFACTURER'S WRITTEN INSTRUCTIONS.

### LEGEND:

|          |                                                |       |                                                               |   |                                       |
|----------|------------------------------------------------|-------|---------------------------------------------------------------|---|---------------------------------------|
| ⊕        | DUPLEX OUTLET                                  | ⊕     | FLUSH-MOUNT LED CEILING FIXTURE                               | ☐ | CHIMES                                |
| ⊕ WP/GFI | WEATHERPROOF GFI DUPLEX OUTLET                 | ⊕     | HANGING FIXTURE                                               | ⊕ | PUSHBUTTON SWITCH                     |
| ⊕ GFI    | GROUND-FAULT CIRCUIT-INTERRUPTER DUPLEX OUTLET | ⊕ CFP | FLUSH-MOUNT LED CEILING FIXTURE (PROVIDE CEILING FAN SUPPORT) | ⊕ | 110V SMOKE DETECTOR W/ BATTERY BACKUP |
| ⊕        | HALF-SWITCHED DUPLEX OUTLET                    | ⊕     | 2-LIGHT VANITY FIXTURE                                        | ⊕ | CO2 DETECTOR                          |
| ⊕ 220V   | 220 VOLT OUTLET                                | ⊕     | 3-LIGHT VANITY FIXTURE                                        | ⊕ | THERMOSTAT                            |
| ⊕        | REINFORCED JUNCTION BOX                        | ⊕     | 4-LIGHT VANITY FIXTURE                                        | ☐ | TELEPHONE                             |
| ⊕        | WALL SWITCH                                    | ⊕     | WALL MOUNT FIXTURE                                            | ☐ | TELEVISION                            |
| ⊕ 3      | THREE-WAY SWITCH                               | ⊕     | EXHAUST FAN (VENT TO EXTERIOR)                                | ⊕ | ELECTRIC METER                        |
| ⊕ 4      | FOUR-WAY SWITCH                                |       |                                                               | ⊕ | ELECTRIC PANEL                        |
|          |                                                |       |                                                               | ⊕ | DISCONNECT SWITCH                     |

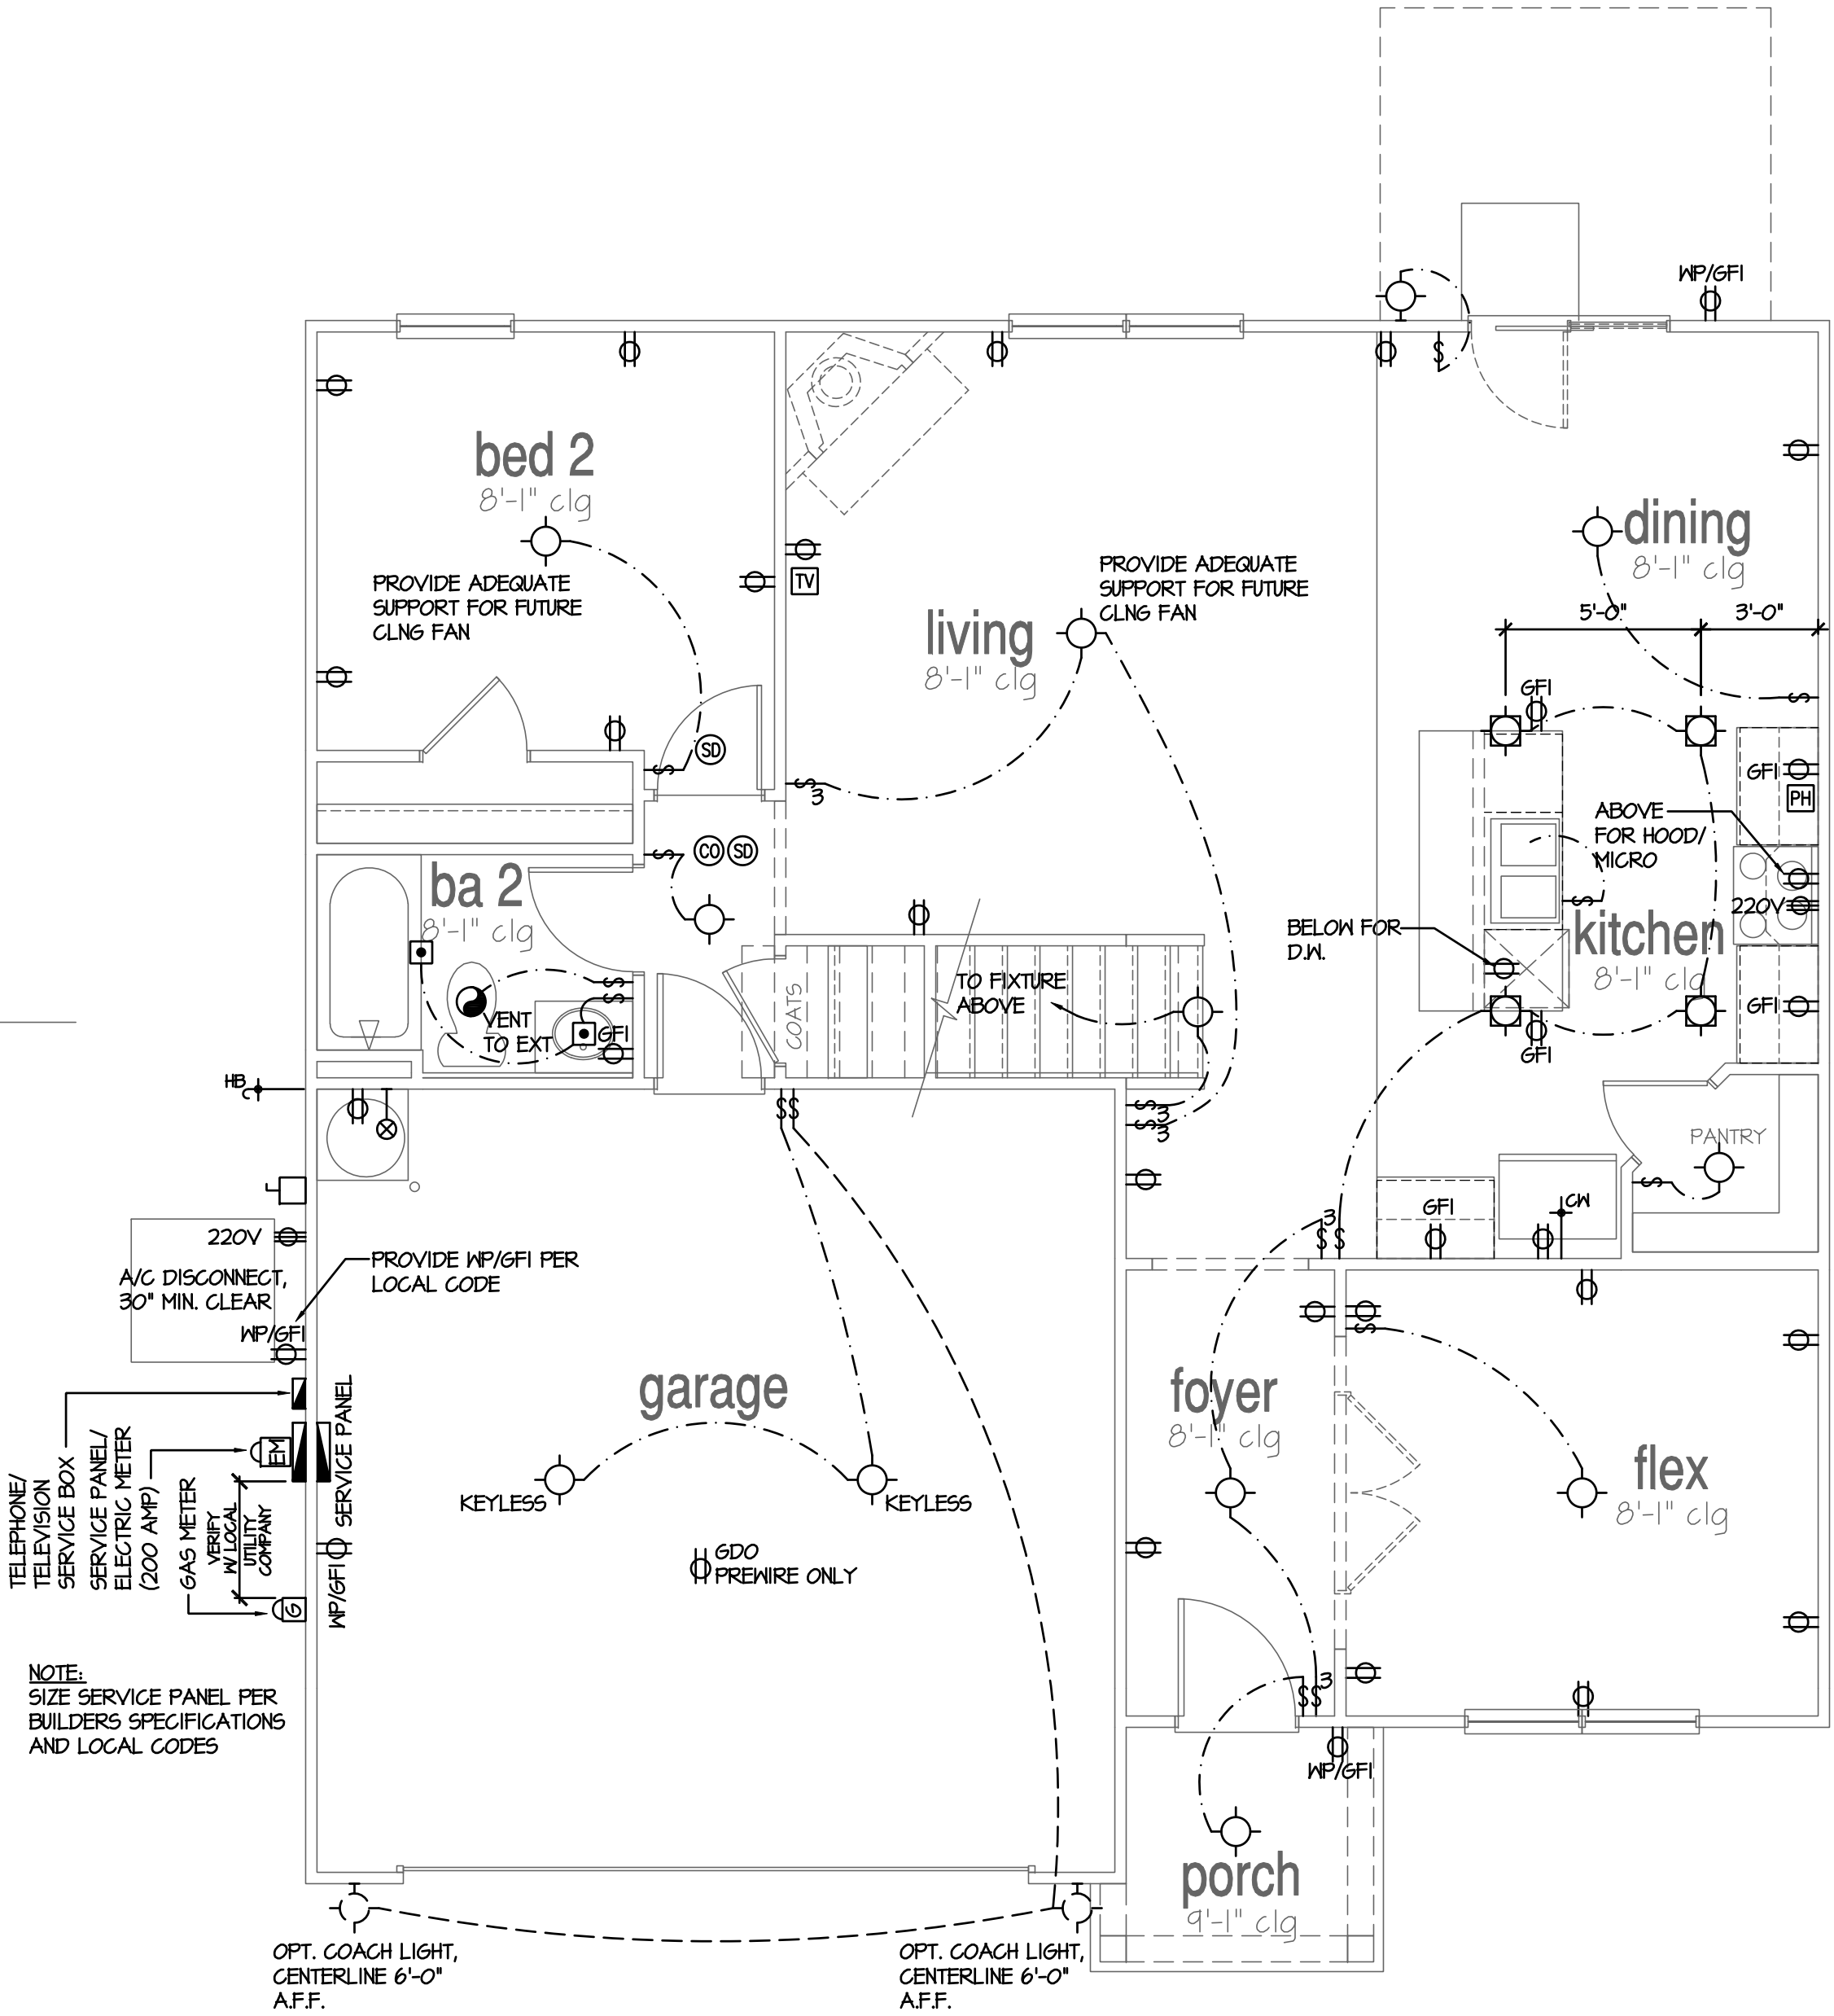

## 1st Floor Plan 'A'

SCALE: 1/4"=1'-0" AT 22"X34" LAYOUT 1/8"=1'-0" AT 11"X11" LAYOUT

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
| 1   | 04.06.23 |                 |
| 2   | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:



PROJECT NO: GMD1049

SHEET TITLE:

'HAYDEN'  
1st FLOOR  
UTILITY PLAN


PRINT DATE:

January 22, 2021


SHEET NO:

7


FOR  
CONSTRUCTION

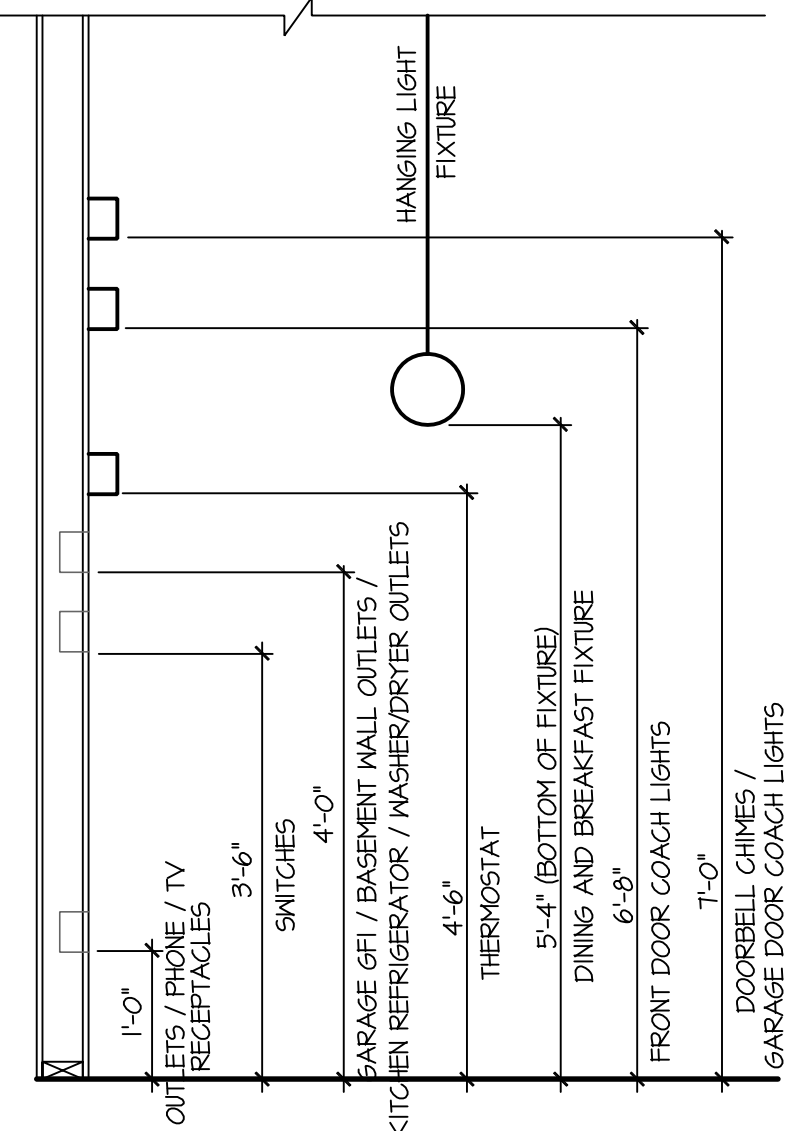

STANDARD ELECTRICAL BOX HEIGHTS

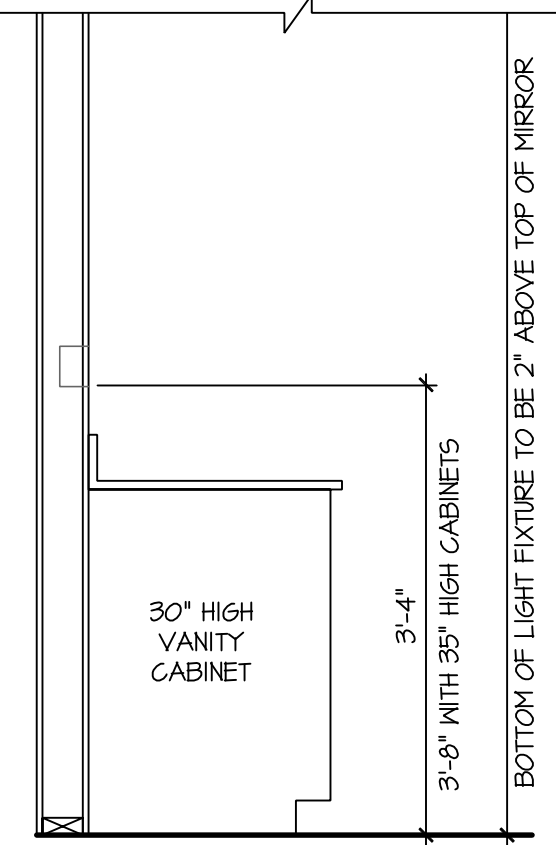

SWITCH AND RECEPTACLE BOXES OVER BATH CABINETS

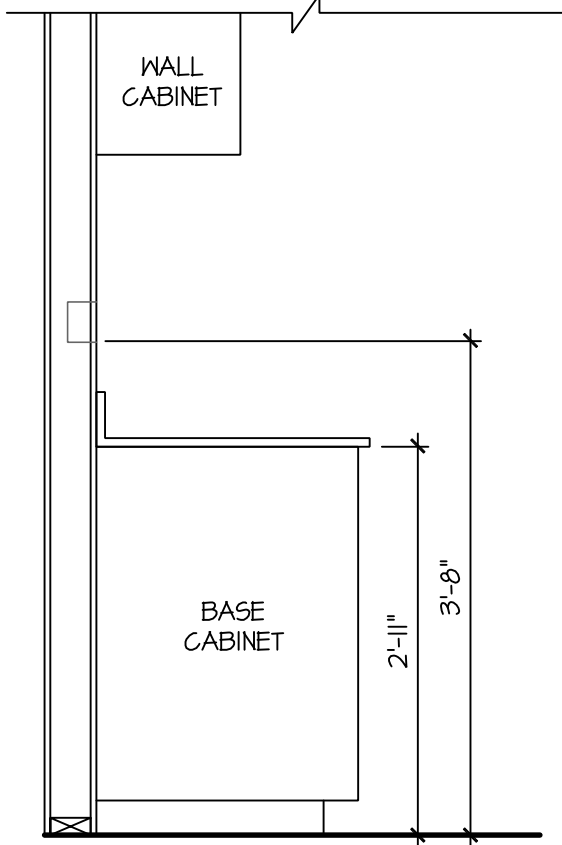


SWITCH AND RECEPTACLE BOXES OVER KITCHEN CABINETS

NOTES:

- PROVIDE GROUNDING ELECTRICAL ROD PER LOCAL CODES.
- PROVIDE AND INSTALL ARC FAULT CIRCUIT-INTERRUPTERS (AFCI) AS REQUIRED BY NATIONAL ELECTRICAL CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES.
- ALL EXHAUST FANS SHALL HAVE BACKDRAFT DAMPERS.
- FAN/LIGHTS IN WET/DAMP LOCATIONS SHALL BE LABELED "SUITABLE FOR WET OR DAMP LOCATIONS."
- ELECTRICAL SYSTEMS ARE SHOWN FOR INTENT ONLY. THESE SYSTEMS SHALL BE ENGINEERED BY OTHERS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROPER INSTALLATION AND PLACEMENT.
- PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS AND CO2 DETECTORS AS REQUIRED BY NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES.
- PROVIDE AND INSTALL GROUND FAULT CIRCUIT-INTERRUPTERS (GFI) AS REQUIRED BY NATIONAL ELECTRICAL CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES.
- ELECTRICAL CONTRACTOR TO PROVIDE REQUIRED DIRECT HOOK-UPS/CUTOFFS.
- HVAC CONTRACTOR TO VERIFY THERMOSTAT LOCATIONS.
- ALL ELECTRICAL AND MECHANICAL EQUIPMENT (FURNACES, A/C UNITS, ELECTRICAL PANELS, SANITARY SUMP PITS, DRAIN TILE PUMP, AND WATER HEATERS) ARE SUBJECT TO RELOCATION DUE TO FIELD CONDITIONS.
- PROVIDE POWER, LIGHT AND SWITCH AS REQUIRED FOR ATTIC FURNACE PER CODE AND MANUFACTURER'S WRITTEN INSTRUCTIONS.

LEGEND:

|  |                                                |  |                                                                  |  |                                          |  |                                           |
|--|------------------------------------------------|--|------------------------------------------------------------------|--|------------------------------------------|--|-------------------------------------------|
|  | DUPLEX OUTLET                                  |  | FLUSH-MOUNT LED CEILING FIXTURE                                  |  | CHIMES                                   |  | CEILING FAN<br>(PROVIDE ADEQUATE SUPPORT) |
|  | WEATHERPROOF GFI DUPLEX OUTLET                 |  | HANGING FIXTURE                                                  |  | PUSHBUTTON SWITCH                        |  |                                           |
|  | GROUND-FAULT CIRCUIT-INTERRUPTER DUPLEX OUTLET |  | FLUSH-MOUNT LED CEILING FIXTURE<br>(PROVIDE CEILING FAN SUPPORT) |  | 110V SMOKE DETECTOR<br>w/ BATTERY BACKUP |  | GAS SUPPLY WITH VALVE                     |
|  | HALF-SWITCHED DUPLEX OUTLET                    |  | 2-LIGHT VANITY FIXTURE                                           |  | CO2 DETECTOR                             |  | HOSE BIBB                                 |
|  | 220 VOLT OUTLET                                |  | 3-LIGHT VANITY FIXTURE                                           |  | THERMOSTAT                               |  | 1/4" WATER STUB OUT                       |
|  | REINFORCED JUNCTION BOX                        |  | 4-LIGHT VANITY FIXTURE                                           |  | TELEPHONE                                |  | WALL SCONCE                               |
|  | WALL SWITCH                                    |  | WALL MOUNT FIXTURE                                               |  | TELEVISION                               |  |                                           |
|  | THREE-WAY SWITCH                               |  | EXHAUST FAN (VENT TO EXTERIOR)                                   |  | ELECTRIC METER                           |  |                                           |
|  | FOUR-WAY SWITCH                                |  |                                                                  |  | ELECTRIC PANEL                           |  |                                           |
|  |                                                |  |                                                                  |  | DISCONNECT SWITCH                        |  |                                           |

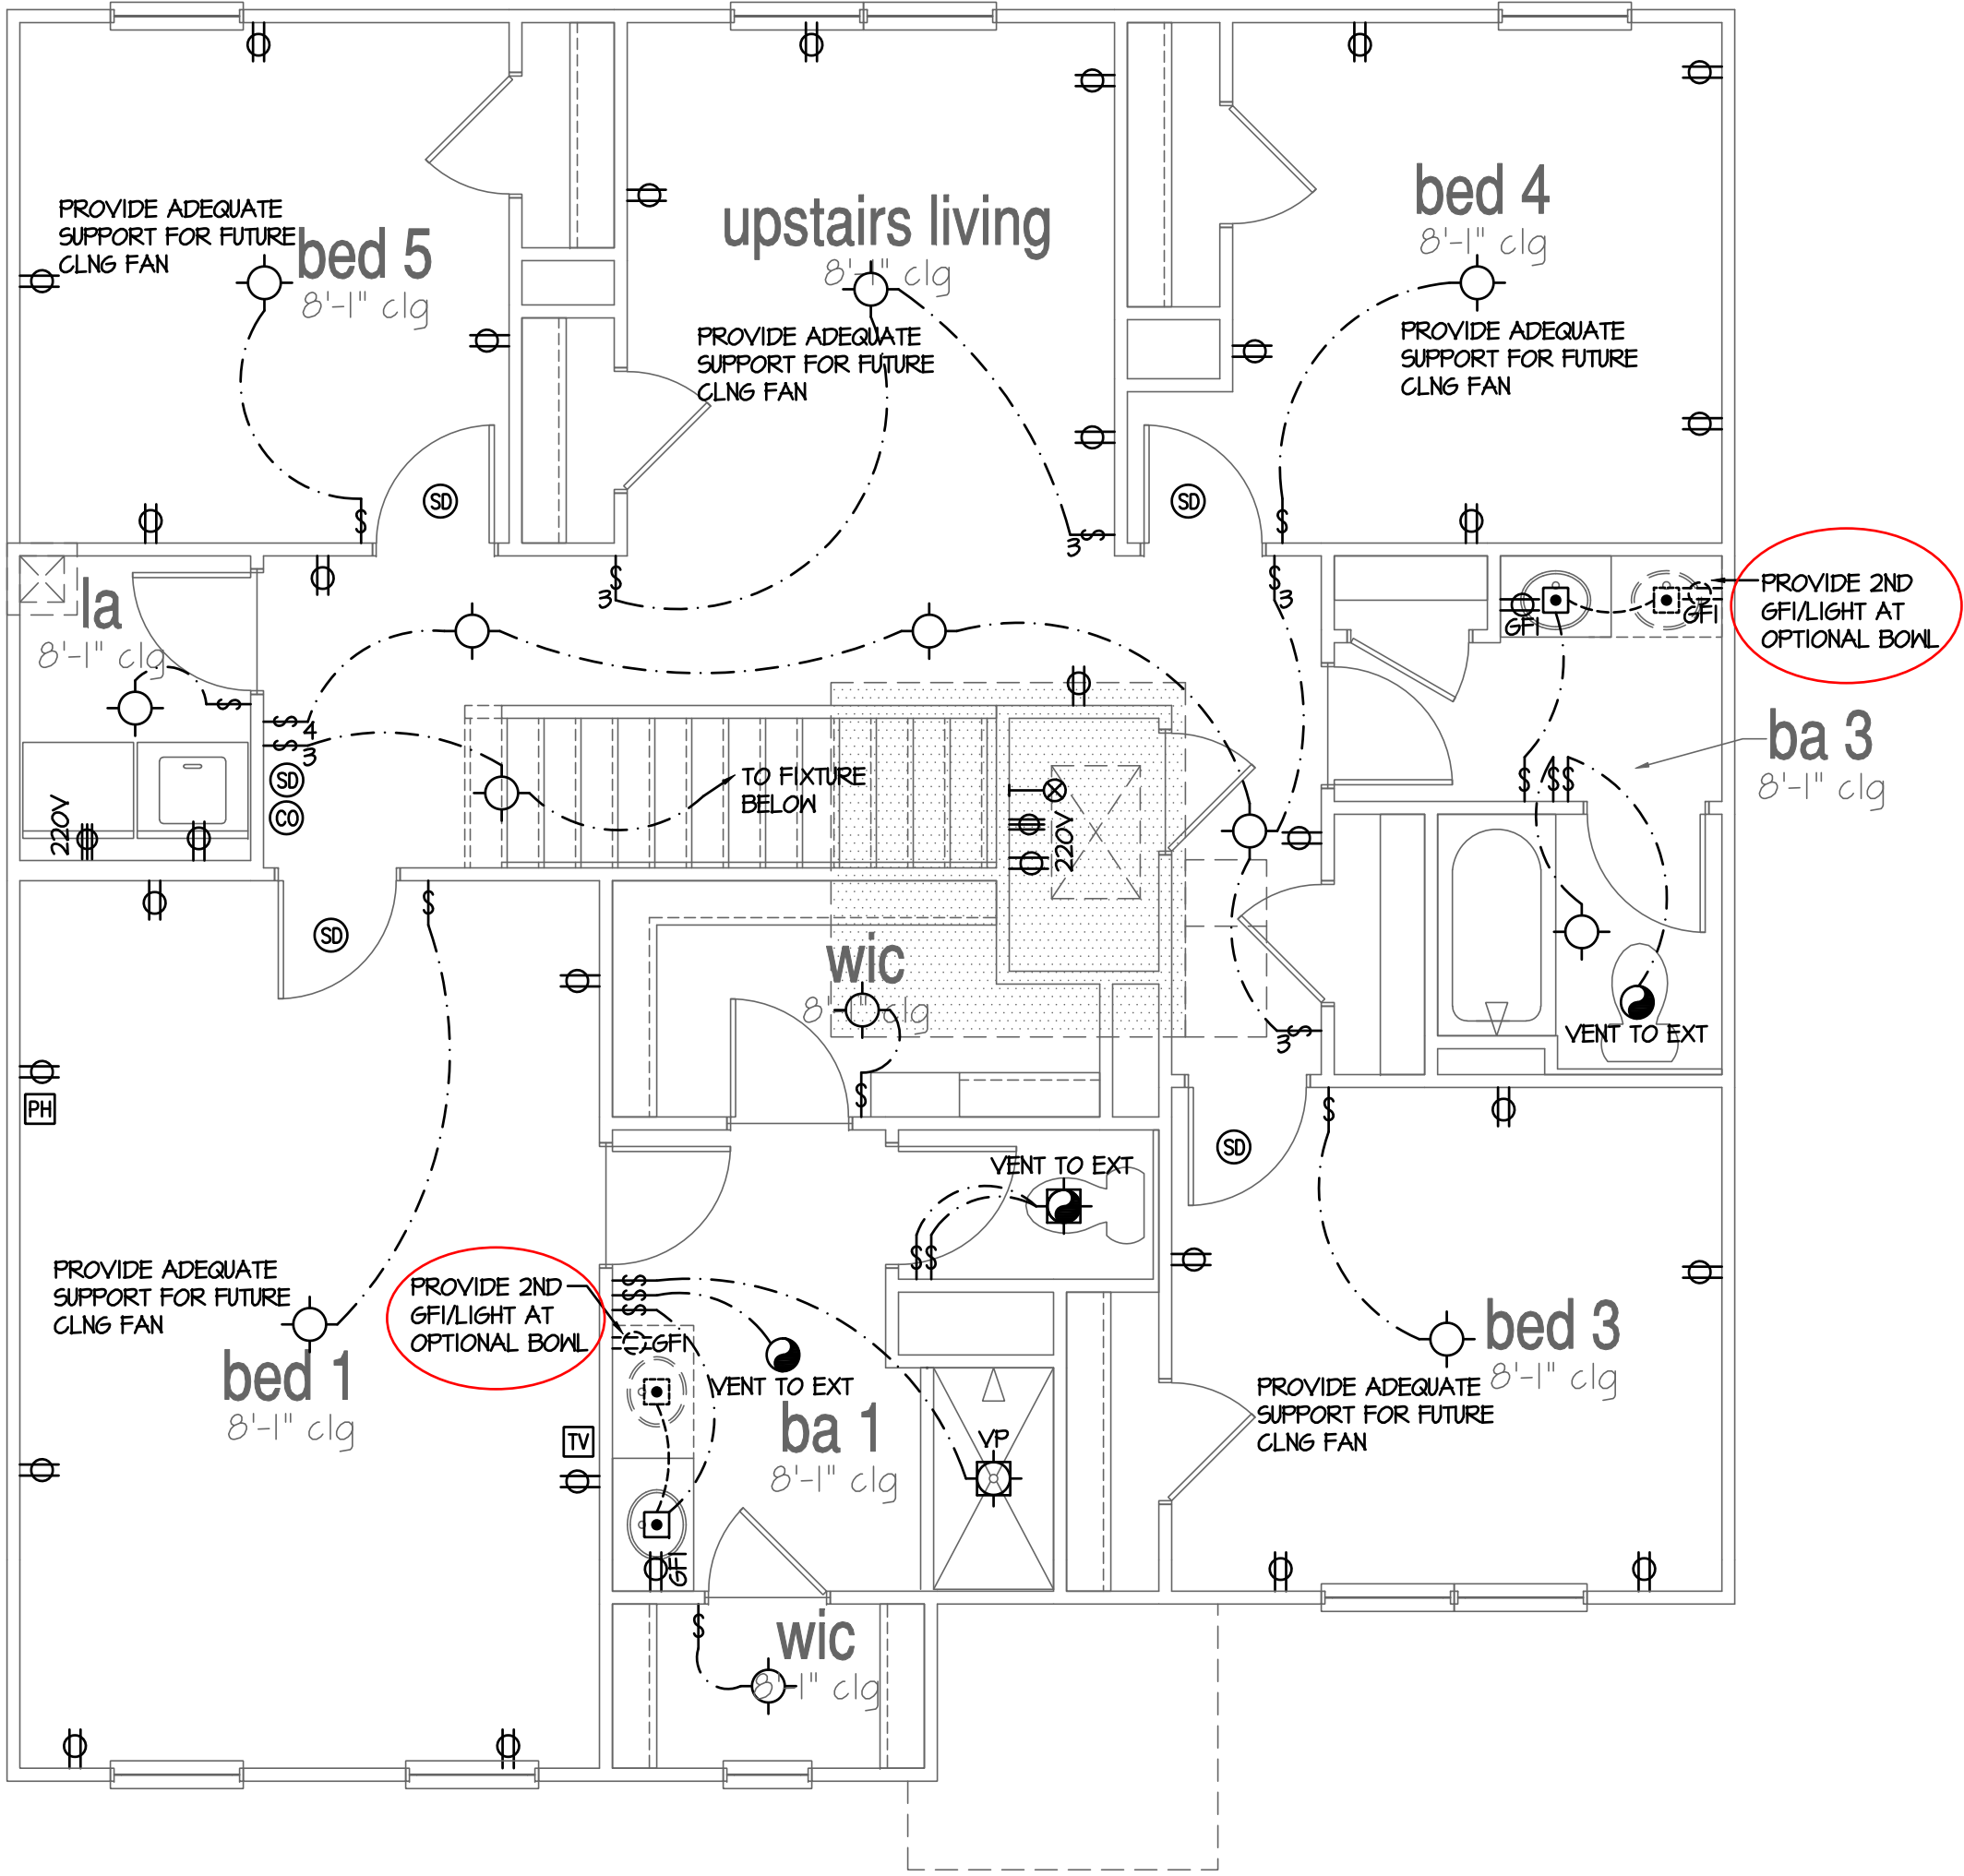

2nd Floor Plan 'A'

SCALE: 1/4"=1'-0" AT 22"x34" LAYOUT 1/8"=1'-0" AT 11"x17" LAYOUT

| NO. | DATE:    | REVISION:       |
|-----|----------|-----------------|
|     | 09.06.23 |                 |
|     | 04.15.25 | FOUNDATION NOTE |

PROFESSIONAL SEAL:

PROJECT TITLE:

40' Series

CLIENTS NAME:



PROJECT NO: GMD17049

SHEET TITLE:

'HAYDEN'  
2nd FLOOR  
UTILITY PLAN

PRINT DATE:

January 22, 2021

SHEET NO:

8

FOR  
CONSTRUCTION

Construction Type: Commerical ☐ Residential ☒

- 2018 North Carolina Residential Building Code with All Local Amendments
- ASCE 7-10: Minimum Design Loads for Buildings and Other Structures

|        |                         |        |
|--------|-------------------------|--------|
| 1.     | Roof Live Loads         |        |
| 1.1.   | Conventional 2x .....   | 20 PSF |
| 1.2.   | Truss .....             | 20 PSF |
| 1.2.1. | Attic Truss .....       | 60 PSF |
| 2.     | Roof Dead Loads         |        |
| 2.1.   | Conventional 2x .....   | 10 PSF |
| 2.2.   | Truss .....             | 20 PSF |
| 3.     | Snow .....              | 15 PSF |
| 3.1.   | Importance Factor ..... | 1.0    |
| 4.     | Floor Live Loads        |        |
| 4.1.   | Typ. Dwelling .....     | 40 PSF |
| 4.2.   | Sleeping Areas .....    | 30 PSF |
| 4.3.   | Decks .....             | 40 PSF |
| 4.4.   | Passenger Garage .....  | 50 PSF |
| 5.     | Floor Dead Loads        |        |
| 5.1.   | Conventional 2x .....   | 10 PSF |
| 5.2.   | I-Joist .....           | 15 PSF |
| 5.3.   | Floor Truss .....       | 15 PSF |

| MEAN ROOF HT. | UP TO 30'  | 30'1"-35'  | 35'1"-40'  | 40'1"-45'  |
|---------------|------------|------------|------------|------------|
| ZONE 1        | 16.7,-18.0 | 17.6,-18.9 | 18.3,-19.7 | 18.8,-20.2 |
| ZONE 2        | 16.7,-21.0 | 17.6,-22.1 | 18.3,-22.9 | 18.8,-23.6 |
| ZONE 3        | 16.7,-21.0 | 17.6,-22.1 | 18.3,-22.9 | 18.8,-23.6 |
| ZONE 4        | 18.2,-19.0 | 19.2,-20.0 | 19.9,-20.8 | 20.4,-21.3 |
| ZONE 5        | 18.2,-19.0 | 19.2,-25.2 | 19.9,-26.2 | 20.4,-26.9 |

|                                                                                                        |         |
|--------------------------------------------------------------------------------------------------------|---------|
| 8.1. Site Class .....                                                                                  | D       |
| 8.2. Design Category .....                                                                             | C       |
| 8.3. Importance Factor .....                                                                           | 1.0     |
| 8.4. Seismic Use Group .....                                                                           | 1       |
| 8.5. Spectral Response Acceleration                                                                    |         |
| 8.5.1. $S_{ms}$ = %g                                                                                   |         |
| 8.5.2. $S_{m1}$ = %g                                                                                   |         |
| 8.6. Seismic Base Shear                                                                                |         |
| 8.6.1. $V_x$ =                                                                                         |         |
| 8.6.2. $V_y$ =                                                                                         |         |
| 8.7. Basic Structural System (check one)                                                               |         |
| <input checked="" type="checkbox"/> Bearing Wall                                                       |         |
| <input type="checkbox"/> Building Frame                                                                |         |
| <input type="checkbox"/> Moment Frame                                                                  |         |
| <input type="checkbox"/> Dual w/ Special Moment Frame                                                  |         |
| <input type="checkbox"/> Dual w/ Intermediate R/C or Special Steel                                     |         |
| <input type="checkbox"/> Inverted Pendulum                                                             |         |
| 8.8. Arch/Mech Components Anchored .....                                                               | No      |
| 8.9. Lateral Design Control: Seismic <input type="checkbox"/> Wind <input checked="" type="checkbox"/> |         |
| 9. Assumed Soil Bearing Capacity .....                                                                 | 2000psf |

9. Assumed Soil Bearing Capacity ..... 2000psf



**FORMERLY SUMMIT ENGINEERING, LABORATORY, &  
TESTING INC.**

HAYDEN LH

OWNER:  
DR Horton, Inc.  
8001 Arrowridge Blvd.  
Charlotte, NC 28273

GMD Design Group  
102 Fountain Brook Circle  
Suite C  
Cary, NC 27511

These drawings are to be coordinated with the architectural, mechanical, plumbing, electrical, and civil drawings. This coordination is not the responsibility of the structural engineering of record (SER). Should any discrepancies become apparent, the contractor shall notify UES Professional Solutions 29, Inc. (UES) before construction begins.


|     |                        |     |                        |
|-----|------------------------|-----|------------------------|
| AB  | ANCHOR BOLT            | PT  | PRESSURE TREATED       |
| AFF | ABOVE FINISHED FLOOR   | RS  | ROOF SUPPORT           |
| CJ  | CEILING JOIST          | SC  | STUD COLUMN            |
| CLR | CLEAR                  | SJ  | SINGLE JOIST           |
| DJ  | DOUBLE JOIST           | SPF | SPRUCE PINE FIR        |
| DSP | DOUBLE STUD POCKET     | SST | SIMPSON STRONG-TIE     |
| EE  | EACH END               | SPY | SOUTHERN YELLOW PINE   |
| EW  | EACH WAY               | TJ  | TRIPLE JOIST           |
| NTS | NOT TO SCALE           | TSP | TRIPLE STUD POCKET     |
| OC  | ON CENTER              | THP | TYPICAL                |
| PSF | POUNDS PER SQUARE FOOT | UNO | UNLESS NOTED OTHERWISE |
| PSI | POUNDS PER SQUARE INCH | WWF | WELDED WIRE FABRIC     |

Roof truss and floor joist layouts, and their corresponding loading details, were not provided to UES Professional Solutions 29, Inc. (UES) prior to the initial design. Therefore, truss and joist directions were assumed based on the information provided by DR Horton, Inc. Subsequent plan revisions based on roof truss and floor joist layouts shall be noted in the revision list, indicating the date the layouts were provided. Should any discrepancies become apparent, the contractor shall notify UES immediately.

| Sheet No. | Description                            |
|-----------|----------------------------------------|
| CS1       | Cover Sheet, Specifications, Revisions |
| CS2       | Cover Sheet Continued                  |
| S1.0m     | Monolithic Slab Foundation             |
| S1.0s     | Stem Wall Foundation                   |
| S1.0c     | Crawl Space Foundation                 |
| S1.0b     | Basement Foundation                    |
| S2.0      | Basement Framing Plan                  |
| S3.0      | First Floor Framing Plan               |
| S4.0      | Second Floor Framing Plan              |
| S5.0      | Roof Framing Plan                      |
| S6.0      | Basement Bracing Plan                  |
| S7.0      | First Floor Bracing Plan               |
| S8.0      | Second Floor Bracing Plan              |

[illegible]

|                                |           |
|--------------------------------|-----------|
| Manager                        | Signature |
| Operations                     |           |
| Operations System              |           |
| Operations Product Development |           |

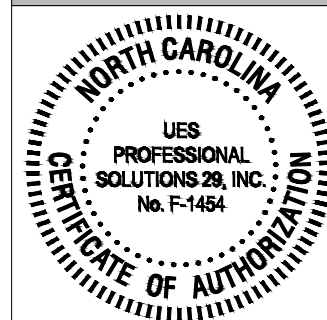

|   |          |                   |
|---|----------|-------------------|
| 2 | 10/24/24 | basement bath/bdr |
|---|----------|-------------------|

DR Horton, Inc.  
8001 Arrowridge Blvd.  
Charlotte, NC 28273

Hayden LH  
Coversheet

07.11.2024



STRUCTURAL MEMBERS ONLY

DATE: 07/10/2024  
SCALE: 22x34 1/4"=1'-0"  
11x17 1/8"=1'-0"  
PROJECT #: A24117.01222.000  
DRAWN BY: EO  
CHECKED BY: GWS

22869 5/15/19

REFER TO COVER SHEET FOR A COMPLETE  
LIST OF REVISIONS

**SHEET**

CS1

GENERAL STRUCTURAL NOTES:

- The design professional whose seal appears on these drawings is the structural engineer of record (SER) for this project. The SER bears the responsibility of the primary structural elements and the performance of this structure. No other party may revise, alter, or delete any structural aspects of these construction documents without written permission of UES Professional Solutions 29, Inc. (UES) or the SER. For the purposes of these construction documents the SER and UES shall be considered the same entity.
- The structure is only stable in its completed form. The contractor shall provide all required temporary bracing during construction to stabilize the structure.
- The SER is not responsible for construction sequences, methods, or techniques in connection with the construction of this structure. The SER will not be held responsible for the contractor's failure to conform to the contract documents, should any non-conformities occur.
- Any structural elements or details not fully developed on the construction drawings shall be completed under the direction of a licensed professional engineer. These shop drawings shall be submitted to UES for review before any construction begins. The shop drawings will be reviewed for overall compliance as it relates to the structural design of this project. Verification of the shop drawings for dimensions, or for actual field conditions, is not the responsibility of the SER or UES.
- Verification of assumed field conditions is not the responsibility of the SER. The contractor shall verify the field conditions for accuracy and report any discrepancies to UES before construction begins.
- The SER is not responsible for any secondary structural elements or non-structural elements, except for the elements specifically noted on the structural drawings.
- This structure and all construction shall conform to all applicable sections of the international residential code.
- This structure and all construction shall conform to all applicable sections of local building codes.
- All structural assemblies are to meet or exceed to requirements of the current local building code.
- The Structural Engineer of Record's (SER) seal applies to structural components only. The SER's seal does not certify dimensional accuracy or architectural layout, including roof geometry. UES Professional Solutions 29, Inc. (UES) nor the SER assumes no liability for changes made to sealed drawings by others, construction methods, or any deviation from these plans. The SER shall be notified prior to construction if any discrepancies are noted on the plans.
- All sealed structural drawings shall have a signed and dated seal to be valid and are limited to the following uses:
  - If these structural drawings are issued as part of a master-plan set intended to be used for mass development, these drawings shall be valid for a period of two (2) years from the date on the seal, or if any code required updates are placed in effect by the governing jurisdiction.
  - If these structural drawings are not issued as part of a master plan set intended for mass development, these drawings are valid for a conditional one time use for the lot of the address specified within the title block.
- UES Professional Solutions 29, Inc. (UES) as its option, may create a set of standard details for a client that are referenced within our drawings. Any details created by UES whether specific to one plan or as part of a "Standard Detail" package are only valid with use of drawings created by UES Professional Solutions 29, Inc. (UES) and shall not be used with any other drawings or for any other construction purposes.

FOUNDATIONS:

- The structural engineer has not performed a subsurface investigation. Verification of this assumed value is the responsibility of the owner or the contractor. Should any adverse soil condition be encountered the SER must be contacted before proceeding.
- The bottom of all footings shall extend below the frost line for the region in which the structure is to be constructed. However, the bottom of all footings shall be a minimum of 12" below grade.
- Any fill shall be placed under the direction or recommendation of a licensed professional engineer.
- The resulting soil shall be compacted to a minimum of 95% maximum dry density.
- Excavations of footings shall be lined temporarily with a 6 mil polyethylene membrane if placement of concrete does not occur within 24 hours of excavation.
- No concrete shall be placed against any subgrade containing water, ice, frost, or loose material.

STRUCTURAL STEEL:

- Structural steel shall be fabricated and erected in accordance with the American Institute of Steel Construction "Code of Standard Practice for Steel Buildings and Bridges" and the manual of Steel Construction "Load Resistance Factor Design" latest editions.
- Structural steel shall receive one coat of shop applied rust-inhibitive paint.
- All steel shall have a minimum yield stress ( $F_y$ ) of 36 ksi unless otherwise noted.
- Welding shall conform to the latest edition of the American Welding Society's Structural Welding Code AWS D1.1. Electrodes and consumables for both shop and field welding shall be 70ksi. All welding shall be performed by a certified welder per the above standards.

CONCRETE:

- Concrete shall be nominal weight concrete with no aggregate larger than 3/4" and a minimum compressive strength ( $f'_c$ ) at 28 days of 3000 psi, unless otherwise noted on the plan.
- Concrete shall be proportioned, mixed, and placed in accordance with the latest editions of ACI 318: "Building Code Requirements for Reinforced Concrete" and ACI 301: "Specifications for Structural Concrete for Buildings".
- Air entrained concrete must be used for all structural elements exposed to freeze/thaw cycles and deicing chemicals. Air entrainment amounts (in percent) shall be within -1% to +2% of target values as follows:
  - Footings: 5%
  - Exterior Slabs: 5%
- No admixtures shall be added to any structural concrete without written permission of the SER.
- Concrete slabs-on-grade shall be constructed in accordance with the latest version of ACI 302.1: "Guide for Concrete Slab and Slab Construction".
- The concrete slab-on-grade has been designed using a subgrade modulus of  $k=250$  pci and a design loading of 200 psf. The SER is not responsible for differential settlement, slab cracking or other future defects resulting from unreported conditions not in accordance with the above assumptions.
- Control or saw cut joints shall be spaced in interior slabs-on-grade at a maximum of 15'-0" O.C. and in exterior slabs-on-grade at a maximum of 10'-0" unless otherwise noted.
- Control or saw cut joints shall be produced using conventional process within 4 to 12 hours after the slab has been finished.
- Reinforcing steel may not extend through a control joint. Reinforcing steel may extend through a saw cut joint.

- All welded wire fabric (W.W.F.) for concrete slabs-on-grade shall be placed at mid-depth of slab. The W.W.F. shall be securely supported during the concrete pour.

CONCRETE REINFORCEMENT:

- Fibrous concrete reinforcement, or fibermesh, specified in concrete slabs-on-grade may be used for control of cracking due to shrinkage and thermal expansion/contraction, lowered water migration, an increase in impact capacity, increased abrasion resistance, and residual strength.
- Fibermesh reinforcing to be 100% virgin polypropylene fibers containing no reprocessed olefin materials and specifically manufactured for use as concrete secondary reinforcement.
- Application of fibermesh per cubic yard of concrete shall equal a minimum of 0.1% by volume (1.5 pounds per cubic yard)
- Fibermesh shall comply with ASTM C1116, any local building code requirements, and shall meet or exceed the current industry standard.
- Steel reinforcing bars shall be new billet steel conforming to ASTM A615, grade 60.
- Detailing, fabrication, and placement of reinforcing steel shall be in accordance with the latest edition of ACI 315: "Manual of Standard Practice for Detailing Concrete Structures"
- Horizontal footing and wall reinforcement shall be continuous and shall have 90° bends, or corner bars with the same size/spacing as the horizontal reinforcement with a class B tension splice.
- Lap reinforcement as required, a minimum of 40 bar diameters for tension or compression unless otherwise noted. Splices in masonry shall be a minimum of 48 bar diameters.
- Where reinforcing dowels are required, they shall be equivalent in size and spacing to the vertical reinforcement. The dowel shall extend 48 bar diameters vertically and 20 bar diameters into the footing.
- Where reinforcing steel is required vertically, dowels shall be provided unless otherwise noted.

WOOD FRAMING:

- Solid sawn wood framing members shall conform to the specifications listed in the latest edition of the "National Design Specification for Wood Construction" (NDS). Unless otherwise noted, all wood framing members are designed to be Southern-Yellow-Pine (SYP) #2 or Spruce-Pine-Fir (SPF) #2.
- LVL or PSL engineered wood shall have the following minimum design values:
  - $E = 1,900,000$  psi
  - $F_b = 2600$  psi
  - $F_v = 285$  psi
  - $F_c = 700$  psi
- Wood in contact with concrete, masonry, or earth shall be pressure treated in accordance with AWPAs standard C-15. All other moisture exposed wood shall be treated in accordance with AWPAs standard C-2
- Nails shall be common wire nails unless otherwise noted.
- Lag screws shall conform to ANSI/ASME standard B18.2.1-1981. Lead holes for lag screws shall be in accordance with NDS specifications.
- All beams shall have full bearing on supporting framing members unless otherwise noted.
- Exterior and load bearing stud walls are to be 2x4 SYP #2/SPF #2 @ 16" O.C. unless otherwise noted. Studs shall be continuous from the sole plate to the double top plate. Studs shall only be discontinuous at headers for window/door openings. A minimum of one king stud shall be placed at each end of the header. King studs shall be continuous.

- Individual studs forming a column shall be attached with one 10d nail @ 6" O.C. staggered. The stud column shall be continuous to the foundation or beam. The column shall be properly blocked at all floor levels to ensure proper load transfer.
- Multi-ply beams shall have each ply attached with (3) 12d nails @ 12" O.C.
- Four and five ply beams shall be bolted together with (2) rows of 1/2" diameter through bolts staggered @ 24" O.C. unless noted otherwise.
- All fasteners that will be exposed to the elements shall be hot dipped galvanized.

WOOD TRUSSES:

- The wood truss manufacturer/fabricator is responsible for the design of the wood trusses. Submit sealed shop drawings and supporting calculations to the SER for review prior to fabrication. The SER shall have a minimum of five (5) days for review. The review by the SER shall review for overall compliance with the design documents. The SER shall assume no responsibility for the correctness for the structural design for the wood trusses.
- The wood trusses shall be designed for all required loadings as specified in the local building code, the ASCE Standard "Minimum Design Loads for Buildings and Other Structures." (ASCE 7-16), and the loading requirements shown on these specifications. The truss drawings shall be coordinated with all other construction documents and provisions provided for loads shown on these drawings including but not limited to HVAC equipment, piping, and architectural fixtures attached to the trusses.
- The trusses shall be designed, fabricated, and erected in accordance with the latest edition of the "National Design Specification for Wood Construction." (NDS) and "Design Specification for Metal Plate Connected Wood Trusses."
- The truss manufacturer shall provide adequate bracing information in accordance with "Commentary and Recommendations for Handling, Installing, and Bracing Metal Plate Connected Wood Trusses" (HIB-91). This bracing, both temporary and permanent, shall be shown on the shop drawings. Also, the shop drawings shall show the required attachments for the trusses.
- Any chords or truss webs shown on these drawings have been shown as a reference only. The final design of the trusses shall be per the manufacturer.


EXTERIOR WOOD FRAMED DECKS:

- Decks are to be framed in accordance with local building codes and as referenced on the structural plans, either through code references or construction details.

WOOD STRUCTURAL PANELS:

- Fabrication and placement of structural wood sheathing shall be in accordance with the APA Design/Construction Guide "Residential and Commercial," and all other applicable APA standards.
- All structurally required wood sheathing shall bear the mark of the APA.
- Wood wall sheathing shall comply with the requirements of local building codes for the appropriate state as indicated on these drawings. Refer to wall bracing notes in plan set for more information. Sheathing shall be applied with the long direction perpendicular to framing, unless noted otherwise.

- Roof sheathing shall be APA rated sheathing exposure 1 or 2. Roof sheathing shall be continuous over two supports and attached to its supporting roof framing with (1)-8d CC nail at 6"o/c at panel edges and at 12"o/c in panel field unless otherwise noted on the plans. Sheathing shall be applied with the long direction perpendicular to framing. Sheathing shall have a span rating consistent with the framing spacing. Use suitable edge support by use of plywood clips or lumber blocking unless otherwise noted. Panel end joints shall occur over framing. Apply building paper over the sheathing as required by the state Building Code.
- Wood floor sheathing shall be APA rated sheathing exposure 1 or 2. Attach sheathing to its supporting framing with (1)-8d CC ringshank nail at 6"o/c at panel edges and at 12"o/c in panel field unless otherwise noted on the plans. Sheathing shall have a span rating consistent with the framing spacing. Use suitable edge support by use of 1&6 plywood or lumber blocking unless otherwise noted. Panel end joints shall occur over framing. Apply building paper over the sheathing as required by the state Building Code.
- Sheathing shall have a 1/8" gap at panel ends and edges as recommended in accordance with the APA.

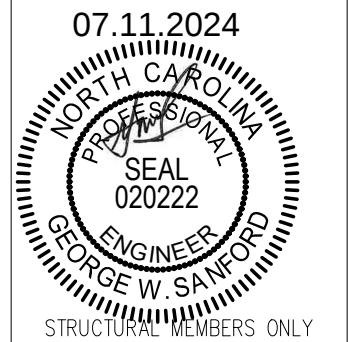

FOUNDATION NOTES:

- FOUNDATIONS TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 4 OF THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE WITH ALL LOCAL AND STATE AMENDMENTS.
- STRUCTURAL CONCRETE TO BE  $F_c = 3000$  PSI, PREPARED AND PLACED IN ACCORDANCE WITH ACI STANDARD 318.
- FOOTINGS TO BE PLACED ON UNDISTURBED EARTH, BEARING A MINIMUM OF 12" BELOW ADJACENT FINISHED GRADE, OR AS OTHERWISE DIRECTED BY THE CODE ENFORCEMENT OFFICIAL.
- FOOTING SIZES BASED ON A PRESUMPTIVE SOIL BEARING CAPACITY OF 2000 PSF. CONTRACTOR IS SOLELY RESPONSIBLE FOR VERIFYING THE SUITABILITY OF THE SITE SOIL CONDITIONS AT THE TIME OF CONSTRUCTION.
- FOOTINGS AND PIERS SHALL BE CENTERED UNDER THEIR RESPECTIVE ELEMENTS. PROVIDE 2" MINIMUM FOOTING PROJECTION FROM THE FACE OF MASONRY.
- MAXIMUM DEPTH OF UNBALANCED FILL AGAINST MASONRY WALLS TO BE AS SPECIFIED IN SECTION R404.1 OF THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.
- PILASTERS TO BE BONDED TO PERIMETER FOUNDATION WALL.
- PROVIDE FOUNDATION WATERPROOFING, AND DRAIN WITH POSITIVE SLOPE TO OUTLET AS REQUIRED BY SITE CONDITIONS.
- PROVIDED PERIMETER INSULATION FOR ALL FOUNDATIONS PER 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.
- CORBEL FOUNDATION WALL AS REQUIRED TO ACCOMMODATE BRICK VENEERS.
- CRAWL SPACE TO BE GRADED LEVEL, AND CLEARED OF ALL DEBRIS.
- FOUNDATION ANCHORAGE SHALL BE CONSTRUCTED PER THE 2018 NORTH CAROLINA RESIDENTIAL CODE SECTION R403.1.6. MINIMUM 1/2" DIA. BOLTS SPACED AT 6'-0" ON CENTER WITH A 7" MINIMUM EMBEDMENT INTO MASONRY OR CONCRETE. MINIMUM (2) ANCHOR BOLTS PER PLATE SECTION AND (1) LOCATED NOT MORE THAN 12" FROM THE CORNER. ANCHOR BOLTS SHALL BE LOCATED IN THE CENTER THIRD OF THE PLATE.
- ABBREVIATIONS:

DJ = DOUBLE JOIST      SJ = SINGLE JOIST  
FT = FLOOR TRUSS      SC = STUD COLUMN  
EE = EACH END      TJ = TRIPLE JOIST  
OC = ON CENTER      CL = CENTER LINE  
EW = EACH WAY      PL = POINT LOAD

- ALL PIERS TO BE 16"x16" MASONRY AND ALL PILASTERS TO BE 8"x16" MASONRY, TYPICAL. (UNO)
- WALL FOOTINGS TO BE CONTINUOUS CONCRETE, SIZES PER STRUCTURAL PLAN.
- A FOUNDATION EXCAVATION OBSERVATION SHOULD BE CONDUCTED BY A PROFESSIONAL GEOTECHNICAL ENGINEER, OR HIS QUALIFIED REPRESENTATIVE. IF ISOLATED AREAS OF YIELDING MATERIALS AND/OR POTENTIALLY EXPANSIVE SOILS ARE OBSERVED IN THE FOOTING EXCAVATIONS AT THE TIME OF CONSTRUCTION, UES PROFESSIONAL SOLUTIONS 29, INC. (UES) MUST BE PROVIDED THE OPPORTUNITY TO REVIEW THE FOOTING DESIGN PRIOR TO CONCRETE PLACEMENT.
- ALL FOOTINGS & SLABS ARE TO BEAR ON UNDISTURBED SOIL OR 95% COMPACTED FILL, VERIFIED BY ENGINEER OR CODE OFFICIAL.

REFER TO BRACED WALL PLAN FOR PANEL LOCATIONS AND ANY REQUIRED HOLD-DOWNS. ADDITIONAL INFORMATION PER SECTION R602.10.8 AND FIGURE R602.10.7 OF THE 2018 NCRC.

NOTE: ALL EXTERIOR FOUNDATION DIMENSIONS ARE TO FRAMING AND NOT BRICK VENEER, UNO

NOTE: A 4" CRUSHED STONE BASE COURSE IS NOT REQUIRED WHEN SLAB IS INSTALLED ON WELL-DRAINED OR SAND-GRAVEL MIXTURE SOILS CLASSIFIED AS GROUP PER TABLE R405.1

NOTE: FOUNDATION ANCHORAGE HAS BEEN DESIGNED TO RESIST THE CONTINUOUS WIND UPLIFT LOAD PATH IN ACCORDANCE WITH METHOD 3 OF SECTION R602.3.5 OF THE 2018 NCRC.

THESE PLANS ARE DESIGNED IN ACCORDANCE WITH ARCHITECTURAL PLANS PROVIDED BY DR. HORTON COMPLETED/REVISED ON 4/15/21. IT IS THE RESPONSIBILITY OF THE CLIENT TO NOTIFY UES PROFESSIONAL SOLUTIONS 29, INC. (UES) IF ANY CHANGES ARE MADE TO THE ARCHITECTURAL PLANS PRIOR TO CONSTRUCTION. UES PROFESSIONAL SOLUTIONS 29, INC. (UES) CANNOT GUARANTEE THE ADEQUACY OF THESE STRUCTURAL PLANS WHEN USED WITH ARCHITECTURAL PLANS DATED DIFFERENTLY THAN THE DATE LISTED ABOVE.


STRUCTURAL MEMBERS ONLY

ENGINEERING SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS ON THIS DOCUMENT. SEAL DOES NOT INCLUDE CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES OR SAFETY PRECAUTIONS. ANY DEVIATIONS OR DISCREPANCIES ON PLANS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF UES PROFESSIONAL SOLUTIONS 29, INC. (UES). FAILURE TO DO SO WILL VOID UES LIABILITY.

STRUCTURAL ANALYSIS BASED ON 2018 NCRC.

MONOLITHIC SLAB FOUNDATION PLAN

SCALE: 1/4"=1'-0" ON 22"x34" OR 1/8"=1'-0" ON 11"x17"

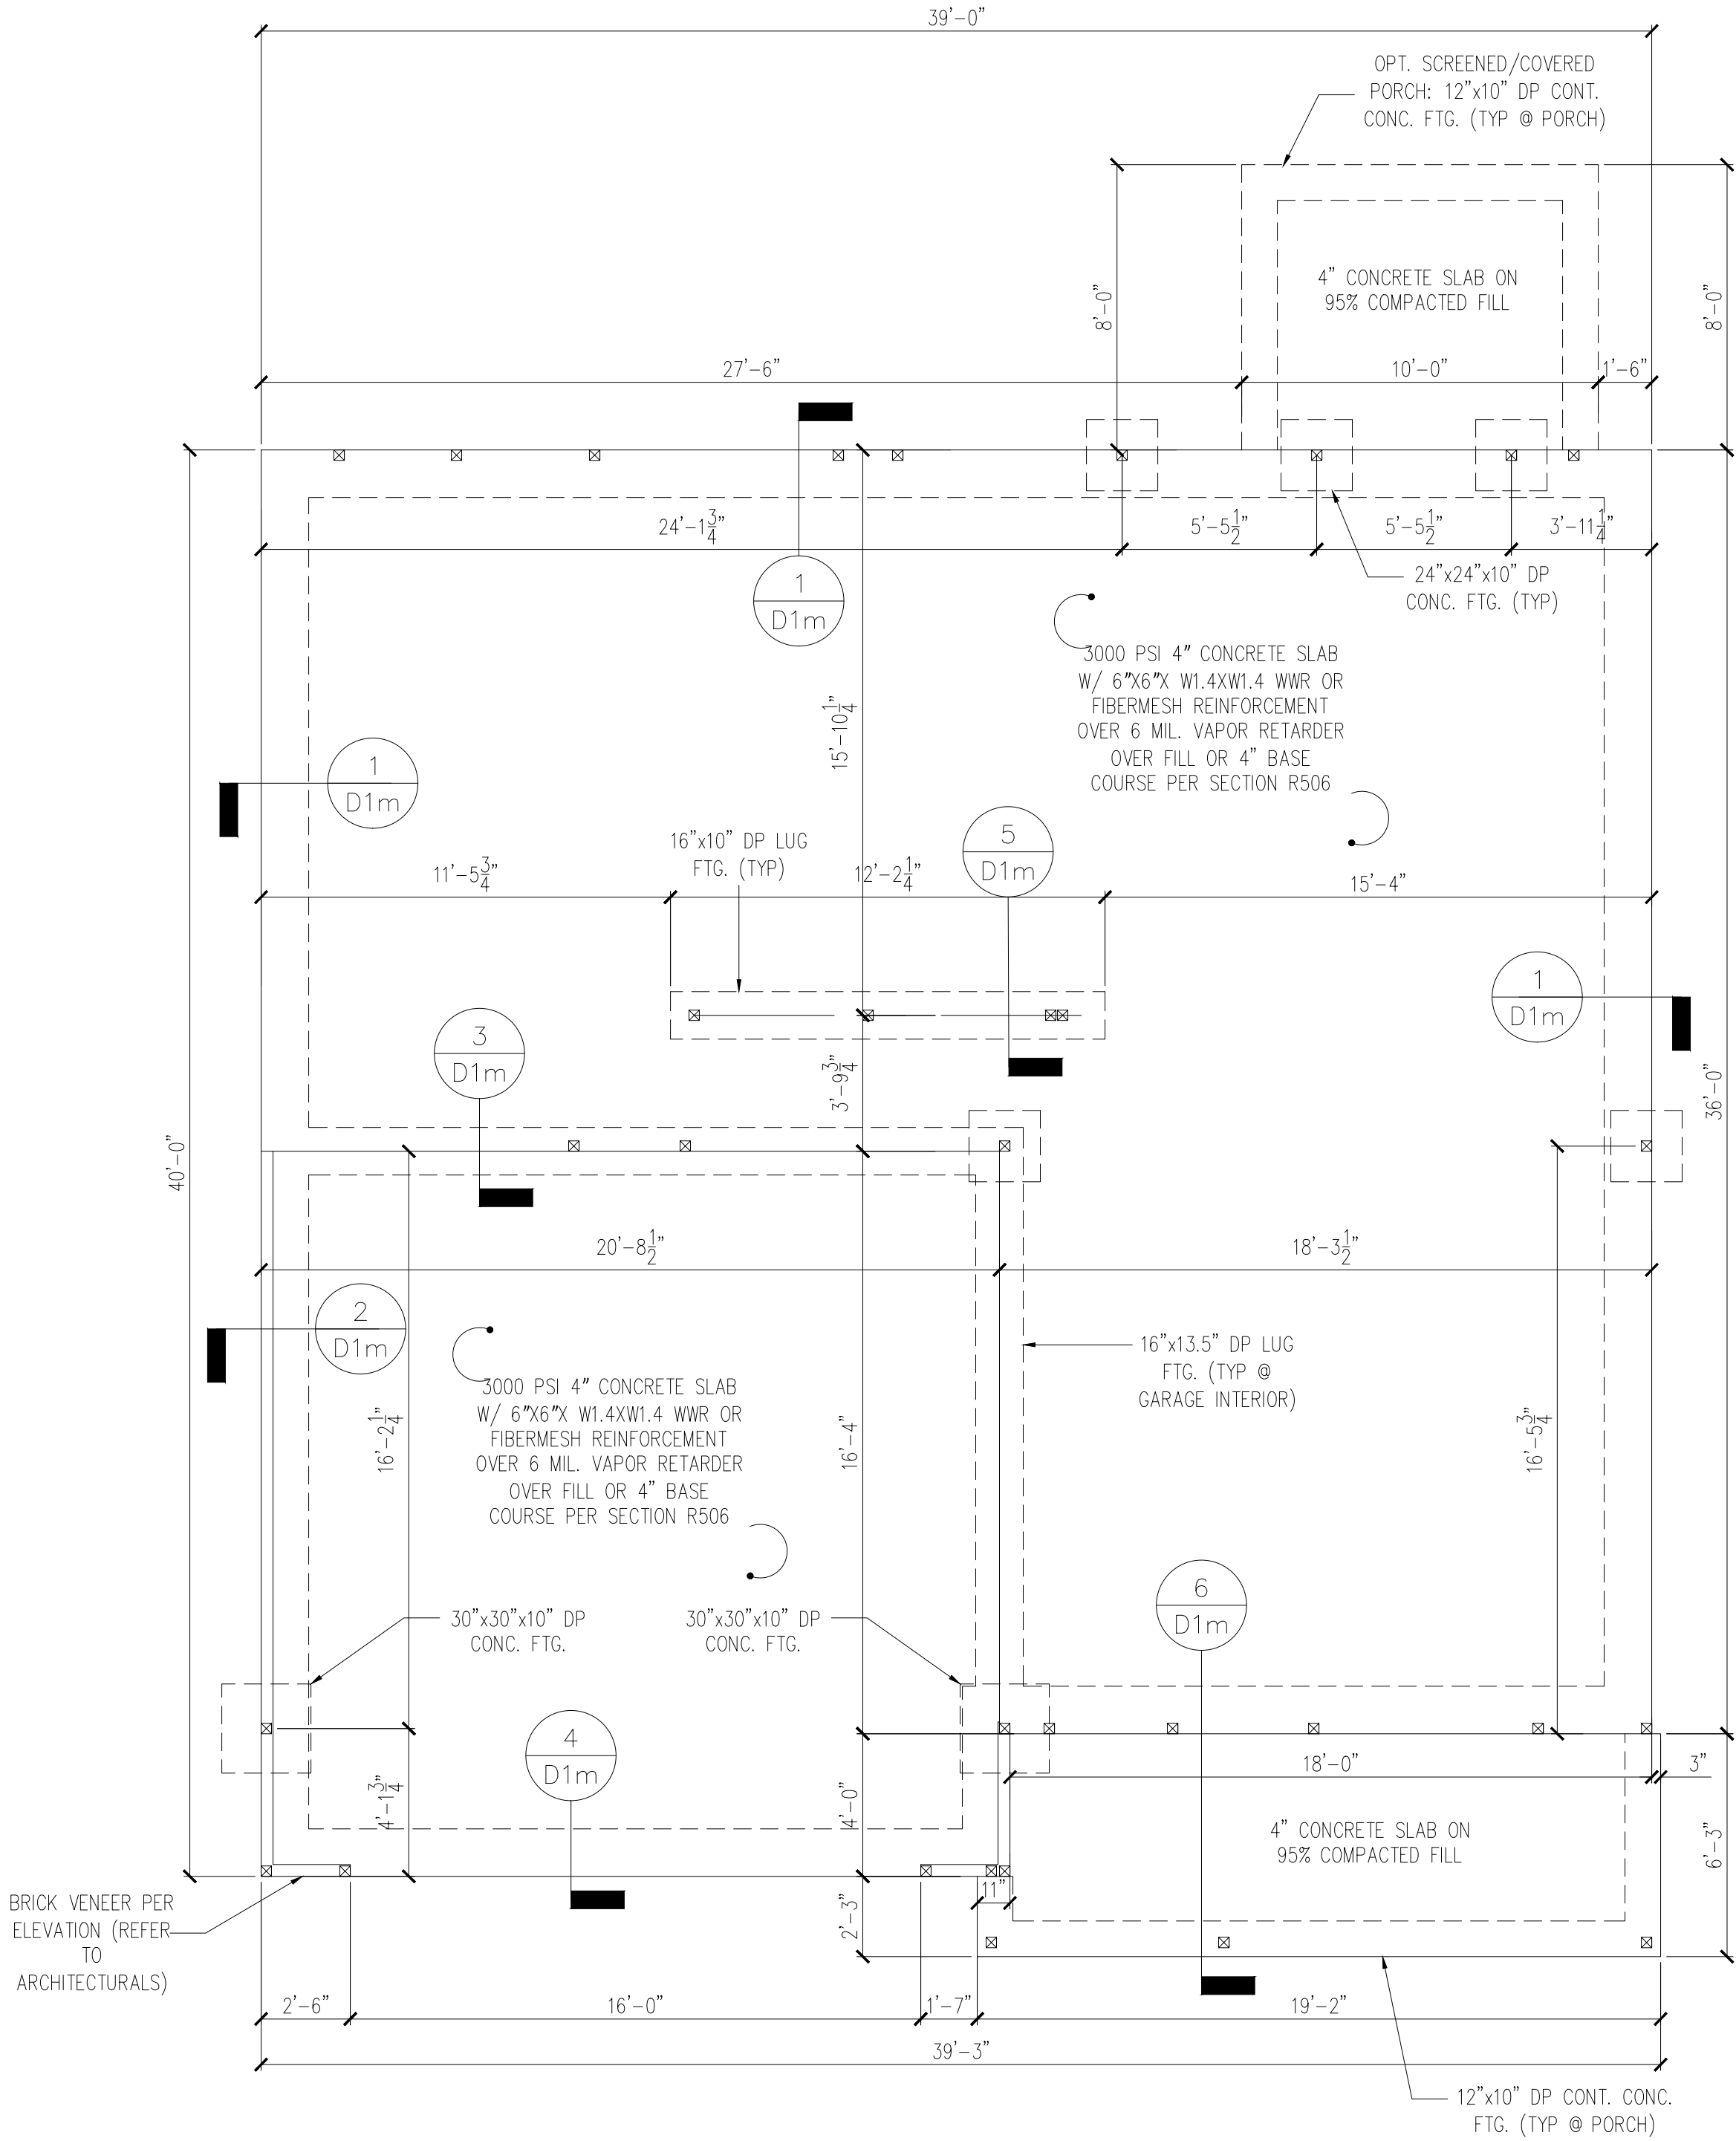

ELEVATION B,F,K



STRUCTURAL MEMBERS ONLY

DATE: 07/10/2024  
SCALE: 22x34 1/4"=1'-0"  
11x17 1/8"=1'-0"  
PROJECT #: A24117.01222.000  
DRAWN BY: ED  
CHECKED BY: CWS

22859 5/15/19

REFER TO COVER SHEET FOR A COMPLETE LIST OF REVISIONS

SHEET

S1.1m

| REQUIRED BRACED WALL PANEL CONNECTIONS |                       |                |                             |                             |
|----------------------------------------|-----------------------|----------------|-----------------------------|-----------------------------|
| METHOD                                 | MATERIAL              | MIN. THICKNESS | REQUIRED CONNECTION         |                             |
|                                        |                       |                | @ PANEL EDGES               | @ INTERMEDIATE SUPPORTS     |
| CS-WSP                                 | WOOD STRUCTURAL PANEL | 3/8"           | 6d COMMON NAILS @ 6" O.C.   | 6d COMMON NAILS @ 12" O.C.  |
| GB                                     | GYPSUM BOARD          | 1/2"           | 5d COOLER NAILS** @ 7" O.C. | 5d COOLER NAILS** @ 7" O.C. |
| WSP                                    | WOOD STRUCTURAL PANEL | 3/8"           | 6d COMMON NAILS @ 6" O.C.   | 6d COMMON NAILS @ 12" O.C.  |
| PF                                     | WOOD STRUCTURAL PANEL | 7/16"          | PER FIGURE R602.10.6.4      | PER FIGURE R602.10.6.4      |
| **OR EQUIVALENT PER TABLE R702.3.5     |                       |                |                             |                             |

BRACED WALL NOTES:

- WALLS SHALL BE DESIGNED IN ACCORDANCE WITH SECTION R602.10 FROM THE 2018 NORTH CAROLINA RESIDENTIAL CODE WITH ALL LOCAL AND STATE AMENDMENTS.
- WALLS ARE DESIGNED FOR SEISMIC ZONES A-C AND MAXIMUM WIND SPEEDS UP TO 130 MPH.
- REFER TO ARCHITECTURAL PLAN FOR DOOR/WINDOW OPENING SIZES.
- BRACING MATERIALS, METHODS AND FASTENERS SHALL BE IN ACCORDANCE WITH TABLE R602.10.1
- ALL BRACED WALL PANELS SHALL BE FULL WALL HEIGHT AND SHALL NOT EXCEED 10 FEET FOR ISOLATED PANEL METHOD AND 12 FEET FOR CONTINUOUS SHEATHING METHOD WITHOUT ADDITIONAL ENGINEERING CALCULATIONS.
- MINIMUM PANEL LENGTH SHALL BE PER TABLE R602.10.1.
- THE INTERIOR SIDE OF EXTERIOR WALLS AND BOTH SIDES OF INTERIOR WALLS SHALL BE SHEATHED CONTINUOUSLY WITH MINIMUM 1/2" GYPSUM BOARD (UNO).
- FOR CONTINUOUS SHEATHING METHOD, EXTERIOR WALLS SHALL BE SHEATHED ON ALL SHEATHABLE SURFACES INCLUDING INFILL AREAS BETWEEN BRACED WALL PANELS, ABOVE AND BELOW WALL OPENINGS, AND ON GABLE END WALLS.
- FLOORS SHALL NOT BE CANTILEVERED MORE THAN 24" BEYOND THE FOUNDATION OR BEARING WALL BELOW WITHOUT ADDITIONAL ENGINEERING CALCULATIONS.
- A BRACED WALL PANEL SHALL BE LOCATED WITHIN 12 FEET OF EACH END OF A BRACED WALL LINE.
- THE MAXIMUM EDGE DISTANCE BETWEEN BRACED WALL PANELS SHALL NOT EXCEED 21 FEET.
- MASONRY OR CONCRETE STEM WALLS w/ A LENGTH OF 48" OR LESS SUPPORTING A BRACED WALL PANEL SHALL BE DESIGNED IN ACCORDANCE WITH FIGURE R602.10.4.3 OF THE 2018 NCRS.
- BRACED WALL PANEL CONNECTIONS TO FLOOR/CEILING SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION R602.10.4.4
- BRACED WALL PANEL CONNECTIONS TO ROOF SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION R602.10.4.5
- CRIPPLE WALLS AND WALK OUT BASEMENT WALLS SHALL BE DESIGNED IN ACCORDANCE WITH SECTION R602.10.4.6
- PORTAL WALLS SHALL BE DESIGNED IN ACCORDANCE WITH FIGURE R602.10.1 (UNO)
- ABBREVIATIONS:

GB = GYPSUM BOARD  
CS-XXX = CONT. SHEATHED  
PF = PORTAL FRAME

WSP = WOOD STRUCTURAL PANEL  
ENG = ENGINEERED SOLUTION  
PF-ENG = ENG. PORTAL FRAME

GENERAL STRUCTURAL NOTES:

- CONSTRUCTION SHALL CONFORM TO 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE WITH ALL LOCAL AND STATE AMENDMENTS.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS. CONTRACTOR SHALL COMPLY WITH THE CONTENTS OF THE DRAWING FOR THIS SPECIFIC PROJECT. ENGINEER IS NOT RESPONSIBLE FOR ANY DEVIATIONS FROM THIS PLAN.
- CONTRACTOR IS RESPONSIBLE FOR PROVIDING TEMPORARY BRACING REQUIRED TO RESIST ALL FORCES ENCOUNTERED DURING ERECTION.
- PROPERTIES USED IN THE DESIGN ARE AS FOLLOWS:  
MICROLAM (LVL):  $F_b = 2600$  PSI,  $F_v = 285$  PSI,  $E = 1.9 \times 10^6$  PSI  
PARALLAM (PSL):  $F_b = 2900$  PSI,  $F_v = 290$  PSI,  $E = 1.25 \times 10^6$  PSI
- ALL WOOD MEMBERS SHALL BE #2 SYP / SPF #2 UNLESS NOTED ON PLAN. ALL STUD COLUMNS AND JOISTS SHALL BE #2 SYP/SPF #2 (UNO).
- ALL BEAMS SHALL BE SUPPORTED WITH A (2) 2x4 #2 SYP/SPF #2 STUD COLUMN AT EACH END UNLESS NOTED OTHERWISE.
- ALL REINFORCING STEEL SHALL BE GRADE 60 BARS CONFORMING TO ASTM A615 AND SHALL HAVE A MINIMUM COVER OF 3".
- CONTRACTOR TO PROVIDED LOOKOUTS WHEN CEILING JOISTS SPAN PERPENDICULAR TO RAFTERS.
- FLITCH BEAMS, 4-PLY LVLS AND 3-PLY SIDE LOADED LVLS SHALL BE BOLTED TOGETHER WITH 1/2" DIA. THRU BOLTS SPACED AT 24" O.C. (MAX) STAGGERED OR EQUIVALENT CONNECTIONS PER DETAIL 1/D3f. MIN. EDGE DISTANCE SHALL BE 2" AND (2) BOLTS SHALL BE LOCATED MINIMUM 6" FROM EACH END OF THE BEAM.
- ALL NON-LOAD BEARING HEADERS SHALL BE (1) FLAT 2x4 SYP #2/SPF #2, DROPPED. FOR NON-LOAD BEARING HEADERS EXCEEDING 8'-0" IN WIDTH AND/OR WITH MORE THAN 2'-0" OF CRIPPLE WALL ABOVE, SHALL BE (2) FLAT 2x4 SYP #2/SPF #2, DROPPED. (UNLESS NOTED OTHERWISE)

THESE PLANS ARE DESIGNED IN ACCORDANCE WITH ARCHITECTURAL PLANS PROVIDED BY DR HORTON COMPLETED/REVISED ON 4/15/21. IT IS THE RESPONSIBILITY OF THE CLIENT TO NOTIFY UES PROFESSIONAL SOLUTIONS 29, INC. (UES) IF ANY CHANGES ARE MADE TO THE ARCHITECTURAL PLANS PRIOR TO CONSTRUCTION. UES PROFESSIONAL SOLUTIONS 29, INC. (UES) CANNOT GUARANTEE THE ADEQUACY OF THESE STRUCTURAL PLANS WHEN USED WITH ARCHITECTURAL PLANS DATED DIFFERENTLY THAN THE DATE LISTED ABOVE.

STRUCTURAL MEMBERS ONLY


ENGINEERING SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS ON THIS DOCUMENT. SEAL DOES NOT INCLUDE CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES OR SAFETY PRECAUTIONS. ANY DEVIATIONS OR DISCREPANCIES ON PLANS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF UES PROFESSIONAL SOLUTIONS 29, INC. (UES). FAILURE TO DO SO WILL VOID UES LIABILITY.

STRUCTURAL ANALYSIS BASED ON 2018 NCRS.

FIRST FLOOR FRAMING PLAN

SCALE: 1/4"=1'-0" ON 22"x34" OR 1/8"=1'-0" ON 11"x17"

| FIRST FLOOR BRACING (FT)    |          |          |
|-----------------------------|----------|----------|
| CONTINUOUS SHEATHING METHOD |          |          |
|                             | REQUIRED | PROVIDED |
| BWL 1-1                     | 11.6     | 24.8     |
| BWL 1-2                     | 11.6     | 15.0     |
| BWL 1-A                     | 11.3     | 40.0     |
| BWL 1-B                     | 11.3     | 36.0     |

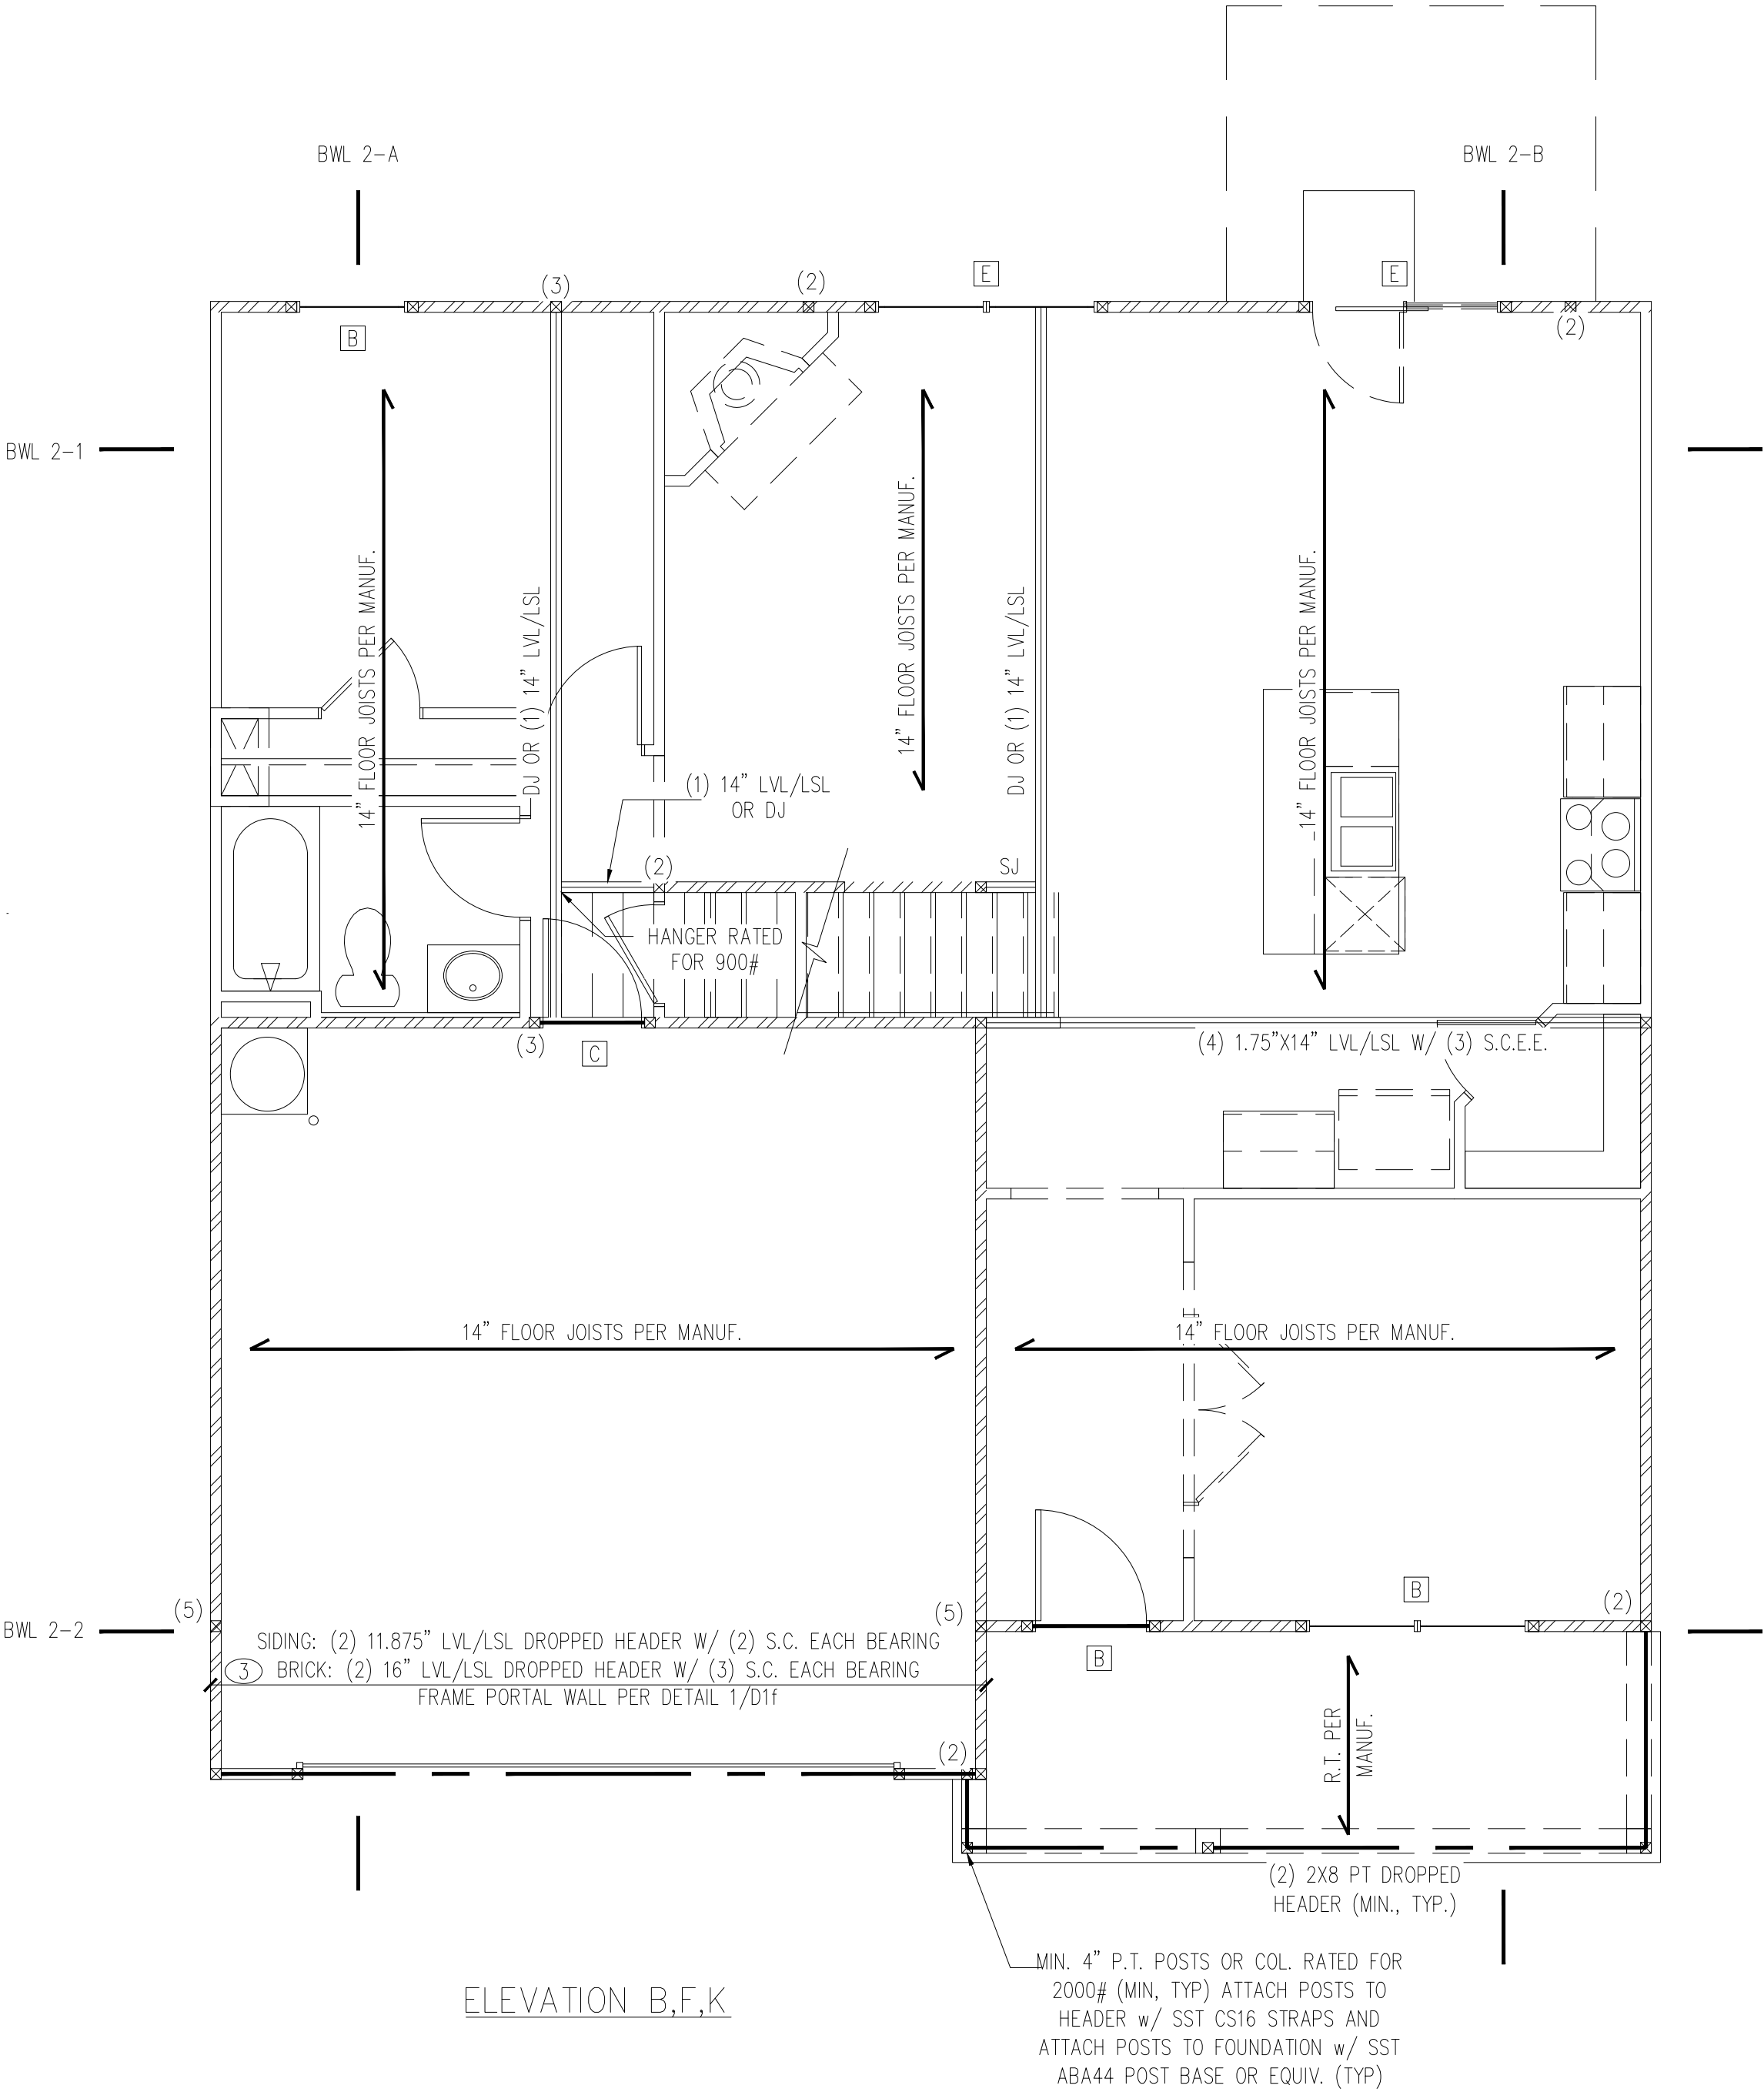

| HEADER SCHEDULE |                     |                  |
|-----------------|---------------------|------------------|
| TAG             | SIZE                | JACKS (EACH END) |
| A               | (2) 2x6             | (1)              |
| B               | (2) 2x8             | (2)              |
| C               | (2) 2x10            | (2)              |
| D               | (2) 2x12            | (2)              |
| E               | (2) 9-1/4\" LSL/LVL | (3)              |
| F               | (3) 2x6             | (1)              |
| G               | (3) 2x8             | (2)              |
| H               | (3) 2x10            | (2)              |
| I               | (3) 2x12            | (2)              |

- NOTES:
- HEADER SIZES SHOWN ON PLANS ARE MINIMUMS. GREATER HEADER SIZES MAY BE USED FOR EASE OF CONSTRUCTION.
  - ALL HEADERS TO BE DROPPED (U.N.O.).
  - STUD COLUMNS NOTED ON PLAN OVERRIDE STUD COLUMNS LISTED ABOVE (U.N.O.).

| KING STUD SCHEDULE  |                         |
|---------------------|-------------------------|
| MAXIMUM HEADER SPAN | MINIMUM KING STUDS E.E. |
| 4'-0"               | (1)                     |
| 6'-0"               | (2)                     |
| 8'-0"               | (2)                     |
| 10'-0"              | (3)                     |
| 12'-0"              | (3)                     |
| 14'-0"              | (3)                     |
| 16'-0"              | (4)                     |
| 18'-0"              | (4)                     |

| WALL STUD SCHEDULE (10 FT HEIGHT) |           |                     |                 |                  |
|-----------------------------------|-----------|---------------------|-----------------|------------------|
| STUD SIZE                         |           | STUD SPACING (O.C.) |                 |                  |
|                                   | ROOF ONLY | ROOF & 1 FLOOR      | ROOF & 2 FLOORS | NON-LOAD BEARING |
| 2x4                               | 24"       | 16"                 | 12"             | 24"              |
| 2x6                               | 24"       | 24"                 | 16"             | 24"              |

NOTES:

1. BRACED WALLS STUDS SHALL BE A MAX. OF 16" O.C.
2. STUDS SUPPORTS OPTIONAL WALK-UP ATTIC SHALL BE SPACED A MAX. OF 16" O.C.
3. TWO STORY WALLS SHALL BE FRAMED w/ 2x4 STUDS @ 12" O.C. OR 2x6 STUDS @ 16" O.C. BALLOON FRAMED w/ HORIZ. BLOCKING @ 6'-0" O.C. VERTICALLY.

| LINTEL SCHEDULE |                                 |                     |
|-----------------|---------------------------------|---------------------|
| TAG             | SIZE                            | OPENING SIZE        |
| ①               | L3x3x1/4"                       | LESS THAN 6'-0"     |
| ②               | L5x3x1/4"                       | 6'-0" TO 10'-0"     |
| ③               | L5x3-1/2x5/16"                  | GREATER THAN 10'-0" |
| ④               | L5x3-1/2x5/16" ROLLED OR EQUIV. | ALL ARCHED OPENINGS |

SECURE LINTEL TO HEADER w/ (2) 1/2" DIAMETER LAG SCREWS STAGGERED @ 16" O.C. (TYP FOR )

ALL HEADERS WHERE BRICK IS USED, TO BE: (UNO)

- SHADED WALLS INDICATED LOAD BEARING WALLS
- NOTE: REDUCE JOIST SPACING UNDER TILE FLOORS, GRANITE COUNTERTOPS AND/OR ISLANDS.
- JOIST & BEAM SIZES SHOWN ARE MINIMUMS. BUILDER MAY INCREASE DEPTH FOR EASE OF CONSTRUCTION.
- NOTE: — = — DESIGNATES JOIST SUPPORTED LOAD BEARING WALL ABOVE. PROVIDE BLOCKING UNDER JOIST SUPPORTED LOAD BEARING WALL.
- NOTE: MEMBERS NOTED AS PRESSURE TREATED MAY BE FRAMED WITH NON-PRESSURE TREATED LUMBER PROVIDED THE ENTIRETY OF THE MEMBER IS WRAPPED TO PREVENT MOISTURE INTRUSION.
- INSTALL HOLD-DOWNS FOR BRACED WALL END CONDITIONS PER SECTION R602.10.8 & FIG. R602.10.7 OF THE 2018 NCRS.
- NOTE: WALL SHEATHING AND FASTENERS HAVE BEEN DESIGNED TO RESIST THE CONTINUOUS WIND UPLIFT LOAD PATH IN ACCORDANCE WITH METHOD 3 OF SECTION R602.3.5 OF THE 2018 NCRS.

UES PROFESSIONAL SOLUTIONS 29, INC.  
FORMERLY SUMMIT ENGINEERING,  
LABORATORY & TESTING, INC.

10121 Pineville Distribution St  
Pineville, NC 28134  
Office: 704.504.1117  
Fax: 704.504.1125  
www.uesna.com

DR Horton, Inc.  
8001 Arrowridge Blvd.  
Charlotte, NC 28273

Hayden LH  
First Floor Framing Plan

07.11.2024

STRUCTURAL MEMBERS ONLY

DATE: 07/10/2024  
SCALE: 22x34 1/4"=1'-0"  
11x17 1/8"=1'-0"  
PROJECT #: A24117.01222.000  
DRAWN BY: ED  
CHECKED BY: CWS

22869 5/15/19

REFER TO COVER SHEET FOR A COMPLETE LIST OF REVISIONS

SHEET

S3.1

| REQUIRED BRACED WALL PANEL CONNECTIONS |                       |                |                             |                             |
|----------------------------------------|-----------------------|----------------|-----------------------------|-----------------------------|
| METHOD                                 | MATERIAL              | MIN. THICKNESS | REQUIRED CONNECTION         |                             |
|                                        |                       |                | @ PANEL EDGES               | @ INTERMEDIATE SUPPORTS     |
| CS-WSP                                 | WOOD STRUCTURAL PANEL | 3/8"           | 6d COMMON NAILS @ 6" O.C.   | 6d COMMON NAILS @ 12" O.C.  |
|                                        |                       |                | 5d COOLER NAILS** @ 7" O.C. | 5d COOLER NAILS** @ 7" O.C. |
| GB                                     | GYPSUM BOARD          | 1/2"           |                             |                             |
| WSP                                    | WOOD STRUCTURAL PANEL | 3/8"           | 6d COMMON NAILS @ 6" O.C.   | 6d COMMON NAILS @ 12" O.C.  |
| PF                                     | WOOD STRUCTURAL PANEL | 7/16"          | PER FIGURE R602.10.6.4      | PER FIGURE R602.10.6.4      |
| **OR EQUIVALENT PER TABLE R702.3.5     |                       |                |                             |                             |

BRACED WALL NOTES:

1. WALLS SHALL BE DESIGNED IN ACCORDANCE WITH SECTION R602.10 FROM THE 2018 NORTH CAROLINA RESIDENTIAL CODE WITH ALL LOCAL AND STATE AMENDMENTS.
2. WALLS ARE DESIGNED FOR SEISMIC ZONES A-C AND MAXIMUM WIND SPEEDS UP TO 130 MPH.
3. REFER TO ARCHITECTURAL PLAN FOR DOOR/WINDOW OPENING SIZES.
4. BRACING MATERIALS, METHODS AND FASTENERS SHALL BE IN ACCORDANCE WITH TABLE R602.10.1
5. ALL BRACED WALL PANELS SHALL BE FULL WALL HEIGHT AND SHALL NOT EXCEED 10 FEET FOR ISOLATED PANEL METHOD AND 12 FEET FOR CONTINUOUS SHEATHING METHOD WITHOUT ADDITIONAL ENGINEERING CALCULATIONS.
6. MINIMUM PANEL LENGTH SHALL BE PER TABLE R602.10.1.
7. THE INTERIOR SIDE OF EXTERIOR WALLS AND BOTH SIDES OF INTERIOR WALLS SHALL BE SHEATHED CONTINUOUSLY WITH MINIMUM 1/2" GYPSUM BOARD (UNO).
8. FOR CONTINUOUS SHEATHING METHOD, EXTERIOR WALLS SHALL BE SHEATHED ON ALL SHEATHABLE SURFACES INCLUDING INFILL AREAS BETWEEN BRACED WALL PANELS, ABOVE AND BELOW WALL OPENINGS, AND ON GABLE END WALLS.
9. FLOORS SHALL NOT BE CANTILEVERED MORE THAN 24" BEYOND THE FOUNDATION OR BEARING WALL BELOW WITHOUT ADDITIONAL ENGINEERING CALCULATIONS.
10. A BRACED WALL PANEL SHALL BE LOCATED WITHIN 12 FEET OF EACH END OF A BRACED WALL LINE.
11. THE MAXIMUM EDGE DISTANCE BETWEEN BRACED WALL PANELS SHALL NOT EXCEED 21 FEET.
12. MASONRY OR CONCRETE STEM WALLS w/ A LENGTH OF 48" OR LESS SUPPORTING A BRACED WALL PANEL SHALL BE DESIGNED IN ACCORDANCE WITH FIGURE R602.10.4.3 OF THE 2018 NCR.
13. BRACED WALL PANEL CONNECTIONS TO FLOOR/CEILING SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION R602.10.4.4
14. BRACED WALL PANEL CONNECTIONS TO ROOF SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION R602.10.4.5
15. CRIPPLE WALLS AND WALK OUT BASEMENT WALLS SHALL BE DESIGNED IN ACCORDANCE WITH SECTION R602.10.4.6
16. PORTAL WALLS SHALL BE DESIGNED IN ACCORDANCE WITH FIGURE R602.10.1 (UNO)
17. ABBREVIATIONS:

GB = GYPSUM BOARD

CS-XXX = CONT. SHEATHED

PF = PORTAL FRAME

WSP = WOOD STRUCTURAL PANEL

ENG = ENGINEERED SOLUTION

PF-ENG = ENG. PORTAL FRAME

GENERAL STRUCTURAL NOTES:

1. CONSTRUCTION SHALL CONFORM TO 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE WITH ALL LOCAL AND STATE AMENDMENTS.
2. CONTRACTOR SHALL VERIFY ALL DIMENSIONS. CONTRACTOR SHALL COMPLY WITH THE CONTENTS OF THE DRAWING FOR THIS SPECIFIC PROJECT. ENGINEER IS NOT RESPONSIBLE FOR ANY DEVIATIONS FROM THIS PLAN.
3. CONTRACTOR IS RESPONSIBLE FOR PROVIDING TEMPORARY BRACING REQUIRED TO RESIST ALL FORCES ENCOUNTERED DURING ERECTION.
4. PROPERTIES USED IN THE DESIGN ARE AS FOLLOWS:

MICROLAM (LVL): F<sub>b</sub> = 2600 PSI, F<sub>v</sub> = 285 PSI, E = 1.9x10<sup>6</sup> PSI

PARALLAM (PSL): F<sub>b</sub> = 2900 PSI, F<sub>v</sub> = 290 PSI, E = 1.25x10<sup>6</sup> PSI
5. ALL WOOD MEMBERS SHALL BE #2 SYP / SPF #2 UNLESS NOTED ON PLAN. ALL STUD COLUMNS AND JOISTS SHALL BE #2 SYP/SPF #2 (UNO).
6. ALL BEAMS SHALL BE SUPPORTED WITH A (2) 2x4 #2 SYP/SPF #2 STUD COLUMN AT EACH END UNLESS NOTED OTHERWISE.
7. ALL REINFORCING STEEL SHALL BE GRADE 60 BARS CONFORMING TO ASTM A615 AND SHALL HAVE A MINIMUM COVER OF 3".
8. CONTRACTOR TO PROVIDED LOOKOUTS WHEN CEILING JOISTS SPAN PERPENDICULAR TO RAFTERS.
9. FLITCH BEAMS, 4-PLY LVLS AND 3-PLY SIDE LOADED LVLS SHALL BE BOLTED TOGETHER WITH 1/2" DIA. THRU BOLTS SPACED AT 24" O.C. (MAX) STAGGERED OR EQUIVALENT CONNECTIONS PER DETAIL 1/D3f. MIN. EDGE DISTANCE SHALL BE 2" AND (2) BOLTS SHALL BE LOCATED MINIMUM 6" FROM EACH END OF THE BEAM.
10. ALL NON-LOAD BEARING HEADERS SHALL BE (1) FLAT 2x4 SYP #2/SPF #2, DROPPED. FOR NON-LOAD BEARING HEADERS EXCEEDING 8'-0" IN WIDTH AND/OR WITH MORE THAN 2'-0" OF CRIPPLE WALL ABOVE, SHALL BE (2) FLAT 2x4 SYP #2/SPF #2, DROPPED. (UNLESS NOTED OTHERWISE)

THESE PLANS ARE DESIGNED IN ACCORDANCE WITH ARCHITECTURAL PLANS PROVIDED BY DR HORTON COMPLETED/REVISED ON 4/15/21. IT IS THE RESPONSIBILITY OF THE CLIENT TO NOTIFY UES PROFESSIONAL SOLUTIONS 29, INC. (UES) IF ANY CHANGES ARE MADE TO THE ARCHITECTURAL PLANS PRIOR TO CONSTRUCTION. UES PROFESSIONAL SOLUTIONS 29, INC. (UES) CANNOT GUARANTEE THE ADEQUACY OF THESE STRUCTURAL PLANS WHEN USED WITH ARCHITECTURAL PLANS DATED DIFFERENTLY THAN THE DATE LISTED ABOVE.

STRUCTURAL MEMBERS ONLY


ENGINEERING SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS ON THIS DOCUMENT. SEAL DOES NOT INCLUDE CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES OR SAFETY PRECAUTIONS. ANY DEVIATIONS OR DISCREPANCIES ON PLANS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF UES PROFESSIONAL SOLUTIONS 29, INC. (UES). FAILURE TO DO SO WILL VOID UES LIABILITY.

STRUCTURAL ANALYSIS BASED ON 2018 NCR.

SECOND FLOOR FRAMING PLAN

SCALE: 1/4"=1'-0" ON 22"x34" OR 1/8"=1'-0" ON 11"x17"

| SECOND FLOOR BRACING (FT)   |          |          |
|-----------------------------|----------|----------|
| CONTINUOUS SHEATHING METHOD |          |          |
|                             | REQUIRED | PROVIDED |
| BWL 2-1                     | 6.0      | 27.0     |
| BWL 2-2                     | 6.0      | 25.0     |
| BWL 2-A                     | 5.8      | 40.0     |
| BWL 2-B                     | 5.8      | 36.0     |

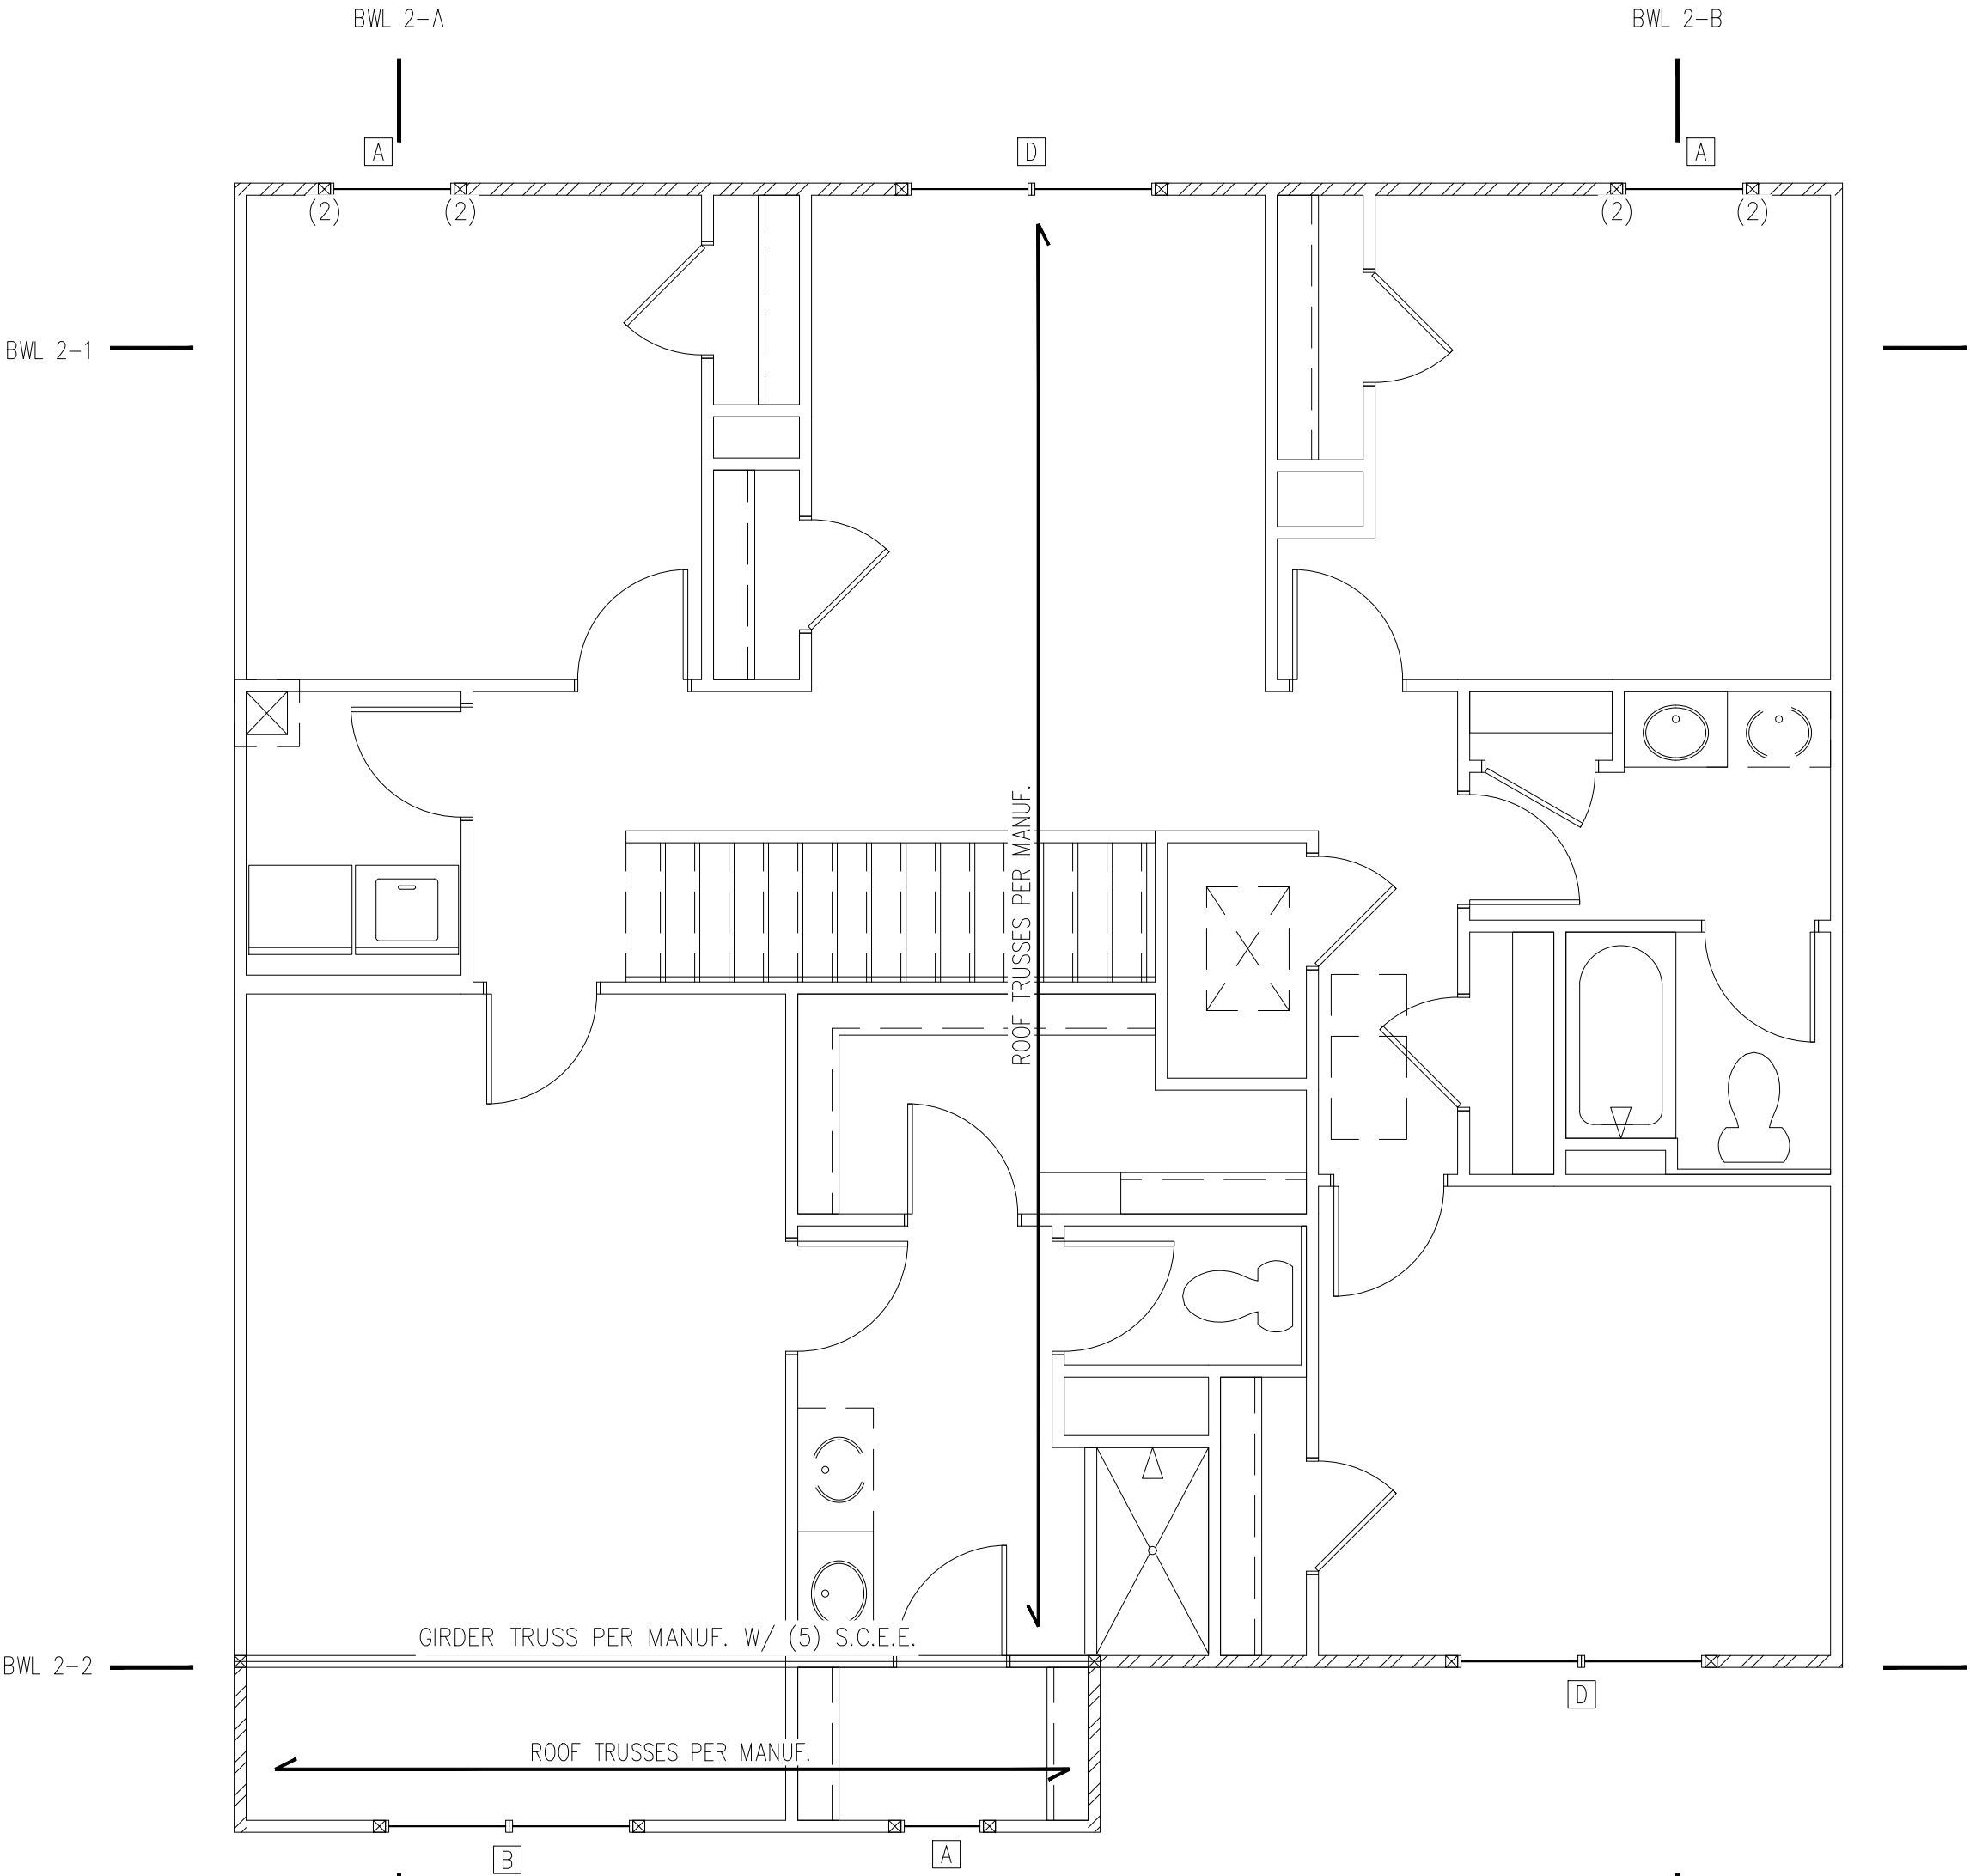

ELEVATION B,F,K

| HEADER SCHEDULE |                    |                  |
|-----------------|--------------------|------------------|
| TAG             | SIZE               | JACKS (EACH END) |
| A               | (2) 2x6            | (1)              |
| B               | (2) 2x8            | (2)              |
| C               | (2) 2x10           | (2)              |
| D               | (2) 2x12           | (2)              |
| E               | (2) 9-1/4" LSL/LVL | (3)              |
| F               | (3) 2x6            | (1)              |
| G               | (3) 2x8            | (2)              |
| H               | (3) 2x10           | (2)              |
| I               | (3) 2x12           | (2)              |

- NOTES:
1. HEADER SIZES SHOWN ON PLANS ARE MINIMUMS. GREATER HEADER SIZES MAY BE USED FOR EASE OF CONSTRUCTION.
2. ALL HEADERS TO BE DROPPED (U.N.O.).
3. STUD COLUMNS NOTED ON PLAN OVERRIDE STUD COLUMNS LISTED ABOVE (U.N.O.).

| KING STUD SCHEDULE  |                         |
|---------------------|-------------------------|
| MAXIMUM HEADER SPAN | MINIMUM KING STUDS E.E. |
| 4'-0"               | (1)                     |
| 6'-0"               | (2)                     |
| 8'-0"               | (2)                     |
| 10'-0"              | (3)                     |
| 12'-0"              | (3)                     |
| 14'-0"              | (3)                     |
| 16'-0"              | (4)                     |
| 18'-0"              | (4)                     |

| WALL STUD SCHEDULE (10 FT HEIGHT) |                     |                |                 |                  |
|-----------------------------------|---------------------|----------------|-----------------|------------------|
| STUD SIZE                         | STUD SPACING (O.C.) |                |                 |                  |
|                                   | ROOF ONLY           | ROOF & 1 FLOOR | ROOF & 2 FLOORS | NON-LOAD BEARING |
| 2x4                               | 24"                 | 16"            | 12"             | 24"              |
| 2x6                               | 24"                 | 24"            | 16"             | 24"              |

- NOTES:
1. BRACED WALLS STUDS SHALL BE A MAX. OF 16" O.C.
2. STUDS SUPPORTS OPTIONAL WALK-UP ATTIC SHALL BE SPACED A MAX. OF 16" O.C.
3. TWO STORY WALLS SHALL BE FRAMED w/ 2x4 STUDS @ 12" O.C. OR 2x6 STUDS @ 16" O.C. BALLOON FRAMED w/ HORIZ. BLOCKING @ 6'-0" O.C. VERTICALLY.

| LINTEL SCHEDULE                                                                           |                                 |                     |
|-------------------------------------------------------------------------------------------|---------------------------------|---------------------|
| TAG                                                                                       | SIZE                            | OPENING SIZE        |
| ①                                                                                         | L3x3x1/4"                       | LESS THAN 6'-0"     |
| ②                                                                                         | L5x3x1/4"                       | 6'-0" TO 10'-0"     |
| ③                                                                                         | L5x3-1/2x5/16"                  | GREATER THAN 10'-0" |
| ④                                                                                         | L5x3-1/2x5/16" ROLLED OR EQUIV. | ALL ARCHED OPENINGS |
| SECURE LINTEL TO HEADER w/ (2) 1/2" DIAMETER LAG SCREWS STAGGERED @ 16" O.C. (TYP FOR ③ ) |                                 |                     |
| ALL HEADERS WHERE BRICK IS USED, TO BE: (UNO)                                             |                                 |                     |


SHADED WALLS INDICATED LOAD BEARING WALLS

JOIST & BEAM SIZES SHOWN ARE MINIMUMS. BUILDER MAY INCREASE DEPTH FOR EASE OF CONSTRUCTION.

NOTE: MEMBERS NOTED AS PRESSURE TREATED MAY BE FRAMED WITH NON-PRESSURE TREATED LUMBER PROVIDED THE ENTIRETY OF THE MEMBER IS WRAPPED TO PREVENT MOISTURE INTRUSION.

INSTALL HOLD-DOWNS FOR BRACED WALL END CONDITIONS PER SECTION R602.10.8 & FIG. R602.10.7 OF THE 2018 NCR.

NOTE: WALL SHEATHING AND FASTENERS HAVE BEEN DESIGNED TO RESIST THE CONTINUOUS WIND UPLIFT LOAD PATH IN ACCORDANCE WITH METHOD 3 OF SECTION R602.3.5 OF THE 2018 NCR.

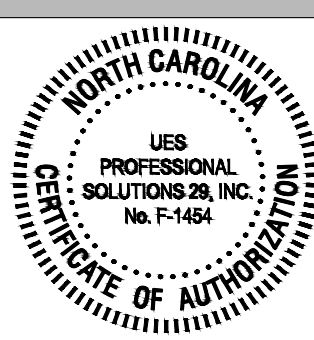

2 10/24/24 basement bath/bdr

DR Horton, Inc.  
8001 Arrowridge Blvd.  
Charlotte, NC 28273

Hayden LH  
Second Floor Framing Plan

07.11.2024



STRUCTURAL MEMBERS ONLY

DATE: 07/10/2024  
SCALE: 22x34 1/4"=1'-0"  
11x17 1/8"=1'-0"  
PROJECT #: A24117.01222.000  
DRAWN BY: ED  
CHECKED BY: CWS

22869 5/15/19

REFER TO COVER SHEET FOR A COMPLETE LIST OF REVISIONS

SHEET

S4.1

| TRUSS UPLIFT CONNECTOR SCHEDULE                                                                                                                                                                                                                                                                                                                                                                                                    |              |                                |              |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------|--------------------------------|--------------|
| MAX. UPLIFT                                                                                                                                                                                                                                                                                                                                                                                                                        | ROOF TO WALL | FLOOR TO FLOOR                 | FLOOR TO FND |
| 600 LBS                                                                                                                                                                                                                                                                                                                                                                                                                            | H2.5A        | PER WALL SHEATHING & FASTENERS |              |
| 1200 LBS                                                                                                                                                                                                                                                                                                                                                                                                                           | (2) H2.5A    | CS16 (END = 11")               | DTT2Z        |
| 1450 LBS                                                                                                                                                                                                                                                                                                                                                                                                                           | HTS20        | CS16 (END = 11")               | DTT2Z        |
| 2000 LBS                                                                                                                                                                                                                                                                                                                                                                                                                           | (2) MTS20    | (2) CS16 (END = 11")           | DTT2Z        |
| 2900 LBS                                                                                                                                                                                                                                                                                                                                                                                                                           | (2) HTS20    | (2) CS16 (END = 11")           | HTT4         |
| 3685 LBS                                                                                                                                                                                                                                                                                                                                                                                                                           | LGT3-SDS2.5  | MSTC52                         | HTT4         |
| 1. ALL PRODUCTS LISTED ARE SIMPSON STRONG-TIE. EQUIVALENT PRODUCTS MAY BE USED PER MANUFACTURER'S SPECIFICATIONS.<br>2. UPLIFT VALUES LISTED ARE FOR SYP #2/SPF #2 GRADE MEMBERS.<br>3. REFER TO TRUSS LAYOUT PER MANUF. FOR UPLIFT VALUES AND TRUSS TO TRUSS CONNECTIONS. CONNECTORS SPECIFIED BY TRUSS MANUFACTURER OVERRIDE THOSE LISTED ABOVE.<br>4. CONTACT UES FOR REQUIRED CONNECTORS WHEN LOADS EXCEED THOSE LISTED ABOVE. |              |                                |              |

NOTE: 1ST PLY OF ALL SHOWN GIRDER TRUSSES TO ALIGN WITH INSIDE FACE OF WALL (TYP, UNO)

NOTE: ROOF TRUSSES SHALL BE SPACED TO SUPPORT FALSE FRAMED DORMER WALLS (TYP, UNO)

REFER TO DETAIL 5/D3F FOR EYEBROW, RETURN OR SHED ROOF FRAMING REQUIREMENTS. (TYP FOR ROOFS PROTRUDING MAXIMUM 24" FROM STRUCTURE)

NOTE: TRUSS UPLIFT LOADS SHALL BE DETERMINED PER TRUSS MANUFACTURER IN ACCORDANCE WITH SECTION R802.11.1.1. WALL SHEATHING AND FASTENERS HAVE BEEN DESIGNED TO RESIST THE WIND UPLIFT LOAD PATH IN ACCORDANCE WITH METHOD 3 OF SECTION R602.3.5 OF THE 2018 NCRC. REFER TO BRACED WALL PLANS FOR SHEATHING AND FASTENER REQUIREMENTS.

THESE PLANS ARE DESIGNED IN ACCORDANCE WITH ARCHITECTURAL PLANS PROVIDED BY DR. HORTON, COMPLETED/REVISED ON 4/15/21. IT IS THE RESPONSIBILITY OF THE CLIENT TO NOTIFY UES PROFESSIONAL SOLUTIONS 29, INC. (UES) IF ANY CHANGES ARE MADE TO THE ARCHITECTURAL PLANS PRIOR TO CONSTRUCTION. UES PROFESSIONAL SOLUTIONS 29, INC. (UES) CANNOT GUARANTEE THE ADEQUACY OF THESE STRUCTURAL PLANS WHEN USED WITH ARCHITECTURAL PLANS DATED DIFFERENTLY THAN THE DATE LISTED ABOVE.


STRUCTURAL MEMBERS ONLY

ENGINEERING SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS ON THIS DOCUMENT. SEAL DOES NOT INCLUDE CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES OR SAFETY PRECAUTIONS. ANY DEVIATIONS OR DISCREPANCIES ON PLANS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF UES PROFESSIONAL SOLUTIONS 29, INC. (UES). FAILURE TO DO SO WILL VOID UES LIABILITY.

STRUCTURAL ANALYSIS BASED ON 2018 NCRC.

ROOF FRAMING PLAN

SCALE: 1/4"=1'-0" ON 22"x34" OR 1/8"=1'-0" ON 11"x17"

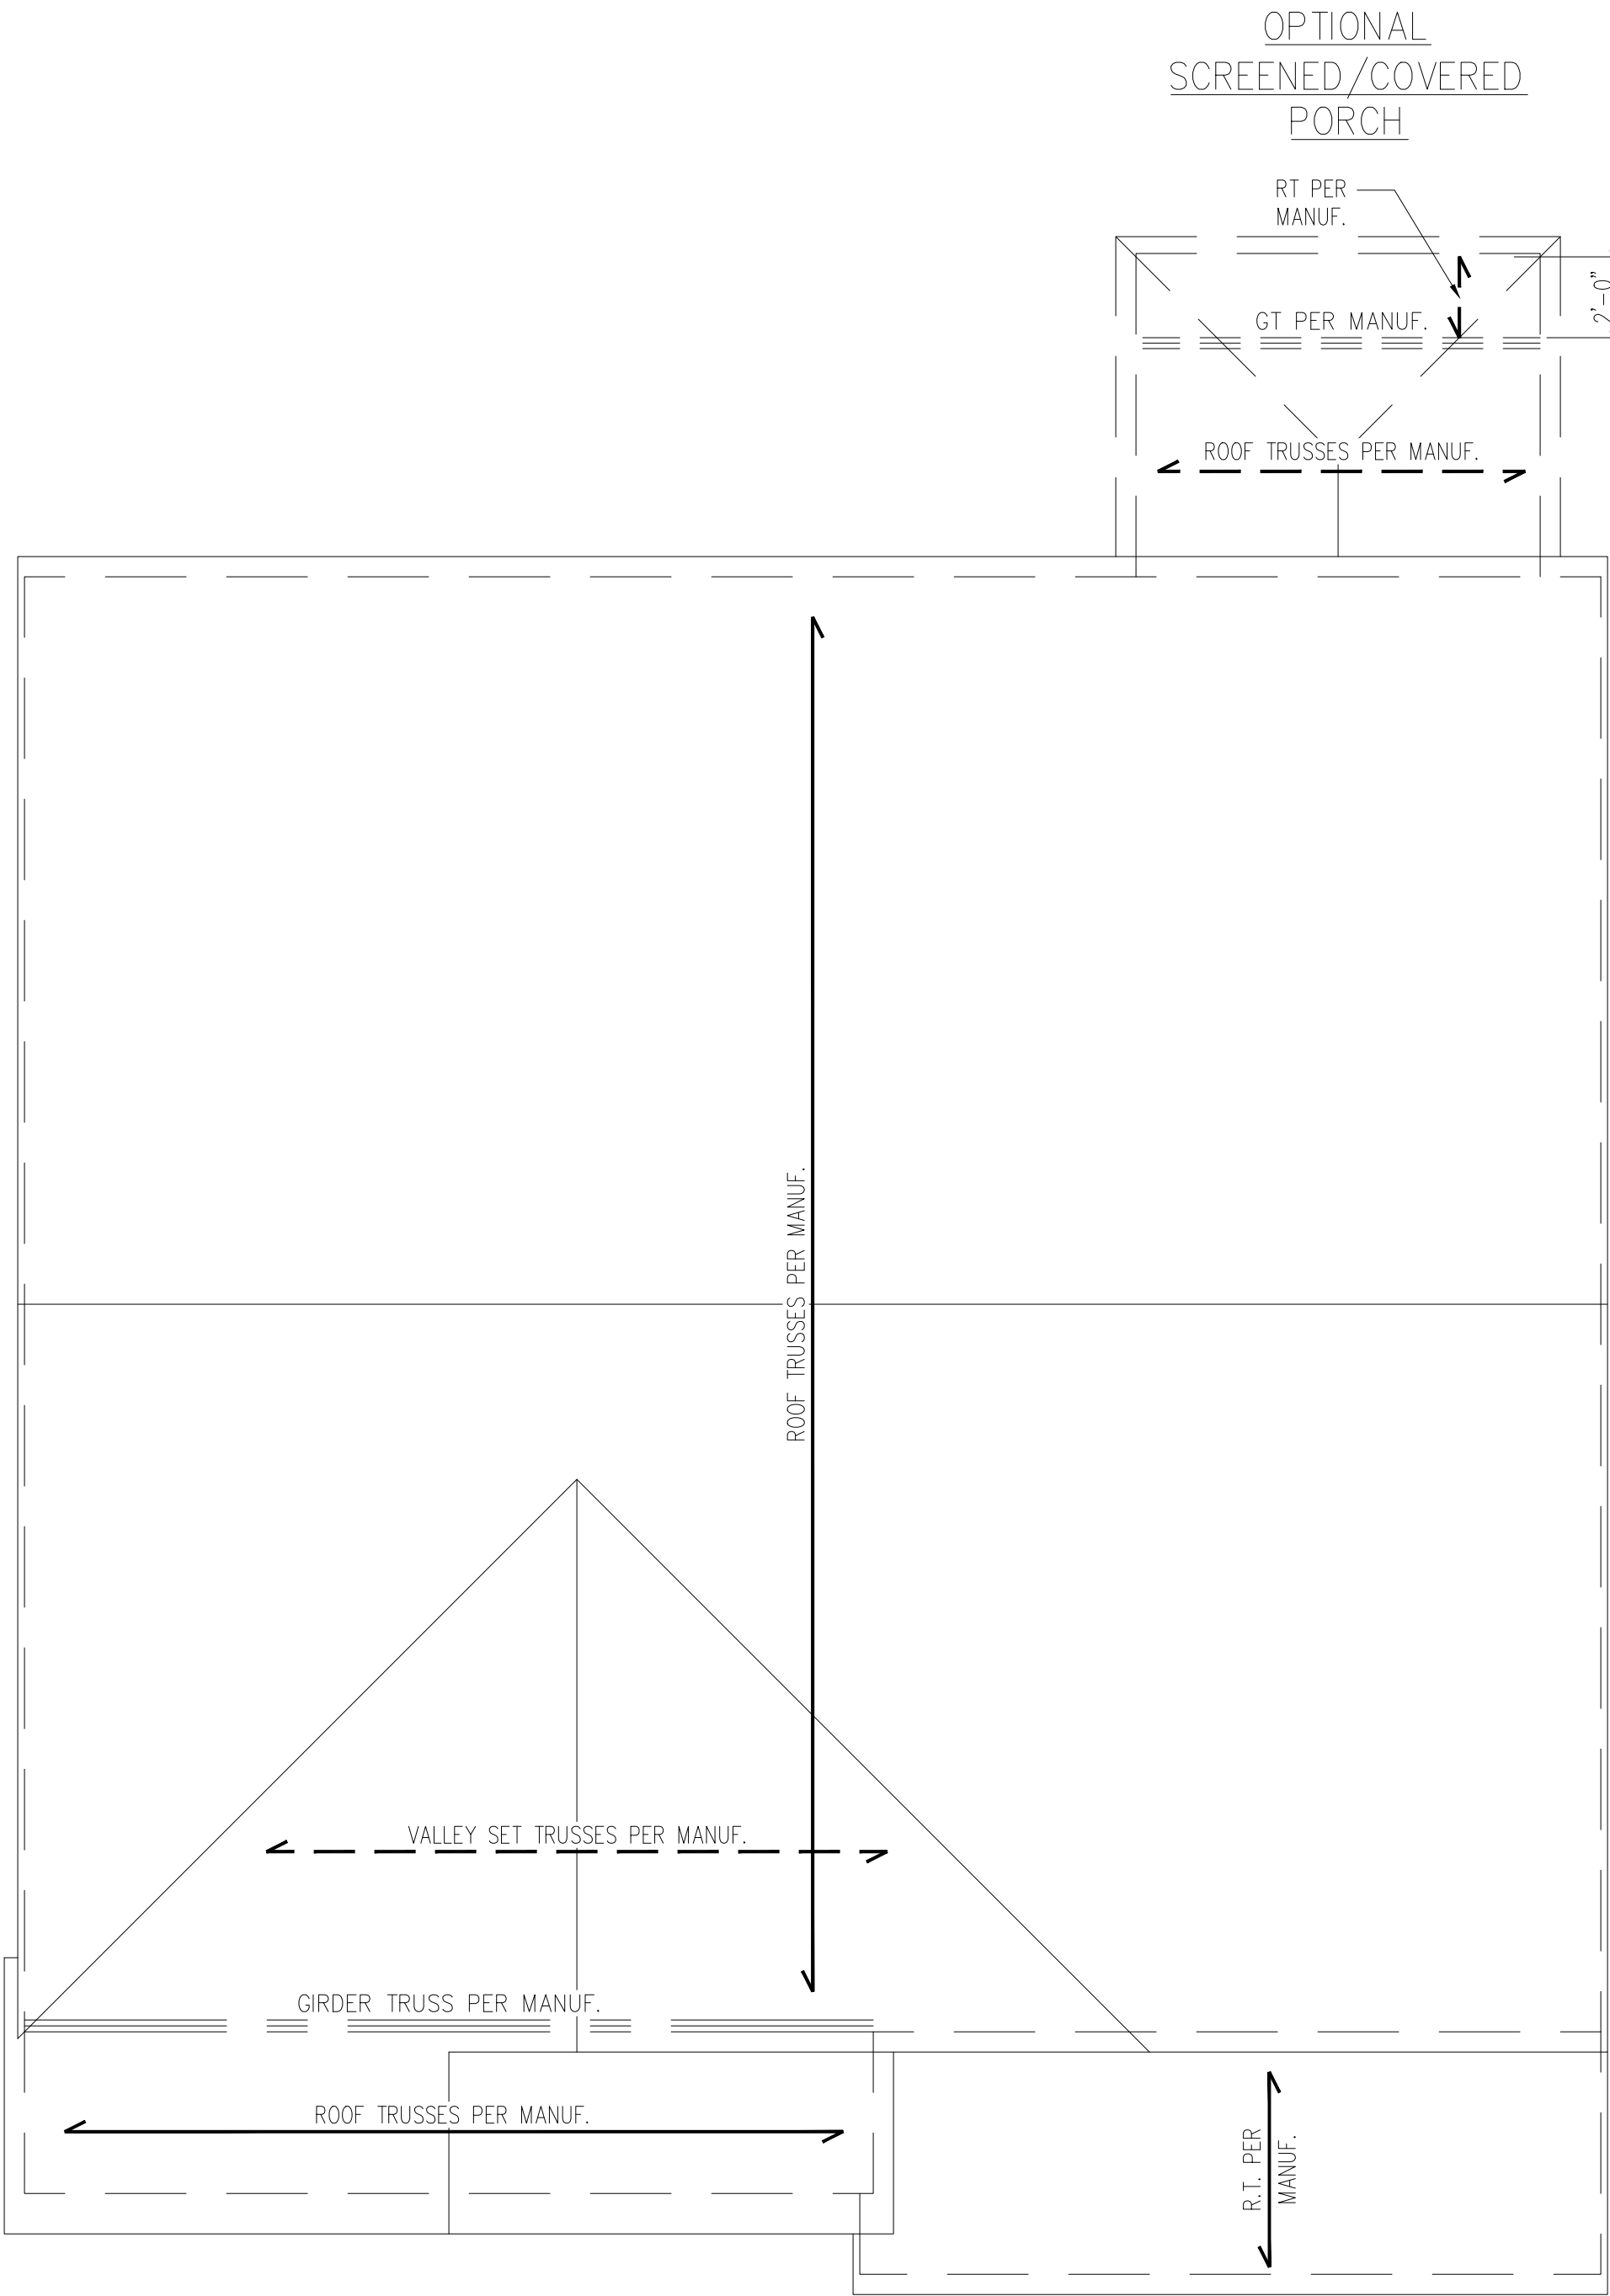

ELEVATION B,F,K



UES PROFESSIONAL SOLUTIONS 29, INC.  
FORMERLY SUMMIT ENGINEERING,  
UNDERSTUDY & TESTING, INC.  
10121 Pineville Distribution St  
Pineville, NC 28134  
Office: 704.504.1117  
Fax: 704.504.1125  
www.ues29.com




210/24/24basement bath/bdr

DR. Horton, Inc.  
8001 Arrowridge Blvd.  
Charlotte, NC 28273

Hayden LH  
Roof Framing Plan

07.11.2024

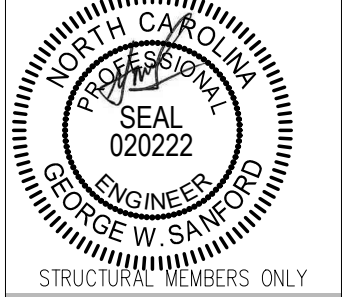

STRUCTURAL MEMBERS ONLY

DATE: 07/10/2024  
SCALE: 22x34 1/4"=1'-0"  
11x17 1/8"=1'-0"  
PROJECT #: A24117.01222.000  
DRAWN BY: ED  
CHECKED BY: CWS

22869 5/15/19

REFER TO COVER SHEET FOR A COMPLETE LIST OF REVISIONS

SHEET

S5.1

10. Assumed Soil Bearing Capacity ..... 2000psf



1. Decks are to be framed in accordance with local building codes and as referenced on the structural plans, either through code references or construction details.

|                                |           |
|--------------------------------|-----------|
| Manager                        | Signature |
| Operations                     |           |
| Operations System              |           |
| Operations Product Development |           |

1. The structural engineer has not performed a subsurface investigation. Verification of this assumed value is the responsibility of the owner or the contractor. Should any adverse soil condition be encountered the SER must be contacted before proceeding.


1. Concrete shall have a normal weight aggregate and a minimum compressive strength ( $f'_c$ ) at 28 days of 3000 psi, unless otherwise noted on the plan.
2. Concrete shall be proportioned, mixed, and placed in accordance with the latest editions of ACI 318: "Building Code Requirements for Reinforced Concrete" and ACI 301: "Specifications for Structural Concrete for Buildings".
3. Air entrained concrete must be used for all structural elements exposed to freeze/thaw cycles and deicing chemicals. Air entrainment amounts (in percent) shall be within -1% to +2% of target values as follows:
  - 3.1. Footings: 5%
  - 3.2. Exterior Slabs: 5%
4. No admixtures shall be added to any structural concrete without written permission of the SER.

1. Fibrous concrete reinforcement, or fibermesh, specified in concrete slabs-on-grade may be used for control of cracking due to shrinkage and thermal expansion/contraction, lowered water migration, an increase in impact capacity, increased abrasion resistance, and residual strength.
2. Fiberglass reinforcing to be 100% virgin polypropylene fibers containing no reprocessed defibr materials and specifically manufactured for use as concrete secondary reinforcement.
3. Application of fibermesh per cubic yard of concrete shall equal a minimum of 0.1% by volume (1.5 pounds per cubic yard).
4. Fibermesh shall comply with ASTM C1116, any local building code requirements, and shall meet or exceed the current industry standard.
5. Steel reinforcing bars shall be new billet steel conforming to ASTM A615, grade 60.
6. Detailing, fabrication, and placement of reinforcing steel shall be in accordance with the latest edition of ACI 315: "Manual of Standard Practice for Detailing Concrete Structures"
7. Horizontal footing and wall reinforcement shall be continuous and shall have 90° bends, or corner bars with the same size/spacing as the horizontal reinforcement with a class B tension splice.
8. Lap reinforcement as required, a minimum of 40 bar diameters for tension or compression unless otherwise noted. Splices in masonry shall be a minimum of 48 bar diameters.

1. Solid sawn wood framing members shall conform to the specifications listed in the latest edition of the "National Design Specification for Wood Construction" (NDS). Unless otherwise noted, all wood framing members are designed to be Spruce-Yellow-Pine (SYP) #2.
2. LVL or PSL engineered wood shall have the following minimum design values:


|      |                             |
|------|-----------------------------|
| 2.1. | $E = 1,900,000 \text{ psi}$ |
| 2.2. | $F_b = 2600 \text{ psi}$    |
| 2.3. | $F_v = 285 \text{ psi}$     |
| 2.4. | $F_c = 700 \text{ psi}$     |
3. Wood in contact with concrete, masonry, or earth shall be pressure treated in accordance with AWP standard C-15. All other moisture exposed wood shall be treated in accordance with AWP standard C-2.
4. Nails shall be common wire nails unless otherwise noted.
5. Lag screws shall conform to ANSI/ASME standard B18.2.1-1981. Lead holes for lag screws shall be in accordance with NDS specifications.
6. All beams shall have full bearing on supporting framing members unless otherwise noted.
7. Exterior and load bearing stud walls are to be 2x4 SYP #2 @ 16" O.C. unless otherwise noted. Studs shall be continuous from the sole plate to the double top plate. Studs shall only be discontinuous at headers for window/door openings. A minimum of one king stud shall be placed at each end of the header. King studs shall be continuous.
8. Individual studs forming a column shall be attached with one 10 nail @ 6" O.C. staggered. The stud column shall be continuous to the foundation or beam. The column shall be properly blocked at all floor levels to ensure proper load transfer.
9. Multi-ply beams shall have each ply attached with (3) 10d nails @ 24" O.C.

1. Fabrication and placement of structural wood sheathing shall be in accordance with the APA Design/Construction Guide "Residential and Commercial," and all other applicable APA standards.
2. All structurally required wood sheathing shall bear the mark of the APA.
3. Wood wall sheathing shall comply with the requirements of local building codes for the appropriate state as indicated on these drawings. Refer to wall bracing notes in plan set for more information. Sheathing shall be applied with the long direction perpendicular to framing, unless noted otherwise.
4. Roof sheathing shall be APA rated sheathing exposure 1 or 2. Roof sheathing shall be continuous over two supports and attached to its supporting roof framing with (1)-8d CC nail at 6"/o/c at panel edges and at 12"/o/c in panel field unless otherwise noted on the plans. Sheathing shall be applied with the long direction perpendicular to framing. Sheathing shall have a span rating consistent with the framing spacing. Use suitable edge support by use of plywood clips or lumber blocking unless otherwise noted. Panel end joints shall occur over framing. Apply building paper over the sheathing as required by the state Building Code.
5. Wood floor sheathing shall be APA rated sheathing exposure 1 or 2. Attach sheathing to its supporting framing with (1)-8d CC ringshank nail at 6"/o/c at panel edges and at 12"/o/c in panel field unless otherwise noted on the plans. Sheathing shall be applied perpendicular to framing. Sheathing shall have a span rating consistent with the framing spacing. Use suitable edge support by use of 1x6 plywood or lumber blocking unless otherwise noted. Panel end joints shall occur over framing. Apply building paper over the sheathing as required by the state Building Code.
6. Sheathing shall have a 1/8" gap at panel ends and edges as recommended in accordance with the APA.

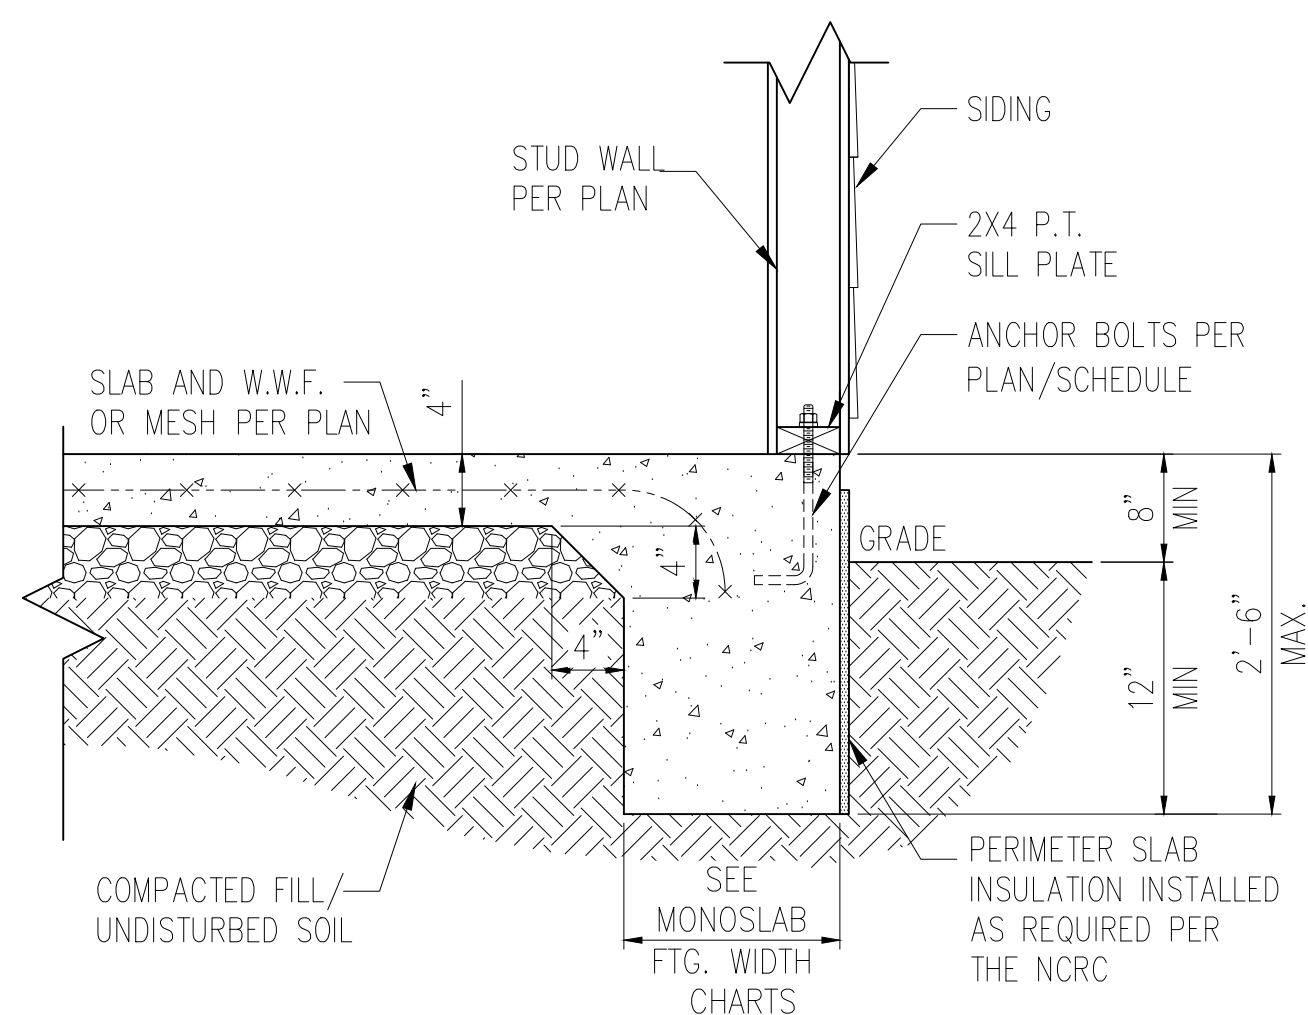


STANDARD – SIDING

1 TYP. SLAB DETAIL  
D1m N.T.S.

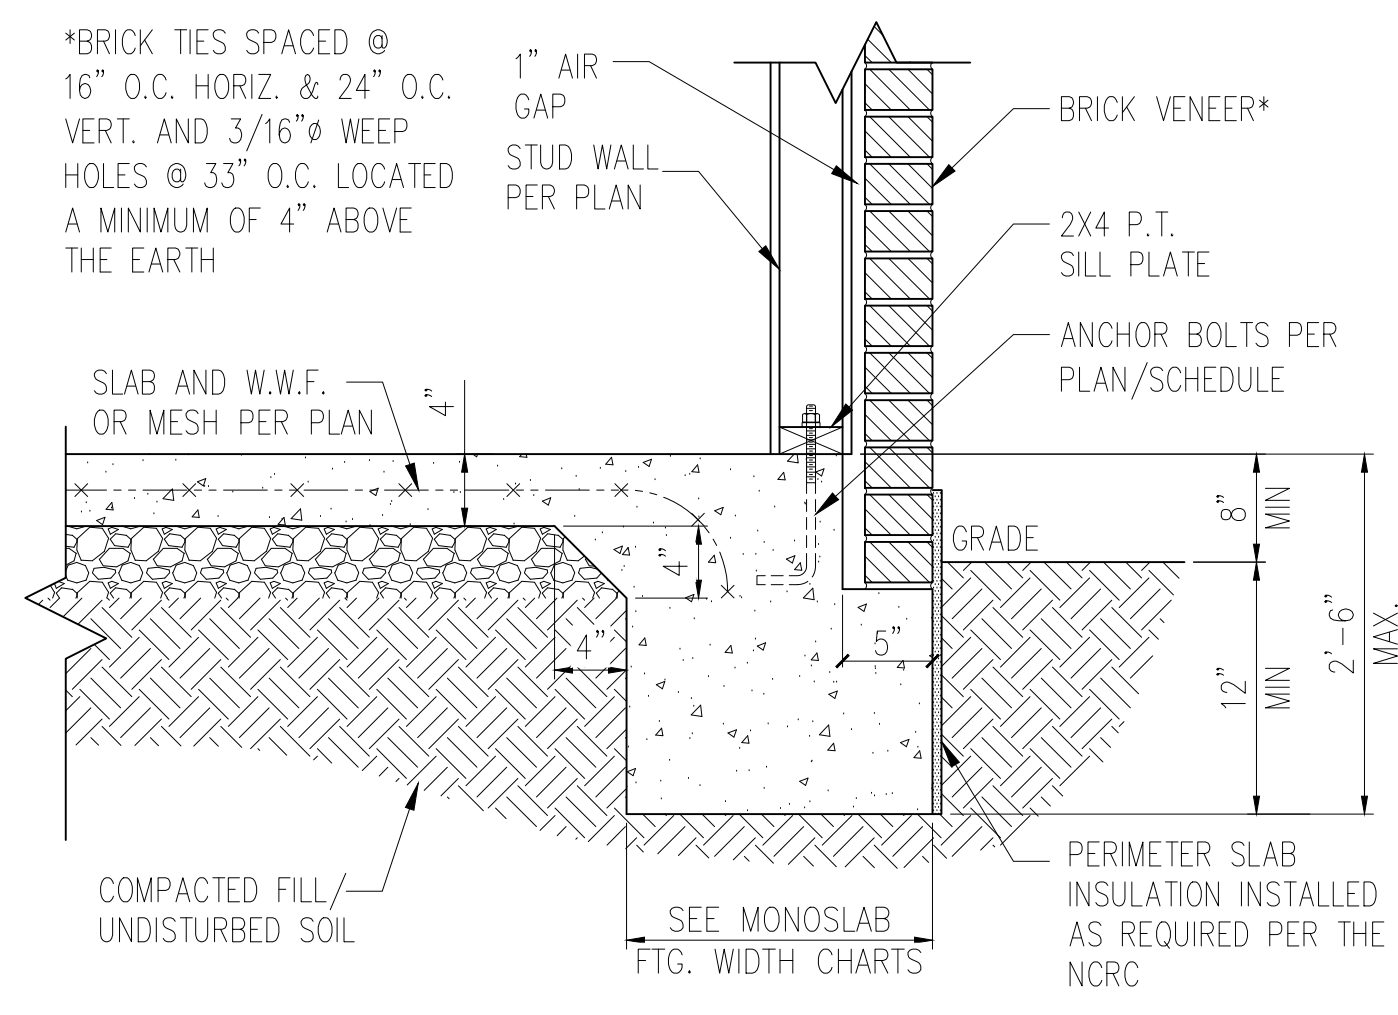


STANDARD – BRICK


2 TYP. GARAGE CURB DETAIL  
D1m N.T.S.

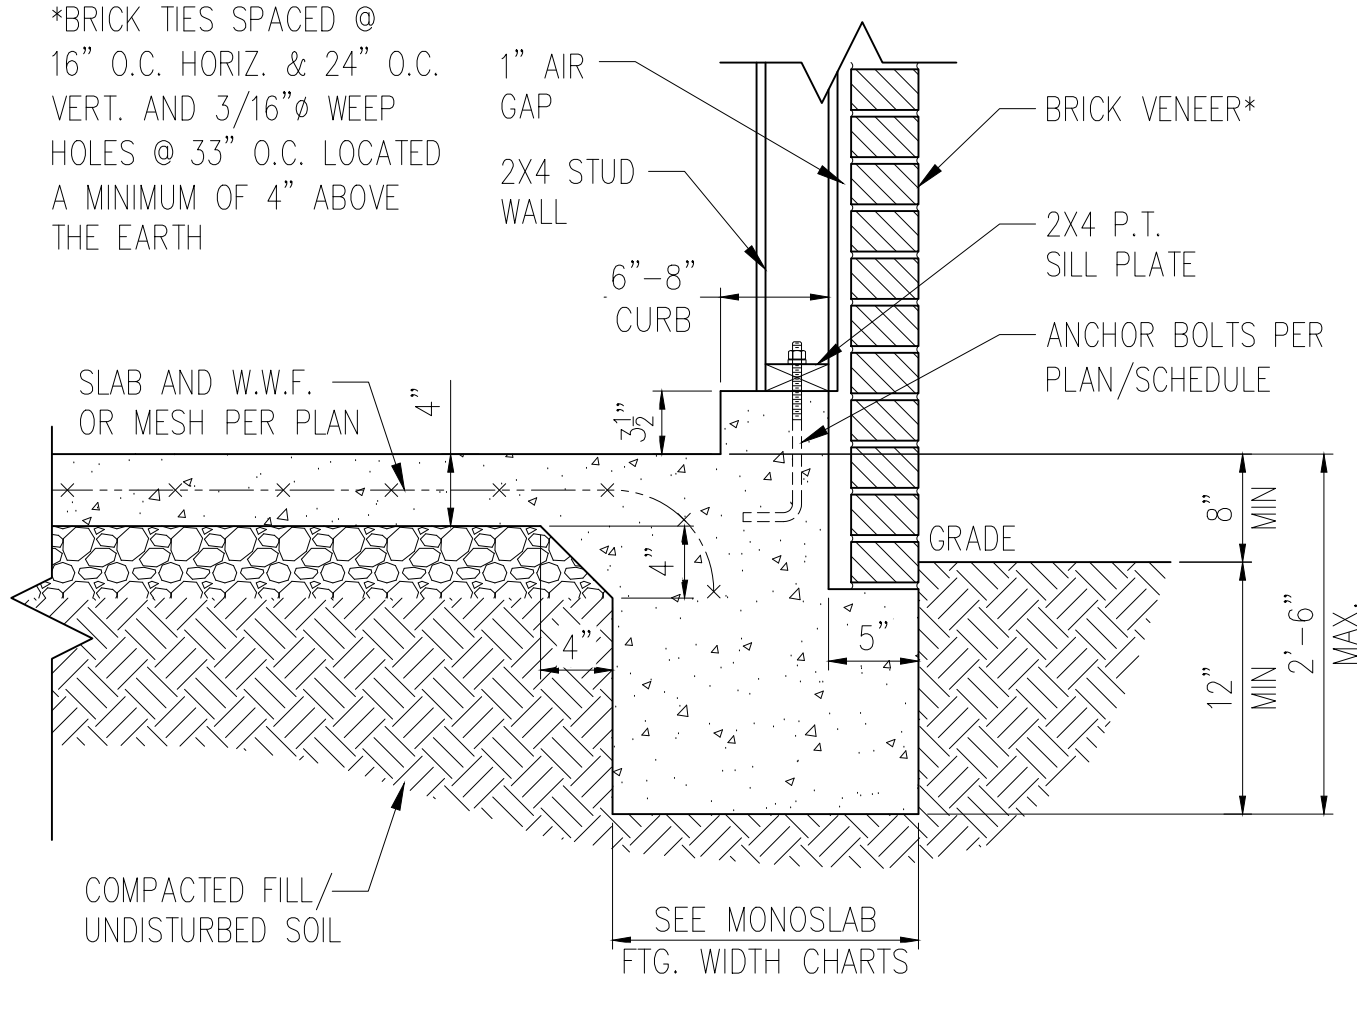

3 STEP IN GARAGE  
D1m N.T.S.

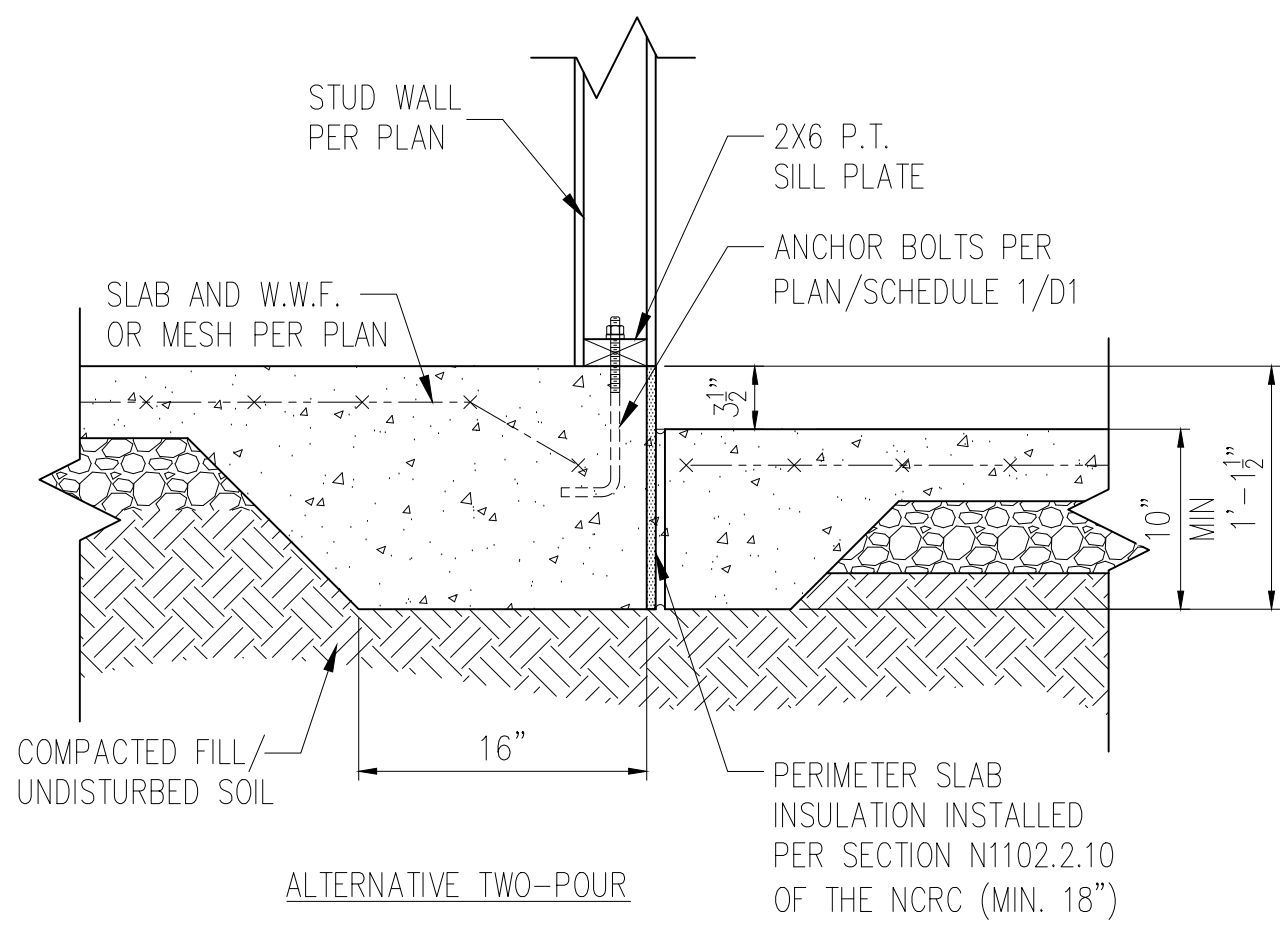

3A ALTERNATE TWO-POUR DETAIL  
D1m N.T.S.

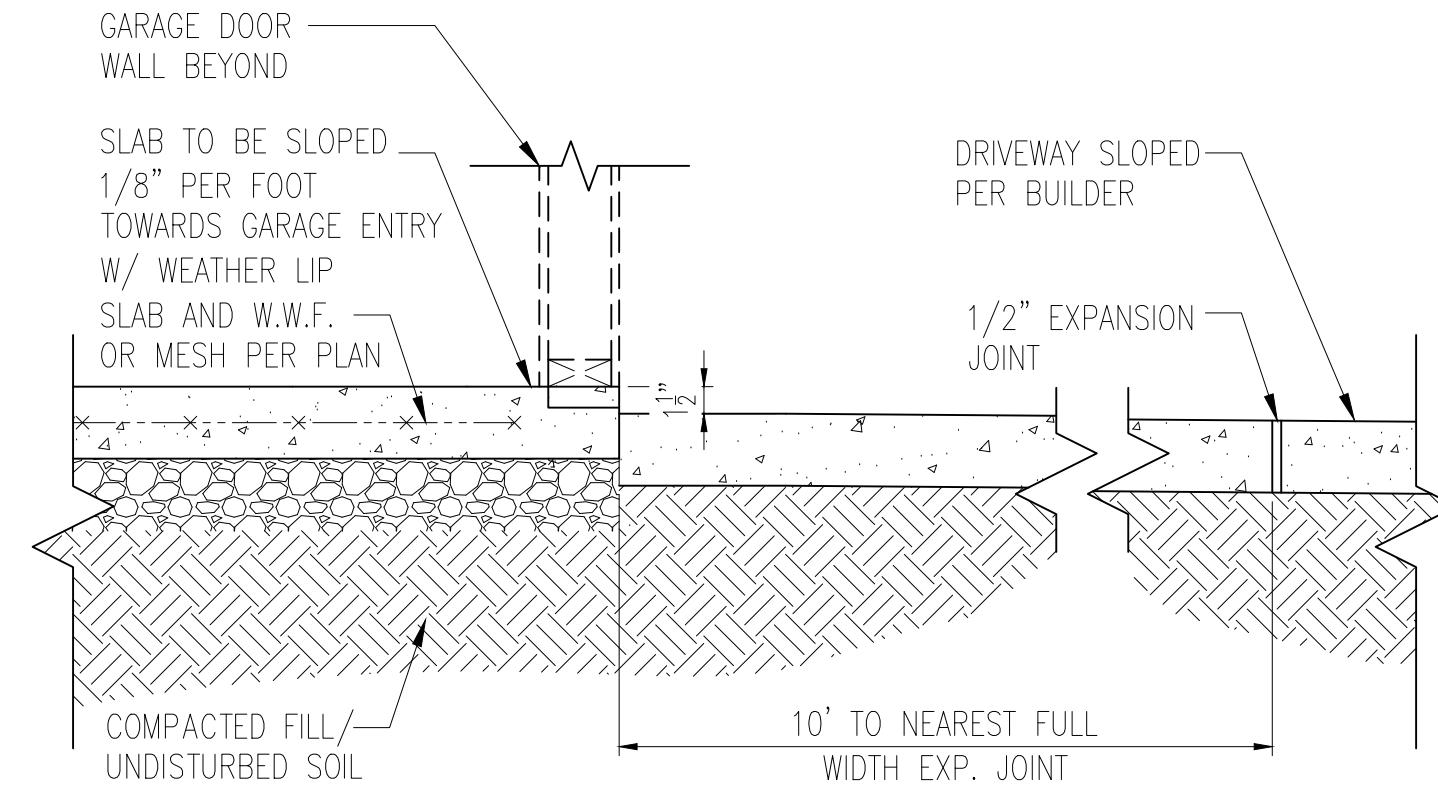

5 TYP. THICKENED SLAB DETAIL  
D1m N.T.S.

MONOLITHIC FOOTING WIDTH

| # OF STORIES           | WIDTH BASED ON SOIL BEARING CAPACITY |          |          |
|------------------------|--------------------------------------|----------|----------|
|                        | 1500 PSF                             | 2000 PSF | 2500 PSF |
| 1 STORY – STD.         | 16"                                  | 16"      | 16"      |
| 1 STORY – BRICK VENEER | 21"*                                 | 21"*     | 21"*     |
| 2 STORY – STD.         | 16"                                  | 16"      | 16"      |
| 2 STORY – BRICK VENEER | 21"*                                 | 21"*     | 21"*     |
| 3 STORY – STD.         | 23"                                  | 18"      | 18"      |
| 3 STORY – BRICK VENEER | 32"*                                 | 24"*     | 24"*     |


\*5" BRICK LEDGE HAS BEEN ADDED TO THE MONOLITHIC FOOTING WIDTH FOR BRICK SUPPORT

WALL ANCHOR SCHEDULE

| TYPE OF ANCHOR                                                    | MIN. CONC. EMBEDMENT | SPACING | INTERIOR WALL | EXTERIOR WALL |
|-------------------------------------------------------------------|----------------------|---------|---------------|---------------|
| 1/2" Ø A307 BOLTS w/ STD. 90° BEND                                | 7"                   | 6'-0"   | YES           | YES           |
| SST – MAS                                                         | 4"                   | 5'-0"   | NO            | YES           |
| SIMPSON TITEN HD 1/2" Ø – 8"                                      | 6-1/2"               | 6'-0"   | YES           | YES           |
| 1/2" Ø HILTI THREADED ROD w/ HIT HY150 ADHESIVE                   | 7"                   | 6'-0"   | YES           | YES           |
| 1/2" Ø HILTI KWIK BOLT, SST WEDGE-ALL, OR EQUIVALENT WEDGE ANCHOR | 7"                   | 6'-0"   | YES           | YES – 2       |


NOTE: 1. INSTALL ALL ANCHORS 12" MAX. FROM ALL BOTTOM PLATE ENDS AND JOINTS.  
2. EXPANSION ANCHORS MAY BE INSTALLED ONLY AS ALLOWED PER MANUFACTURE SPECIFICATIONS.

- NOTES:
- REFER TO GENERAL NOTES & SPECIFICATIONS ON COVERSHEET FOR ADDITIONAL INFORMATION.
  - PROVIDE 6 MIL VAPOR BARRIER UNDER ALL SLABS-ON-GRADE.
  - SEE ARCH. DWGS. FOR ALL TOP OF THE SLAB ELEVATIONS, SLOPES AND DEPRESSIONS.
  - REFER TO STRUCTURAL PLANS AND FRAMING DETAILS FOR BRACED WALL PANEL LAYOUT, DIMENSIONS, ATTACHMENT AND CONNECTIONS
  - REFER TO LOCAL AND STATEWIDE CODES FOR ADDITIONAL AMENDMENTS AND REQUIREMENTS NOT SHOWN
  - PERIMETER INSULATION SHOWN AS REQUIRED BY LOCAL CLIMATE ZONE. INSTALL PER TABLE N1102.1.2 OF THE 2018 NCRC

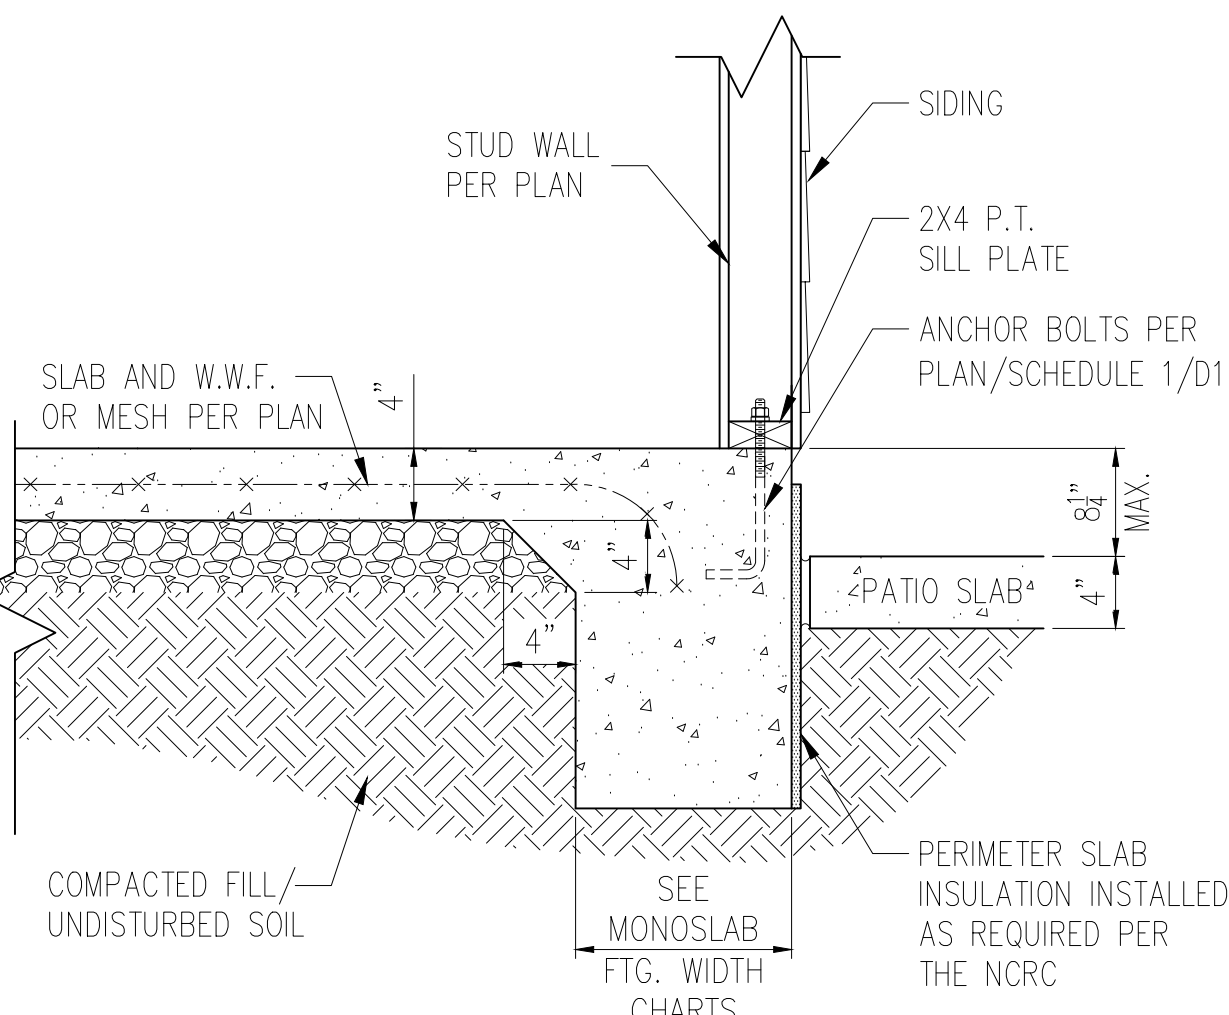


STANDARD – SIDING

6 PATIO SLAB DETAIL  
D1m N.T.S.

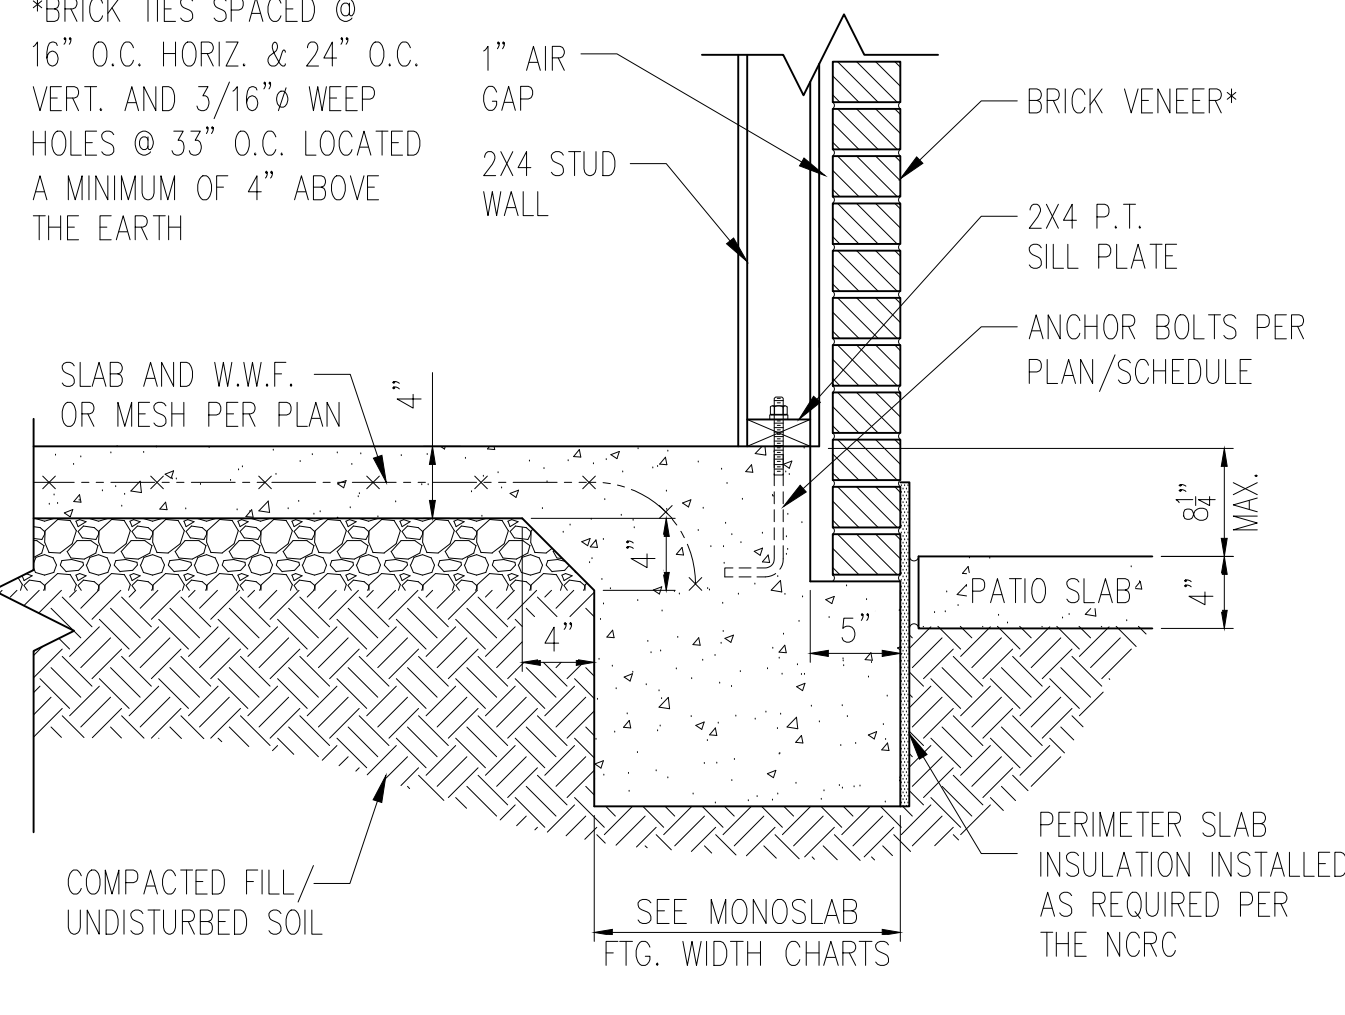


STANDARD – BRICK

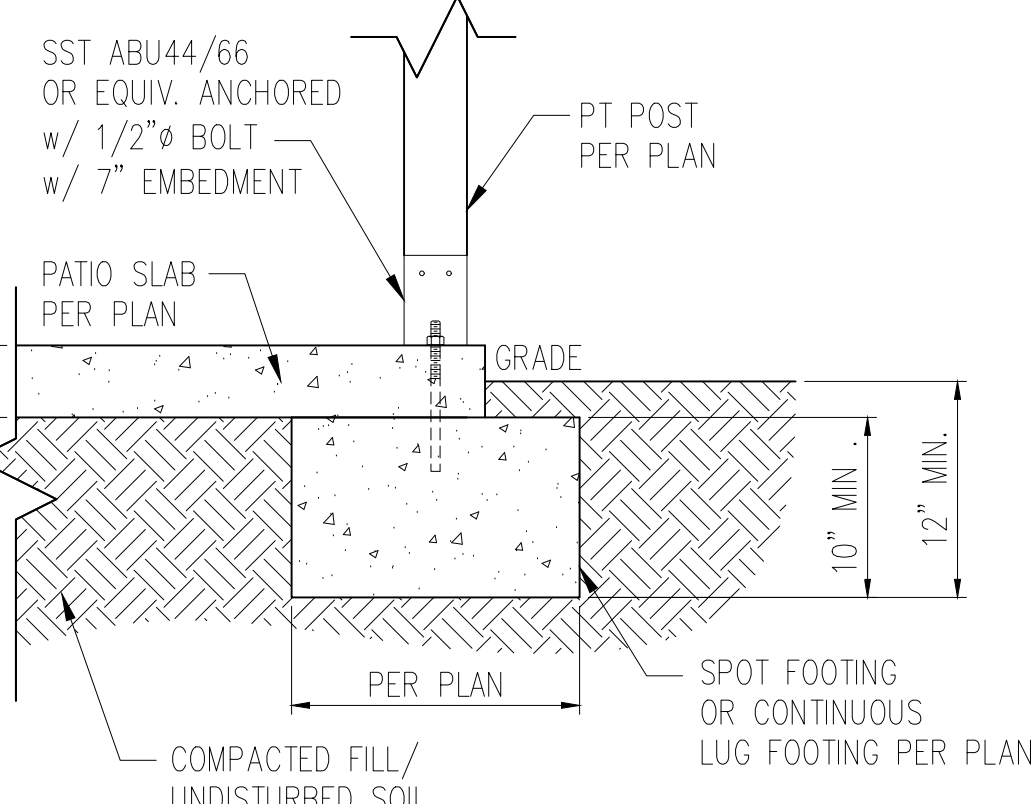

6A COVERED PATIO DETAIL  
D1m N.T.S.

MIN. 3/8" ROOF SHEATHING SECURED IN ACCORDANCE WITH FIGURE TABLE R602.3(1) (SEE NOTE G FOR ULTIMATE WIND SPEEDS GREATER THAN 120MPH). PROVIDE UNDERLAYMENT IN ACCORDANCE WITH CHAPTER 9 OF THE 2018 NCRC


PROVIDE MINIMUM INSULATION REQUIRED PER N1102.1.2 OF THE 2018 NCRC

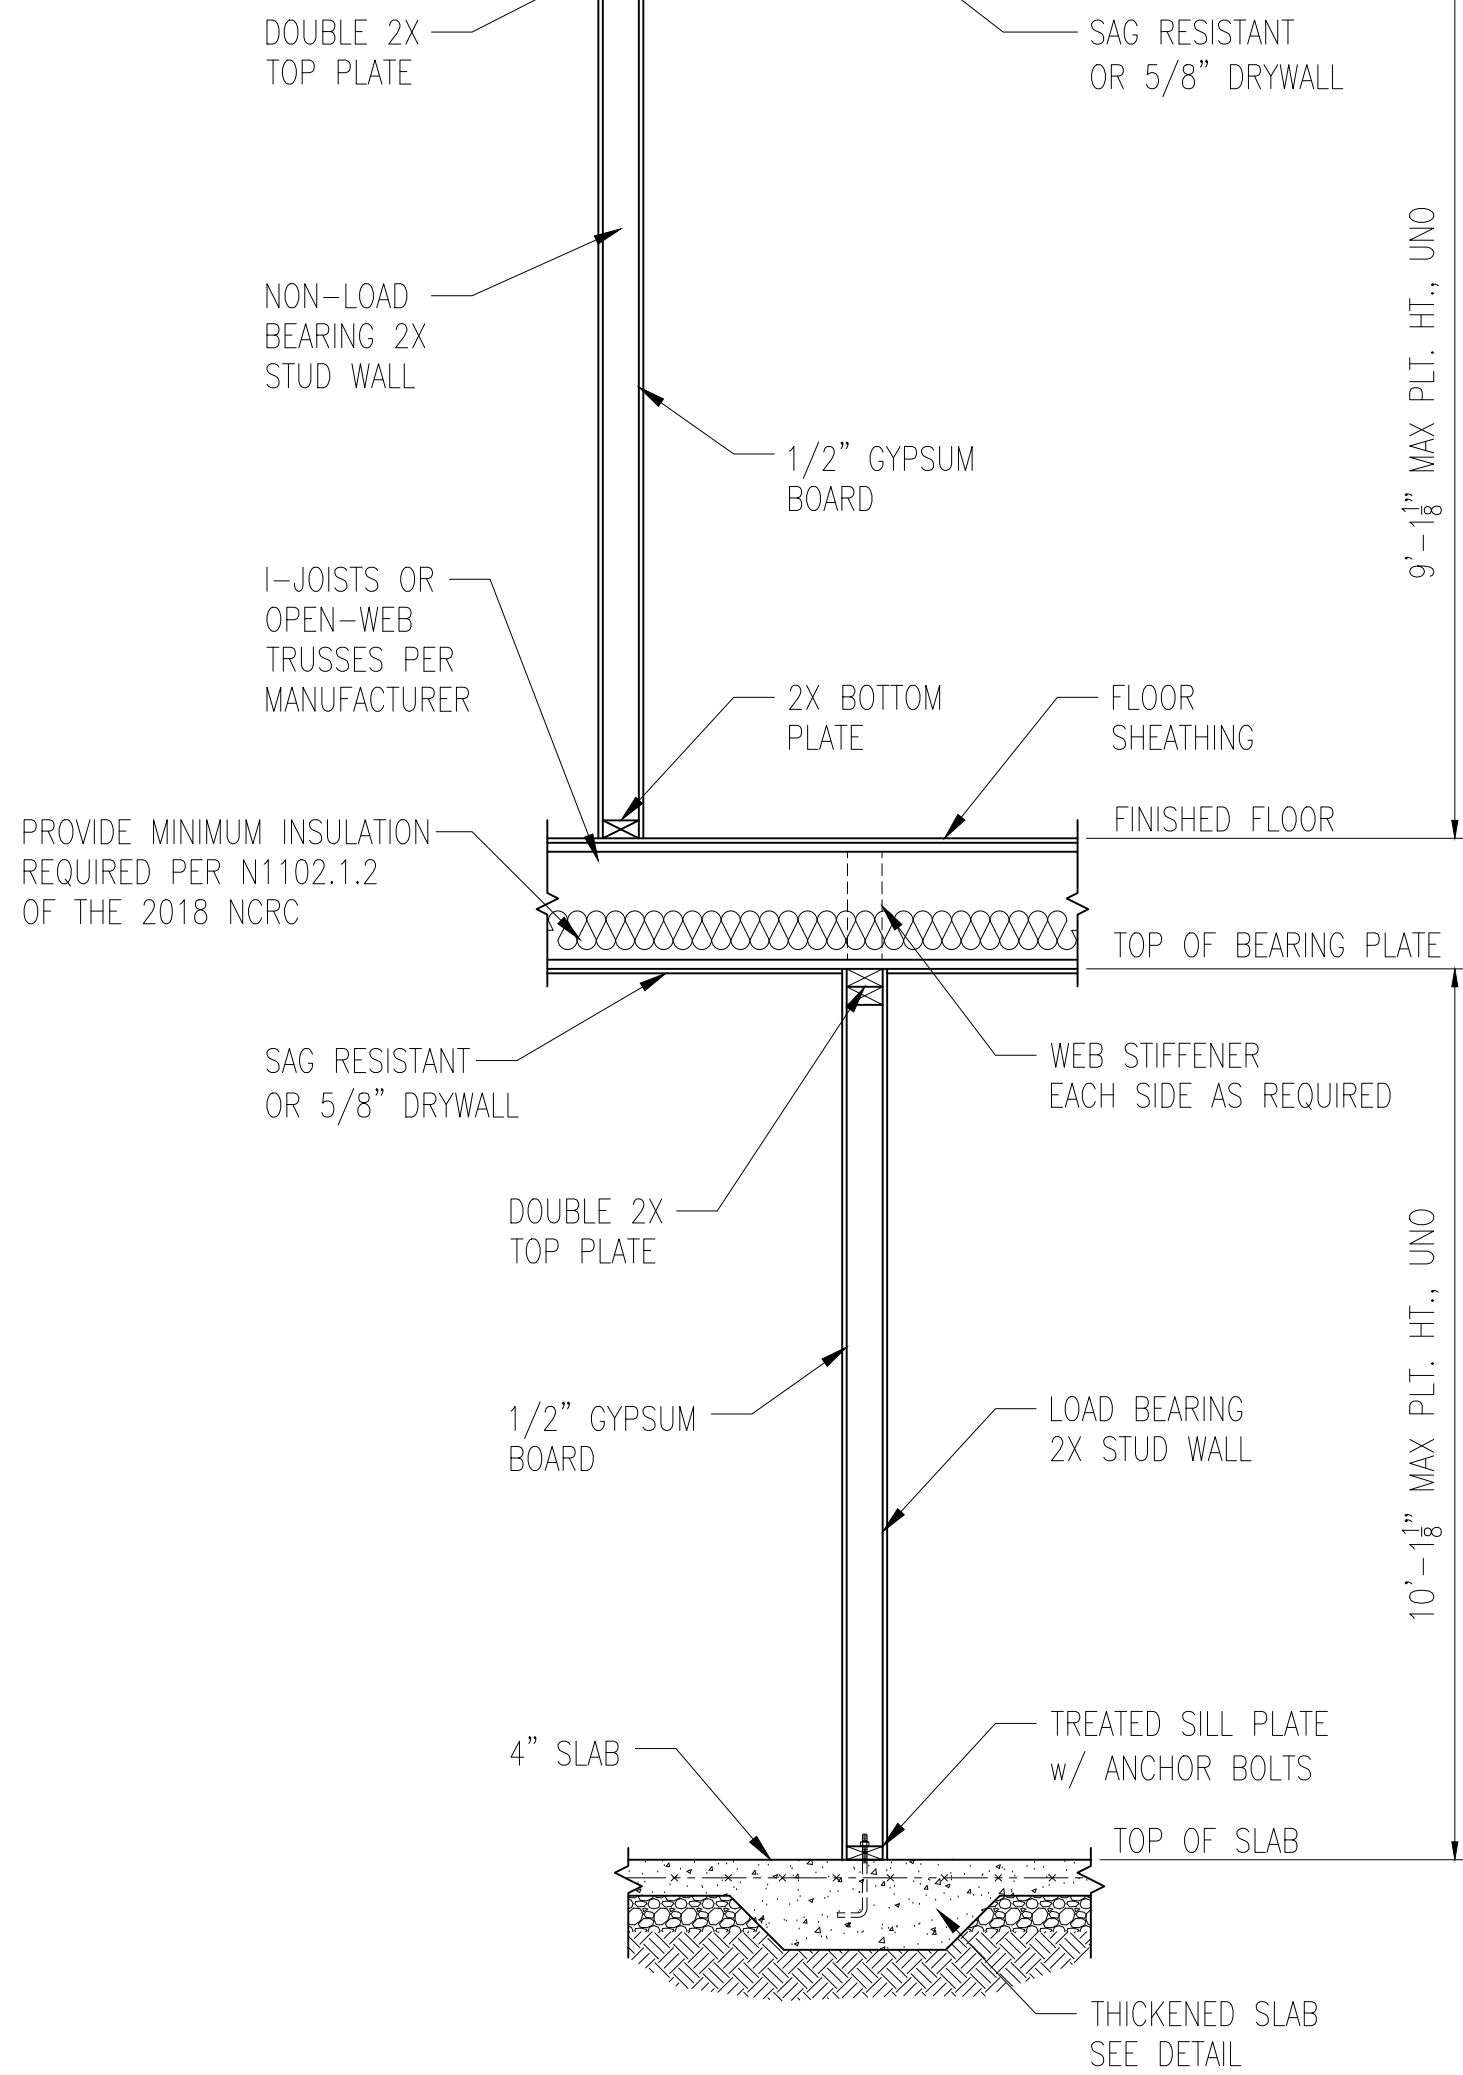

1 TYP. INTERIOR LOAD BEARING WALL SECTION  
D2m N.T.S.

MIN. 3/8" ROOF SHEATHING SECURED IN ACCORDANCE WITH FIGURE TABLE R602.3(1) (SEE NOTE G FOR ULTIMATE WIND SPEEDS GREATER THAN 120MPH). PROVIDE UNDERLAYMENT IN ACCORDANCE WITH CHAPTER 9 OF THE 2018 NCRC


PROVIDE MINIMUM INSULATION REQUIRED PER N1102.1.2 OF THE 2018 NCRC

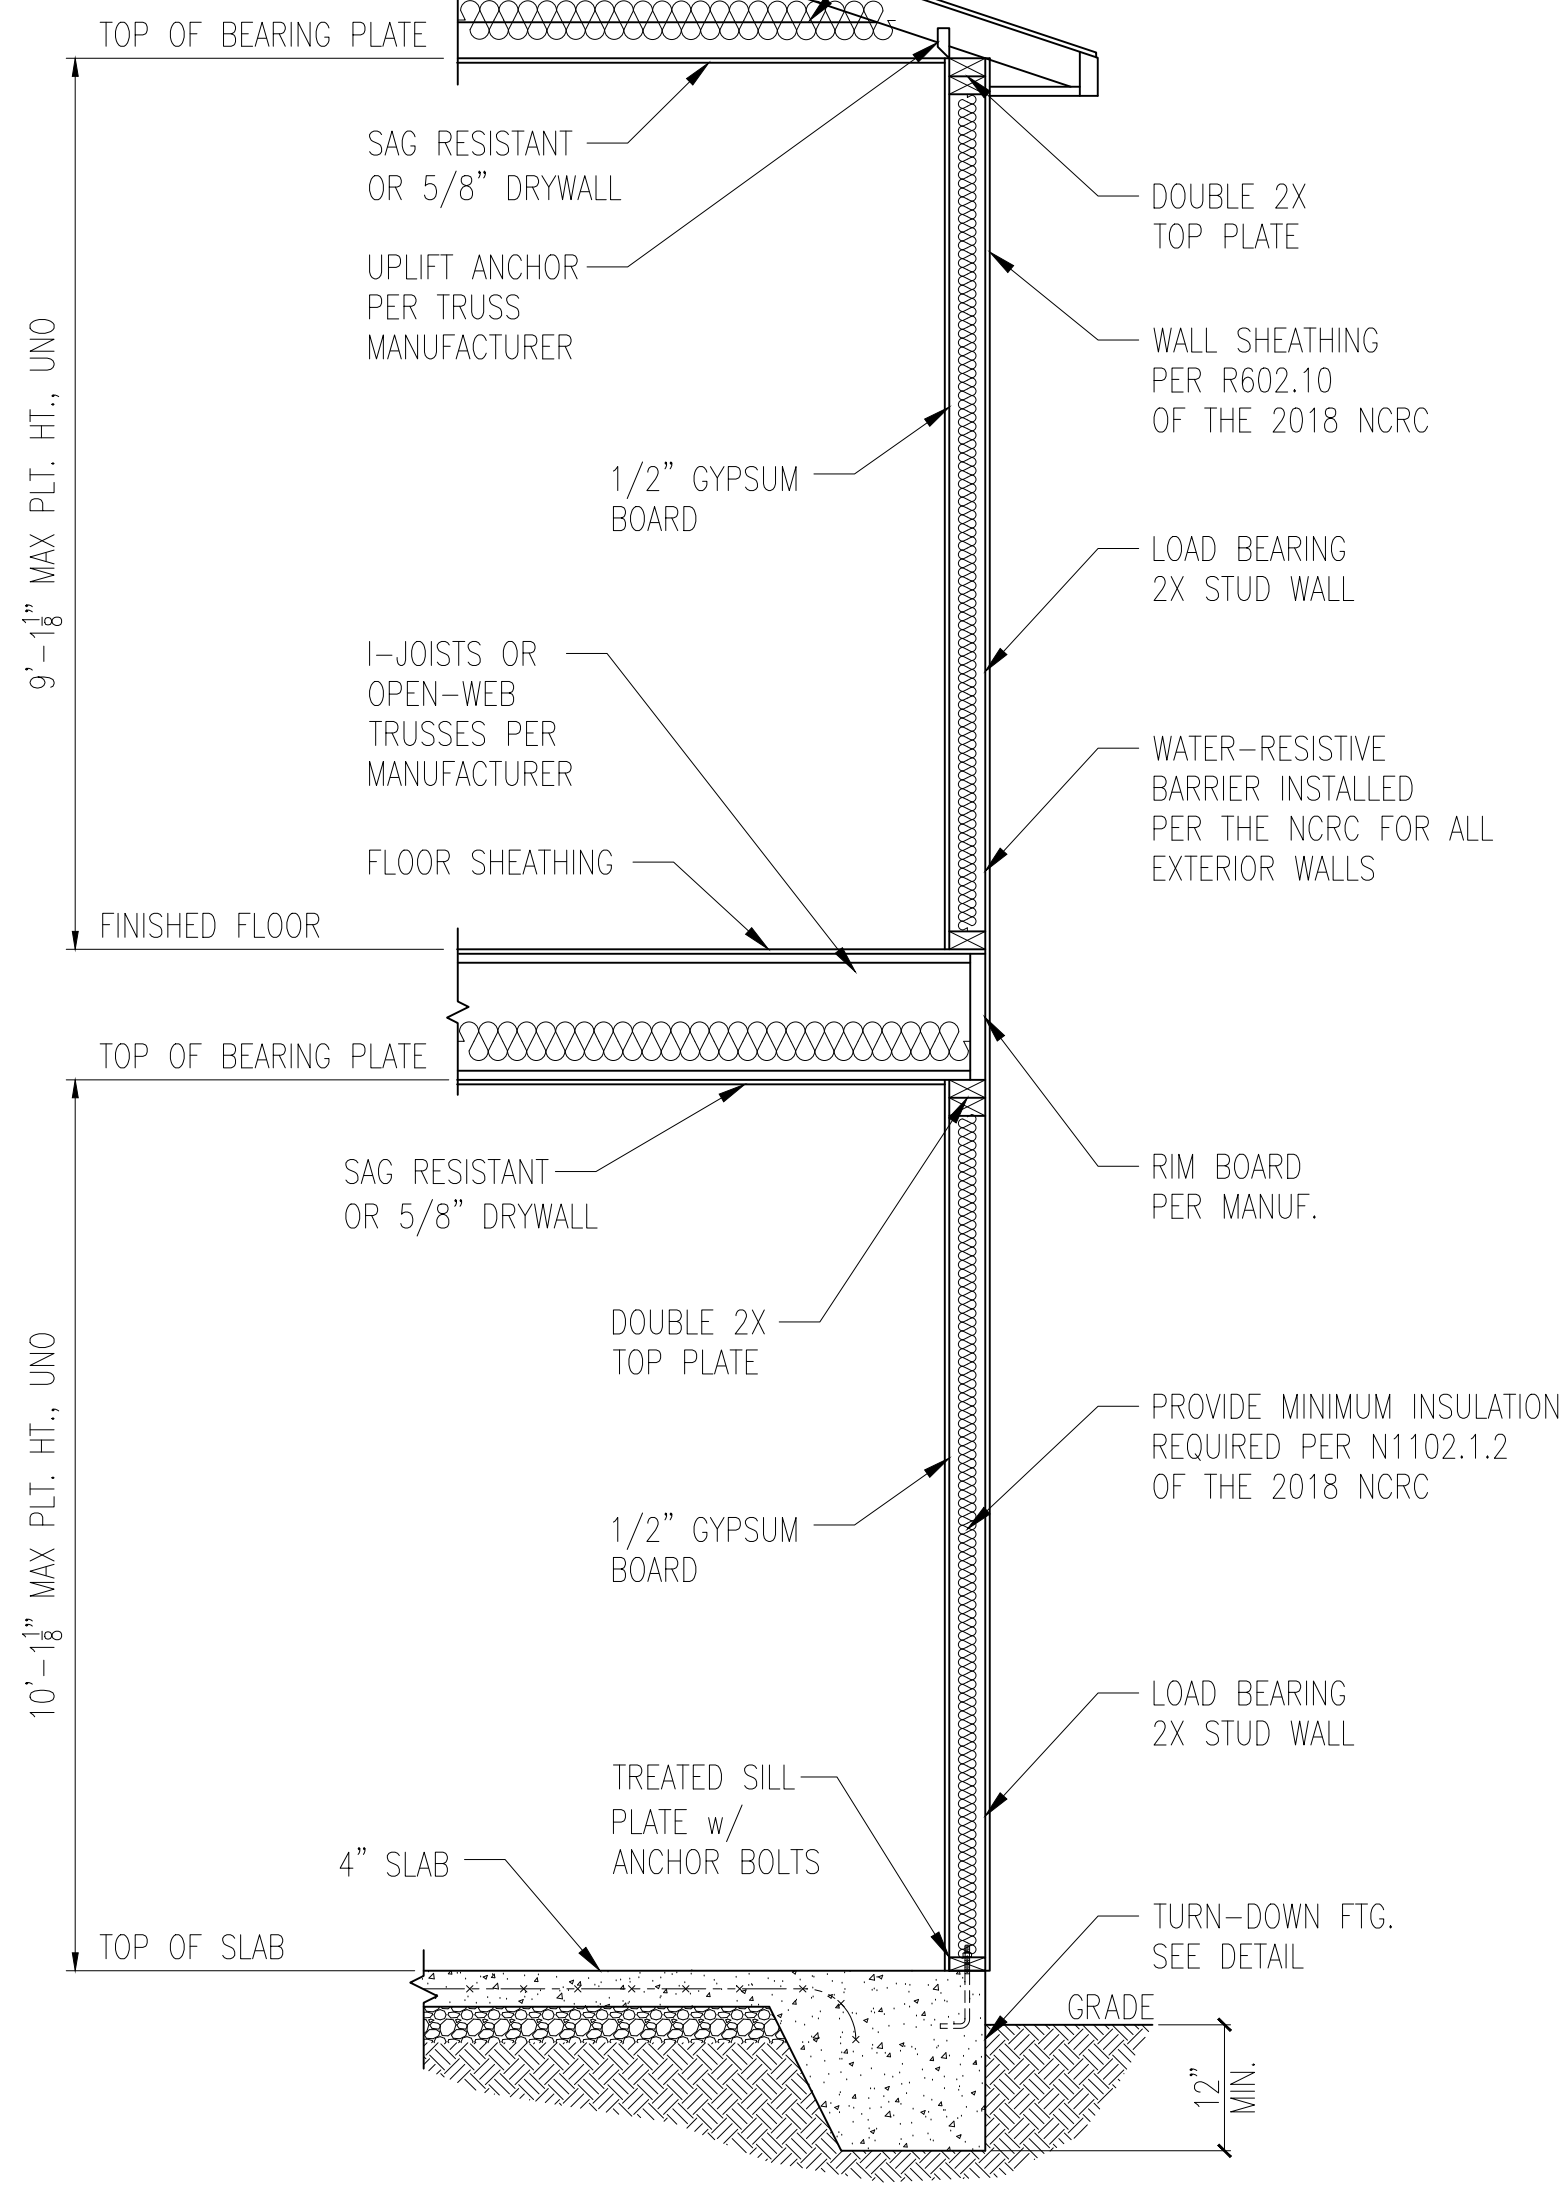


2 TYP. EXTERIOR LOAD BEARING WALL SECTION  
D2m N.T.S.

-SIMILAR w/ BRICK AND STONE  
-BRICK TIES SPACED @ 16" O.C. HORIZ. & 24" O.C. VERT.  
-MIN. 3/16" WEAP HOLES @ 33" O.C.

\*BRICK TIES SPACED @ 16" O.C. HORIZ. & 24" O.C. VERT. AND 3/16" WEAP HOLES @ 33" O.C. LOCATED A MINIMUM OF 4" ABOVE THE EARTH

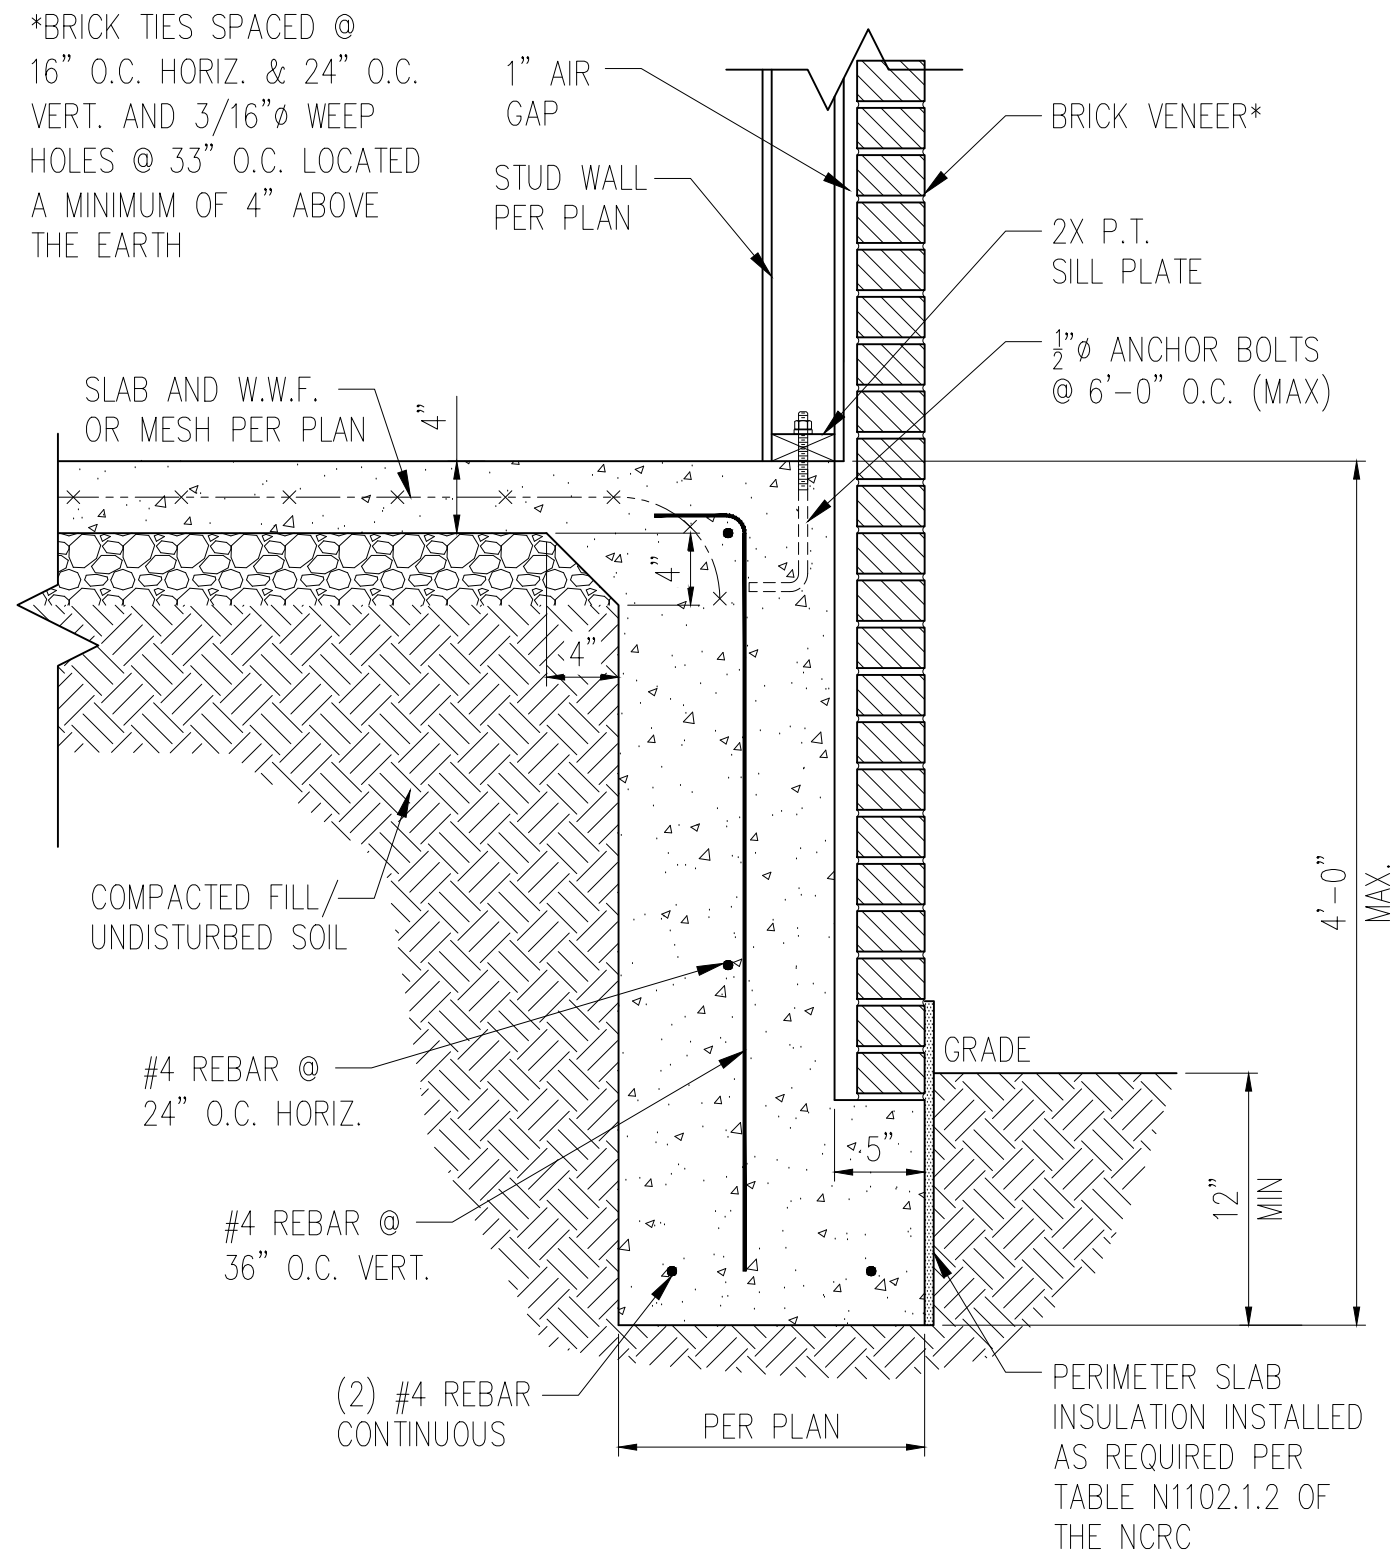


3 TALL SLAB DETAIL w/ BRICK VENEER  
D2m N.T.S.

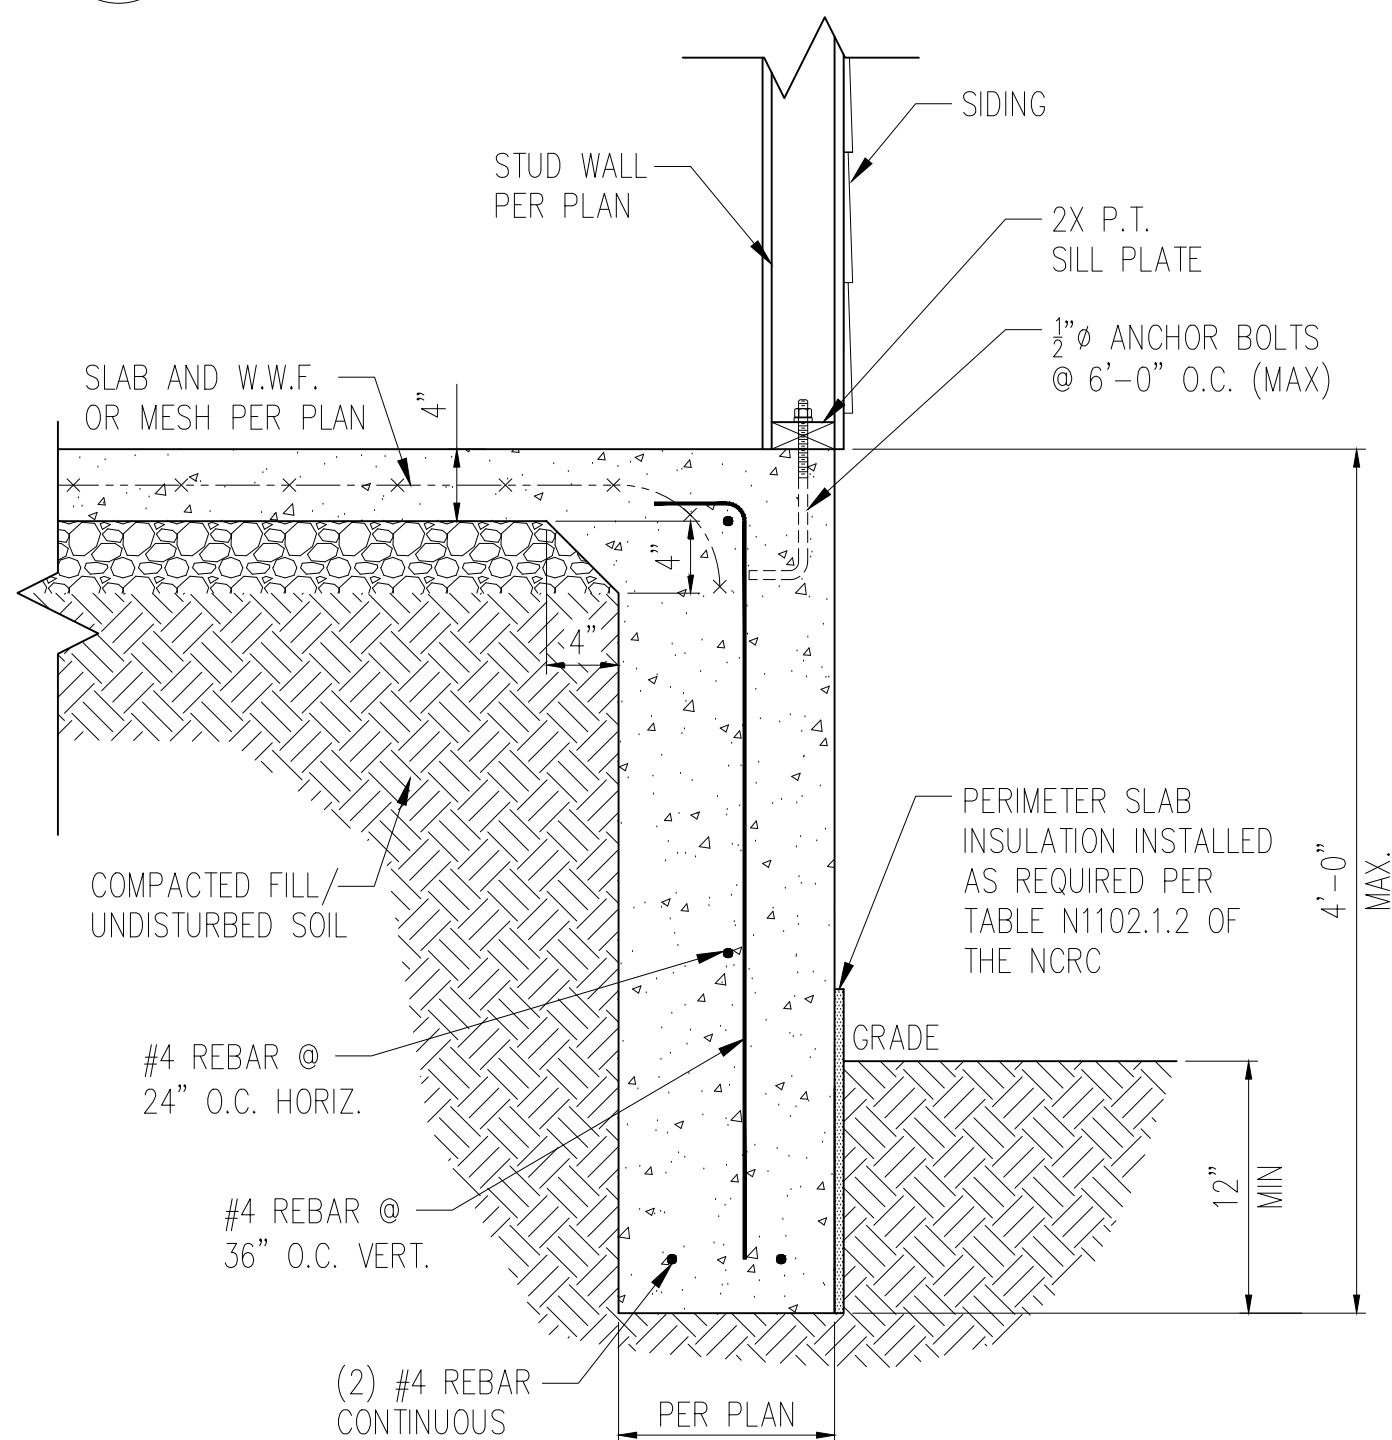



4 TALL SLAB DETAIL w/ SIDING  
D2m N.T.S.

#### NOTES:



- REFER TO GENERAL NOTES & SPECIFICATIONS ON COVERSHEET FOR ADDITIONAL INFORMATION.
- PROVIDE 6 MIL VAPOR BARRIER UNDER ALL SLABS-ON-GRADE.
- SEE ARCH. DWGS. FOR ALL TOP OF THE SLAB ELEVATIONS, SLOPES AND DEPRESSIONS.
- REFER TO STRUCTURAL PLANS AND FRAMING DETAILS FOR BRACED WALL PANEL LAYOUT, DIMENSIONS, ATTACHMENT AND CONNECTIONS
- REFER TO LOCAL AND STATEWIDE CODES FOR ADDITIONAL AMENDMENTS AND REQUIREMENTS NOT SHOWN
- PERIMETER INSULATION SHOWN AS REQUIRED BY LOCAL CLIMATE ZONE. INSTALL PER TABLE N1102.1.2 OF THE 2018 NCRC

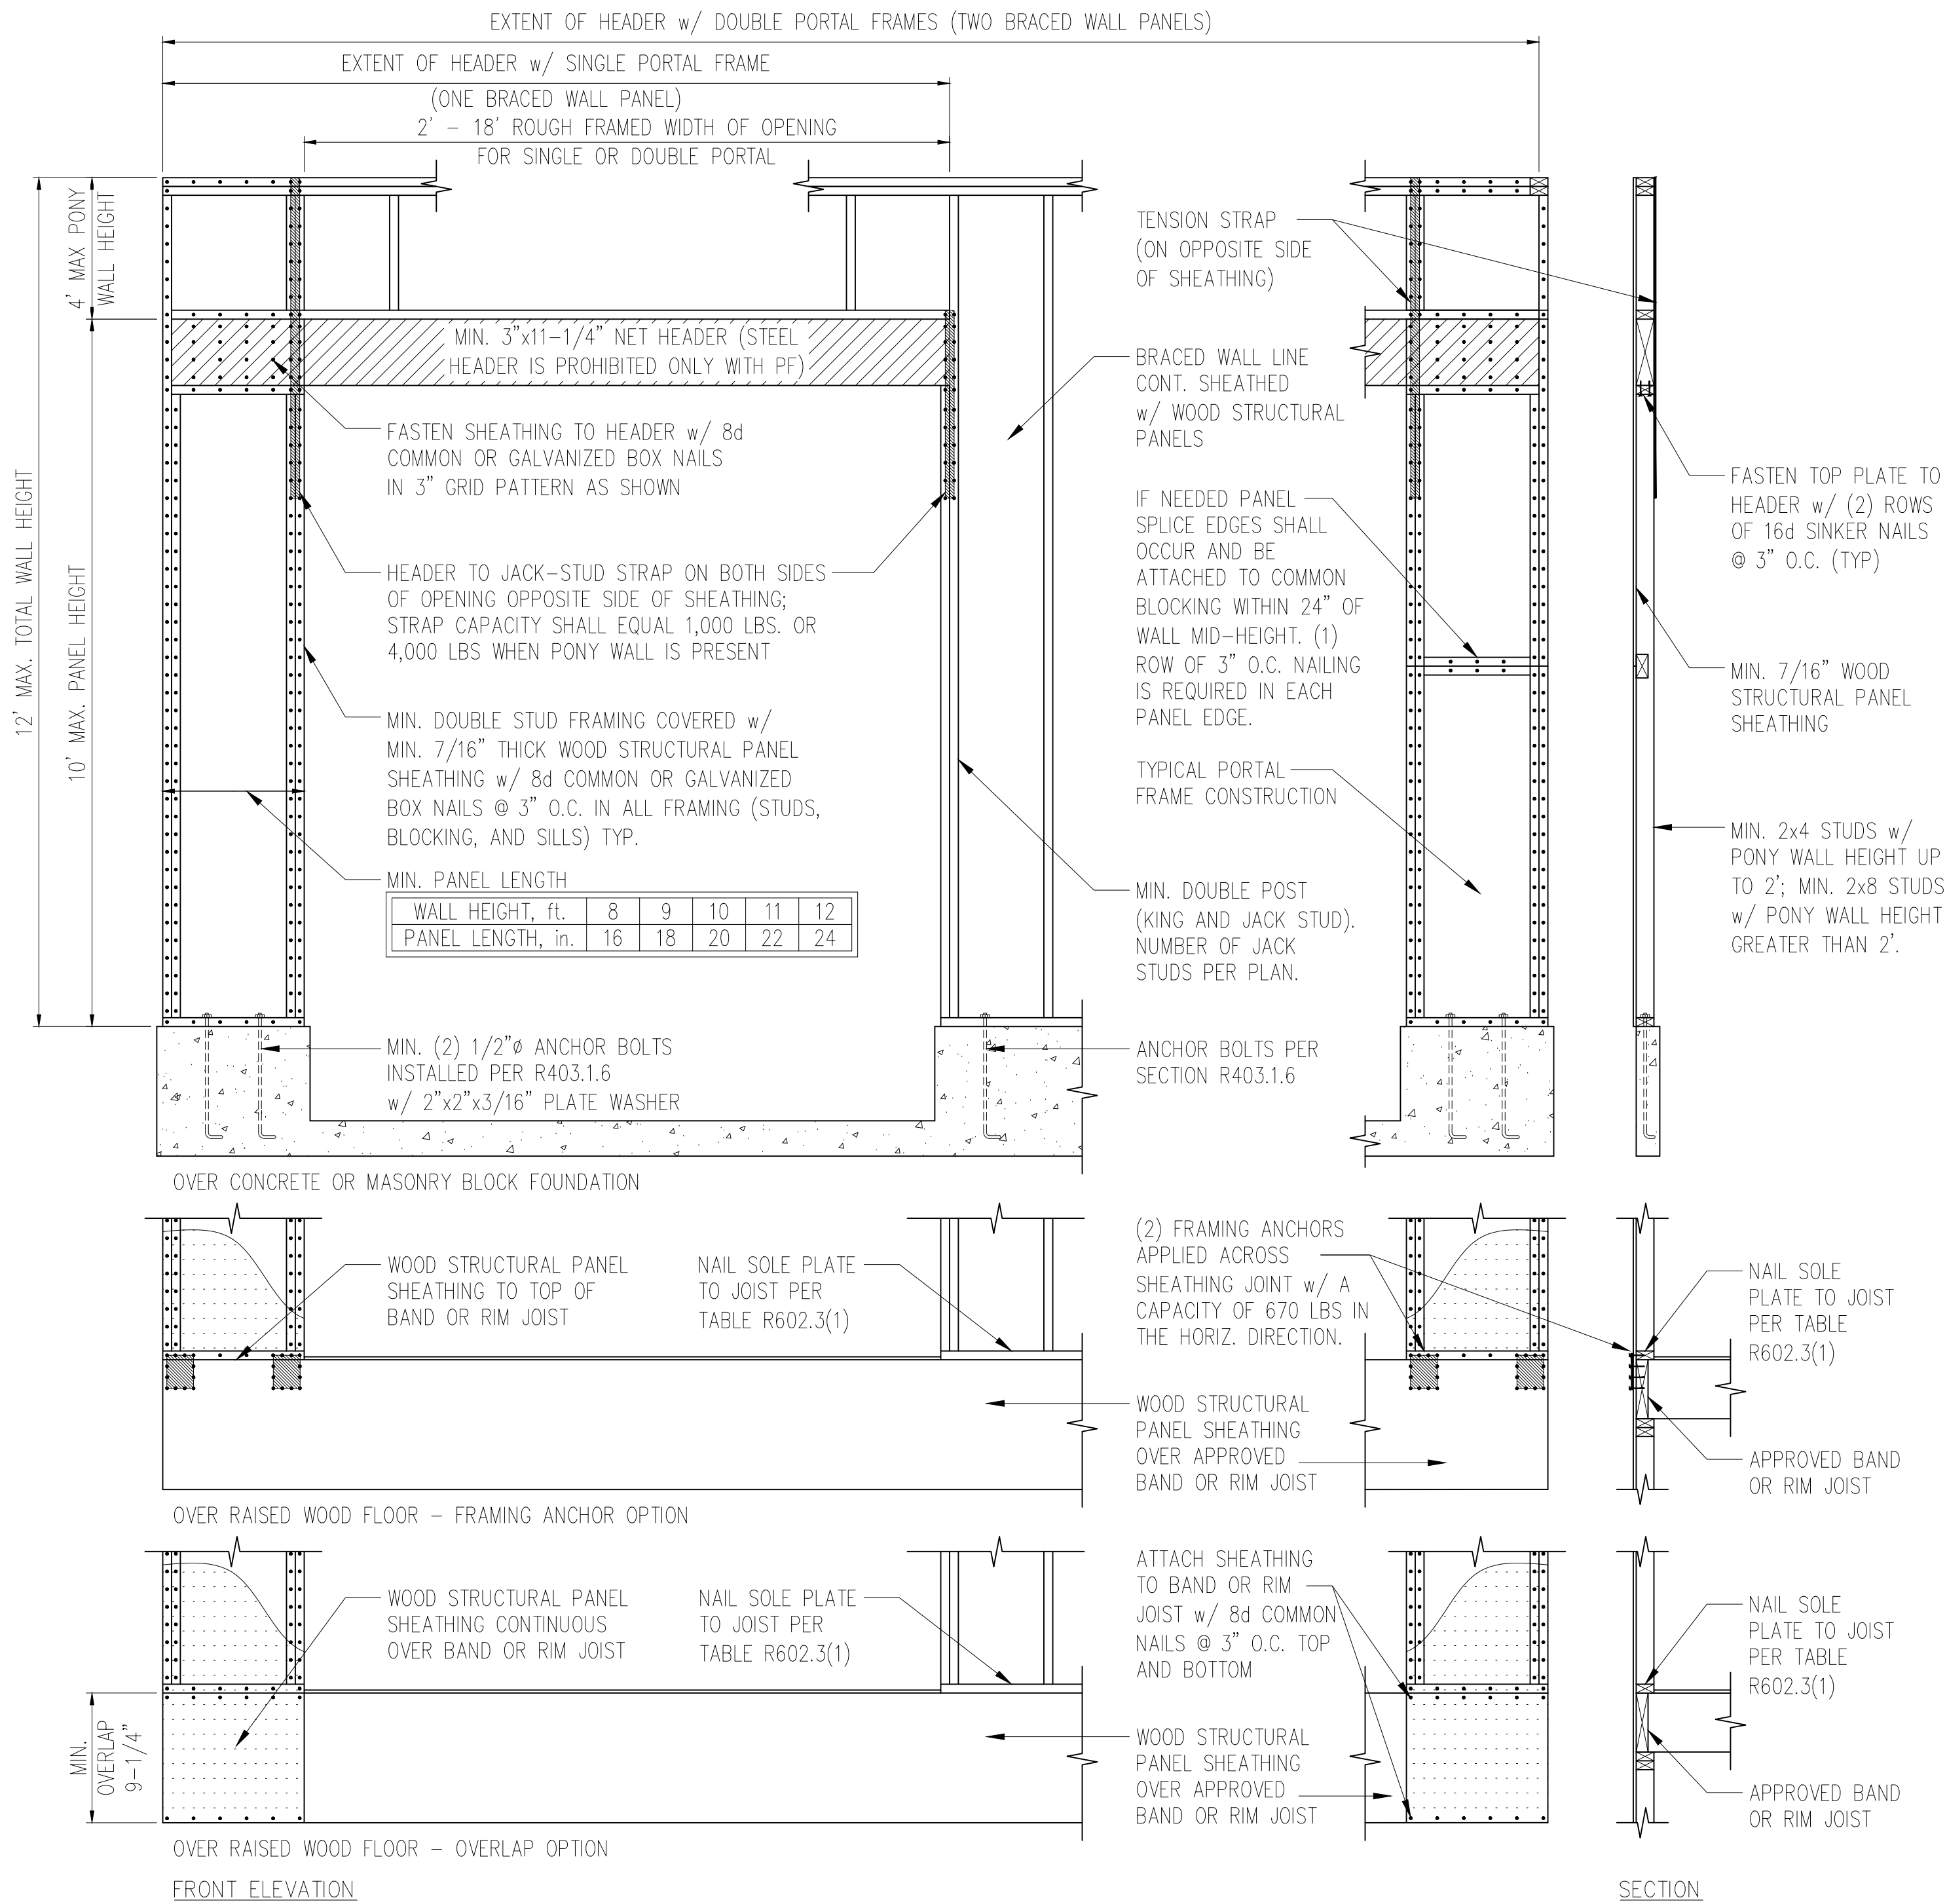





1 METHOD PF: PORTAL FRAME DETAIL  
3/8" = 1'-0"

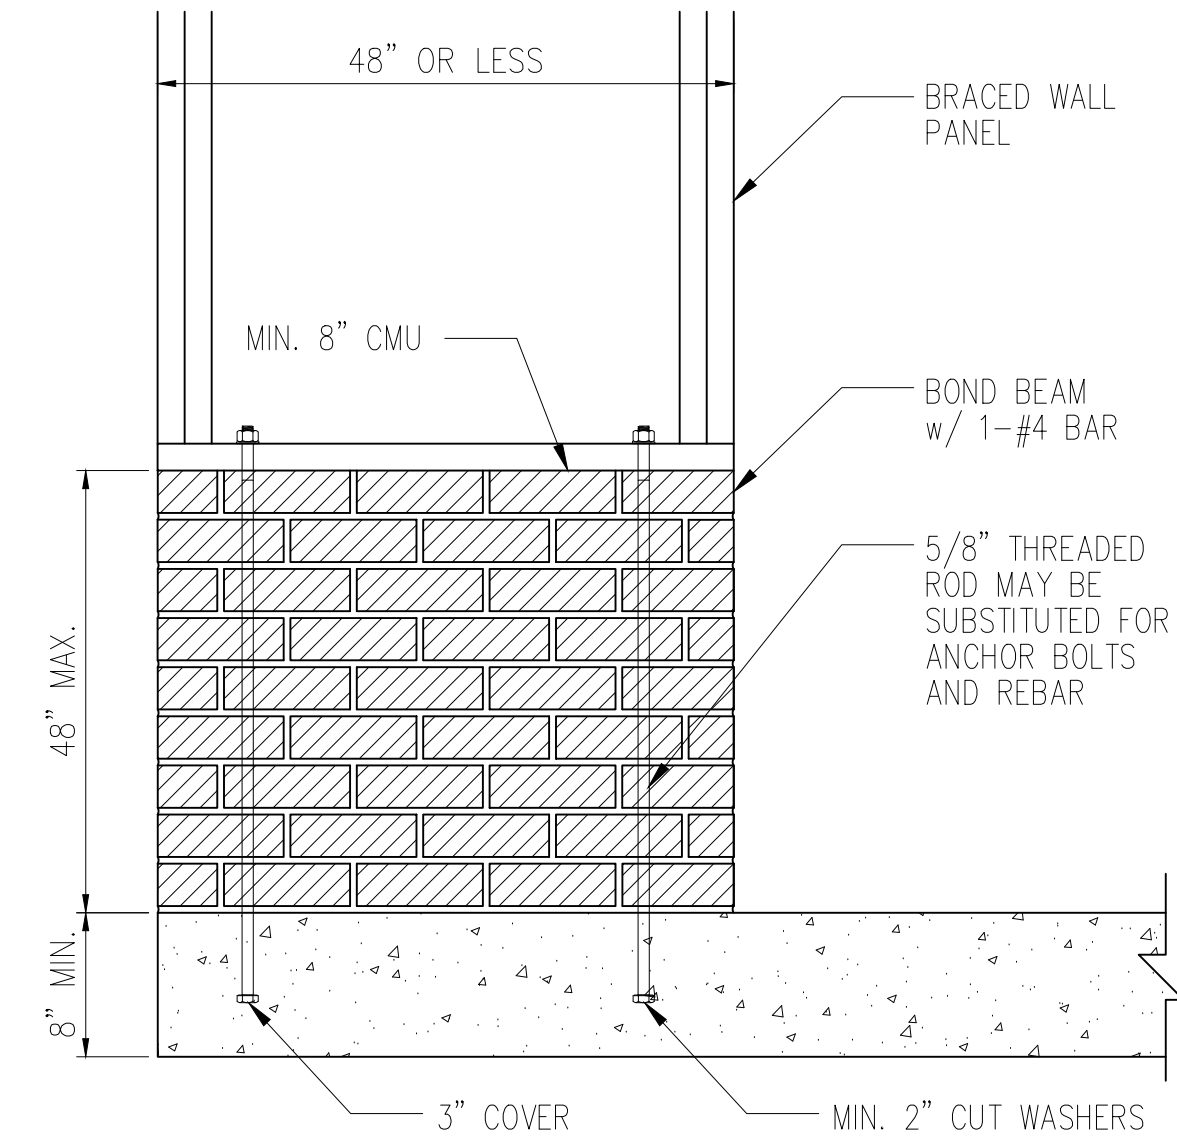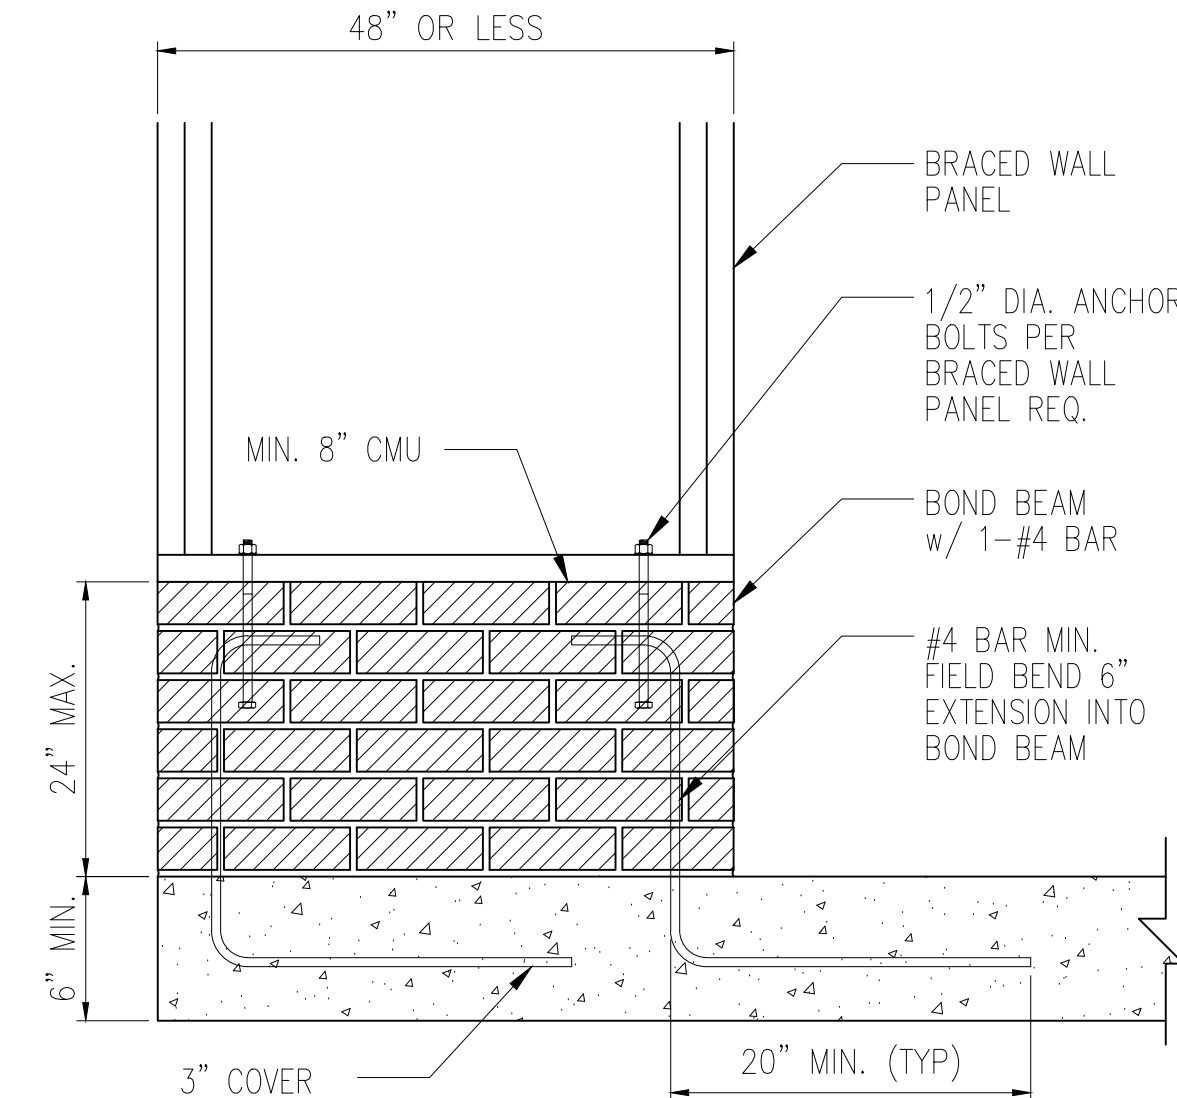

2 MASONRY STEM WALLS SUPPORTING BRACED WALL PANELS  
D1f NTS

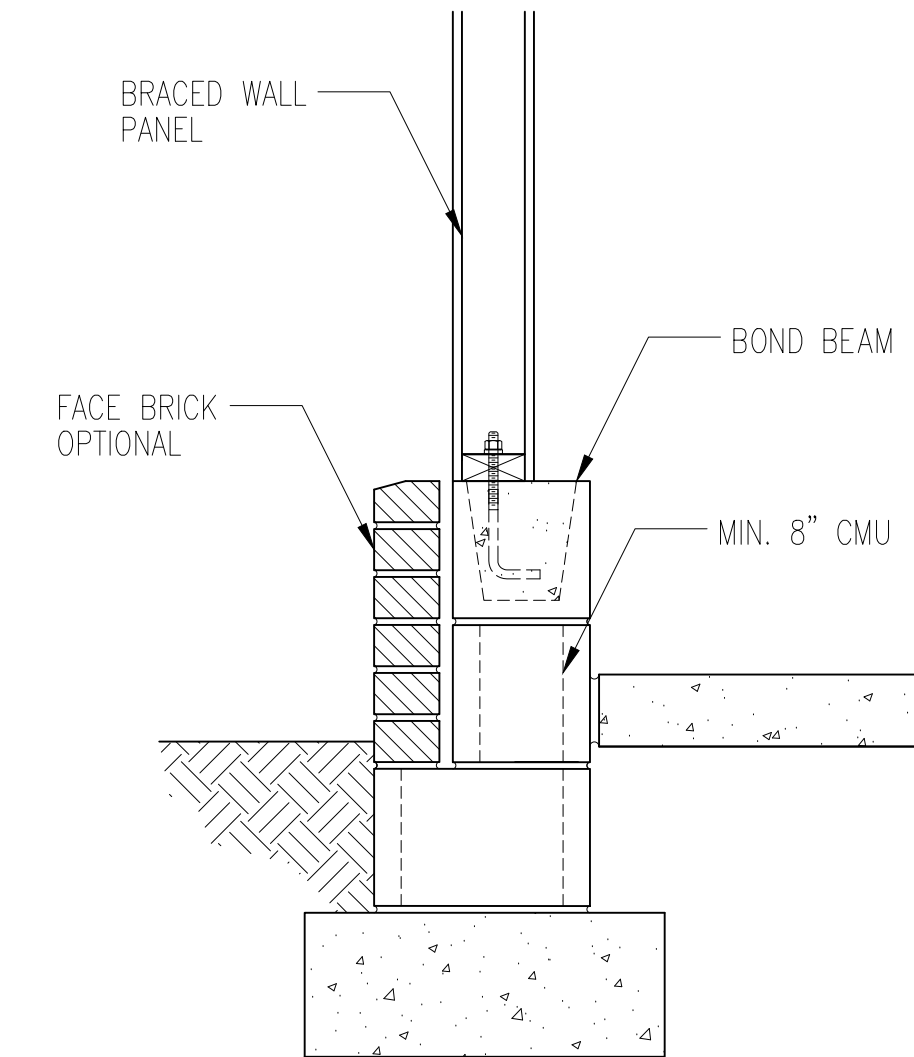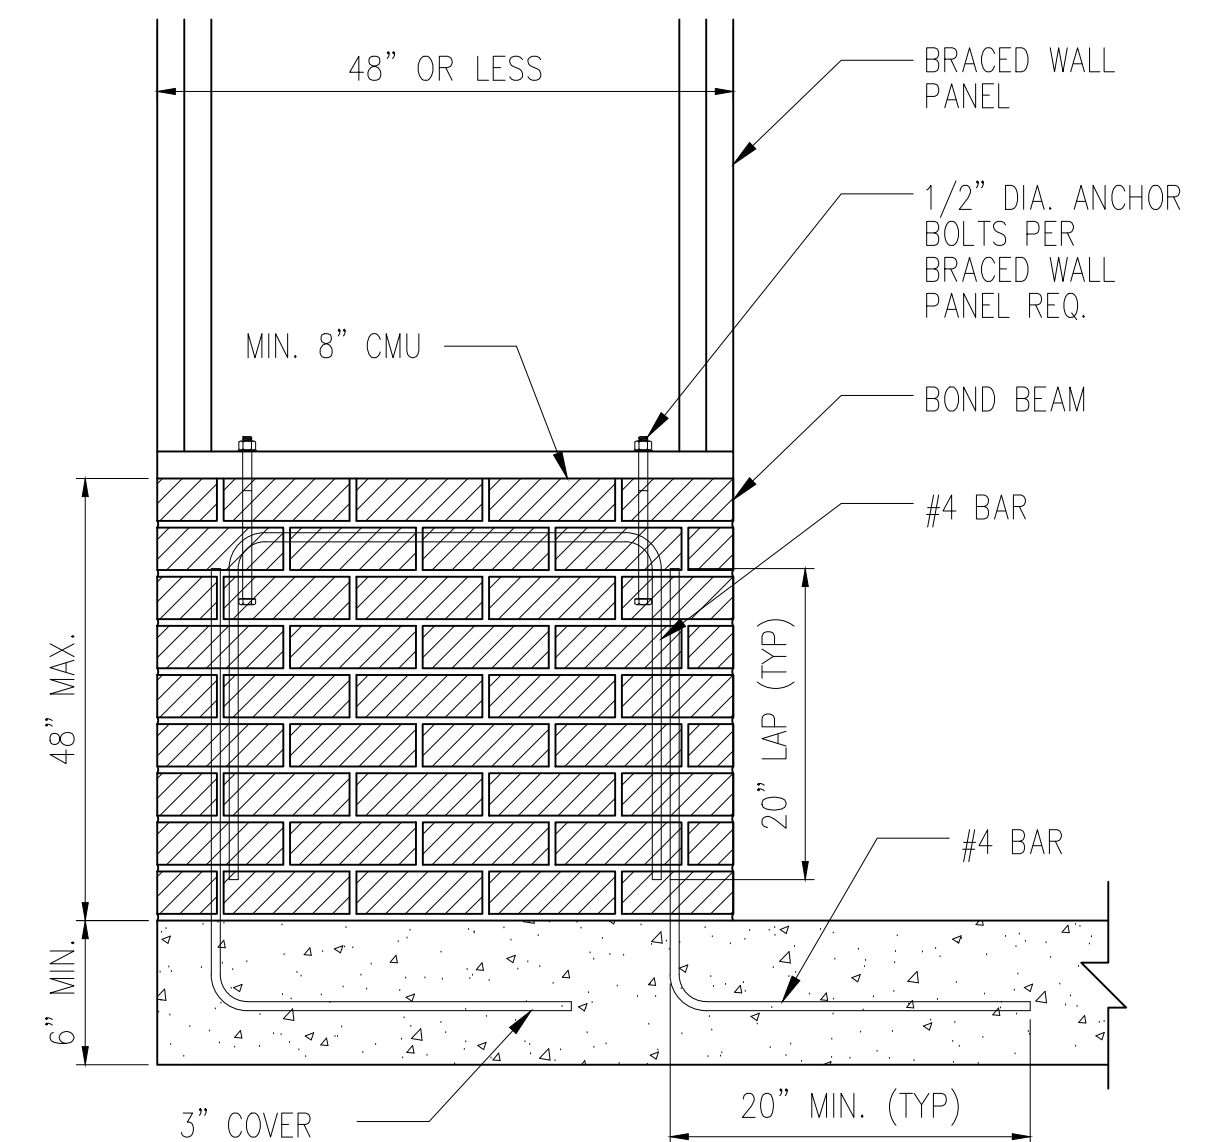


NOTE: GROUT BOND BEAMS AND ALL CELLS WHICH CONTAIN REBAR, THREADED RODS AND ANCHOR BOLTS

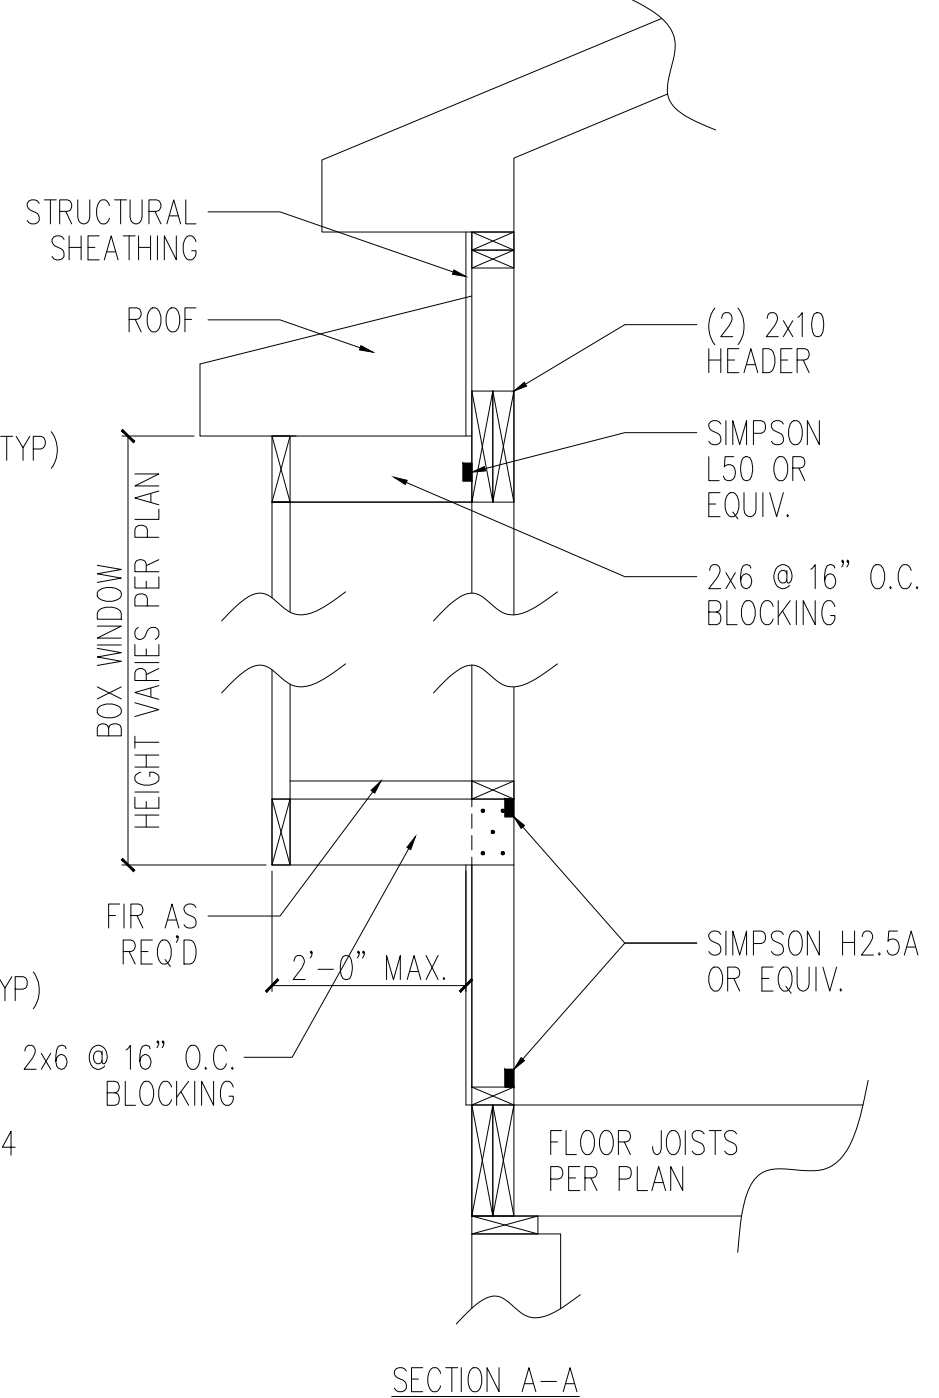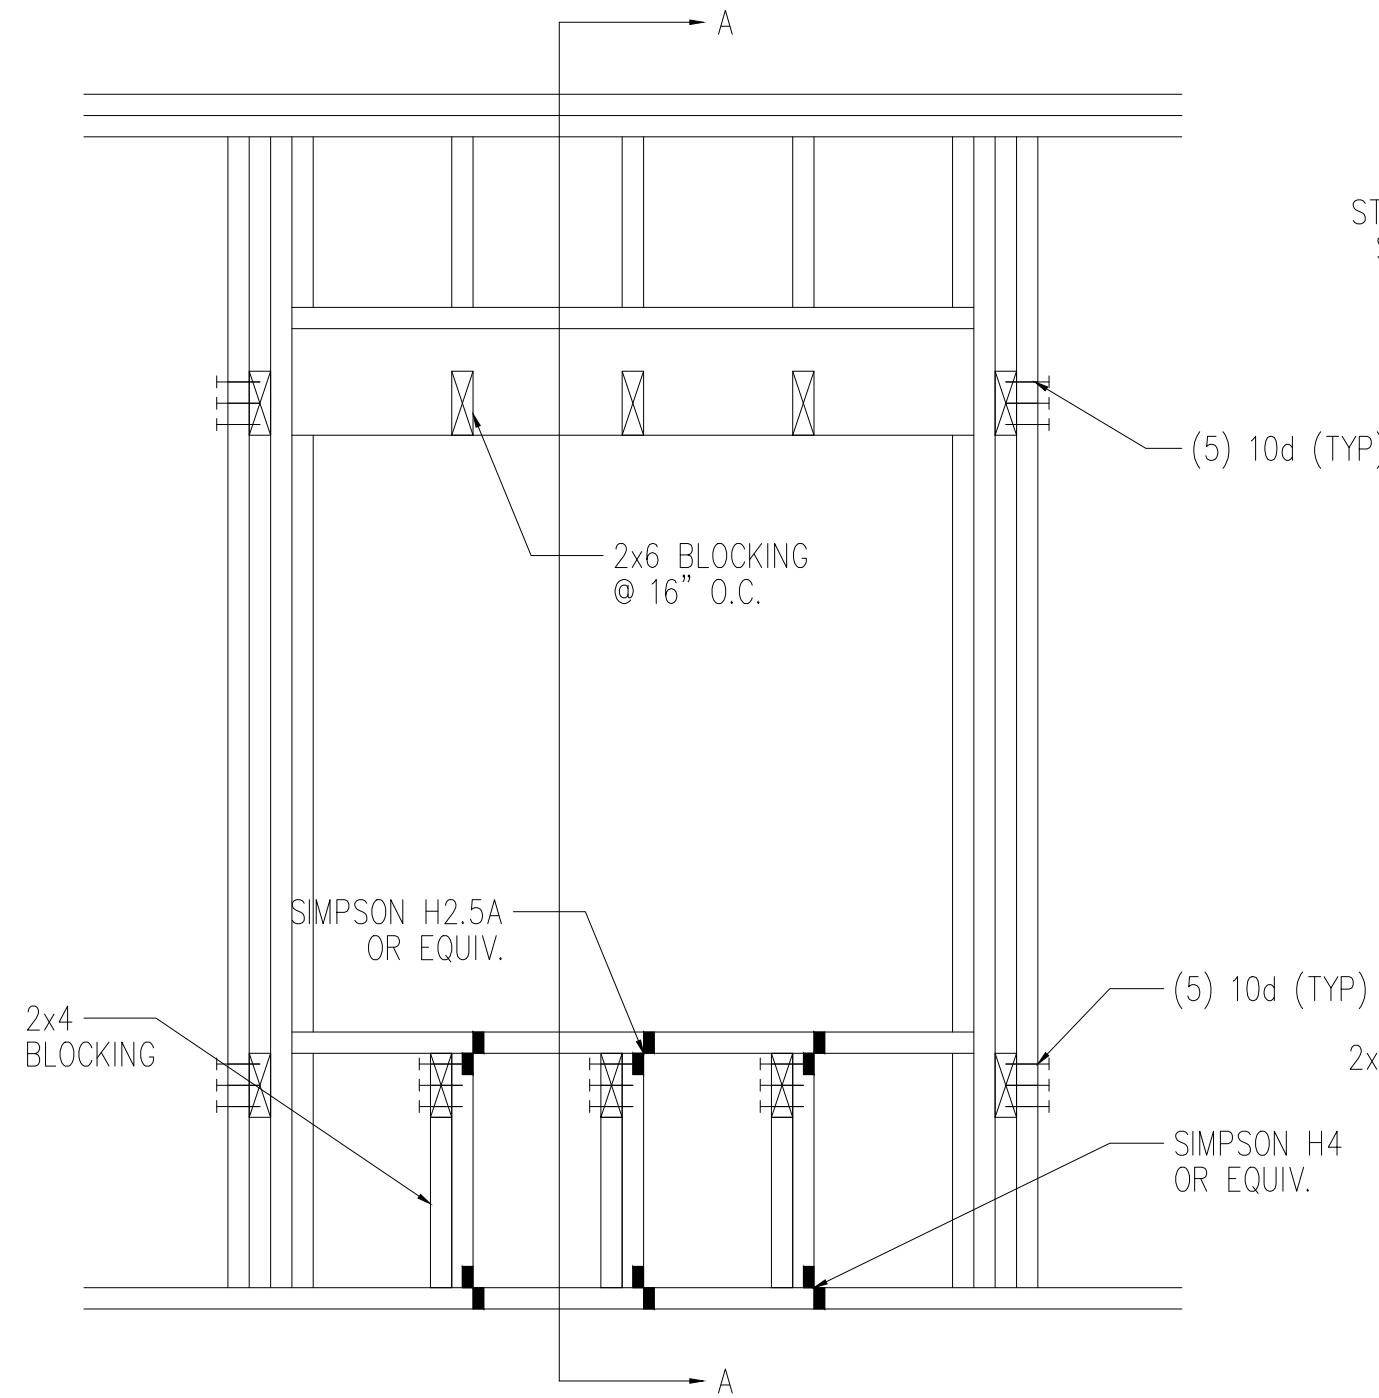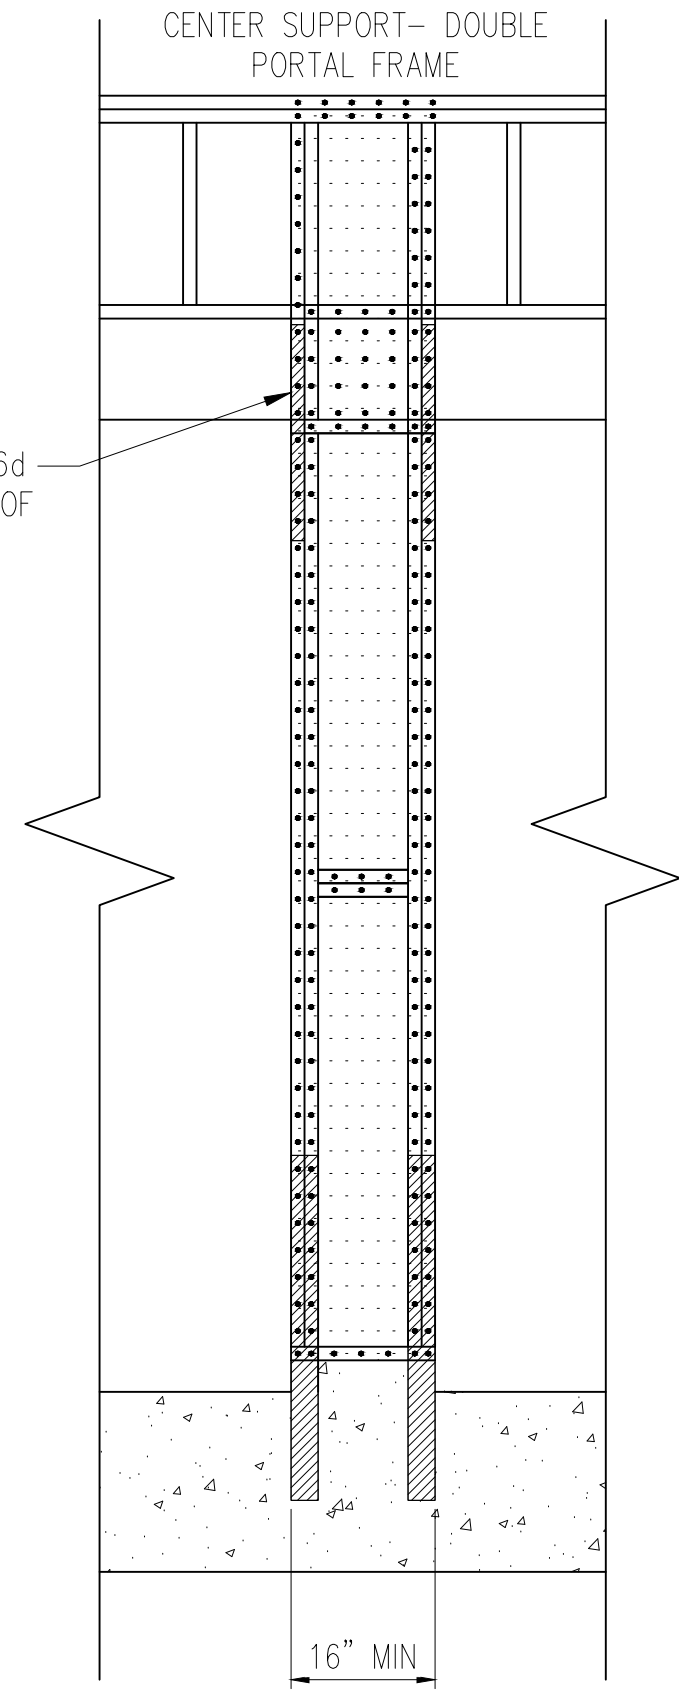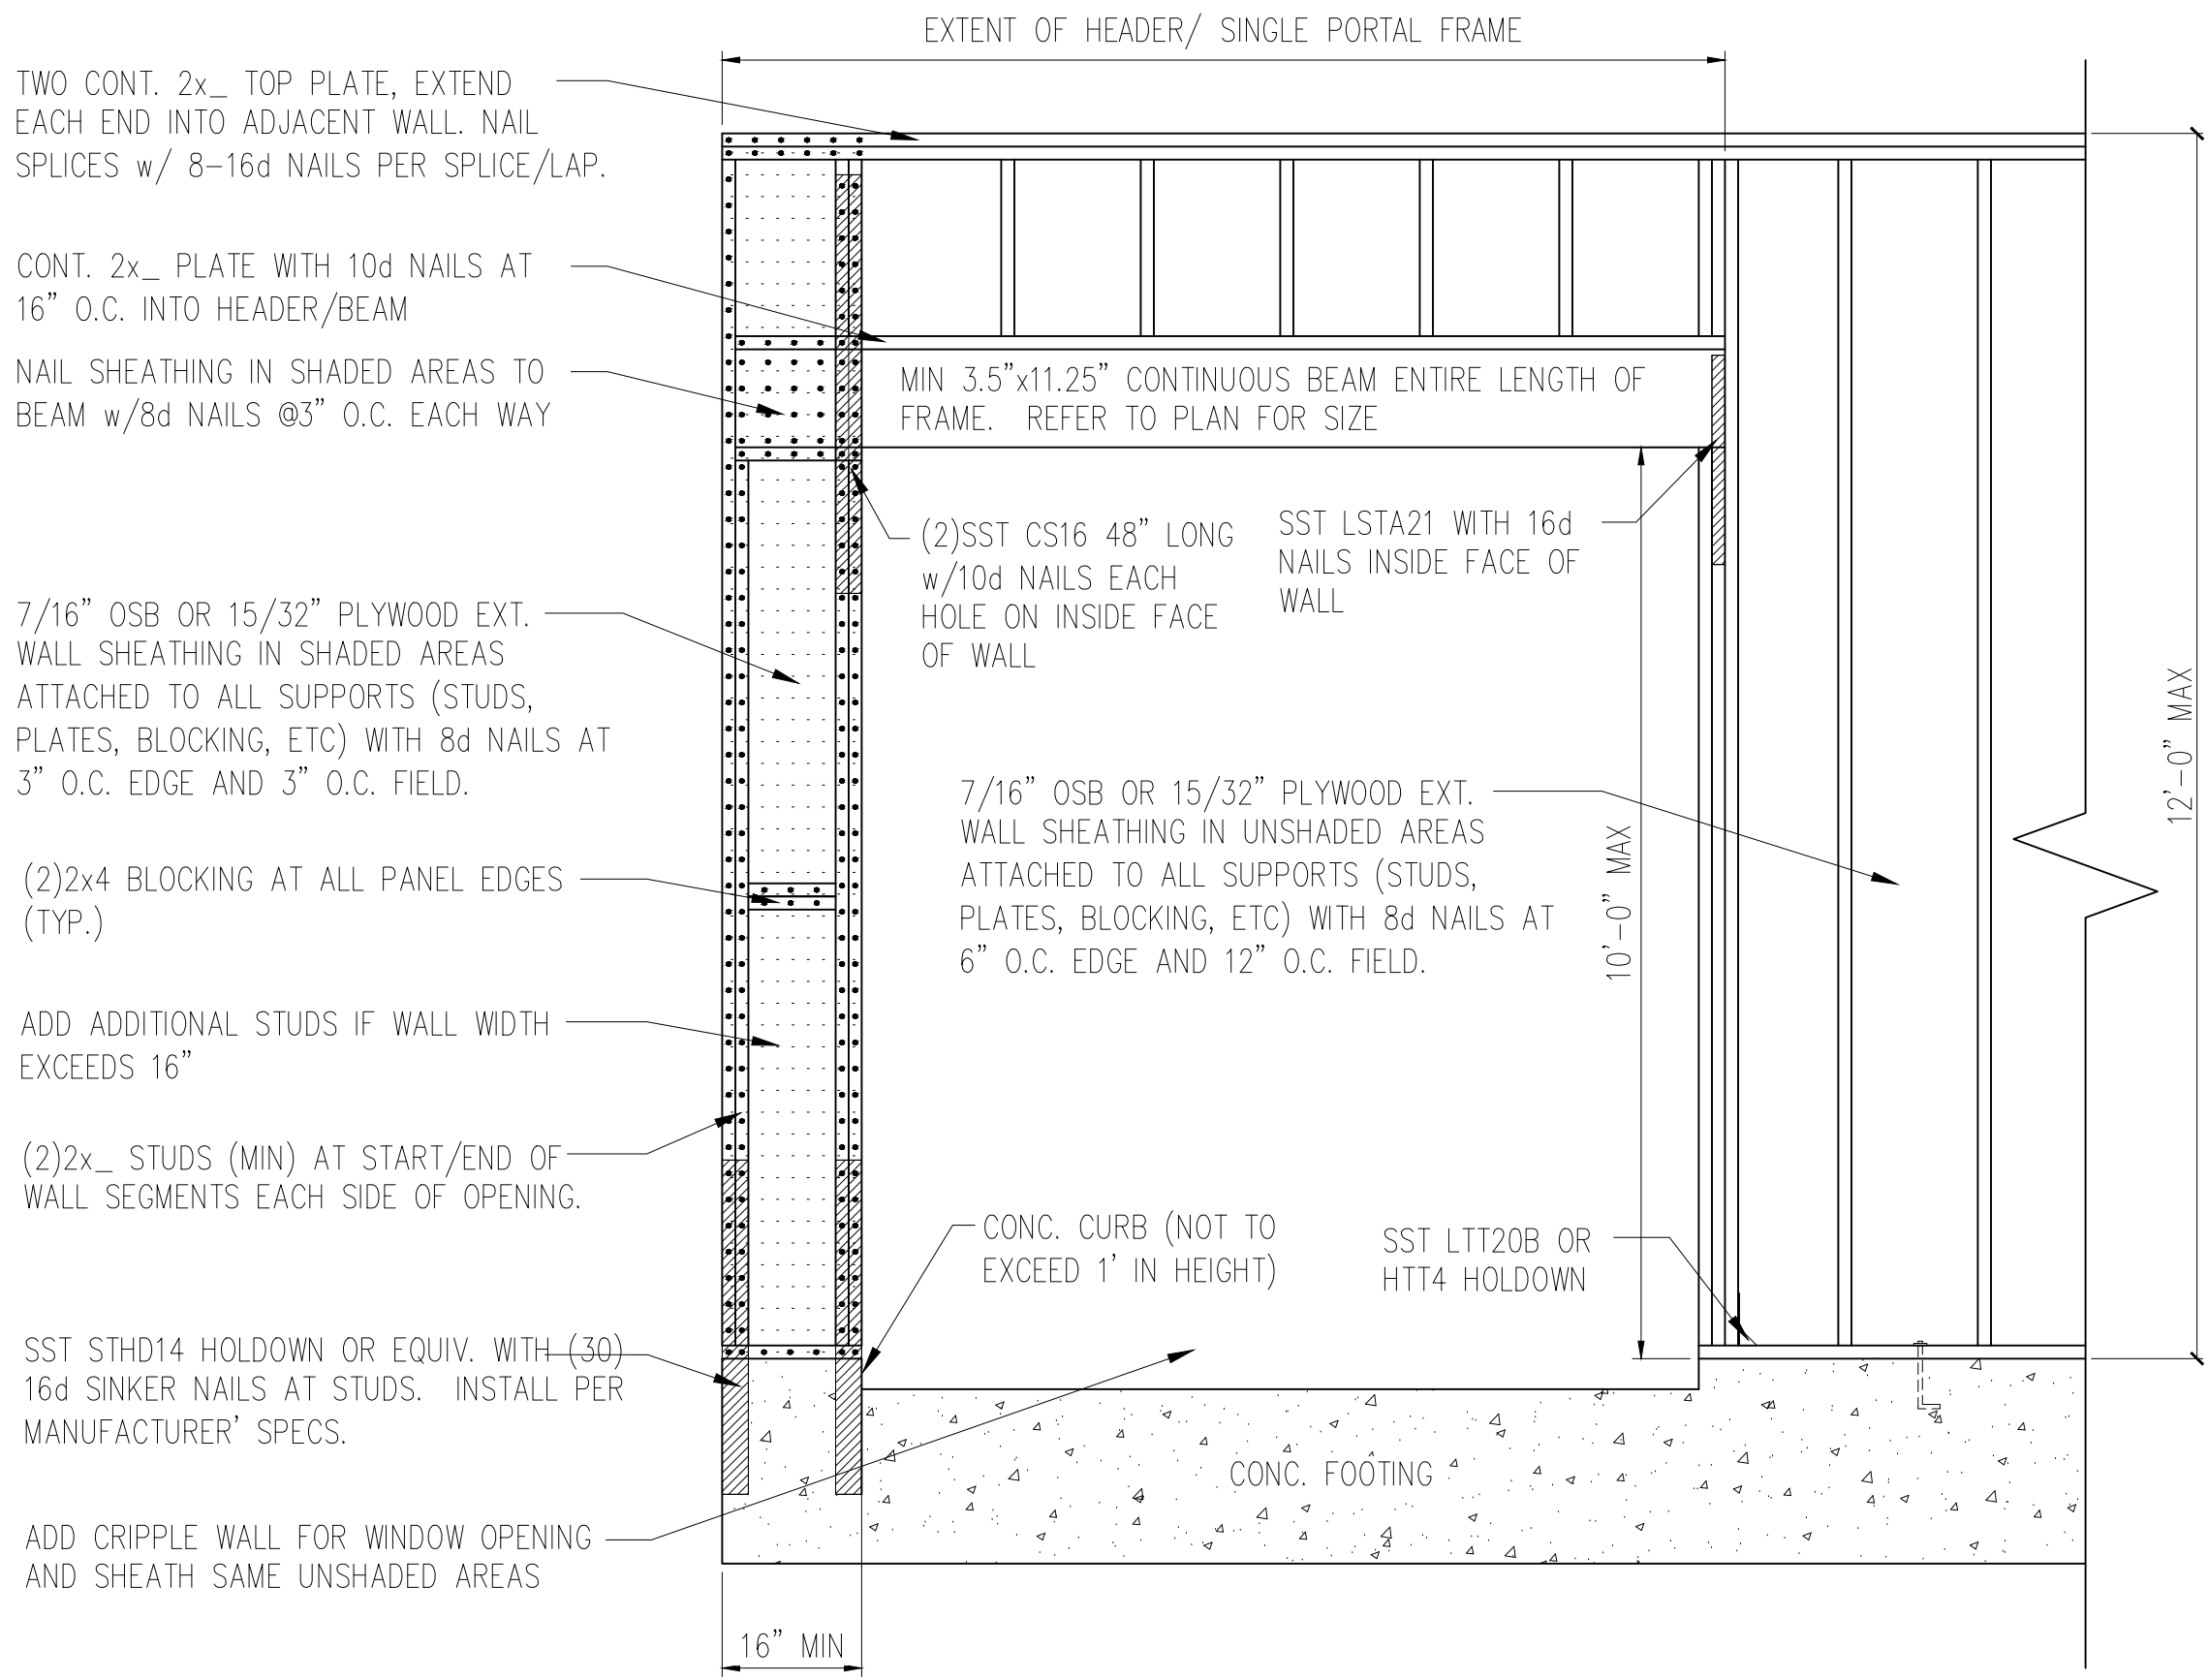


1 METHOD PF: PORTAL FRAME DETAIL w/ HOLD-DOWNS  
D2f 3/4" = 1'-0"


2 BOX WINDOW DETAIL  
D2f N.T.S

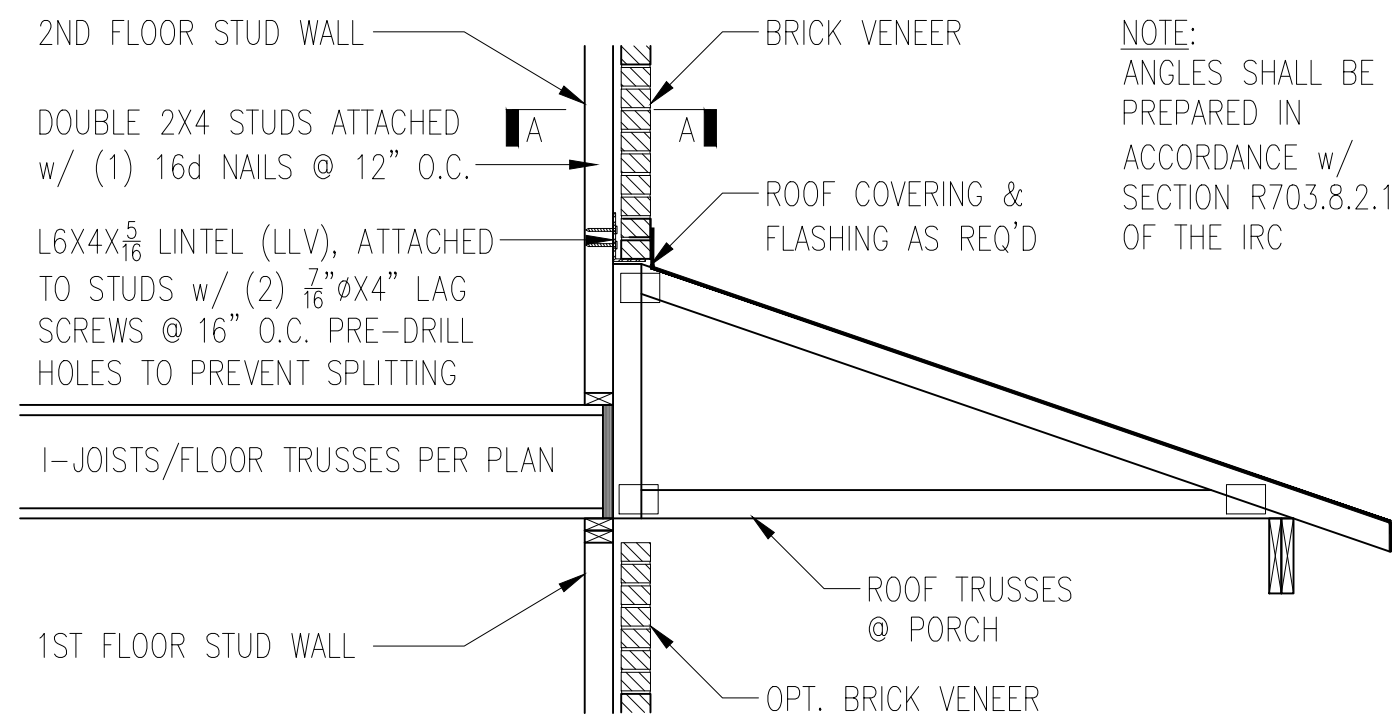


TRUSSES PERPENDICULAR TO STUD WALL

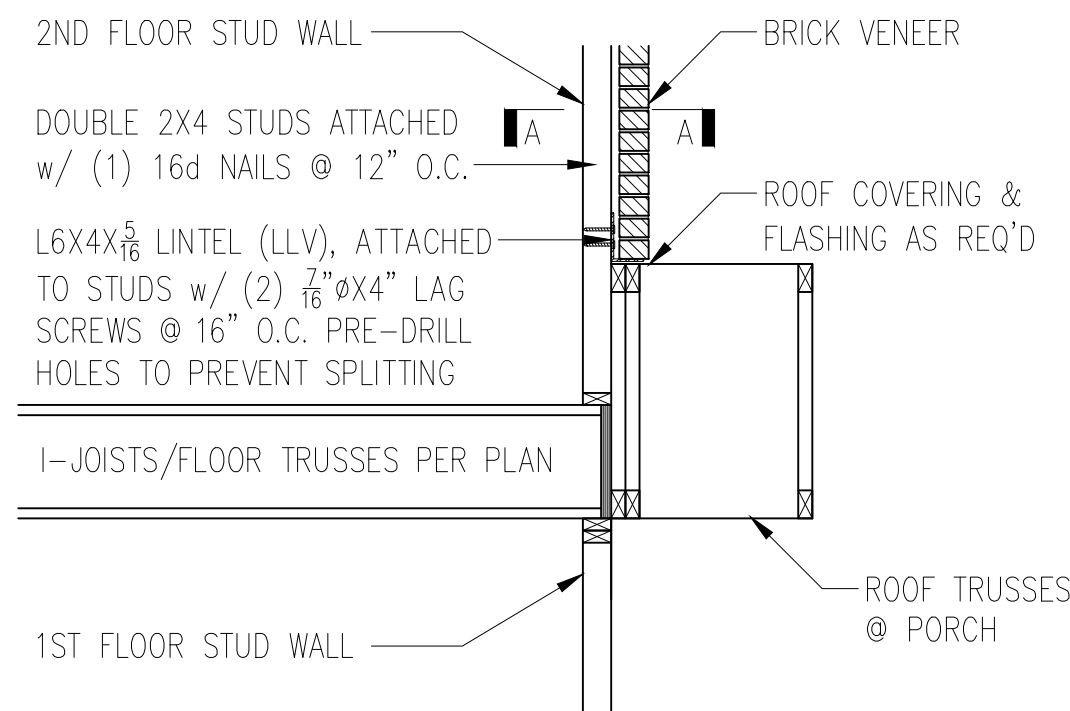

TRUSSES PARALLEL TO STUD WALL

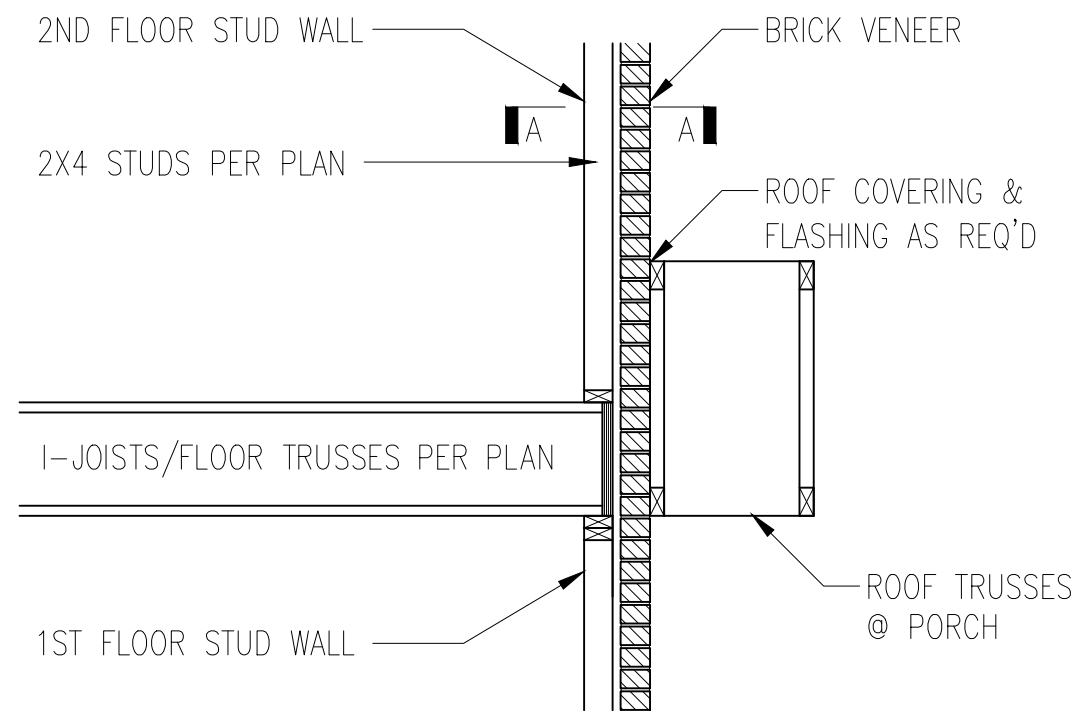


TRUSSES PARALLEL TO STUD WALL w/ CONTINUOUS BRICK VENEER

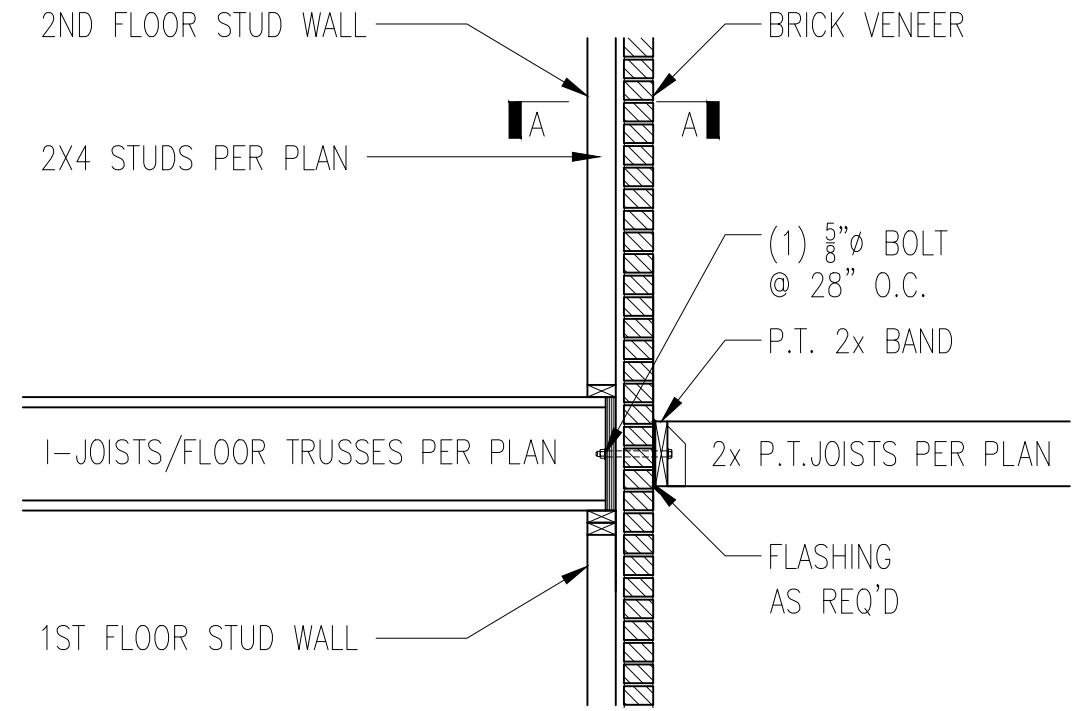

BALCONY JOIST ATTACHMENT  
D2f NTS

3 BRICK SUPPORT ABOVE STORAGE/PORCH ROOF DETAIL  
D2f NTS

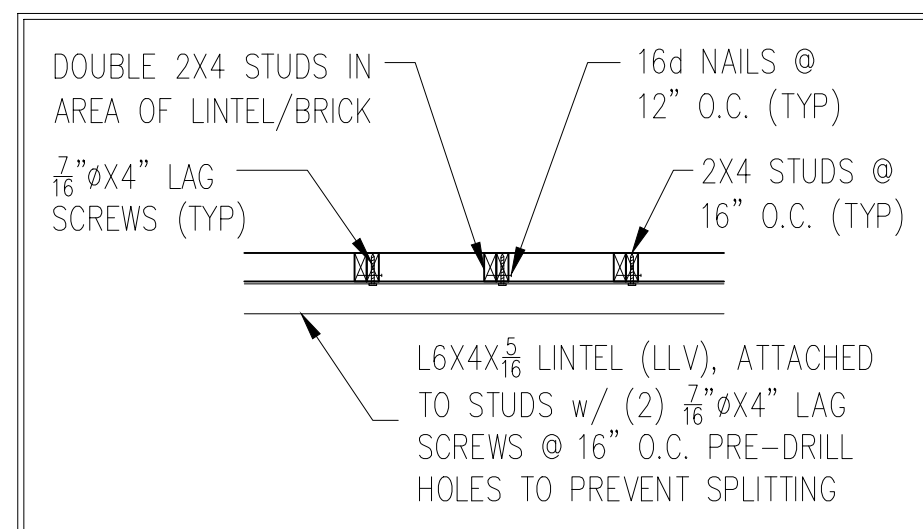


SECTION A-A  
NTS



MINIMUM FASTENING  
REQUIREMENTS FOR  
TOP- AND SIDE-LOADED  
MEMBERS

| FASTENER TYPE                               | LVL DEPTH      | 3 1/2" WIDE            | 5 1/4" WIDE            |                   | 7" WIDE                |                        |   |
|---------------------------------------------|----------------|------------------------|------------------------|-------------------|------------------------|------------------------|---|
|                                             |                |                        |                        |                   |                        |                        |   |
| 10d (0.128" x 3")<br>Nails                  | 7/4" ≤ d < 14" | 3 rows @ 12" o.c.      | 3 rows @ 12" o.c. (ES) | 3 rows @ 12" o.c. | -                      | 3 rows @ 12" o.c. (ES) | - |
|                                             | d ≥ 14"        | 4 rows @ 12" o.c.      | 4 rows @ 12" o.c. (ES) | 4 rows @ 12" o.c. | -                      | 4 rows @ 12" o.c. (ES) | - |
| 16d (0.162" x 3 1/2")<br>Nails              | 7/4" ≤ d < 14" | 2 rows @ 12" o.c.      | 2 rows @ 12" o.c. (ES) | 2 rows @ 12" o.c. | -                      | 2 rows @ 12" o.c. (ES) | - |
|                                             | d ≥ 14"        | 3 rows @ 12" o.c. (ES) | 3 rows @ 12" o.c. (ES) | 3 rows @ 12" o.c. | -                      | 3 rows @ 12" o.c. (ES) | - |
| 1/2" Through Bolts                          | d ≥ 7 1/4"     | 2 rows @ 24" o.c.      |                        | 2 rows @ 24" o.c. |                        | 2 rows @ 24" o.c.      |   |
| SDS 1/4" x 3 1/2", WS35,<br>3 3/8" TrussLok |                | 2 rows @ 24" o.c.      | 2 rows @ 24" o.c. (ES) | 2 rows @ 24" o.c. | -                      | 2 rows @ 24" o.c. (ES) | - |
| SDS 1/4" x 6", WS6                          |                | -                      | -                      | -                 | 2 rows @ 24" o.c. (ES) |                        |   |
| 5" TrussLok                                 |                | -                      | 2 rows @ 24" o.c.      |                   | -                      |                        |   |
| 6 3/4" TrussLok                             |                | -                      | -                      | -                 | 2 rows @ 24" o.c.      |                        |   |



- NOTES:**
- All fasteners must meet the minimum requirements in the table above. Side-loaded multiple-ply members must meet the minimum fastening and side-loading capacity requirements given on page 48.
  - Minimum fastening requirements for depths less than 7 1/4" require special consideration. Please contact your technical representative.
  - Three general rules for staggering or offsetting for a certain fastener schedule:  
(1) if staggering or offsetting is not referenced, then none is required;  
(2) if staggering is referenced, then fasteners installed in adjacent rows on the front side are to be staggered up to one-half the o.c. spacing, but maintaining the fastener clearances above; and  
(3) if "ES" is referenced, then the fastener schedule must be repeated on each side, with the fasteners on the back side offset up to one-half the o.c. spacing of the front side (whether or not it is staggered).

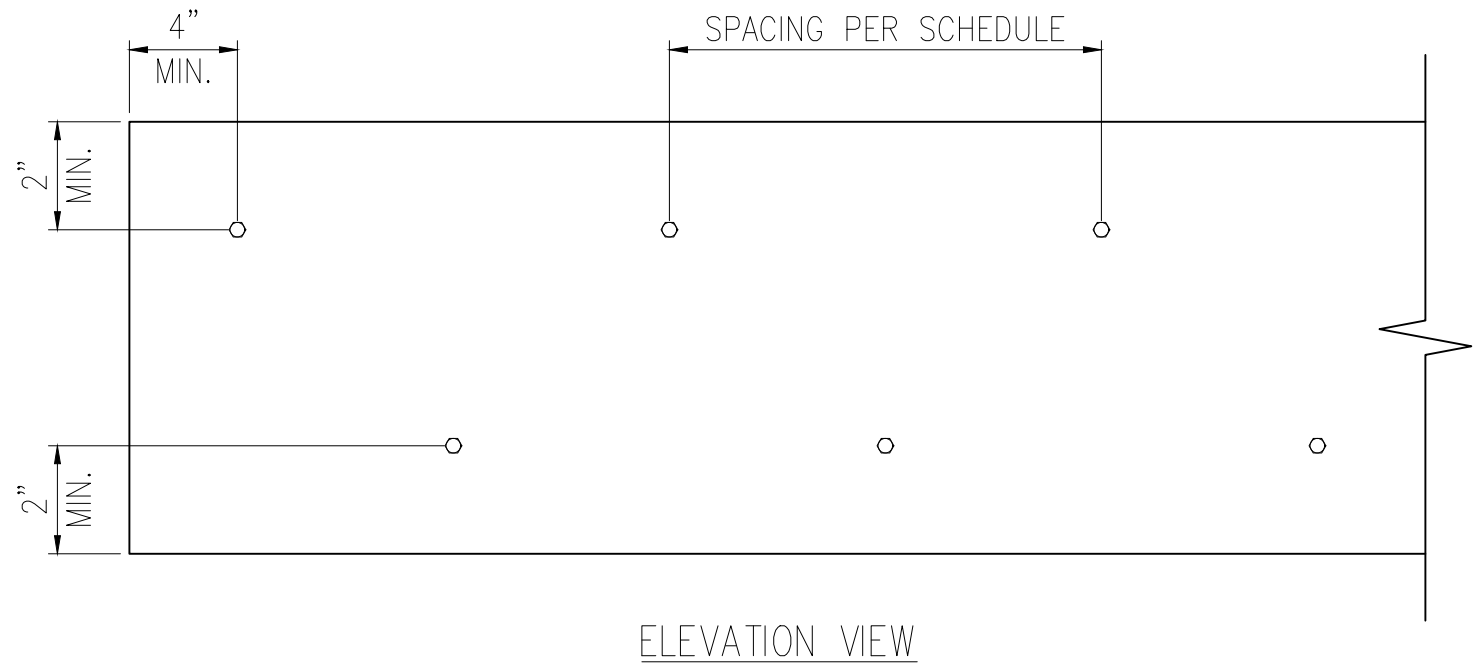


1 MULTI-PLY BEAM CONNECTION DETAIL  
D3f N.T.S.

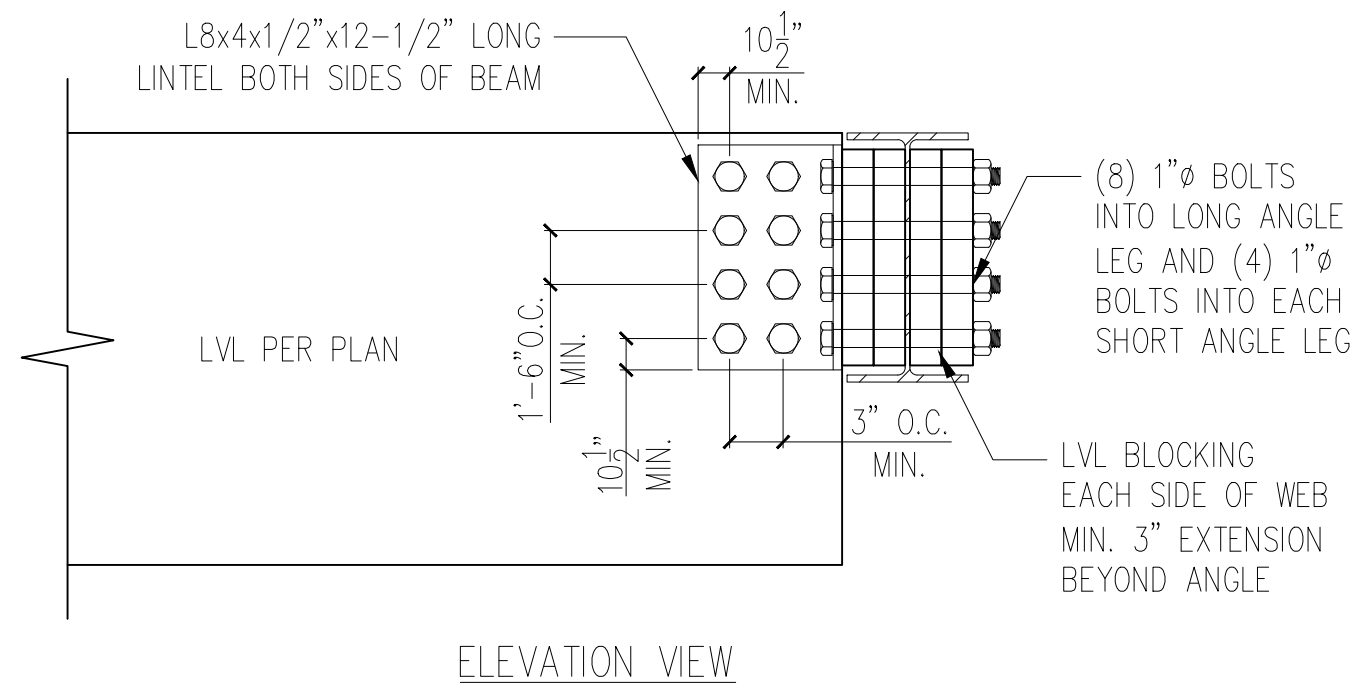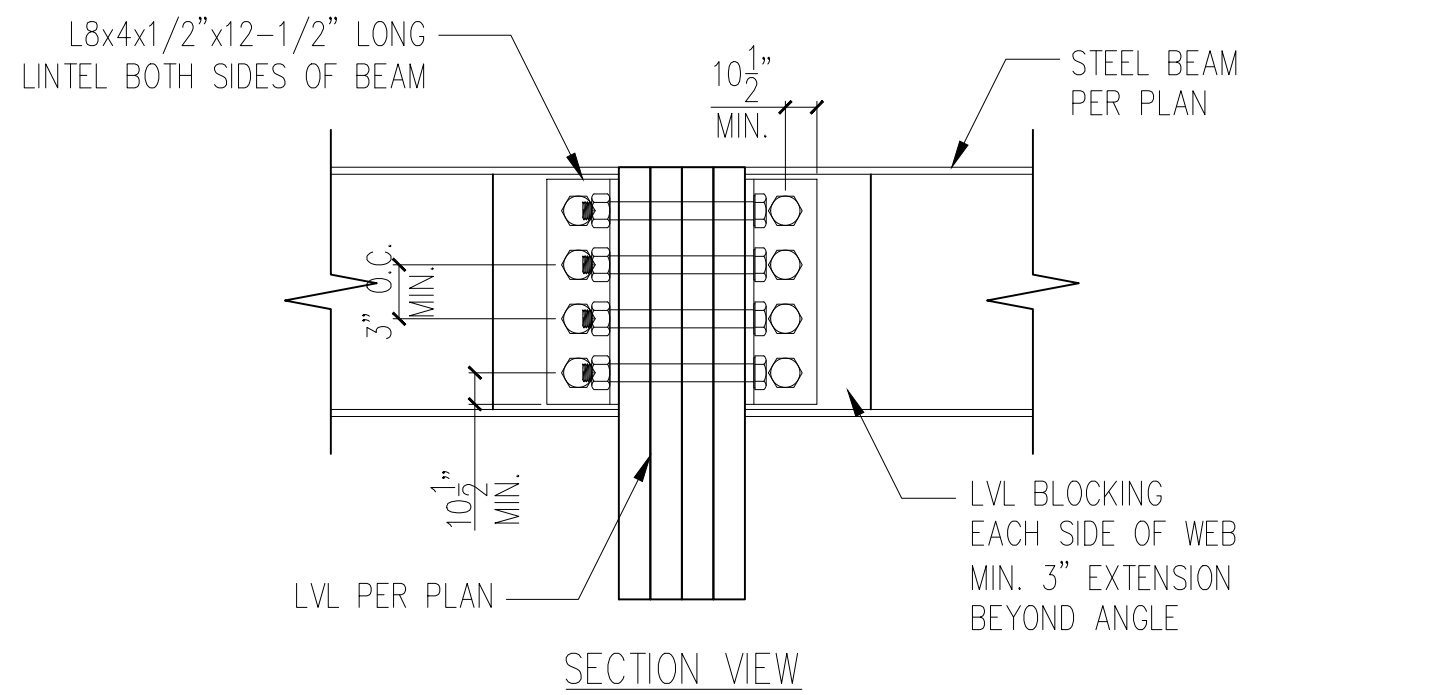


3 LVL TO STEEL DETAIL  
D3f N.T.S.

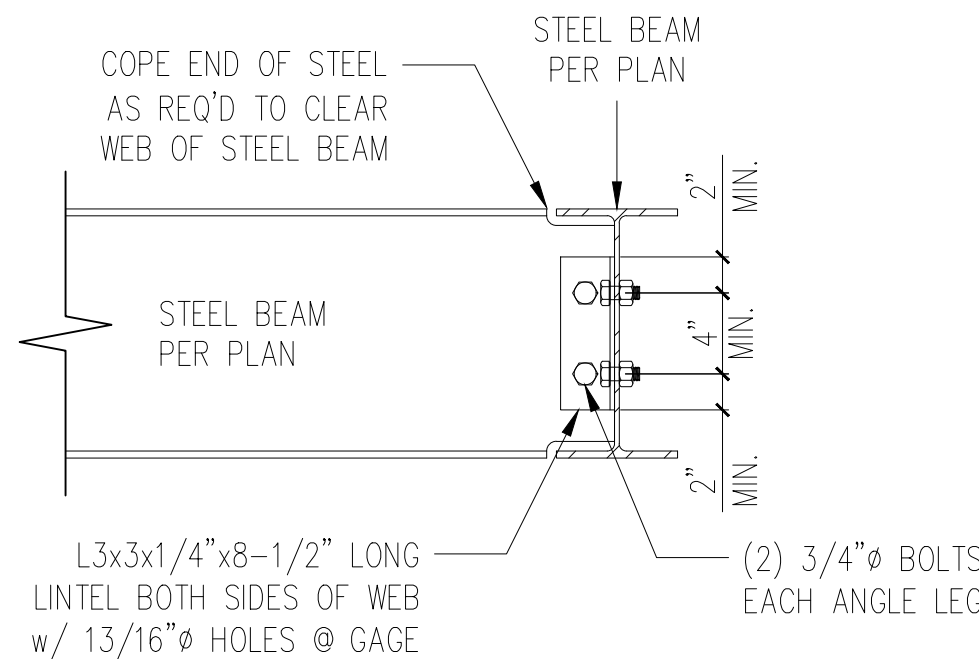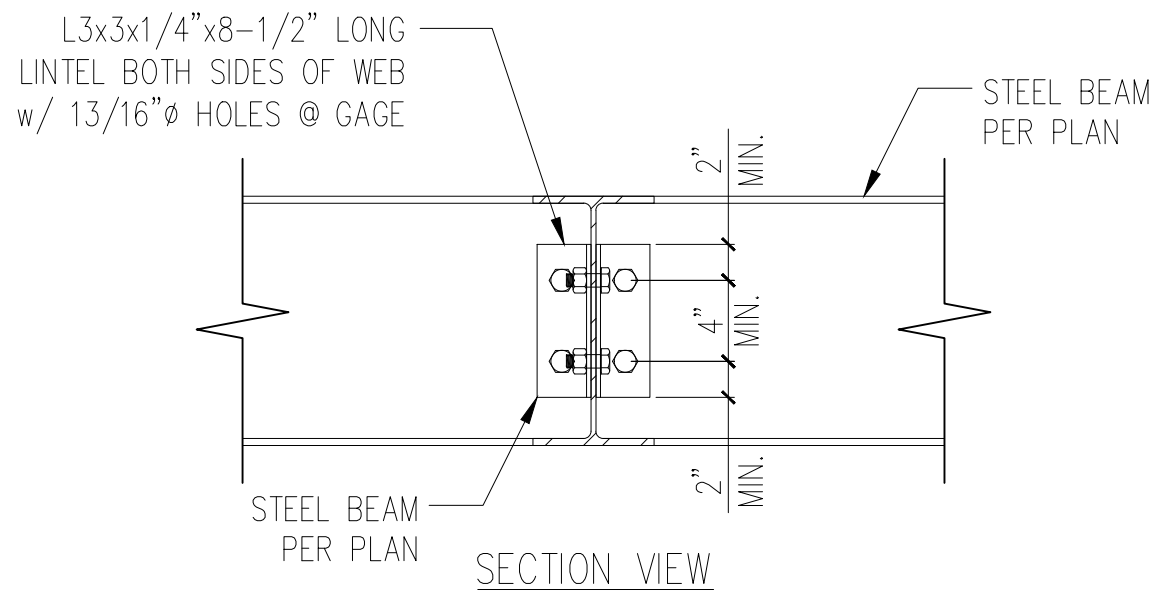


4 STEEL TO STEEL DETAIL  
D3f N.T.S.

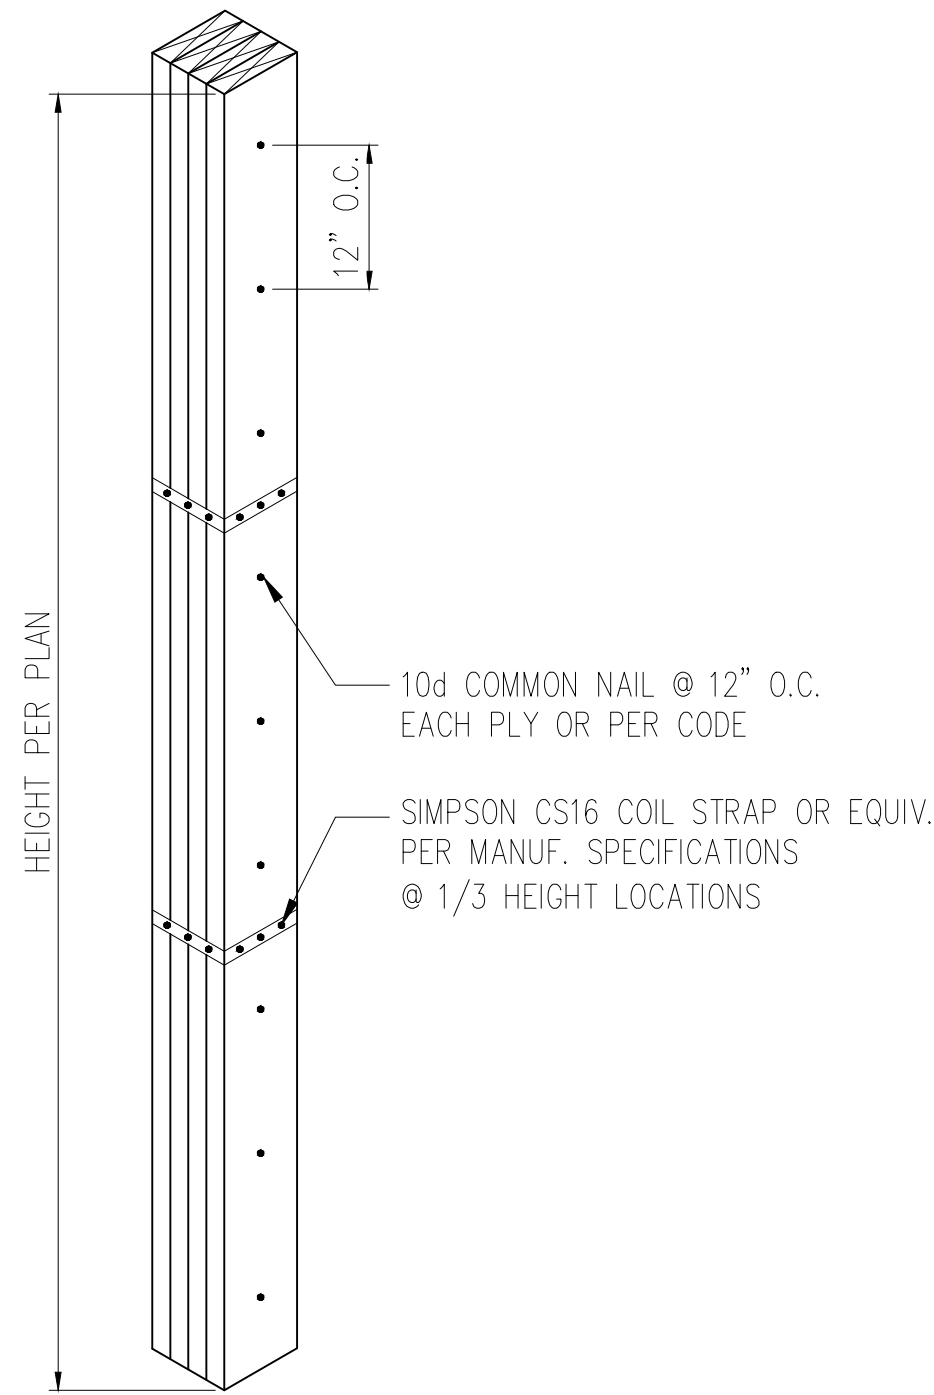

2 MULTI-PLY STUD CONNECTION DETAIL  
D3f N.T.S. 4+ PLIES

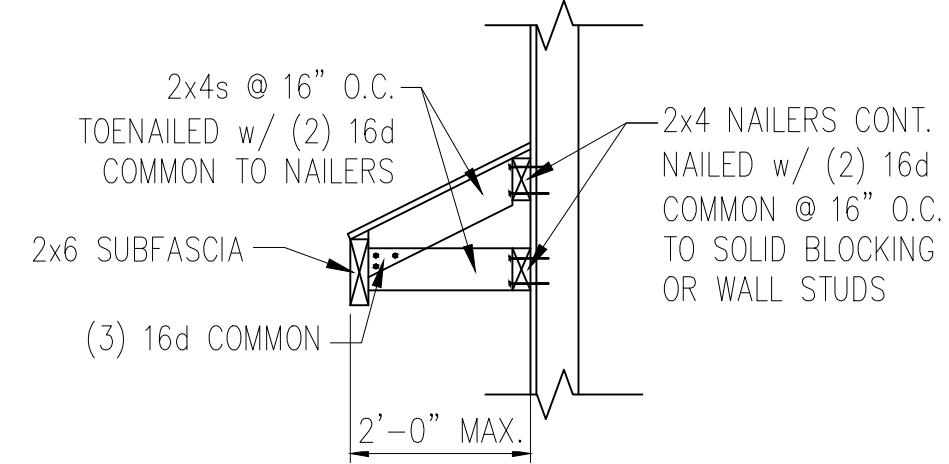


5 GABLE ROOF RETURN  
D3f N.T.S.

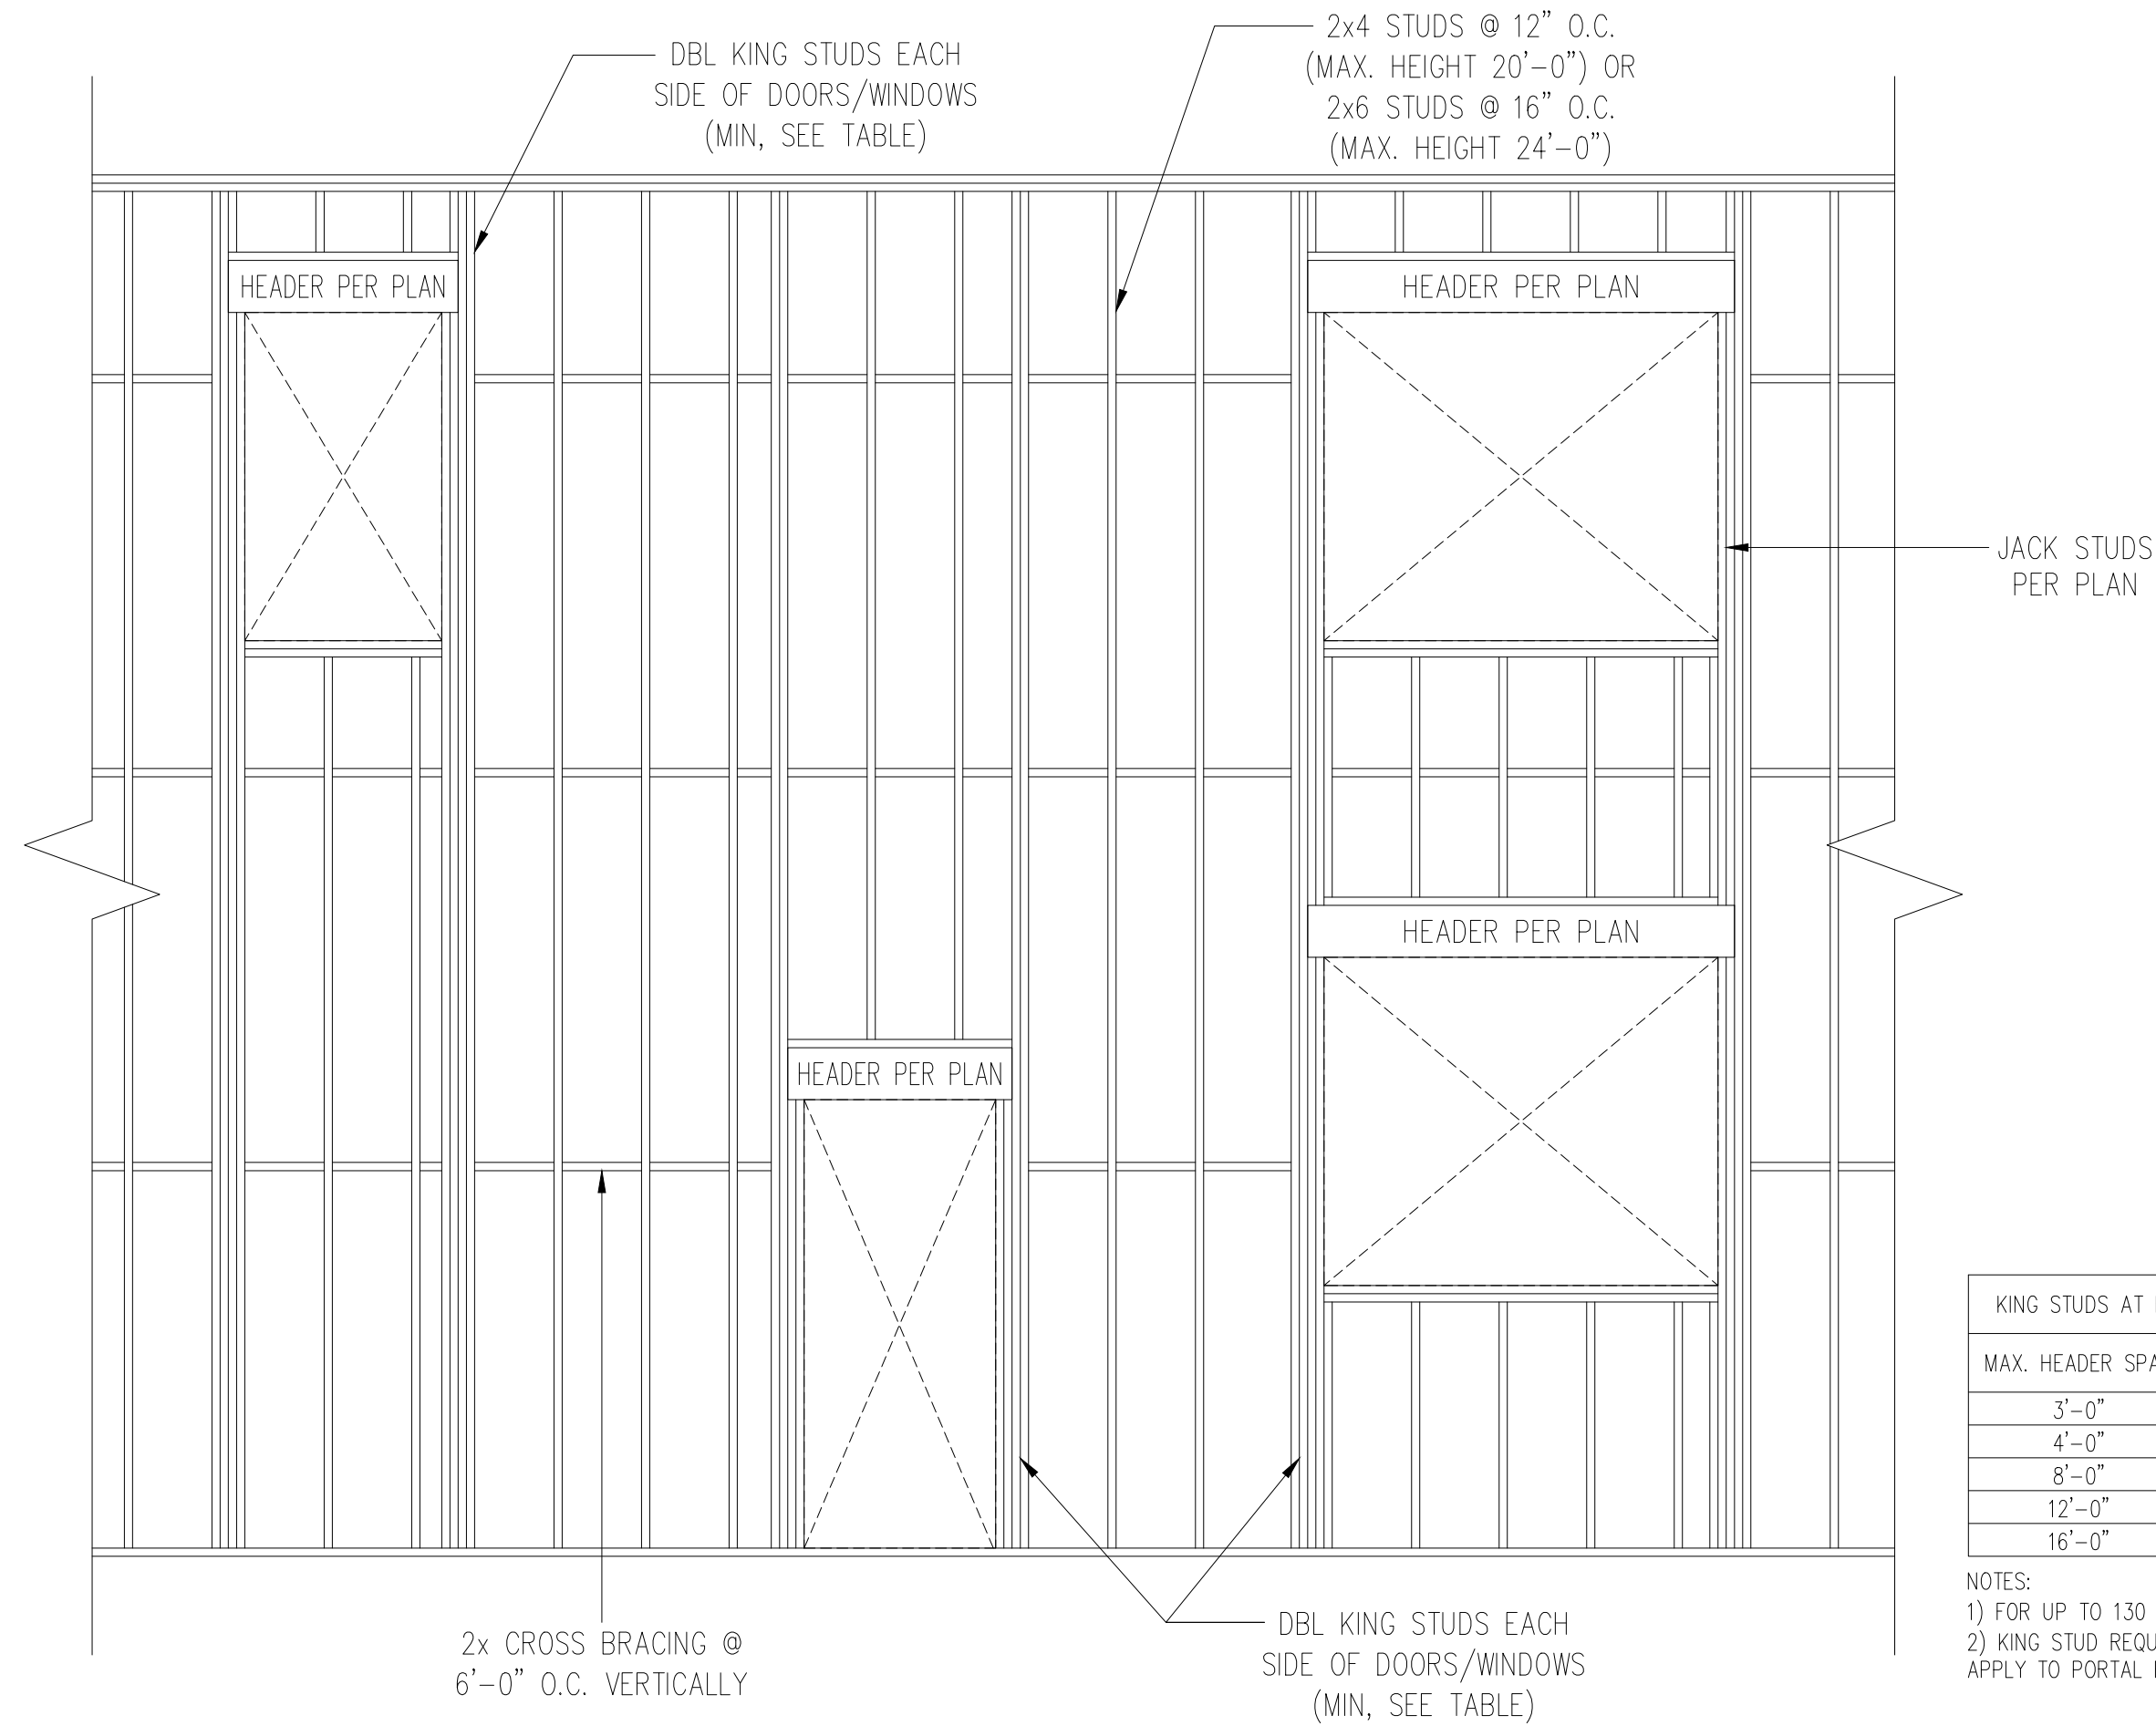


| KING STUDS AT EACH END OF HEADERS |              |
|-----------------------------------|--------------|
| MAX. HEADER SPAN                  | STUDS (MIN.) |
| 3'-0"                             | 1            |
| 4'-0"                             | 2            |
| 8'-0"                             | 3            |
| 12'-0"                            | 5            |
| 16'-0"                            | 6            |

- NOTES:
- FOR UP TO 130 MPH, EXPOSURE B
  - KING STUD REQUIREMENTS DO NOT APPLY TO PORTAL FRAMED OPENINGS

6 TYP. BALLOON FRAMING DETAIL  
D3f N.T.S.

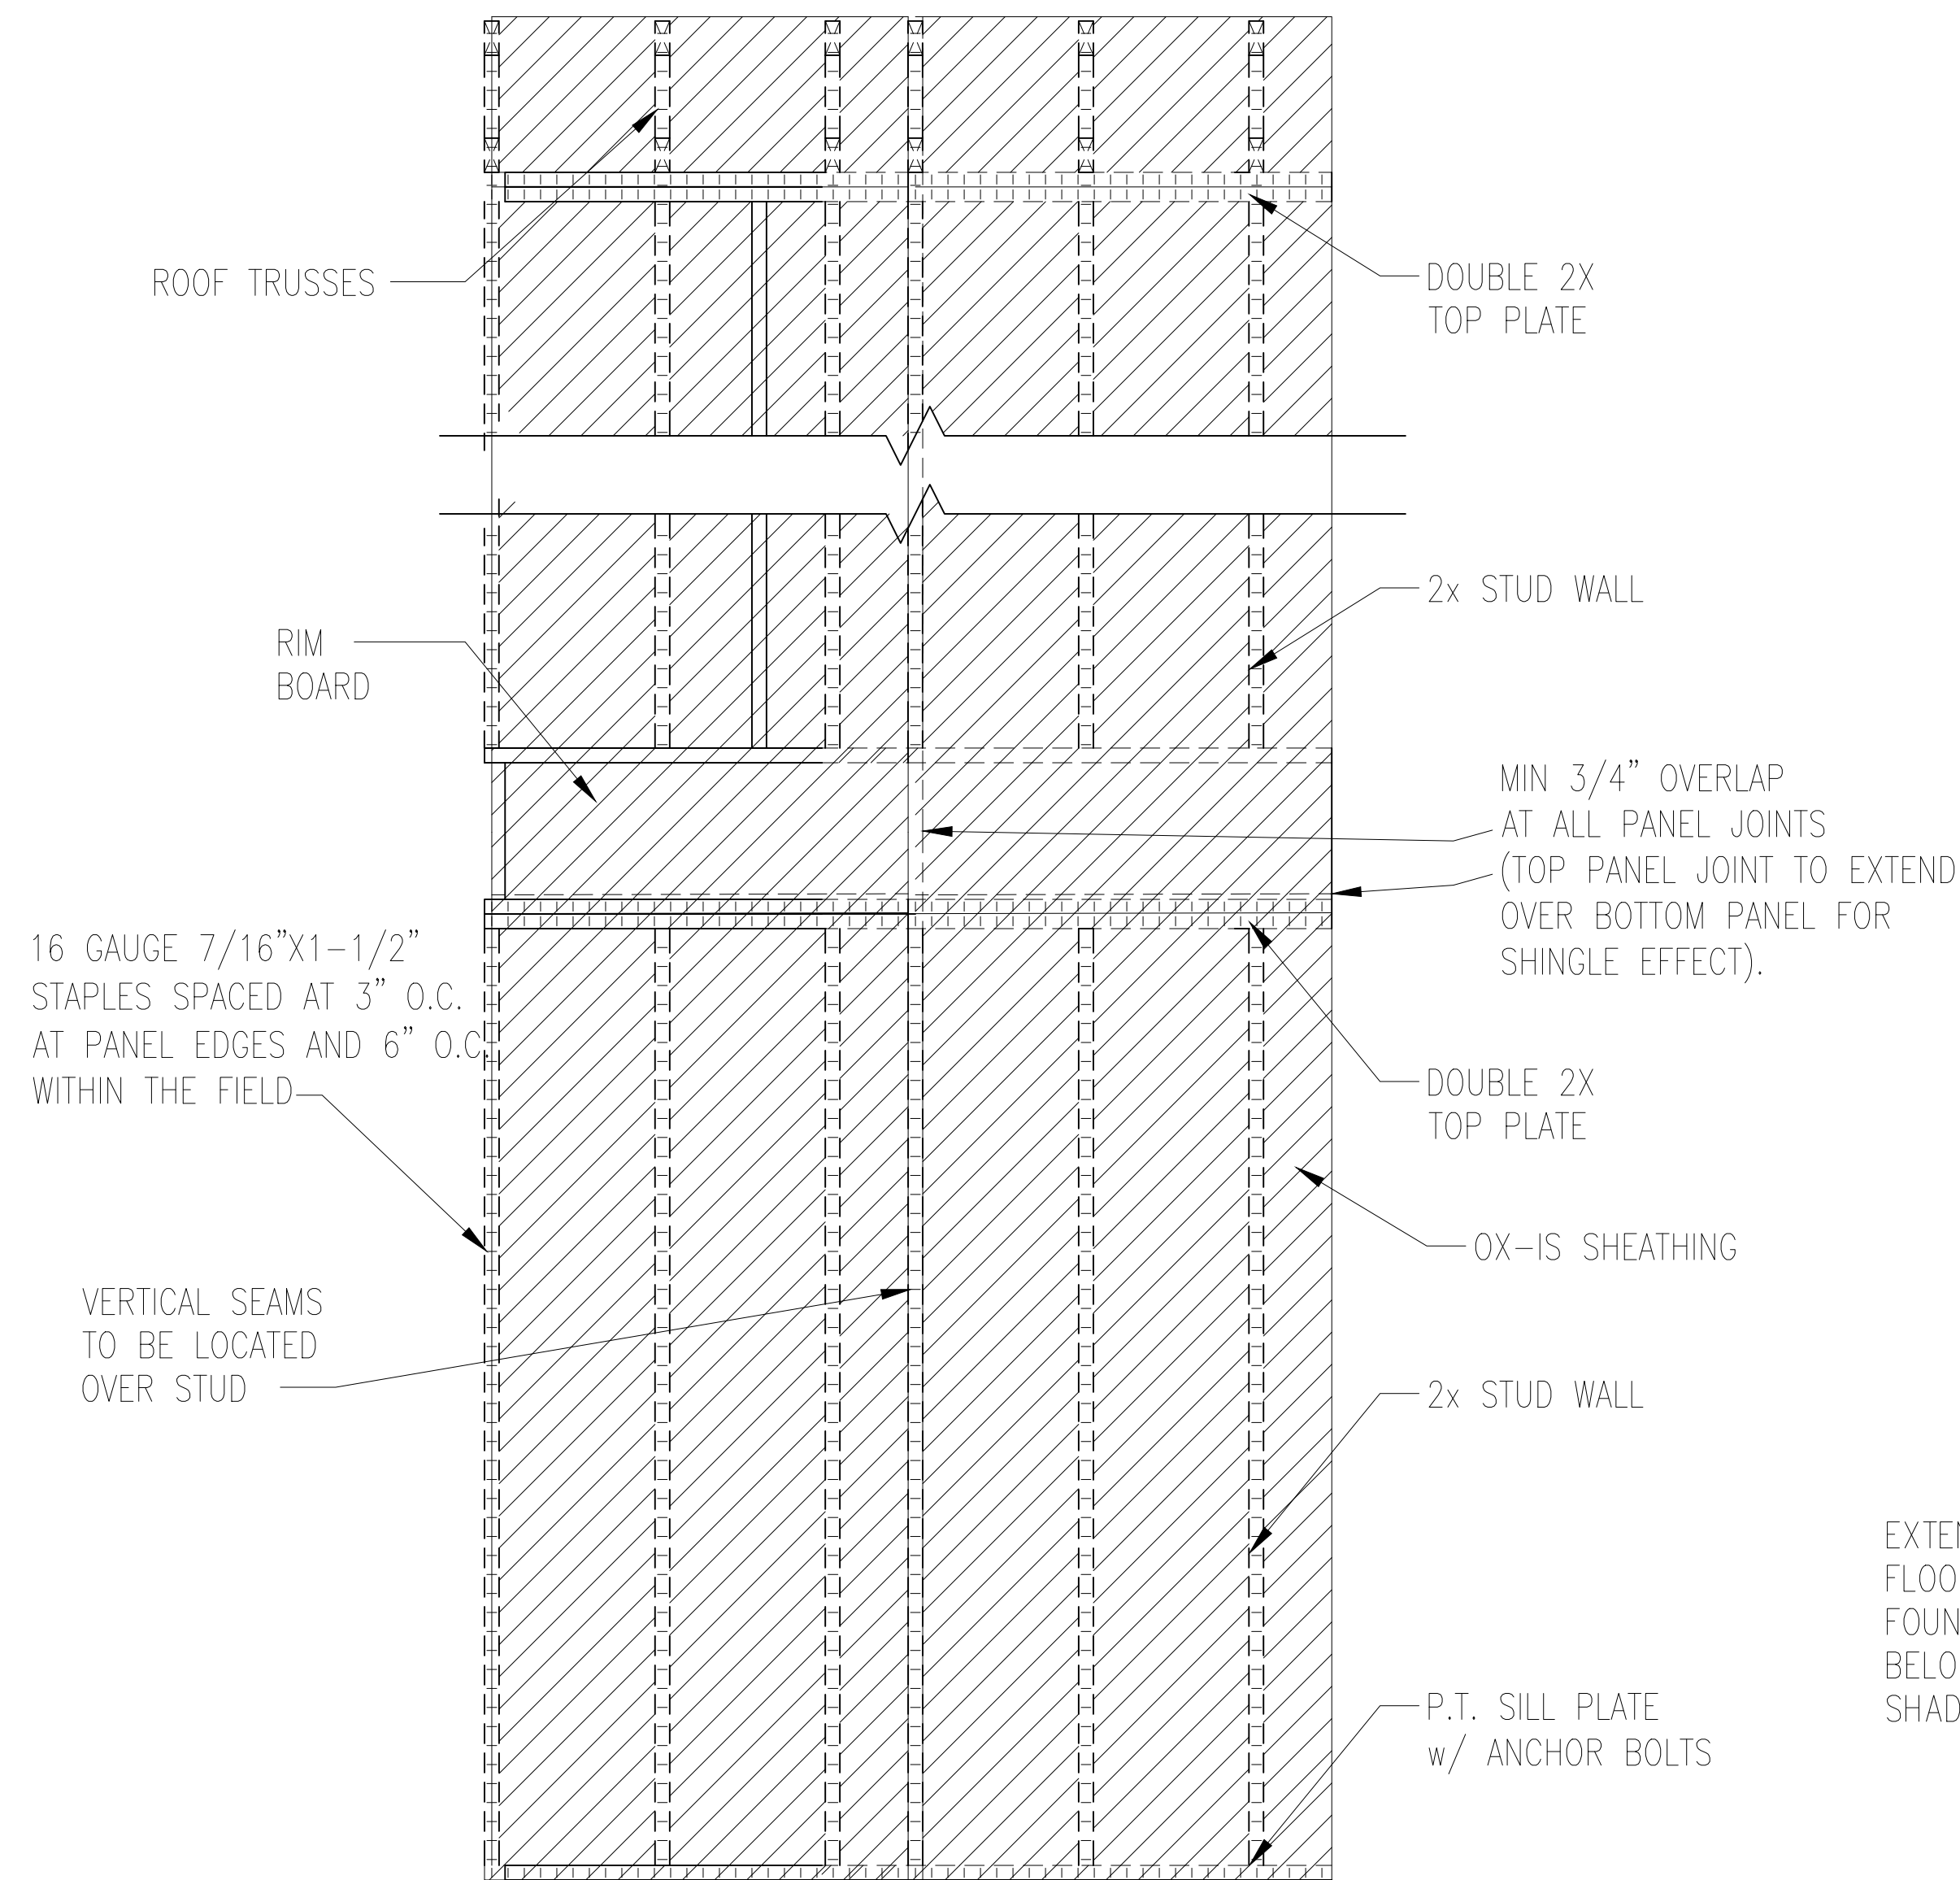

1 TYP. WALL BRACING  
D4f NTS

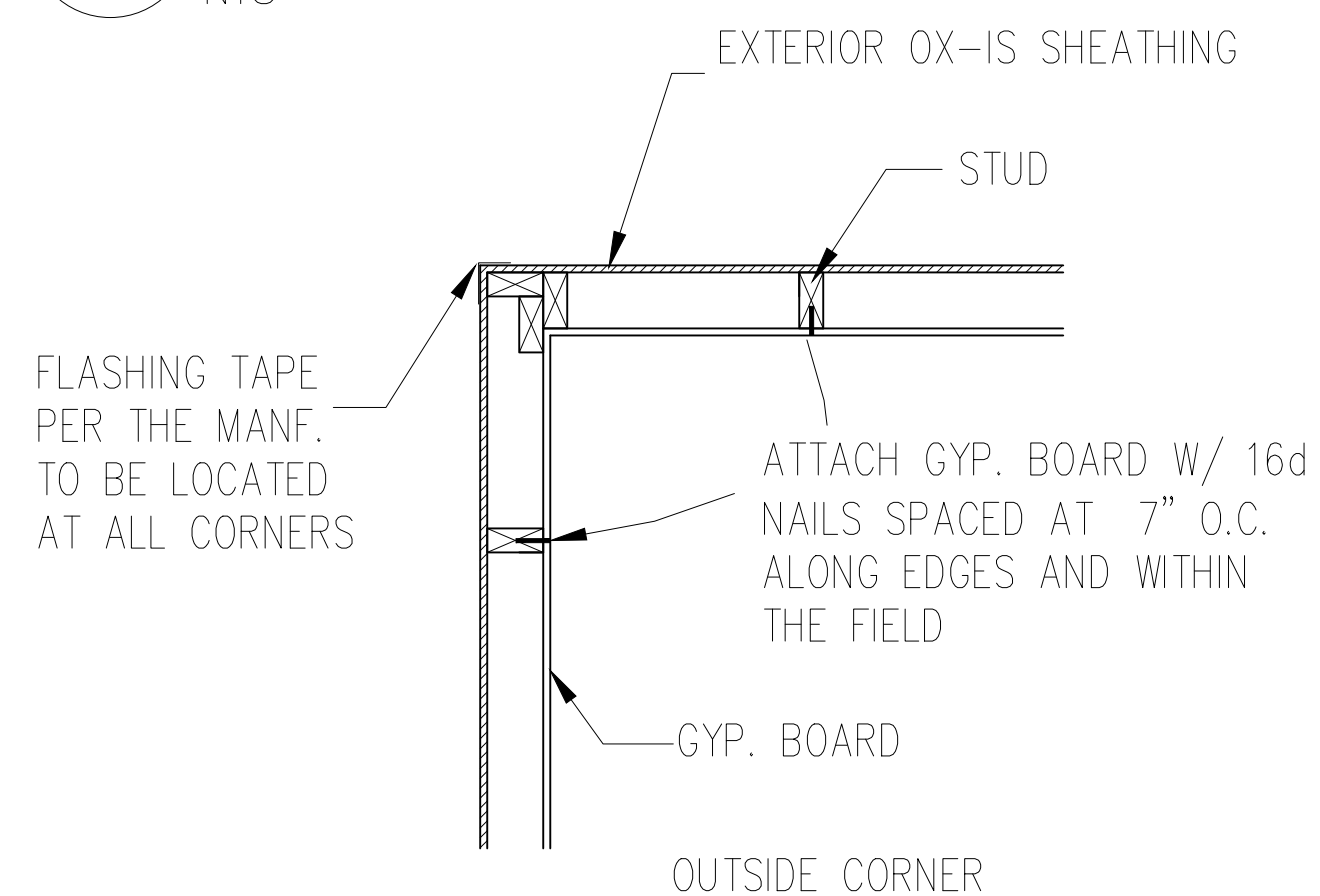

2 TYP. EXTERIOR CORNER ATTACHMENT  
D4f NTS

TWO CONT. 2x\_ TOP PLATE, EXTEND EACH END INTO ADJACENT WALL. NAIL SPLICES WITH 8-16d NAILS PER SPLICE/LAP.

CONT. 2x\_ PLATE WITH 10d NAILS AT 16" O.C. INTO HEADER/BEAM

OX-IS EXT. WALL SHEATHING IN SHADED AREAS ATTACHED TO ALL SUPPORTS (STUDS, PLATES, BLOCKING, ETC) WITH 16 GA. STAPLES AT 3" O.C. EDGE AND 3" O.C. FIELD 1" MIN. EMBEDMENT.

(2)2x4 BLOCKING AT ALL PANEL EDGES (TYP.)


ADD ADDITIONAL STUDS IF WALL WIDTH EXCEEDS 16"

(2)2x\_ STUDS (MIN) AT START/END OF WALL SEGMENTS EACH SIDE OF OPENING.

EXTEND OX-IS SHEATHING TO COVER FLOOR RIM AND ATTACH TO SILL PLATE ON FOUNDATION OR TOP PLATE OF WALL BELOW. SAME ATTACHMENT AS ALL OTHER SHADED AREAS.

2x4 P.T. PLATE WITH (2)1/2" DIA ANCHOR BOLTS EMBEDDED IN CONC. 7" MIN. WITH 3/16"x2"x2" PLATE WASHERS

NOTES:  
-OX-IS MAY BE INSTALLED IN LIEU OF OSB FOR CS-WSP AND CS-PF BRACING METHODS SHOWN ON THE BRACING PLAN. BRACED WALLS SHALL BE INSTALLED PER LENGTHS SHOWN ON THE SEALED PLANS.  
-16 GA. STAPLES MAY BE SUBSTITUTED WITH 0.113-INCH DIAMETER (3/8" HEAD OR 2" CAP) NAILS WITH MINIMUM 1" EMBEDMENT.  
-STAPLES MAY RUN PARALLEL WITH WOOD GRAIN OF FRAMING STUDS AT SHEATHING SEAMS.  
-WHERE 3/4" OVERLAP IS NOT INSTALLED, CONTRACTOR MAY COVER SEAM WITH 5" BUTYL FLASHING TAPE.  
-FLASH WINDOWS AND DOORS PER MANF.  
-THE DETAILS ABOVE ARE LIMITED TO 130 MPH WIND ZONES.

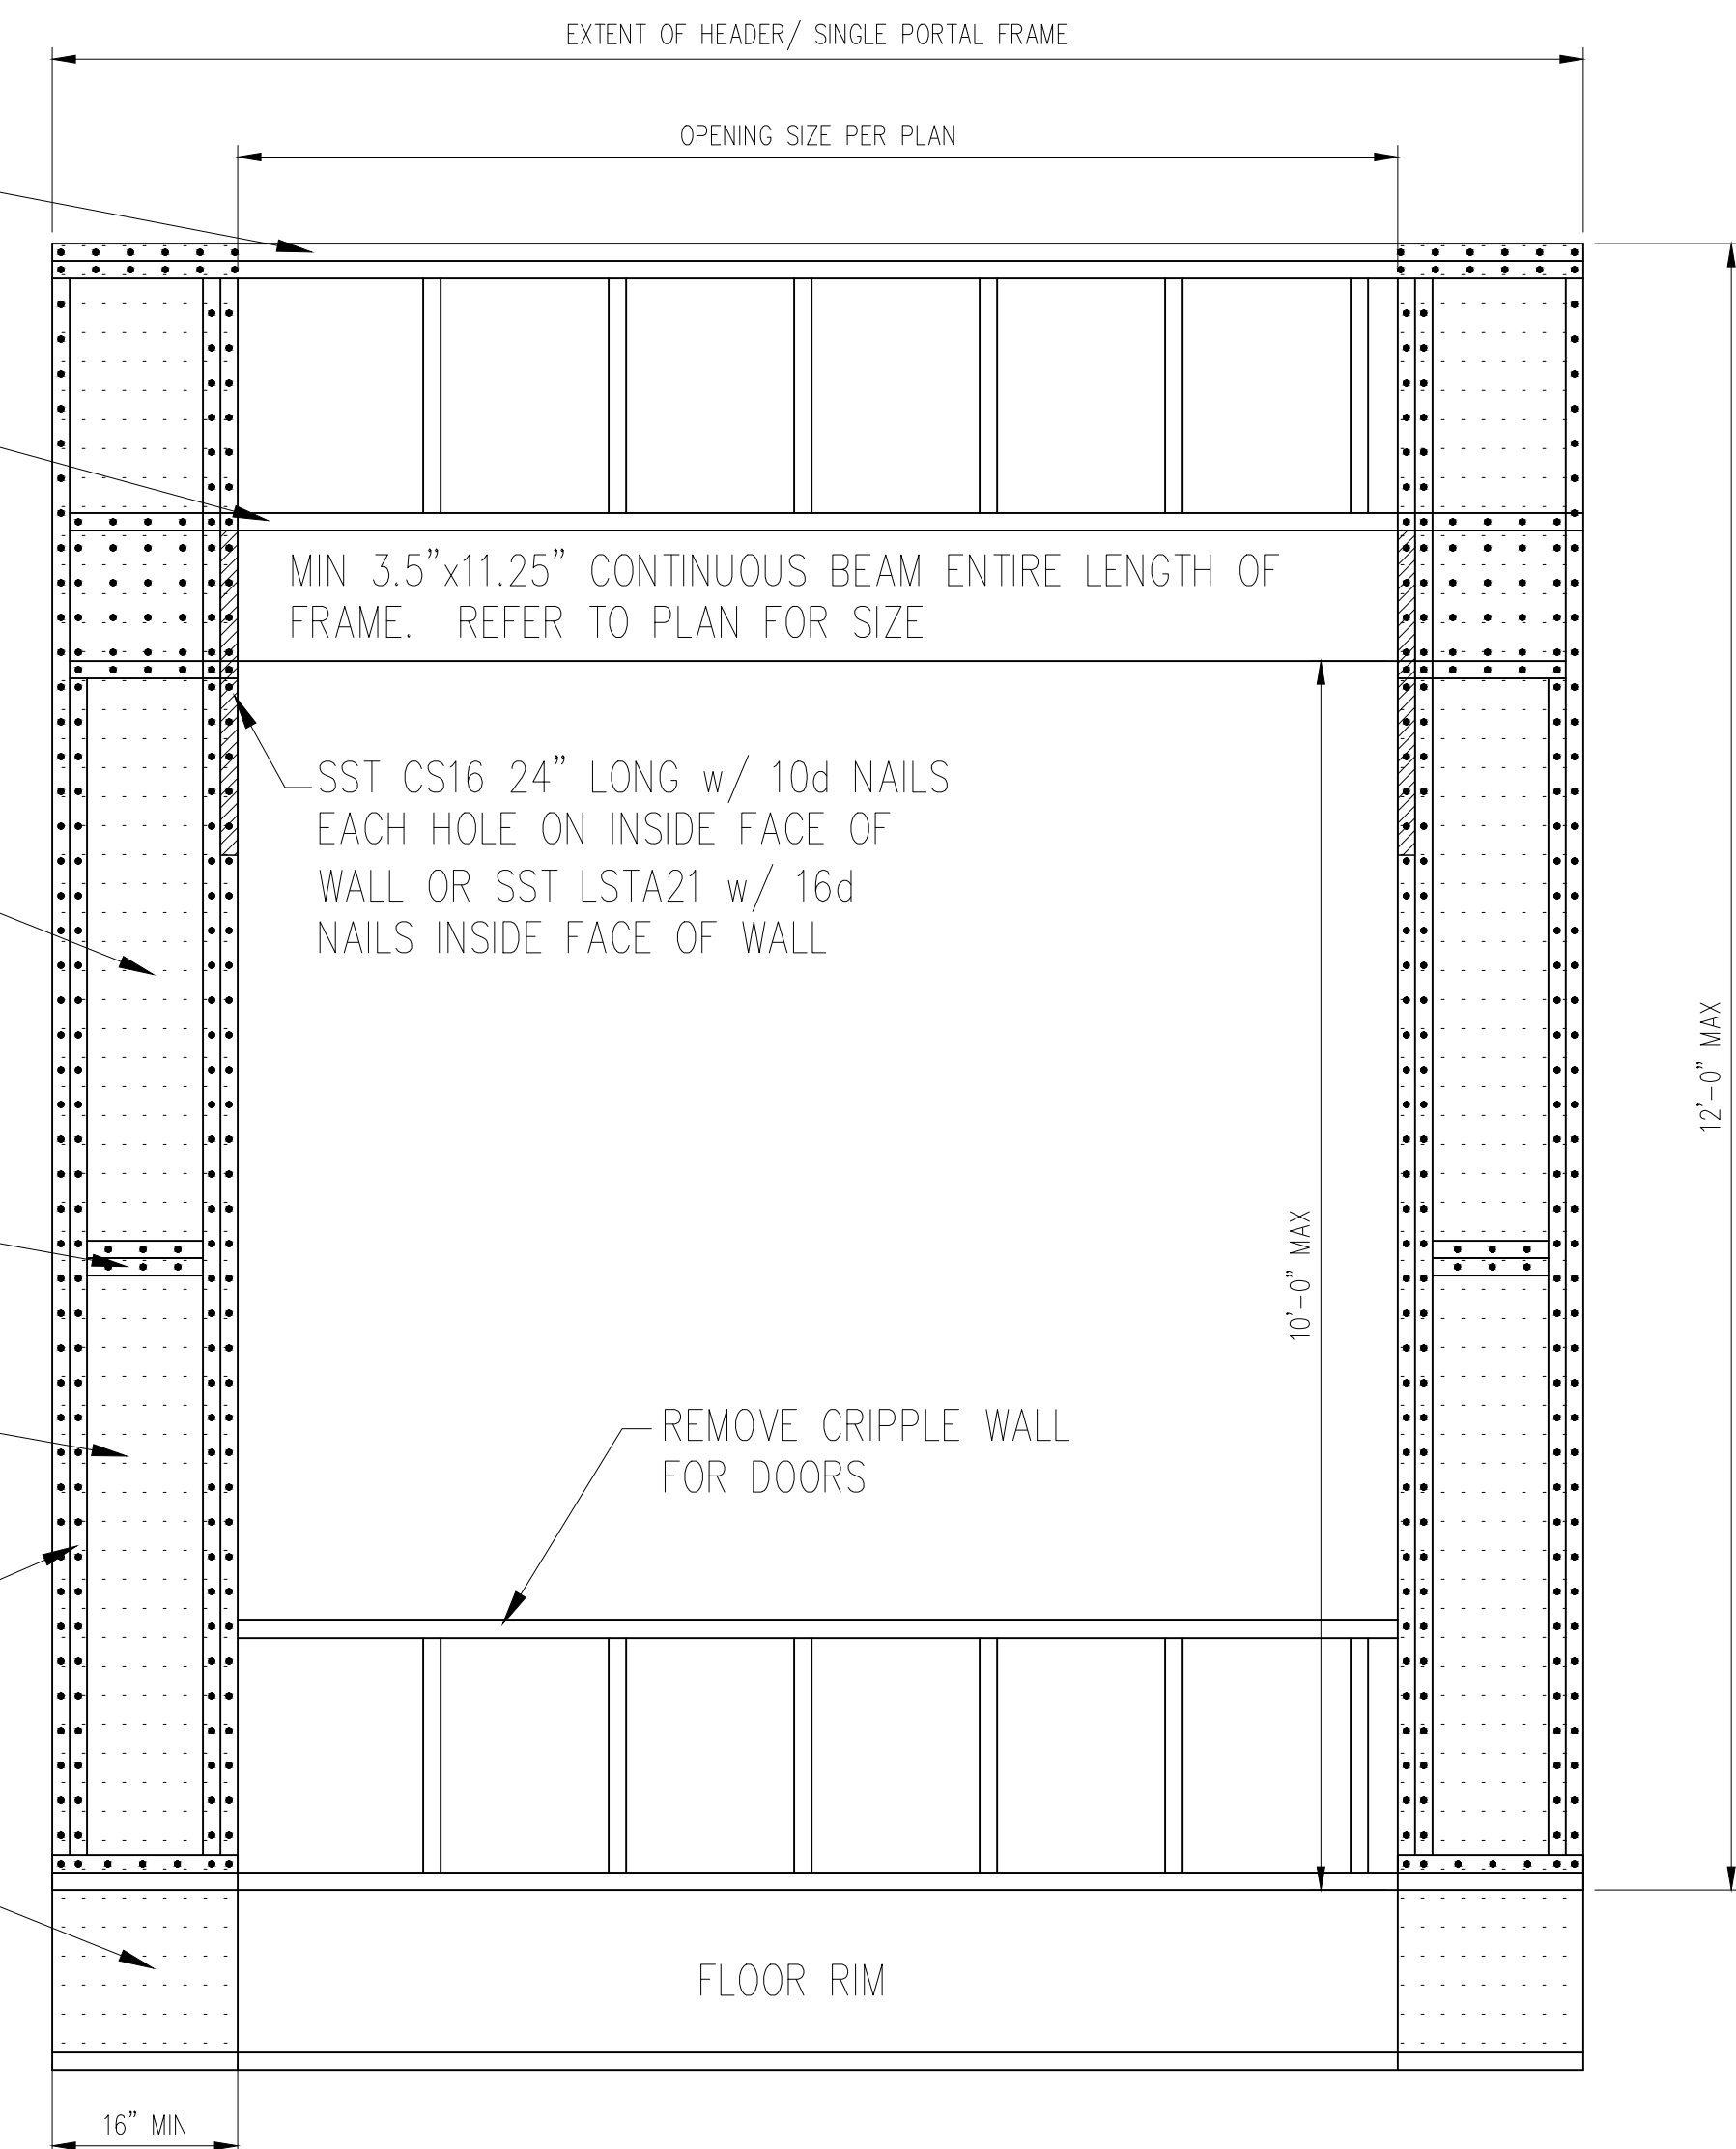

3 METHOD PF: PORTAL FRAME DETAIL  
D4f NTS

General Notes: \*\* CUTTING OR DRILLING OF COMPONENTS SHOULD NOT BE DONE WITHOUT CONTACTING COMPONENT SUPPLIER FIRST. CUSTOMER TAKES FULL RESPONSIBILITY FOR COMPONENTS IF CUT BEFORE AUTHORIZATION.

\*\* LVL AND JOISTS MUST BE FULLY CONNECTED TOGETHER PRIOR TO ADDING ANY LOADS.


| Revisions |      |
|-----------|------|
| 09/20/23  | DW   |
| 00/00/00  | Name |
| 00/00/00  | Name |
| 00/00/00  | Name |
| 00/00/00  | Name |

This is an I-Joist Placement Plan Only. All designs of I-Joist follow the ISC/IPC Code Requirements along with Manufacturer's guidelines. This is NOT an engineered placement plan. This placement plan is created from plans provided by the customer using Manufactures guidelines. It is the responsibility of the EOR, or builder to review and approve all bearing conditions, connections, spans, loading, product usage, and quantities. Do not notch or drill holes in beams or flanges on joists without prior approval from the manufacturing Representative unless following hole guidelines in the installation guide of product. Builder takes full responsibility for doing so and NO Back charge will be accepted.



DR Horton  
26 Cross Creek  
Hayden K  
FLOOR JOIST LAYOUT

|                     |
|---------------------|
| Scale: 1/4" = 1'-0" |
| Date: // 10/01/25   |
| Designer: DW        |
| Project #: 25090186 |
| Sheet Number:       |
| 1 / 1               |

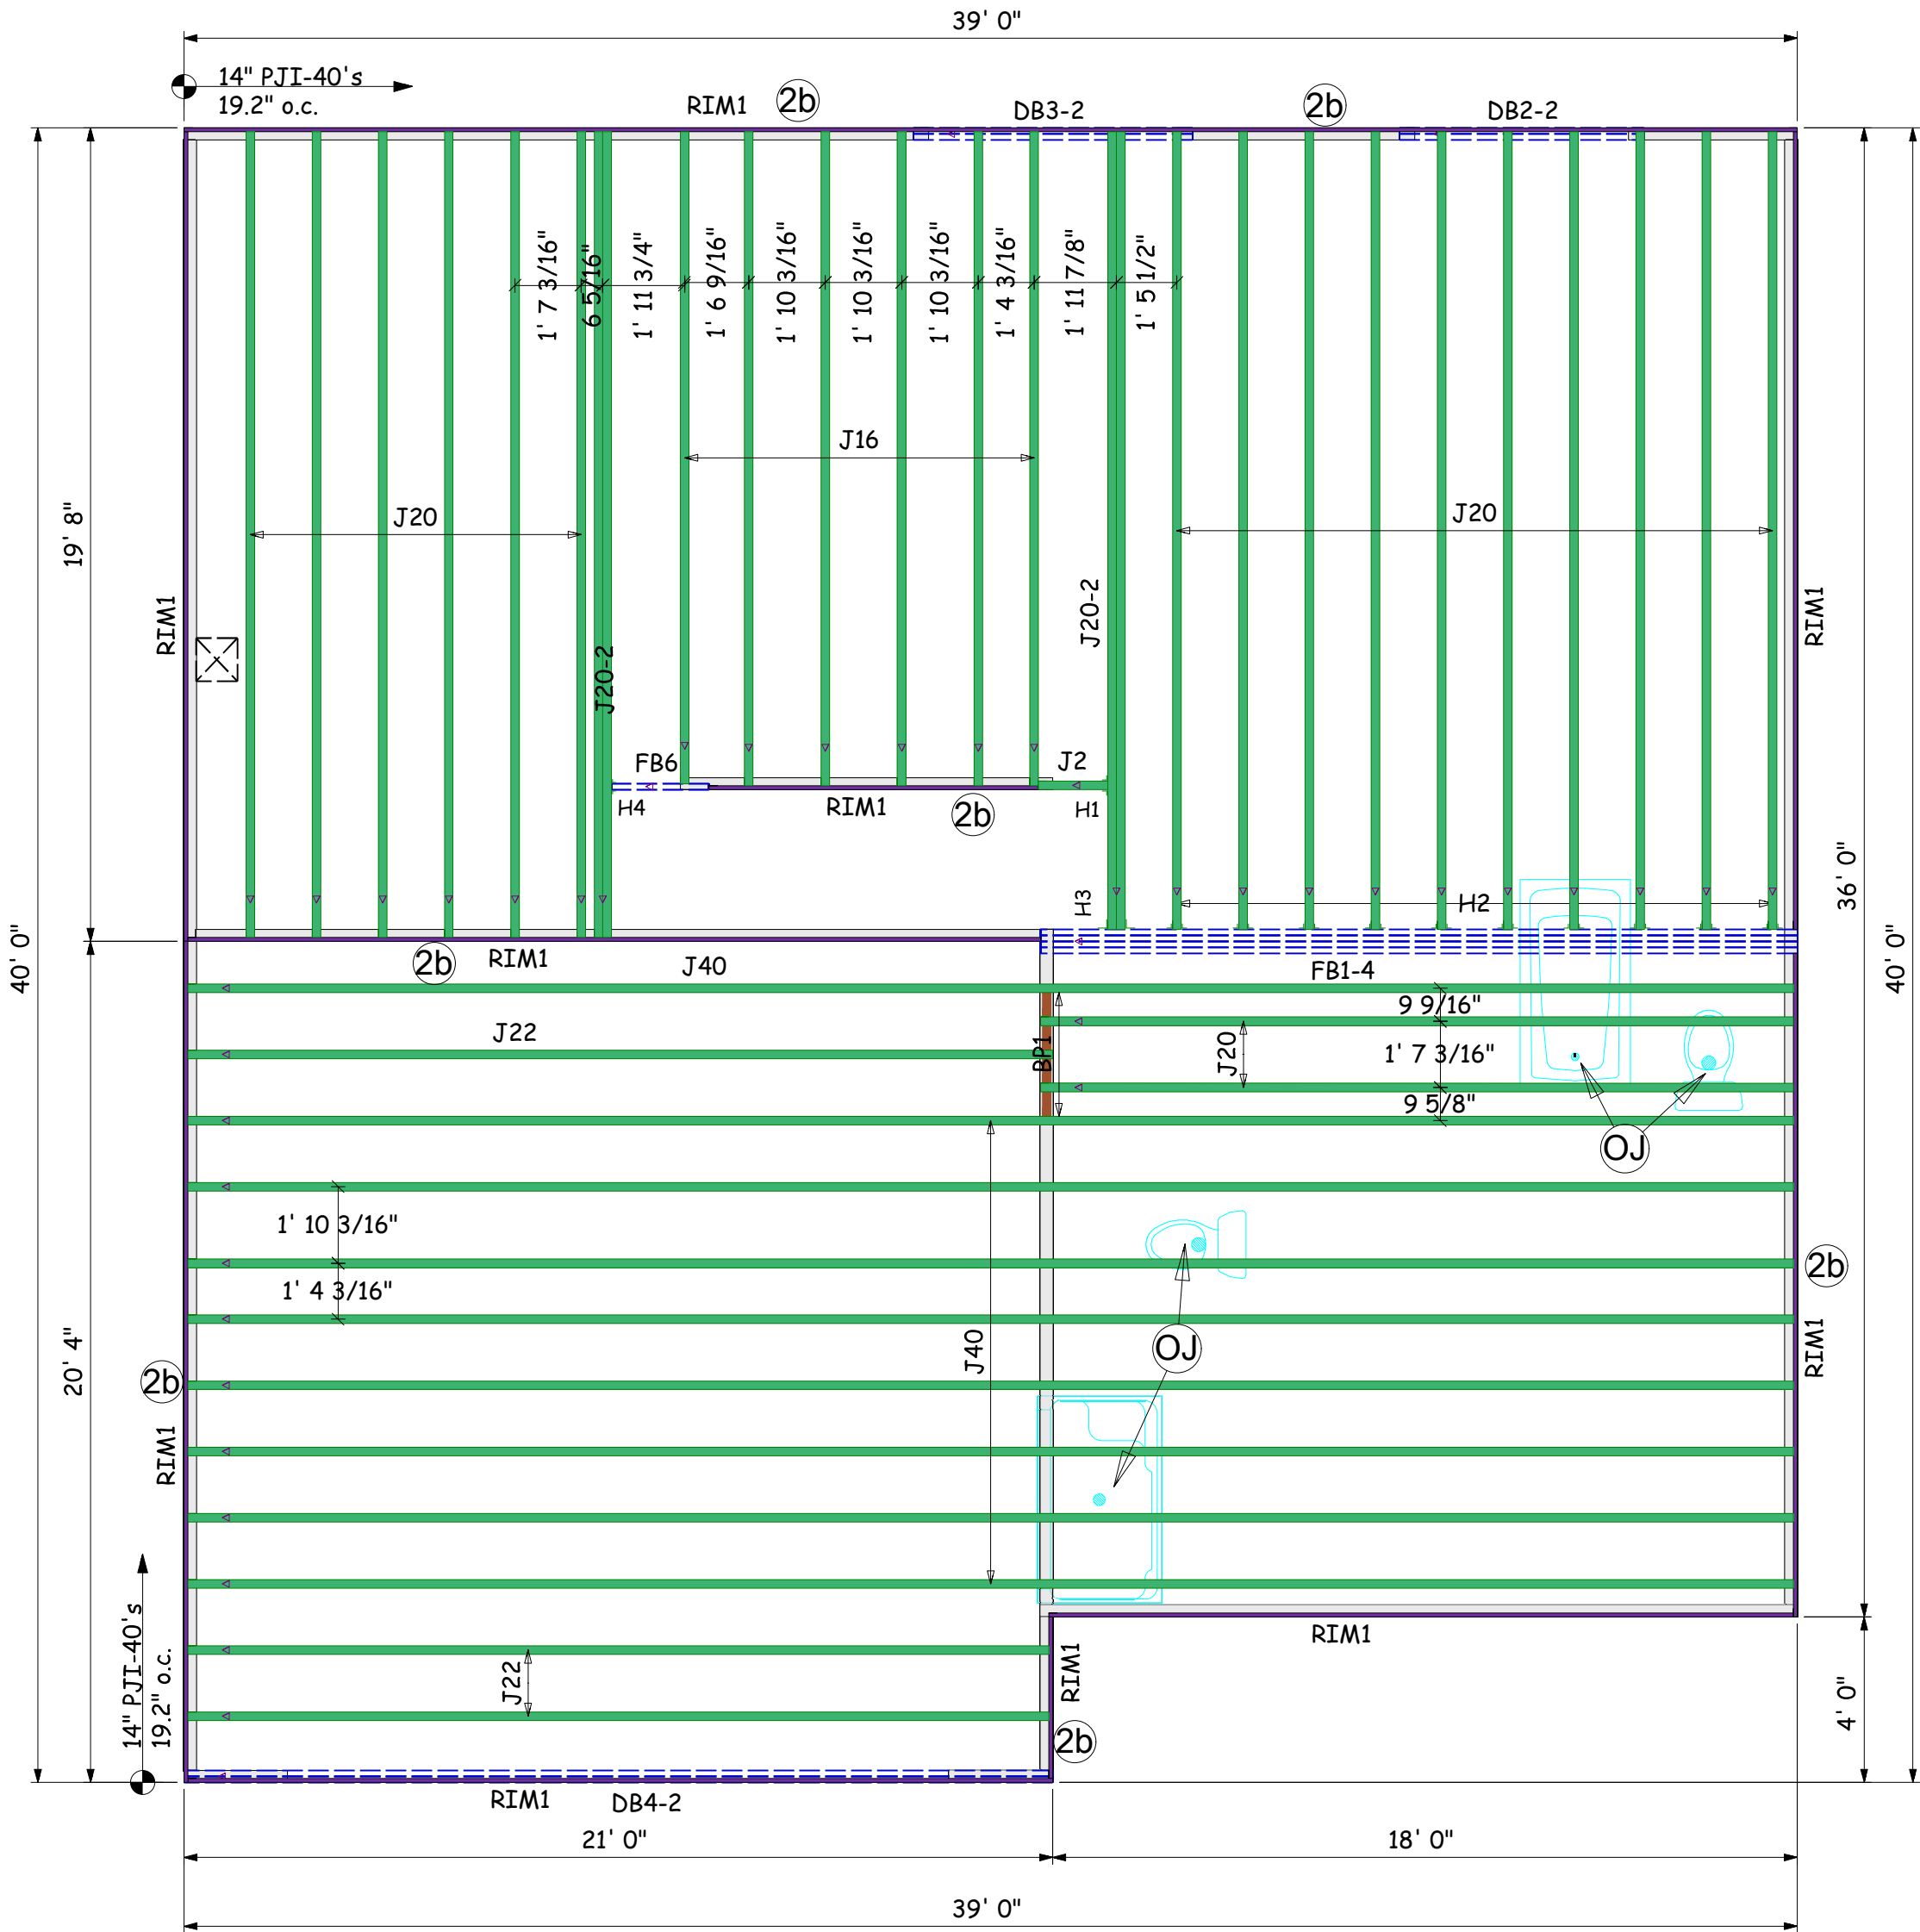








| Products |             |                                   |       |         |
|----------|-------------|-----------------------------------|-------|---------|
| PlotID   | Length      | Product                           | Plies | Net Qty |
| J40      | 40'-00'-00" | 14" PJI-40                        | 1     | 9       |
| J22      | 22'-00'-00" | 14" PJI-40                        | 1     | 3       |
| J20      | 20'-00'-00" | 14" PJI-40                        | 1     | 18      |
| J20-2    | 20'-00'-00" | 14" PJI-40                        | 2     | 4       |
| J16      | 16'-00'-00" | 14" PJI-40                        | 1     | 6       |
| J2       | 2'-00'-00"  | 14" PJI-40                        | 1     | 1       |
| DB3-2    | 8'-00'-00"  | 2.1 RigidLam SP LVL 1-3/4 x 9-1/4 | 2     | 2       |
| DB2-2    | 6'-00'-00"  | 2.1 RigidLam SP LVL 1-3/4 x 9-1/4 | 2     | 2       |
| FB1-4    | 20'-00'-00" | 2.1 RigidLam SP LVL 1-3/4 x 14    | 4     | 4       |
| FB6      | 4'-00'-00"  | 2.1 RigidLam SP LVL 1-3/4 x 14    | 1     | 1       |
| DB4-2    | 22'-00'-00" | 2.1 RigidLam SP LVL 1-3/4 x 16    | 2     | 2       |
| RIM1     | 12'-00'-00" | 1 1/8" x 14" APA Rim Board        | 1     | 16      |
| BP1      | 2'-00'-00"  | 14" PJI-40                        | 1     | 2       |

| Accessories |        |              |       |
|-------------|--------|--------------|-------|
| PlotID      | Length | Product      | Plies |
|             |        | 3/4" 4x8 OSB | 1     |
|             |        |              | 46    |

| Connector Summary |     |         |            |               |           |
|-------------------|-----|---------|------------|---------------|-----------|
| PlotID            | Qty | Manuf   | Product    | Backer Blocks | Web Stiff |
| H1                | 1   | Simpson | IUS2.56/14 | 2 and Filler  | No        |
| H2                | 10  | Simpson | IUS2.56/14 | No            | No        |
| H3                | 1   | Simpson | MIU5.12/14 | No            | No        |
| H4                | 1   | Simpson | HUS1.81/10 | No            | No        |

KEMPSVILLE BUILDING MATERIALS IS NOT RESPONSIBLE FOR THE DESIGN OR CALCULATION OF ANY AND ALL I-JOIST AND LVL/PSL BEAM MATERIAL. ALL ENGINEERING AND INFORMATION FOR THIS MATERIAL IS TO BE PROVIDED BY THE ENGINEER OF RECORD MARKED ON APPROVED SET OF PLANS. ALL BEAM PLACEMENTS ARE PER THE ENGINEERING RECEIVED. ALL CONNECTION DETAILS TO BE PROVIDED BY ENGINEER OF RECORD. REFER TO ENGINEER OR RECORD FOR ALL MULTI-PLY LVL/ I-JOIST CONNECTION PATTERNS. BUILDER TO VERIFY ALL MATERIAL LENGTHS, QUANTITIES, AND SIZES PRIOR TO ORDERING.

## 2ND FLOOR LAYOUT

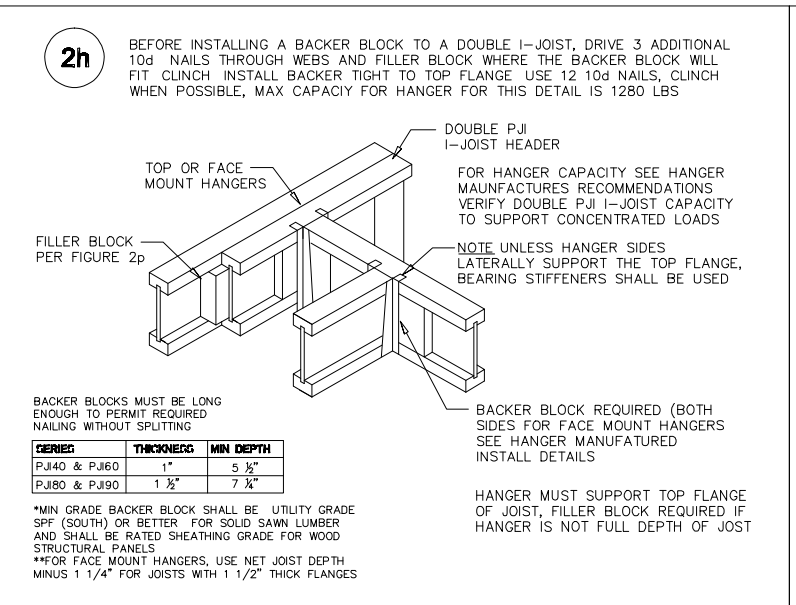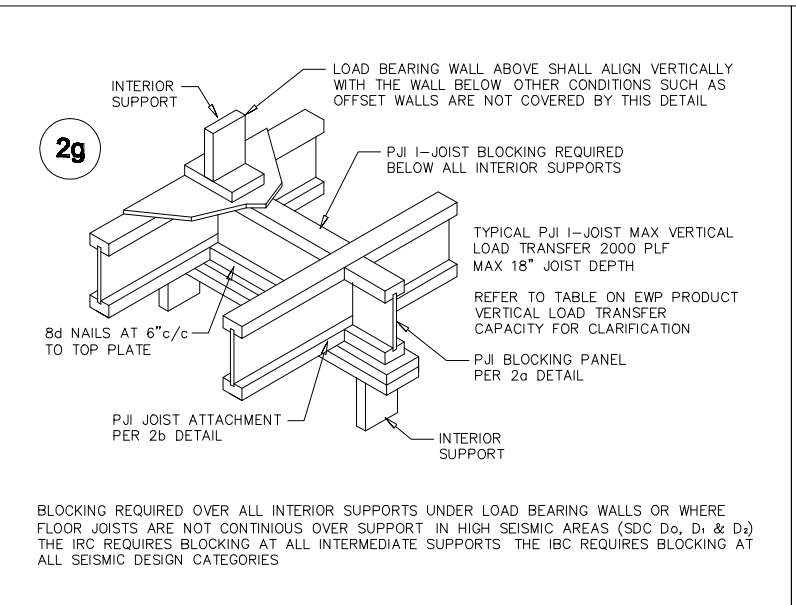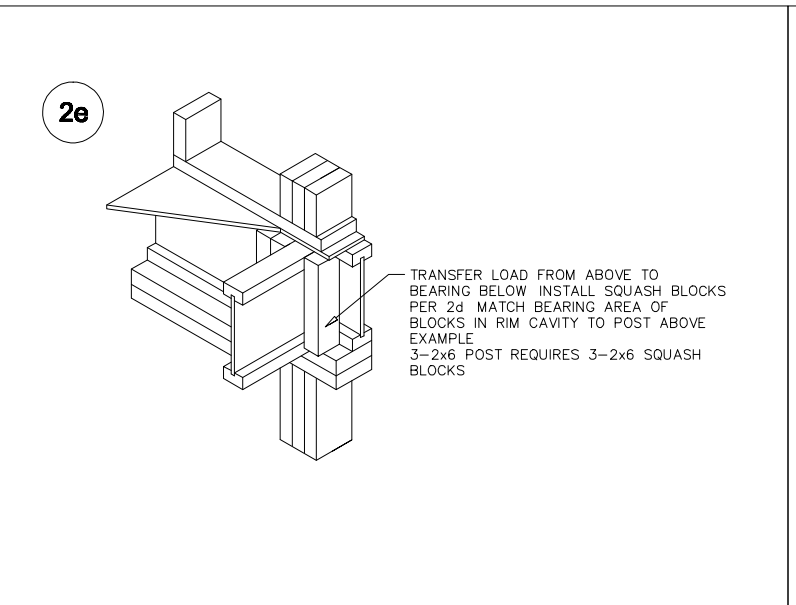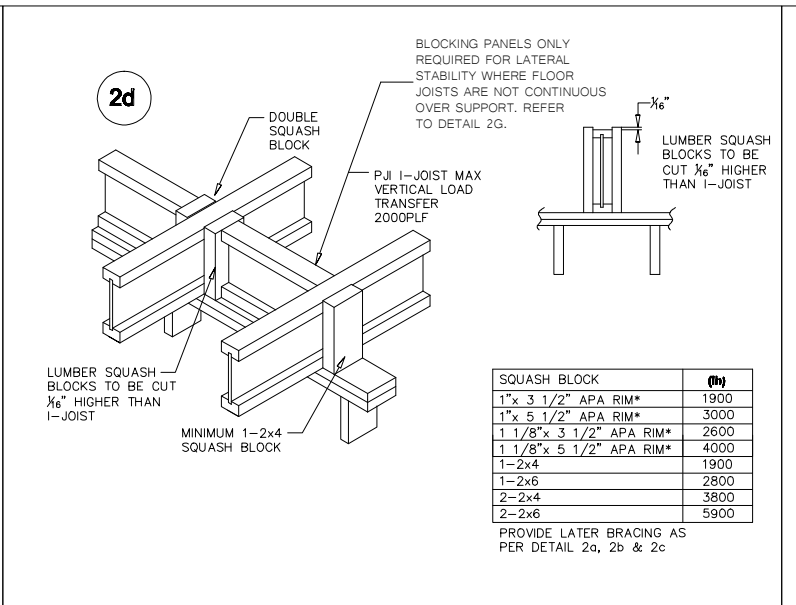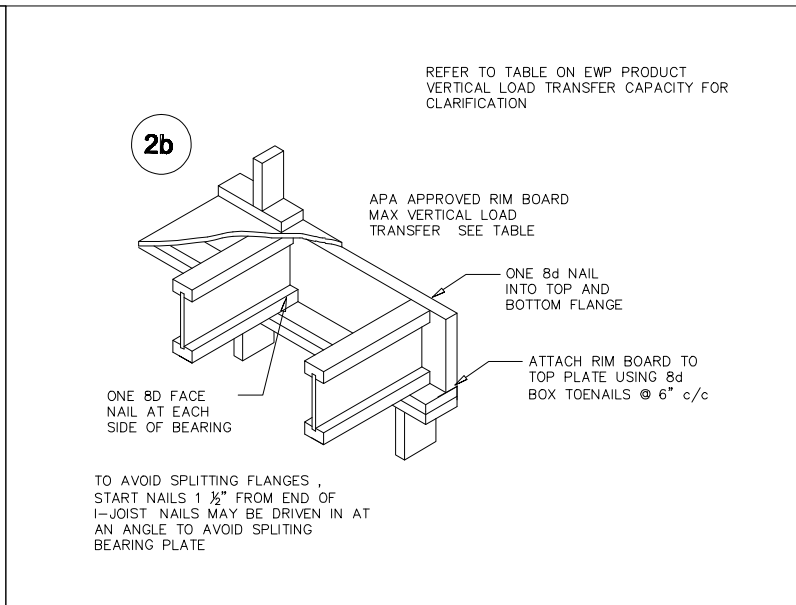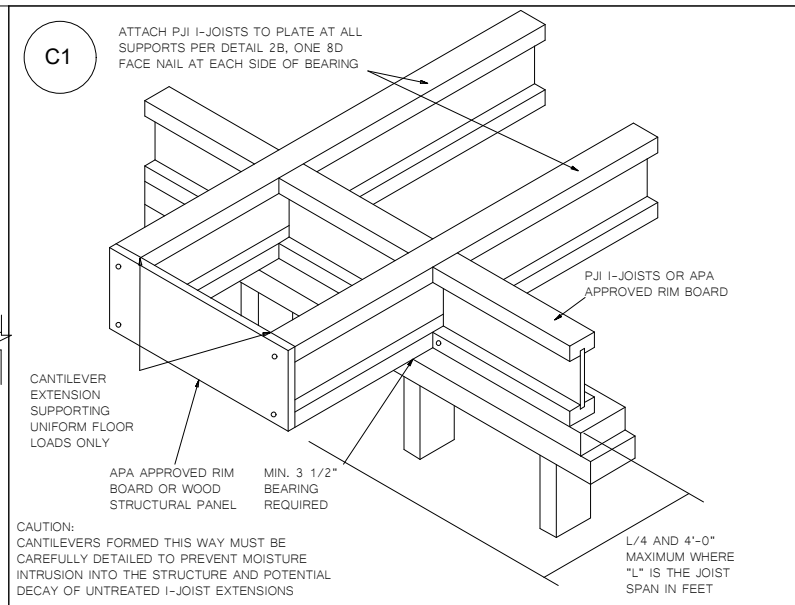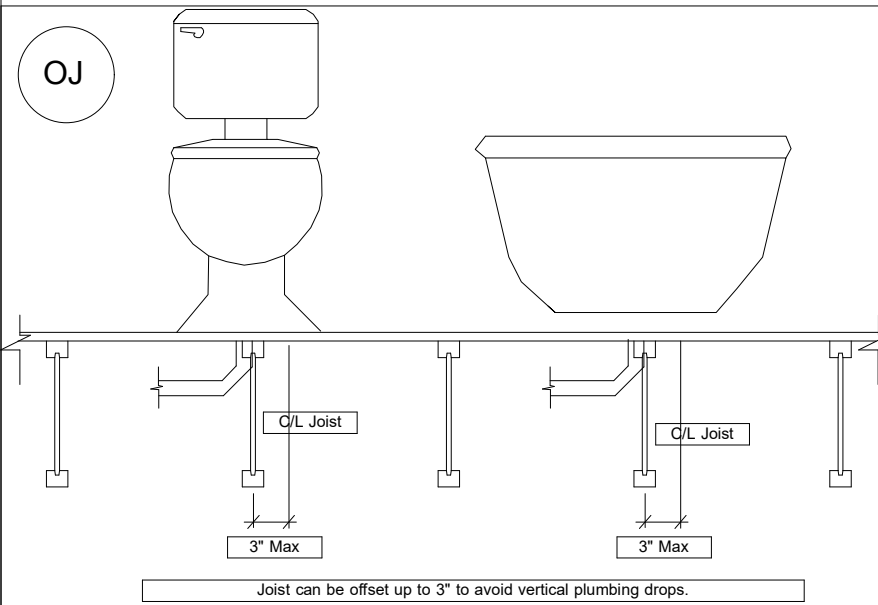

| LABEL LEGEND |                    |
|--------------|--------------------|
| BBO          | = Beam by Others   |
| PBO          | = Post by Others   |
| GBO          | = Girder by Others |
| J            | = I-Joist          |
| FB           | = Flush Beam       |
| DB           | = Dropped Beam     |
| RB           | = Roof Beam        |
| BP           | = Blocking Panels  |
| SB           | = Squash Blocks    |

\*\* PLUMBING DROPS NOTED ARE IN APPROXIMATE LOCATIONS PER PLAN. BUILDER MUST VERIFY LOCATIONS BEFORE SETTING JOISTS.

\*\* ALL POINT LOADS FROM ABOVE MUST BE TRANSFERRED TO BEARING FROM UNDER SIDE OF SHEATHING.

\*\* REFER TO INSTALLATION GUIDE FOR PLY TO PLY CONNECTIONS.

\*\* DAMAGED FLOOR JOISTS SHOULD NOT BE INSTALLED UNLESS APPROVED BY COMPONENT PLANT.

\*\* DIMENSIONS ARE READ AS: FOOT-INCH-SIXTEENTH.

\*\* FRAMER MUST REFER TO PLANS WHILE SETTING COMPONENTS.