
James Bates
10/10/2025

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for - and should not be placed by NVR on - these plans and specifications. These plans and specifications are prepared solely by, and for the exclusive use of, NVR, Inc. and are solely for a family residence consisting of eight or fewer attached units with grade level exits and which is not part of or physically connected with any other buildings or residential units. NVR, Inc. does not provide any third party the opportunity to customize these plans. The respective drawings contained herein shall be used only as construction assembly drawings by NVR, Inc. and its subcontractors. Any unauthorized use of these plans without the written consent of NVR, Inc. is prohibited.

KIPLING VILLAGE - LOT 23 - 333 SOUTH BREEZE WAY
0652-46-1805.000
RYAN HOMES

GRAND BAHAMA

DIV-COMM-LOT-UNIT

RLH-VK-0023

COMM-LOT

KIPLING VILLAGE - 0023

STREET ADDRESS

333 SOUTH BREEZE WAY

APT. NO.

CITY

FUGUAY VARINA

STATE

NC

ZIP

27526

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.



NVR, Inc.
5285 Westview Drive,
Suite 100
Frederick, MD 21703

[Signature]
James Sales
10/10/2025

Page	Sheet	Description	Page	Sheet	Description	Page	Sheet	Description
1	CS-1	COVERSHEET						
1.1	SS-1	SPEC. SHEET						
2	CA-1	ROOF VENT AND VOLUME CALCULATIONS						
5	NC-1	ELEVATIONS						
7	NC-3	FOUNDATION						
9	NC-4	FOUNDATION HOLD DOWN						
10	NC-5	PLUMBING						
12	NC-7	FIRST FLOOR PLAN						
13	NC-8	BUILDING SECTION						
14	NC-9	BUILDING SECTION - GARAGE						
21	S-2	ROOF FRAMING						
22	S-3	TRUSS BRACING DETAILS						
23	S-4	WALL BRACING DETAILS						
	AD-1	HOUSE SPECIFIC DETAILS						
	DR-1	DOOR DETAILS						
	DR-1B	DOOR DETAILS						
	DR-3	DOOR DETAILS						
	ET-1	EXTERIOR TRIM DETAILS						
	ET-1B	EXTERIOR TRIM DETAILS						
	ET-1C	EXTERIOR TRIM DETAILS						
	ET-1D	EXTERIOR TRIM DETAILS						
	ET-1H	EXTERIOR TRIM DETAILS						
	ET-3	EXTERIOR TRIM DETAILS						
	ET-3B	EXTERIOR TRIM DETAILS						
	ET-3C	EXTERIOR TRIM DETAILS						
	F-1	FLASHING DETAILS						
	F-1B	FLASHING DETAILS						
	F-1D	FLASHING DETAILS						
	F-3	FLASHING DETAILS STONE						
	F-3B	FLASHING DETAILS STONE						
	FA-1B	FIRE ASSEMBLY DETAILS						
	FC-1	FRAMING/FASTENER DETAILS						
	FC-1B	FRAMING/FASTENER DETAILS						
	FC-2	FRAMING/FASTENER DETAILS						
	FC-4	FRAMING/FASTENER DETAILS						
	FC-5	FRAMING/FASTENER DETAILS						
	FD-1	FOUNDATION DETAILS						
	FD-1B	FOUNDATION DETAILS						
	FD-4	FOUNDATION DETAILS						
	IT-1	INTERIOR TRIM DETAILS						
	IT-1B	INTERIOR TRIM DETAILS						
	IT-1C	INTERIOR TRIM DETAILS						
	KT-1	KITCHEN TRIM DETAILS						
	KT-1B	KITCHEN TRIM DETAILS						
	RF-1	ROOF FRAMING DETAILS						
	RF-1B	ROOF FRAMING DETAILS						
	RF-1C	ROOF FRAMING DETAILS						
	SEP-1	STANDARD ENERGY PACKAGE DETAILS						
	SEP-2	STANDARD ENERGY PACKAGE DETAILS						
	SEP-3	STANDARD ENERGY PACKAGE DETAILS						
	SEP-4	STANDARD ENERGY PACKAGE DETAILS						
	WB-1	WALL BRACING DETAILS						
	WB-2	WALL BRACING DETAILS						
	WD-1	WINDOW DETAILS						
	WD-3	WINDOW DETAILS						
	WS-1B	WALL SECTION DETAILS						

KIPLING VILLAGE - LOT 23 - 333 SOUTH BREEZE WAY
0652-46-1805.000
RYAN HOMES

STRUCTURAL DESIGN CRITERIA	
• ALL LOCAL AND STATE CODES • ROOF LIVE LOAD 20 psf • ULTIMATE WIND SPEED 130 mph • WIND EXPOSURE CATEGORY B • SEISMIC DESIGN CATEGORY A / B	

FIRST FLOOR SQUARE FOOTAGE

DESCRIPTION	TOTAL SQ. FT.
1ST FLOOR (BASE SF)	1330 SF
	1330 SF

GARAGE SQUARE FOOTAGE

DESCRIPTION	TOTAL SQ. FT.
TWO CAR GARAGE - FRONT ENTRY	431 SF
	431 SF

UNFINISHED SQUARE FOOTAGE

DESCRIPTION	TOTAL SQ. FT.
REAR COVERED PORCH (ADD. SF)	140 SF
FRONT COVERED PORCH	25 SF
	165 SF

TOTAL FINISHED SQUARE FOOTAGE

DESCRIPTION	TOTAL SQ. FT.
1ST FLOOR (BASE SF)	1330 SF
	1330 SF

SET NO. - VERSION

GBH00 - 01

SHEET NO.

CS-1

PAGE NO.

RELEASE NO. ----

VA As-Sold 2 - Jobs\Market Services\Assigned\RLH-VK-0023\ELK_R_VK_0023\1 CS-1 COVERSHEET.dwg 10/10/25 - 2:08 pm

GENERAL

- These plans and specifications are designed for the exclusive use by NVR, Inc. for the purpose of residential construction. As such, these products are offered for sale in NVR, Inc. communities only. NVR, Inc. is a production homebuilder and does not provide the opportunity to customize these plans. The respective drawings contained here in shall only be used as construction assembly drawings by NVR, Inc. and their sub-contractors. Any unauthorized use of these plans without the written consent of NVR, Inc. is prohibited. All standard notes, section markers, elevation markers and title markers that reference "A-#" shall be considered "NC-#" for sheet reference.
- These plans are subjected to modification as necessary to meet code requirements or to facilitate mechanical/plumbing installations or to incorporate design improvements.
- These plans are not to be scaled for construction purposes. Dimension lines and notes supersede all scale references.
- Single Family Attached/Detached - Automatic residential fire sprinkler systems shall be installed in accordance with NCRBC F2404 or NFPA 13D where required.
- This note sheet only covers major code requirements. The plans are intended to conform to all current applicable codes or engineering design in accordance with Section 301.13.

CODE ANALYSIS

- This note sheet only covers major code requirements. The plans are intended to conform to all current applicable codes including, but not limited to:
NCRG 2018, NCMC 2018, NCPG 2018, NCFGC 2018, NEC 2020 w/ NC Amendments, NCEC 2018, NCCFC 2018
- Constr. Type: V-B
- Max Stories: 3

ENERGY AND MECHANICAL

- Insulation requirements per 2018 NCRG Chapter 11, Energy Efficiency, or Chapter 4 of the 2018 North Carolina Energy Conservation Code (NCECC), or Chapter 4 of the 2015 International Energy Conservation Code (IECC), Residential Energy Efficiency by the prescriptive method. Use NVR "Standard Energy Package" for field procedures and details.

R-values shown below are the minimum used.

CLIMATE ZONE	FENESTRATION U-FACTOR	GLAZED FENESTRATION SHGC	CEILING R-VALUE	FRAME WALL R-VALUE 2x4 / 2x6	FLOOR R-VALUE	BASEMENT WALL R-VALUE UNFIN. / FIN.	SLAB R-VALUE # DEPTH	GRAVEL SPACE WALL R-VALUE
3	0.35	0.30	38	15 / 19	19	5 / 15	NA	5 / 15
4	0.35	0.30	38	15 / 19	19	10 / 15	10	10 / 15

- All HVAC equipment is sized based on ACCA Manual J calculations. Ductwork is sized using ACCA Manual D. Minimum efficiencies of equipment are as listed below. Upgrades for improved energy performance may be installed.
 - Air conditioner - 14 SEER
 - Gas furnace - 92% / 96%
 - Heat Pump - 8.2 HSPF
- Winter interior design temperatures shall be 70°F and summer interior design temperatures shall be 75°F. Exterior design temperatures vary based on geographic location and are listed on the Manual J calculations.
- Roof ventilation calculations are based on the following specifications:
 - Ridge vent: Minimum 18 sq. in. of vent per linear foot
 - Soffit vent: Minimum 4.9 sq. in. of vent per linear foot
 - Roof Jack (box vent): Minimum 45 sq. in. of vent per unit
- See NVR "Standard Energy Package" for field procedures and details.

DESIGN LOADS

Table of Loads for House Structure. Per Table 301.5

Floor Living Areas	- 40# P.S.F. (Live) - 10# P.S.F. (Dead) unless noted otherwise by calculations						
Floor Sleeping Areas	- 30# P.S.F. (Live) unless noted otherwise by calculations - 10# P.S.F. (Dead) unless noted otherwise by calculations						
Garage Floors	- 50# P.S.F. (Live) - 50# P.S.F. (Dead)						
Roof Areas	- Top Chord - 20# P.S.F. (Live) - 10# P.S.F. (Dead) - Bottom Chord - 10# P.S.F. (Live) (Attics without storage) - 20# P.S.F. (Live) (Attics with limited storage) - 10# P.S.F. (Dead) - 30# P.S.F. (Live)						
Habitable Attics	- 30# P.S.F. (Live)						
Trusses	- Areas up to 130 mph ultimate wind speed per Table R301.2(4) - Exposure category 'B'						
Walls	- Areas up to 130 mph ultimate wind speed per Table R301.2(4)						
	<table><tr><td>Vult</td><td>115 mph</td><td>130 mph</td></tr><tr><td>Vasd</td><td>84 mph</td><td>101 mph</td></tr></table> Note: Linear interpolation between contour lines permitted.	Vult	115 mph	130 mph	Vasd	84 mph	101 mph
Vult	115 mph	130 mph					
Vasd	84 mph	101 mph					
Stairs	- 40# P.S.F. (Live) - 10# P.S.F. (Dead)						
Allowable deflection of structural members per IRC Table R301.7							

Design Criteria

- Design Codes:
- National Design specification for Wood Construction by National Forest Products Association.
 - Specification for the Design Fabrication and Erection of Structural Steel for Buildings by American Institute of Steel Construction.

Materials:

Headers* Southern Pine (KD-19), No. 1 Grade

Slids Spruce-Pine-Fir, Stud Grade

Jacks Spruce-Pine-Fir, Stud Grade

Beams** Southern Pine (KD-19), No. 1 Grade

Joists 2x10 Hem-Fir (KD-19), No. 2 Grade or better (NCLIB & NWPFA)

2x8 Southern Pine (KD-19), No. 1 Grade or better

2x10 Spruce-Pine-Fir (KD-19), No. 2 Grade or better (NL6A)

LVL 1.9E Minimum

- Where required, Laminated Veneer Lumber may be used per Engineering
- Structural Steel - A5.TM, A58

FOUNDATIONS

- All plain and reinforced concrete shall comply with requirements in ACI 318.
- Concrete footings shall be poured a maximum 5' slump, 5 bag mix, and 2500 psi minimum strength per Table R402.2. Concrete walls shall be poured a maximum 5' slump, 5 1/2-bag mix, and 3,000 psi minimum strength per Foundation Wall Design table below. Special soil and or wall height conditions may require a higher psi mix.
- Walls and footings designed as unreinforced unless otherwise specified on foundation plans or details. Special soil and/or site conditions may require the addition of reinforcing.
- Footing frost depth to be no less than 12" per R403.1.4 and Table R301.2(1).
- Minimum Soil Bearing Capacity shall be 2,000 PSF per Table R401.4.1.
- Slab requirements:
Interior slabs on grade (excluding garage slabs) to be minimum 3-1/2" concrete (may be represented on plans as nominal 4") over 4" sub-base, with vapor barrier (6-mil polyethylene) as required per Section 506 and a minimum 2500 PSI per Table R402.2.
Non-structural garage slabs shall be nominal 3-1/2" thick and shall be installed on compacted / undisturbed soil per Table R402.2. Slabs shall be 3500 PSI air-entrained concrete.
Structural garage slabs utilizing grade beams shall be nominal 4" thick. Slabs shall be 3500 PSI air-entrained concrete.
Porch slab and exterior concrete work shall be nominal 4" minimum 3500 PSI air-entrained concrete with 6x6 XL4xHL4 mesh or equivalent fiber mesh reinforcement.
- Unconditioned crawl spaces shall have a minimum net area of ventilation not less than 1 square foot for each 150 square feet of area, unless the ground surface is covered by a Class I vapor retarder, in which case the minimum net area of ventilation shall not be less than 1 square foot for each 1500 square feet of area. One such ventilating opening shall be within 3 feet (914 mm) of each corner of the building, per R408.1.2.
- Foundation drains shall be located per local codes and according to local site conditions. Drain discharge by gravity or mechanical means to conform with approved site plan and installed per Section R405.1.
- The top course of block of foundation walls shall be semi-solid block or open cores of hollow block shall be filled with mortar.
- Block piers to be solid block or mortar-filled hollow block.
- A poured concrete foundation wall designed to withstand an equivalent fluid weight of 30# per cubic ft, may be substituted where masonry units (block) are shown on plans.
- Concrete and masonry foundation walls shall be dampproofed with min. 3/8" portland cement parging from footing to top of finished grade. The parging shall be covered with a coat of approved bituminous material applied at the recommended rate per R406.1.
- Where required, concrete and masonry foundation walls shall be waterproofed with an approved membrane extending from footing to top of finished grade. The joints in the membrane shall be lapped and sealed with an adhesive compatible with the waterproofing membrane. Waterproofing to be in accordance with R406.2.
- Reserved for future use.
- Foundation framing anchors shall be 1/2"x18" anchor bolts with 1" minimum embedment or Simpson Strong-Tie MASA / USP FA3 (16 gauge steel, galvanized) or equivalent set in concrete or grouted cell, 11"-0" maximum from corners and spaced at a maximum of 6' o.c. and in the middle third of the width of the plate. For walls connecting offset braced wall panels, those 24" in length or shorter shall have min. (1) anchor strap and those 12" or shorter can be installed without anchor straps. Townhouses in seismic design category "C" shall require a 22"x 3" x 3" plate washer per R403.1.6.1 and maximum anchor bolt spacing for buildings over two stories shall be 4'.
- Steel columns and bases shall be given a shop coating of rust-inhibitive paint or equivalent to provide corrosion resistance per R401.2.
- For masonry veneers:
Per R103.8.4.1 - Corrugated sheet metal veneer ties shall be a minimum of No. 22 U.S. gauge by 7/8 inch. Each tie shall be spaced not more than 32" o.c. horizontally and 24" o.c. vertically and shall support not more than 2.67 square feet of wall area. For townhouses in Seismic Design Category C and in wind areas of more than 30 pounds per square foot pressure, each tie shall support not more than 2 square feet of wall area.
Additional metal ties shall be provided around all wall openings greater than 16 inches (406 mm) in either dimension. Metal ties around the perimeter of openings shall be spaced not more than 3 feet (914mm) on center and placed within 12 inches (305 mm) of the wall opening.
Per R103.2 - One layer of No. 15 asphalt felt or other approved water-resistive barrier shall be provided behind brick.
Per Table R103.8.4 - Provide minimum 1-Inch air space between brick veneer and sheathing.
Per R103.8.6 - Provide minimum 3/16" diameter weep holes at 33" on center maximum, located immediately above the flashing.
Per R103.8.5 - When veneer of brick, clay tile, concrete, or natural or artificial stone are used, 6 mil plastic flashing shall be attached to the sheathing wherever necessary to prevent moisture penetration behind the veneer. See NVR Flashing Details.

- Reserved for future use.
- Foundation wall strip footing thickness to be 8" (or 6" with a single story) unless otherwise noted as specified by engineering. Strip footing projections beyond the face of the foundation wall shall not to exceed the footing thickness. Bump out footings, pier pads, and any other footing identified as being greater than 8" in thickness shall not be reduced.
- Block foundation walls may be substituted for poured foundation walls shown on foundation plans provided all requirements of Section R404 are met.
- Termite treatment provided below slabs or to framing members per R318.1.

FOUNDATION WALL DESIGN (C)
NCRBC PRESCRIPTIVE CODE OR ENGINEERED DESIGN PER ACI 332

WALL HEIGHT	WALL THICKNESS	LATERAL SOIL UNBALANCED LOAD (a)	FILL	VERTICAL REINFORCING (b)	HORIZONTAL REINFORCING (c)
8'-0"	45	6'-0"	NOT REQUIRED	2- #4 BARS (f)	
			7'-0"	NOT REQUIRED (d)	3- #4 BARS (de)
			6'-0"	NOT REQUIRED (d)	3- #4 BARS (de)
	60	7'-0"	#4 @ 22" O.C. (d)	3- #4 BARS (de)	
			6'-0"	NOT REQUIRED	2- #4 BARS (f)
			7'-0"	NOT REQUIRED	2- #4 BARS (f)
10'	45	6'-0"	NOT REQUIRED	2- #4 BARS (f)	
			7'-0"	NOT REQUIRED	2- #4 BARS (f)
			6'-0"	NOT REQUIRED	2- #4 BARS (f)
	60	7'-0"	NOT REQUIRED	2- #4 BARS (f)	
			6'-0"	NOT REQUIRED	2- #4 BARS (f)
			7'-0"	NOT REQUIRED	2- #4 BARS (f)
8'-0"	45	6'-0"	NOT REQUIRED	4- #4 BARS (de)	
			8'-0"	#4 @ 19" O.C. (d)	4- #4 BARS (de)
			7'-0"	#4 @ 19" O.C. (d)	4- #4 BARS (de)
	60	7'-0"	#4 @ 15" O.C. (d)	4- #4 BARS (de)	
			6'-0"	NOT REQUIRED	3- #4 BARS (g)
			7'-0"	NOT REQUIRED (d)	4- #4 BARS (de)
9'-0"	45	6'-0"	NOT REQUIRED	4- #4 BARS (de)	
			7'-0"	NOT REQUIRED (d)	4- #4 BARS (de)
			8'-0"	#4 @ 19" O.C. (d)	4- #4 BARS (de)

NOTE: BACKFILLING OF THE FOUNDATION SHALL NOT TAKE PLACE BEFORE THE BASEMENT SLAB IS IN PLACE AND THE FLOOR FRAMING IS ERECTED OR UNLESS WALLS ARE ADEQUATELY BRACED.

- SOIL CLASSSES GM, GC, SM, SM-SG AND ML - 45 PSF
SOIL CLASSSES SC, MH, ML-CL AND CL - 60 PSF
- SPACINGS SHOWN IS BASED UPON Fy = 60,000 PSI
STEEL FOR Fy = 40,000 PSI STEEL, REDUCE SPACINGS BY 0.67
- CONCRETE SHALL HAVE A COMPRESSIVE STRENGTH OF NOT LESS THAN 3000 PSI
- ENGINEERED DESIGN PER ACI 332-14, REQUIREMENTS FOR RESIDENTIAL CONCRETE CONSTRUCTION
- FOR ALL WALL HEIGHTS, ONE HORIZONTAL BAR SHALL BE LOCATED WITHIN THE TOP 24", ONE IN THE BOTTOM 24" WITH THE REMAINING BARS EQUALLY SPACED. MAINTAIN 2" OF CONCRETE COVER BETWEEN INSIDE FACE OF WALL AND FACE OF HORIZONTAL BARS.
- ONE BAR WITHIN 12" OF TOP AND AT MID-HEIGHT OF WALL PER TABLE R404.1.2(1).
- ONE BAR WITHIN 12" OF TOP AND ONE EACH AT THIRD POINT OF WALL HEIGHT PER TABLE 404.1.2(1).

PLANS

- Habitable attics and sleeping rooms shall have a window or door as a second means of egress that shall be minimum 5.7 sq. ft. operable area (5.0 sq. ft. if at grade level) with maximum sill height 44" above finish floor (min. hgt. 24"; min. width 20") per R310.1.
- All emergency escape and rescue openings shall have a minimum net clear operable area of 4 sq. ft. The minimum net clear opening height shall be 22" and a minimum net clear opening width of 20". Emergency escape and rescue openings must have a minimum total glazing area of not less than 5 sq. ft. In the case of a ground window and not less than 5.7 sq ft in the case of an upper story window per R310.2.1. Window wells where required, shall be installed per R310.2.3 with a minimum of 4 sq ft and a minimum horizontal projection and width of 36". Wells with a greater depth of 44" shall have permanently affixed ladder or steps per R310.2.3.1.
- Clear opening heights for exterior doors to be 6'-6" minimum per R311.2. All interior doors providing egress from habitable rooms shall have nominal minimum dimensions of 2'-6" by 6'-8" per R311.6.1. Habitable rooms with double doors less than 5'-0" in total width (less than 2'-6" per door slab) shall have a total opening width of at least 2'-6" with no slide bolts or locking devices installed on either door.
- Sliding glass drs/patio drs/wdws must be safety glazed per R308.4.
- Interior stairway shall have minimum head room of 6'-8" per 311.7.2 and minimum tread depth of 9" and maximum riser height of 8 1/4". Handrails are required for stairs with four or more risers and shall have minimum height of 34" and maximum height of 38" above treads and landings. Handrail to have maximum 4 1/2" projection into width of stair per Section R311.7. Enclosed accessible space under stairs shall have walls, under stair surface and any soffits protected on the enclosed side with 1/2" gypsum board per R302.7.
- Guard rails to have minimum height of 36" and shall not have openings from the walking surface to the required guard height which allow passage of a sphere 4 inches in diameter per R312.
- The triangular openings at the open side of stair, formed by the riser, tread and bottom rail of a guard, shall not allow passage of a sphere 6 inches (153 mm) in diameter per R312.1.3.
- Where exterior landings or floors serving the required egress door are not at grade, they shall be provided with access to grade by means of a stairway in accordance with Section R311.7 (see item #5 above) or a ramp in accordance with Section R311.8.
- Handrails shall be installed on exterior stairs having (4) or more risers per R311.7.8. Guards shall be installed at exterior porches / decks that are located more than 30 inches (762 mm) measured vertically to the floor or grade below at any point within 36 inches (914 mm) horizontally to the edge of the open side. Insect screening shall not be considered as a guard.
- All flashing used (including at windows, doors, and with stone or masonry veneer) shall be corrosion-resistant per R103.4. See NVR Flashing Details.
- Wood framed bearing walls shall 2 x 6 at 24" o.c. maximum or 2 x 4 at 16" o.c. maximum per Table R602.3(3) and Table R602.3(5) unless otherwise noted on plans.
- All exterior sheathing to be structural sheathing designed in accordance with R602.10.
- An approved water-resistive barrier shall be applied over sheathing of exterior walls per Section R103.2.
- Interior sheathing shall be 1/2" gypsum wall board unless otherwise noted. Exceptions may include, but are not limited to, special requirements for wall bracing and fire separation.
 - Screen fastening is typical for gypsum installation and nailing will only be permitted at the perimeter of the board.
 - All screws shall be corrosion-resistant Type W 1-1/4" drywall screws.

SCREEN FASTENING SCHEDULE			
Framing Spacing	WITH ADHESIVE		
	Ceilings	Load-brg. walls	Non-load-brg. walls
16	16	24	24
24	16	16	24
Framing Spacing	WITHOUT ADHESIVE		
	Ceilings	Load-brg. walls	Non-load-brg. walls
16	12	16	16
24	12	16	12


- For 1/2" wallboard, nails shall be 1-1/4" long, 1/4" head and .098 diameter shanks with annular ring or acceptable equivalent and comply with ASTM C514.
 - For 5/8" wallboard, nails shall be 1-3/8" long, 1/4" head and .098 diameter shanks.
- Garages shall be completely separated from the residence and attic area by not less than 1/2" gypsum board applied to the exterior side of the garage. Garages beside habitable rooms shall be separated by habitable rooms above by not less than 5/8" type X gyp. board. Where a structure is supporting a floor-ceiling assembly due to living space above the garage, the structure shall also be protected by not less than 1/2" gypsum board per Section R302.6. Openings and penetrations through the separation shall be protected by sealing the area around the penetration per Section R302.5. The garage door shall be a 20-minute fire-rated door and be equipped with a self-closing device installed per Section R302.5.1.
 - Asphalt shingles shall be installed per section R405.2. For roof slopes of 2:12 through 4:12, in lieu of two layers of underlayment, a self-adhering polymer-modified bitumen underlayment shall be used per section R405.1.1 Exception #1.
 - Attic spaces shall be ventilated w/ ridge and soffit vents unless otherwise noted. Venting provided per R606.2.
 - Fireblocking shall be installed between ceiling and floor openings per R302.11. Draftstopping to be installed in accordance with R302.12.
 - Water closet, lavatory or bidet shall not be set closer than 15 inches from its center to any side wall, partition or vanity or closet than 30 inches center-to-center between adjacent fixtures. There shall be a clearance of not less than 21 inches in front of the water closet, lavatory or bidet to any wall, fixture or door per F2105.1.
 - Heating and cooling equipment installation shall be in accordance with IRC Chapter 14 and the International Mechanical Code.
 - Mechanical fireplaces shall be installed per Section R1004 and 1005.
 - Single family attached structures to have 2-hour dwelling unit separation wall continuous to roof deck. Roofing material to be minimum class "C" over approved fire retardant wood decking extending 4" each side of dwelling unit separation wall per R302.2 and R302.3.
 - Untreated wood shall be minimum 8" above finish grade per R317.1 item #2.
 - Bottom plates on slabs and any wood in contact w/ concrete or masonry to be pressure treated material per Section R317.
 - Exterior egress swing doors shall open onto a landing not more than 8 1/4" below the top of the threshold when door swings in and 1 1/2" below the top of the threshold when the door swings out. The landing shall extend a minimum of 36" in the direction of travel and be at least the width of the doorway served per R311.3.
 - Air exhaust and intake openings that terminate outdoors shall be protected with corrosion-resistant screen, louvers, or grills having a min. opening size of 1/4" and maximum of 1/2" in any dimension per R308.6.
 - Fasteners and connectors for pressure preservative-treated wood shall be hot-dipped galvanized steel.
 - Windows that have an operable opening more than 72" above finished grade or surface below, the lowest part of the clear opening of the window shall be a minimum of 24" above the finished floor of the room in which the window is located. Glazing between the floor and 24" shall be fixed or have openings through which a 4" dia. sphere cannot pass per Section R312.2.
 - The final grade shall fall a minimum of 6 inches within the first 10 feet of the foundation per R401.3.
 - One- and two-family dwelling construction (R302.1.1).
Vinyl or aluminum soffit material shall be securely attached to framing members and use an underlayment material of either fire retardant treated wood, 3/4-inch wood sheathing or 5/8-inch gypsum board. Venting requirements shall apply to both soffit and underlayment and shall be per Section R806. Where the property line is 10 feet or more from the building face, the provisions of this code section shall not apply.
Townhouse construction (R302.2.5).
Projections extending into the fire-separation distance shall have not less than 1-hour fire-resistive construction on the underside. Vinyl or aluminum soffit material shall be securely attached to framing members and use an underlayment material of either fire retardant treated wood, 3/4-inch wood sheathing or 5/8-inch gypsum board. Venting requirements shall apply to both soffit and underlayment. Vents shall be nominal 2-inch continuous or equivalent intermittent and shall not exceed the minimum net free air requirements of Section R806.2 by more than 50%. Vents in soffit are not allowed within 4 feet of fire walls or property lines per R302.2.5 and R302.2.6.
 - 1-hour fire-rated construction required on projections within 2' to 3' of lot line per R302.1. No projections allowed within 2' of property line.
1-hour fire-rated construction required on townhouse eaves within 3' of the property line.
Note: Single Family Detached product will NOT be built within 3' of the property line.
 - Wall bracing is designed in compliance with Section R602.10. When wall bracing is beyond the criteria for a prescriptive approach, the structure is analyzed utilizing engineering in compliance with the North Carolina Building Code (NCBC). Refer to house-specific wall bracing detail sheets and wall bracing standard details. Adhesive attachment of wall sheathing, including Method 6B, shall not be permitted in Seismic Design Category C.
 - Minimum floor sheathing shall be 5/8" tongue & groove decking underlayment grade plugged and sanded, exterior glue, glued and nailed on joists to meet, "American Plywood Association" approved glued floor system, unless otherwise specified.

ELECTRICAL


- Ground-fault and arc-fault circuit interrupter protection is provided per NFPA 70 (National Electric Code).
- Electric panel box installation to be in accordance with NFPA 70, Article 408 Section III. Location may vary by design.
- Approved smoke detectors shall be installed in each sleeping room; outside each separate sleeping area in the immediate vicinity of the bedrooms; and on each additional story of the dwelling, including basements and habitable attics but not including crawl spaces and uninhabitable attics. Where more than one smoke detector is required, the devices shall be interconnected in such a manner that the activation of one alarm will activate all of the alarms in the individual unit. All smoke detectors shall receive their primary power from the building wiring and be equipped with a battery backup.
- Unless listed for installation in such locations, smoke detectors shall be installed at least 10 feet from a cooking appliance, at least 3 feet from the door to a bathroom containing a tub or shower, at least 3 feet from forced air supply registers, and at least 3 feet from the tip of a ceiling fan blade. In sleeping rooms, smoke detectors should be located in the vicinity of the room entrances. They shall be installed at the highest portion of the ceiling (including tray or coffered ceilings) or within 12 inches vertically from the highest point in rooms with sloped ceilings.
- Interior stairs shall be provided with an artificial light source in the vicinity of each landing or directly over each stair section and capable of illuminating treads and landings to a level not less than 1fc measured at the center of the tread or landing per R303.7.
- Outlets within 6' of a sink must be GFI protected.
- An approved carbon monoxide alarm shall be installed outside of each separate sleeping area in the immediate vicinity of the bedrooms. Where a fuel-burning appliance is located within a bedroom or its attached bathroom, a carbon monoxide alarm shall be installed within the bedroom. R315.3.
- Outlets installed in laundry areas must be GFI protected.

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.

REV. NO.	DATE	REMARKS
1	10/1/14	1BET - CODE UPDATES FOR 2018 NCBC
2	9/1/14	1BET - UPDATED ENERGY NOTES
3	12/16/22	CAP - REVISE NOTE FOR 2X4 OR 2X6 EXTERIOR WALLS

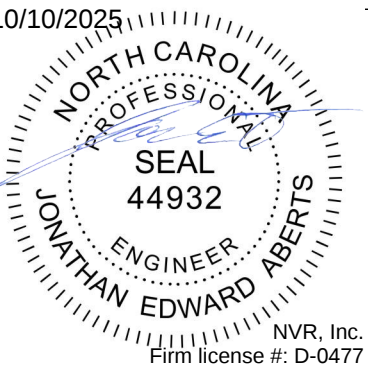

I, NVR, Inc., hereby reserve its copyright and other property rights in these plans. These plans are not to be copied, reproduced, or otherwise used in any form or manner whatsoever, nor are they to be used in any way without the written consent of NVR, Inc.

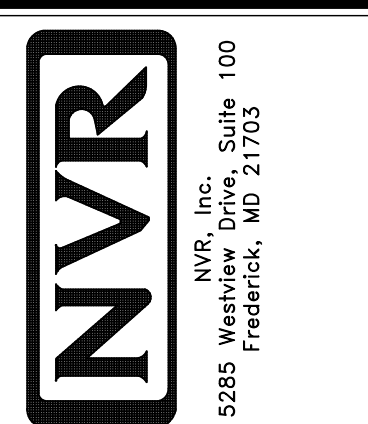

SET NO.	VERSION
DRAWN BY	DATE:
OPTION	


MODEL	NVR
DRAWING TITLE	SS-1
SINGLE FAMILY ATTACHED	
SINGLE FAMILY DETACHED	
OPTION DESCRIPTION	NC State Building Code - Residential Code 2018
SHEET NO.	1.1



James Bales
10/10/2025

COMM-LOT
KIPLING VILLAGE - 0023



5



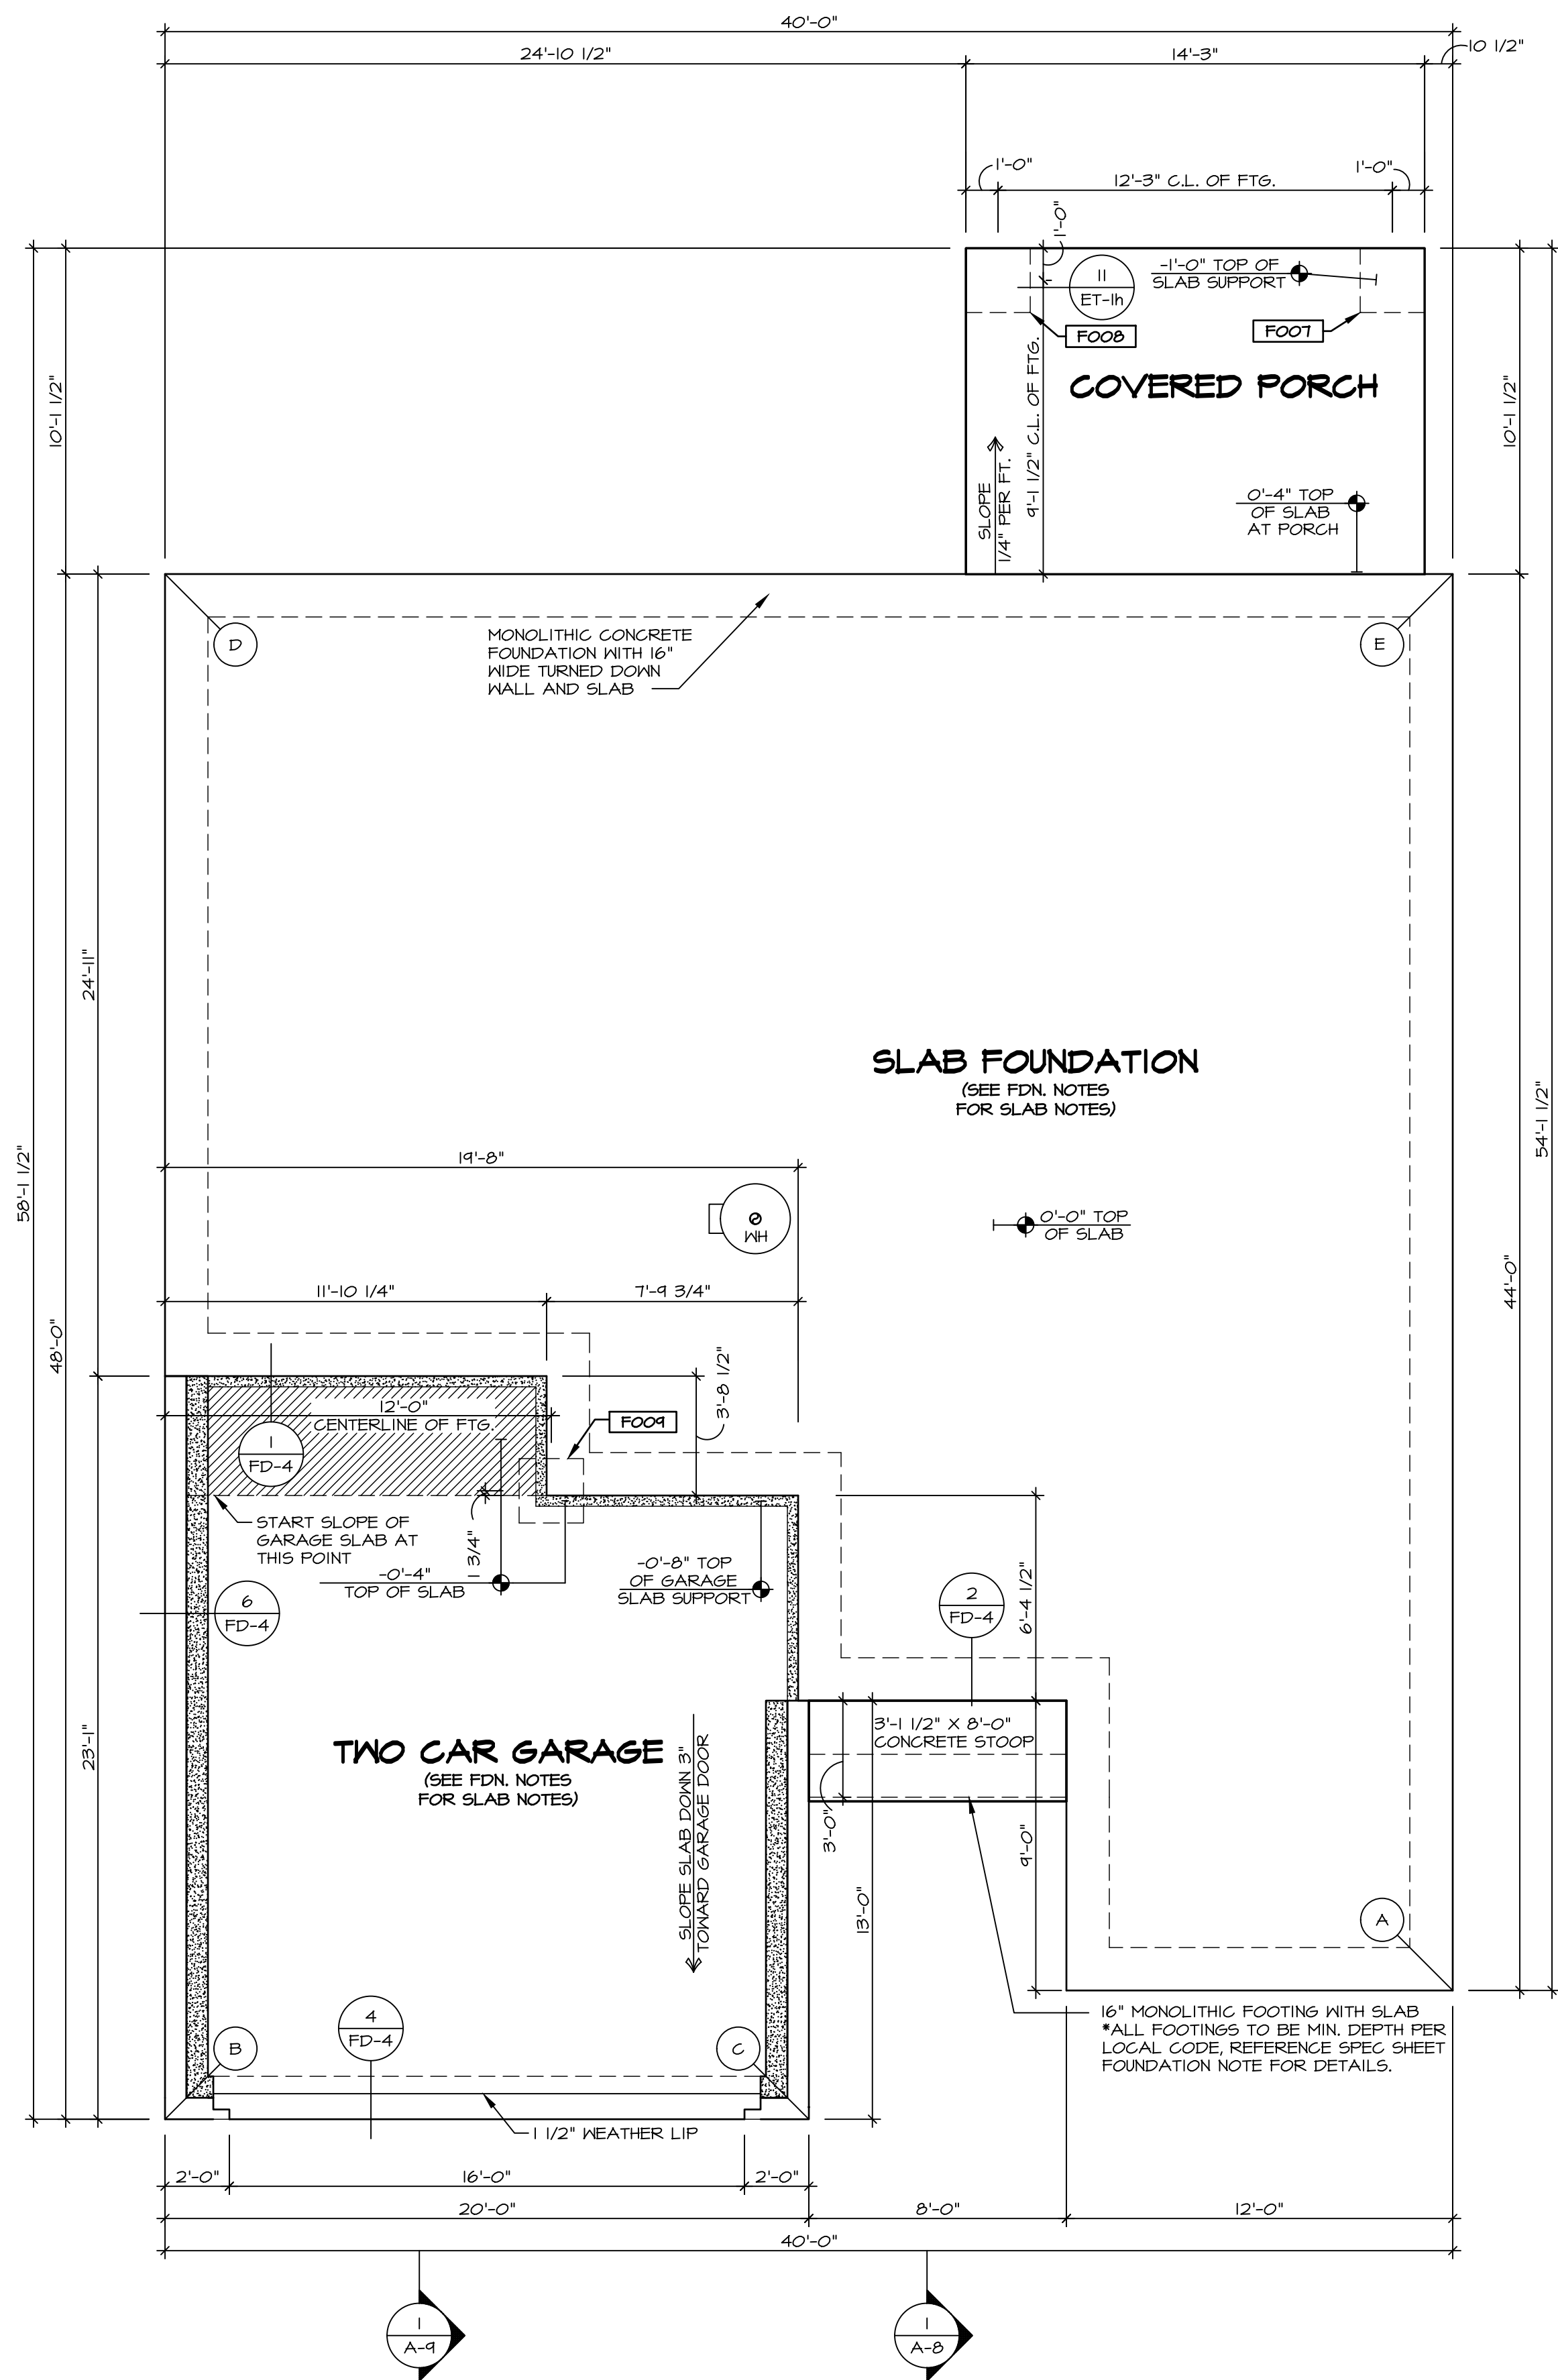

FOUNDATION DIAGONALS					
A			B		
A	0"		A	40'-2 3/8"	
B	40'-2 3/8"		B	0"	
C	20'-4 3/4"		C	20'-0"	
D	54'-5 4/16"		D	48'-0"	
E	44'-0"		E	62'-5 13/16"	


FOOTING/THICKENED SLAB SCHEDULE					
IDENTIFIER	LENGTH	WIDTH	HEIGHT	ENG. NUM.	REMARKS
FOOT	2'-0"	2'-0"	1'-0"	S0001	
FOOB	2'-0"	2'-0"	1'-0"	S0001	
FOOD	2'-0"	2'-0"	1'-0"	S0002	

- FOUNDATION NOTES - SLAB**
- SEE STANDARD DETAIL CATEGORY "FD" SHEET(S).
 - CONCRETE SLAB ON VAPOR BARRIER OVER SUB-BASE (SEE SPEC SHEET FOR SLAB NOTES)
 - FOUNDATION UNDER GARAGE:
 - UNEKGAVATED WITH CONCRETE SLAB OVER SUB-BASE (SEE SPEC SHEET FOR SLAB NOTES) OR
 - STRUCTURAL CONCRETE SLAB OVER SUB-BASE (SEE SPEC SHEET FOR SLAB NOTES)
 - SEE FOUNDATION HOLD DOWN SHEET FOR CONNECTION INFORMATION.
 - SLAB LEDGE LOCATIONS VARY W/ GRADE BEAM(S) ORIENTATION. SEE GB-1 FOR DETAILS.
 - THE DIRECTION OF THE ARROW IS THE DIRECTION OF REBAR, AS REQUIRED.
 - ALL FOOTINGS ARE PLAIN, NON-REINFORCED CONCRETE UNLESS NOTES OTHERWISE.
 - SEE MS- DETAILS FOR FOOTER SLEEVE INFORMATION.
 - THICKEND SLAB DEPTHS MEASURE FROM TOP OF PAD. FOOTING DEPTHS MEASURE 4" BELOW TOP OF SLAB.


LEGEND	
	BEARING WALL
	NON BEARING WALL
	MASONRY WALL
	INDICATES BEARING FROM POINT-LOAD ABOVE
	JACKS
	BEAM/HEADER
	FOOTINGS/THICKENED SLAB
	STEEL COLUMN
	TRUSS TIE DOWN
	PORTAL FRAME
	JOIST/TRUSS
	LVL
	ENGINEERING PAGE NUMBER
	WINDOW/DOOR TAG
	PRECAST LINTEL TAG
	SEE FA DETAILS FOR FIRE ASSEMBLIES
	SEE FC DETAILS FOR FRAMING CONNECTORS AND MATERIAL USAGE

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.


IV-COMM-LOT-UNIT
RLH-VK-0023
ONM-LOT
SIPILING VILLAGE - 0023
TREET ADDRESS
333 SOUTH BREEZE MAY
ITT
STATE
ZIP
27526

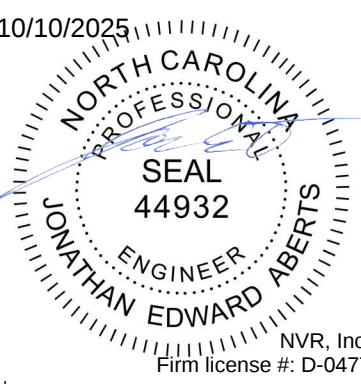


NVR, Inc. expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written consent of NVR, Inc.

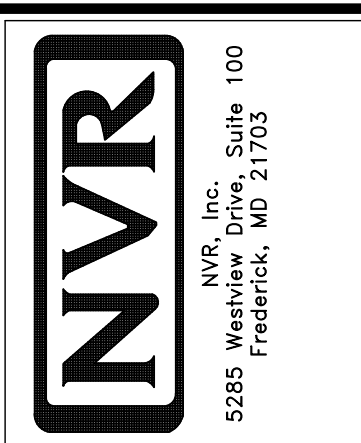



MODEL GRAND BAHAMA	SET NO. 06H00
DRAWING TITLE FOUNDATIONS	VERSION 01
OPTION DESCRIPTION	RELEASE NO. ----
7	DRAWN BY DATE: OPTION

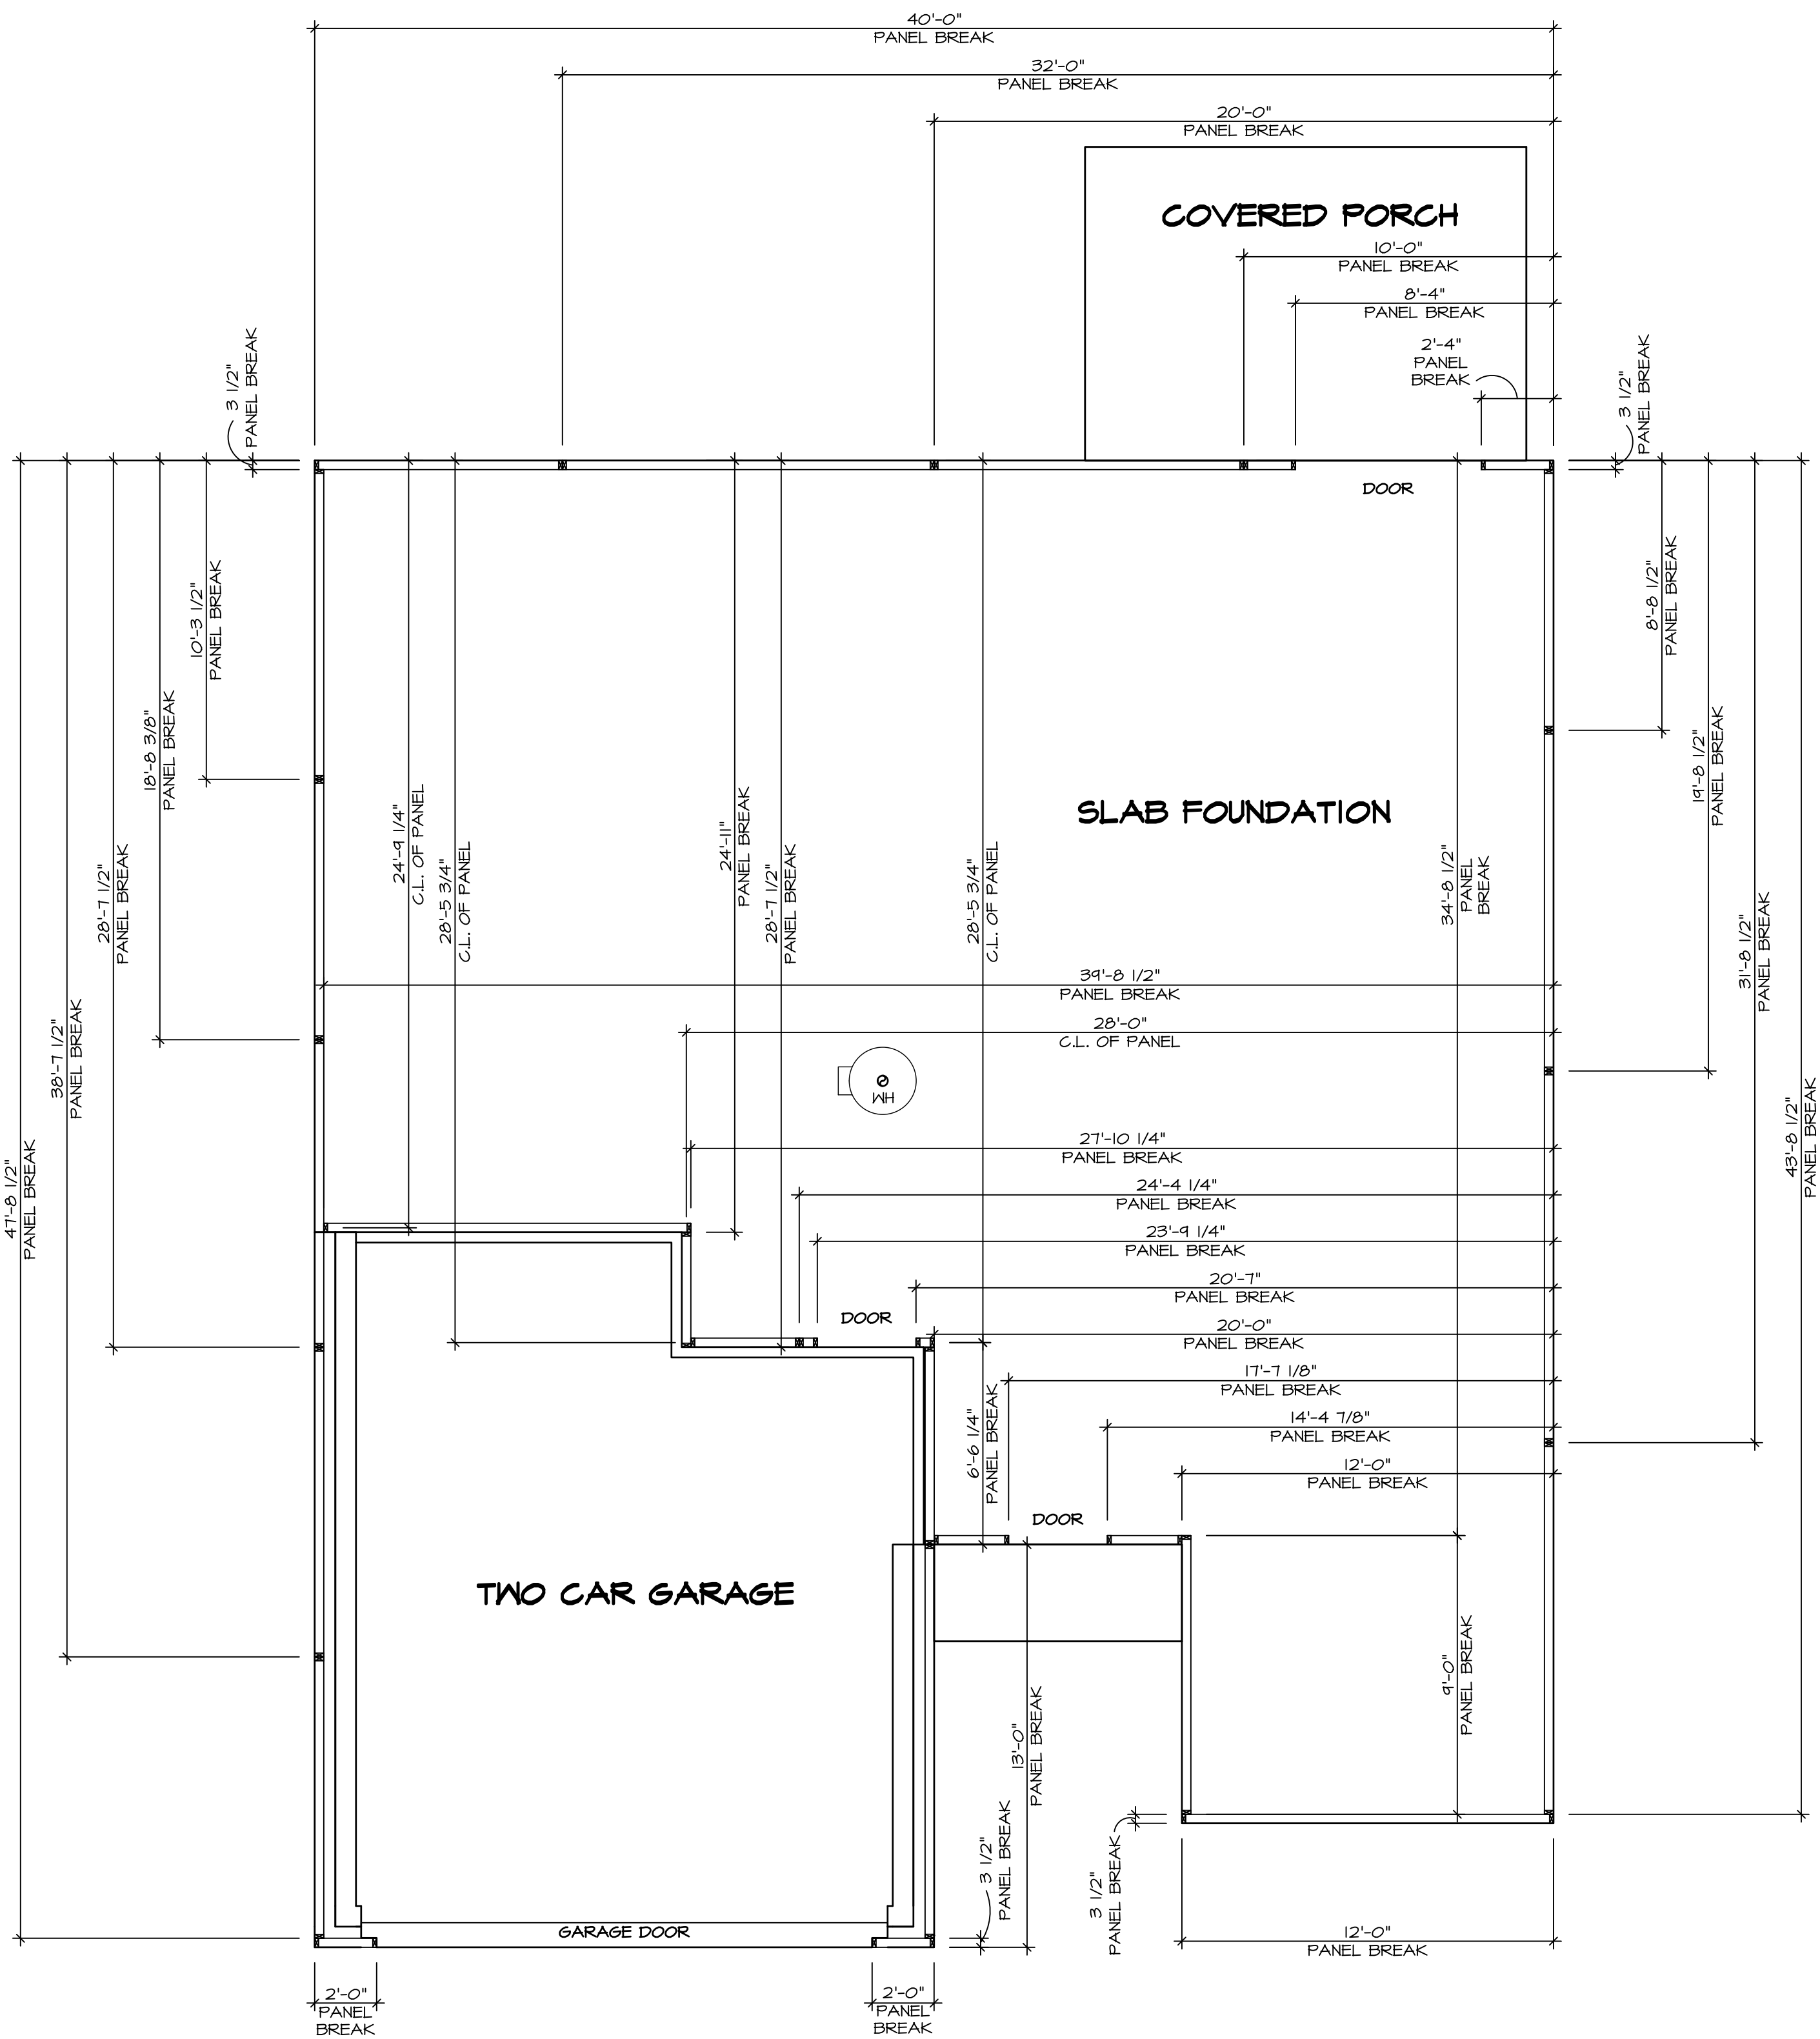

2
NC-4
PANEL BREAK DETAIL
SCALE: 1/4" = 1'-0"

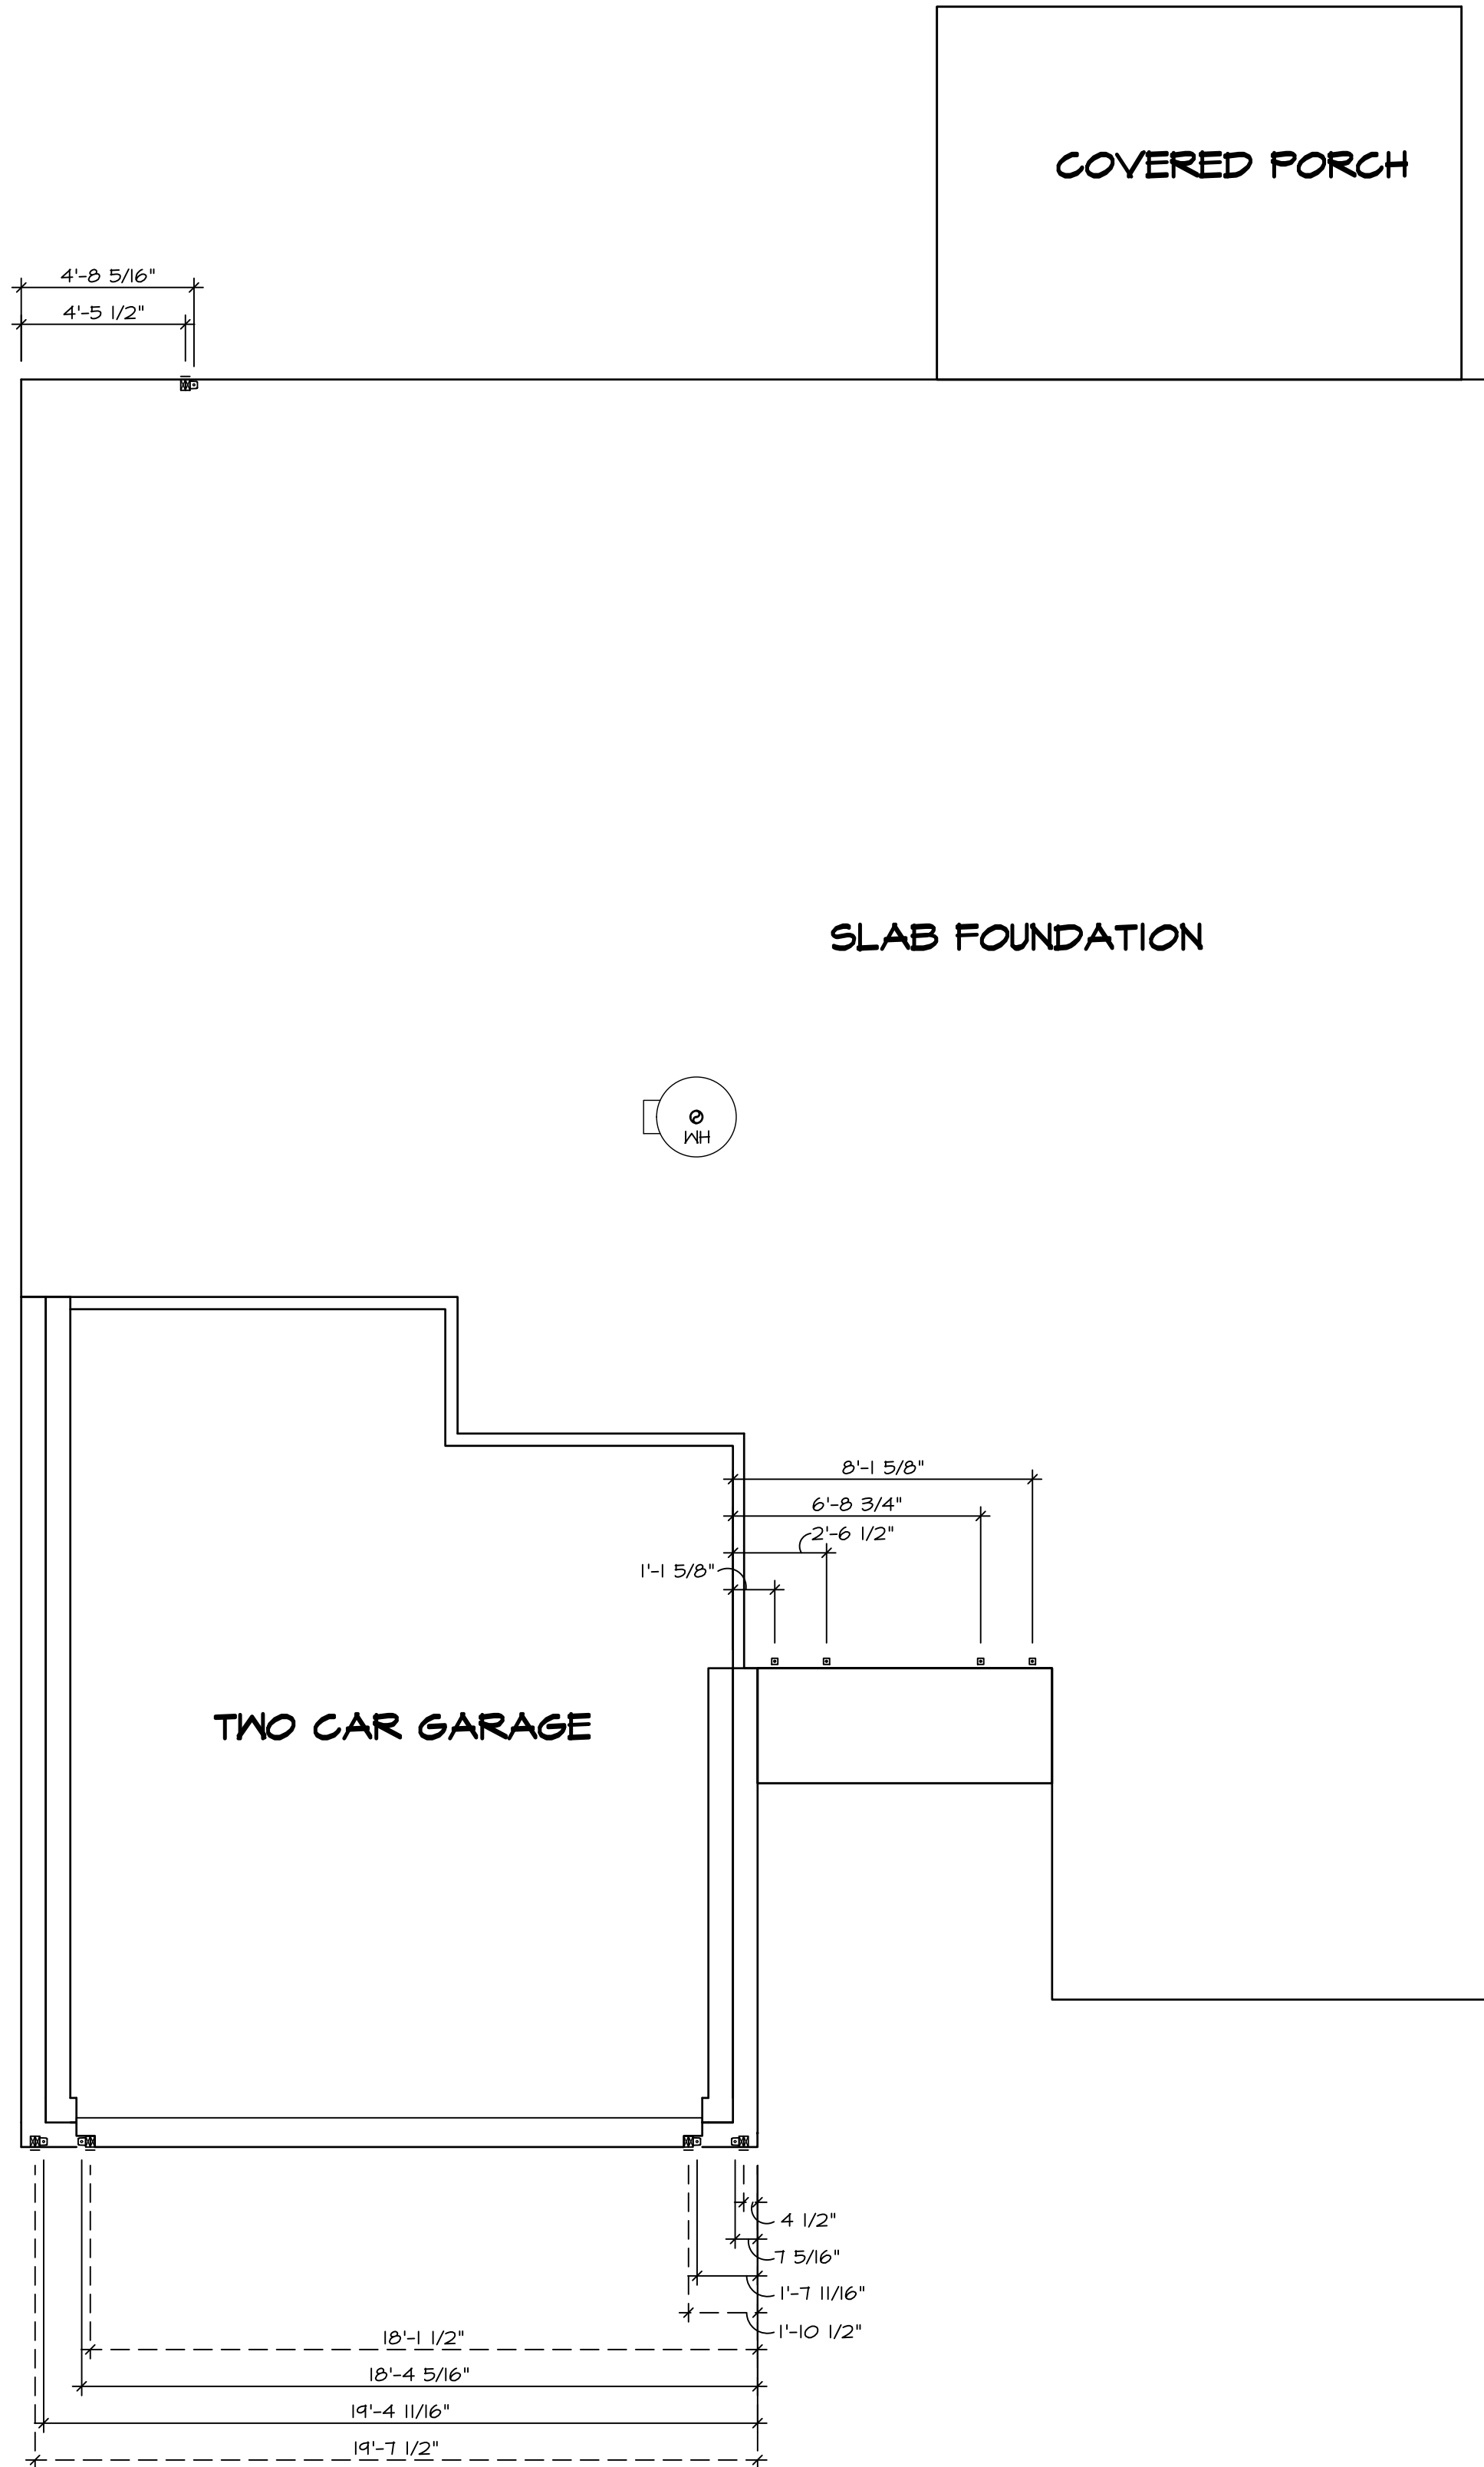

1
NC-4
FOUNDATION HOLD DOWN DETAIL
SCALE: 1/4" = 1'-0"

HOLD DOWN NOTES	
REFER TO DETAIL (1/2D-1) FOR HOLD DOWN OFFSET DIMENSIONS. REFER TO DETAIL (12/2D-1) FOR HOLD DOWNS ON CMU BLOCK.	
	1. ALL PANELS GREATER THAN 24" SHALL HAVE AN ANCHOR WITHIN 12" OF THE PANEL BREAKS / ENDS. (SEE DETAIL SHEET FC-1 FOR MORE INFORMATION ON ANCHOR DETAILS)
STRAP 	1. STRAP: a. ON FOUNDATION USE (STHD14) b. ON FLOOR SYSTEM USE (STHD14R.U) 2. ALL OTHER HOLD DOWN SEE DETAIL MB- FOR MORE INFORMATION. 3. STRAP LOCATION ON PLANS SHOWN BY DASHED DIMENSION TO CENTER OF STUDS
OR	
BOLT 	1. THREADED ROD 2. ALL OTHER HOLD DOWN SEE DETAIL MB- FOR MORE INFORMATION. 3. BOLT LOCATION ON PLANS SHOWN BY SOLID DIMENSION TO CENTER OF BOLT

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.

IV-COMM-LOT-UNIT

RLH-VK-0023

01M-LOT

SIFLING VILLAGE - 0023

TREET ADDRESS

333 SOUTH BREEZE WAY

ITT

STATE

NC

ZIP

27526

10/10/2025

NORTH CAROLINA

PROFESSIONAL

SEAL

44932

EDWARD

HERBERTS

NVR, Inc.

Firm license #: D-0477

© NVR, Inc., expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or copied in any form or manner whatsoever, nor are they to be used for any project not specifically identified on these plans without the prior written consent of NVR, Inc.

NVR

NVR, Inc., Suite 100

5285 Westwick, MD 21703

Frederick, MD 21703

SET NO. 06H00

VERSION 01

RELEASE NO. ----

DRAWN BY

DATE:

OPTION

MODEL

GRAND BAHAMA

DRAWING TITLE

FOUNDATION HOLD DOWNS


PANEL BREAK DETAILS

OPTION DESCRIPTION

9

VA-As-Sold 2-Jobs\Mitak Services\Assigned\RLH-VK-0023\ELK_R_VK_0023\9_NC-4_FDNHD_LS.dwg 10/10/25 - 2:08 pm

INSTALLATION OF RADON STACK AND
LOOP TO BE DETERMINED BY DIVISION

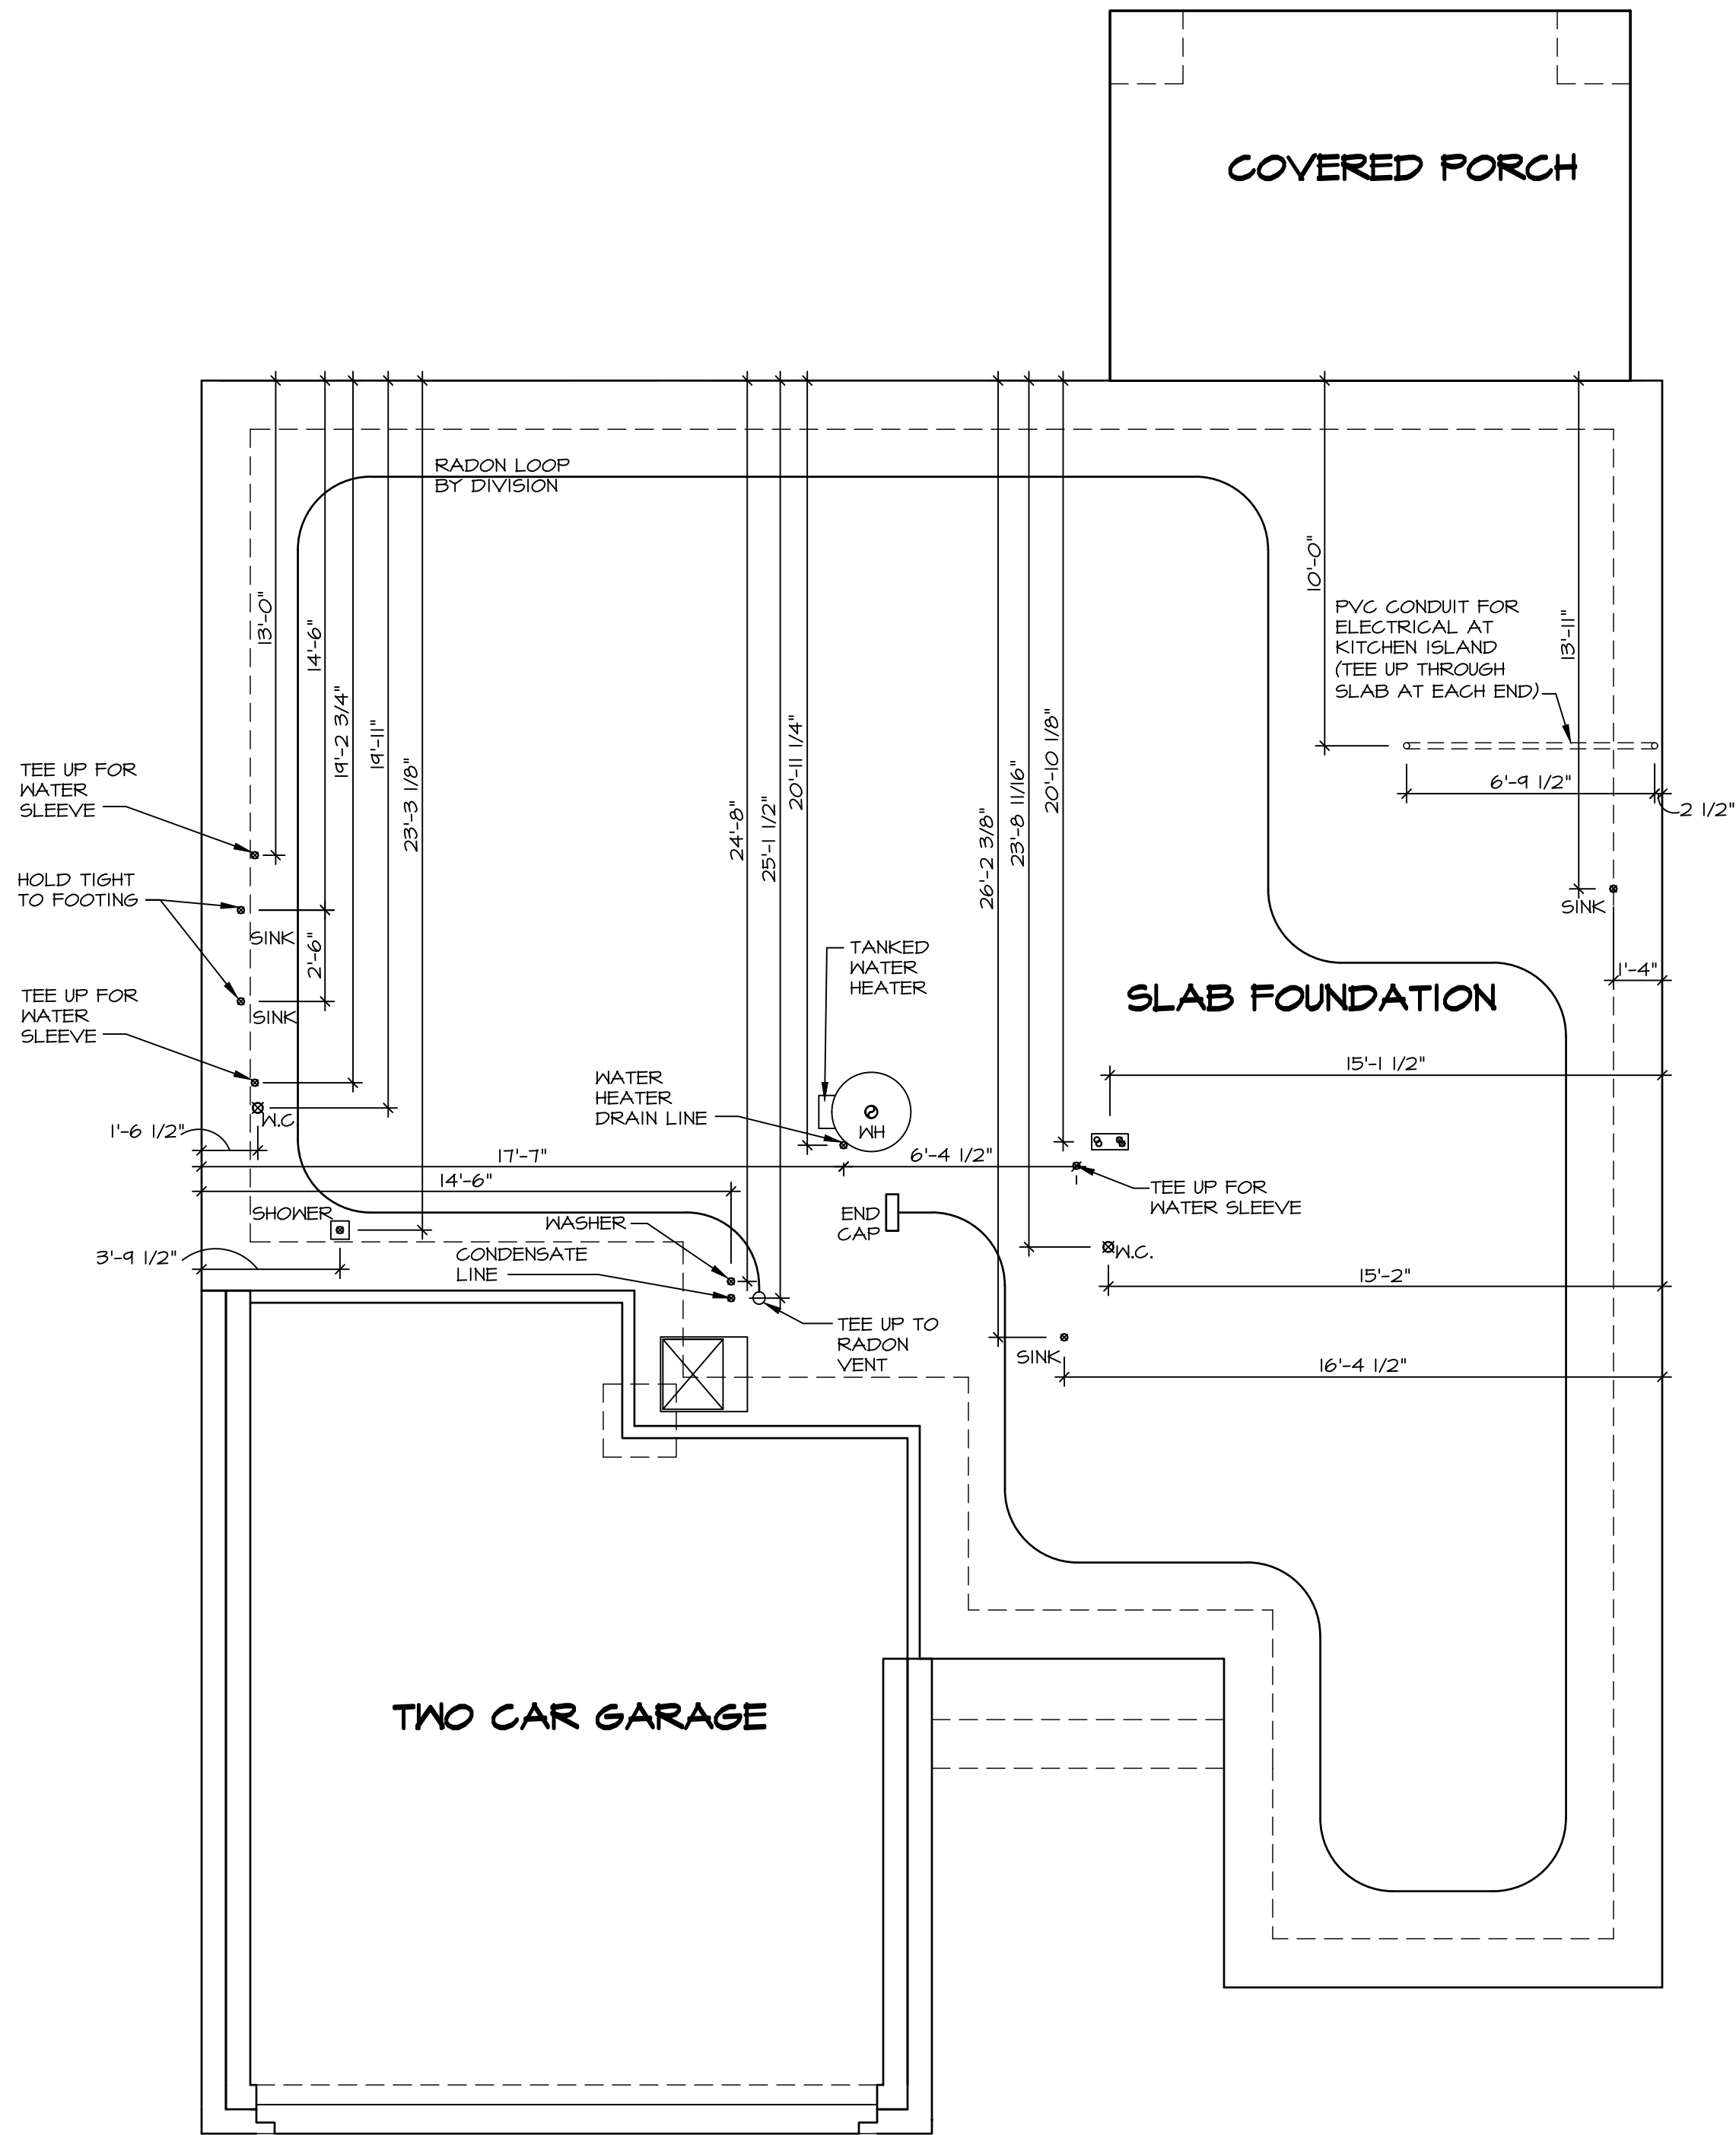

1
NC-5
PLUMBING PLAN
SCALE: 1/4" = 1'-0"

PLUMBING NOTES:
RADON REMEDIATION
RADON LOOP:
- (4") PERFORATED "LOOP"
- MUST BE PLACED IN STONE BED SLIGHTLY HIGHER THAN ANY INTERIOR DRAINTILE
- LOOP TO BE SEPARATE FROM ANY DRAINTILE ELEMENTS
- TO BE CORRUGATED PIPE
- SCREWS TO BE INSTALLED THROUGH LOOP AT TEE UP INTO STACK
STACK REQUIREMENTS:
- 3" PVC STACK (4" IF BASEMENT IS GREATER THAN 2200 SQFT.)
- NO PART OF STACK IS TO BE HORIZONTAL (45° ELBOWS PERMITTED AS REQUIRED)
- PIPE TO BE PHYSICALLY LABELED IN THE FIELD AS "RADON VENT" OR OTHER
JURISDICTIONALLY REQUIRED LANGUAGE (ON EVERY LEVEL OF HOUSE)
- ROOF TERMINATION TO BE IN TOP 1/3 OF ROOF
- SCREEN OR VENT CAP INSTALLED TO KEEP PESTS OUT OF RADON VENT AT ROOF TERMINATION.

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.


James Bates
10/10/2025

SHEET NO. NC-5	MODEL GRAND BAHAMA	SET NO. 06H00	VERSION 01	RELEASE NO. ----
	DRAWING TITLE PLUMBING	DRAWN BY	DATE:	OPTION
	OPTION DESCRIPTION			
	10			

DIV-COMM-LOT-UNIT
RLH-VK-0023


COMM-LOT
KIPLING VILLAGE - 0023

STREET ADDRESS
939 SOUTH BREEZE WAY

CITY
FUGUAY VARINA


STATE
NC

ZIP
27526

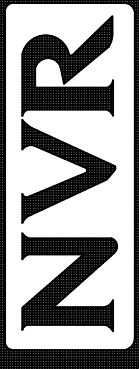
NVR, Inc., Suite 100
5285 Westwood Drive
Frederick, MD 21703

© NVR, Inc., expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or transmitted in any form or manner whatsoever, nor are they to be used for any purpose other than the first obtaining the expressed written consent of NVR, Inc.

V:\As-Built\2-Jobs\Mitek_Services\Assigned\RLH-VK-0023\ELK_R_VK_0023\10 NC-5 PLMG LS.dwg 10/10/25 - 2:08 pm

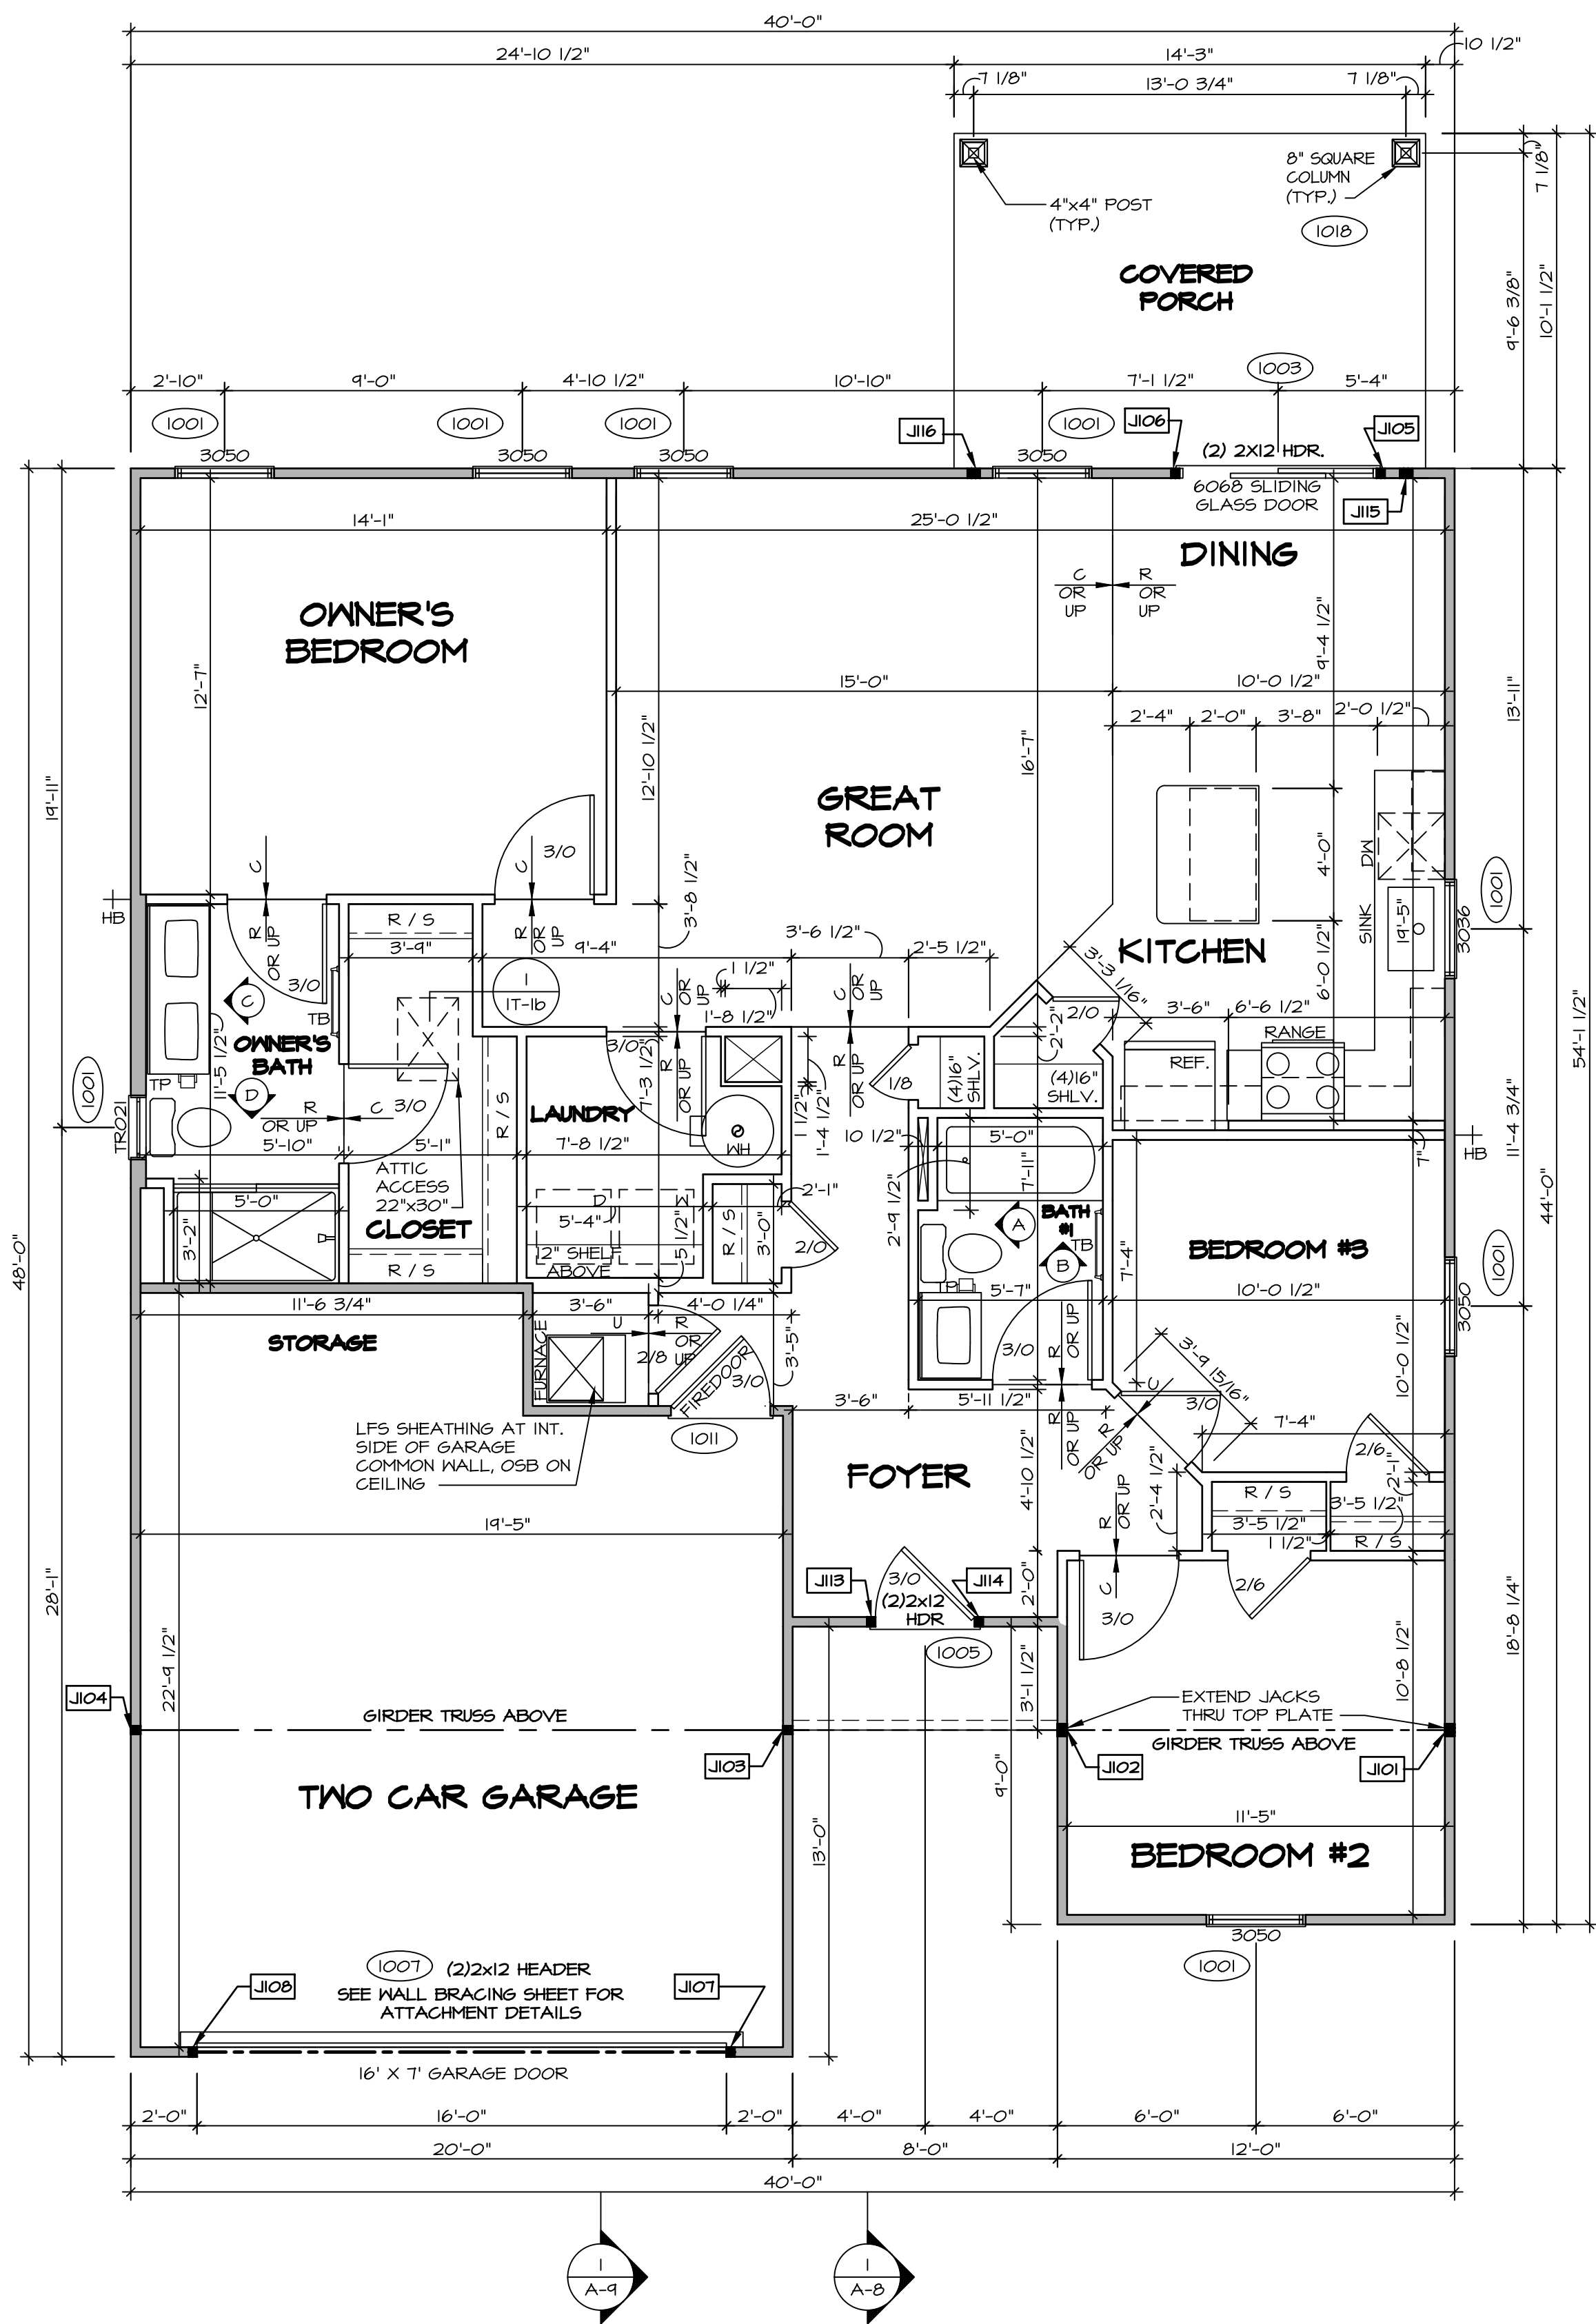

FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"

FIRST FLOOR JACK SCHEDULE			
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS
J101	JACK - (3) 2X4 SFF#1	1000	EXTEND THRU TOP PLATE
J102	JACK - (3) 2X4 SFF#1	1000	EXTEND THRU TOP PLATE
J103	JACK - (2) 2X4 SFF STUD GRADE	1000	
J104	JACK - (2) 2X4 SFF STUD GRADE	1000	
J105	JACK - (2) 2X4 SFF STUD GRADE	1003	
J106	JACK - (2) 2X4 SFF STUD GRADE	1003	
J107	JACK - (2) 2X4 SFF STUD GRADE	1007	
J108	JACK - (2) 2X4 SFF STUD GRADE	1007	
J113	JACK - (2) 2X4 SFF STUD GRADE	1005	
J114	JACK - (2) 2X4 SFF STUD GRADE	1005	
J115	JACK - (3) 2X4 SFF STUD GRADE	1018	
J116	JACK - (3) 2X4 SFF STUD GRADE	1018	

LVL PLY TO PLY FASTENING SCHEDULE: (WHERE APPLICABLE BASED ON LVL USAGE)	
1.A - (2) PLY UP TO AND INCLUDING 11 7/8" TALL; FASTEN FLIES W/ (2) ROWS 16D NAILS AT 12" O.C. OR ALT 1 1/2" WIDE LVL FASTEN FLIES W/ (3) ROWS 12D NAILS AT 12" O.C.	
2.A - (2) PLY 14" UP TO AND INCLUDING 18"; FASTEN FLIES W/ (3) ROWS 16D NAILS AT 12" O.C. OR ALT 1 1/2" WIDE LVL FASTEN FLIES W/ (4) ROWS 12D NAILS AT 12" O.C.	
3.A - (2) PLY 20" TALL AND OVER; FASTEN FLIES W/ (4) ROWS 16D NAILS AT 12" O.C. OR ALT 1 1/2" WIDE LVL FASTEN FLIES W/ (5) ROWS 12D NAILS AT 12" O.C.	
4.A - (3) PLY UP TO AND INCLUDING 11 7/8" TALL; FASTEN FLIES W/ (2) ROWS 16D NAILS AT 12" O.C. FROM EACH SIDE OR ALT 1 1/2" WIDE LVL FASTEN FLIES W/ (3) ROWS 12D NAILS AT 12" O.C. FROM EACH SIDE.	
5.A - (3) PLY 14" UP TO AND INCLUDING 18"; FASTEN FLIES W/ (3) ROWS 16D NAILS AT 12" O.C. FROM EACH SIDE OR ALT 1 1/2" WIDE LVL FASTEN FLIES W/ (4) ROWS 12D NAILS AT 12" O.C. FROM EACH SIDE.	
6.A - (3) PLY 20" TALL AND OVER; FASTEN FLIES W/ (4) ROWS 16D NAILS AT 12" O.C. FROM EACH SIDE OR ALT 1 1/2" WIDE LVL FASTEN FLIES W/ (5) ROWS 12D NAILS AT 12" O.C. FROM EACH SIDE.	
7.A - (4) PLY (ALL SIZES); FASTEN FLIES WITH (5) ROWS OF SDP2634 STRUCTURAL WOOD SCREWS, OR EQUIVALENT, AT 16" O.C. STAGGERED. SEE SHOP DRAWING FOR ADDITIONAL INFORMATION.	


GYPSUM NOTES:
AT GARAGE:
GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-1(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.
AT STAIRS:
1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS IN CLOSET

- FLOOR PLAN NOTES:**
- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.
 - ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE NOTED.
 - ALL EXTERIOR WALLS TO BE 4" OR 6" AND ALL INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-1B FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS.
 - SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.
 - SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS.
 - SEE DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.
 - ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED.
 - TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.
 - INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6'-11", 9' CEILING WILL BE 7'-11", 10' CEILING WILL BE 8'-3", UNLESS OTHERWISE NOTED.
 - ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED.
 - NON-BEARING WALLS OVER CONCRETE TO BE HELD 1/2" SHORT OF FRAMING ABOVE.


LEGEND	
	BEARING WALL
	NON BEARING WALL
	MASONRY WALL
	INDICATES BEARING FROM POINT-LOAD ABOVE
	JACKS
	BEAM/HEADER
	FOOTINGS/THICKENED SLAB
	STEEL COLUMN
	TRUSS TIE DOWN
	PORTAL FRAME
	JOIST/TRUSS
	LVL
	ENGINEERING PAGE NUMBER
	WINDOW/DOOR TAG
	PRECAST LINTEL TAG
-SEE FA DETAILS FOR FIRE ASSEMBLIES	
-SEE FC DETAILS FOR FRAMING CONNECTORS AND MATERIAL USAGE	

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.


IV-COMM-LOT-UNIT		RLH-VK-0023	
OWN-LOT	SEILING VILLAGE - 0023	APT. NO.	----
TREET ADDRESS	333 SOUTH BREEZE WAY	STATE	NC
ITY	DUJAY VARINA	ZIP	27526

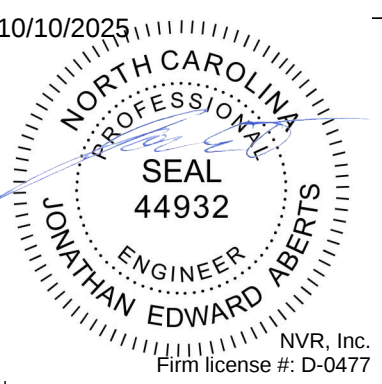


I, NVR, Inc., expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written consent of NVR, Inc.

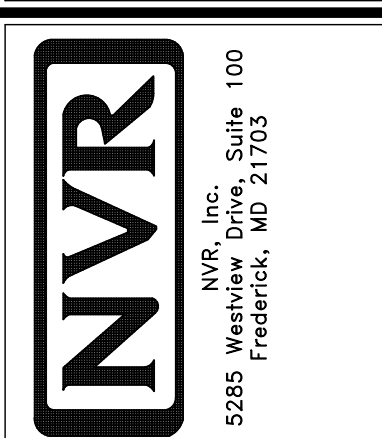

SHEET NO.	MODEL	SET NO. 68H00
	GRAND BAHAMA	VERSION 01
	DRAWING TITLE	RELEASE NO. ----
NC-7	FIRST FLOOR PLAN	DRAWN BY
		DATE:
	OPTION	
12		

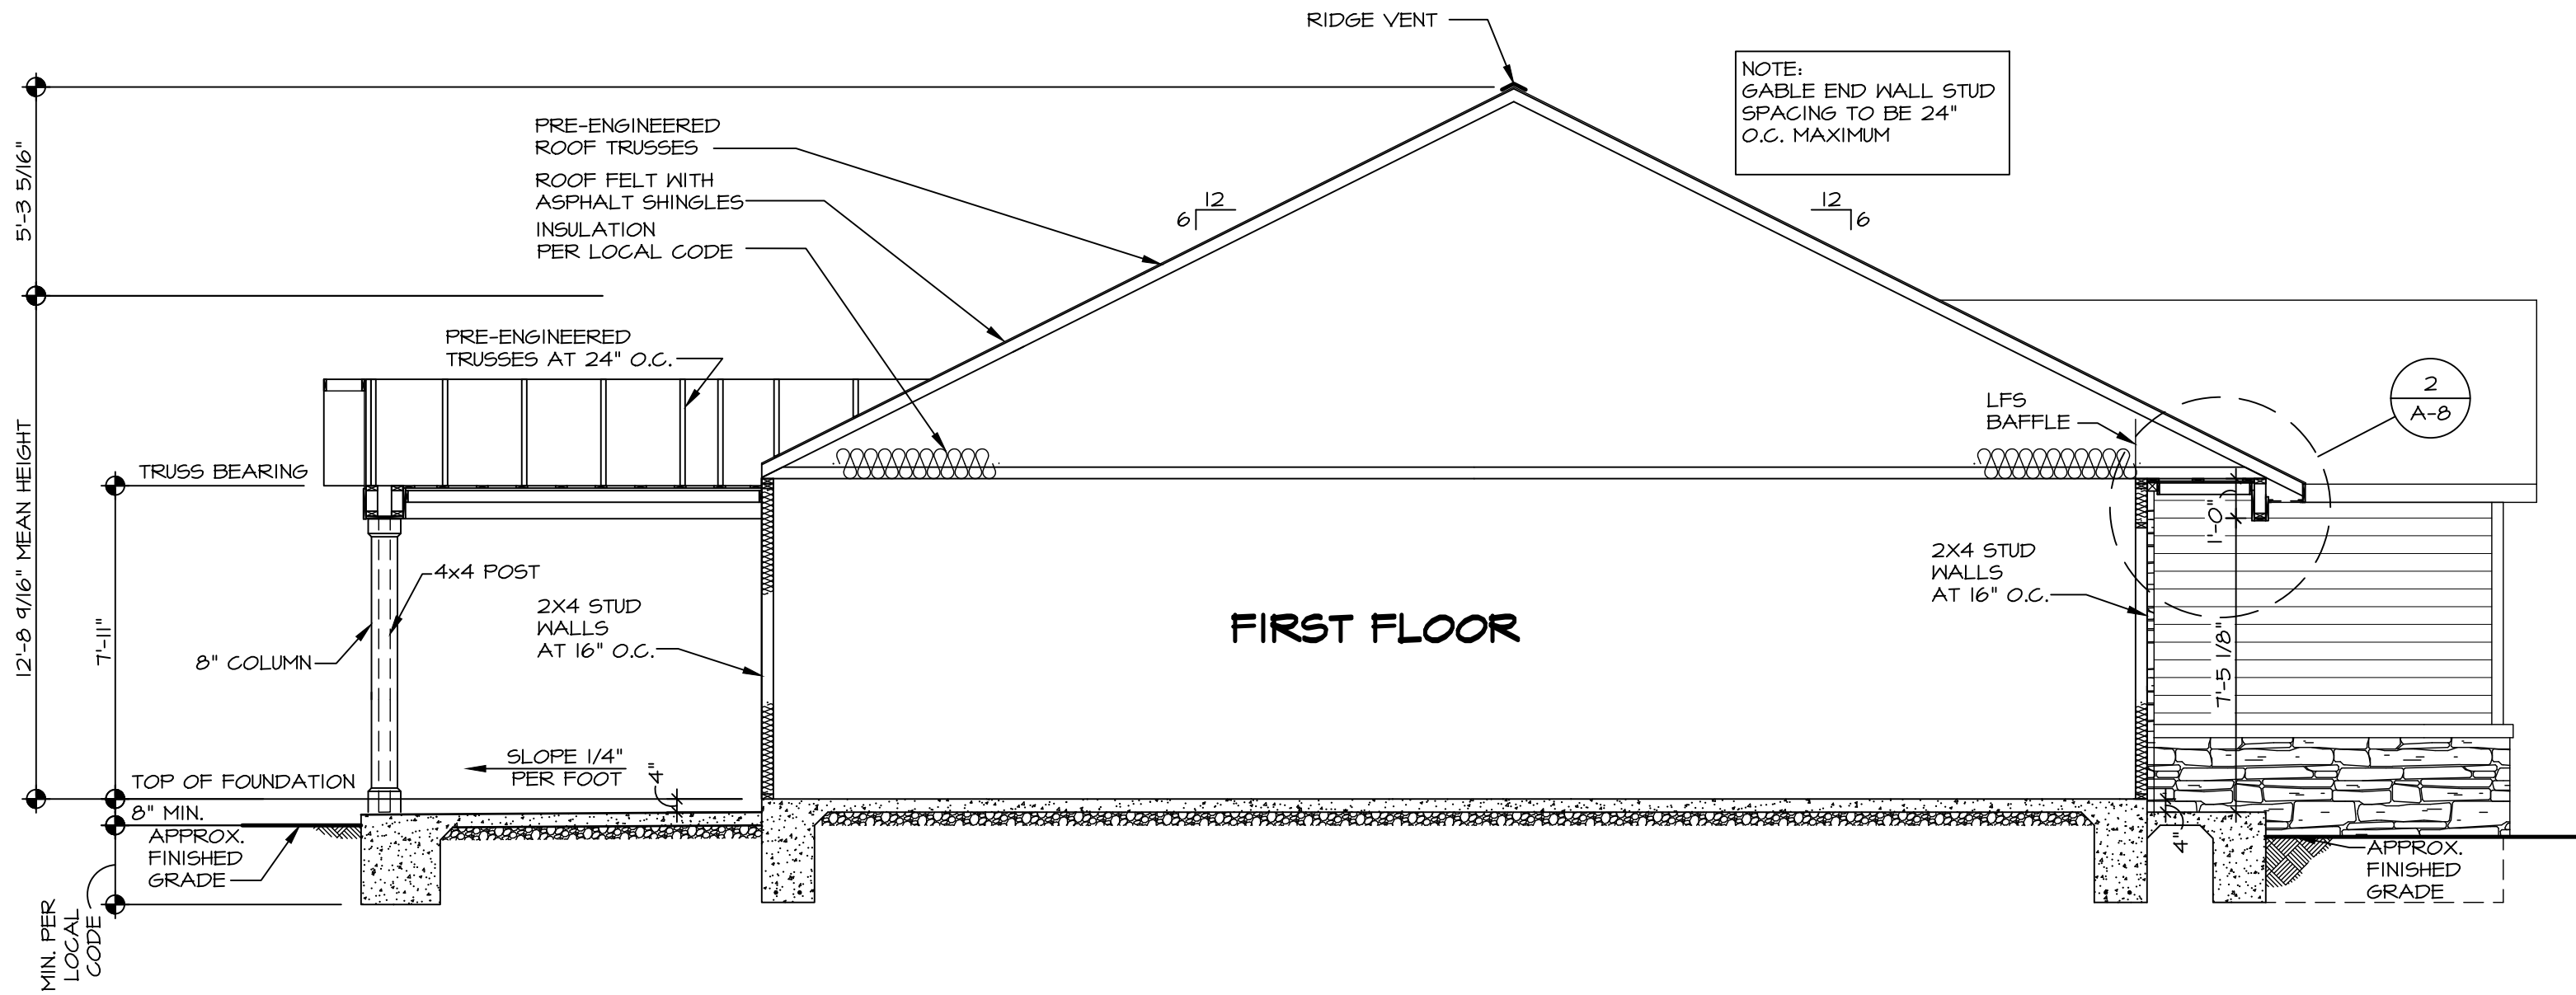

BUILDING SECTION - FOYER
SCALE: 1/4" = 1'-0"

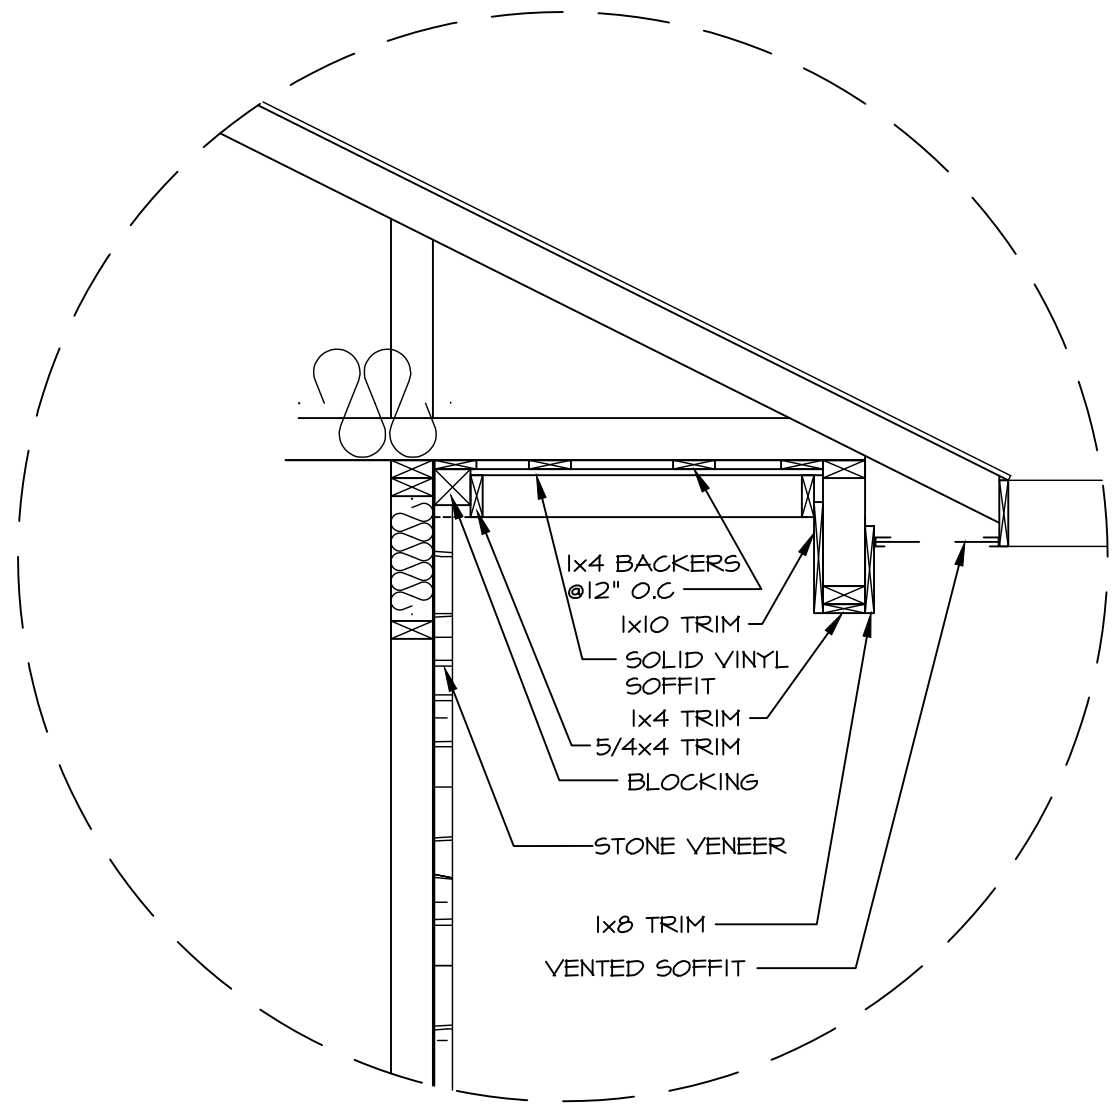

2 DETAIL
SCALE: 3/4" = 1'-0"

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.

James Bates
James Bates
10/10/2025

DIV-COMM-LOT-UNIT			
RLH-VK-0023			
COM-LOT			
KIPLING VILLAGE - 0023			
STREET ADDRESS			
939 SOUTH BREEZE WAY			
APT. NO.			


CITY			
FUGUAY VARINA			
STATE			
NC			
ZIP			
27526			

©NVR, Inc. expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or transmitted in any form or manner whatsoever, nor are they to be used for any purpose other than the first obtaining the expressed written consent of NVR, Inc.

NVR

NVR, Inc., Suite 100
5285 Westchase Lane
Frederick, MD 21703

SHEET NO. NC-8	MODEL GRAND BAHAMA		SET NO. 6BHO0
	DRAWING TITLE BUILDING SECTIONS		VERSION 01
	OPTION DESCRIPTION		RELEASE NO. ----
	13		DRAWN BY DATE: OPTION

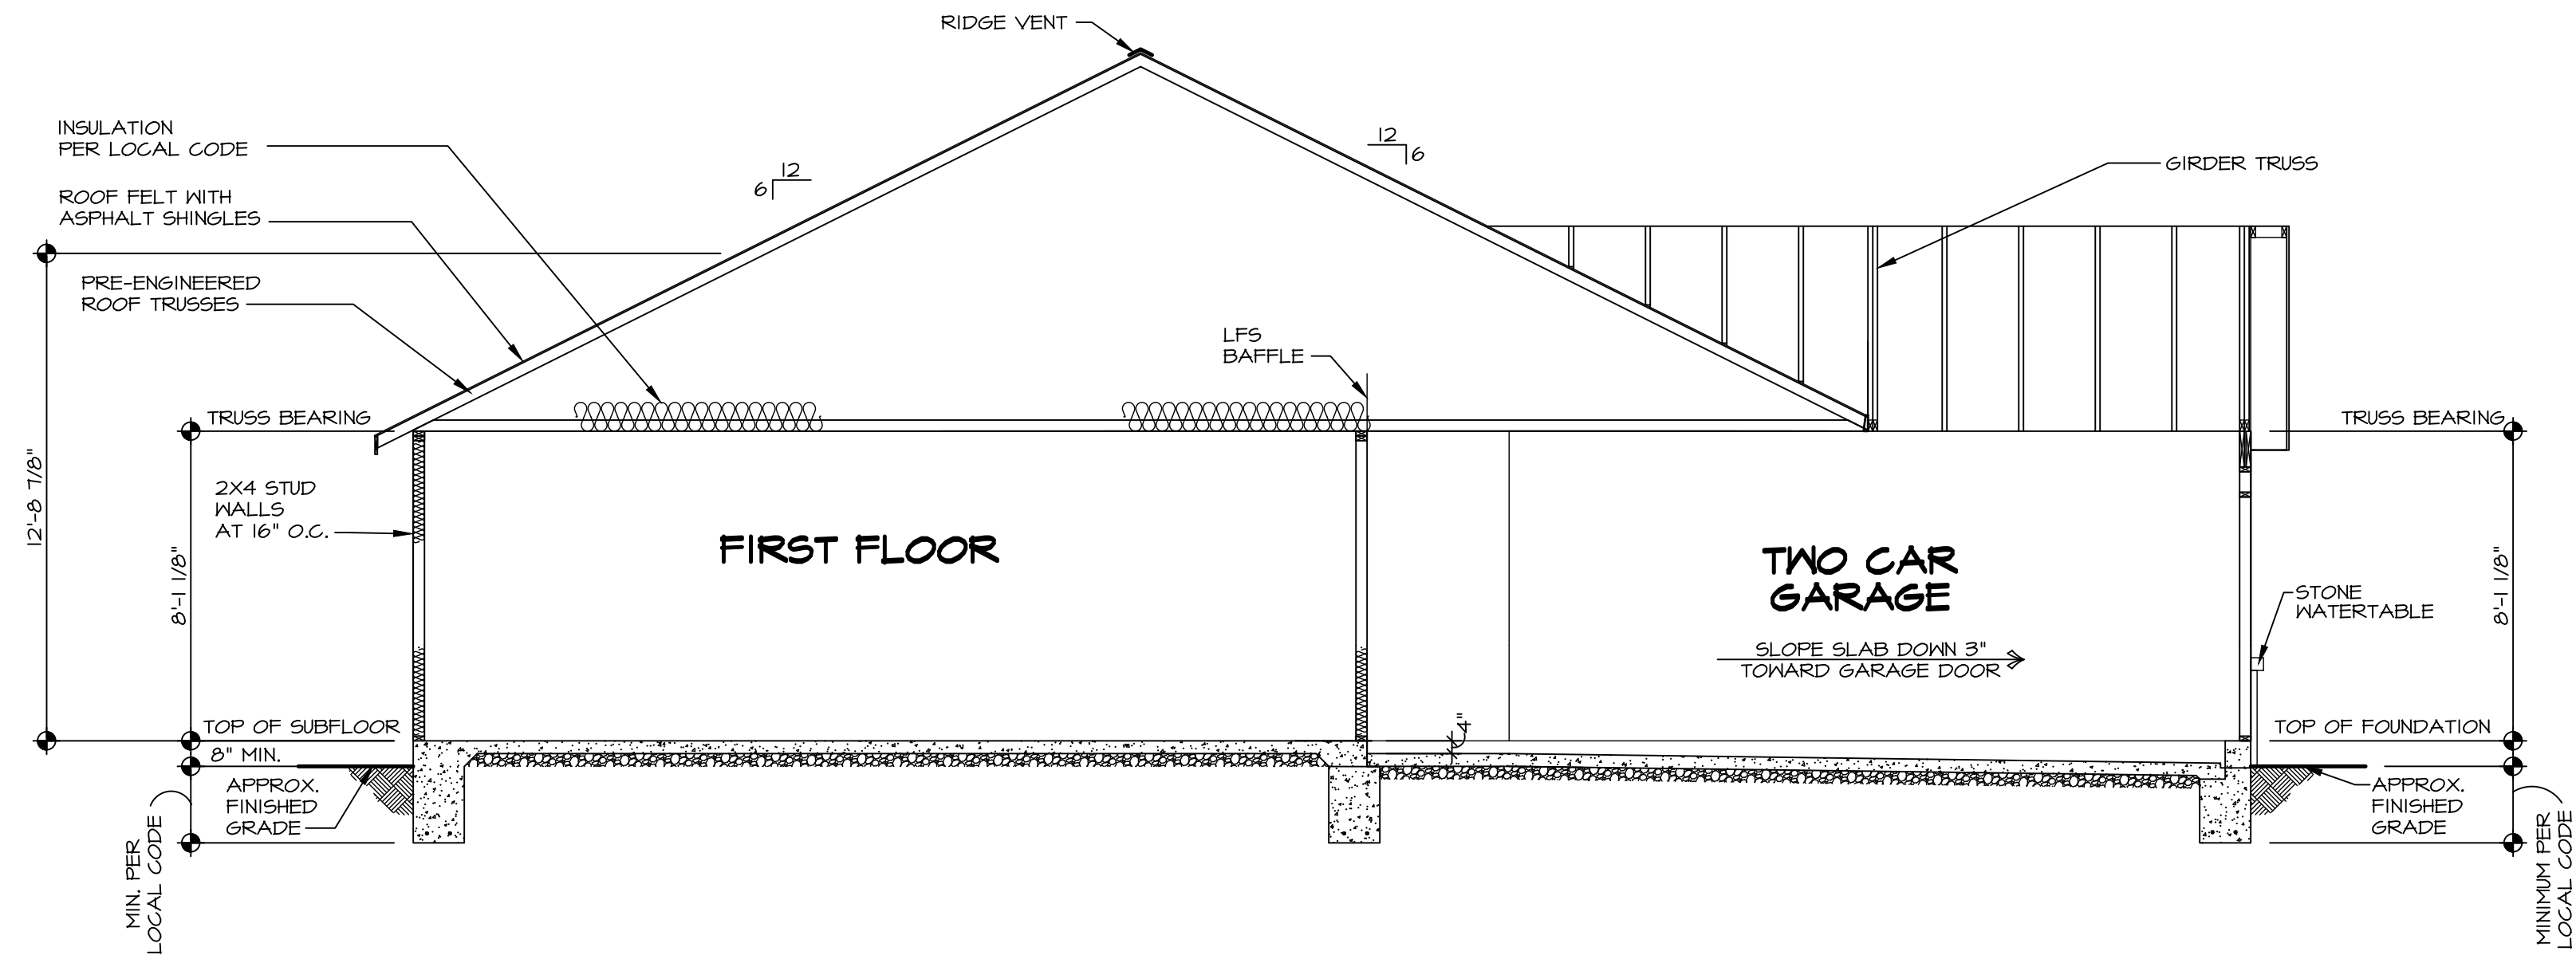


BUILDING SECTION - GARAGE
SCALE: 1/4" = 1'-0"

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.

James Bates
James Bates
10/10/2025










DIV-COMM-LOT-UNIT RLH-VK-0023			
COMM-LOT KIPLING VILLAGE - 0023			
STREET ADDRESS 939 SOUTH BREEZE WAY			
APT. NO. ----			
CITY FUGUAY VARINA		STATE NC	ZIP 27526

© NVR, Inc., expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or transmitted in any form or manner whatsoever, nor are they to be used for any purpose other than that first obtaining the expressed written consent of NVR, Inc.

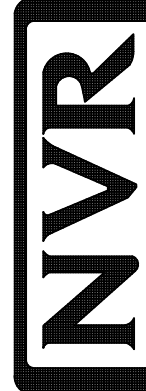

NVR, Inc., Suite 100
5285 Westwood Lane
Frederick, MD 21703

SHEET NO. NC-9	MODEL GRAND BAHAMA	SET NO. 6BHO0
	DRAWING TITLE BUILDING SECTIONS	VERSION 01
		RELEASE NO. ----
		DRAWN BY
		DATE:
	OPTION DESCRIPTION	OPTION
14		

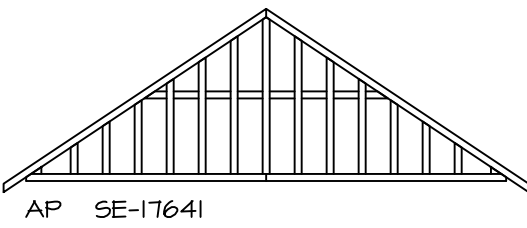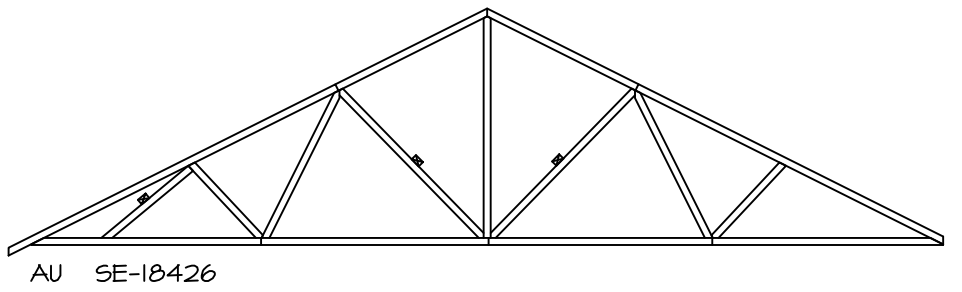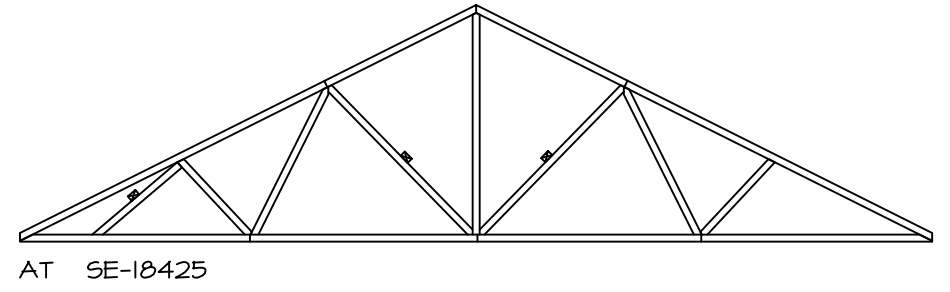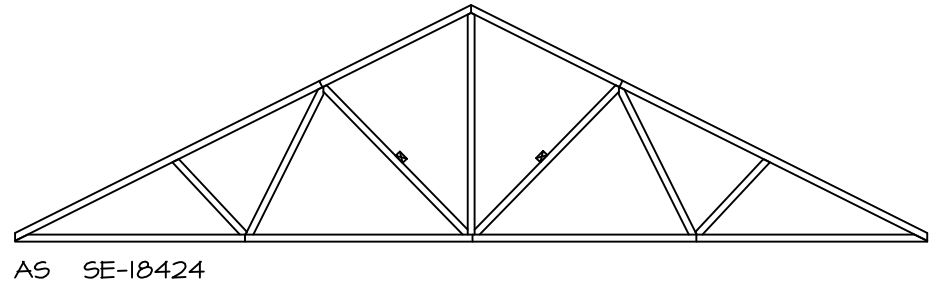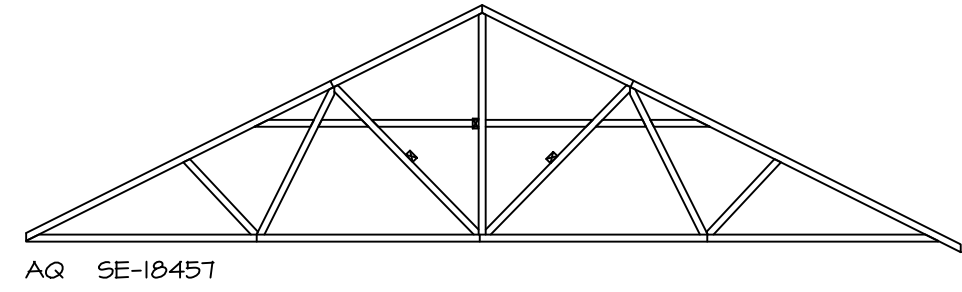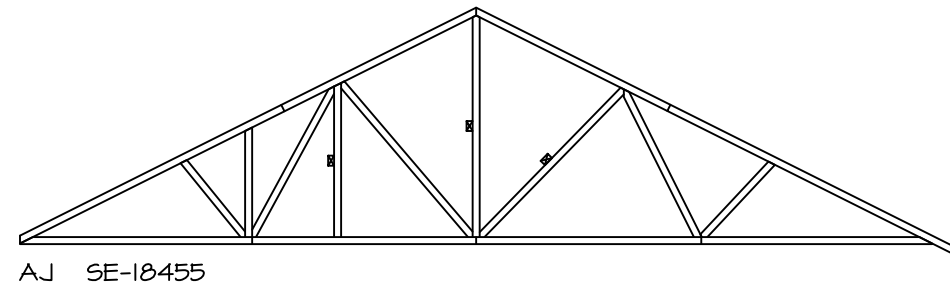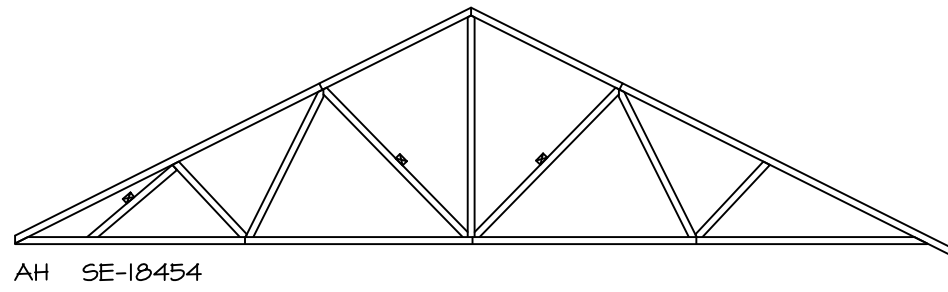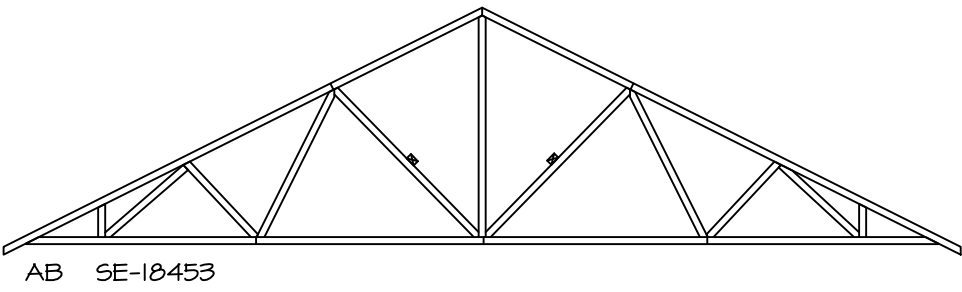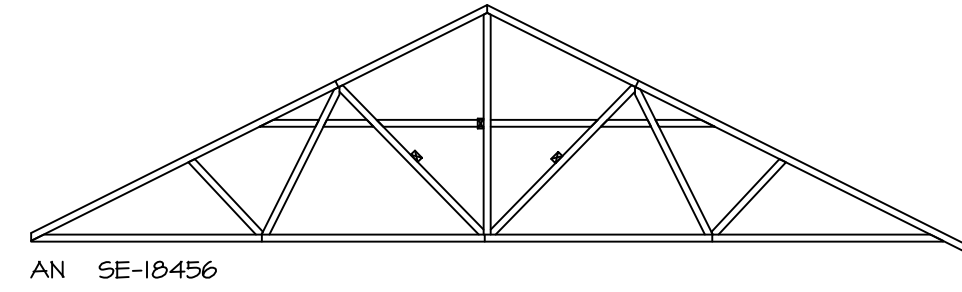

1
5-3

TRUSS BRACING DETAILS


SCALE: 1/8" = 1'-0"

TRUSS BRACING NOTES:


- IF TRUSS DOES NOT APPEAR ON THIS TRUSS BRACING SHEET, NO ADDITIONAL LATERAL BRACING IS REQUIRED.
- 2X4 SPF#2 LATERAL BRACES SHALL BE NAILED TO MINIMUM (3) TRUSS MEMBERS WITH MINIMUM (2) 10D NAILS. PROVISIONS MUST BE MADE AT ENDS OR SPECIFIED INTERVALS TO RESTRAIN OR ANCHOR LATERAL BRACING.
- WEB "T" BRACE, DETAIL 3(VRF-1c) IS REQUIRED WHERE LATERAL BRACING IS NOT CONTINUOUS ACROSS THREE (3) OR MORE TRUSSES AND MAY BE USED IN LIEU OF 2X4 LATERAL BRACINGS.
- DIAGONAL BRACING REQUIRED WHEN LATERAL BRACING IS REQUIRED (4(RF-1c)
- STUDDED GABLE BRACING DETAIL (1(VRF-1c) TO BE UTILIZED FOR TRUSSES 6'-9" IN HEIGHT OR GREATER.
- PARTIALLY SHEATHED GABLES, SEE (5(VRF-1c) FOR "L" BRACING WHEN REQUIRED.
- LATERAL BRACING CAN BE APPLIED TO EITHER SIDE OF THE WEB MEMBER IDENTIFIED IN THE DRAWING.
- SHEATHING (OSB OR GYPSUM) REPLACES LATERAL AND DIAGONAL TRUSS BRACINGS.

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.

IV-COMM-LOT-UNIT		RLH-VK-0023	
OWN-LOT	SIFLING VILLAGE - 0023		
TREET ADDRESS	APT. NO.	STATE	ZIP
333 SOUTH BREEZE WAY	----	NC	27526
ITT	TODJAY VARINA		

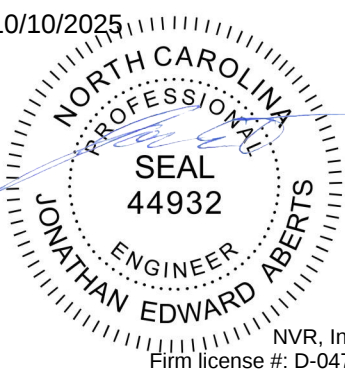


NVR, Inc.
Firm license #: D-0477

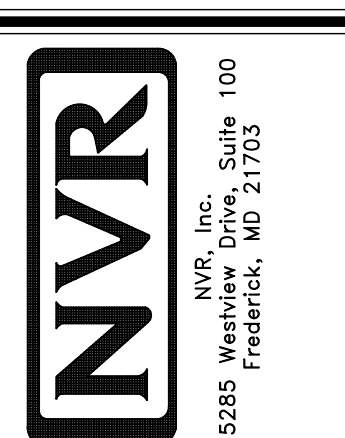

MODEL	SET NO. 06H00
GRAND BAHAMA	VERSION 01
DRAWING TITLE	RELEASE NO. ----
TRUSS BRACING	DRAWN BY
OPTION DESCRIPTION	DATE:
	OPTION
SHEET NO.	22
S-3	

BRACED WALL LINE SCHEDULE				
WIND SPEED (ULT)	IDENTIFIER	REQUIRED (FT)	ACTUAL (FT)	METHOD
130 MPH	BWL 100.00	4.97'	6.00'	CONTINUOUS (WITH GNB)
130 MPH	BWL 101.00	8.38'	38.01'	WSP (WITH GNB)
130 MPH	BWL 102.00	11.75'	16.46'	CONTINUOUS (WITH GNB)
130 MPH	BWL 103.00	4.70'	34.04'	WSP (WITH GNB)
130 MPH	BWL 104.00	7.38'	6.00'	ENGINEERED
130 MPH	BWL 105.00	5.40'	13.00'	WSP (WITH GNB)
130 MPH	BWL 106.00	6.21'	8.16'	CONTINUOUS (WITH GNB)
130 MPH	BWL 107.00	2.33'	4.00'	WSP (WITH GNB)

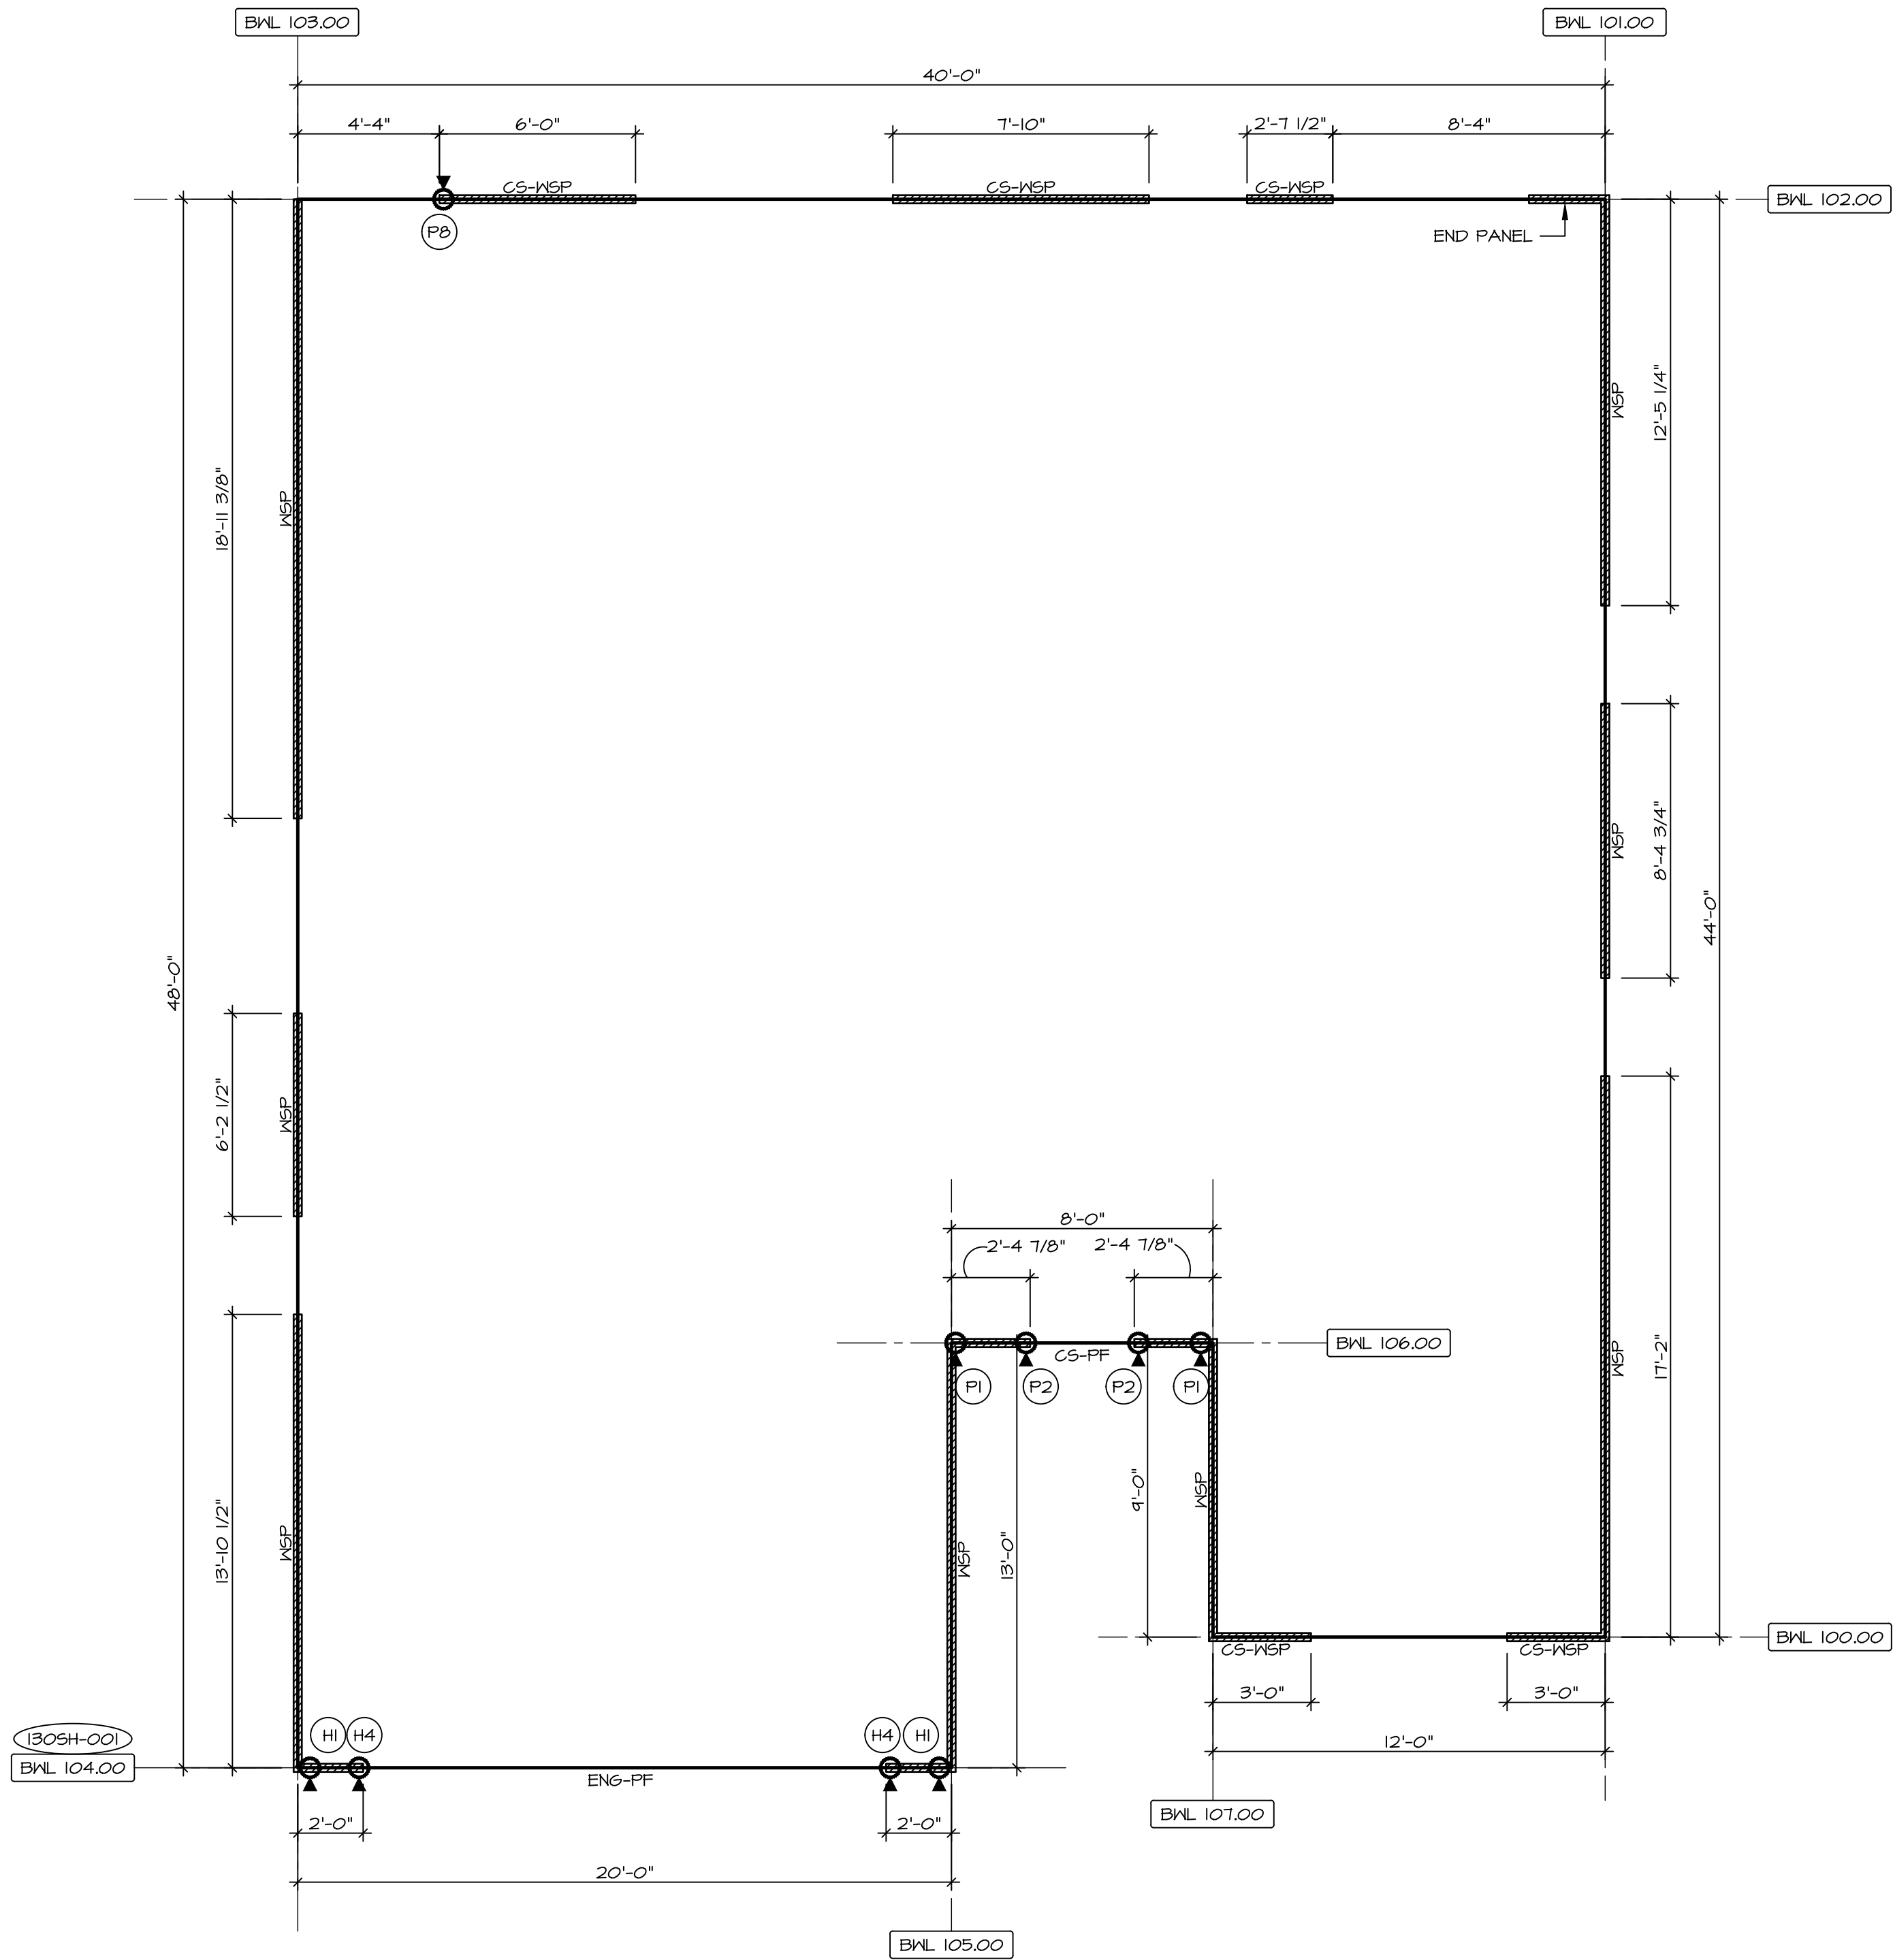

1
S-4
FIRST FLOOR BRACED WALL DETAIL
SCALE: 1/4" = 1'-0"


FASTENING SCHEDULE			
SHEATHING	FASTENER	SPACING	
		EDGES	FIELD
PREScriptive 7/16" WOOD STRUCTURAL PANELS OR EQUIVALENT (W METHOD WSP, CS-WSP, CS-G)	8d COMMON NAILS	6" O.C.	6" O.C.
ENGINEERED 7/16" WOOD STRUCTURAL PANELS (W METHOD ENG-WSP-A, ENG-WSP-B, ENG-WSP-C)	ALTERNATIVE FASTENER 1-3/4" 16-GAUGE CORROSION RESISTANT STAPLES	3" O.C.	6" O.C.
	A - 8d COMMON NAILS	4" O.C.	6" O.C.
	A - 1-3/4" 16-GAUGE CORROSION RESISTANT STAPLES	3" O.C.	6" O.C.
	B - 8d COMMON NAILS*	3" O.C.	6" O.C.
	B - 1-3/4" 16-GAUGE CORROSION RESISTANT STAPLES	N/A	6" O.C.
	C - 8d COMMON NAILS* SHEATHING ON BOTH SIDES OF THE WALL	3" O.C.	6" O.C.
1/2" GYPSUM WALL BOARD (W METHOD GB-1, GB-2, ENG-GBI-A)	C - 1-3/4" 16-GAUGE CORROSION RESISTANT STAPLES SHEATHING ON BOTH SIDES OF THE WALL	N/A	6" O.C.
	1-1/4" LONG, 1/4" HEAD, .048" DIA. ANNULAR-RINGED NAILS CORROSION RESISTANT TYPE IN 1-1/4" DRYWALL SCREWS	7" O.C.	7" O.C.
1/2" GYPSUM WALL BOARD (W METHOD GB-1, GB-2, ENG-BW)	BLOCKING REQUIRED AT ALL GYPSUM EDGES. USE CORROSION RESISTANT TYPE IN 1-1/4" DRYWALL SCREWS	4" O.C.	12" O.C.

BRACING LEGEND			
BWL XXX.XX	BRACED WALL LINE I.D.		
---	BRACED WALL LINE		
---	HOUSE WALL		
///	BRACED WALL PANEL		
(X)	ENGINEERING PAGE NUMBER		
WSP	WOOD STRUCTURAL PANEL		
GB	GYPSUM BOARD (1) SIDED OR (2) SIDED		
GB-BW	GYPSUM BOARD BLOCKED WALL CONSTRUCTION (1) SIDED OR (2) SIDED (SEE STANDARD DETAIL G /WB-2)		
LIB	LET-IN BRACING (SEE STANDARD DETAIL F /WB-2)		
CS-WSP	CONTINUOUS SHEATHING - WOOD STRUCTURAL PANEL		
CS-PF	CONTINUOUS SHEATHING - PORTAL FRAME. SEE FLOOR PLANS FOR PORTAL FRAME HEADER INFORMATION (SEE STANDARD DETAIL A, C /WB-2)		
CS-G	CONTINUOUS SHEATHING - WOOD STRUCTURAL PANEL ADJACENT TO GARAGE OPENINGS		
ENG-WSP-A	ENGINEERED DESIGN W/ WALL STRUCTURAL PANEL SHEATHING TYPE 'A' FASTENING REQUIREMENTS (NO HOLD DOWNS REQUIRED UNLESS NOTED)		
ENG-WSP-B	ENGINEERED DESIGN W/ WALL STRUCTURAL PANEL SHEATHING TYPE 'B' FASTENING REQUIREMENTS (NO HOLD DOWNS REQUIRED UNLESS NOTED)		
ENG-WSP-C	ENGINEERED DESIGN W/ WALL STRUCTURAL PANEL SHEATHING ON BOTH SIDES OF THE WALL TYPE 'C' FASTENING REQUIREMENTS (NO HOLD DOWNS REQUIRED UNLESS NOTED)		
ENG-PF	ENGINEERED DESIGN W/ PORTAL FRAME. SEE FLOOR PLANS FOR PORTAL FRAME HEADER INFORMATION (SEE STANDARD DETAIL PAGE WB-1)		
ENG-GBI-A	ENGINEERED DESIGN W/ (1) SIDED GYPSUM BOARD TYPE 'A' FASTENING REQUIREMENTS		
ENG-GBI-B	ENGINEERED DESIGN W/ (1) SIDED GYPSUM BOARD TYPE 'B' FASTENING REQUIREMENTS		
ENG-BW	ENGINEERED DESIGN W/ (1) SIDED GYPSUM BOARD W/ BLOCK WALL CONSTRUCTION (SEE STANDARD DETAIL I /WB-1)		
HO	HOLD-DOWN 1. SEE SHEET WB-2 FOR "P-" INDICATOR SCHEDULE AND DETAILS 2. SEE SHEET WB-1 FOR "H-" INDICATOR SCHEDULE AND DETAILS 3. ARROW INDICATES LOCATION.		


NOTES:			
HOUSE HAS BEEN ANALYZED UTILIZING A PRESCRIPTIVE METHOD IN COMPLIANCE WITH INTERNATIONAL RESIDENTIAL CODES (IRC) UNLESS OTHERWISE NOTED. ENGINEERED WALL LINES ARE IN COMPLIANCE WITH INTERNATIONAL BUILDING CODES (IBC).			

As directed by the North Carolina Board of Architecture and Registered Interior Designers, architectural seals are not required for – and should not be placed by NVR on – these plans and specifications.


IV-COMM-LOT-UNIT	RLH-VK-0023
ONM-LOT	SIPLING VILLAGE - 0023
TREET ADDRESS	333 SOUTH BREEZE WAY
APT. NO.	----
IT	STATE NC
QUAY VARINA	ZIP 21526

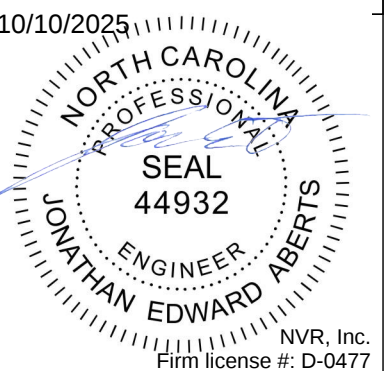

NVR, Inc. expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written consent of NVR, Inc.

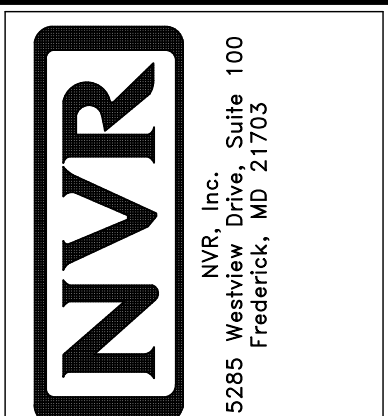

MODEL	GRAND BAHAMA	SET NO. 6BHO0	VERSION 01	RELEASE NO. ----
DRAWING TITLE	WALL BRACING DETAILS	DRAWN BY	DATE:	OPTION
OPTION DESCRIPTION				
SHEET NO.	S-4			23

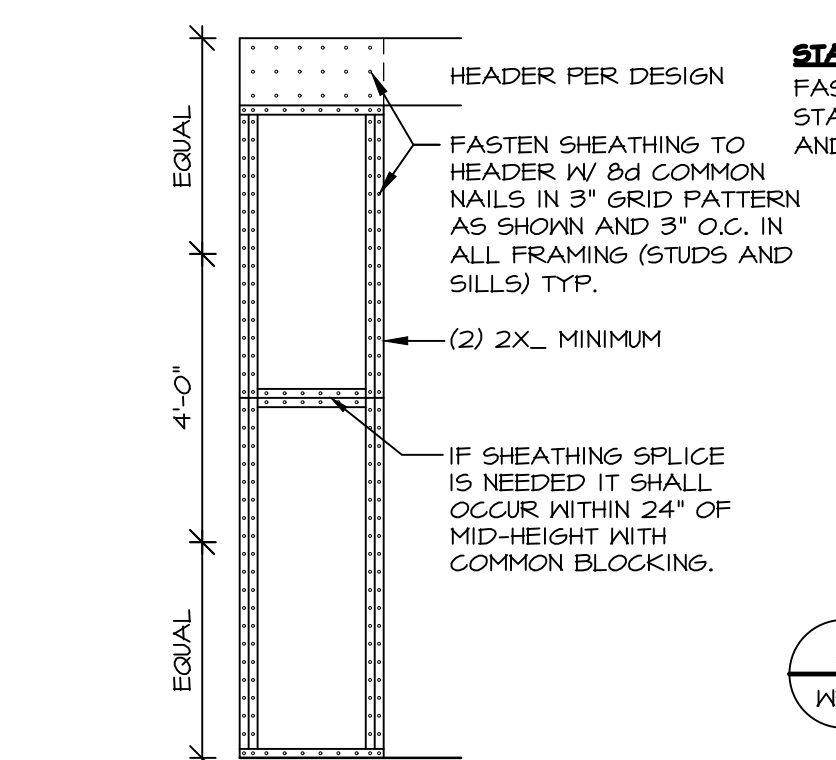

SHEATHING AT HEADER / PANEL CONNECTION

TP31 TIE PLATE AT INTERSECTION OF PANELS (WHERE APPLICABLE) PER ENGINEERED DESIGN

FASTEN SHEATHING CONTINUOUSLY ACROSS PANEL AND HEADER. FASTEN SHEATHING TO HEADER USING (4) ROWS OF 8d NAILS AT 3" O.C. (IN A 3" GRID PATTERN) AND TO ALL OTHER FRAMING MEMBERS AT 3" O.C. (TYP.)


FASTEN HEADER TO TOP PLATE WITH (2) ROWS OF 16d SINKERS AT 3" O.C. (TYP.)

1000 LB. LSTA24 HEADER STRAP TO JACK STUD, INSTALLED ON INTERIOR SIDE OF PANEL

MIN. (2) 2 x 4


ENGINEERED PORTAL: TYP. HEADER / PANEL CONNECTION

SCALE 3/8" = 1'-0"

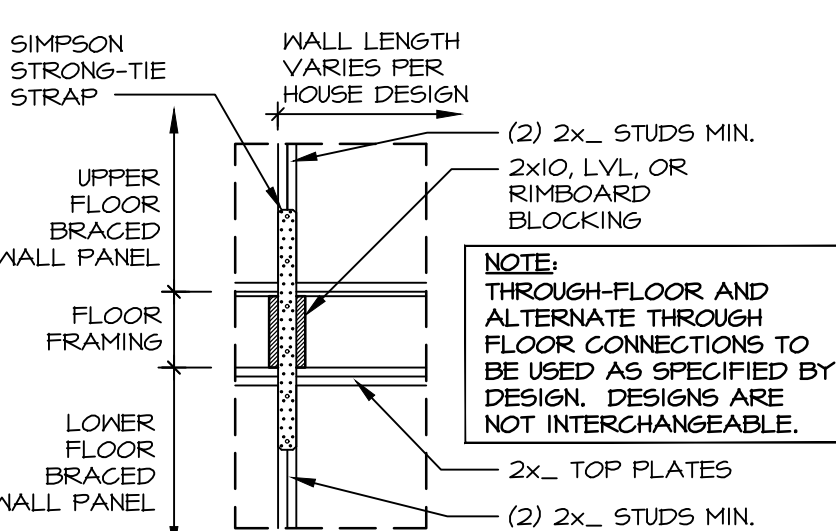


THROUGH-FLOOR CONNECTION

SCALE 3/8" = 1'-0"

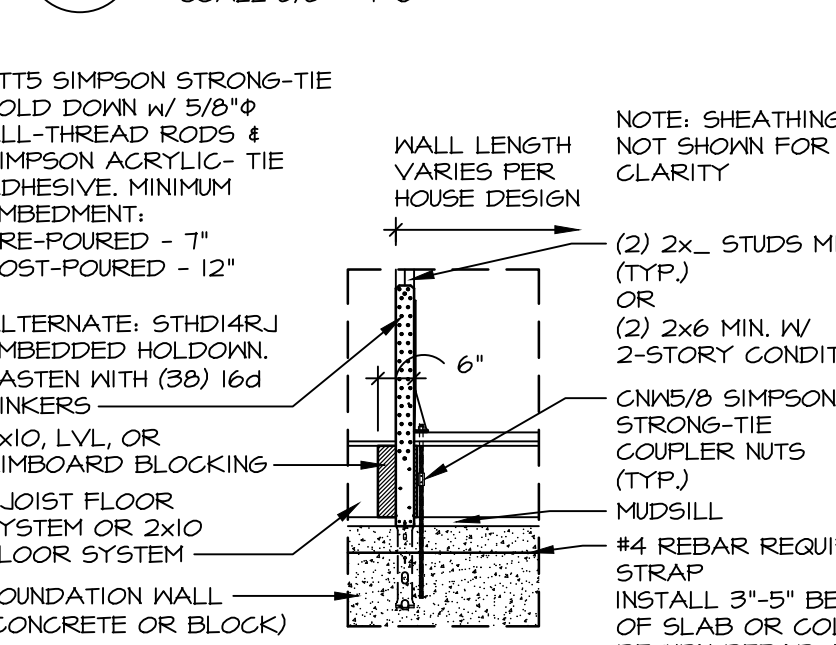

HOLD-DOWN DETAIL: FRAMED FLOOR

SCALE 3/8" = 1'-0"

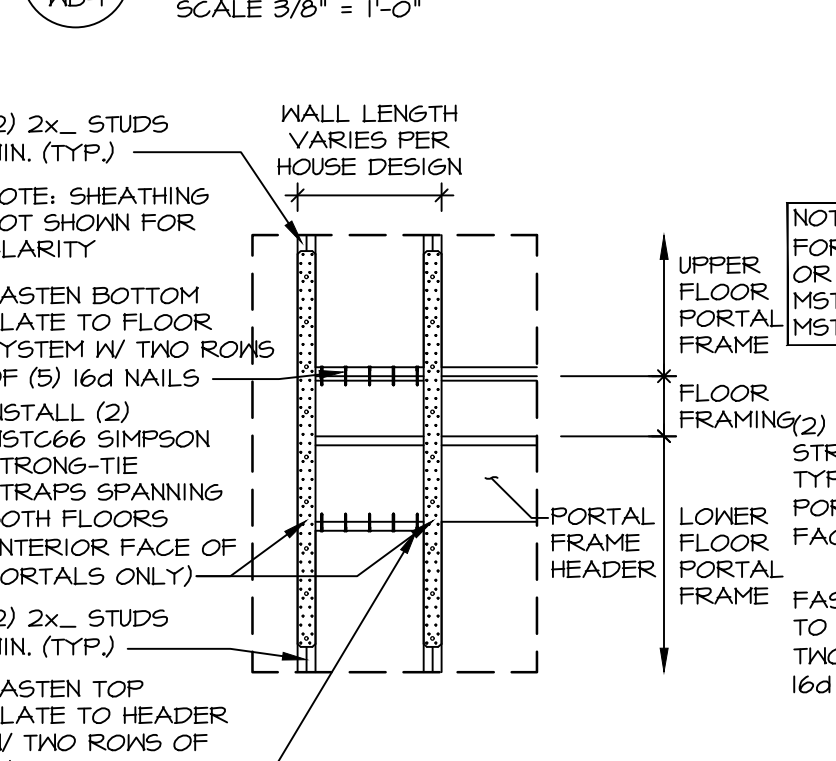

CONNECTING PORTALS BETWEEN FLOORS

SCALE 3/8" = 1'-0"

STAPLE FASTENING ENGINEERED ALTERNATIVE

FASTEN SHEATHING TO HEADER USING 16 GAUGE, 1.75" Lx6" STAPLES (MIN. 7/16" CROWN) IN A 15" X 3" GRID PATTERN AND TO ALL OTHER FRAMING MEMBERS AT 1/2" O.C. (TYP.)

LSTA24 SIMPSON STRONG-TIE STRAP (TYP.)

FASTEN TOP PLATE TO HEADER W/ TWO ROWS OF (5) 16d NAILS

NOTE: SHEATHING NOT SHOWN FOR CLARITY. SEE DETAIL 1 FOR MORE INFO.

HEADER PER DESIGN

(2) 2x6 MINIMUM

IF SHEATHING SPLICE IS NEEDED IT SHALL OCCUR WITHIN 24" OF MID-HEIGHT WITH COMMON BLOCKING.

2

SCALE 3/8" = 1'-0"

STRAP NOT REQUIRED TO ATTACH TO THE TOP PLATES

FIELD FASTEN LOOSE SHIPPED SHEATHING CONTINUOUSLY ACROSS PANELS AND HEADER. FASTEN SHEATHING TO HEADER USING (4) ROWS OF 8d NAILS AT 3" O.C. (IN A 3" GRID PATTERN) AND TO ALL OTHER FRAMING MEMBERS AT 3" O.C. (TYP.)

FASTEN HEADER TO TOP PLATE WITH (2) ROWS OF 16d SINKERS AT 3" O.C. (TYP.)

1000 LB. LSTA24 HEADER STRAP TO JACK STUD, INSTALLED ON INTERIOR SIDE OF PANEL. STRAP OVERLAP JACKS BY 12" MINIMUM

SIMPSON MST40 HEADER STRAP (CAPACITY = 5140) TO JACK STUD, STRAP ON BOTH SIDES OF OPENING, INSTALLED ON INTERIOR SIDE OF PANEL. STRAP OVERLAP JACKS BY 12" MINIMUM

12'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT


10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

10'-0" MAX. HEIGHT

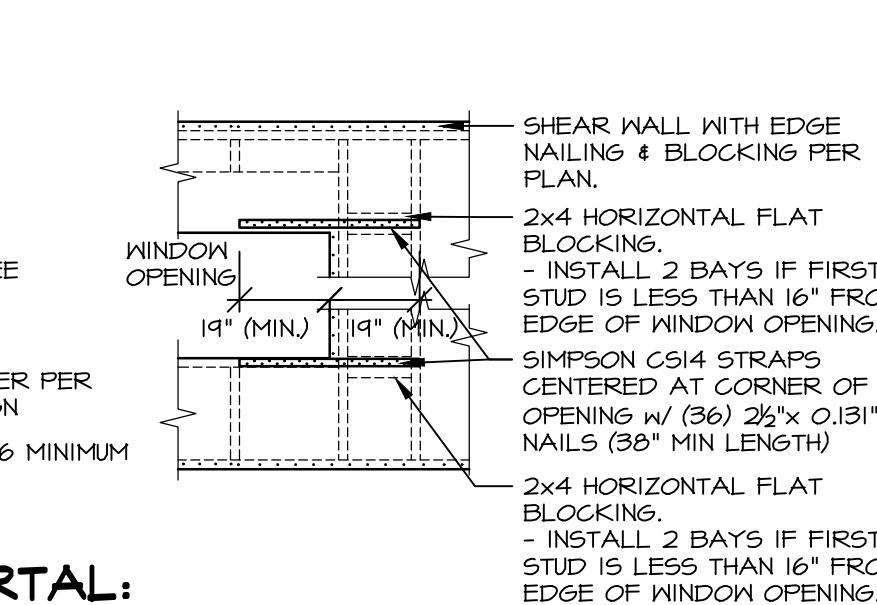

FRAMED FLOOR CONNECTION

SCALE 3/8" = 1'-0"

(2) 2x STUDS MIN. FOR ATTACHMENT

MIN. 6 TO LB. FRAMING ANCHORS (LTP4 TYP. - ANY ORIENTATION PERMITTED). INSTALL (2) PER PANEL AS SHOWN

NAIL SILL PLATE TO JOIST PER IRC TABLE R602.3(1)

FLOOR FRAMING

2ND ROW OF BLOCKING ONLY REQUIRED W/ OVERHEIGHT PANELS

NO. 6 - 1 1/4" SCREWS SPACED AT 4" O.C. AT ALL EDGES AND 12" O.C. IN THE FIELD

1/2" GYPSUM BOARD

FIELD INSTALLED: MIN. 2x4 BLOCKING AT MIDPOINT OF PANEL W/ 8'-0" OR 9'-0" CEILING (48" OR 54" GYPSUM BOARD)

INTERIOR

17

NOT TO SCALE

1/2" FILLER

MST SIMPSON STRONG-TIE GIRDER TIEDOWN

HTT5 SIMPSON STRONG-TIE HOLD DOWN W/ 5/8" ALL-THREAD ROD

NOTE: SHEATHING NOT SHOWN FOR CLARITY

(2) 2x STUDS MIN. (TYP.)

NOTE: THROUGH-FLOOR AND ALTERNATE THROUGH FLOOR CONNECTIONS TO BE USED AS SPECIFIED BY DESIGN. DESIGNS ARE NOT INTERCHANGEABLE.

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL



UPLIFT AT LVL CONNECTION

SCALE 3/8" = 1'-0"

(2) 2x STUDS MIN. (TYP.)

NOTE: THROUGH-FLOOR AND ALTERNATE THROUGH FLOOR CONNECTIONS TO BE USED AS SPECIFIED BY DESIGN. DESIGNS ARE NOT INTERCHANGEABLE.

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL


2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

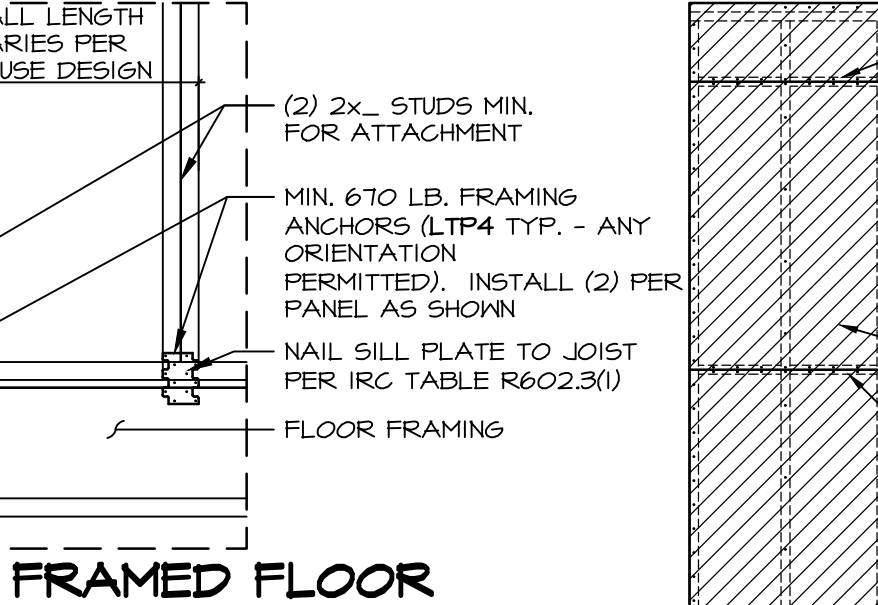

BLOCKED WALL CONSTRUCTION

SCALE 3/8" = 1'-0"

(2) 2x STUDS MIN. (TYP.)

NOTE: THROUGH-FLOOR AND ALTERNATE THROUGH FLOOR CONNECTIONS TO BE USED AS SPECIFIED BY DESIGN. DESIGNS ARE NOT INTERCHANGEABLE.

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL


2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

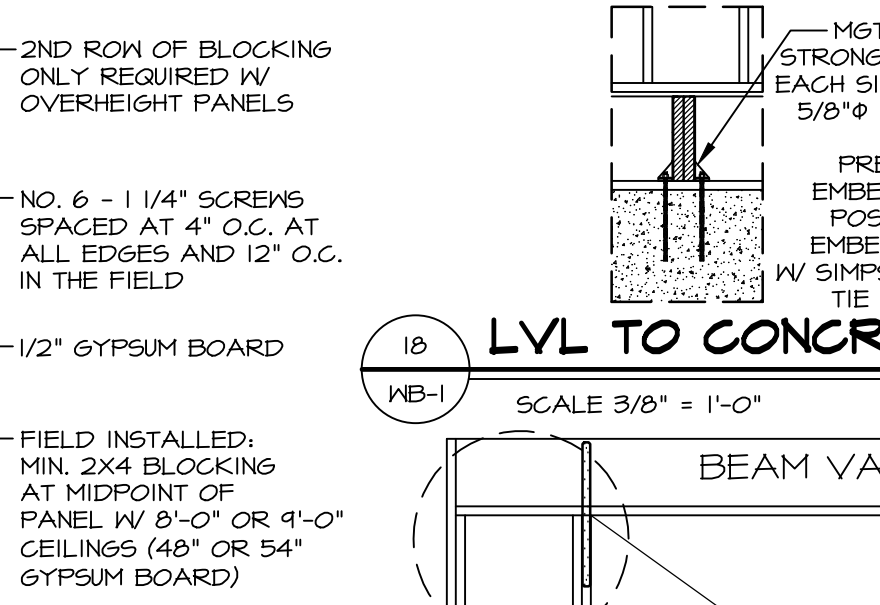

FLUSH LVL BEAM CONNECTION

SCALE 3/8" = 1'-0"

(2) 2x STUDS MIN. (TYP.)

NOTE: THROUGH-FLOOR AND ALTERNATE THROUGH FLOOR CONNECTIONS TO BE USED AS SPECIFIED BY DESIGN. DESIGNS ARE NOT INTERCHANGEABLE.

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL


2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

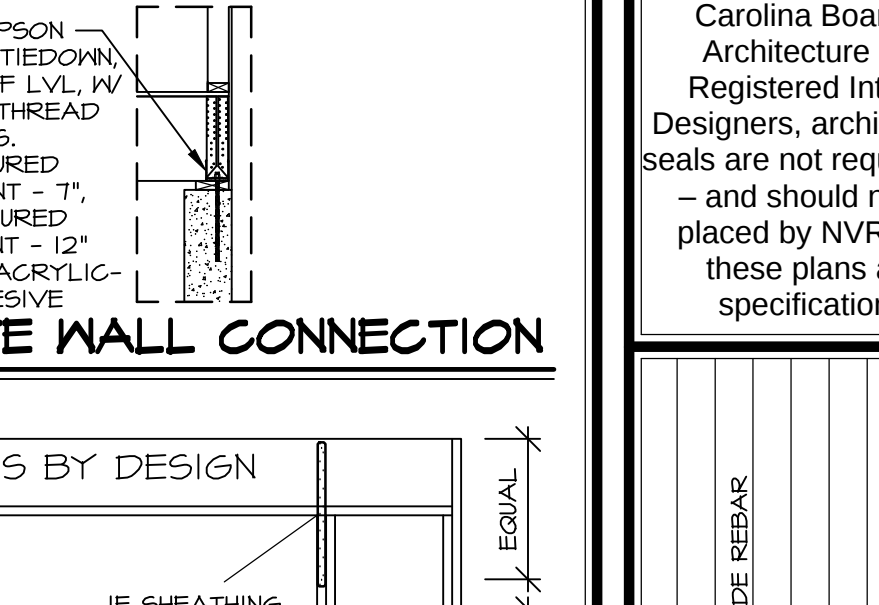

ENGINEERED STACKED PORTAL

SCALE 3/8" = 1'-0"

(2) 2x STUDS MIN. (TYP.)

NOTE: THROUGH-FLOOR AND ALTERNATE THROUGH FLOOR CONNECTIONS TO BE USED AS SPECIFIED BY DESIGN. DESIGNS ARE NOT INTERCHANGEABLE.

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

LOWER FLOOR BRACED WALL PANEL

WALL LENGTH VARIES PER HOUSE DESIGN

1000 LB. STRAP (LSTA36) TO JACK STUD, EACH END OF WALL LINE. INSTALLED ON EXTERIOR SIDE OF PANEL

2x TOP PLATES

UPPER FLOOR BRACED WALL PANEL

FLOOR FRAMING

