

1
5-3

TRUSS BRACING DETAILS

SCALE: 1/4" = 1'-0"

TRUSS BRACING NOTES:

- IF TRUSS DOES NOT APPEAR ON THIS TRUSS BRACING SHEET, NO ADDITIONAL LATERAL BRACING IS REQUIRED.
- 2X4 SPF#2 LATERAL BRACES SHALL BE NAILED TO MINIMUM (3) TRUSS MEMBERS WITH MINIMUM (2) 10D NAILS. PROVISIONS MUST BE MADE AT ENDS OR SPECIFIED INTERVALS TO RESTRAIN OR ANCHOR LATERAL BRACING.
- WEB "T" BRACE, DETAIL 3(RF-1c) IS REQUIRED WHERE LATERAL BRACING IS NOT CONTINUOUS ACROSS THREE (3) OR MORE TRUSSES AND MAY BE USED IN LIEU OF 2X4 LATERAL BRACINGS.
- DIAGONAL BRACING REQUIRED WHEN LATERAL BRACING IS REQUIRED (4(RF-1c))
- STUDDED GABLE BRACING DETAIL 1(RF-1c) TO BE UTILIZED FOR TRUSSES 6'-9" IN HEIGHT OR GREATER.
- PARTIALLY SHEATHED GABLES, SEE 5(RF-1c) FOR "L" BRACING WHEN REQUIRED.
- LATERAL BRACING CAN BE APPLIED TO EITHER SIDE OF THE WEB MEMBER IDENTIFIED IN THE DRAWING.
- SHEATHING (OSB OR GYPSUM) REPLACES LATERAL AND DIAGONAL TRUSS BRACINGS.

SHEET NO.	MODEL	SET NO.	GRAND BAHAMA
S-3	GRAND BAHAMA	VERSION 01	
	DRAWING TITLE	RELEASE NO.	----
	TRUSS BRACING	DRAWN BY	
		DATE:	
	OPTION DESCRIPTION	OPTION	
22			

NVR
NVR, Inc., Suite 100 5285 Westview Dr. Frederick, MD 21703

NVR, Inc., expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, stored in a retrieval system, or transmitted in any form or manner whatsoever, nor are they to be used for any purpose other than that first obtaining the expressed written consent of NVR, Inc.

DIV-COMM-LOT-UNIT

COM-LOT

STREET ADDRESS
939 SOUTH BREEZE WAY

CITY
FUGUAY VARINA

STATE
NC

ZIP
27526


RLH-VK-0023

APT. NO.

Job	Truss	Truss Type	Qty	Ply	10_Southeast	I49147390
ORDERS	SE-14544	COMN	1	1	Job Reference (optional)	

NVR, Frederick, MD - 21703,

8.530 s Nov 29 2021 MiTek Industries, Inc. Tue Dec 7 20:30:24 2021 Page 1
ID:RrLVUNcBotMPeFP6cfGVKyElz_-drnYGGGrXdjJPOJLLzF6lUyAJmzsf3dn5?sstyBF8z



4x6 =

Scale = 1:29.1

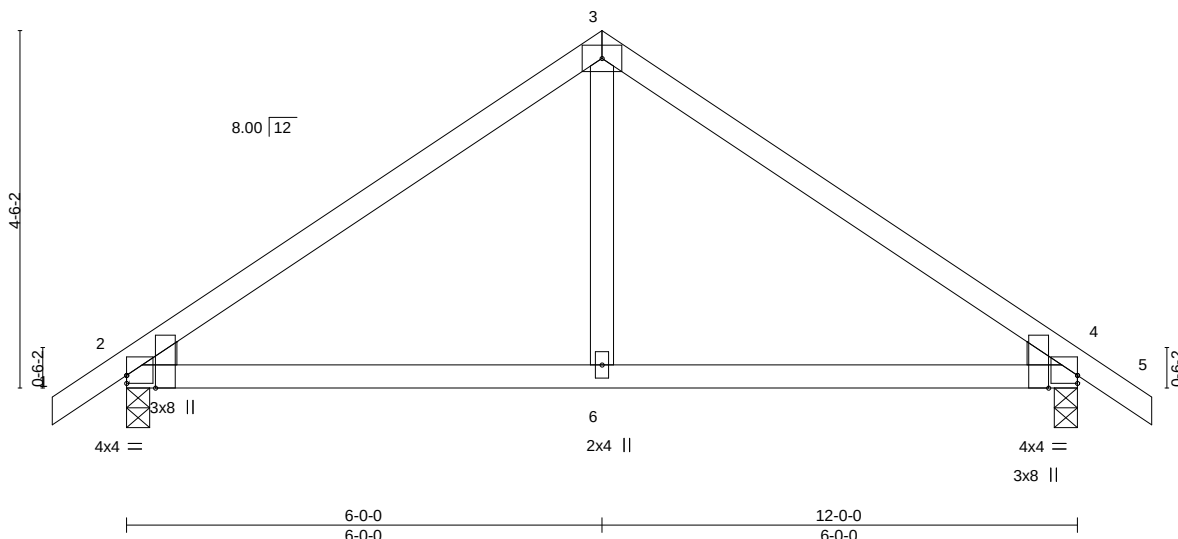


Plate Offsets (X,Y)--		[2:0-0-0,0-1-3], [2:0-1-15,Edge], [4:0-0-0,0-1-3], [4:0-1-15,Edge]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.15	TC 0.49
TCDL 10.0	Lumber DOL	1.15	BC 0.38
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11
BCDL 10.0	Code	IBC2021/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.03 2-6 >999 360
			Vert(CT) -0.06 2-6 >999 240
			Horz(CT) 0.01 4 n/a n/a
			Wind(LL) 0.03 2-6 >999 240
			PLATES
			MT20
			GRIP
			197/144
			Weight: 50 lb FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3 or 2x4 SPF Stud
WEDGE

Left: 2x4 SP or SPF No.3 or Stud, Right: 2x4 SP or SPF No.3 or Stud

REACTIONS.

(size) 2=0-3-8, 4=0-3-8
Max Horz 2=118(LC 9)
Max Uplift 2=-79(LC 10), 4=-79(LC 11)
Max Grav 2=533(LC 1), 4=533(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-558/86, 3-4=-558/86
BOT CHORD 2-6=-1/377, 4-6=-1/377
WEBS 3-6=0/286

NOTES- (6-8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 79 lb uplift at joint 2 and 79 lb uplift at joint 4.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	10_Southeast	
ORDERS	SE-14545	COMN	1	1		I49147391

NVR, Frederick, MD - 21703,

8.530 s Nov 29 2021 MiTek Industries, Inc. Tue Dec 7 20:30:25 2021 Page 1
ID:RrLVUNcBotMPeFP6cfGVkyElz_-51O9lcHTHwra1YuXvgnuuey19Tj4zb5Hm0IIPOJyBF8y

0-11-4 5-1-3 10-0-0 14-10-13 20-0-0 20-11-4
0-11-4' 5-1-3' 4-10-13' 4-10-13' 5-1-3' 0-11-4'

4x6 ||

Scale = 1:44.6

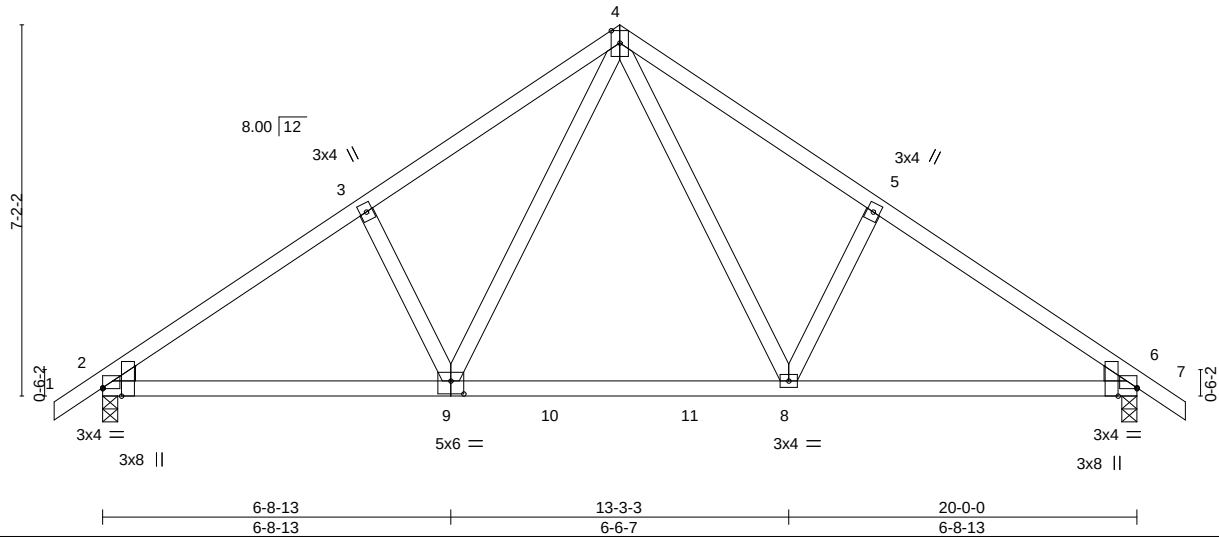


Plate Offsets (X,Y)--		[2:0-0-0,0-0-3], [2:0-1-15,Edge], [6:0-1-15,Edge], [6:0-0-0,0-0-3], [9:0-3-0,0-3-0]							
LOADING (psf)		SPACING-2-0-0		CSI		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	-0.08 8-9 >999 360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.46	Vert(CT)	-0.12 6-8 >999 240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.02 6 n/a n/a		
BCDL	10.0	Code IBC2021/TPI2014		Matrix-S		Wind(LL)	0.03 2-9 >999 240	Weight: 103 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3 or 2x4 SPF Stud
WEDGE

Left: 2x4 SP or SPF No.3 or Stud, Right: 2x4 SP or SPF No.3 or Stud

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=-185(LC 8)
Max Uplift 2=-117(LC 10), 6=-117(LC 11)
Max Grav 2=853(LC 1), 6=853(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1113/140, 3-4=-979/207, 4-5=-979/207, 5-6=-1113/140
BOT CHORD 2-9=-145/940, 8-9=-2/616, 6-8=-38/842
WEBS 3-9=-270/210, 4-9=-122/482, 4-8=-123/482, 5-8=-270/210

NOTES- (6-8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 117 lb uplift at joint 2 and 117 lb uplift at joint 6.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-14546	Truss Type COMN	Qty 1	Ply 2	11_Southeast-Girder-Int Job Reference (optional)	I49147402
---------------	-------------------	--------------------	----------	----------	---	-----------

NVR, Frederick, MD - 21703,

8.530 s Nov 29 2021 MiTek Industries, Inc. Tue Dec 7 20:30:58 2021 Page 1
ID:RrLVUNcBotMPeFP6cfGVKyElz_-dNuehugAW3?uUdwrtK6sdUvuoU0ClqvQdcOf3uyBF8R



5x6 //

Scale = 1:27.2

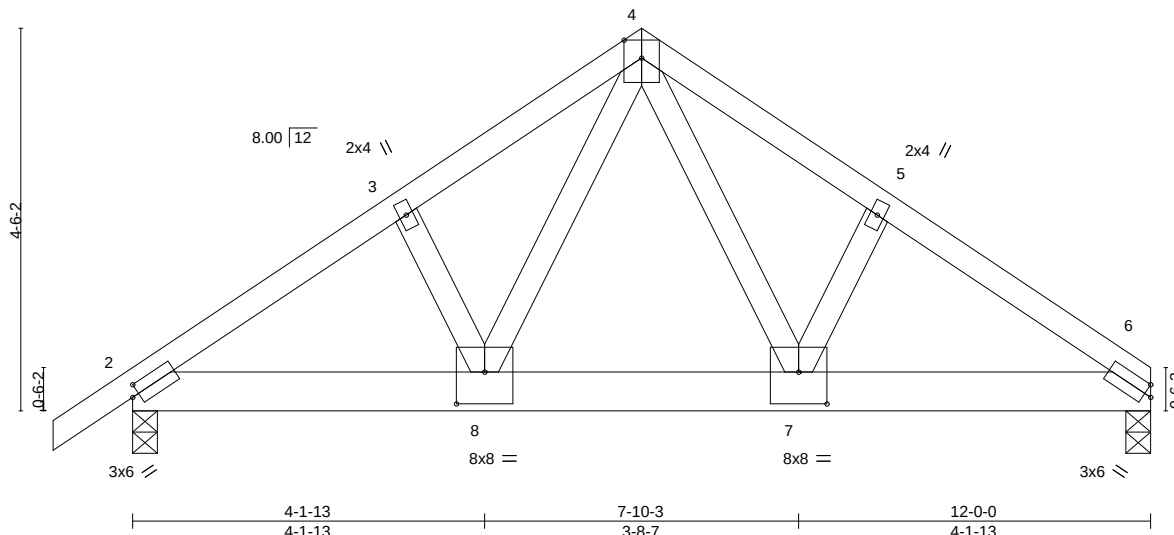


Plate Offsets (X,Y)-- [2:0-1-0,0-1-8], [7:0-4-0,0-4-8], [8:0-4-0,0-4-8]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.37	Vert(LL) -0.05	7-8	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 1.00	Vert(CT) -0.09	7-8	>999	240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.69	Horz(CT) 0.02	6	n/a	n/a		
BCDL 10.0	Code IBC2021/TPI2014	Matrix-S	Wind(LL) 0.03	7-8	>999	240	Weight: 140 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-11-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=91(LC 7)
Max Uplift 2=-201(LC 8), 6=-189(LC 9)
Max Grav 2=4787(LC 15), 6=4722(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-5667/237, 3-4=-5565/268, 4-5=-5576/271, 5-6=-5682/239
BOT CHORD 2-8=-195/4614, 7-8=-102/3296, 6-7=-162/4562
WEBS 4-8=-159/3286, 4-7=-163/3309

NOTES- (9-11)

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-8-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope); cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=201, 6=189.
- Girder carries tie-in span(s): 38-0-0 from 0-0-0 to 12-0-0
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.

LOAD CASE(S) Standard



January 12,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	11_Southeast-Girder-Int
ORDERS	SE-14546	COMN	1	2	I49147402

NVR, Frederick, MD - 21703,


8.530 s Nov 29 2021 MiTek Industries, Inc. Tue Dec 7 20:30:58 2021 Page 2
ID:?RrLVUNcBotMPeFP6cfGVKyElz_-dNuehugAW3?uUdwtK6sdUvuoU0ClqvQdcOFf3uyBF8R

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 2-6=-734(B=-714), 1-4=-60, 4-6=-60

Job ORDERS	Truss SE-14547	Truss Type COMN	Qty 1	Ply 2	11_Southeast-Girder-Int Job Reference (optional)	I49147403
---------------	-------------------	--------------------	----------	----------	---	-----------

NVR, Frederick, MD - 21703,

8.530 s Nov 29 2021 MiTek Industries, Inc. Tue Dec 7 20:30:59 2021 Page 1
ID: ?RrLVUNcBotMPeFP6cfGVKyElz_-5aS0uEhoHN7i6nV3upOs07R?XQhHZSanq2_DbLyBF8Q

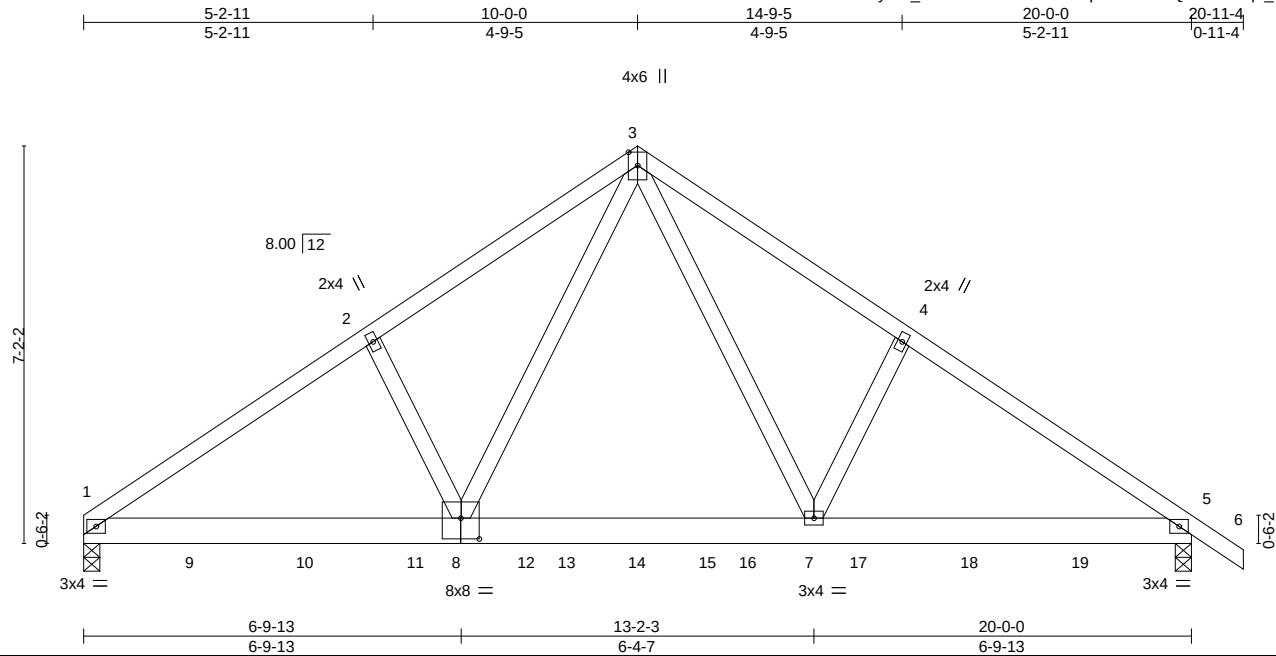

Scale = 1:41.6

Plate Offsets (X,Y)-- [8:0-4-0,0-4-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	-0.04 1-8 >999	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.44	Vert(CT)	-0.08 1-8 >999	240	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.25	Horz(CT)	0.02 5 n/a	n/a	
BCDL	10.0	Code IBC2021/TPI2014		Matrix-S		Wind(LL)	0.03 1-8 >999	240	Weight: 233 lb FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 5=0-3-8
Max Horz 1=-145(LC 4)
Max Uplift 1=-39(LC 8), 5=-51(LC 9)
Max Grav 1=1678(LC 1), 5=1746(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2319/78, 2-3=-2200/132, 3-4=-2194/130, 4-5=-2314/77
BOT CHORD 1-8=-67/1913, 7-8=0/1292, 5-7=-3/1845
WEBS 3-8=-78/1216, 3-7=-77/1207

NOTES- (9-11)

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope); cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 198 lb down and 9 lb up at 2-0-0, 198 lb down and 9 lb up at 4-0-0, 198 lb down and 9 lb up at 6-0-0, 198 lb down and 9 lb up at 8-0-0, 198 lb down and 9 lb up at 10-0-0, 198 lb down and 9 lb up at 12-0-0, 198 lb down and 9 lb up at 14-0-0, and 198 lb down and 9 lb up at 16-0-0, and 198 lb down and 9 lb up at 18-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12, 2022

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	11_Southeast-Girder-Int
ORDERS	SE-14547	COMN	1	2	I49147403
Job Reference (optional)					


LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
- Vert: 1-5=-20, 1-3=-60, 3-6=-60
- Concentrated Loads (lb)
- Vert: 9=-198(F) 10=-198(F) 11=-198(F) 12=-198(F) 14=-198(F) 16=-198(F) 17=-198(F) 18=-198(F) 19=-198(F)

Job ORDERS	Truss SE-14549	Truss Type COMN	Qty 1	Ply 1	10_Southeast Job Reference (optional)	I49147393
---------------	-------------------	--------------------	----------	----------	--	-----------

NVR, Frederick, MD - 21703,

8.530 s Nov 29 2021 MiTek Industries, Inc. Tue Dec 7 20:30:28 2021 Page 1
ID:RrLVUNcBotMPeFP6cfGVKyElz_Vc4IOeJMarD9u0d6apKbGbeluwCRoULDijz4?eyBF8v



4x6 =

Scale = 1:29.1

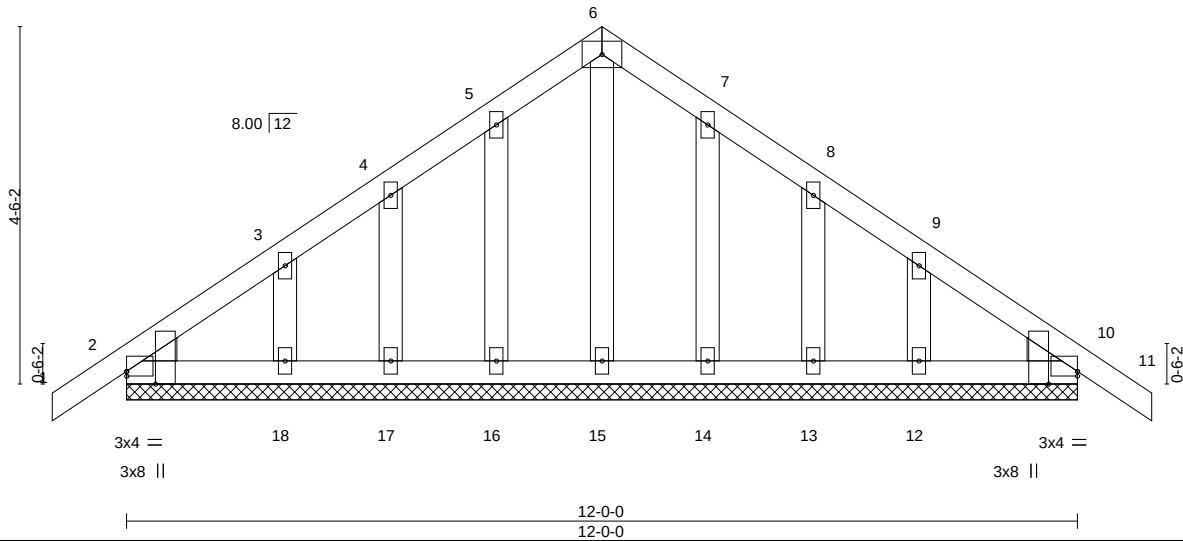


Plate Offsets (X,Y)-- [2:0-0-0,0-0-11], [2:0-1-15,Edge], [10:0-0-0,0-0-11], [10:0-1-15,Edge]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) -0.00	10	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00	11	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00	10	n/a	n/a		
BCDL 10.0	Code IBC2021/TPI2014	Matrix-S					Weight: 70 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
OTHERS 2x4 SP No.3 or 2x4 SPF Stud
WEDGE

Left: 2x4 SP or SPF No.3 or Stud, Right: 2x4 SP or SPF No.3 or Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 12-0-0.

(lb) - Max Horz 2=-118(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 16, 17, 18, 14, 13, 12

Max Grav All reactions 250 lb or less at joint(s) 2, 10, 15, 16, 17, 18, 14, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 16, 17, 18, 14, 13, 12.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-17641	Truss Type COMN	Qty 1	Ply 1	10_Southeast	I49171651
---------------	-------------------	--------------------	----------	----------	--------------	-----------

NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 02:08:01 2021 Page 1
ID: ?RrLVUNcBotMPeFP6cfGVkyElz_-EuzXW?12f_NKfIWzxLF6LYO_XPjFHHybXJuBrMyAr6S

0-11-4 10-0-0 20-0-0 20-11-4
0-11-4 10-0-0 10-0-0 0-11-4

4x6 =

Scale = 1:45.8

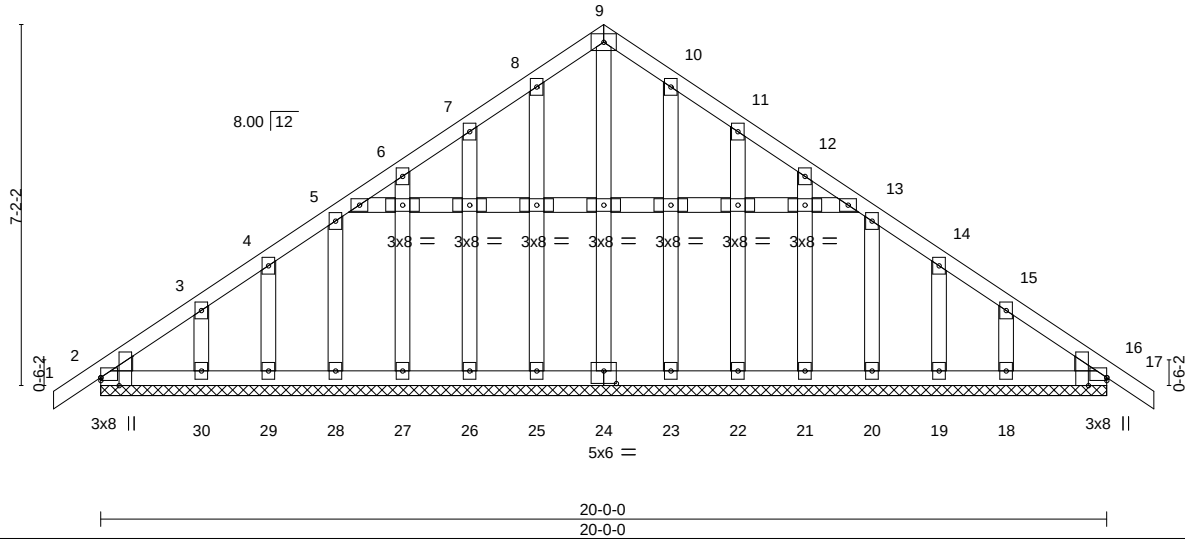


Plate Offsets (X,Y)-- [2:0-0-0,0-0-11], [2:0-1-15,Edge], [16:0-0-0,0-0-11], [16:0-1-15,Edge], [24:0-3-0,0-3-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) -0.00	16	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00	17	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.12	Horz(CT) 0.00	16	n/a	n/a		
BCDL 10.0	Code IBC2021/TPI2014	Matrix-S					Weight: 155 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.2 or 2x4 SPF No.2
OTHERS 2x4 SP No.3 or 2x4 SPF Stud
WEDGE

Left: 2x4 SP or SPF No.3 or Stud , Right: 2x4 SP or SPF No.3 or Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 20-0-0.

(lb) - Max Horz 2=-185(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 2, 16, 25, 26, 27, 28, 29, 30, 23,
22, 21, 20, 19, 18

Max Grav All reactions 250 lb or less at joint(s) 2, 16, 24, 25, 26, 27, 28, 29, 30,
23, 22, 21, 20, 19, 18

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 3x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 16, 25, 26, 27, 28, 29, 30, 23, 22, 21, 20, 19, 18.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.
- Framing and bracing of the gable end frame shall be provided by the building designer.



January 12,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job ORDERS	Truss SE-18423	Truss Type COMN	Qty 1	Ply 1	10_Southeast	I49194674
---------------	-------------------	--------------------	----------	----------	--------------	-----------

NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:34 2021 Page 1
ID:TfhWPze26pZ0d7TmAocjK4zu5rq-l_hYJ8QaU_RuBMyltzBoR5dwpZLo?HWombRc2jyAarJ

-0-11-4 0-11-4	7-0-0 7-0-0	14-0-0 7-0-0	14-11-4 0-11-4
-------------------	----------------	-----------------	-------------------

Scale = 1:25.5

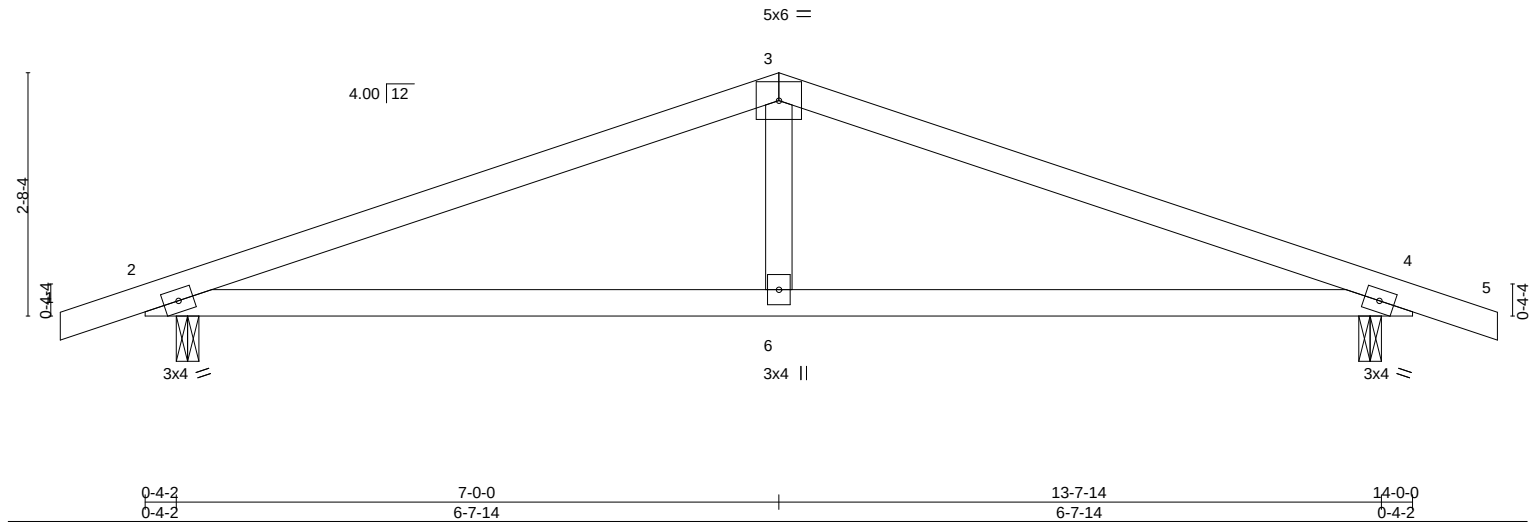

0-4-2 0-4-2	7-0-0 6-7-14	13-7-14 6-7-14	14-0-0 0-4-2
----------------	-----------------	-------------------	-----------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.76	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.57	Vert(LL) -0.06 4-6 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.13	Vert(CT) -0.14 2-6 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 4 n/a n/a		
	Code IBC2021/TPI2014		Wind(LL) 0.05 2-6 >999 240	Weight: 49 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-6 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-0, 4=0-3-0
Max Horz 2=-45(LC 15)
Max Uplift 2=-129(LC 6), 4=-129(LC 7)
Max Grav 2=614(LC 1), 4=614(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1021/122, 3-4=-1021/122
BOT CHORD 2-6=-65/903, 4-6=-65/903
WEBS 3-6=0/332

NOTES- (6-8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 2 and 129 lb uplift at joint 4.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-18424	Truss Type COMN	Qty 1	Ply 1	10_Southeast	I49194675
---------------	-------------------	--------------------	----------	----------	--------------	-----------

NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:35 2021 Page 1

ID: ?RrLVUNcBotMPeFP6cfGVkyElz_-DBFwXURCFHziWUXURgj1zJA1OzbGkehY_FA9a9yAarl



Scale = 1:65.0

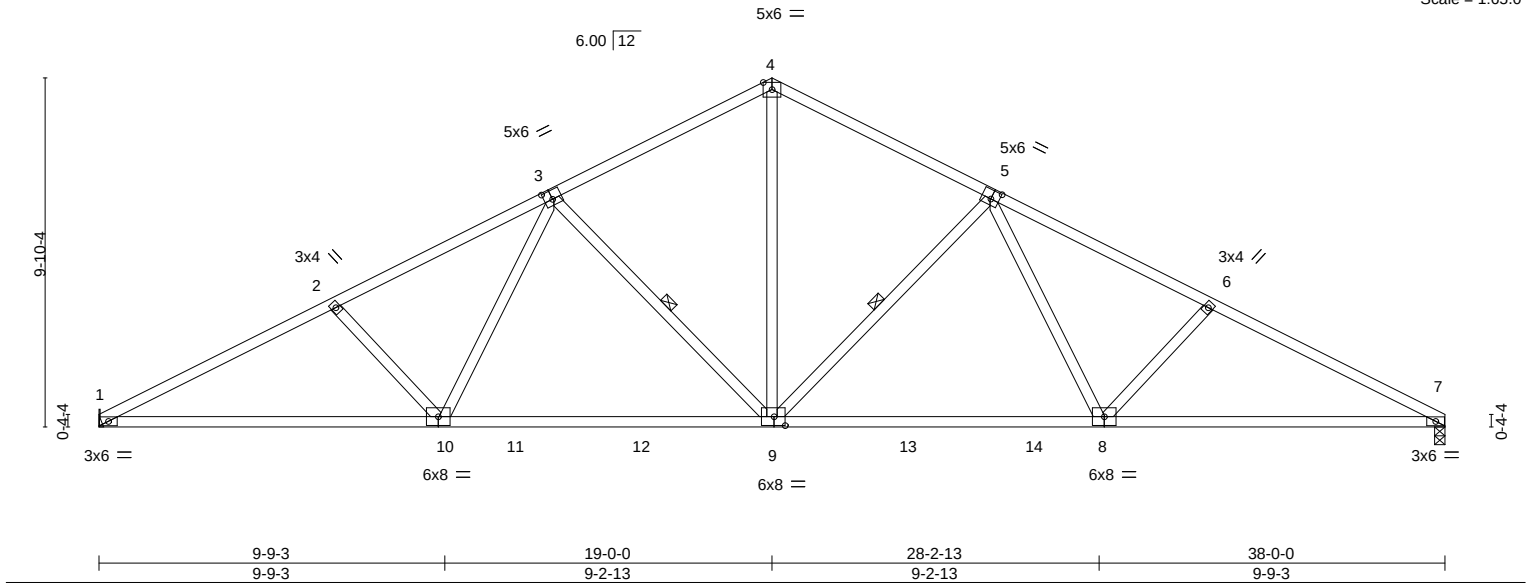


Plate Offsets (X,Y)--		[3:0-2-12,0-3-0], [5:0-2-12,0-3-0], [9:0-3-12,0-3-0]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.15	TC 0.96		Vert(LL)	-0.26	9-10	>999	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.94		Vert(CT)	-0.50	1-10	>900		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.52		Horz(CT)	0.12	7	n/a		
BCDL 10.0		Code IBC2021/TPI2014		Matrix-S		Wind(LL)	0.12	9	>999	Weight: 193 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2D *Except*
3-4,4-5: 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2D *Except*
7-8,1-10: 2x4 SP No.1
WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 1 Row at midpt 3-9, 5-9

REACTIONS.

(size) 7=0-3-8, 1=Mechanical
Max Horz 1=164(LC 10)
Max Uplift 7=-195(LC 11), 1=-196(LC 10)
Max Grav 7=1512(LC 1), 1=1512(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2850/387, 2-3=-2587/356, 3-4=-1785/289, 4-5=-1793/290, 5-6=-2578/356,
6-7=-2830/383
BOT CHORD 1-10=-431/2487, 9-10=-247/2001, 8-9=-103/1995, 7-8=-263/2463
WEBS 2-10=-370/234, 3-10=-56/569, 3-9=-709/267, 4-9=-128/1209, 5-9=-697/266,
5-8=-57/557, 6-8=-353/230

NOTES- (7-9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 195 lb uplift at joint 7 and 196 lb uplift at joint 1.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-18425	Truss Type COMN	Qty 1	Ply 1	10_Southeast	I49194676
---------------	-------------------	--------------------	----------	----------	--------------	-----------


NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:36 2021 Page 1

ID:7RrLVUNcBotMPeFP6cfGVKyElz_hNpJkpSr0bhcQf6g?OEGWWjDJNwdT4nhDwwj6byAarH

6-8-3 6-8-3	12-10-2 6-1-14	19-0-0 6-1-14	25-1-14 6-1-14	31-3-13 6-1-14	38-0-0 6-8-3
----------------	-------------------	------------------	-------------------	-------------------	-----------------

Scale = 1:65.6

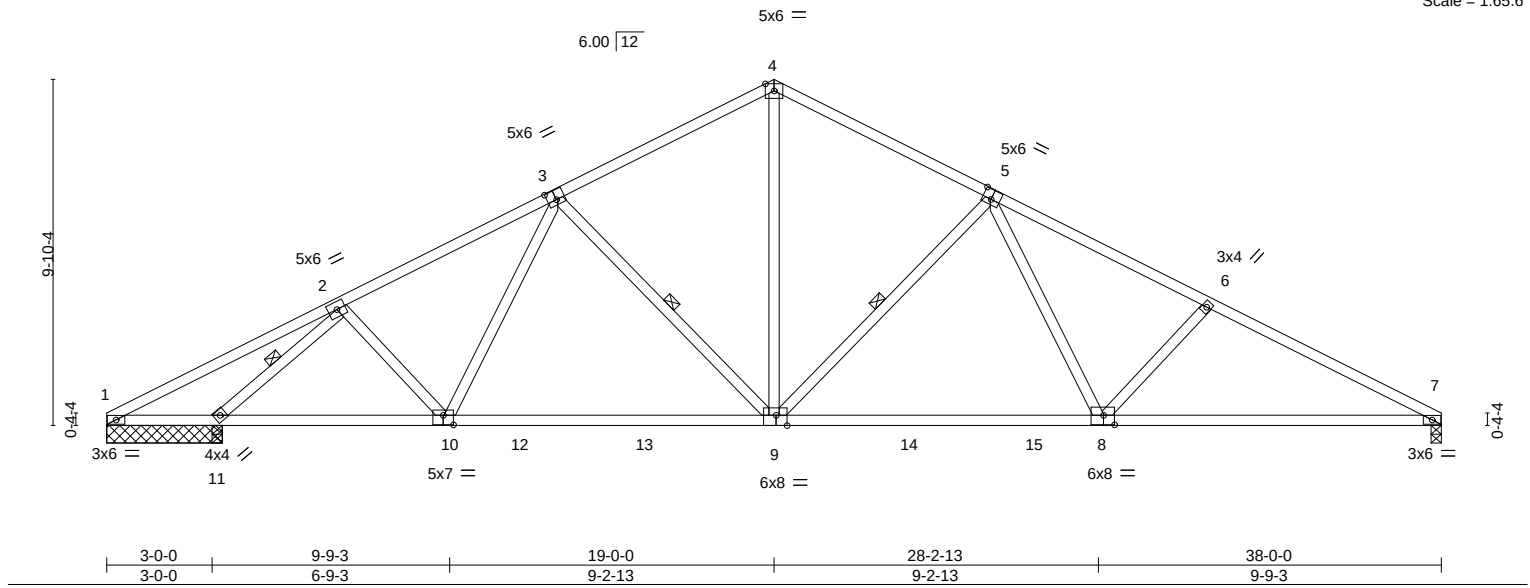

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.95	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 1.00	Vert(LL) -0.24 8-9 >999 360		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.59	Vert(CT) -0.47 7-8 >882 240		
BCDL 10.0	Code IBC2021/TPI2014	Matrix-S	Horz(CT) 0.09 7 n/a n/a		
			Wind(LL) 0.10 7-8 >999 240	Weight: 200 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 7-8: 2x4 SP No.2D
 WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 WEBS 1 Row at midpt 3-9, 5-9, 2-11

REACTIONS.

All bearings 3-3-8 except (jt=length) 7=0-3-8.
 (lb) - Max Horz 1=164(LC 14)
 Max Uplift All uplift 100 lb or less at joint(s) except 7=190(LC 11), 1=169(LC 26), 11=221(LC 10)
 Max Grav All reactions 250 lb or less at joint(s) 1 except 7=1370(LC 1), 11=1786(LC 1), 11=1786(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-137/703, 2-3=-1660/250, 3-4=-1477/277, 4-5=-1483/254, 5-6=-2268/345,
 6-7=-2522/373
 BOT CHORD 1-11=-542/189, 10-11=-265/1183, 9-10=-181/1447, 8-9=-72/1717, 7-8=-254/2190
 WEBS 2-10=0/385, 3-9=-372/222, 4-9=-116/945, 5-9=-696/267, 5-8=-59/554, 6-8=-357/230,
 2-11=-2370/370

NOTES- (6-8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 190 lb uplift at joint 7, 169 lb uplift at joint 1 and 221 lb uplift at joint 11.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job ORDERS	Truss SE-18426	Truss Type COMN	Qty 1	Ply 1	10_Southeast	I49194677
---------------	-------------------	--------------------	----------	----------	--------------	-----------

NVR, Frederick, MD - 21703,


8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:37 2021 Page 1

ID:RrLVUNcBotMPEfP6cfGVKyElz_-9ZNhy9STnvpT2phtZ5IV2kFNwnFnCYQrSzfGf2yAarG

Job Reference (optional)

0-11-4 0-11-4	6-8-3 6-8-3	12-10-2 6-1-14	19-0-0 6-1-14	25-1-14 6-1-14	31-3-13 6-1-14	38-0-0 6-8-3
------------------	----------------	-------------------	------------------	-------------------	-------------------	-----------------

Scale = 1:65.0

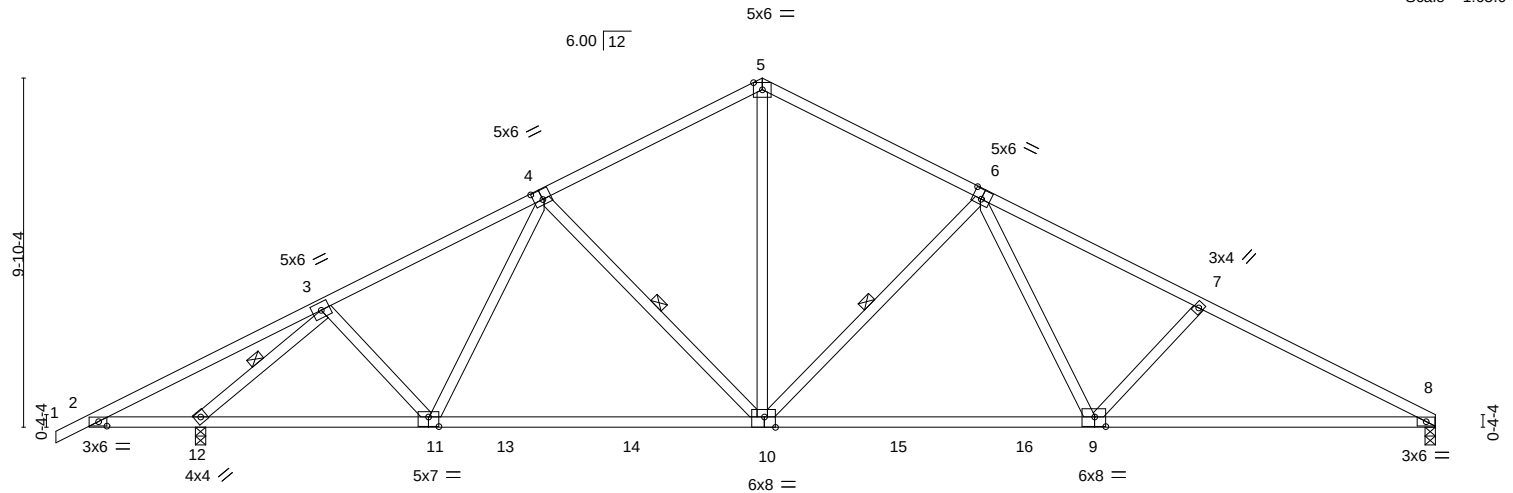

		3-0-0	3-1-12	9-9-3			19-0-0			28-2-13			38-0-0	
		3-0-0	0-1-12	6-7-7			9-2-13			9-2-13			9-9-3	
Plate Offsets (X,Y)--		[2:0-2-13,0-1-8], [4:0-3-0,0-3-4], [6:0-3-0,0-3-4], [9:0-3-12,0-3-4], [10:0-3-12,Edge], [11:0-3-8,0-3-4]												
LOADING (psf)		SPACING-		2-0-0	CSL		DEFL.		in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL	20.0	Plate Grip DOL		1.15	TC	0.96	Vert(LL)		-0.24	9-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL		1.15	BC	1.00	Vert(CT)		-0.48	8-9	>881	240		
BCLL	0.0 *	Rep Stress Incr		YES	WB	0.57	Horz(CT)		0.09	8	n/a	n/a		
BCDL	10.0	Code IBC2021/TPI2014			Matrix-S		Wind(LL)		0.10	8-9	>999	240	Weight: 201 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
8-9: 2x4 SP No.2D
WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied or 1-4-12 oc bracing.
WEBS 1 Row at midpt 4-10, 6-10, 3-12

REACTIONS.

(size) 8=0-3-8, 12=0-3-8
Max Horz 12=178(LC 14)
Max Uplift 8=188(LC 11), 12=236(LC 10)
Max Grav 8=1380(LC 1), 12=1705(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-159/534, 3-4=-1718/242, 4-5=-1498/274, 5-6=-1504/251, 6-7=-2289/342,
7-8=-2543/369
BOT CHORD 2-12=-393/204, 11-12=-254/1281, 10-11=-178/1485, 9-10=-69/1736, 8-9=-251/2208
WEBS 3-11=0/330, 4-10=-378/219, 5-10=-113/968, 6-10=-696/267, 6-9=-59/553, 7-9=-356/230,
3-12=-2258/381

NOTES- (6-8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 188 lb uplift at joint 8 and 236 lb uplift at joint 12.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-18453- Cond1	Truss Type COMN	Qty 1	Ply 1	10_Southeast	i49194686
Job Reference (optional)						

NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:46 2021 Page 1

ID: ?RrLVUNcBotMPeFP6cfGVkyElz_-PIQ5rEZ6fgyBdCtbaUPcWd70cPLvpW89WTLFT0yAar7

0-11-4	3-1-12	6-8-3	12-10-2	19-0-0	25-1-14	31-3-13	34-10-4	38-0-0	38-11-4
0-11-4	3-1-12	3-6-7	6-1-14	6-1-14	6-1-14	6-1-14	3-6-7	3-1-12	0-11-4

Scale = 1:65.6

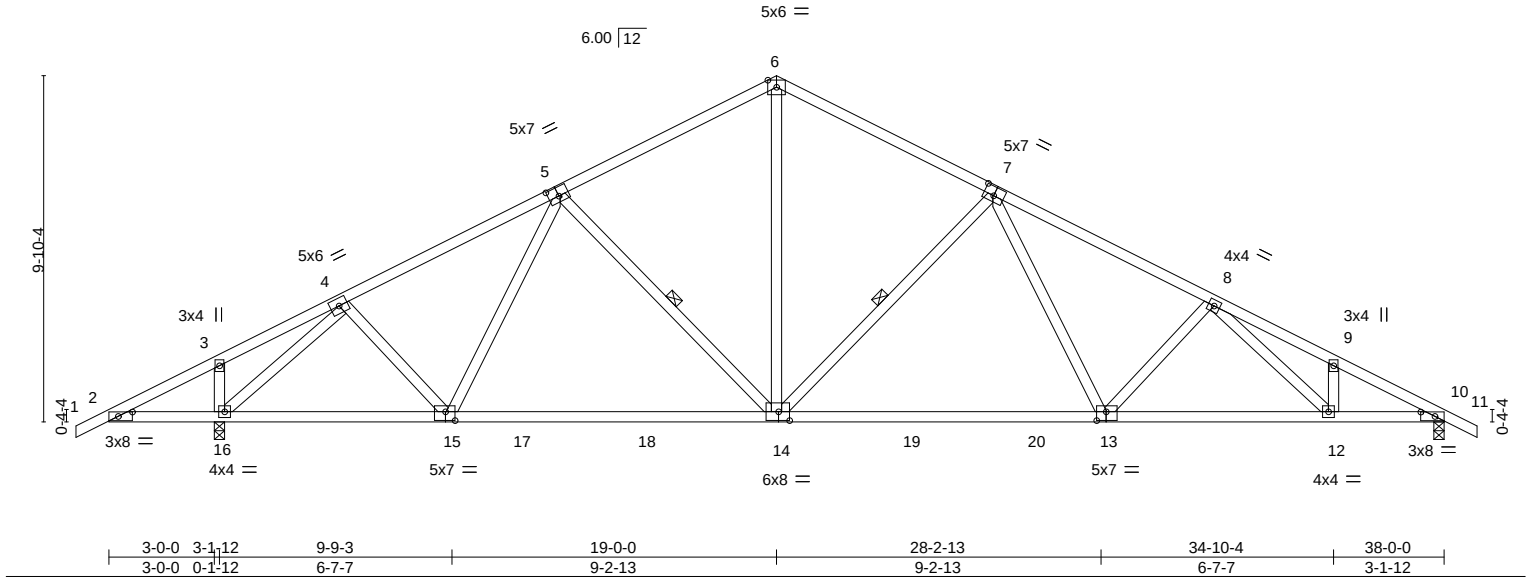


Plate Offsets (X,Y)--		[2:0-4-13,0-1-8], [5:0-3-8,0-3-0], [7:0-3-8,0-3-0], [10:0-4-13,0-1-8], [13:0-3-4,0-3-0], [14:0-3-12,0-3-0], [15:0-3-4,0-3-0]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.15	TC 0.52		Vert(LL)	-0.20 13-14	>999	360	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.94		Vert(CT)	-0.40 13-14	>999	240		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.99		Horz(CT)	0.08 10	n/a	n/a		
BCDL 10.0		Code IBC2021/TPI2014		Matrix-S		Wind(LL)	0.09 13	>999	240	Weight: 213 lb	FT = 5%

LUMBER-		BRACING-		[MCT]
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 3-4-11 oc purlins.	
BOT CHORD	2x4 SP No.2D *Except*	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.	
	10-13: 2x4 SP 2250F 1.9E or 2x4 SPF 2100F 1.8E	WEBS	1 Row at midpt 5-14, 7-14	
	2-15: 2x4 SP No.2 or 2x4 SPF No.2			
WEBS	2x4 SP No.3 or 2x4 SPF Stud			

REACTIONS. (size) 10=0-3-8, 16=0-3-8
Max Horz 16=171(LC 10)
Max Uplift 10=212(LC 11), 16=237(LC 10)
Max Grav 10=1437(LC 1), 16=1712(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-111/370, 3-4=-55/371, 4-5=-1644/226, 5-6=-1481/271, 6-7=-1486/249,
7-8=-2237/335, 8-9=-2565/393, 9-10=-2643/335
BOT CHORD 2-16=-285/136, 15-16=-218/1188, 14-15=-169/1455, 13-14=-60/1715, 12-13=-210/2167,
10-12=-239/2280
WEBS 4-15=0/393, 5-14=-362/222, 6-14=-115/960, 7-14=-691/274, 7-13=-50/514,
8-13=-355/194, 4-16=-2001/255

- NOTES-** (6-8)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=212, 16=237.
 - Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
 - Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
 - Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

NVR, Frederick, MD - 21703, 8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:47 2021 Page 1
 ID:?RrLVUNcBotMPEfP6cfGVKyElz_-tV_T2aakQz42EMSo8BwrSrgBmPh3YzQJl74o?TyAar6
 0-11-4 3-1-12 6-8-3 12-10-2 19-0-0 25-1-14 31-3-13 34-10-4 38-0-0 38-11-4
 0-11-4 3-1-12 3-6-7 6-1-14 6-1-14 6-1-14 6-1-14 3-6-7 3-1-12 0-11-4
 Scale = 1:66.2

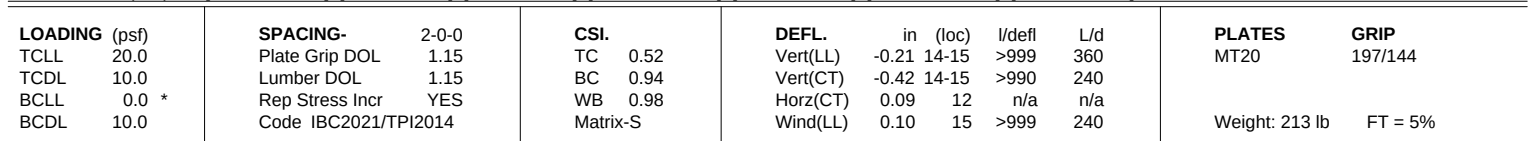

REACTIONS. (size) 2=0-3-8, 12=0-3-8
 Max Horz 2=-171(LC 15)
 Max Uplift 2=-212(LC 10), 12=-237(LC 11)
 Max Grav 2=1437(LC 1), 12=1712(LC 1)

NOTES- (6-8)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=212, 12=237.
- 6) Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- 7) Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- 8) Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.

Job ORDERS	Truss SE-18454	Truss Type COMN	Qty 1	Ply 1	10_Southeast	I49194687
---------------	-------------------	--------------------	----------	----------	--------------	-----------


NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:48 2021 Page 1

ID:RrLVUNcBotMPEFP6cfGVKyElz_LhYrFwbMBHCvsV1_ivR4?2CJXD0PHWmS_nqLYvyAar5

6-8-3 6-8-3	12-10-2 6-1-14	19-0-0 6-1-14	25-1-14 6-1-14	31-3-13 6-1-14	38-0-0 6-8-3	38-11-4 0-11-4
----------------	-------------------	------------------	-------------------	-------------------	-----------------	-------------------

Scale = 1:66.2

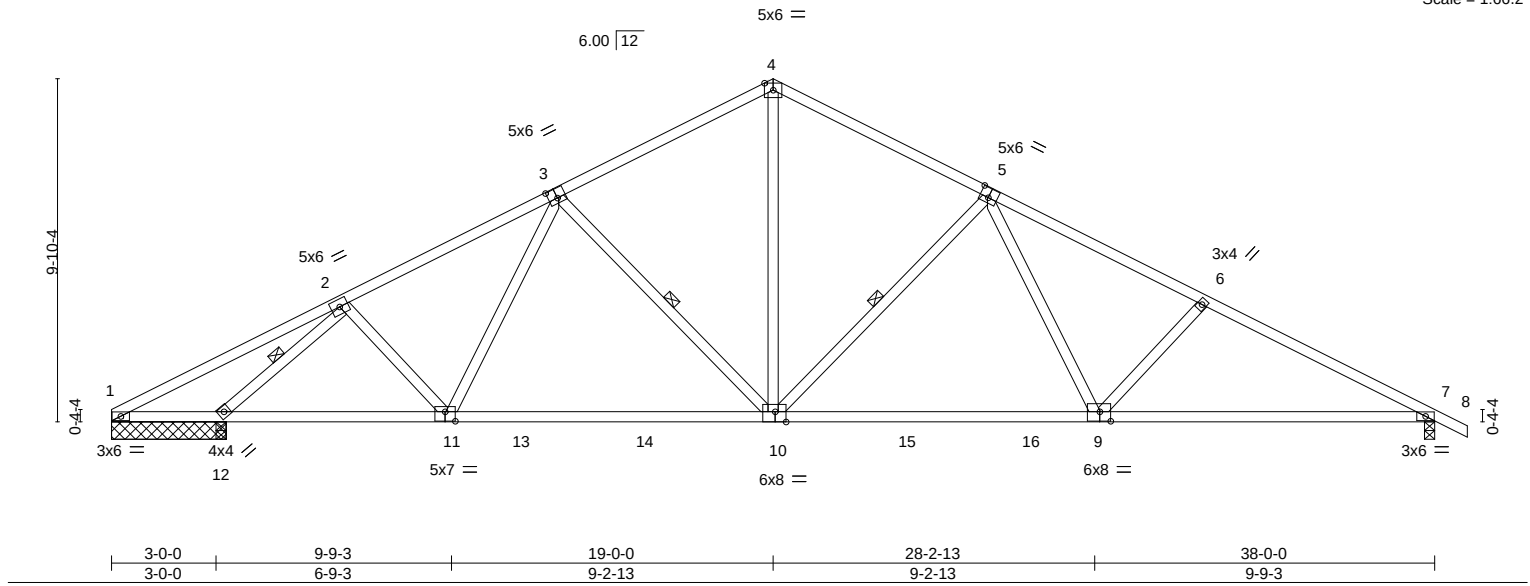

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.24 9-10 >999 360	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	1.00	Vert(CT)	-0.45 7-9 >920 240				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.59	Horz(CT)	0.09 7 n/a n/a				
BCDL	10.0	Code IBC2021/TPI2014		Matrix-S		Wind(LL)	0.10 7-9 >999 240				

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 2-4-0 oc purlins.
BOT CHORD	2x4 SP No.2 or 2x4 SPF No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
	7-9: 2x4 SP No.2D	WEBS	1 Row at midpt 3-10, 5-10, 2-12
WEBS	2x4 SP No.3 or 2x4 SPF Stud		

REACTIONS.	
(lb) - Max Horz 1=178(LC 11)	
Max Uplift All uplift 100 lb or less at joint(s) except 7=214(LC 11), 1=168(LC 26), 12=219(LC 10)	
Max Grav All reactions 250 lb or less at joint(s) 1 except 7=1436(LC 1), 12=1785(LC 1), 12=1785(LC 1)	

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-2=-133/701, 2-3=-1658/251, 3-4=-1475/277, 4-5=-1481/254, 5-6=-2261/343, 6-7=-2513/368
BOT CHORD	1-12=-540/196, 11-12=-259/1183, 10-11=-175/1446, 9-10=-62/1714, 7-9=-233/2179
WEBS	2-11=0/385, 3-10=-372/222, 4-10=-116/944, 5-10=-694/267, 5-9=-56/552, 6-9=-350/224, 2-12=-2367/367

- NOTES-** (6-8)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 214 lb uplift at joint 7, 168 lb uplift at joint 1 and 219 lb uplift at joint 12.
 - Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
 - Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
 - Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-18455-	Truss Type CONN	Qty 1	Ply 1	10_Southeast	149194688
Job Reference (optional)						

NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:51 2021 Page 1
ID: ?RrLVUNcBotMPEFP6cfGVkyElz_-IGD_uydFUCaUjzmZN1?ndhqrWQ4xUuVugl208EyAar2



6-8-3	12-10-2	19-0-0	25-1-14	31-3-13	38-0-0	38-11-4
6-8-3	6-1-14	6-1-14	6-1-14	6-1-14	6-8-3	0-11-4

Scale = 1:63.3

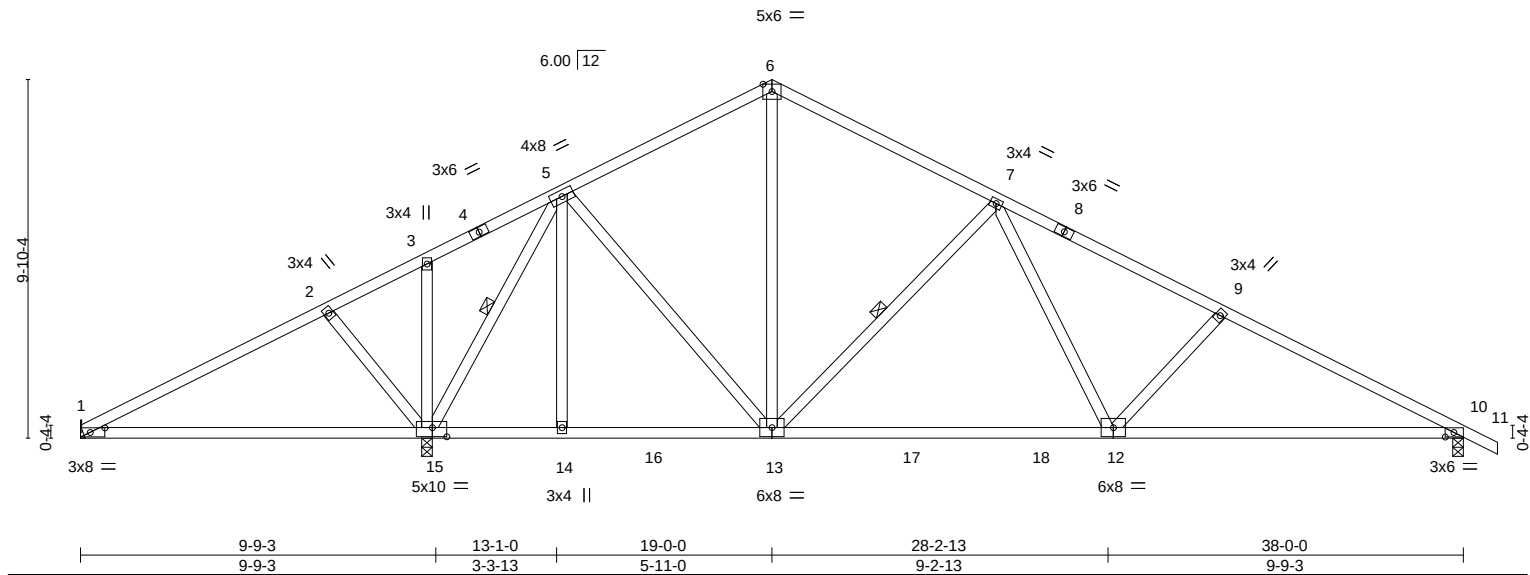


Plate Offsets (X,Y)--		[1:0-4-13,0-1-8], [10:0-2-13,0-1-8], [15:0-4-12,0-3-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL 1.15		TC 0.70		Vert(LL) -0.23	1-15	>501	360	MT20	197/144
TCDL 10.0		Lumber DOL 1.15		BC 0.82		Vert(CT) -0.47	1-15	>243	240		
BCLL 0.0 *		Rep Stress Incr YES		WB 0.53		Horz(CT) 0.03	10	n/a	n/a		
BCDL 10.0		Code IBC2021/TPI2014		Matrix-S		Wind(LL) 0.08	10-12	>999	240	Weight: 210 lb	FT = 5%

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-4-0 oc purlins.	
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 10-12: 2x4 SP No.1, 12-13: 2x4 SP No.2D	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 1-15.	
WEBS 2x4 SP No.3 or 2x4 SPF Stud	WEBS 1 Row at midpt 5-15, 7-13	

REACTIONS.	(size) 15=0-3-8, 10=0-3-8, 1=Mechanical
	Max Horz 1=178(LC 11)
	Max Uplift 15=250(LC 10), 10=-192(LC 11), 1=-26(LC 24)
	Max Grav 15=1863(LC 1), 10=1104(LC 1), 1=205(LC 23)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-59/377, 2-3=-76/524, 3-5=-41/602, 5-6=-731/229, 6-7=-740/206, 7-9=-1542/292, 9-10=-1796/318
BOT CHORD	1-15=-301/192, 14-15=0/307, 13-14=0/307, 12-13=-14/1062, 10-12=-189/1543
WEBS	2-15=-378/221, 5-15=-1472/162, 5-13=-24/559, 6-13=-74/330, 7-13=-705/265, 7-12=-52/575, 9-12=-358/225

- NOTES-** (7-9)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 250 lb uplift at joint 15, 192 lb uplift at joint 10 and 26 lb uplift at joint 1.
 - Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
 - Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
 - Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-18455-	Truss Type COMN	Qty 1	Ply 1	10_Southeast	I49194688
Job Reference (optional)						

NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:38:52 2021 Page 1

ID: ?RrLVUNcBotMPeFP6cfGVkyElz_DSsnM5letFWiKL7KxIW09uN_XqO6DMF2uPoZhgyAar1

6-8-3	12-10-2	19-0-0	25-1-14	31-3-13	38-0-0	38-11-4
6-8-3	6-1-14	6-1-14	6-1-14	6-1-14	6-8-3	0-11-4

Scale: 3/16"=1'

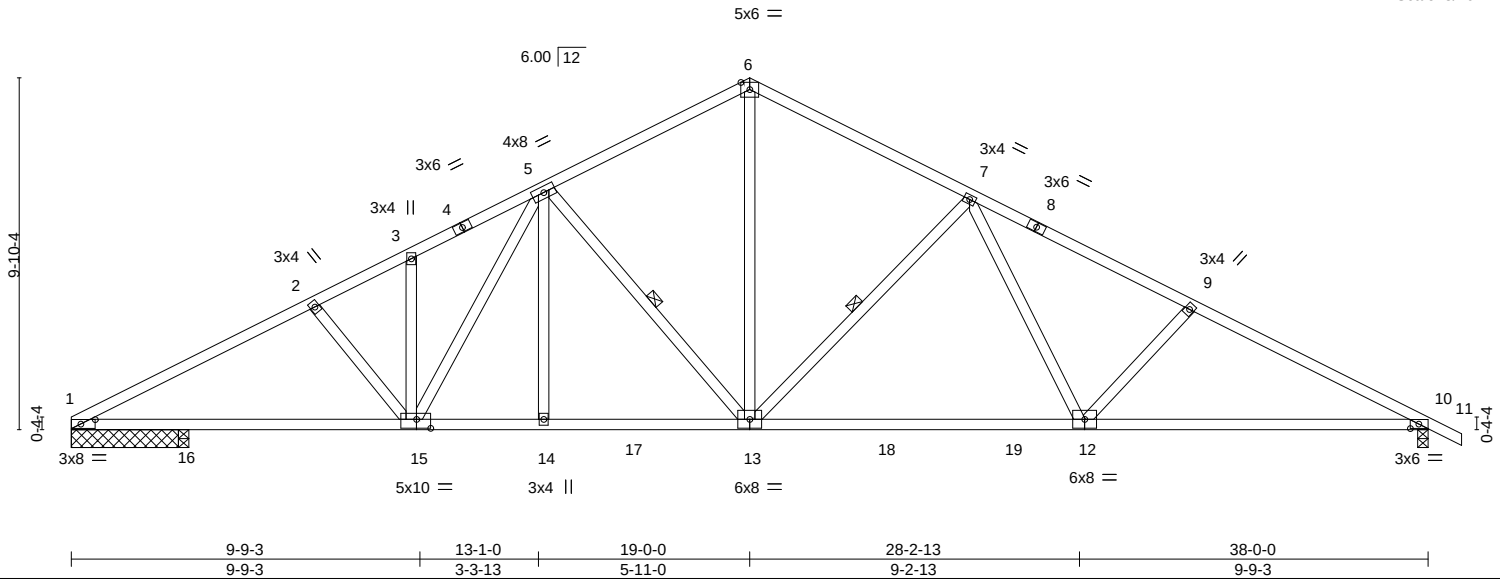


Plate Offsets (X,Y)-- [1:0-4-13,0-1-8], [10:0-2-13,0-1-8], [15:0-4-12,0-3-0]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl
TCLL 20.0	Plate Grip DOL	1.15	TC 0.81	Vert(LL)	-0.30 12-13	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.95	Vert(CT)	-0.54 12-13	>776
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.50	Horz(CT)	0.12 10	n/a
BCDL 10.0	Code IBC2021/TPI2014		Matrix-S	Wind(LL)	0.14 14-15	>999
				L/d	360	
				240		
				n/a		
				240		
				Weight: 210 lb	FT = 5%	

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 10-12: 2x4 SP No.1, 12-13: 2x4 SP No.2D
 WEBS 2x4 SP No.3 or 2x4 SPF Stud

REACTIONS.

(size) 10=0-3-8, 1=3-0-0, 16=0-3-8
 Max Horz 1=178(LC 15)
 Max Uplift 10=224(LC 11), 1=228(LC 10)
 Max Grav 10=1561(LC 1), 1=1307(LC 1), 16=296(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2696/414, 2-3=-2435/375, 3-5=-2383/411, 5-6=-1740/300, 6-7=-1749/298,
 7-9=-2537/362, 9-10=-2787/387
 BOT CHORD 1-16=-447/2326, 15-16=-447/2326, 14-15=-233/1913, 13-14=-233/1913, 12-13=-103/1959,
 10-12=-250/2422
 WEBS 2-15=-330/221, 5-15=-144/433, 5-13=-668/258, 6-13=-140/1156, 7-13=-699/264,
 7-12=-51/566, 9-12=-347/224

NOTES- (6-8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 224 lb uplift at joint 10 and 228 lb uplift at joint 1.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932


Job ORDERS	Truss SE-18456	Truss Type COMN	Qty 1	Ply 1	Plates added Job Reference (optional)	155156609
---------------	-------------------	--------------------	----------	----------	--	-----------

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Nov 8 10:21:37 2022 Page 1
ID: ?RrLVUNcBotMPeFP6cfGVkyElz_-J4kpInS0MXaNNMv2KZSS3nLMZ69R25XSwdbdInyLGti

6-8-3 6-8-3	12-10-2 6-1-14	19-0-0 6-1-14	25-1-14 6-1-14	31-3-13 6-1-14	38-0-0 6-8-3	38-11-4 0-11-4
----------------	-------------------	------------------	-------------------	-------------------	-----------------	-------------------

Scale = 1:66.7

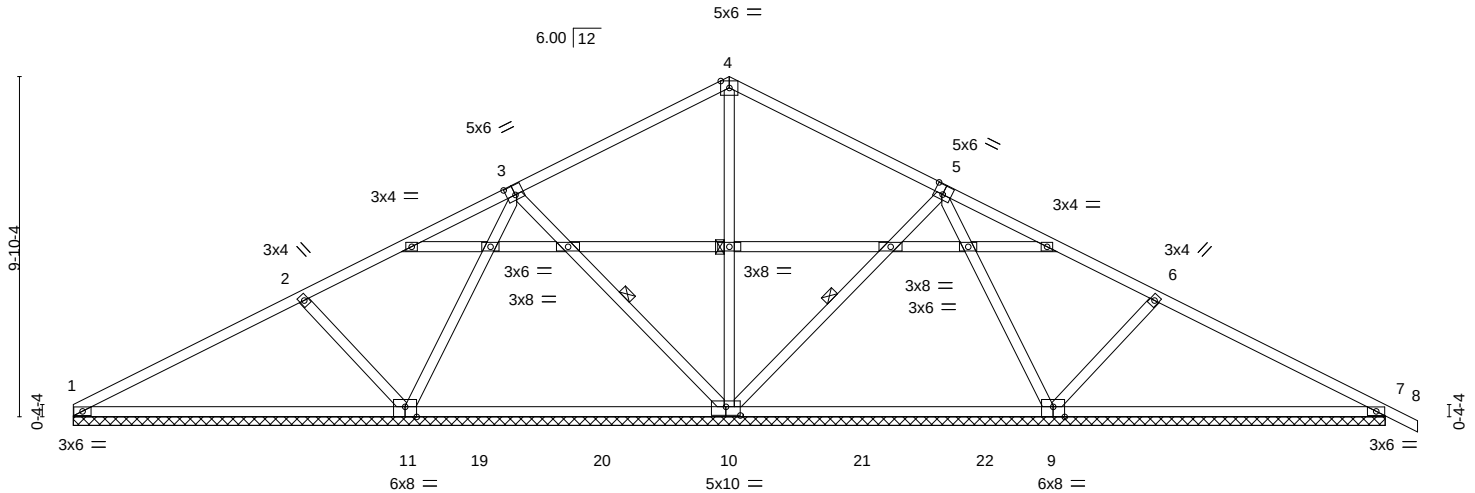

		9-9-3		19-0-0		28-2-13		38-0-0	
		9-9-3		9-2-13		9-2-13		9-9-3	
Plate Offsets (X,Y)-- [3:0-3-0,0-3-4], [5:0-3-0,0-3-4], [9:0-4-0,Edge], [10:0-5-0,0-3-0], [11:0-4-0,Edge]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL 1.15		TC	0.59	Vert(LL)	0.03 8 n/r	120	MT20 197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.81	Vert(CT)	0.07 8 n/r	120	
BCLL	0.0 *	Rep Stress Incr YES		WB	0.39	Horz(CT)	0.01 7 n/a	n/a	
BCDL	10.0	Code IBC2021/TPI2014		Matrix-S					Weight: 221 lb FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 6-0-0 oc bracing: 10-11.
1 Row at midpt 3-10, 4-10, 5-10

REACTIONS.

All bearings 38-0-0.
(lb) - Max Horz 1=-178(LC 15)
Max Uplift All uplift 100 lb or less at joint(s) 10, 7, 1 except 11=-175(LC 10), 9=-158(LC 11)
Max Grav All reactions 250 lb or less at joint(s) except 11=834(LC 23), 10=764(LC 2), 9=837(LC 24), 7=380(LC 24), 1=320(LC 23)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-11=-402/239, 3-11=-359/131, 4-10=-386/50, 5-9=-364/116, 6-9=-397/233

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 7, 1 except (jt=lb) 11=175, 9=158.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



November 9, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-18457	Truss Type COMN	Qty 1	Ply 1	Plates added Job Reference (optional)	155156610
---------------	-------------------	--------------------	----------	----------	--	-----------

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Tue Nov 8 10:21:38 2022 Page 1

ID:RrLVUNcBotMPeFP6cfGVkyEiz_-nGICV7te7riE?WUEuH_hc?uWJWVgnYmb9HLArDyLGth

6-8-3 6-8-3	12-10-2 6-1-14	19-0-0 6-1-14	25-1-14 6-1-14	31-3-13 6-1-14	38-0-0 6-8-3	38-11-4 0-11-4
----------------	-------------------	------------------	-------------------	-------------------	-----------------	-------------------

Scale = 1:66.7

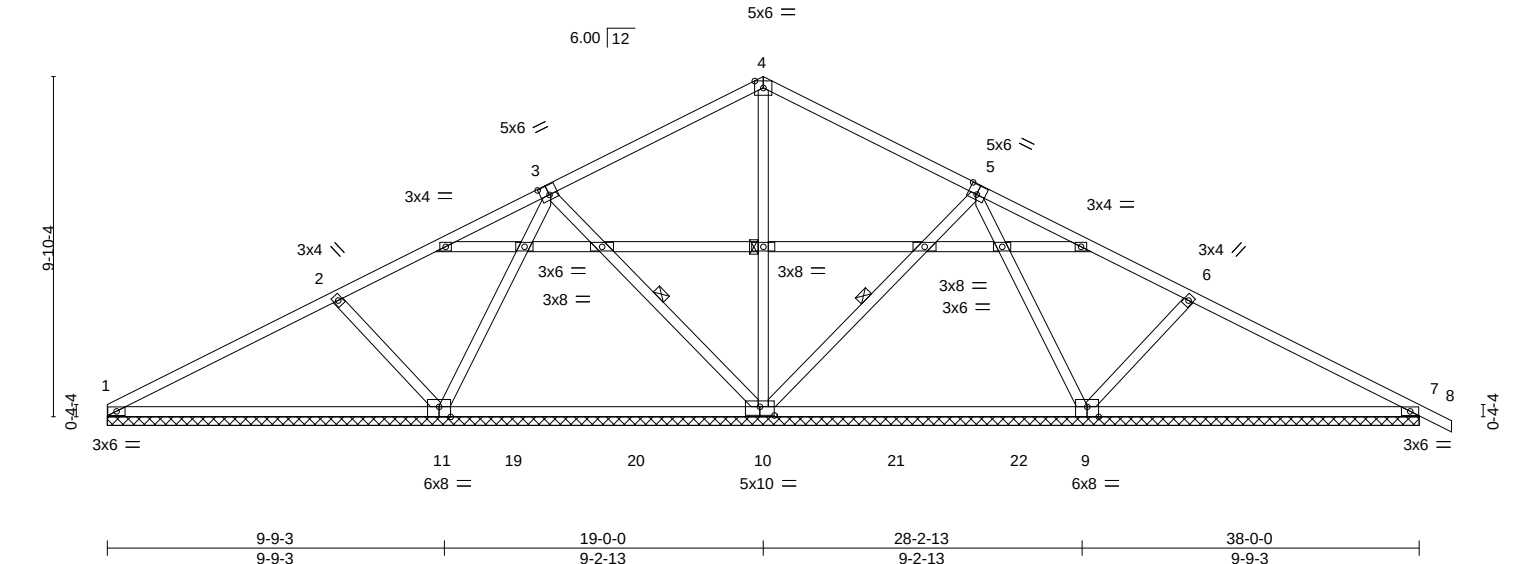


Plate Offsets (X,Y)--		[3:0-3-0,0-3-4], [5:0-3-0,0-3-4], [9:0-4-0,Edge], [10:0-5-0,0-3-0], [11:0-4-0,Edge]	
LOADING (psf)	SPACING	2-0-0	CSL
TCLL 20.0	Plate Grip DOL 1.15		TC 0.59
TCDL 10.0	Lumber DOL 1.15		BC 0.81
BCLL 0.0 *	Rep Stress Incr YES		WB 0.39
BCDL 10.0	Code IBC2021/TPI2014		Matrix-S
			DEFL. in (loc) l/defl L/d
			Vert(LL) 0.03 8 n/r 120
			Vert(CT) 0.07 8 n/r 120
			Horz(CT) 0.01 7 n/a n/a
			PLATES MT20
			GRIP 197/144
			Weight: 221 lb FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 6-0-0 oc bracing: 10-11.
1 Row at midpt 3-10, 4-10, 5-10

REACTIONS.

All bearings 38-0-0.
(lb) - Max Horz 1=-178(LC 15)
Max Uplift All uplift 100 lb or less at joint(s) 10, 7, 1 except 11=-175(LC 10), 9=-158(LC 11)
Max Grav All reactions 250 lb or less at joint(s) except 11=834(LC 23), 10=764(LC 2), 9=837(LC 24), 7=380(LC 24), 1=320(LC 23)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-11=-402/239, 3-11=-359/131, 4-10=-386/50, 5-9=-364/116, 6-9=-397/233

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 7, 1 except (jt=lb) 11=175, 9=158.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.
- Framing and bracing of the gable end frame shall be provided by the building designer.



November 9,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job ORDERS	Truss SE-18591	Truss Type COMN	Qty 1	Ply 1	10_Southeast Job Reference (optional)	I49194693
---------------	-------------------	--------------------	----------	----------	--	-----------


NVR, Frederick, MD - 21703,

8.530 s Dec 6 2021 MiTek Industries, Inc. Thu Dec 9 20:45:06 2021 Page 1

ID:TfhWPze26pZ0d7TmAocjK4zu5rq-GPNlbAATAQqGCBwerIDkKms_cb4Era55vbOMp?yAalB

-0-11-4 0-11-4	7-0-0 7-0-0	14-0-0 7-0-0	14-11-4 0-11-4
-------------------	----------------	-----------------	-------------------

Scale = 1:25.5

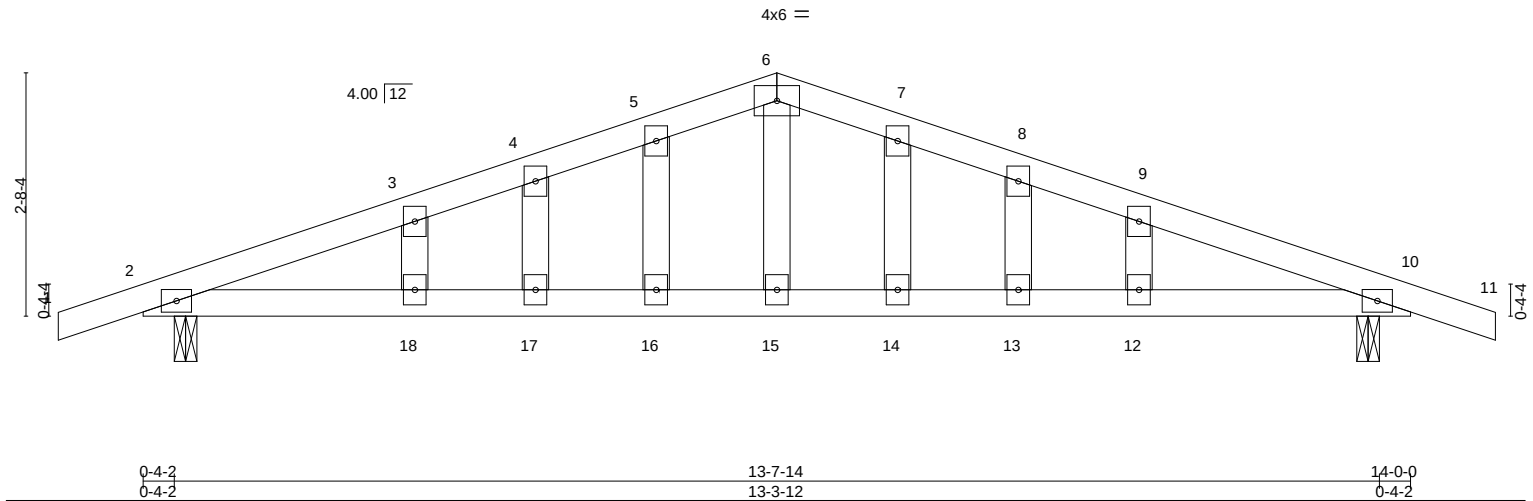

0-4-2 0-4-2	13-7-14 13-3-12	14-0-0 0-4-2
----------------	--------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.40	Vert(LL)	-0.10 12-13	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.72	Vert(CT)	-0.17 12-13	>975	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.02 10	n/a	n/a		
BCDL 10.0	Code IBC2021/TPI2014		Matrix-S	Wind(LL)	0.09 17-18	>999	240	Weight: 60 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
OTHERS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-3-6 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-0, 10=0-3-0
Max Horz 2=-45(LC 15)
Max Uplift 2=-129(LC 6), 10=-129(LC 7)
Max Grav 2=614(LC 1), 10=614(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1039/115, 3-4=-989/132, 4-5=-970/141, 5-6=-967/155, 6-7=-967/155,
7-8=-969/140, 8-9=-989/132, 9-10=-1039/115
BOT CHORD 2-18=-82/933, 17-18=-82/933, 16-17=-82/933, 15-16=-82/933, 14-15=-82/933,
13-14=-82/933, 12-13=-82/933, 10-12=-82/933
WEBS 6-15=-43/375

NOTES- (9-11)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 3x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 2 and 129 lb uplift at joint 10.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.
- Metal hangers, of any seat size, can be used in place of wood bearing, of any seat size, provided the hanger has been sized for the required maximum reaction.



January 12, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	02_Valley
ORDERS	VT-95510	VCOM	1	1	Job Reference (optional)

I47779321

NVR, Frederick, MD - 21703,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 6 05:29:14 2021 Page 1

ID:v6Z6pgbJ9MBbXVTJcHb?unyGd2m-pdTH53gv6durCw64m7kYi2txuudo6uUeX5HATmygS23



Scale = 1:11.1

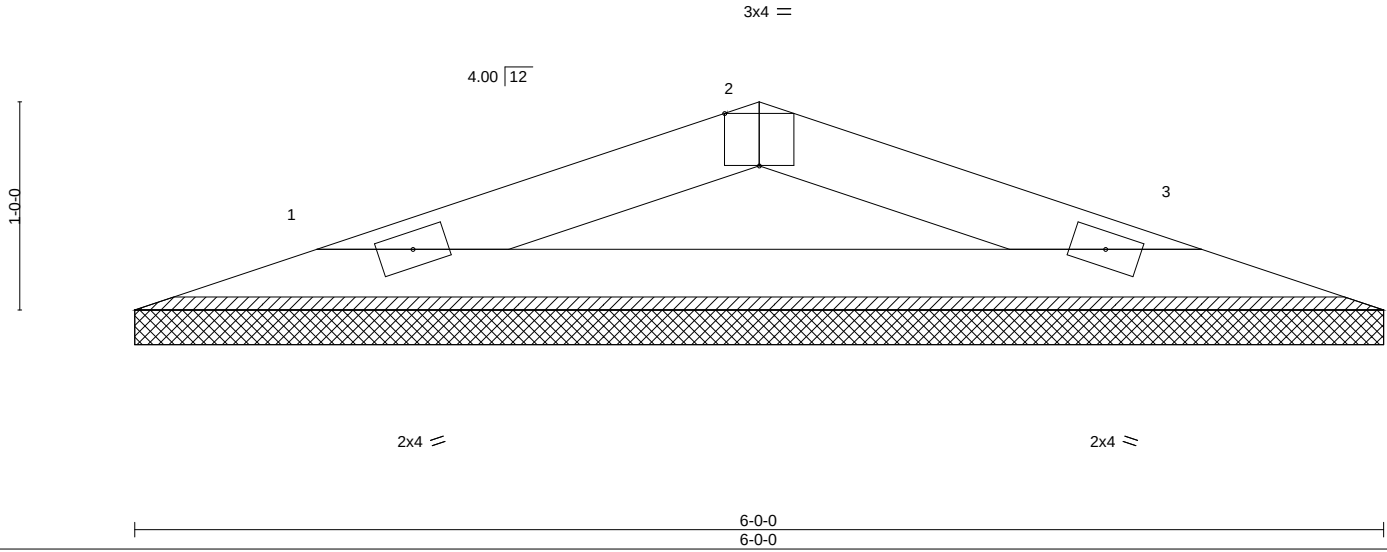


Plate Offsets (X,Y)-- [2:0-2-0,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	n/a	-	n/a	999	MT20	197/144
(Roof Snow=30.0)	Lumber DOL	1.15	BC 0.38	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCLL 0.0	Code IBC2021/TPI2014		Matrix-P						Weight: 16 lb	FT = 5%
BCDL 10.0										

LUMBER-

TOP CHORD 2x4 SP No.3 or 2x4 SPF Stud
 BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-0-0, 3=6-0-0
 Max Horz 1=-16(LC 13)
 Max Uplift 1=-51(LC 8), 3=-51(LC 9)
 Max Grav 1=224(LC 18), 3=224(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-287/114, 2-3=-287/114
 BOT CHORD 1-3=-93/252

NOTES- (7-8)

- 1) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCCL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 7) Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- 8) Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.



September 16, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	02_Valley
ORDERS	VT-95511	VCOM	1	1	Job Reference (optional)


I47779322

NVR, Frederick, MD - 21703,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 6 05:29:15 2021 Page 1
ID:v6Z6pgbJ9MBbXVTJcHb?unyGd2m-Hp0fIPgXtx0iq4gGKrFnFFP_zlzLrKEoml0k?CygS22

6-0-0	12-0-0
6-0-0	6-0-0

Scale = 1:18.9

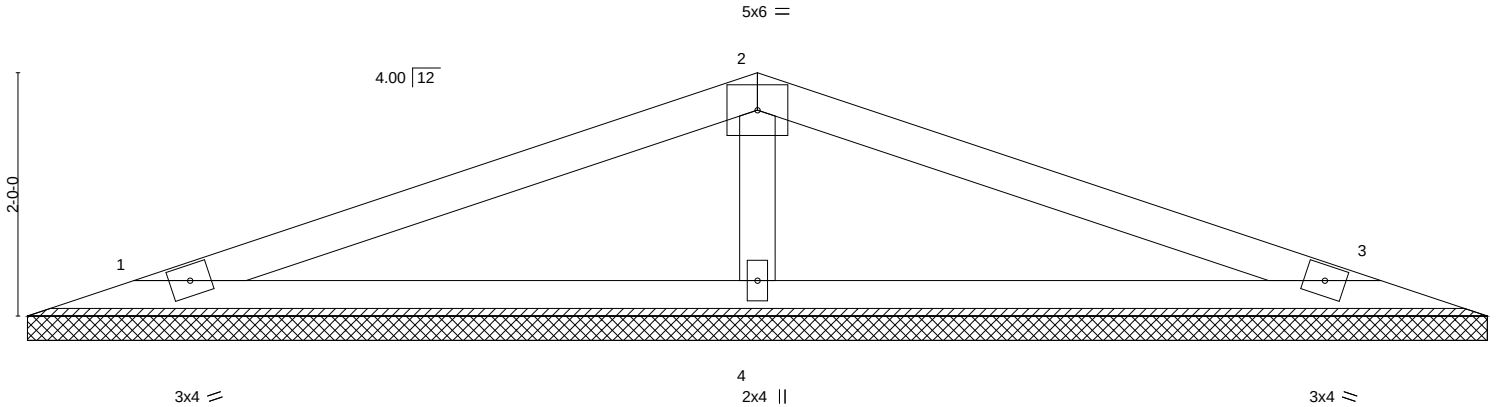

6-0-0		12-0-0	
6-0-0		6-0-0	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 30.0	2-0-0	TC 0.71	in (loc) l/defl L/d
(Roof Snow=30.0)	Plate Grip DOL 1.15	BC 0.43	Vert(LL) n/a - n/a 999
TCDL 10.0	Lumber DOL 1.15	WB 0.10	Vert(CT) n/a - n/a 999
BCLL 0.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 3 n/a n/a
BCDL 10.0	Code IBC2021/TPI2014		
		PLATES	GRIP
		MT20	197/144
		Weight: 36 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud
 WEBS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=12-0-0, 3=12-0-0, 4=12-0-0
 Max Horz 1=-39(LC 13)
 Max Uplift 1=-71(LC 8), 3=-76(LC 13), 4=-105(LC 8)
 Max Grav 1=310(LC 18), 3=310(LC 19), 4=580(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-4=-426/162

NOTES- (7-8)

- 1) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=33ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3 except (jt=lb) 4=105.
- 7) Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust), wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 115 mph.
- 8) Design checked for ASCE 7-16 ultimate wind speed at 130 mph (3-second gust) meets or exceeds IRC2012 nominal wind speed of 100 mph, wind reaction x 0.78 will adjust wind uplift reaction to a wind speed of 90 mph.



September 16, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	02_Valley	154705066
ORDERS	VT-00861	VCOM	1	1	Job Reference (optional)	

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Oct 13 12:35:37 2022 Page 1
ID:hwgfhqLuldM7W6Kxo5rjJByUXxn-tl0UVwpW5nlQcYixzK5McV9S1Qbd2s7Y0umzOByTqEK

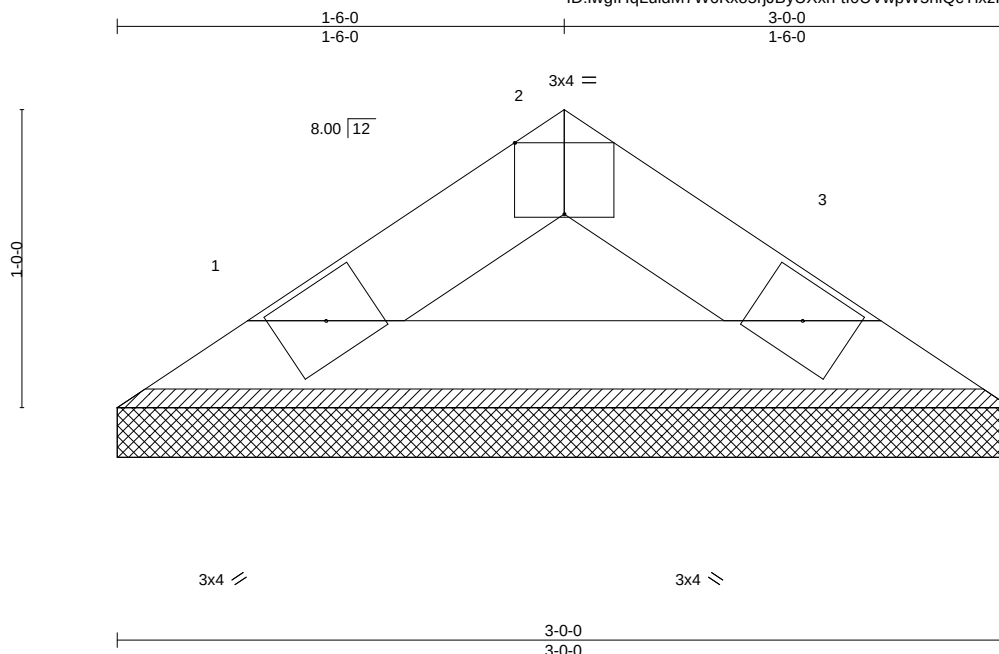

Scale = 1:7.7

Plate Offsets (X,Y)-- [2:0-2-0,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
(Roof Snow=30.0)	Lumber DOL	1.15	BC 0.08	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCLL 0.0	Code IBC2021/TPI2014		Matrix-P						Weight: 8 lb	FT = 5%
BCDL 10.0										

LUMBER-

TOP CHORD 2x4 SP No.3 or 2x4 SPF Stud
BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=3-0-0, 3=3-0-0
Max Horz 1=23(LC 11)
Max Uplift 1=-22(LC 12), 3=-22(LC 13)
Max Grav 1=108(LC 18), 3=108(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



October 13, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	02_Valley	154705067
ORDERS	VT-00862	VCOM	1	1	Job Reference (optional)	

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Oct 13 12:35:38 2022 Page 1

ID:D6E1UAMWWxU_8Gv8MpMysOyUXxm-LVatjFp8s4tHdH7X2cb9ihYkpqYnJNiFYVWwdyTqEJ

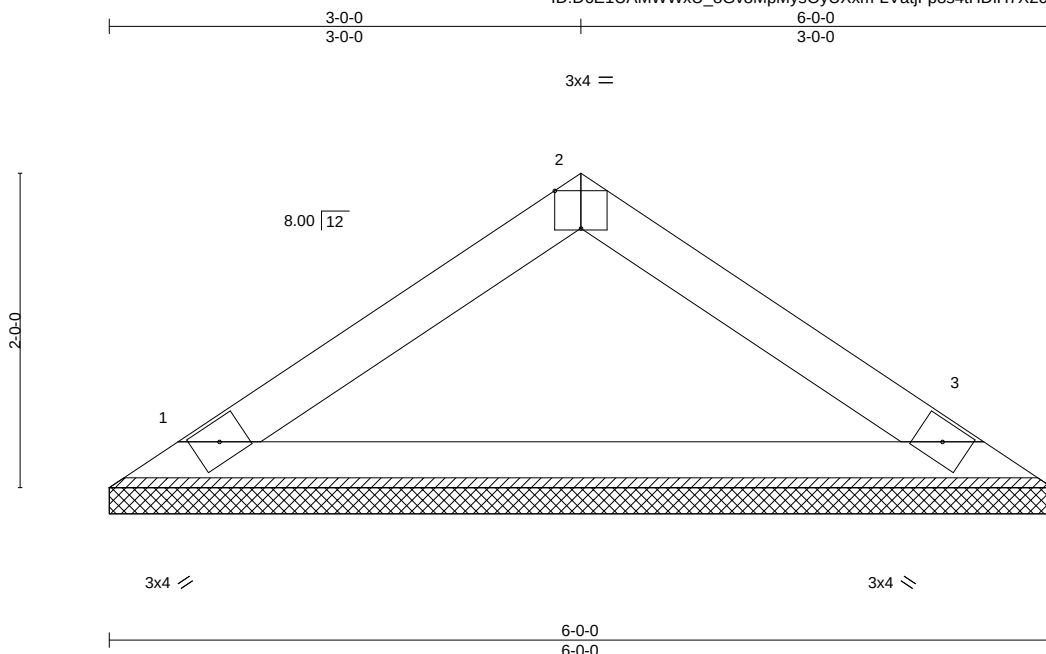

Scale = 1:14.7

Plate Offsets (X,Y)--		[2:0-2-0,Edge]													
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in	(loc)	l/defl	L/d		PLATES	GRIP		
TCLL 30.0		Plate Grip DOL	1.15	TC 0.41		Vert(LL)	n/a	-	n/a	999		MT20	197/144		
(Roof Snow=30.0)		Lumber DOL	1.15	BC 0.55		Vert(CT)	n/a	-	n/a	999					
TCDL 10.0		Rep Stress Incr	YES	WB 0.00		Horz(CT)	0.00	3	n/a	n/a					
BCLL 0.0		Code IBC2021/TPI2014		Matrix-P											
BCDL 10.0												Weight: 18 lb	FT = 5%		

LUMBER-

TOP CHORD 2x4 SP No.3 or 2x4 SPF Stud
BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-0-0, 3=6-0-0
Max Horz 1=58(LC 9)
Max Uplift 1=-54(LC 12), 3=-54(LC 13)
Max Grav 1=292(LC 18), 3=292(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



October 13,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	02_Valley	154705068
ORDERS	VT-00863	VCOM	1	1	Job Reference (optional)	

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Oct 13 12:35:39 2022 Page 1
ID:hJoPiVN8HEcmQUKwWtBOcyUXxl-ph8FwbqmdO?8rsrK5i7rhWEfiDE1WlarUCF3T3yTqEI

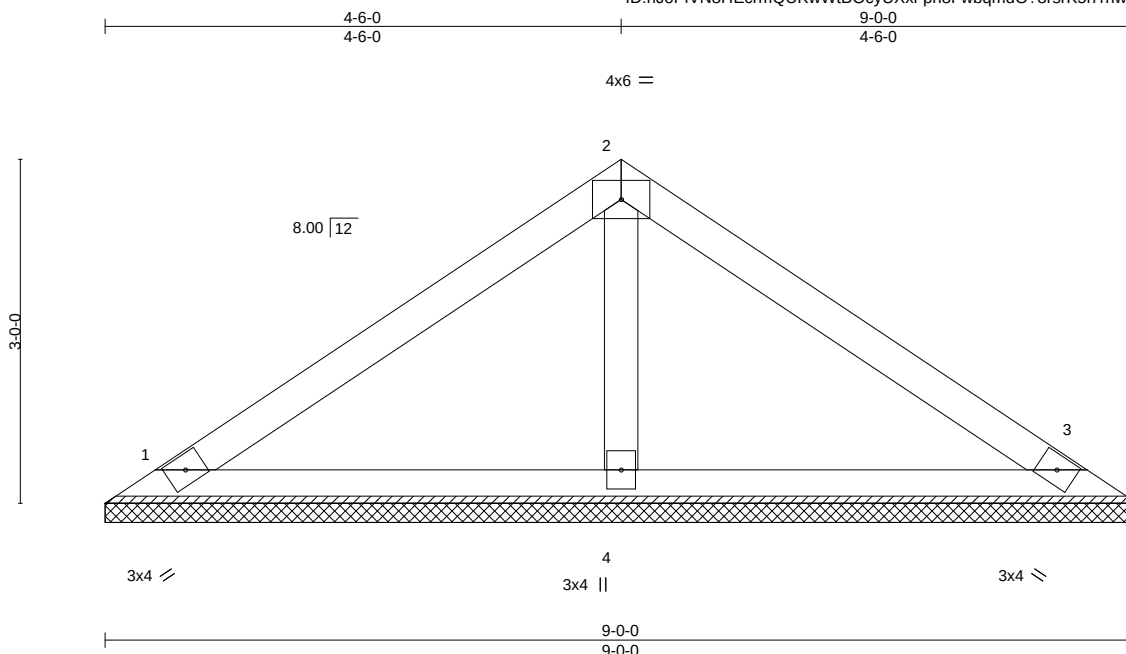

Scale = 1:20.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0 (Roof Snow=30.0)	Plate Grip DOL	1.15	TC 0.65	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	n/a	-	n/a	999	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code IBC2021/TPI2014		Matrix-S						
								Weight: 31 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud
OTHERS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.

(size) 1=9'-0", 3=9'-0", 4=9'-0"
Max Horz 1=-92(LC 8)
Max Uplift 1=-73(LC 12), 3=-86(LC 13), 4=-27(LC 12)
Max Grav 1=312(LC 18), 3=312(LC 19), 4=364(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-264/218

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.



October 13, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	02_Valley	154705069
ORDERS	VT-00864	VCOM	1	1	Job Reference (optional)	

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Oct 13 12:35:40 2022 Page 1
ID:9VMovrOm2YkhOZ3WUEOQxpyUXxk-Hthd8xrPOi7?T0QWeTe4E7nqadbLFCu?is_d?WyTqEH

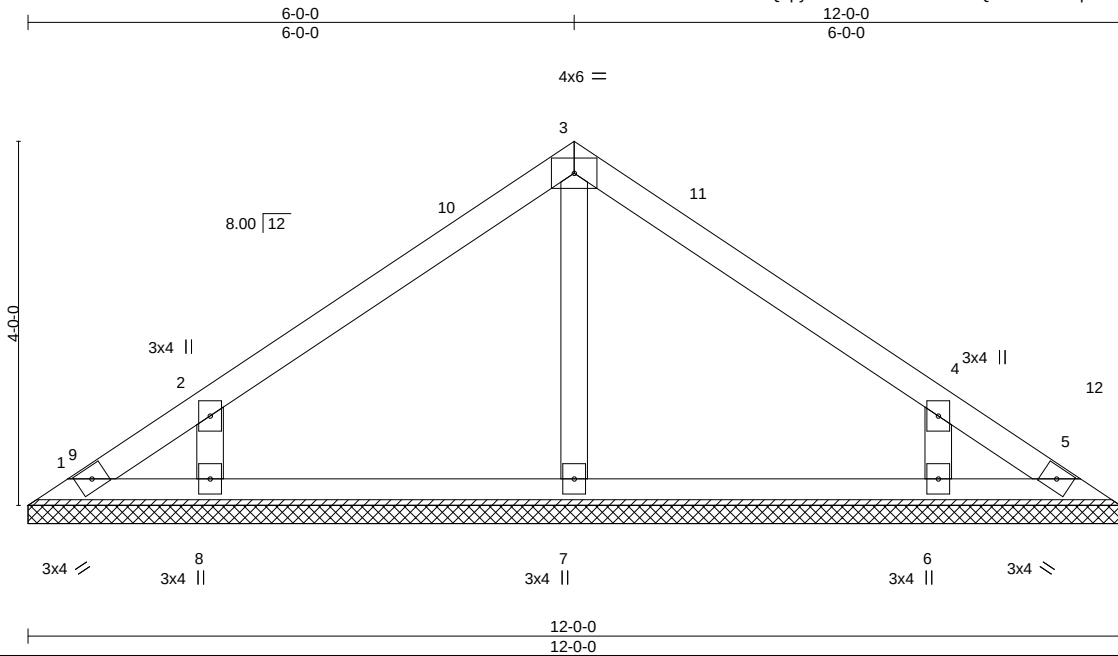

Scale = 1:25.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.64	Vert(LL)	n/a	-	n/a	999	MT20	197/144
(Roof Snow=30.0)	Lumber DOL	1.15	BC 0.21	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.00	5	n/a	n/a		
BCLL 0.0	Code IBC2021/TPI2014		Matrix-S						Weight: 45 lb	FT = 5%
BCDL 10.0										

LUMBER-

TOP CHORD 2x4 SP No.3 or 2x4 SPF Stud
BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud
OTHERS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.

All bearings 12-0-0.

(lb) - Max Horz 1=-127(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=-210(LC 12), 6=-209(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=341(LC 19), 8=561(LC 18), 6=561(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-7=-255/83, 2-8=-507/413, 4-6=-507/413

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-5-12 to 4-10-8, Corner(3R) 4-10-8 to 7-1-8, Corner(3E) 7-1-8 to 11-6-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=210, 6=209.



October 13, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	02_Valley	154705070
ORDERS	VT-00865	VCOM	1	1	Job Reference (optional)	

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Oct 13 12:35:41 2022 Page 1
ID:dhwA6BPOpssY?dj1xvfT1yUXxj-l4F?LHs19?Fs4A?iCA9JnLJ?D1yq_fd8xWkAXyyTqEG

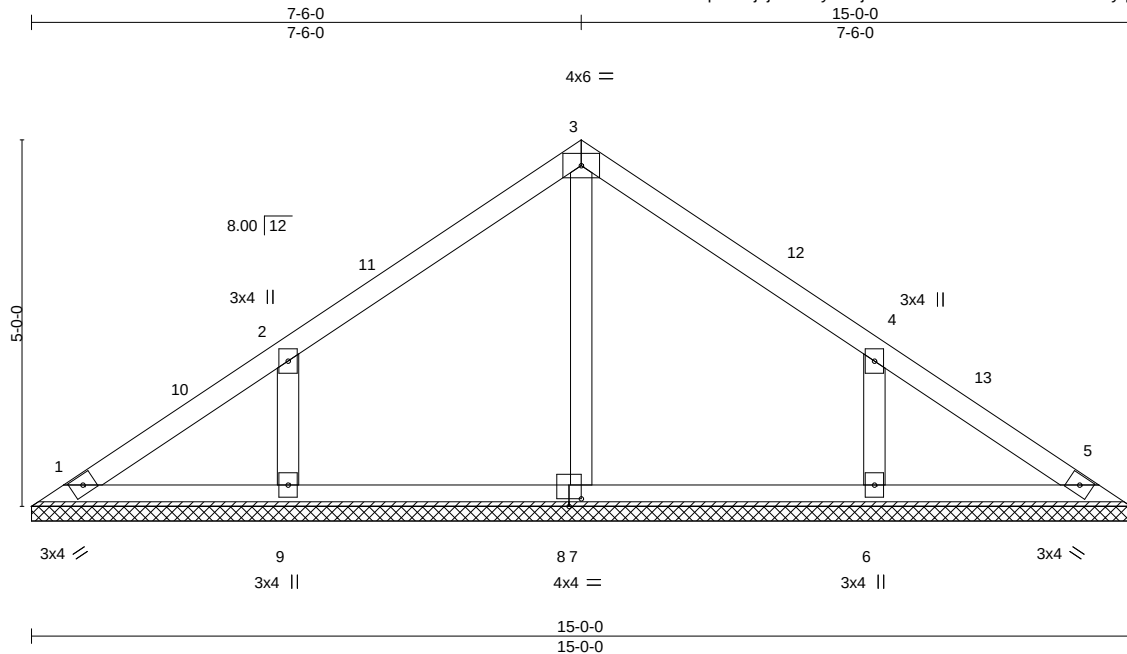

Scale = 1:31.4

Plate Offsets (X,Y)-- [8:0-2-0,0-1-4]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	
TCLL 30.0		Plate Grip DOL	1.15	TC 0.65	in (loc)	l/defl	L/d
(Roof Snow=30.0)		Lumber DOL	1.15	BC 0.19	n/a -	n/a	999
TCDL 10.0		Rep Stress Incr	YES	WB 0.12	Vert(CT)	n/a -	n/a
BCLL 0.0		Code IBC2021/TPI2014		Matrix-S	Horz(CT)	0.00 5	n/a
BCDL 10.0							
						PLATES	GRIP
						MT20	197/144
						Weight: 59 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.3 or 2x4 SPF Stud
BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud
OTHERS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 15-0-0.

(lb) - Max Horz 1=-161(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 9=-230(LC 12), 6=-230(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=334(LC 18), 9=592(LC 18), 6=592(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-7=-254/22, 2-9=-512/383, 4-6=-512/383

NOTES-

(7)

- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-5-12 to 4-10-8, Corner(3R) 4-10-8 to 10-1-8, Corner(3E) 10-1-8 to 14-6-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 9=230, 6=230.



October 13,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	02_Valley	154705071
ORDERS	VT-00866	VCOM	1	1	Job Reference (optional)	

NVR, Frederick, MD - 21703,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Oct 13 12:35:42 2022 Page 1
ID:dhwA6BPOpssY?jdj1xvfT1yUXxj-DGpNZdsfwJNjiKaumtgYJYs8ERGIj5tHAATk4OyTqEF

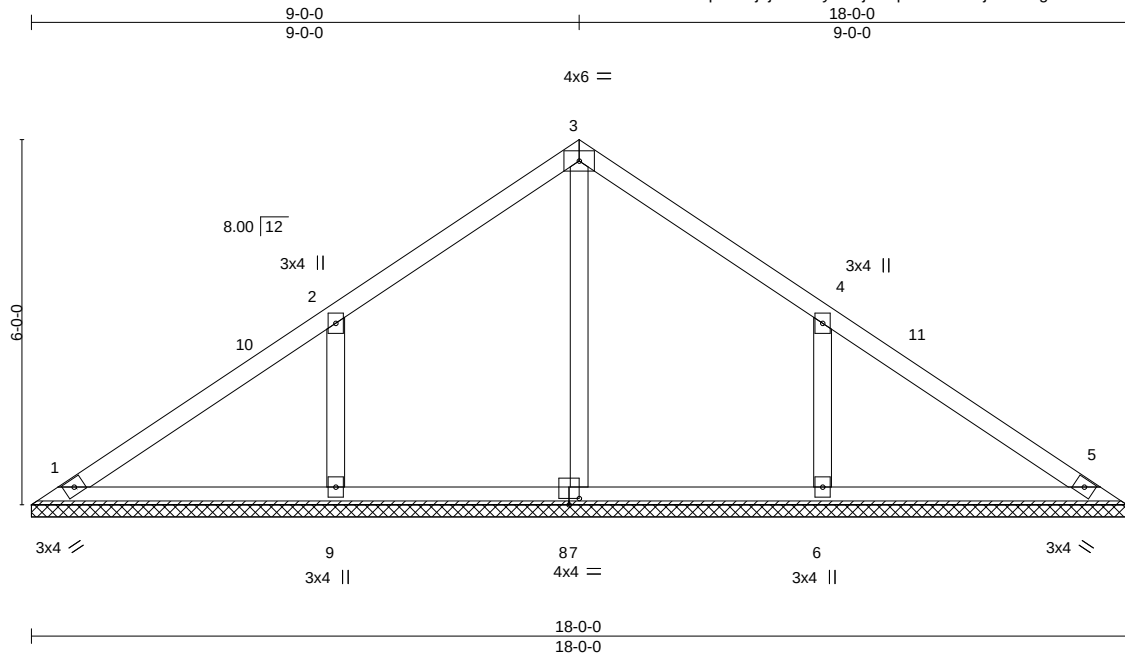

Scale = 1:37.9

Plate Offsets (X,Y)-- [8:0-2-0,0-1-4]							
LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d
TCLL 30.0	2-0-0	TC 0.82	Vert(LL)	n/a	-	n/a	999
(Roof Snow=30.0)	Plate Grip DOL 1.15	BC 0.28	Vert(CT)	n/a	-	n/a	999
TCDL 10.0	Lumber DOL 1.15	WB 0.16	Horz(CT)	0.00	5	n/a	n/a
BCLL 0.0	Rep Stress Incr YES	Matrix-S					
BCDL 10.0	Code IBC2021/TPI2014						
						PLATES	GRIP
						MT20	197/144
						Weight: 74 lb	FT = 5%

LUMBER-

TOP CHORD 2x4 SP No.3 or 2x4 SPF Stud
BOT CHORD 2x4 SP No.3 or 2x4 SPF Stud
OTHERS 2x4 SP No.3 or 2x4 SPF Stud

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.

All bearings 18'-0".

(lb) - Max Horz 1=195(LC 11)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 9=281(LC 12), 6=281(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=300(LC 18), 9=686(LC 18), 6=686(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-9=-576/406, 4-6=-576/406

NOTES-

- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-5-12 to 5-0-0, Corner(3R) 5-0-0 to 13-0-0, Corner(3E) 13-0-0 to 17-6-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pf=30.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 9=281, 6=281.



October 13,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932